

# 1966

## THE MARGATE II (SIDING)

### FLORIDA SERIES

PAD SIZE: 40' X 65'

**SHEET INDEX:**

- 00 COVER SHEET
- 01AB FOUNDATION PLAN 'A'
- 02AB FLOOR PLAN W/ DIMENSIONS 'A'
- 03AB FLOOR PLAN W/ NOTES 'A'
- 04A EXTER. ELEVATION 'A'- FRONT & REAR
- 05A EXTER. ELEVATION 'A'- LEFT & RIGHT
- 06 CROSS SECTION / INTERIOR ELEVATIONS
- 07AB ELECTRICAL PLAN
- 08A TRUSS LAYOUT 'A'
- 09AB PRE-CAST LINTEL LAYOUT- 'A'
- 10 TYPICAL DETAILS
- 11 TYPICAL DETAILS
- D1 TYPICAL STRUCTURAL DETAILS
- D2 TYPICAL STRUCTURAL DETAILS
- D3 TYPICAL STRUCTURAL DETAILS

\* ADD .3 FOR 3-CAR GARAGE OPTION

**SHEET INDEX:**

- 00 COVER SHEET
- 01AB FOUNDATION PLAN 'B'
- 02AB FLOOR PLAN W/ DIMENSIONS 'B'
- 03AB FLOOR PLAN W/ NOTES 'B'
- 04B EXTER. ELEVATION 'B'- FRONT & REAR
- 05B EXTER. ELEVATION 'B'- LEFT & RIGHT
- 06 CROSS SECTION / INTERIOR ELEVATIONS
- 07AB ELECTRICAL PLAN
- 08B TRUSS LAYOUT 'B'
- 09AB PRE-CAST LINTEL LAYOUT- 'B'
- 10 TYPICAL DETAILS
- 11 TYPICAL DETAILS
- D1 TYPICAL STRUCTURAL DETAILS
- D2 TYPICAL STRUCTURAL DETAILS
- D3 TYPICAL STRUCTURAL DETAILS

\* ADD .3 FOR 3-CAR GARAGE OPTION

**SHEET INDEX:**

- 00 COVER SHEET
- 01C FOUNDATION PLAN 'C'
- 02C FLOOR PLAN W/ DIMENSIONS 'C'
- 03C FLOOR PLAN W/ NOTES 'C'
- 04C EXTER. ELEVATION 'C'- FRONT & REAR
- 05C EXTER. ELEVATION 'C'- LEFT & RIGHT
- 06 CROSS SECTION / INTERIOR ELEVATIONS
- 07C ELECTRICAL PLAN
- 08C TRUSS LAYOUT 'C'
- 09C PRE-CAST LINTEL LAYOUT- 'C'
- 10 TYPICAL DETAILS
- 11 TYPICAL DETAILS
- D1 TYPICAL STRUCTURAL DETAILS
- D2 TYPICAL STRUCTURAL DETAILS
- D3 TYPICAL STRUCTURAL DETAILS

\* ADD .3 FOR 3-CAR GARAGE OPTION

REVISION SCHEDULE			
NO.	DATE	DESCRIPTION	BY
1	12/22/17	UPDATE TO 2017 CODE	MW
2	05/03/18	-ADDED OPT. GAREGE SERVICE DOOR	AN
3	11/28/18	-DELETE MASTER BR. NICHE & CHANGE ALL INTERIOR ARCHES TO FLAT SOFFITS	MW
4	02/15/19	-ADDED 2019 PLAN FEET CHANGES	MW
5	05-16-19	-ADDED NEW A,B,C SIDING ELEVATIONS	JF
6	07-08-19	-REVISE ENTRY FLOORING	MW
7	01-05-21	-UPDATE TO 2020 CODE	JN
8	06-10-21	-ADD 2x6 WALL IN LAUNDRY ROOM	JN
9	08-05-21	-ADD FRONT ENTRY SECTION	JN
10	10/05/23	- DELETE INTERIOR DOORS HT	JN
11	01/04/24	- 2023 CODE UPDATE - ELEV A, B & C	JN
12	05/24/24	- ADD ON-Q PANEL	JN
13	06/25/24	- ADD EXTERNEDED FOYER & MOVE GARAGE WALL 2' FORWARD	JN

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME 1966 MARGATE II

FLORIDA SERIES

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET

00

OF 00 SHEETS

REVISIONS

NO.	DATE	BY
05-16-19		JF

ITEC

THOMPSON ENGINEERING GROUP, INC.

10000 W. Colonial Ave., Suite 200

Orlando, Florida 32811

Phone: (407) 734-1790

www.itec.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.


5200 Vineland Road, Suite 200

Orlando, Florida 32811




Phone: (407) 529-3000

Park Square HOMES



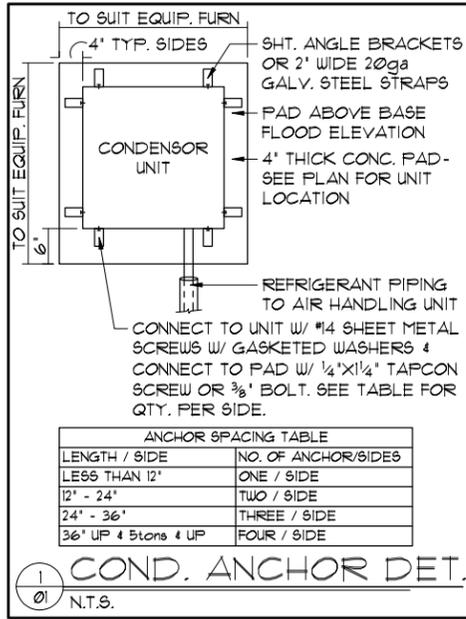

- ### FOUNDATION NOTES
- CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
  - DENOTES FILL CELL REINF. W/ CONC. W/ (1) #5 REBAR GRADE 60
  - DENOTES FILL CELL REINF. W/ CONC. W/ (2) #5 REBAR GRADE 60
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATER AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR WATER HEATER SHALL HAVE APPROVED THERMAL EXPANSION DEVICE.
  - DENOTES FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6X6 10/10 GAUGE REINFORCING MAT. WITH MIN. 1" COVER TERMITE TREATED SOIL WITH 2006mm (6 mil) POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. WVF SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS ALTERNATIVE TO WIRE MESH.
  - PAVERS MAY BE USED ILO CONCRETE SLABS IN PATIO, PORCH, DRIVE AND WALKWAY AREAS. DELETE SLAB IN AREAS PAVERS ARE USED.
  - ~~● STANDARD FOOTING~~ NOT USED  
~~○ ALTERNATE FOOTING~~
  - MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
  - IN LIEU OF TREATING THE SOIL, AN ALTERNATIVE TO TERMITE TREATED SOIL CAN BE TERMICIDE.
  - BORA-CARE TO BE APPLIED ON INTERIOR WALLS IAW MANUFACTURER'S INSTRUCTIONS AND SPECIFICATIONS, PURSUANT TO CH.402 FLORIDA BUILDING CODE.

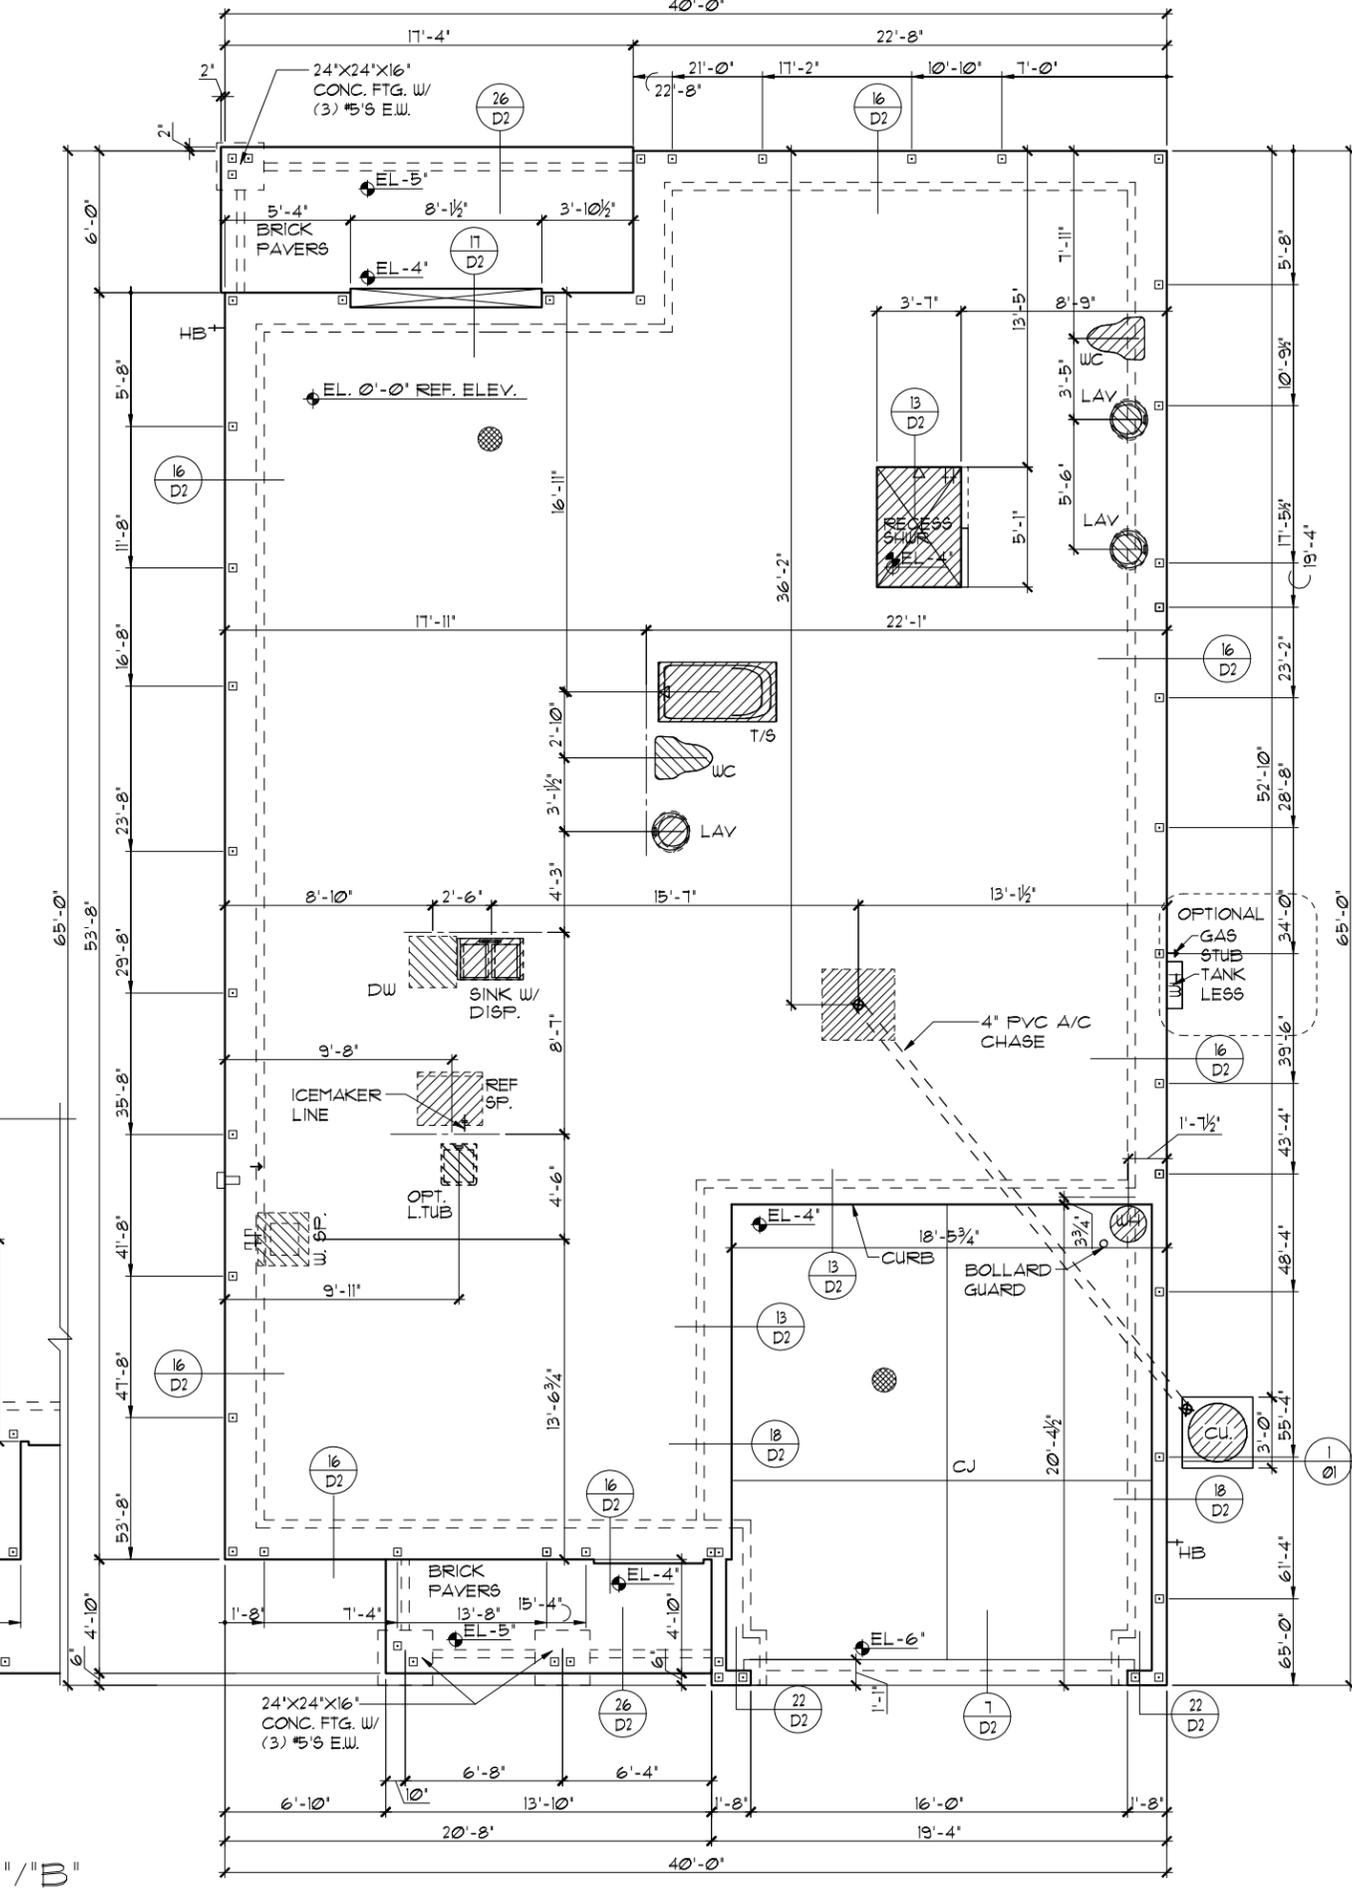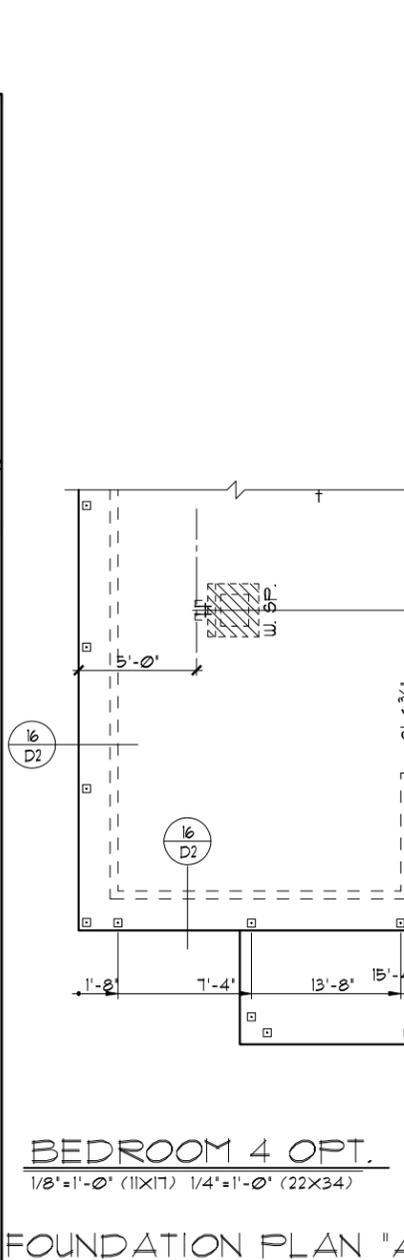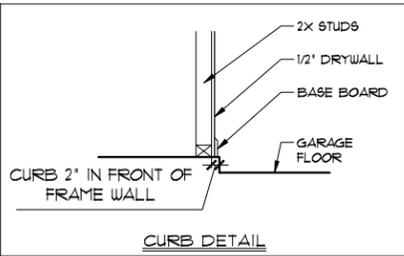









TABULATION	
TOTAL LIVING	1,974 SF.
GARAGE	385 SF.
ENTRY PORCH	90 SF.
LANAI	104 SF.
TOTAL UNDER ROOF	2,553 SF.
OPT. 3-CAR GARAGE	203 SF.
TOTAL UNDER ROOF	2,756 SF.

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
  - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
  - PULL ALL DIMENSIONS FROM THE REAR OF PLAN.

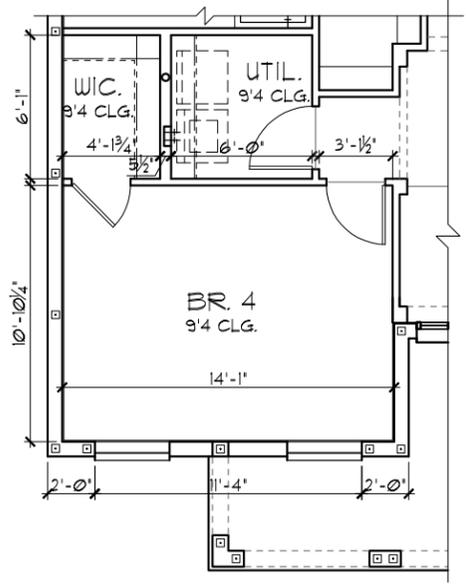

**FLOOR PLAN W/ DIMENSIONS "A"/"B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

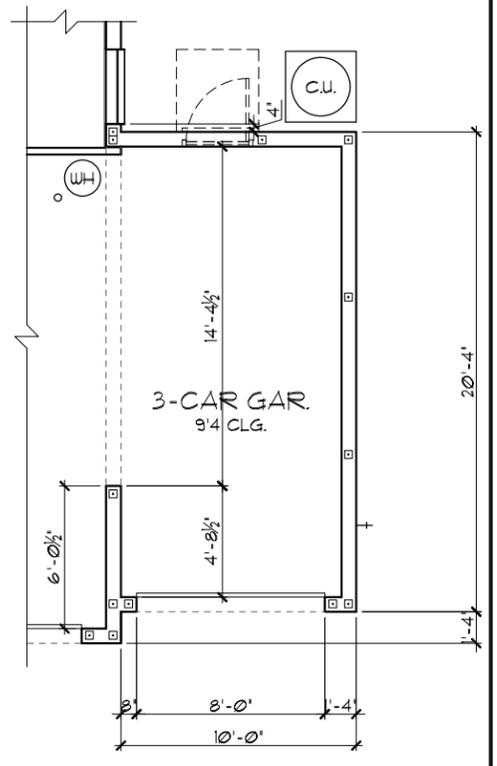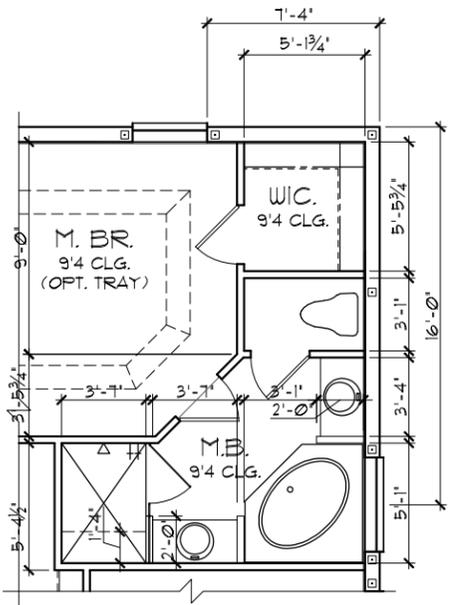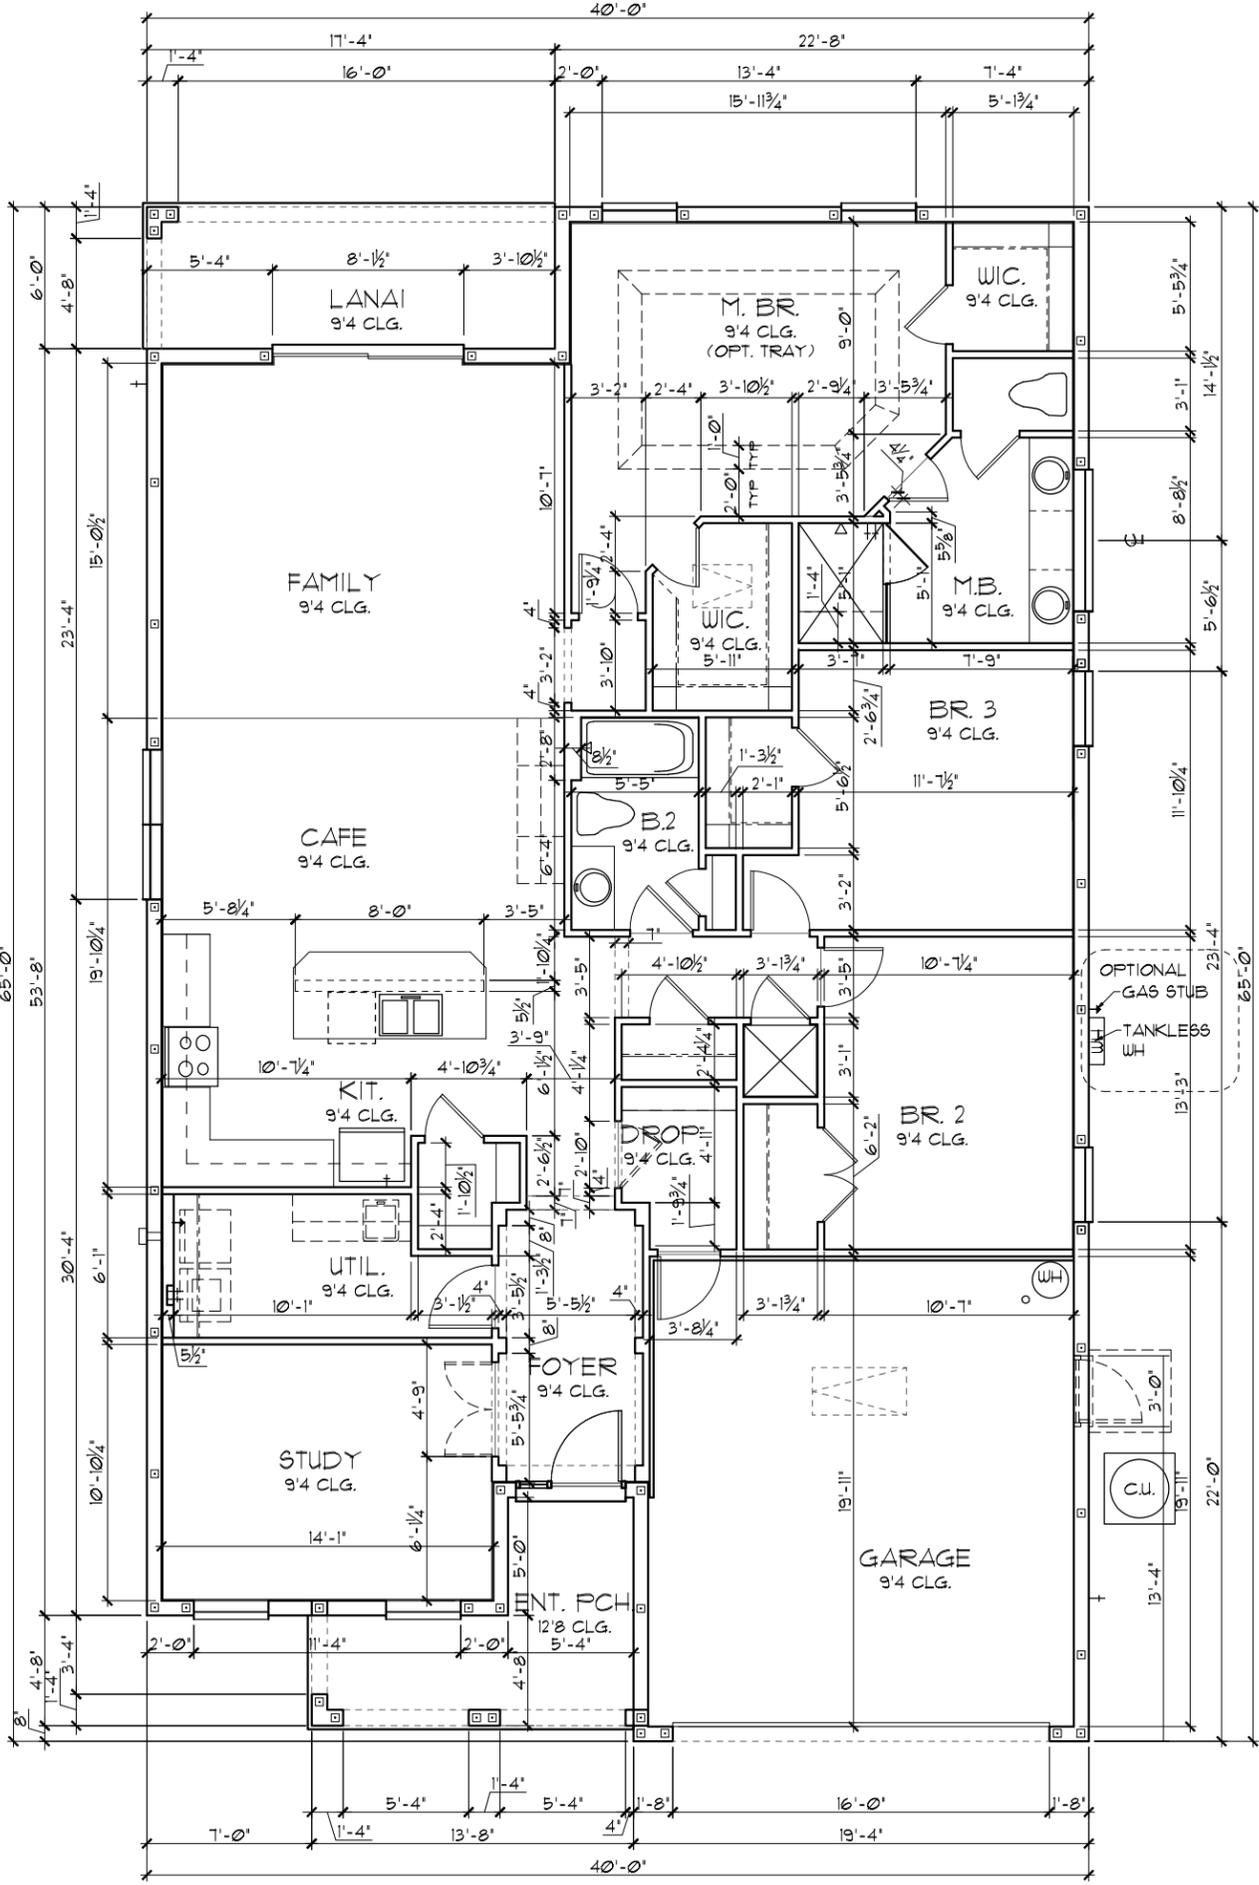

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: **FLORIDA SERIES**

1966  
MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
02AB0  
OF 00 SHEETS

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529 - 3000


**ITEG**  
HARRISON ENGINEERING GROUP, INC.  
10000 South Orange Avenue, Suite 100  
Orlando, FL 32837  
Tel: (407) 734-1400  
Fax: (407) 734-1700  
www.iteg.com

REVISIONS BY  
05-16-19 JF

THIS PLAN AND DESIGN ARE NOT TO BE COPIED OR REPRODUCED IN ANY MANNER WITHOUT THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.



TABULATION	
TOTAL LIVING	2,000 SF.
GARAGE	385 SF.
ENTRY PORCH	64 SF.
LANAI	104 SF.
TOTAL UNDER ROOF	2,553 SF.
OPT. 3-CAR GARAGE	203 SF.
TOTAL UNDER ROOF	2,756 SF.

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
  - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
  - FULL ALL DIMENSIONS FROM THE REAR OF PLAN.

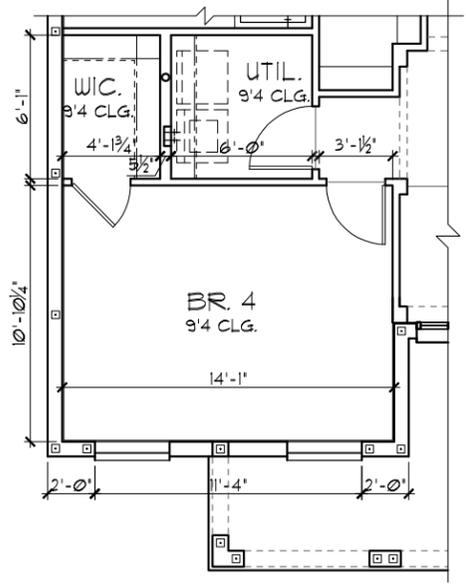


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**FLOOR PLAN W/ DIMENSIONS "A"/"B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

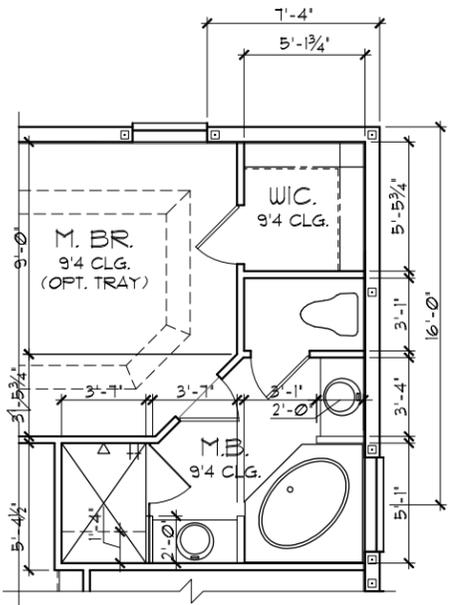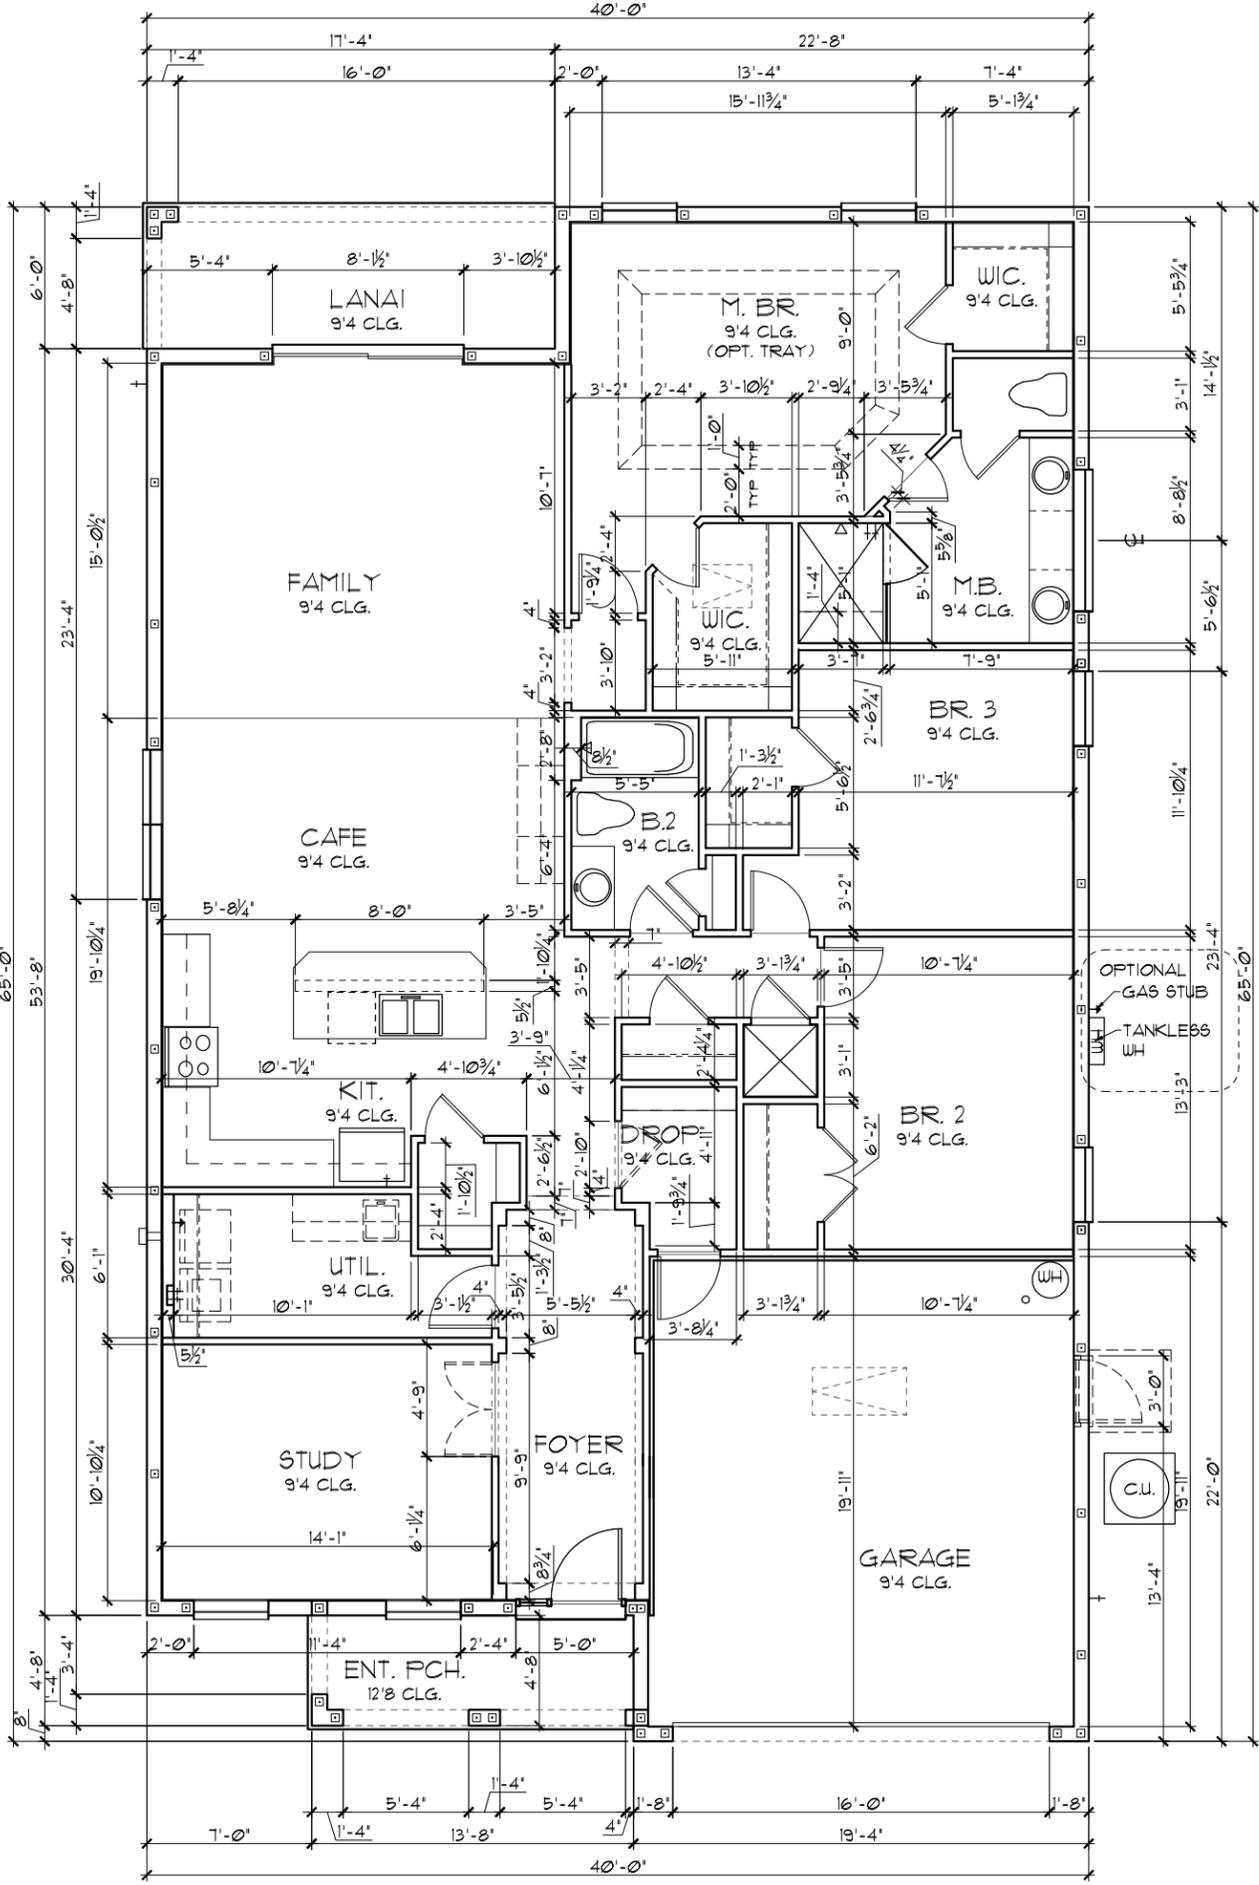

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

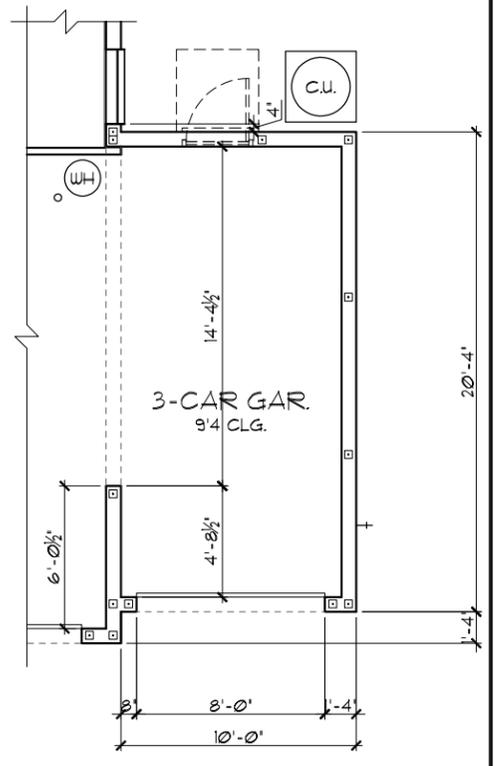

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**FLORIDA SERIES**

**LOT: 0000, COMMUNITY NAME**

**1966**

**MARGATE II**

REVISIONS	BY
05-16-19	JF

**ITEG**  
HARRISON ENGINEERING GROUP, INC.  
10000 WINDY HOLLOW ROAD, SUITE 200  
ORLANDO, FLORIDA 32811  
TEL: (407) 734-1400  
FAX: (407) 734-1790  
WWW.ITEG.COM


**Park Square HOMES**

**FLOOR PLAN W/ DIMENSIONS EXTENDED FOYER**




DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
**02AB.0**  
OF 00 SHEETS

TABULATION	
TOTAL LIVING	1,914 SF.
GARAGE	385 SF.
ENTRY PORCH	90 SF.
LANAI	104 SF.
TOTAL UNDER ROOF	2,553 SF.
OPT. 3-CAR GARAGE	203 SF.
TOTAL UNDER ROOF	2,756 SF.

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
  - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
  - FULL ALL DIMENSIONS FROM THE REAR OF PLAN.

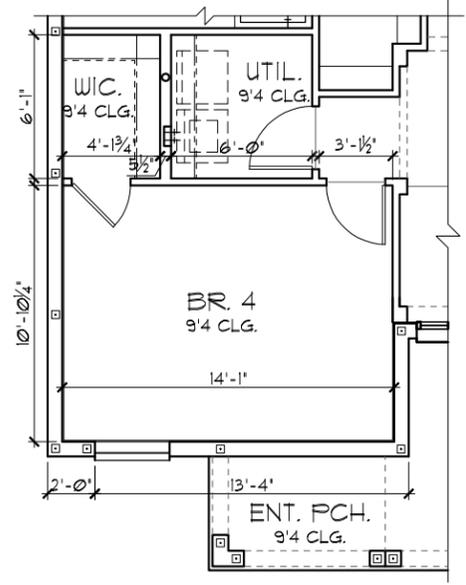

**FLOOR PLAN W/ DIMENSIONS "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

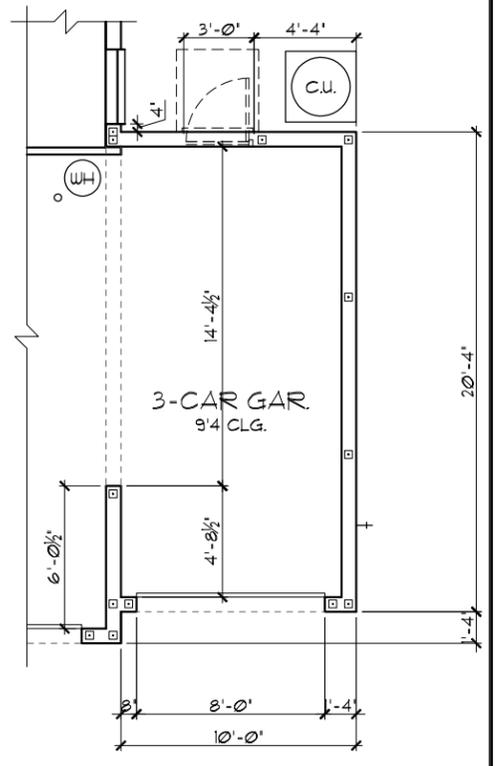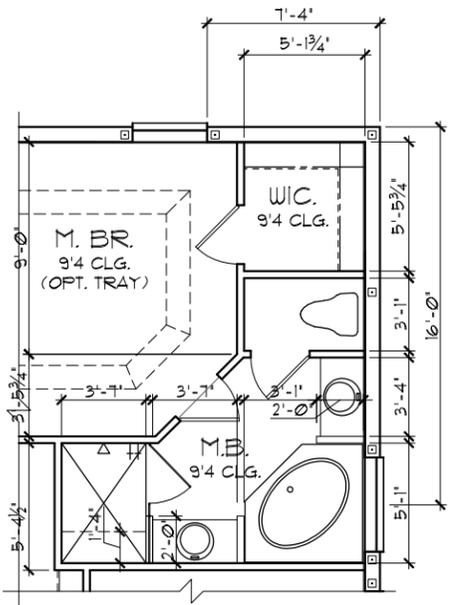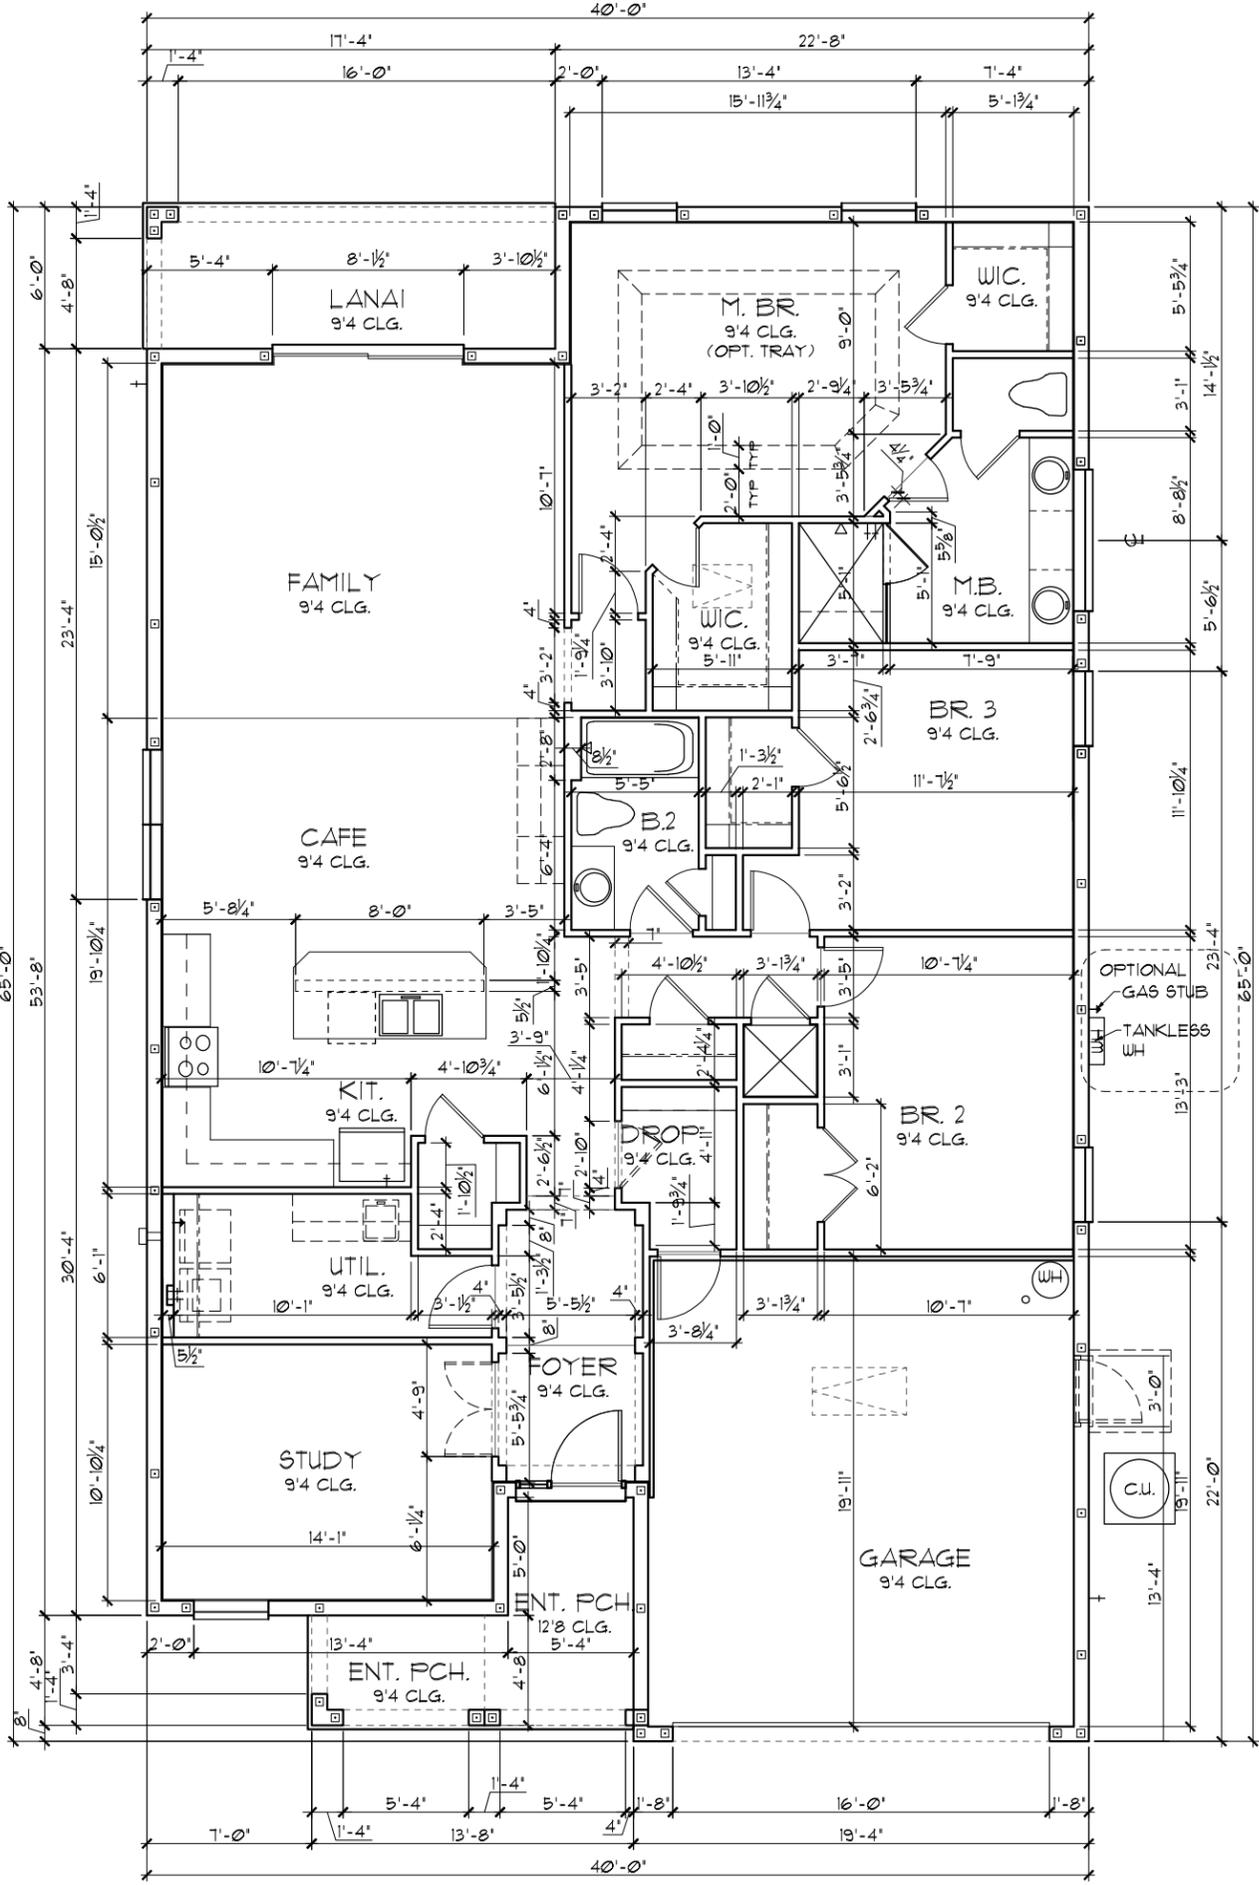

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: **FLORIDA SERIES**


A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000  
**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 10000 Lake Nona Blvd., Suite 100  
 Orlando, FL 32826  
 Tel: (407) 724-1400  
 Fax: (407) 724-1700  
 www.iteg.com

REVISIONS	BY
05-16-19	JF

**Park Square HOMES**  
 FLOOR PLAN W/ DIMENSIONS  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
**02C.0**  
 OF 00 SHEETS



TABULATION	
TOTAL LIVING	2,000 SF.
GARAGE	385 SF.
ENTRY PORCH	64 SF.
LANAI	104 SF.
TOTAL UNDER ROOF	2,553 SF.
OPT. 3-CAR GARAGE	203 SF.
TOTAL UNDER ROOF	2,756 SF.

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
  - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
  - FULL ALL DIMENSIONS FROM THE REAR OF PLAN.

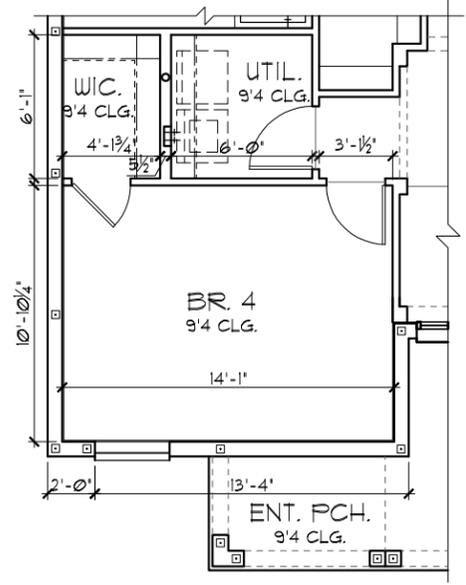


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**FLOOR PLAN W/ DIMENSIONS "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

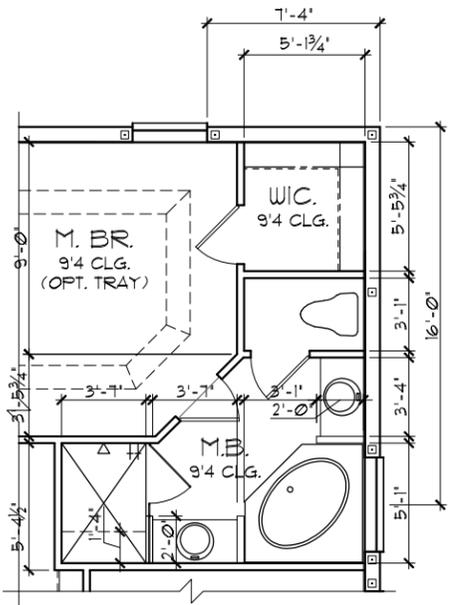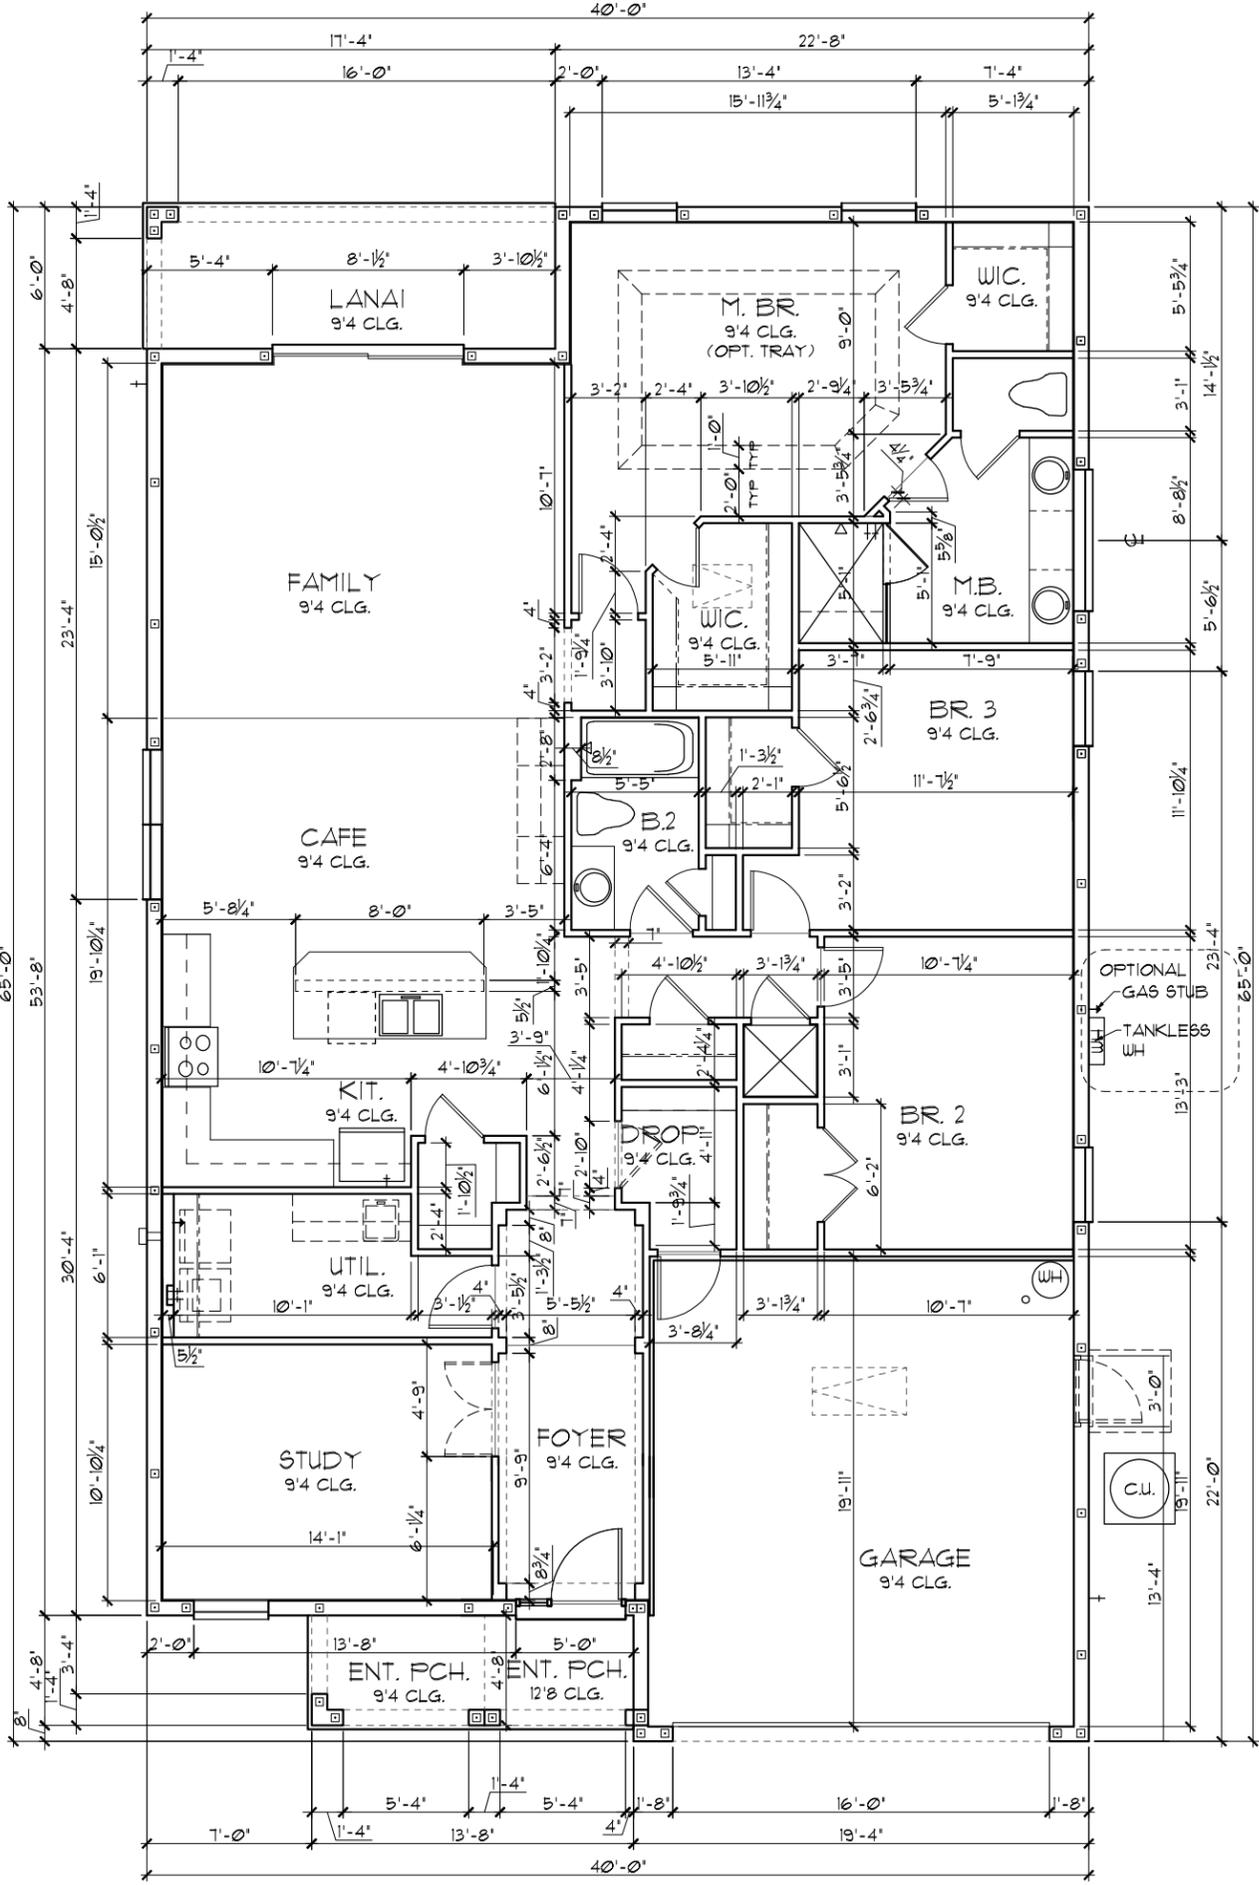

**M.B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

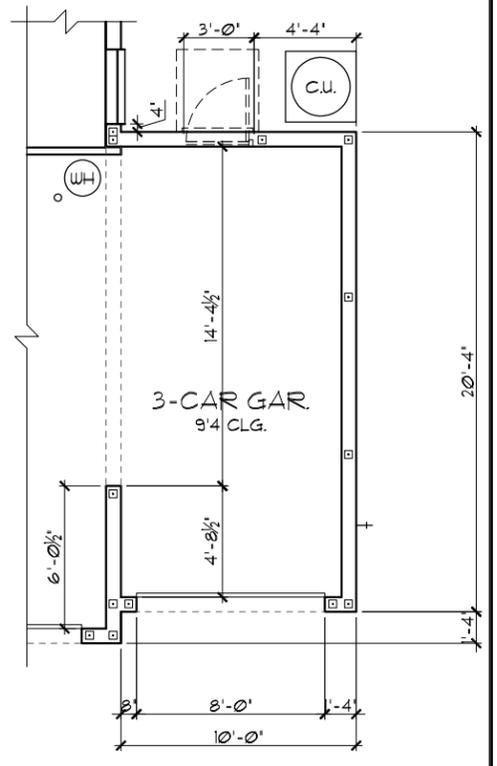

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2003 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**FLORIDA SERIES**

**LOT: 0000, COMMUNITY NAME**

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
HARRISON ENGINEERING GROUP, INC.  
10000 W. Colonial Ave., Suite 200  
Orlando, Florida 32811  
Tel: (407) 734-1400  
Fax: (407) 734-1700  
www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529-3000

**Park Square HOMES**

**FLOOR PLAN W/ DIMENSIONS EXTENDED FOYER**

1966  
**MARGATE II**

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	
OF	02C.0
	00 SHEETS

**LOAD INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

**DEAD LOADS**

FLOOR: STRUCTURE	1 PSF
CEILING	3 PSF
MECH/ELEC	5 PSF
PARTITIONS	5 PSF
<b>TOTAL</b>	<b>20 PSF</b>

**ROOF LIVE LOADS**

ROOF: SHEATHING	5 PSF
STRUCTURE	1 PSF
CEILING	3 PSF
MECH/ELEC	5 PSF
<b>TOTAL</b>	<b>20 PSF</b>

**FLOOR LIVE LOADS**

RESIDENTIAL FLOOR:	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	40 PSF
SLEEPING ROOM:	30 PSF
STAIR LIVE LOAD:	40 PSF
BALCONIES:	40 PSF
PASSANGER VEHICLE GARAGE:	50 PSF

**ROOF LIVE LOADS**

MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER			
0-12 < 4:12	20	16	12
> 4:12 < 12:12	16	14	12
> 12:12	12	12	12

**WIND INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

- BASIC WIND SPEED: 140 MPH
- RISK CATEGORY: II
- WIND EXPOSURE: B
- BUILDING TYPE: V-B
- ENCLOSURE CLASSIFICATION +/- .18, INCLUDED INTERNAL PRESSURE IN NOTE #6 COEFFICIENT:
- COMPONENT / CLADDING: SEE PLAN DESIGN WIND PRESSURE:

+ XXX	DESIGN WIND PRESSURE IAW FLA
- XXX	RESIDENTIAL CODE, SECTION R302




NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.

- GENERAL NOTES**
- PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.
  - VENT DRYER THRU ROOF.
  - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.
  - |           |   |
|-----------|---|
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 9'-4" AFF.  |
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 12'-8" AFF. |
  - REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS
  - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES
  - ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M1307.2
  - ALL INTER. FIRST FLOOR CEILINGS AT 9'-4" UNLESS NOTED OTHERWISE.
  - ALL INTER. SECOND FLOOR CEILINGS AT N/A UNLESS NOTED OTHERWISE.

**NOTE:** 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THAN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5.1

**NOTE:**

- ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2023)
- IN DWELLING UNITS, WHERE THE BOTTOM OF THE CLEAR OPENING OF AN OPERABLE WINDOW OPENING IS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

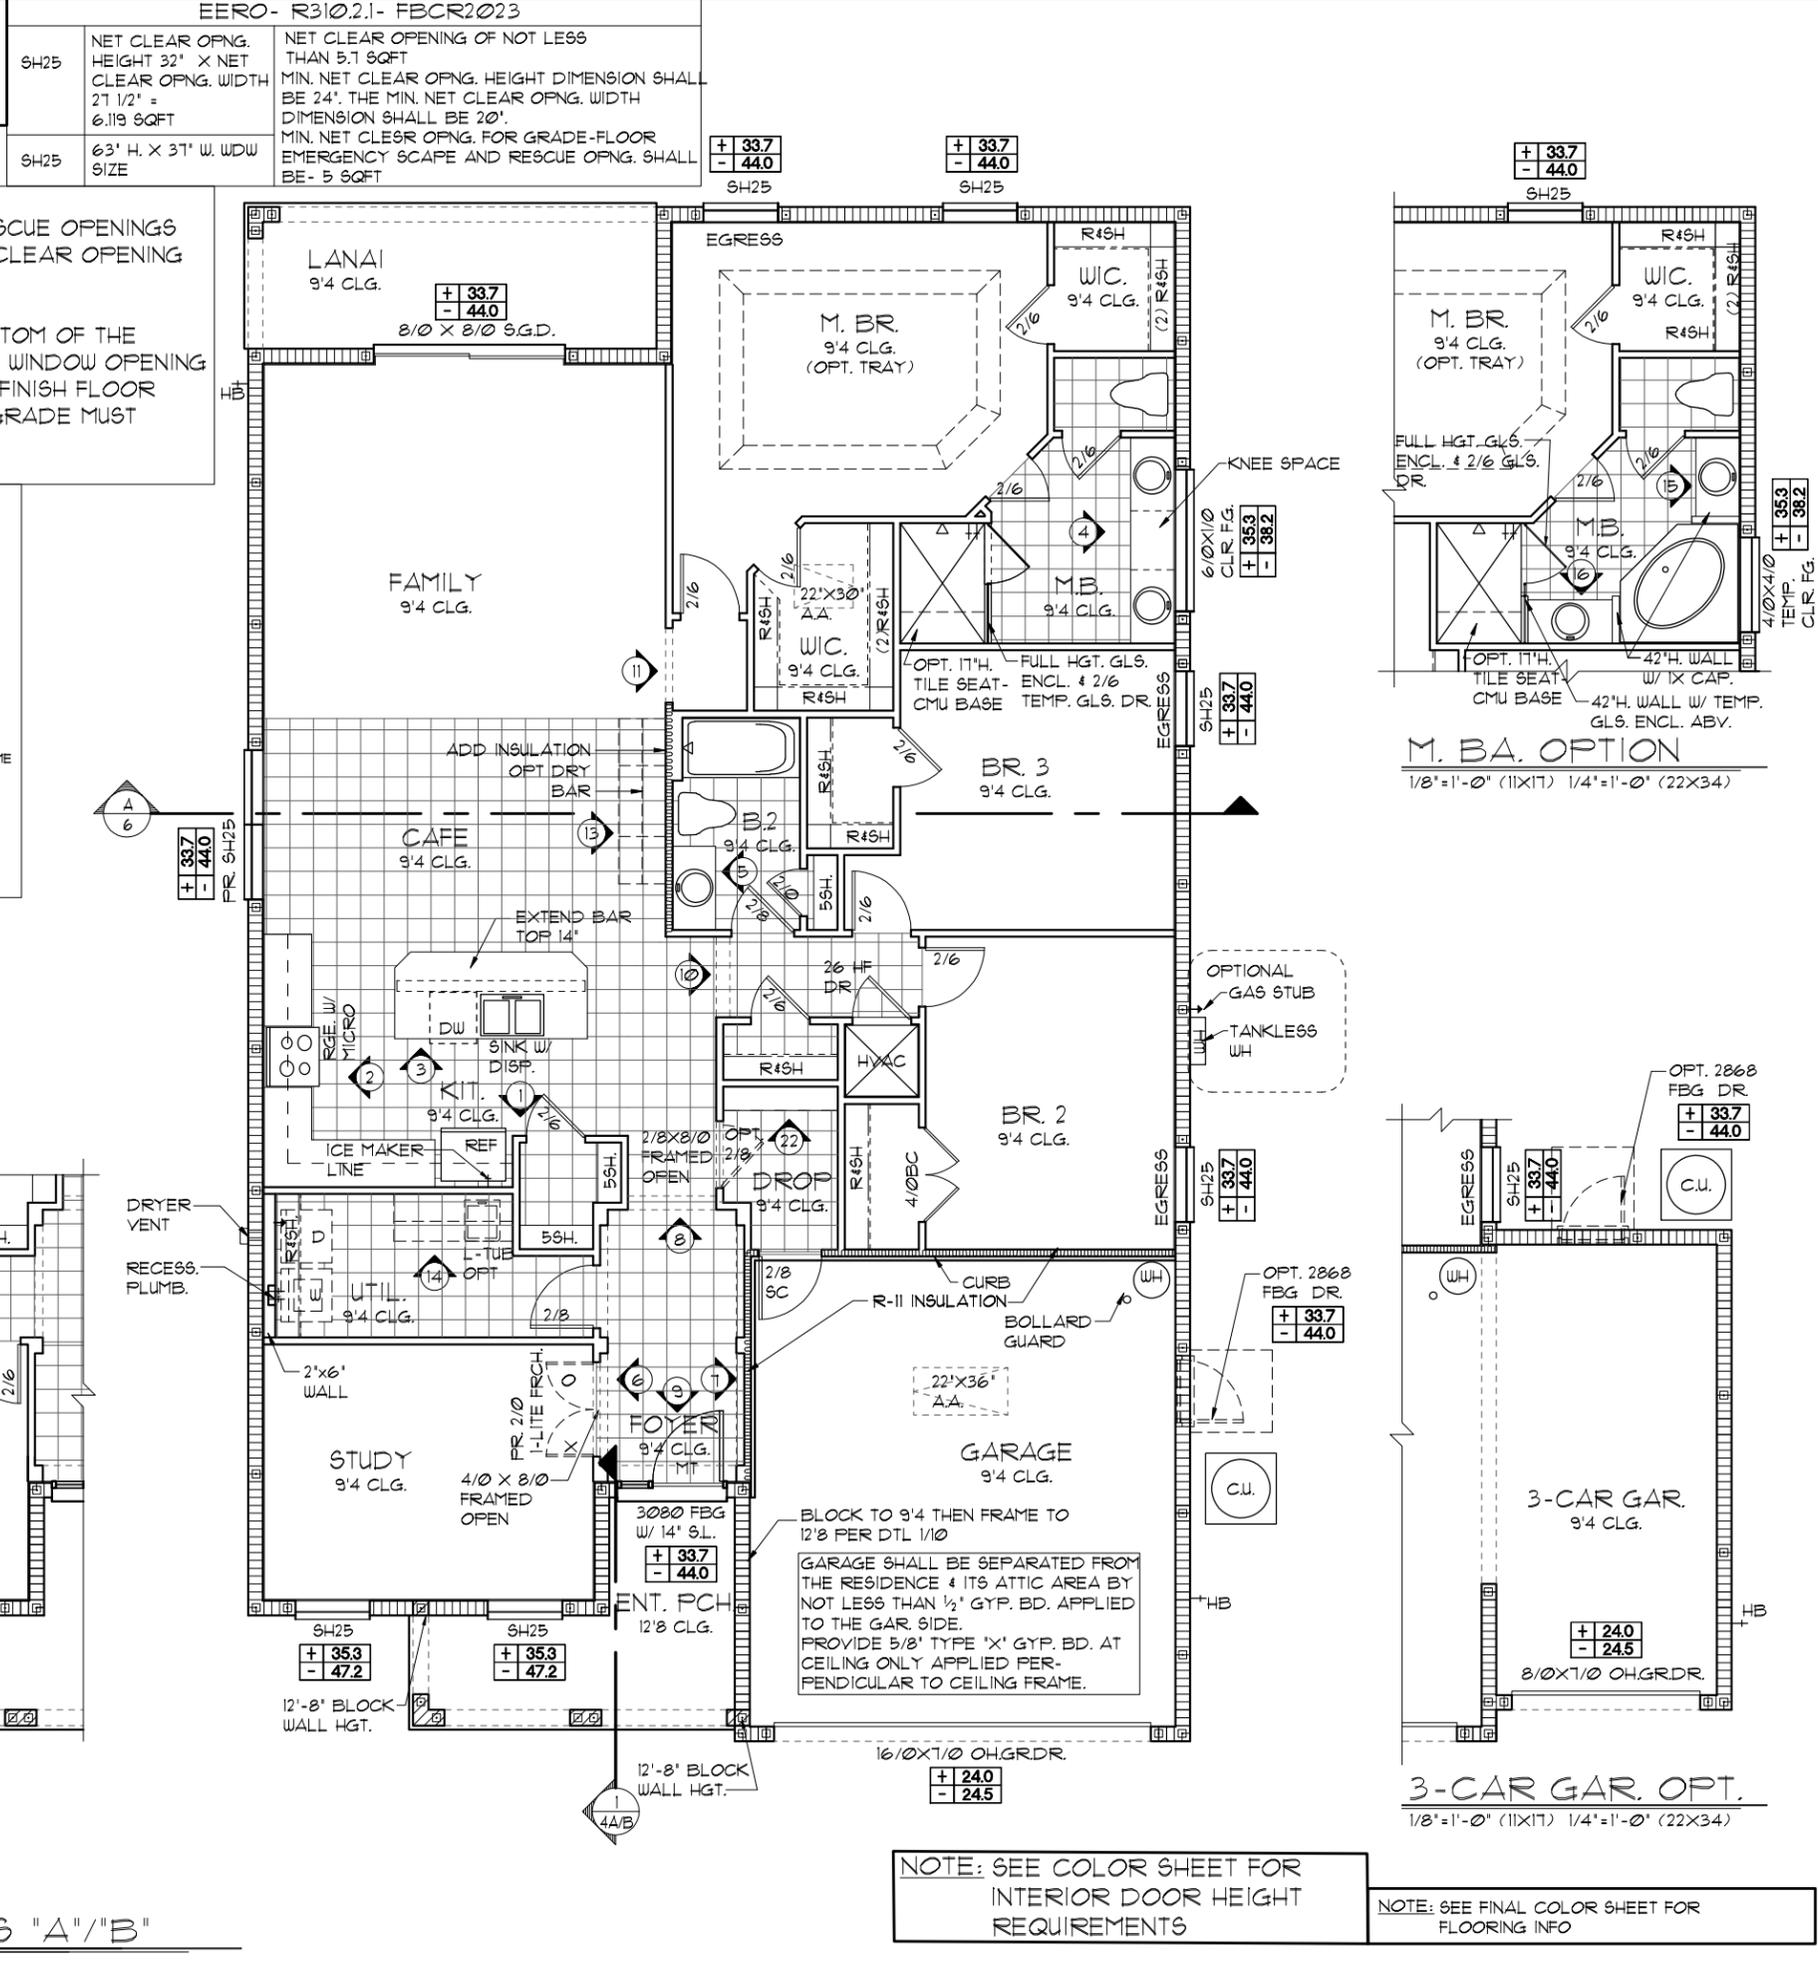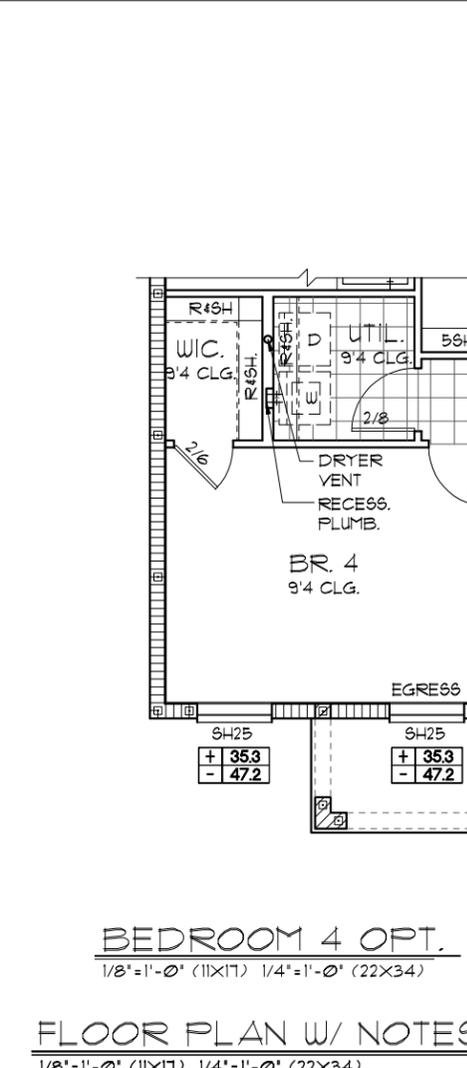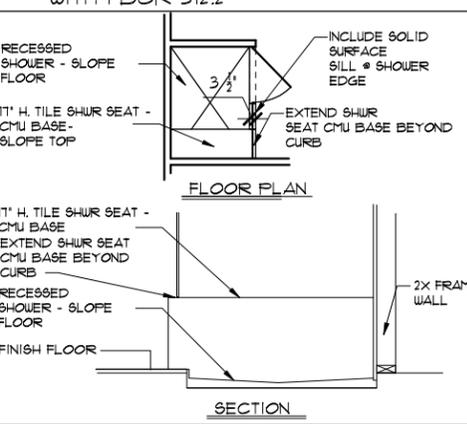

**FLORIDA SERIES**

**LOT: 0000, COMMUNITY NAME**

**1966 MARGATE II**

**FLOOR PLAN W/ NOTES**

**DATE 04-05-2017**

**SCALE AS NOTED**

**DRAWN RDC**

**JOB N/A**

**SHEET**

**03AB**

**OF 00 SHEETS**

**REVISIONS**

REVISIONS	BY
05-16-19	JF

**ITEG**  
HOBBS ENGINEERING GROUP, INC.  
10000 W. BIRCHWOOD BLVD. SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1400  
WWW.ITEG.COM

**Park Square HOMES**  
A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32817  
Phone: (407) 529-3000

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**LOAD INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

**DEAD LOADS**

FLOOR: STRUCTURE	1 PSF
CEILINGS	3 PSF
MECH/ELEC	5 PSF
PARTITIONS	5 PSF
TOTAL	20 PSF

**ROOF LIVE LOADS**

ROOF: SHEATHING	5 PSF
STRUCTURE	1 PSF
CEILINGS	3 PSF
MECH/ELEC	5 PSF
TOTAL	20 PSF

**FLOOR LIVE LOADS**

RESIDENTIAL FLOOR:	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	40 PSF
SLEEPING ROOM:	30 PSF
STAIR LIVE LOAD:	40 PSF
BALCONIES:	40 PSF
PASSANGER VEHICLE GARAGE:	50 PSF

**ROOF LIVE LOADS**

MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER			
0-12 < 4:12	20	16	12
> 4:12 < 12:12	16	14	12
> 12:12	12	12	12

**WIND INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

- BASIC WIND SPEED: 140 MPH
- RISK CATEGORY: II
- WIND EXPOSURE: B
- BUILDING TYPE: V-B
- ENCLOSURE CLASSIFICATION +/- .18, INCLUDED INTERNAL PRESSURE IN NOTE #6 COEFFICIENT:
- COMPONENT / CLADDING: SEE PLAN DESIGN WIND PRESSURE:




+ XXX	DESIGN WIND PRESSURE IAW FLA
- XXX	RESIDENTIAL CODE, SECTION R301

NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.

- GENERAL NOTES**
- PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.
  - VENT DRYER THRU ROOF.
  - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.
  - |           |   |
|-----------|---|
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 9'-4" AFF.  |
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 12'-8" AFF. |
  - REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS
  - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES
  - ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M1307.2
  - ALL INTER. FIRST FLOOR CEILINGS AT 9'-4" UNLESS NOTED OTHERWISE.
  - ALL INTER. SECOND FLOOR CEILINGS AT N/A UNLESS NOTED OTHERWISE.

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THAN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5.1

NOTE:  
• ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2023)  
• IN DWELLING UNITS, WHERE THE BOTTOM OF THE CLEAR OPENING OF AN OPERABLE WINDOW OPENING IS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

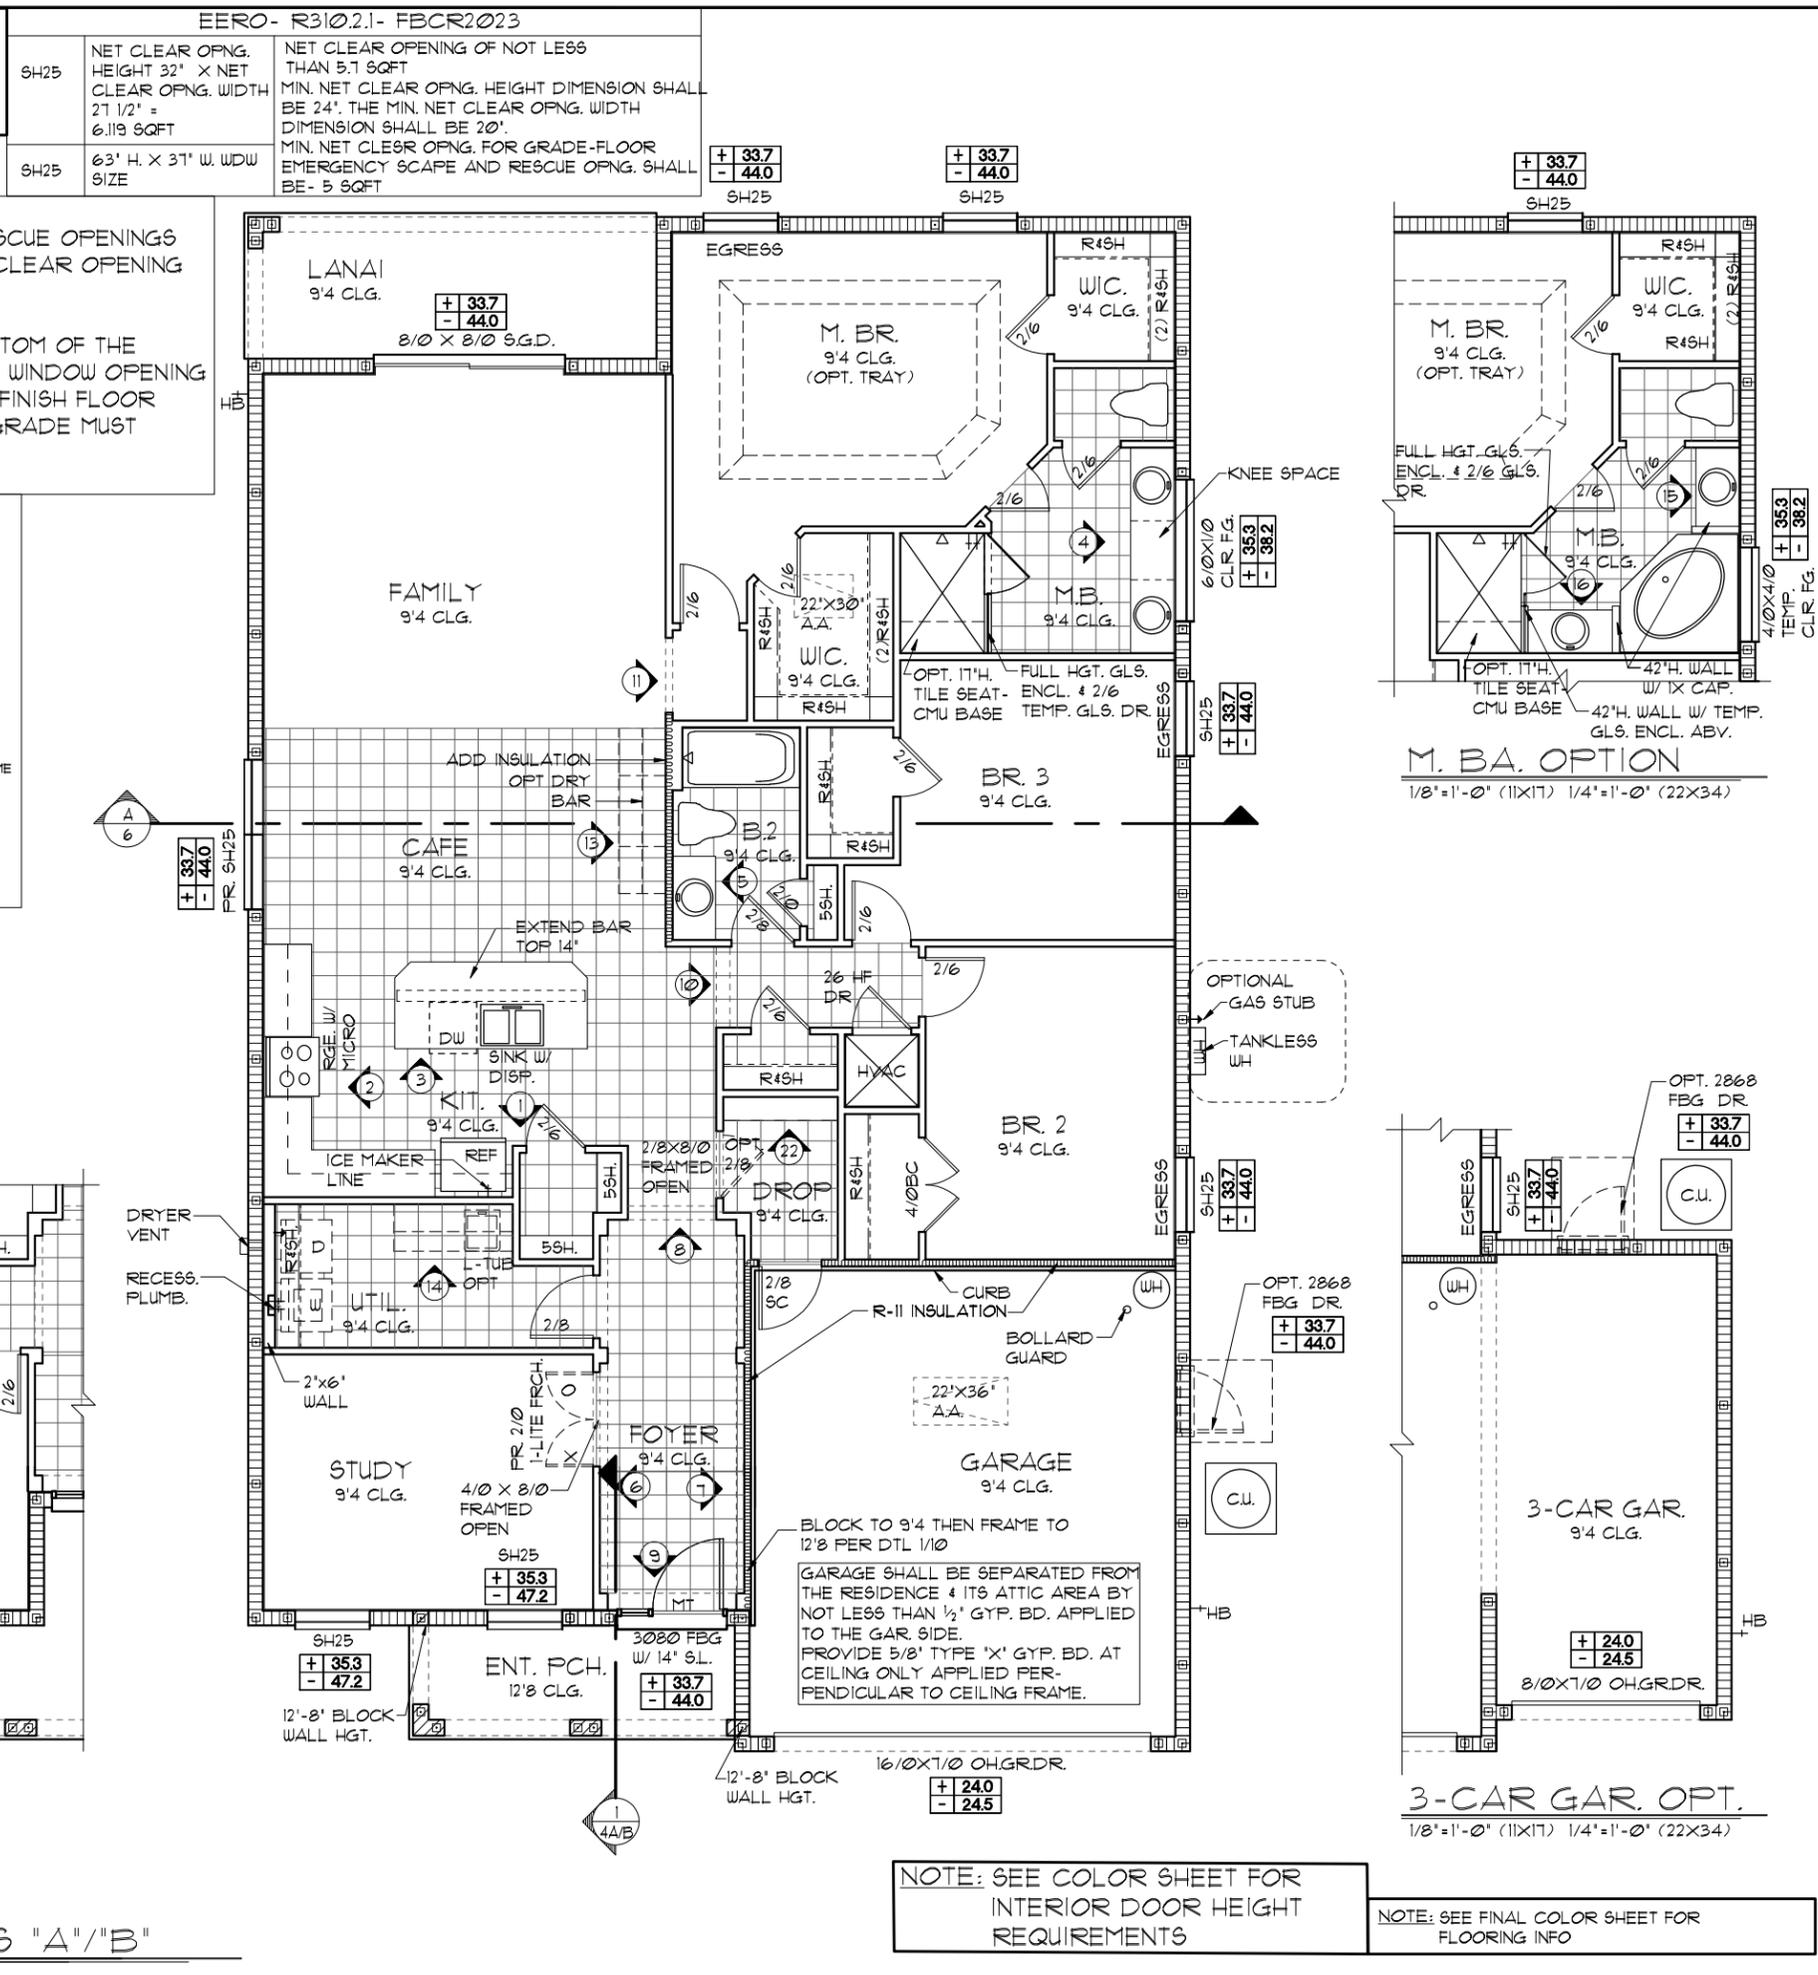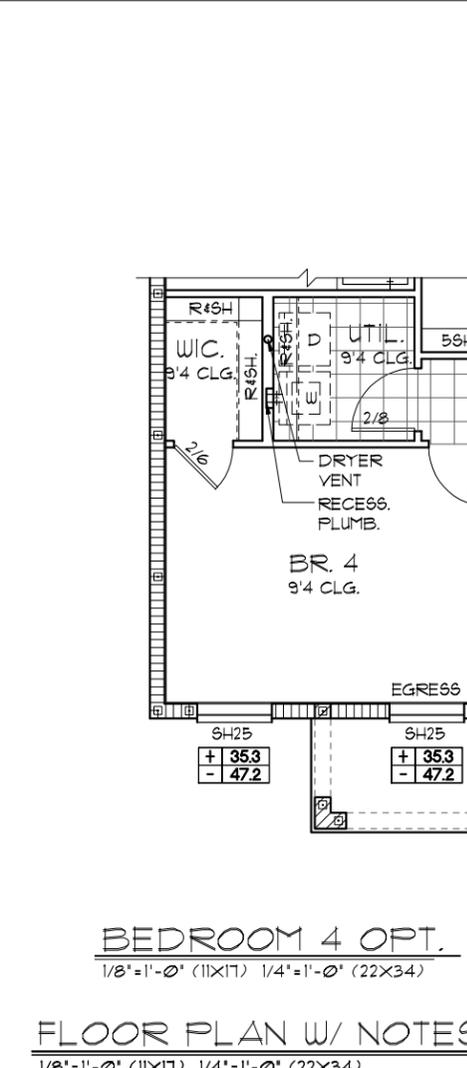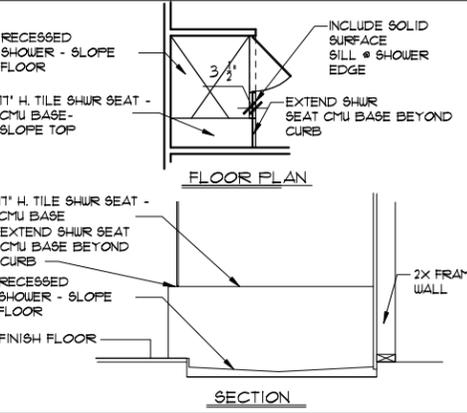

**FLORIDA SERIES**

**ITEG**  
INTERTECH ENGINEERING GROUP, INC.  
10000 W. BIRCHWOOD BLVD. SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1400  
WWW.ITEG.COM

**Park Square HOMES**  
A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32817  
Phone: (407) 529 - 3000

**FLOOR PLAN W/ NOTES EXTENDED FOYER**

1966  
MARGATE II

REVISIONS

REVISIONS	BY
05-16-19	JF

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
03AB OF 00 SHEETS

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**LOAD INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

**DEAD LOADS**

FLOOR: STRUCTURE	1 PSF
CEILINGS	3 PSF
MECH/ELEC	5 PSF
PARTITIONS	5 PSF
TOTAL	20 PSF

**FLOOR LIVE LOADS**

RESIDENTIAL FLOOR:	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	40 PSF
SLEEPING ROOM:	30 PSF
STAIR LIVE LOAD:	40 PSF
BALCONIES:	40 PSF
PASSANGER VEHICLE GARAGE:	50 PSF

**ROOF LIVE LOADS**

MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER			
0-12 < 4:12	20	16	12
> 4:12 < 12:12	16	14	12
> 12:12	12	12	12

**WIND INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

- BASIC WIND SPEED: 140 MPH
- RISK CATEGORY: II
- WIND EXPOSURE: B
- BUILDING TYPE: V B
- ENCLOSURE CLASSIFICATION +/- 10, INCLUDED INTERNAL PRESSURE IN NOTE #6 COEFFICIENT:
- COMPONENT / CLADDING: SEE PLAN DESIGN WIND PRESSURE:

+ XXX	DESIGN WIND PRESSURE IAW FLA
- XXX	RESIDENTIAL CODE, SECTION R302



NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.

- GENERAL NOTES**
- PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.
  - VENT DRYER THRU ROOF.
  - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.
  - |           |   |
|-----------|---|
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 9'-4" AFF.  |
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 12'-8" AFF. |
  - REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS
  - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES
  - ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M1307.2
  - ALL INTER. FIRST FLOOR CEILINGS AT 9'-4" UNLESS NOTED OTHERWISE.
  - ALL INTER. SECOND FLOOR CEILINGS AT N/A UNLESS NOTED OTHERWISE.

**NOTE:** 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THAN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5.1



**NOTE:**

- ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2023)
- IN DWELLING UNITS, WHERE THE BOTTOM OF THE CLEAR OPENING OF AN OPERABLE WINDOW OPENING IS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

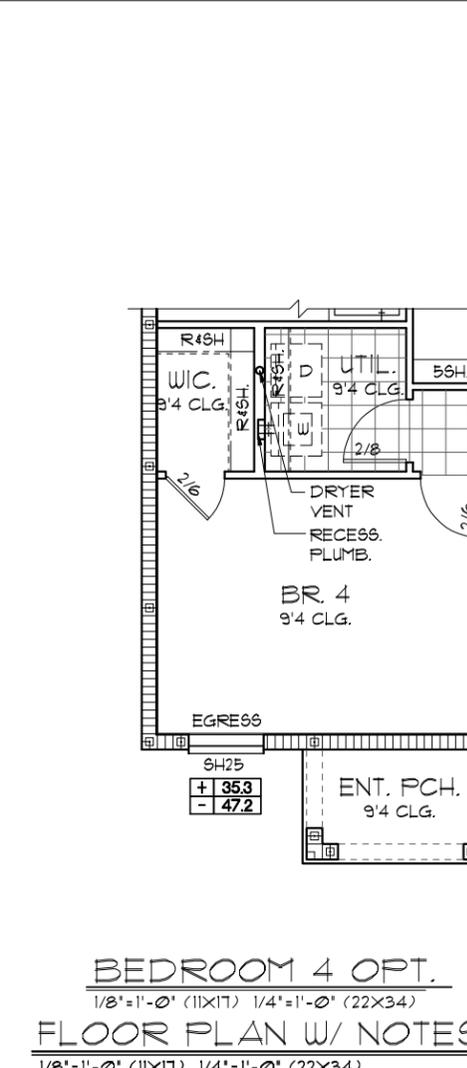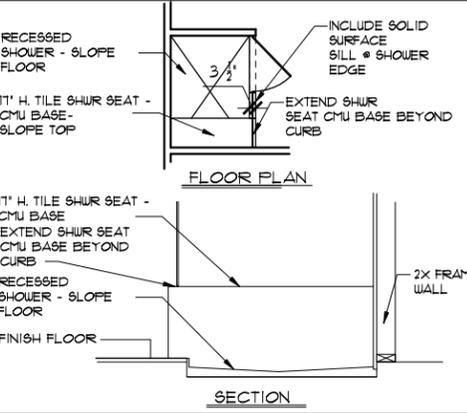

**EERO - R310.2.1 - FBCR2023**

SH25	NET CLEAR OPNG. HEIGHT 32' X NET CLEAR OPNG. WIDTH 21 1/2' = 6.119 SQFT	NET CLEAR OPNG. HEIGHT DIMENSION SHALL BE 24'. THE MIN. NET CLEAR OPNG. WIDTH DIMENSION SHALL BE 20'.
SH25	63" H. X 31" W. WDW SIZE	MIN. NET CLEAR OPNG. FOR GRADE-FLOOR EMERGENCY ESCAPE AND RESCUE OPNG. SHALL BE - 5 SQFT

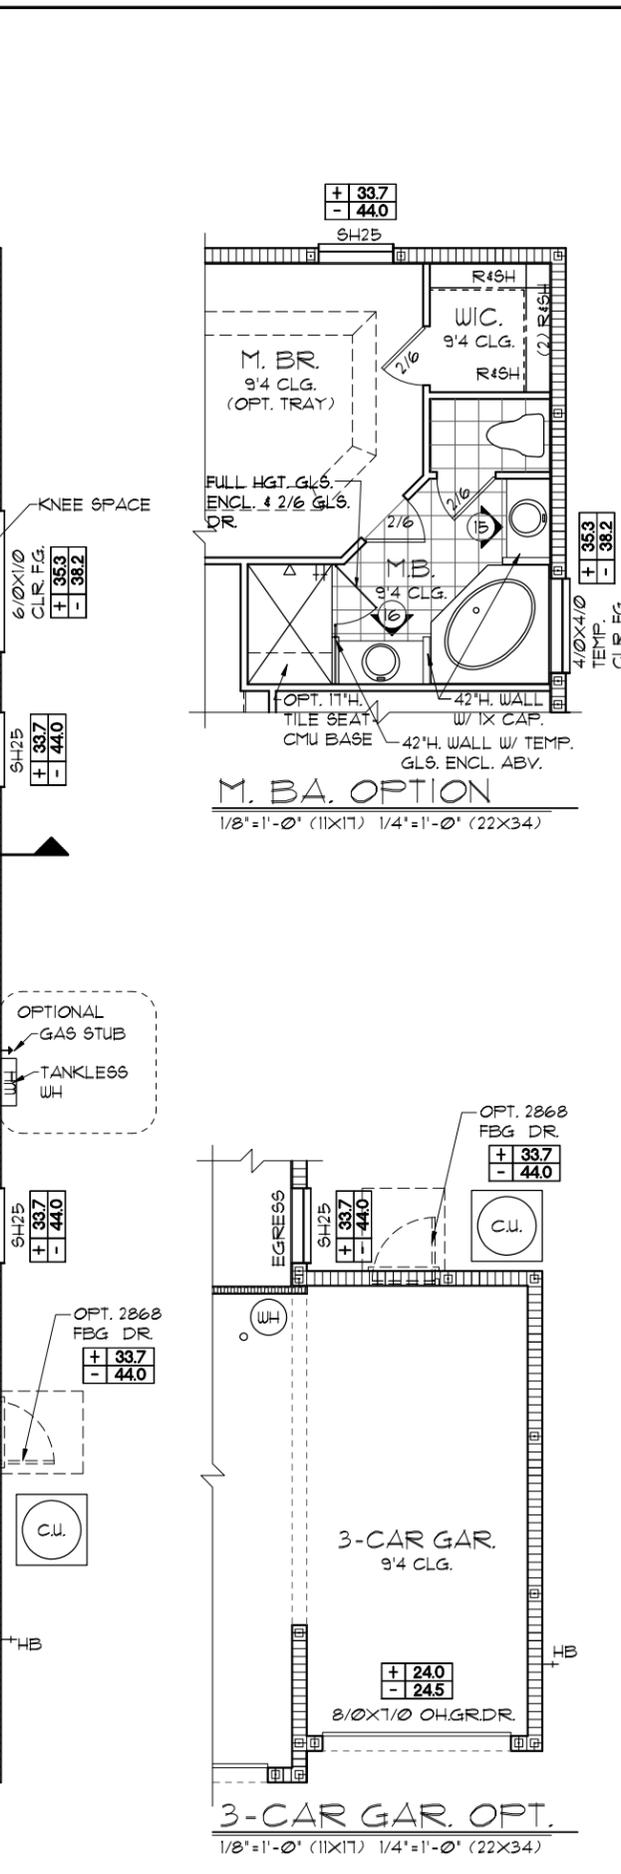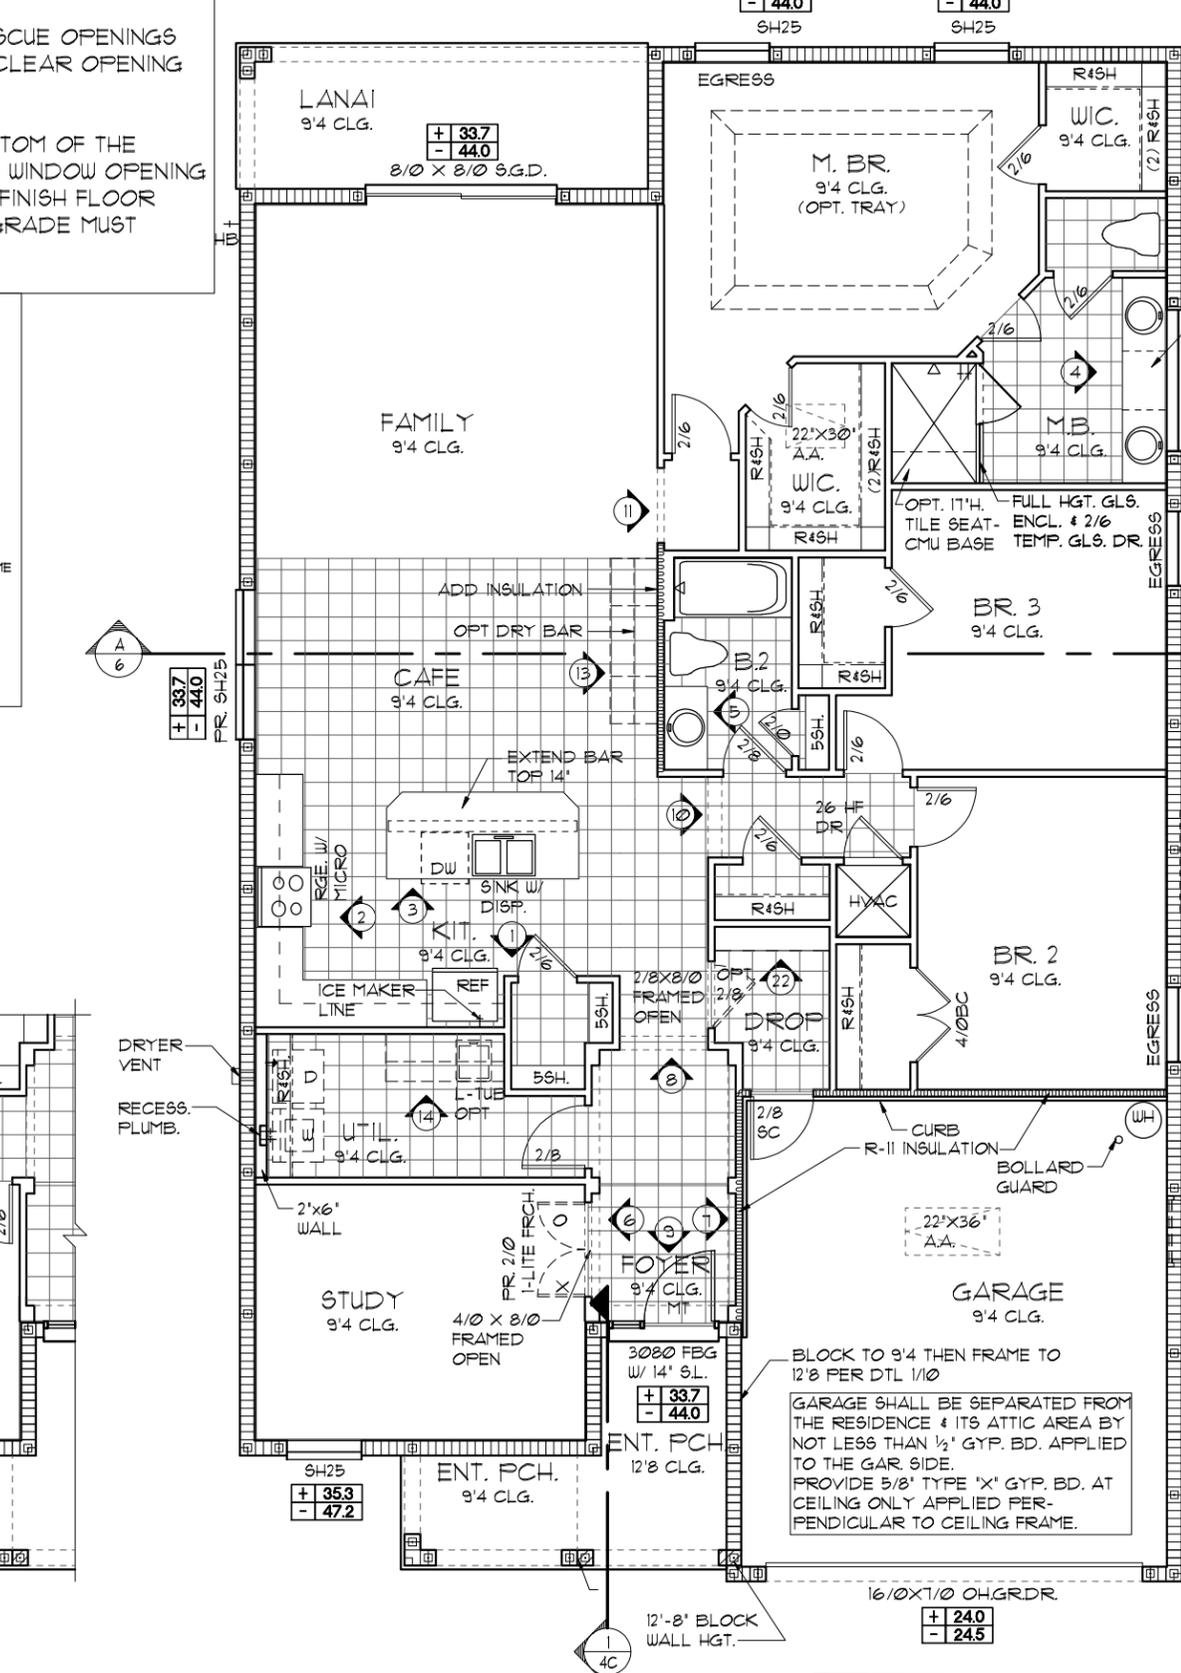

**NOTE:** SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS

**NOTE:** SEE FINAL COLOR SHEET FOR FLOORING INFO

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**FLORIDA SERIES**

**LOT: 0000, COMMUNITY NAME**

**1966 MARGATE II**

**FLOOR PLAN W/ NOTES**

**DATE 04-05-2017**

**SCALE AS NOTED**

**DRAWN RDC**

**JOB N/A**

**SHEET**

**03C**

**OF 00 SHEETS**

**REVISIONS**

REVISIONS	BY
05-16-19	JF

**ITEG**  
INTERTECH ENGINEERING GROUP, INC.  
10000 W. BIRCHWOOD BLVD., SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1400  
FAX: (407) 734-1700  
WWW.ITEG.COM

**Park Square HOMES**  
A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32817  
Phone: (407) 529 - 3000

**LOAD INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

**DEAD LOADS**

FLOOR: STRUCTURE	1 PSF
CEILING	3 PSF
MECH/ELEC	5 PSF
PARTITIONS	5 PSF
<b>TOTAL</b>	<b>20 PSF</b>

**FLOOR LIVE LOADS**

RESIDENTIAL FLOOR:	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	40 PSF
SLEEPING ROOM:	30 PSF
STAIR LIVE LOAD:	40 PSF
BALCONIES:	40 PSF
PASSANGER VEHICLE GARAGE:	50 PSF
<b>TOTAL</b>	<b>20 PSF</b>

**TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER**

ROOF SLOPE	0-200	201-600	OVER 600
0:12 < 4:12	20	16	12
≥ 4:12 < 12:12	16	14	12
≥ 12:12	12	12	12

**WIND INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

- BASIC WIND SPEED: 140 MPH
- RISK CATEGORY: II
- WIND EXPOSURE: B
- BUILDING TYPE: V B
- ENCLOSURE CLASSIFICATION +/- 10, INCLUDED INTERNAL PRESSURE IN NOTE #6 COEFFICIENT:
- COMPONENT / CLADDING: SEE PLAN DESIGN WIND PRESSURE:

+ XXX	DESIGN WIND PRESSURE IAW FLA
- XXX	RESIDENTIAL CODE, SECTION R301

NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.

**GENERAL NOTES**


- PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.
- VENT DRYER THRU ROOF.
- PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
- DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
- MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.
- |           |   |
|-----------|---|
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 9'-4" AFF.  |
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 12'-8" AFF. |
- REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS
- REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES
- ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M1307.2
- ALL INTER. FIRST FLOOR CEILING AT 9'-4" UNLESS NOTED OTHERWISE.
- ALL INTER. SECOND FLOOR CEILING AT N/A UNLESS NOTED OTHERWISE.

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THAN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5.1

**EERO - R310.2.1 - FBCR2023**

SH25	NET CLEAR OPNG. HEIGHT 32' X NET CLEAR OPNG. WIDTH 21 1/2' = 6.119 SQFT	NET CLEAR OPNG. HEIGHT DIMENSION SHALL BE 24'. THE MIN. NET CLEAR OPNG. WIDTH DIMENSION SHALL BE 20'.
SH25	63" H. X 31" W. WDW SIZE	MIN. NET CLEAR OPNG. FOR GRADE-FLOOR EMERGENCY ESCAPE AND RESCUE OPNG. SHALL BE - 5 SQFT

NOTE:  
• ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2023)  
• IN DWELLING UNITS, WHERE THE BOTTOM OF THE CLEAR OPENING OF AN OPERABLE WINDOW OPENING IS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

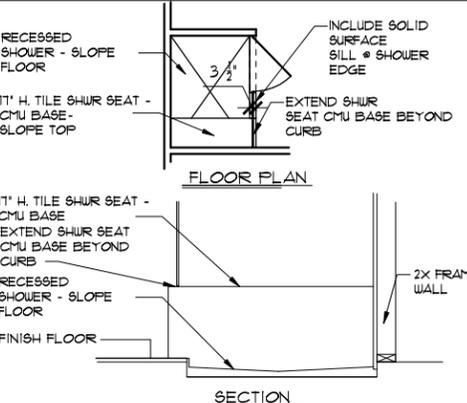

FLOOR PLAN SECTION




SECTION



SECTION





SECTION




SECTION



SECTION

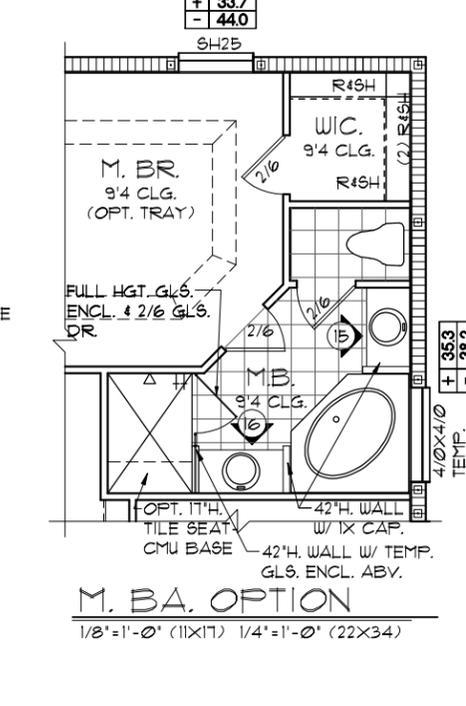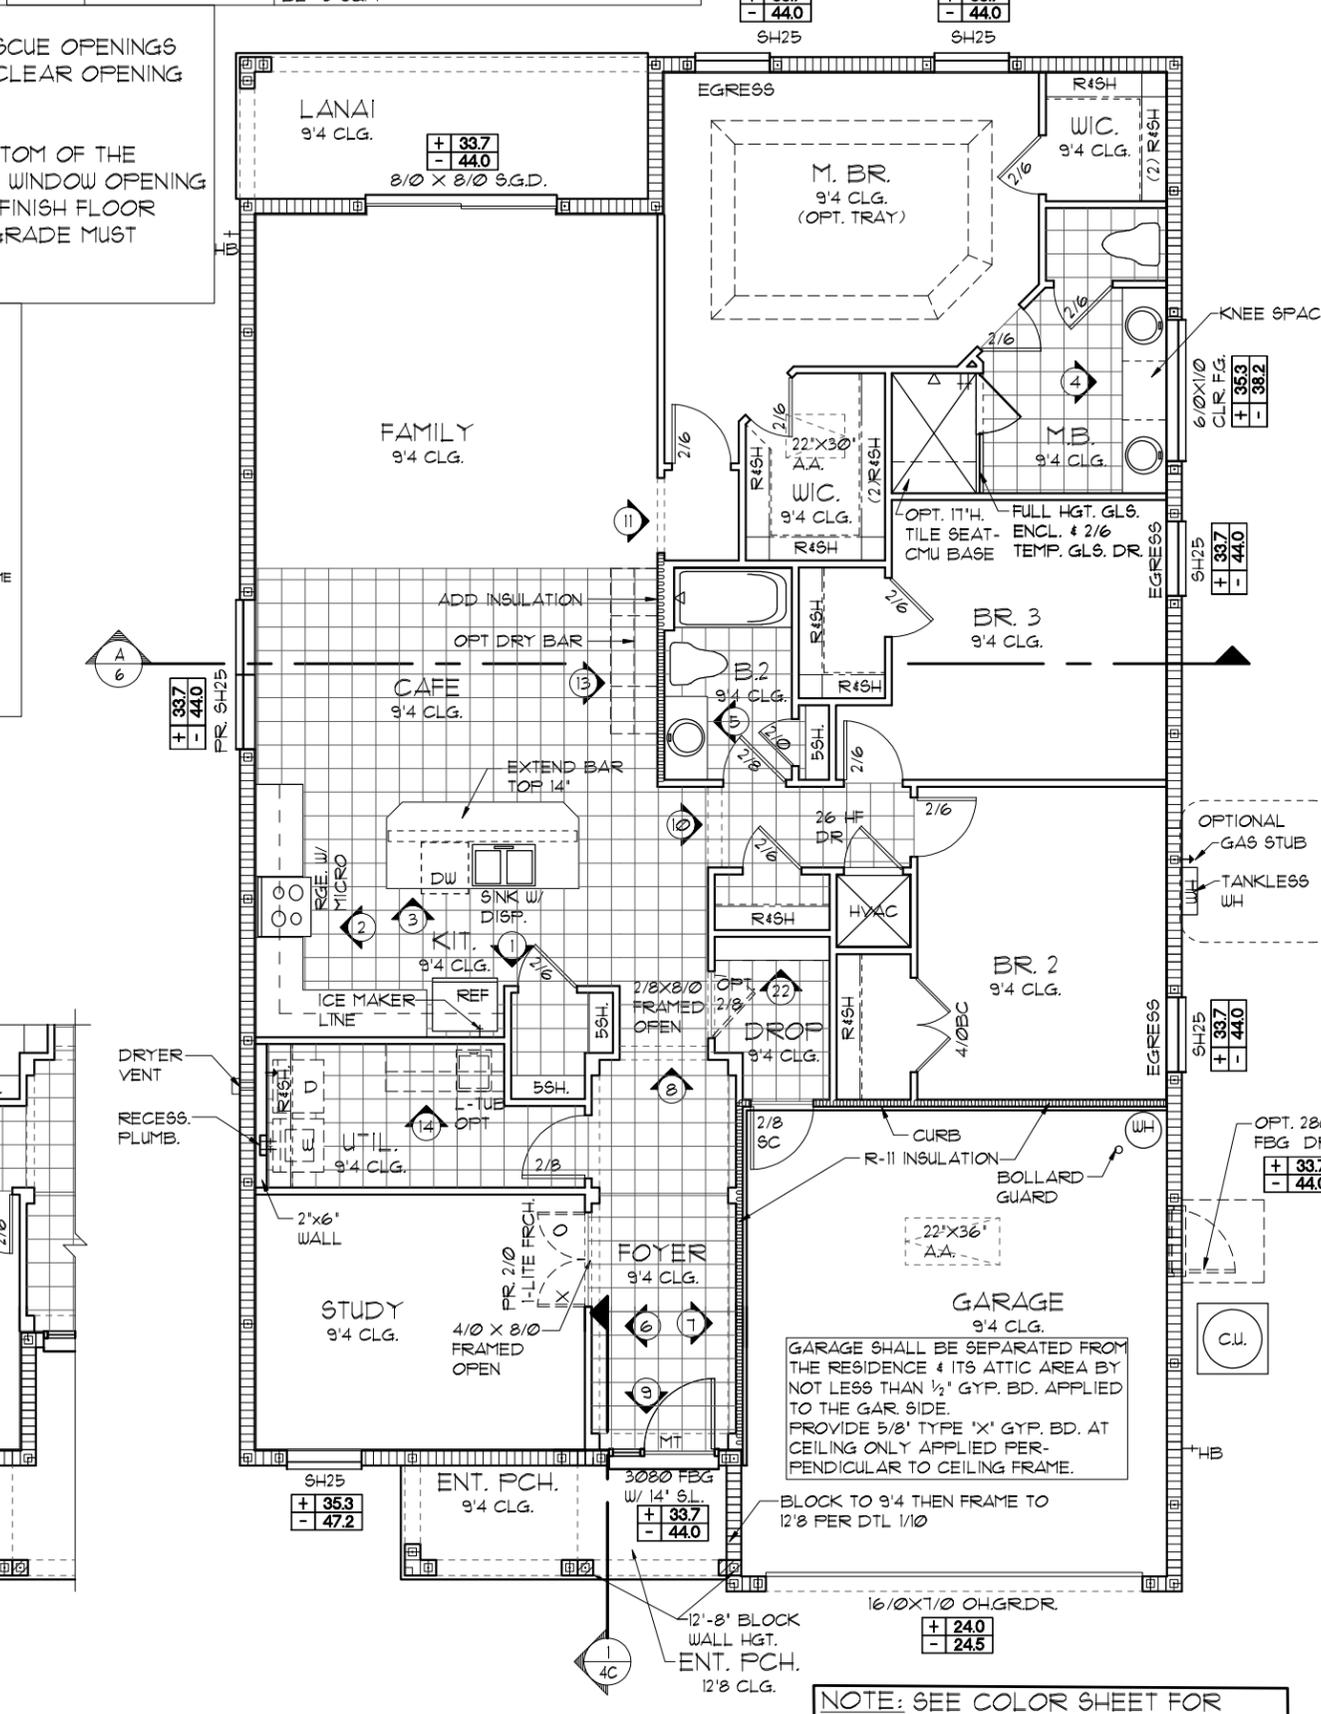

M. B.A. OPTION

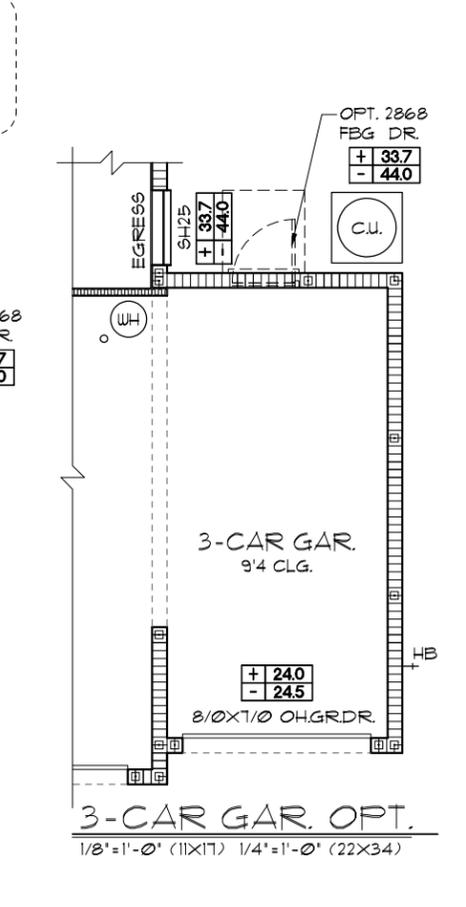

**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)  
**FLOOR PLAN W/ NOTES "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTE: SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS

NOTE: SEE FINAL COLOR SHEET FOR FLOORING INFO

**FLORIDA SERIES**

LOT: 0000, COMMUNITY NAME: MARGATE II

1966

FLOOR PLAN W/ NOTES EXTENDED FOYER

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET 03C OF 00 SHEETS





THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

**ITEG**  
INTERTECH ENGINEERING GROUP, INC.  
10000 W. BIRCHWOOD BLVD., SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1700  
WWW.ITEG.COM

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32817  
Phone: (407) 529-3000

REVISIONS BY  
05-16-19 JF

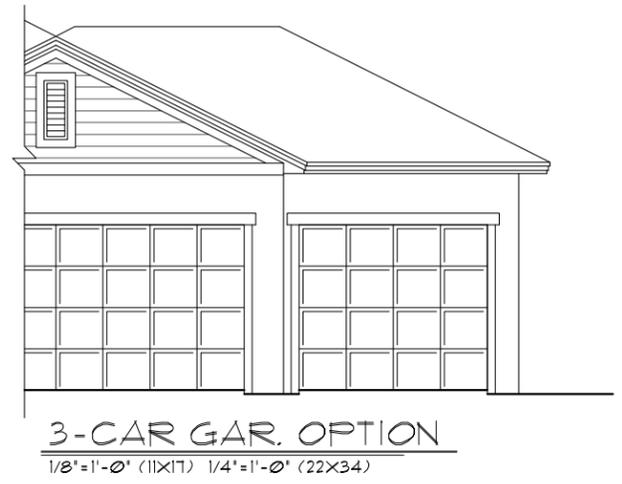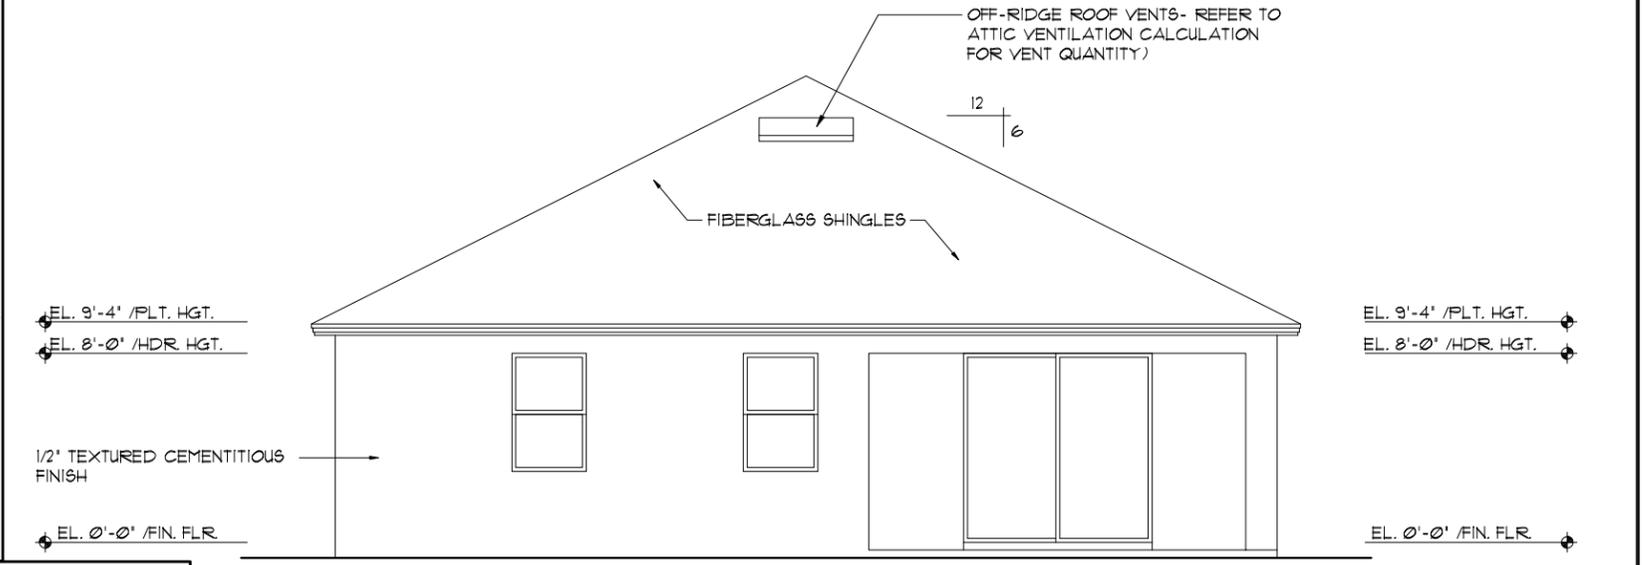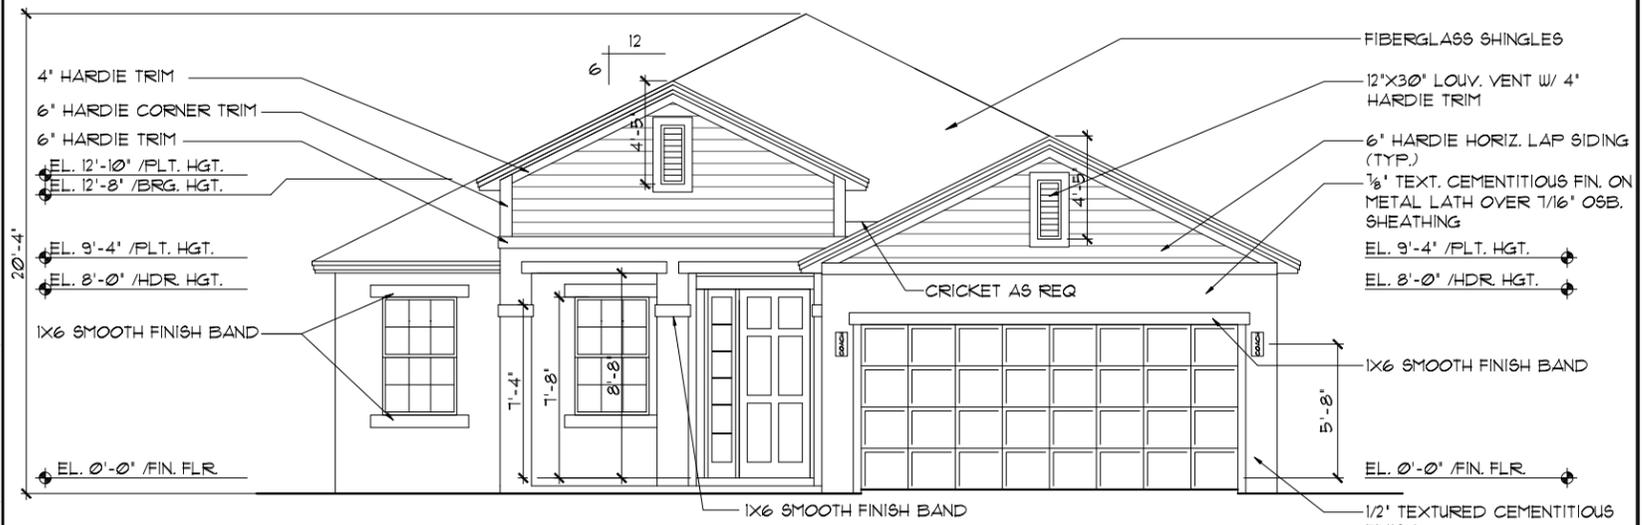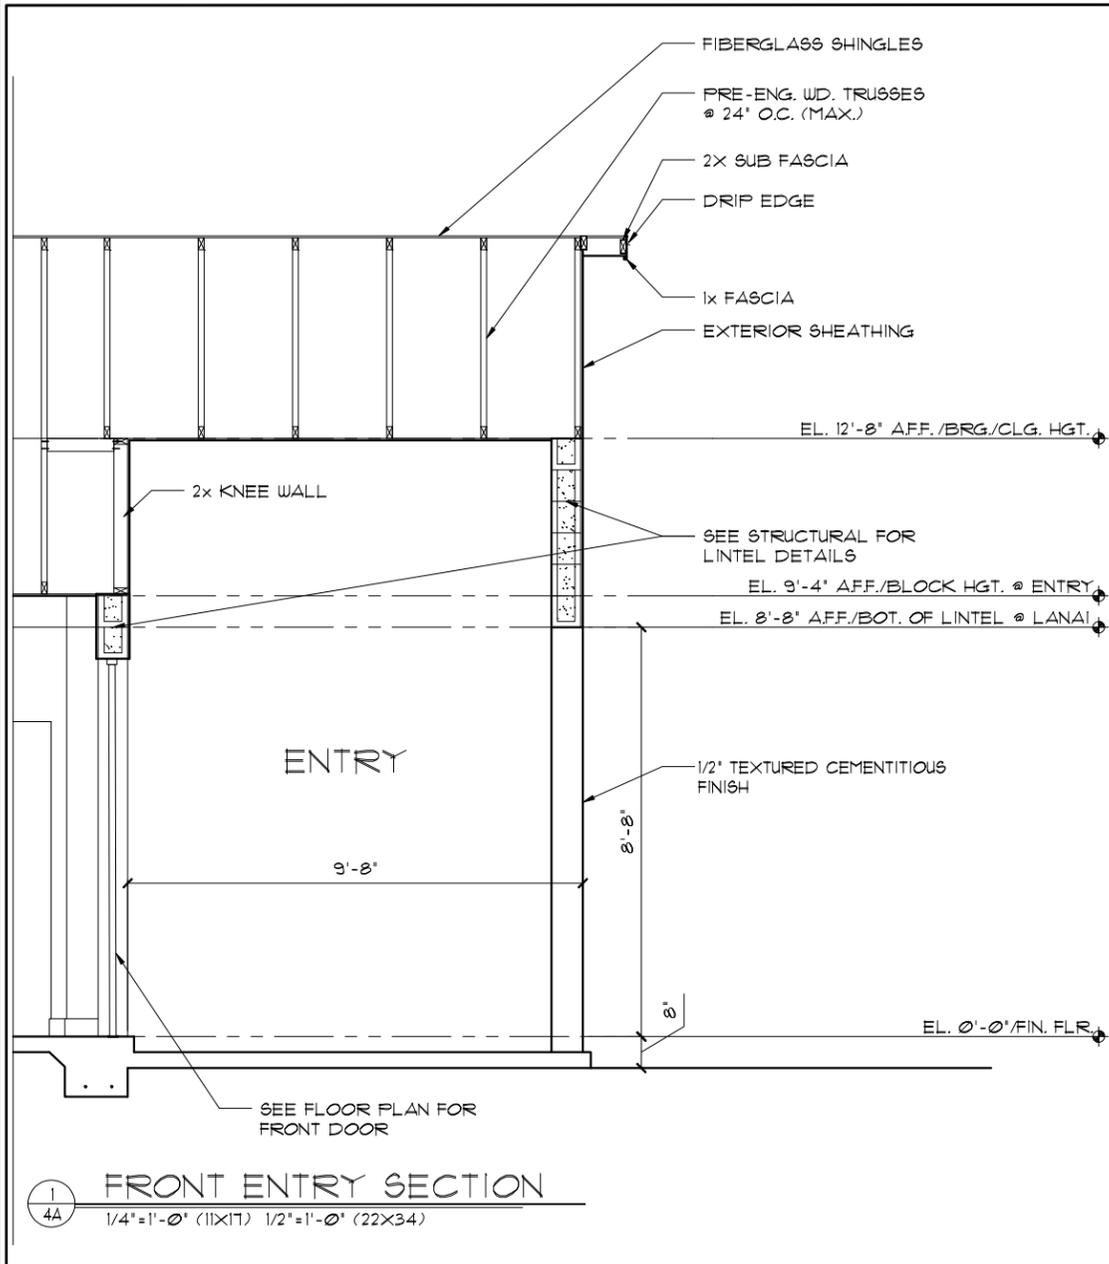

- EXTERIOR FINISH NOTES**
- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR 2023 - ALL LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1-1/2 INCH 11 GAGE NAILS HAVING A 7/16 INCH HEAD, OR 1 1/2 INCH LONG 16 GAGE STAPLES SPACED IN ACCORDANCE WITH ASTM C1063 OR C1181 OR AS OTHERWISE APPROVED.
  - PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR 2023
  - WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR 2023- MINIMUM NO 26 GALVANIZED SHEET GAGE CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3-1/2 INCHES SHALL BE PROVIDED AT OR BELOW THE PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C 926. THE WEEP SCREED SHALL BE PLACED A MINIMUM OF 4 INCHES ABOVE THE EARTH OR 2 INCHES ABOVE PAVED AREAS. THE WEATHER RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.
  - WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR 2023- INSTALLED OVER WOOD BASED SHEATHING SHALL INCLUDE A WATER RESISTIVE VAPOR PERMEABLE BARRIER EQUIVALENT TO 2 LAYERS OF GRADE D PAPER
  - 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.
  - STUCCO APPLICATION MUST BE IAW R103.1.4 OF THE 8TH EDITION, FBCR 2023 OR EXCEPTION : APPLICATION INSTALLED IN ACCORDANCE WITH ASTM C 926
  - UNDERLAYMENT REQUIREMENTS MUST BE IAW R305.1.1 OF THE 8TH EDITION, FBCR 2023 -  
 R305.1.1 Underlayment.  
 Underlayment for roof slopes 2:12 and greater shall conform to the applicable standards listed in this chapter. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151, OR ASTM D8251 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated. Underlayment for roof slopes 2:12 and greater shall be applied and attached in accordance with Section R305.1.1.1, R305.1.1.2 as applicable.

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

REVISIONS	BY
05-16-19	JF




**ITEG**  
 ITRIPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000


**Park Square HOMES**

EXTERIOR ELEVATION FRONT AND REAR

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 04A  
 OF 00 SHEETS

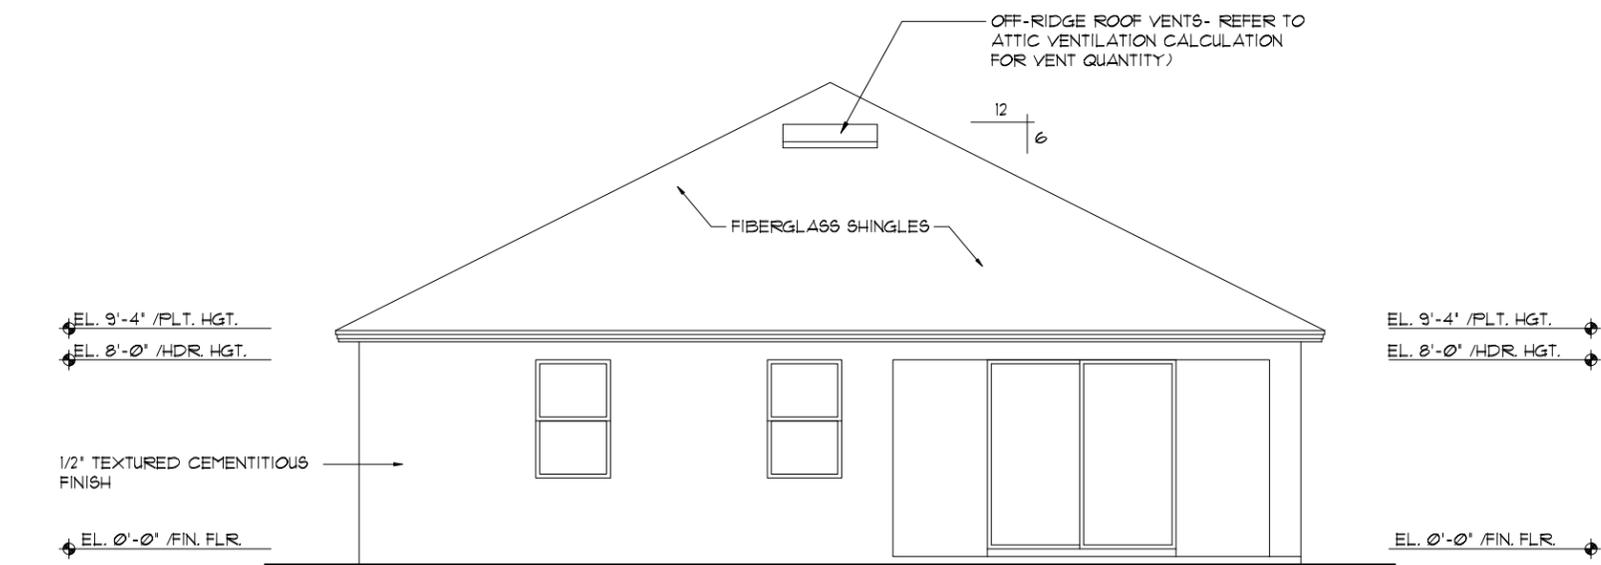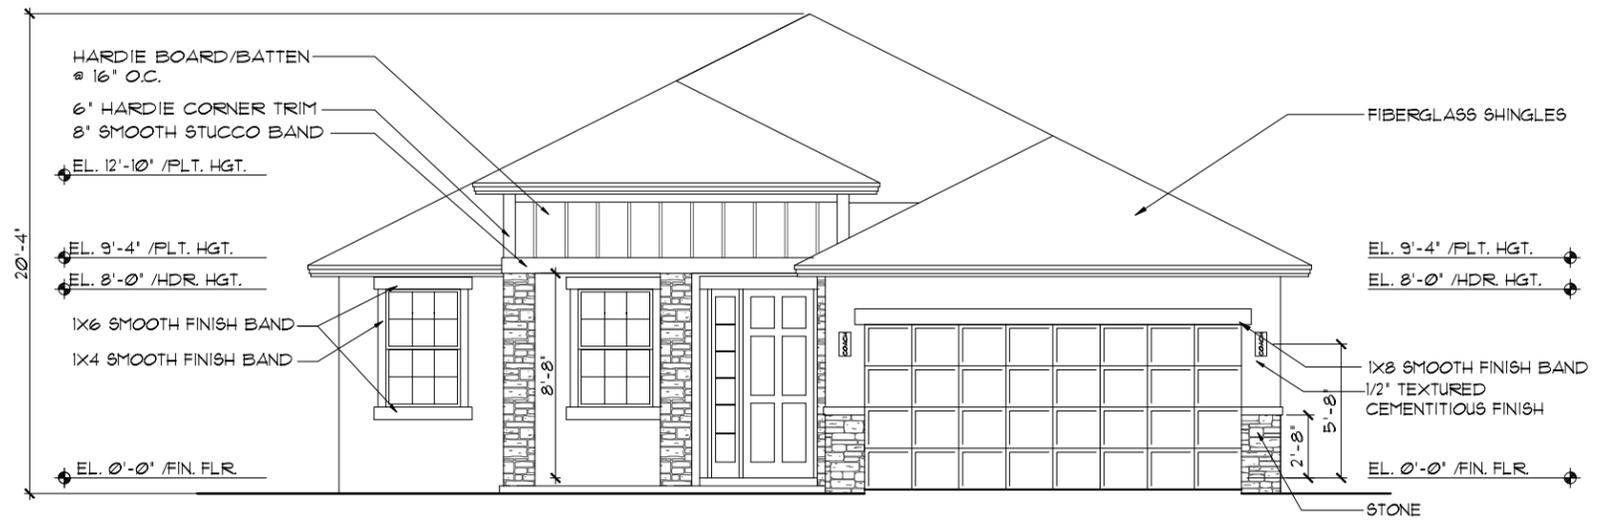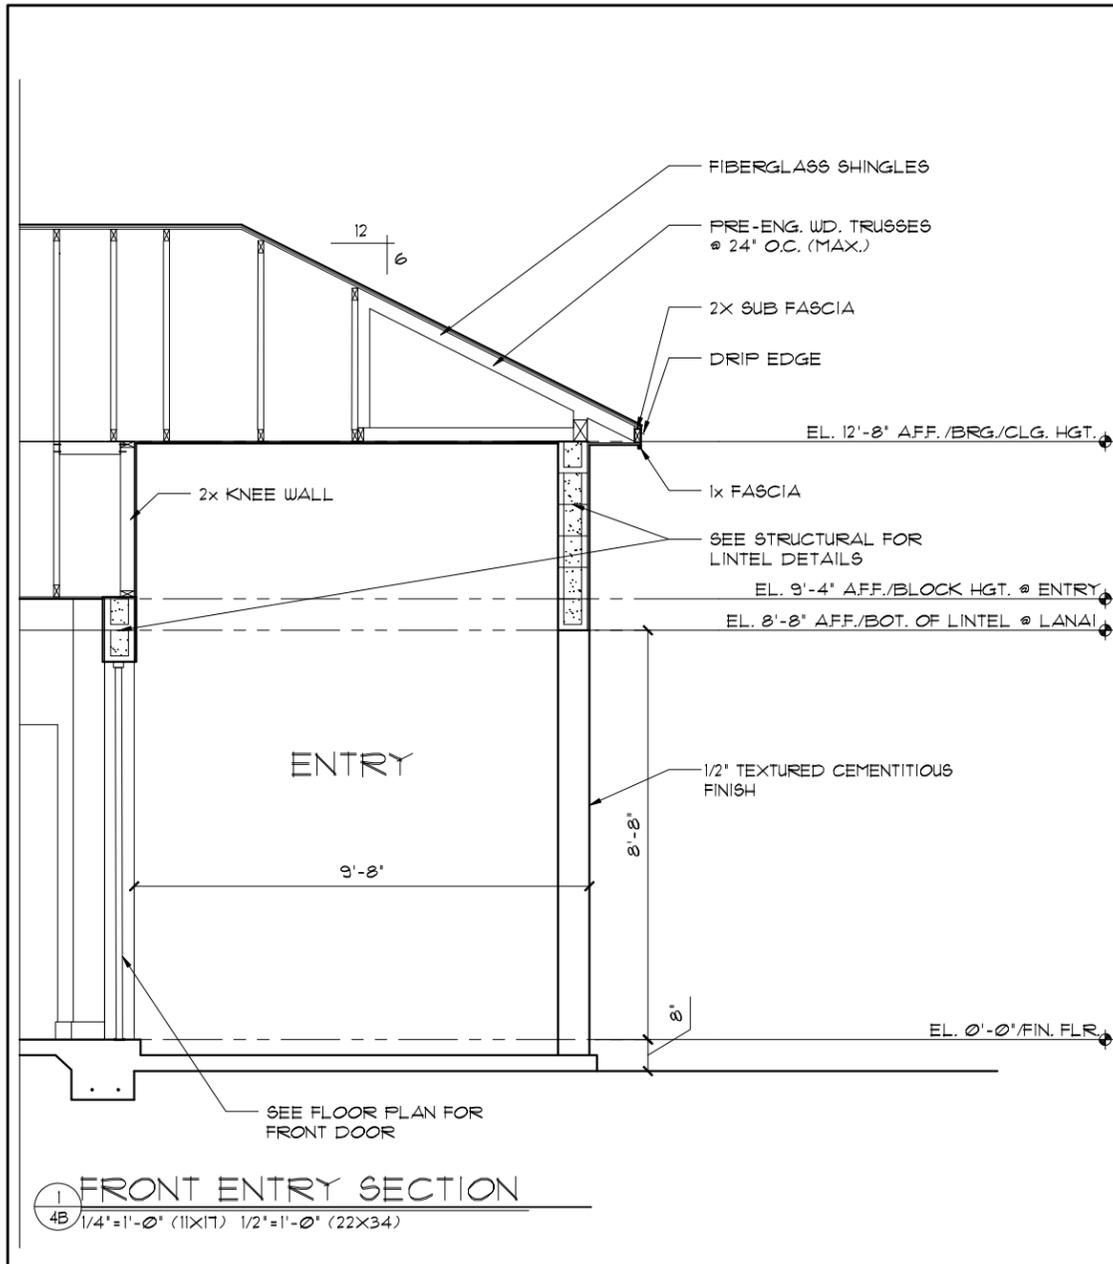

- EXTERIOR FINISH NOTES**
- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR 2023 - ALL LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1-1/2 INCH 11 GAGE NAILS HAVING A 7/16 INCH HEAD, OR 1 1/2 INCH LONG 16 GAGE STAPLES SPACED IN ACCORDANCE WITH ASTM C1063 OR C1181 OR AS OTHERWISE APPROVED.
  - PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR 2023
  - WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR 2023- MINIMUM NO 26 GALVANIZED SHEET GAGE CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3-1/2 INCHES SHALL BE PROVIDED AT OR BELOW THE PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C 926. THE WEEP SCREED SHALL BE PLACED A MINIMUM OF 4 INCHES ABOVE THE EARTH OR 2 INCHES ABOVE PAVED AREAS. THE WEATHER RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.
  - WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR 2023- INSTALLED OVER WOOD BASED SHEATHING SHALL INCLUDE A WATER RESISTIVE VAPOR PERMEABLE BARRIER EQUIVALENT TO 2 LAYERS OF GRADE D PAPER
  - 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.
  - STUCCO APPLICATION MUST BE IAW R103.1.4 OF THE 8TH EDITION, FBCR 2023 OR EXCEPTION : APPLICATION INSTALLED IN ACCORDANCE WITH ASTM C 926
  - UNDERLAYMENT REQUIREMENTS MUST BE IAW R305.1.1 OF THE 8TH EDITION, FBCR 2023 - R305.1.1 Underlayment. Underlayment for roof slopes 2:12 and greater shall conform to the applicable standards listed in this chapter. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151, OR ASTM D8251 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated. Underlayment for roof slopes 2:12 and greater shall be applied and attached in accordance with Section R305.1.1.1, R305.1.1.2 as applicable.

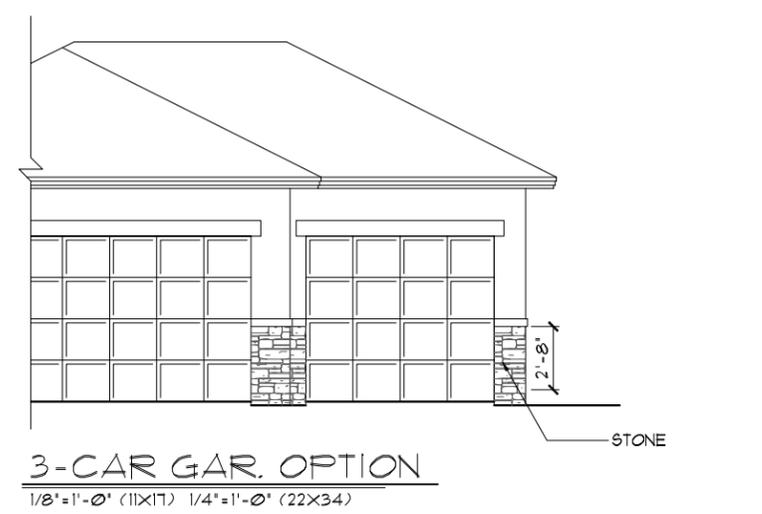

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
**LOT: 0000, COMMUNITY NAME**  
**FLORIDA SERIES**

REVISIONS	BY
05-16-19	JF

**ITEG**  
 ITC ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com




A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 529 - 3000

**Park Square HOMES**

**EXTERIOR ELEVATION FRONT AND REAR**

1966  
**MARGATE II**


DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
**04B**  
 OF 00 SHEETS

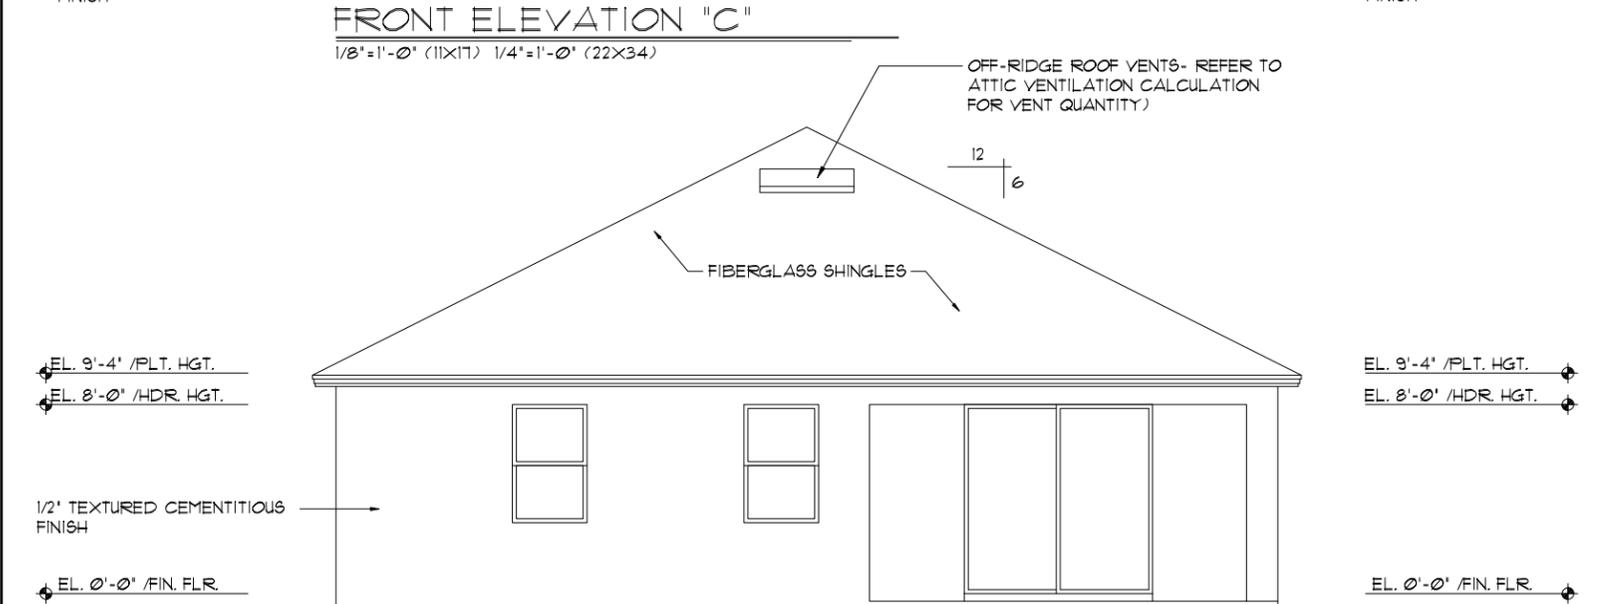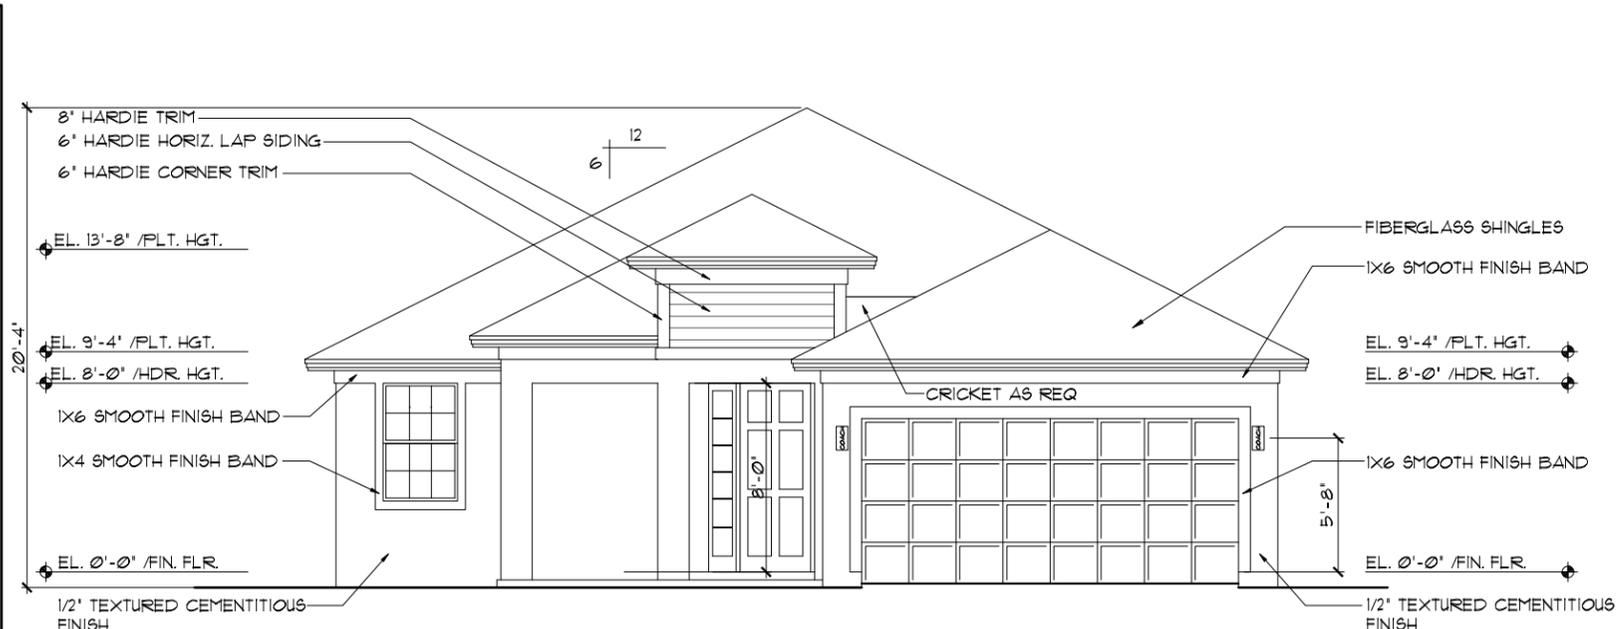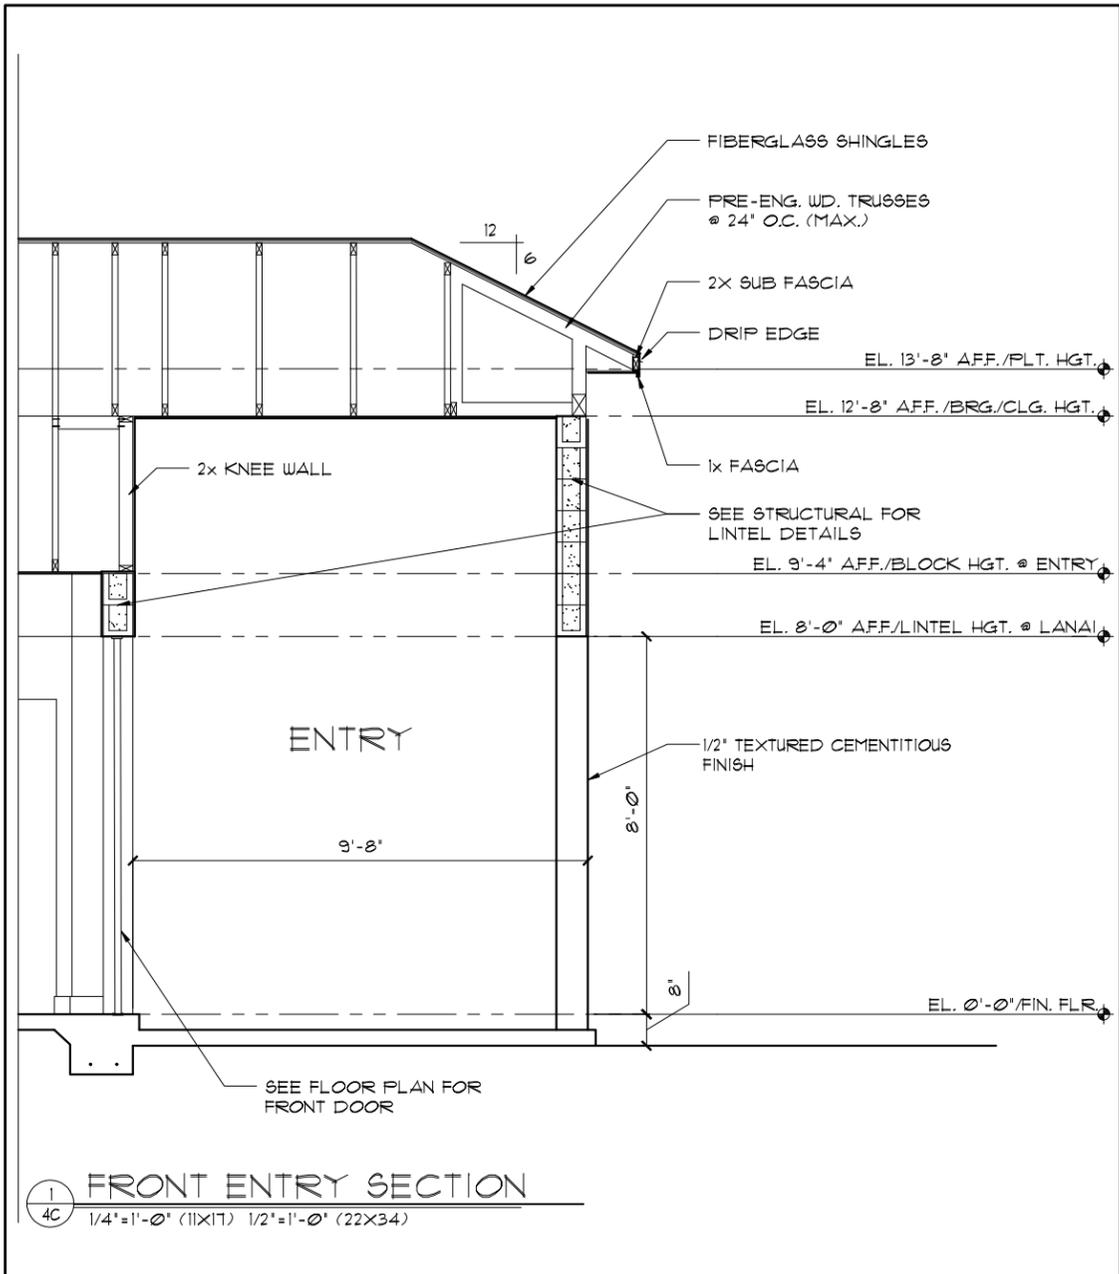

1 FRONT ENTRY SECTION  
4C 1/4"=1'-0" (11X17) 1/2"=1'-0" (22X34)

FRONT ELEVATION "C"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

REAR ELEVATION  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

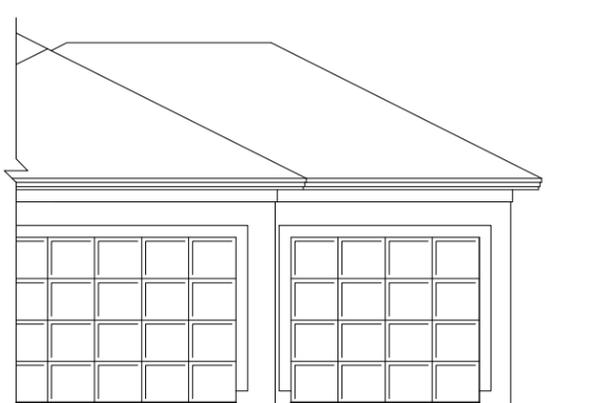

3-CAR GAR. OPTION  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

- EXTERIOR FINISH NOTES**
- LATH TO BE ATTACHED IAW R103.1 OF THE 8TH EDITION, FBCR 2023 - ALL LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL, EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1-1/2 INCH 11 GAGE NAILS HAVING A 7/16 INCH HEAD, OR 1 1/2 INCH LONG 16 GAGE STAPLES SPACED IN ACCORDANCE WITH ASTM C1063 OR C1181 OR AS OTHERWISE APPROVED.
  - PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.12 OF THE 8TH EDITION, FBCR 2023
  - WEEP SCREED TO BE INSTALLED IAW R103.12.1 OF THE 8TH EDITION, FBCR 2023- MINIMUM NO 26 GALVANIZED SHEET GAGE CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3-1/2 INCHES SHALL BE PROVIDED AT OR BELOW THE PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C 926. THE WEEP SCREED SHALL BE PLACED A MINIMUM OF 4 INCHES ABOVE THE EARTH OR 2 INCHES ABOVE PAVED AREAS. THE WEATHER RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.
  - WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.13 OF THE 8TH EDITION, FBCR 2023- INSTALLED OVER WOOD BASED SHEATHING SHALL INCLUDE A WATER RESISTIVE VAPOR PERMEABLE BARRIER EQUIVALENT TO 2 LAYERS OF GRADE D PAPER
  - 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.
  - STUCCO APPLICATION MUST BE IAW R103.14 OF THE 8TH EDITION, FBCR 2023 OR EXCEPTION : APPLICATION INSTALLED IN ACCORDANCE WITH ASTM C 926
  - UNDERLAYMENT REQUIREMENTS MUST BE IAW R305.1 OF THE 8TH EDITION, FBCR 2023 -  
R305.1.1 Underlayment.  
Underlayment for roof slopes 2:12 and greater shall conform to the applicable standards listed in this chapter. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151, OR ASTM D8251 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated. Underlayment for roof slopes 2:12 and greater shall be applied and attached in accordance with Section R305.1.1.1, R305.1.1.2 as applicable.

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

FLORIDA SERIES

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529-3000

EXTERIOR ELEVATION FRONT AND REAR




1966 MARGATE II

REVISIONS	BY
05-16-19	JF

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET 04C OF 00 SHEETS

**EXTERIOR FINISH NOTES**

- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR 2023
- PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR 2023
- WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR 2023
- WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR 2023
- 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.

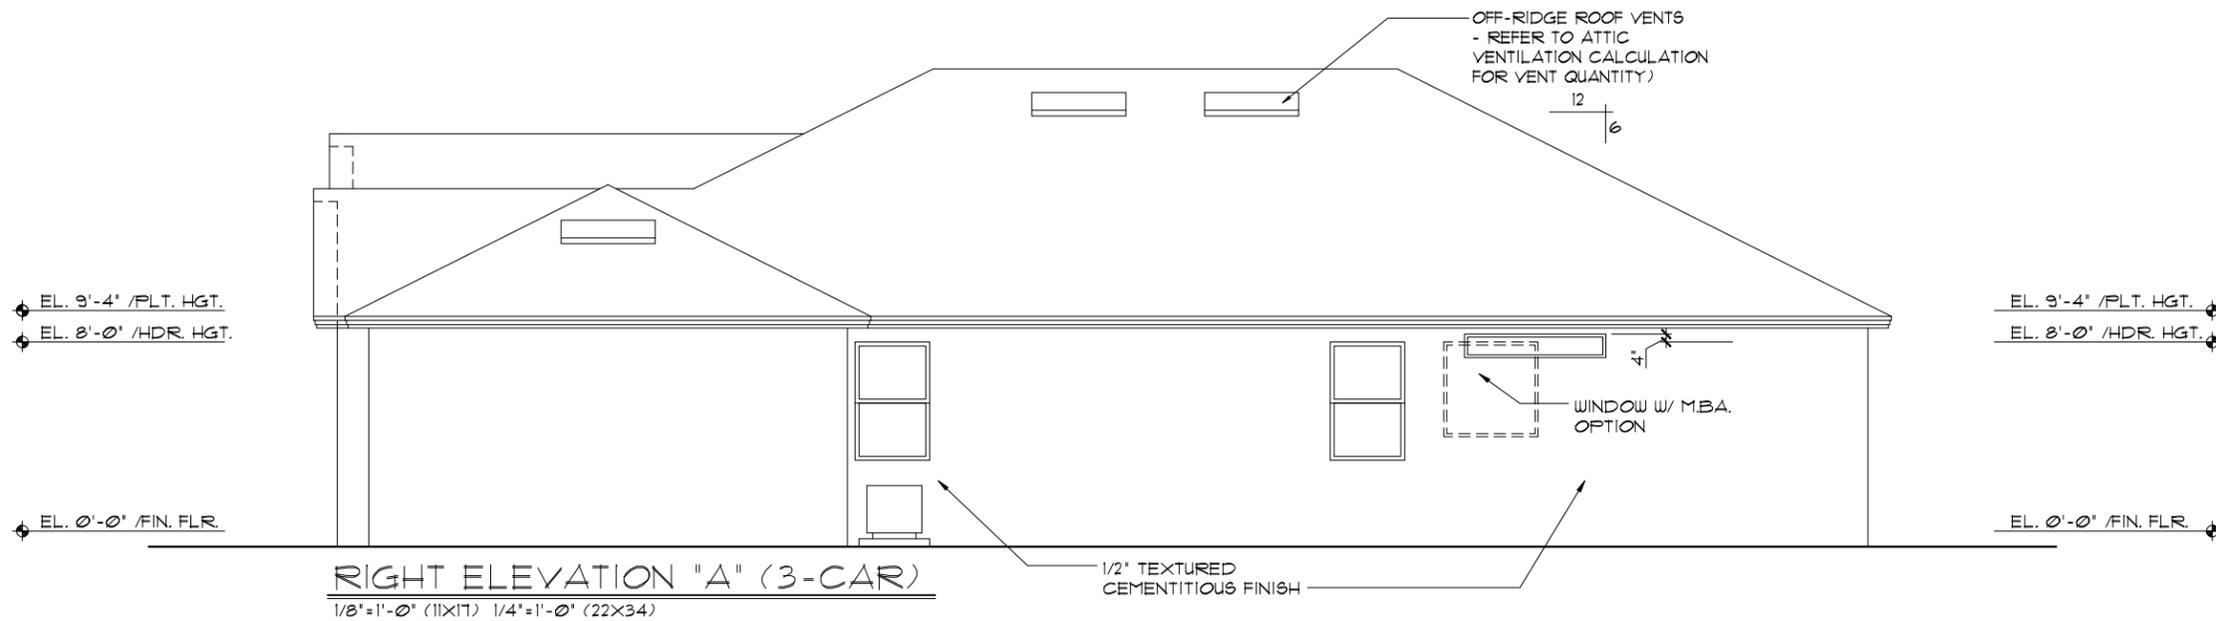
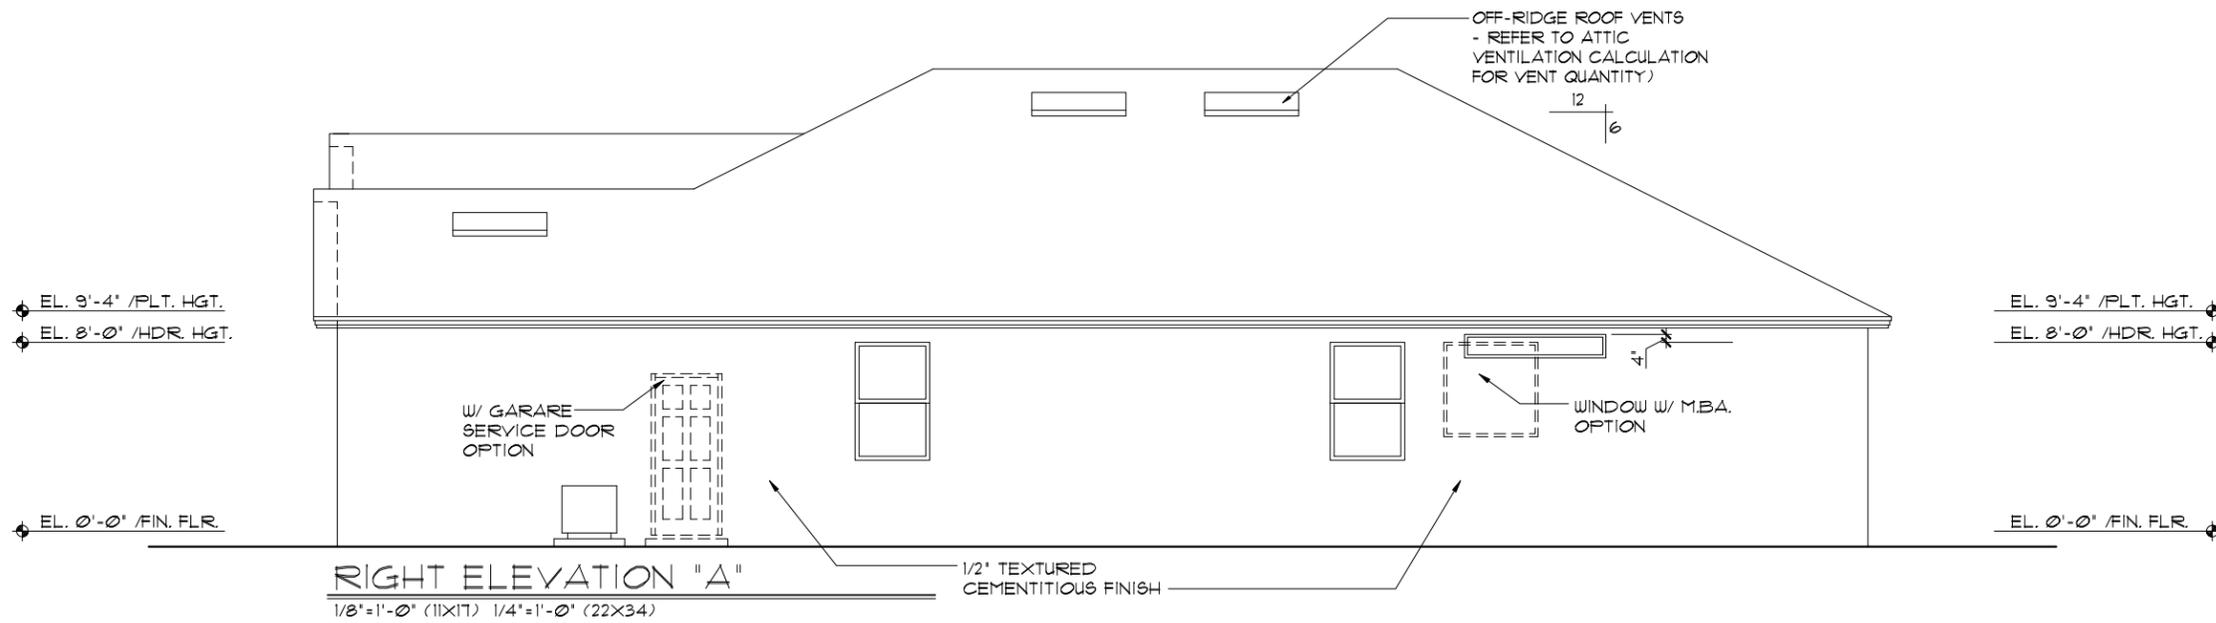
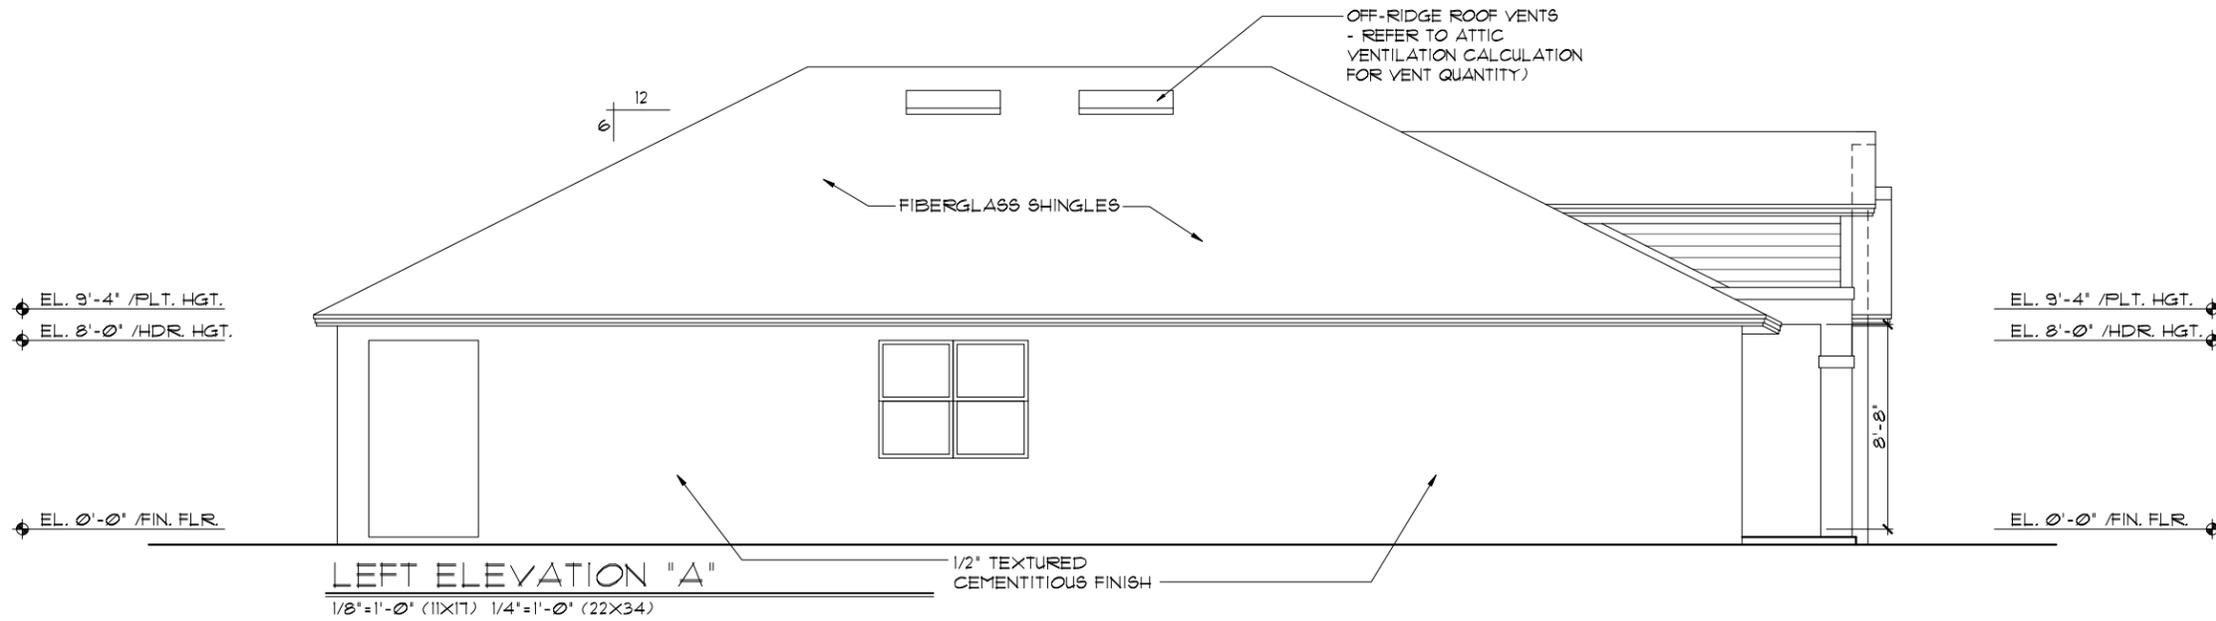


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
**LOT: 0000, COMMUNITY NAME**  
**FLORIDA SERIES**

Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida, 32811 Phone: (407) 529-3000	REVISIONS 05-16-19 JF
<b>Park Square HOMES</b>	
EXTERIOR ELEVATION LEFT AND RIGHT	
1966 MARGATE II	DATE 04-05-2017 SCALE AS NOTED DRAWN RDC JOB N/A SHEET <b>05A</b> OF 00 SHEETS

- EXTERIOR FINISH NOTES**
1. LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR. 2023
  2. PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR. 2023
  3. WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR. 2023
  4. WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR. 2023
  5. 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.

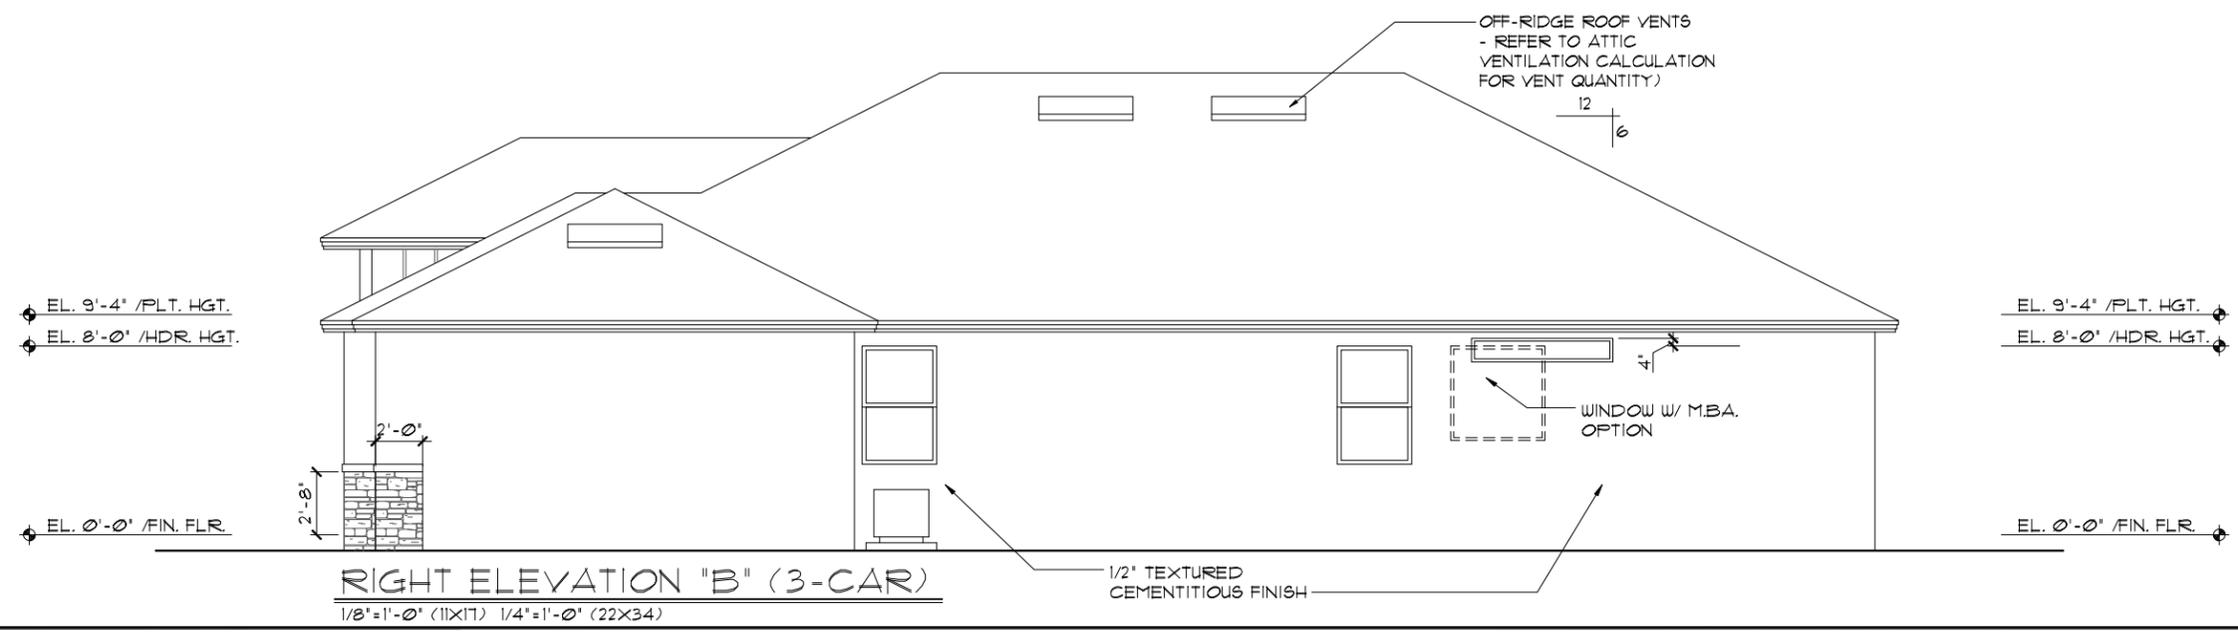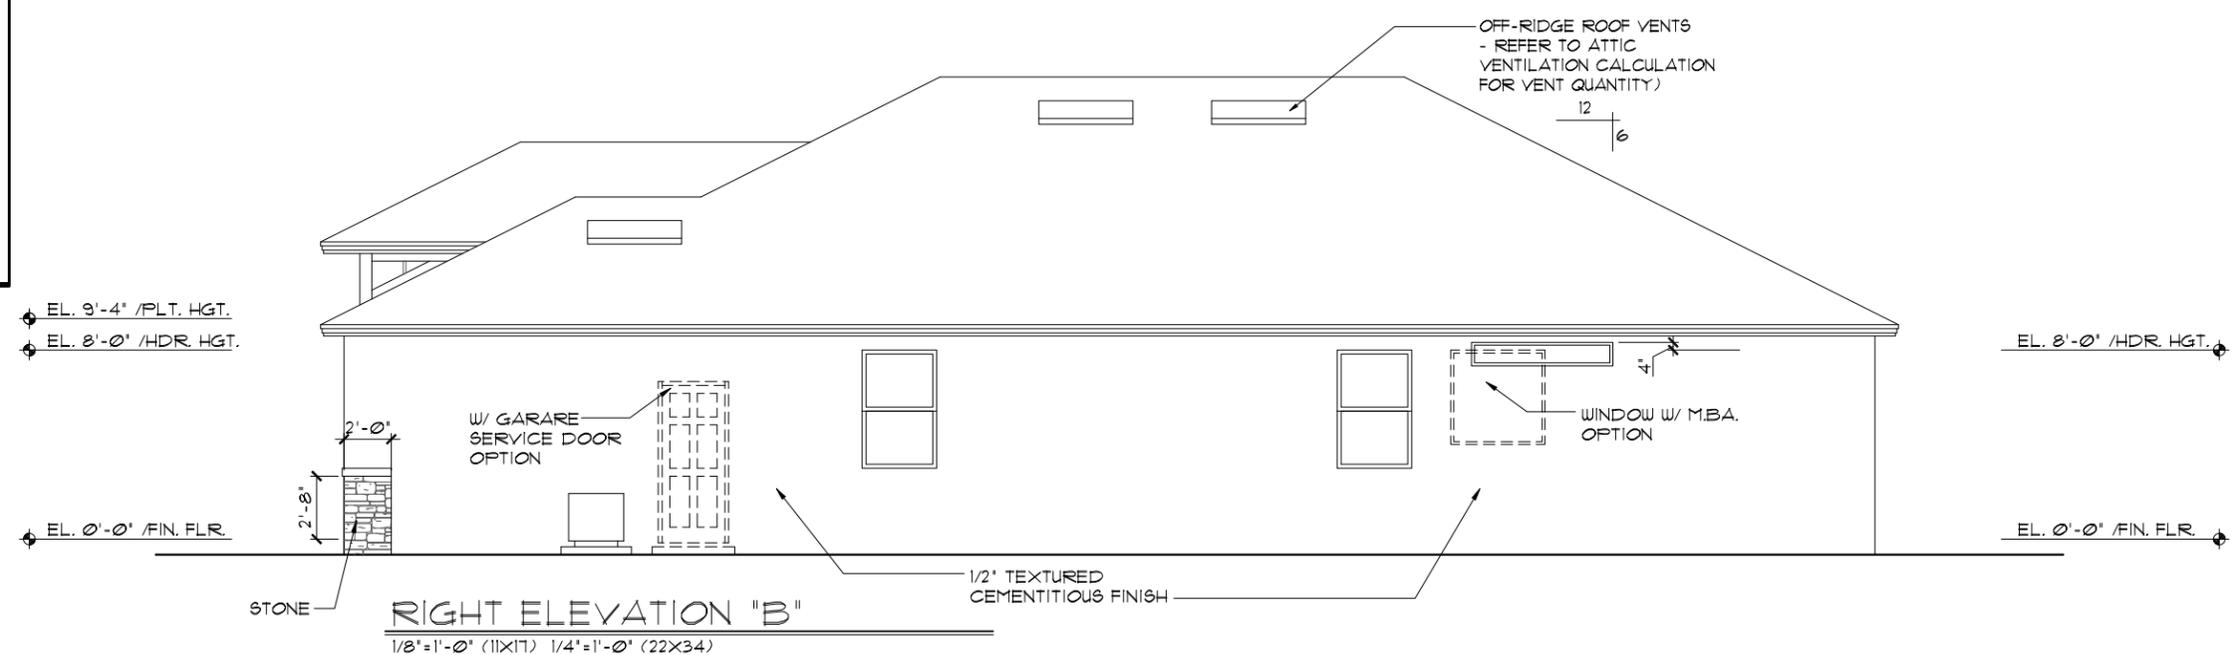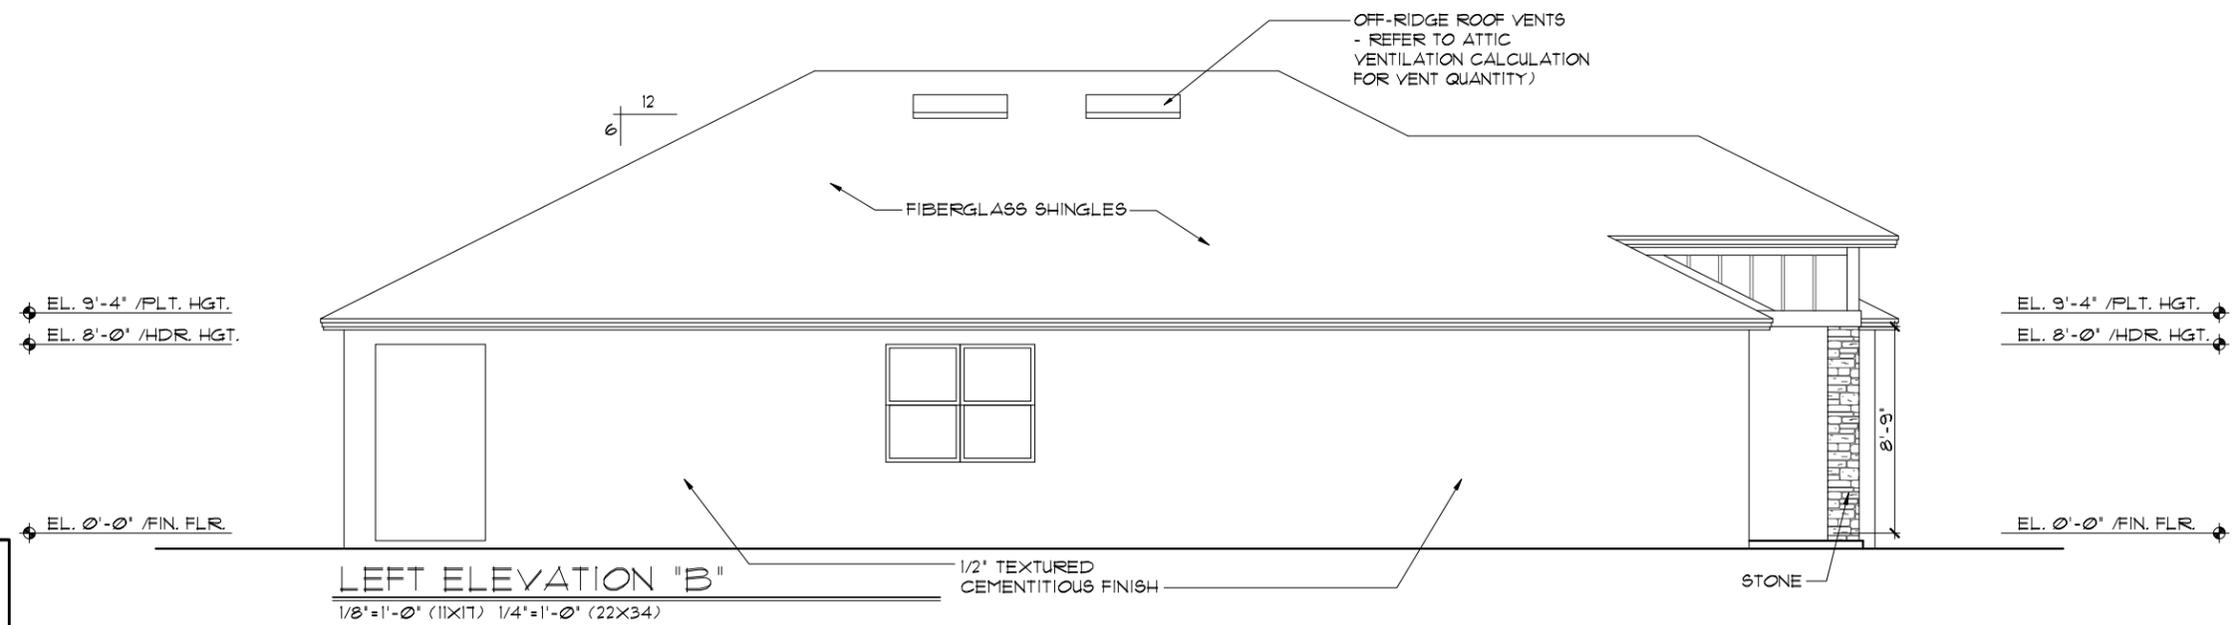

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 05B OF 00 SHEETS

**FLORIDA SERIES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000


REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 10000 South Orange Avenue, Suite 100  
 Orange, FL 32837  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com

**Park Square HOMES**  
 EXTERIOR ELEVATION LEFT AND RIGHT


**EXTERIOR FINISH NOTES**

- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR 2023
- PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR 2023
- WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR 2023
- WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR 2023
- 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.

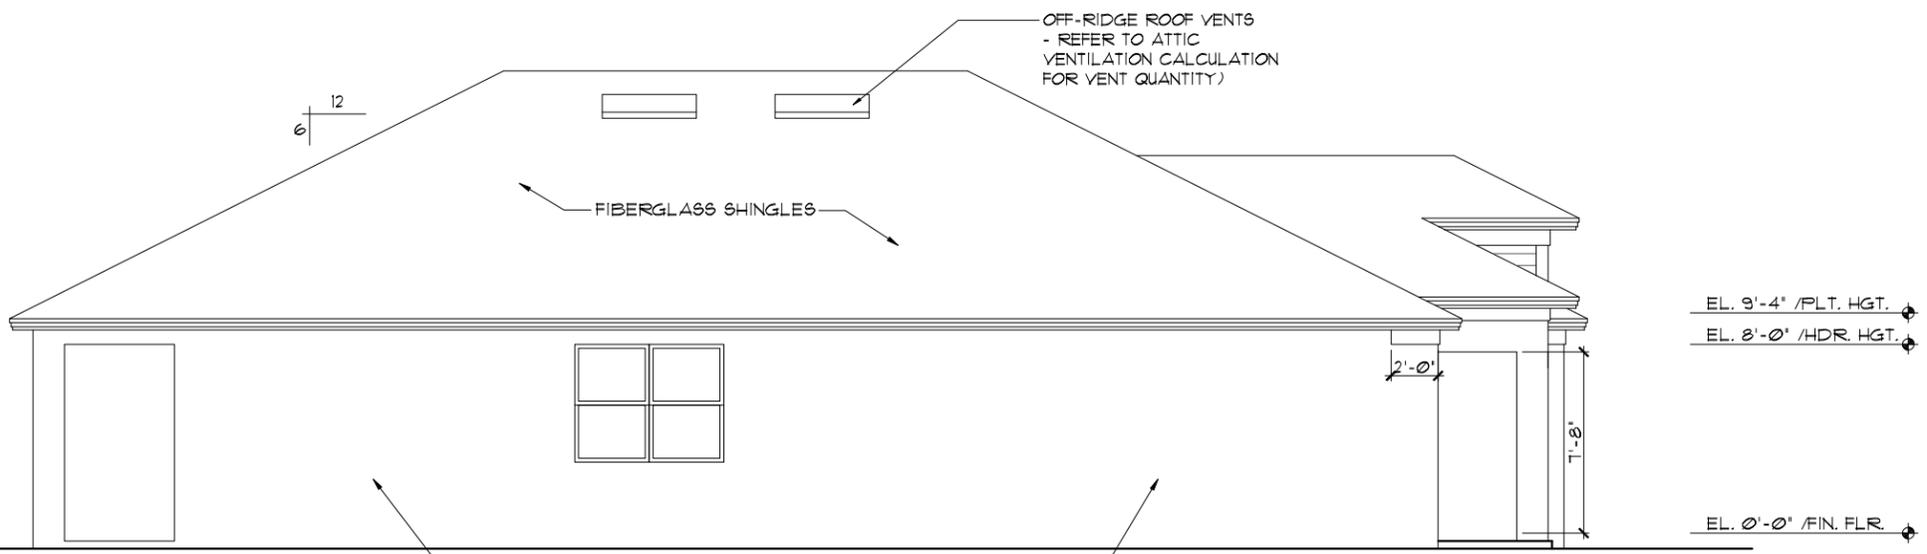


**LEFT ELEVATION "C"**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

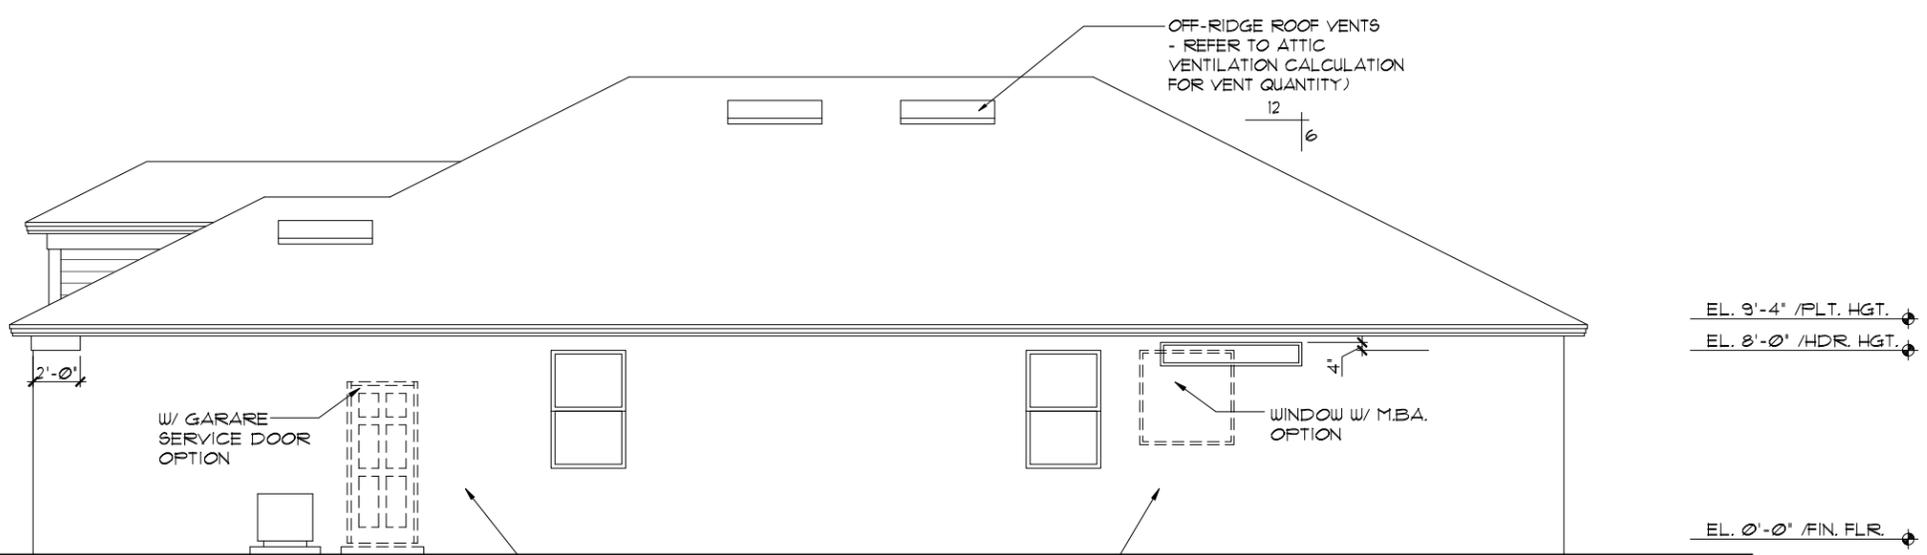

**RIGHT ELEVATION "C"**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

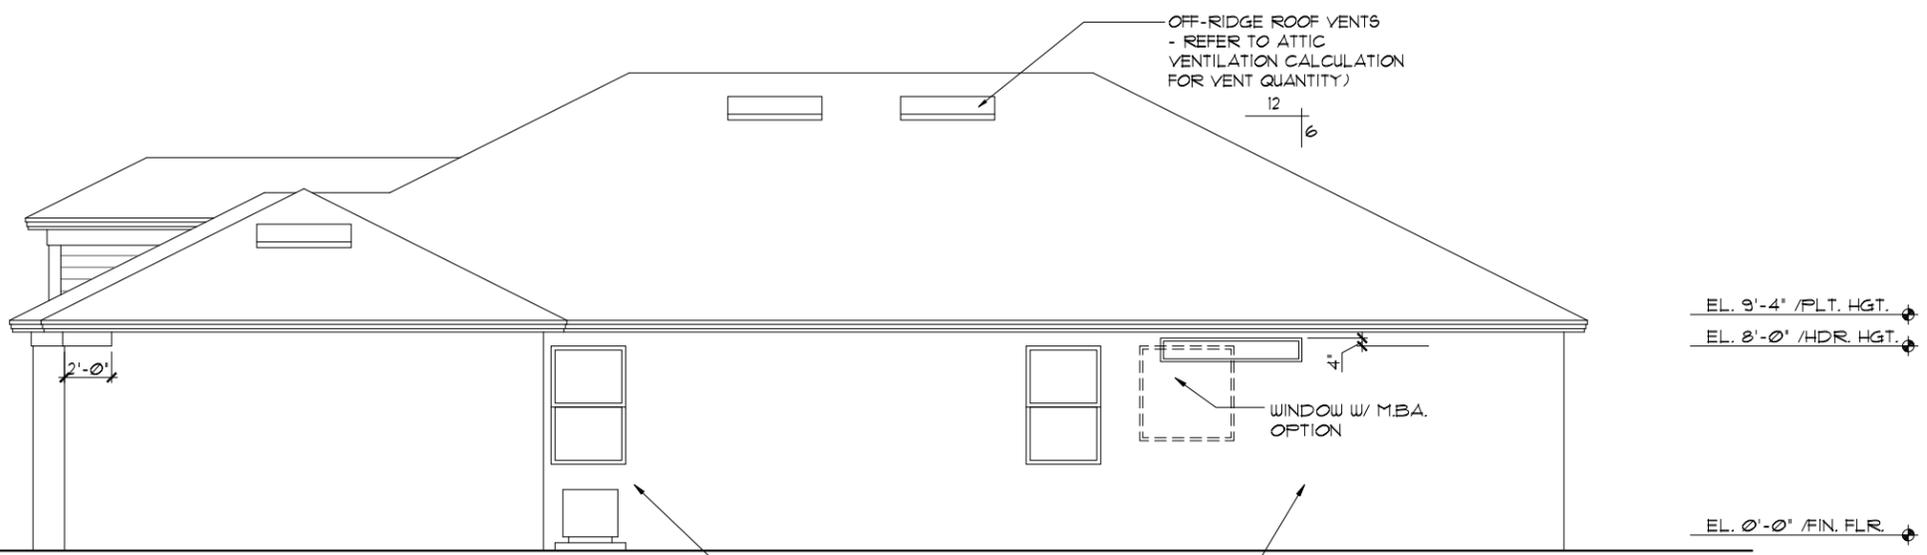

**RIGHT ELEVATION "C" (3-CAR)**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

FLORIDA SERIES

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF



**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 734-1790  
 www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

**Park Square HOMES**  
 EXTERIOR ELEVATION LEFT AND RIGHT

1966  
 MARGATE II

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	05C
OF	00 SHEETS

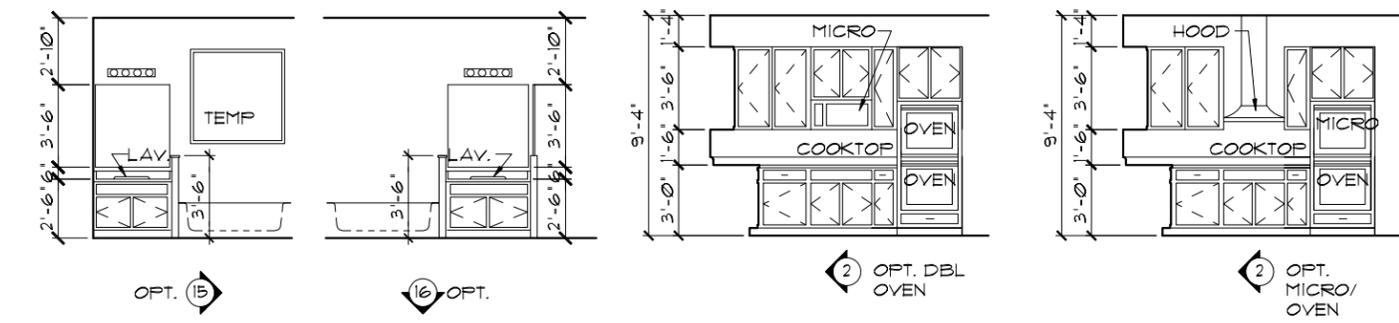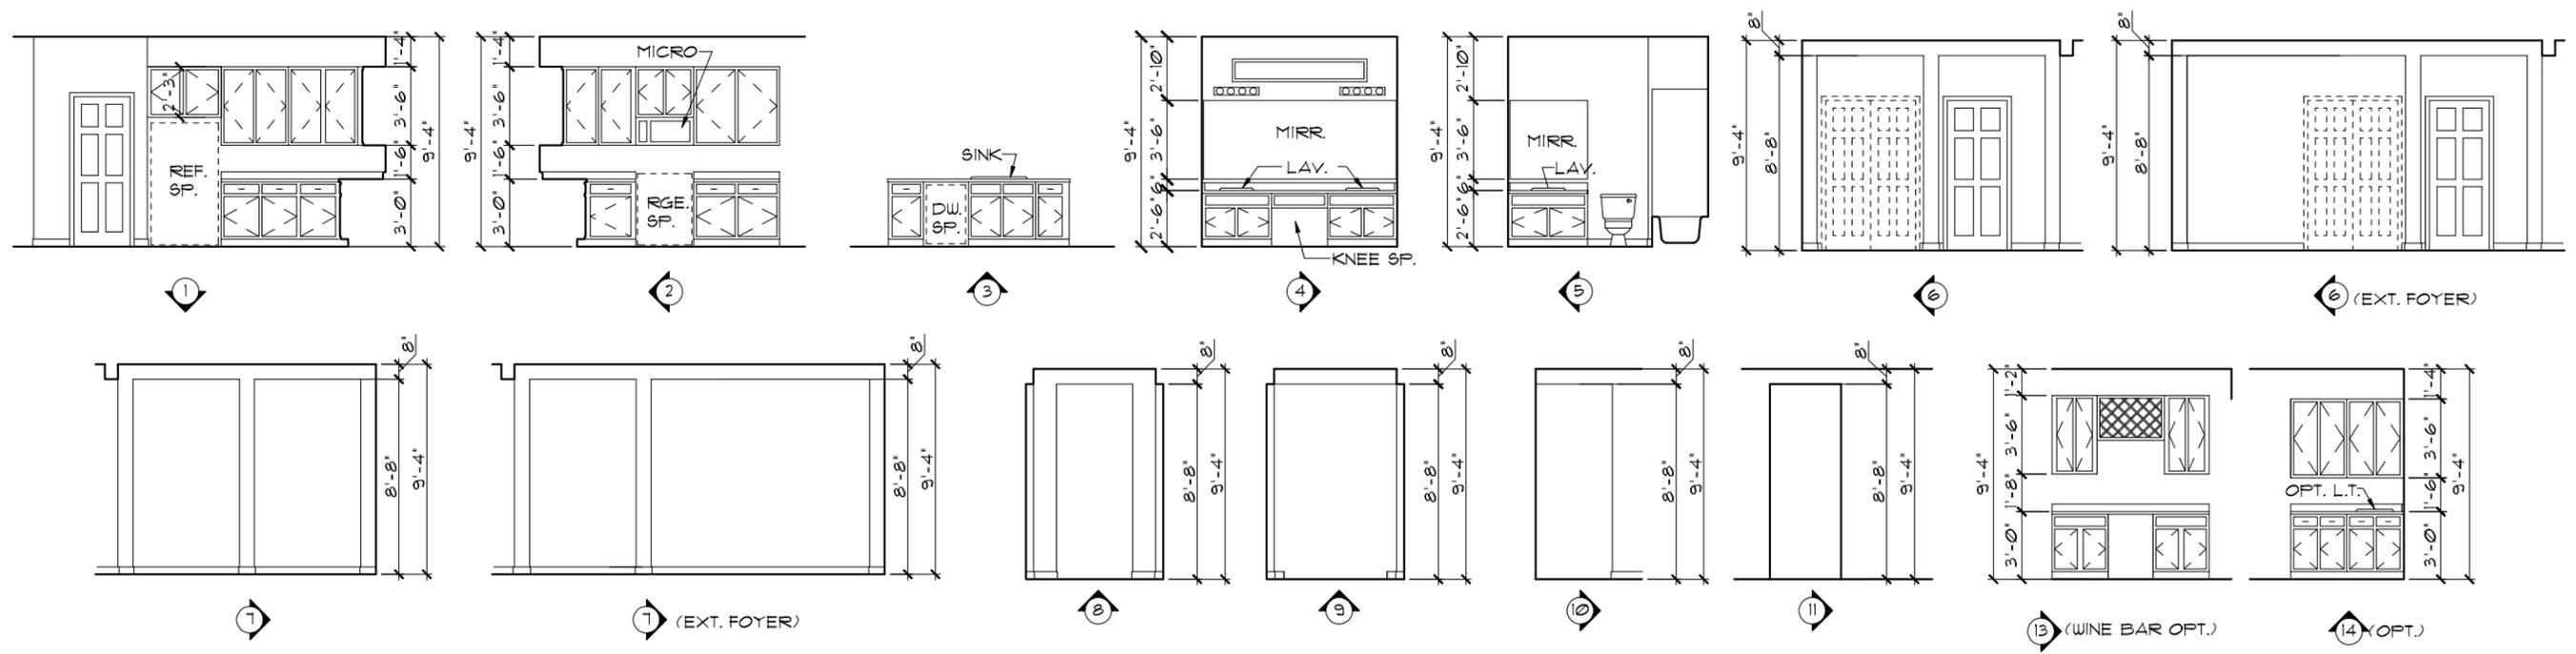


**INTERIOR ELEVATIONS**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)  
 NOTE: INTERIOR ELEVATIONS ARE CONCEPTUAL ONLY.  
 SEE CABINET SHOP DRAWINGS FOR FINAL VERIFICATION.

INSULATION INFORMATION- FBC- ENERGY R402, TABLE R402.12

WALL TYPES	INSULATION
1. CONCRETE BLOCK - INT INSULATION, EXTERIOR	R= 4.0
2. FRAME- WOOD EXTERIOR	R= 13.0
3. FRAME -WOOD, ADJACENT	R= 13.0
CEILING TYPES	
1. UNDER ATTIC (VENTED)	R= 30.0

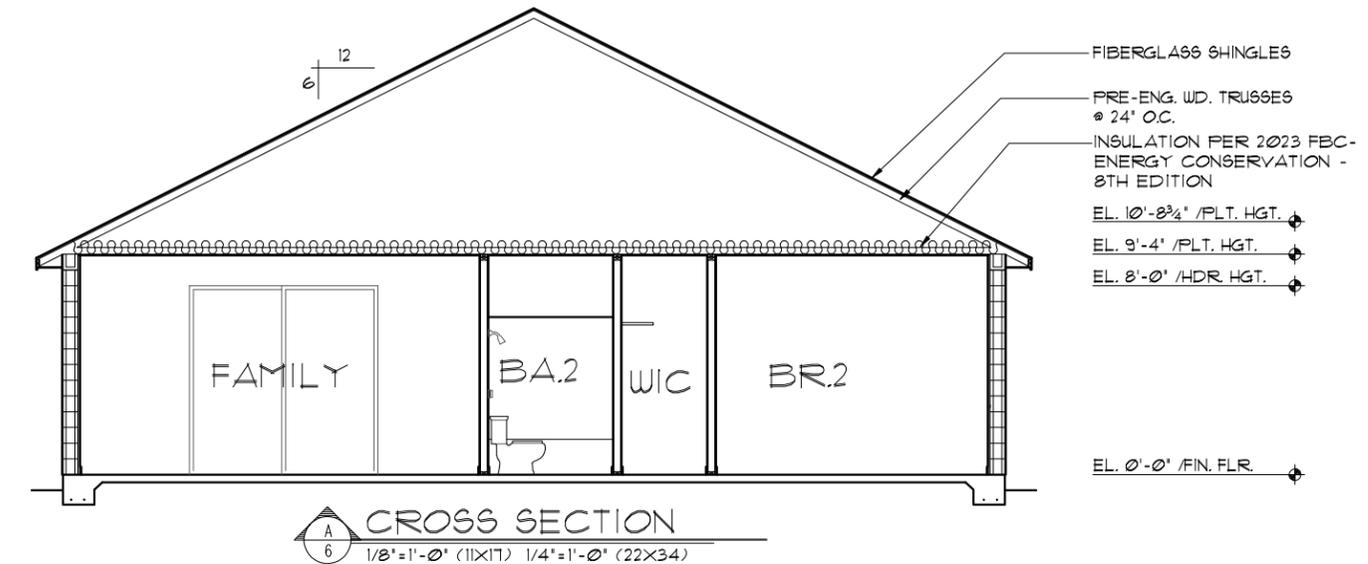


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 LOT: 0000, COMMUNITY NAME  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 06 OF 06 SHEETS

**FLORIDA SERIES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000  
**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 10000 Lake Nona Blvd, Suite 100  
 Orlando, FL 32826  
 Phone: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com  
 REVISIONS BY  
 05-16-19 JF  
**INTERIOR ELEVATIONS/ CROSS SECTION**

**MECHANICAL/GENERAL NOTES**

- PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL
- 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1
  - 2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.
    - A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION M1305.1
  - 3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.
  - 4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.
  - 5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.
  - 6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND LAUNDRY ROOM SHALL BE GFCI
  - 7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL # TO BE USED ON THIS JOB TO BE:
    - BRK: SMOKE-9120B, C/O- SC9120B
    - KIDDE: SMOKE-21007581, C/O 21006377-N
  - 8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED. F2801.1
  - 9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED.
  - 10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3
  - 11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-NEC 2020
  - 12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2)
  - 12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

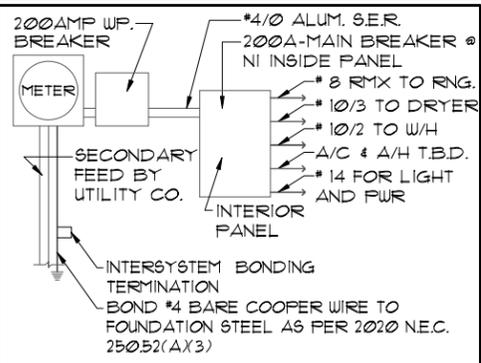

**ELECTRICAL RISER DIAGRAM**  
N.T.S.  
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.



250.52(A)3) Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.


There are two types of concrete-encased electrodes:  
(1) steel reinforcing bars or rods which are not less than 1/4 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete;  
(2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.

The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available in those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

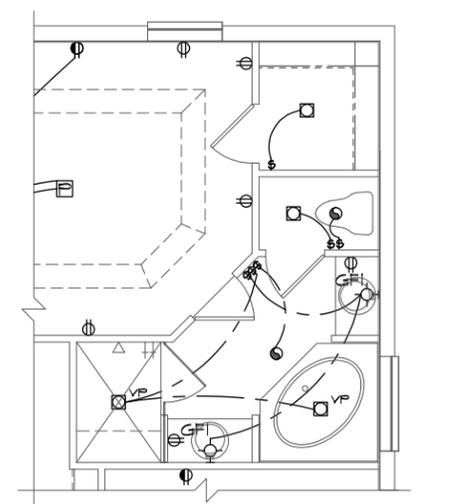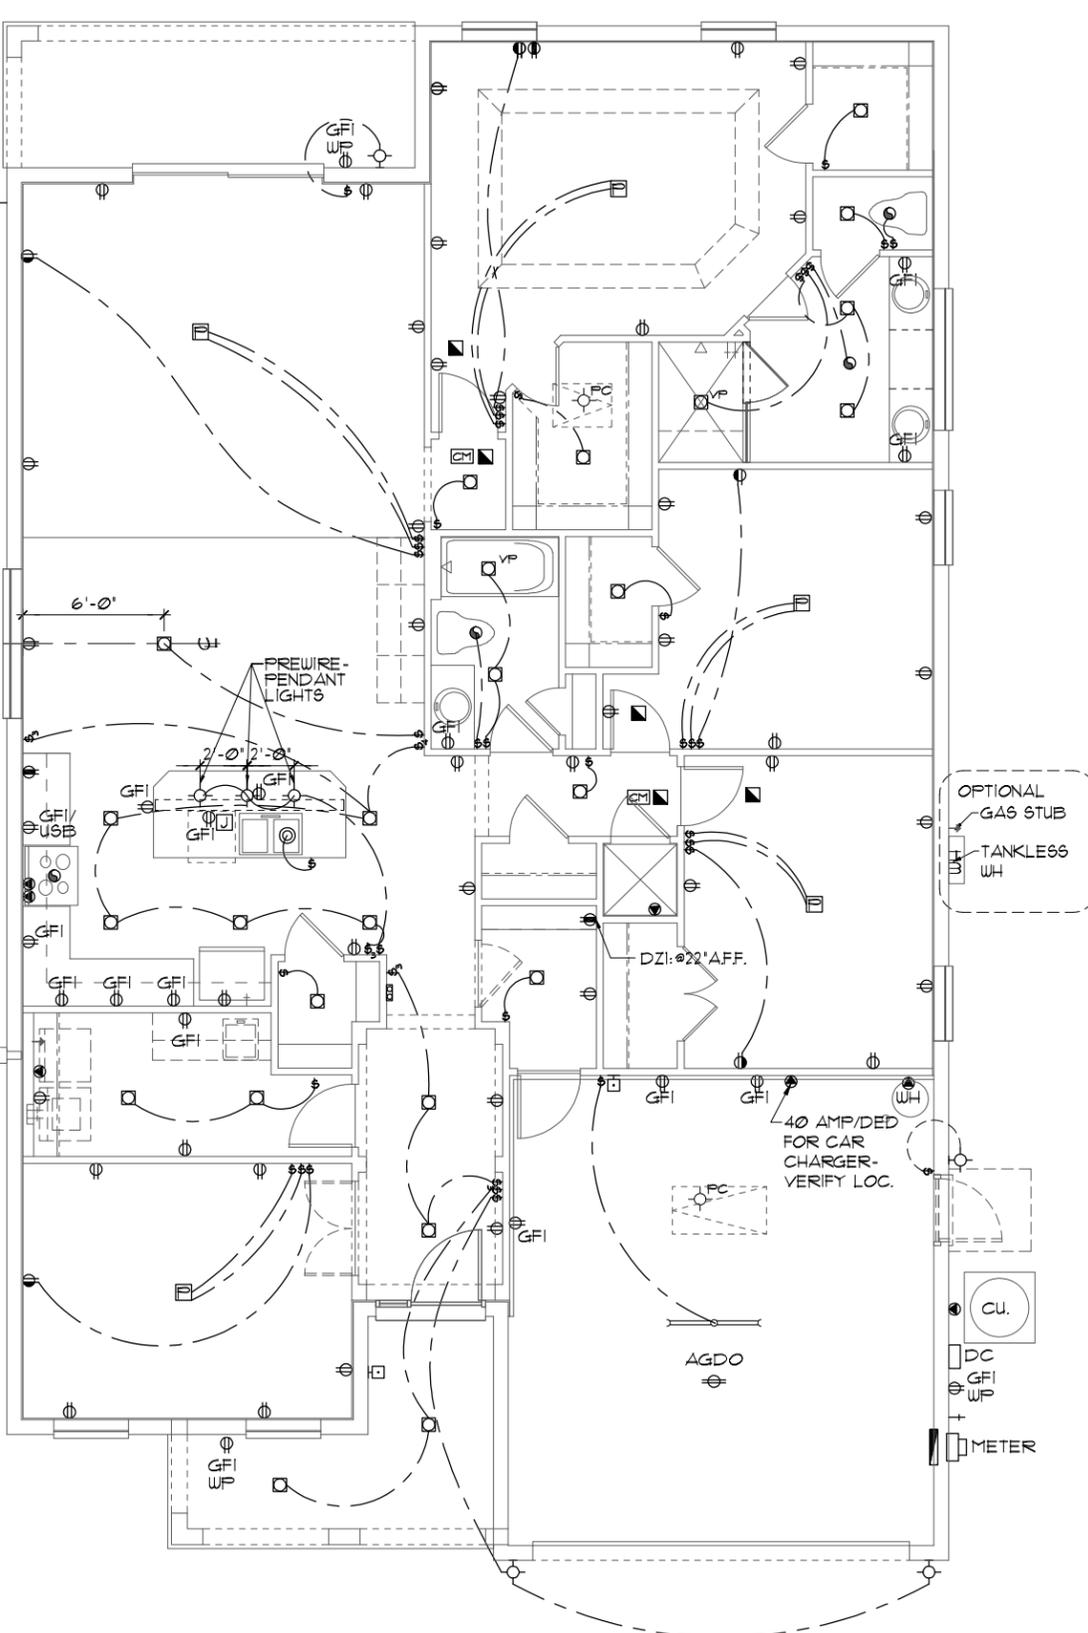

**M. BA. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

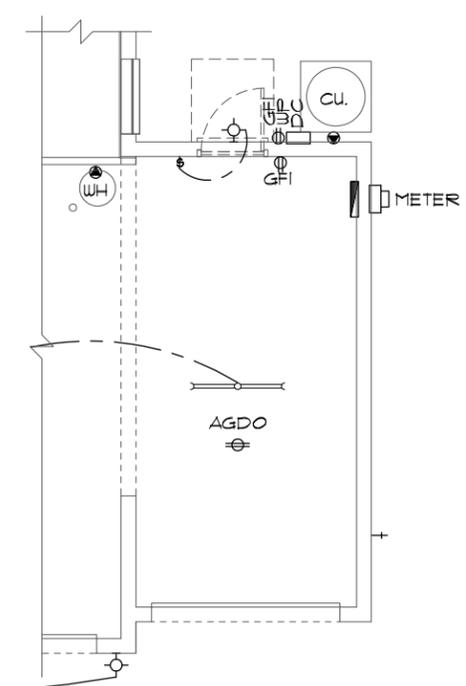

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL LEGEND**

⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	⊞	CHIMES
⊞	OUT. 110-115, W/ USB	⊞	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	⊞	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	⊞	PUSH BUTTON
⊞	SPL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., FULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL PLAN**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**FLORIDA SERIES**

**LOT: 0000, COMMUNITY NAME**

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET

1966

MARGATE II

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET

07

OF 00 SHEETS

NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS

REVISIONS BY

05-16-19 JF


**ITEG**  
HOBBS ENGINEERING GROUP, INC.  
10000 W. BIRCHWOOD BLVD. SUITE 100  
ORLANDO, FLORIDA 32817  
TEL: (407) 754-1400  
WWW.ITEG.COM

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 VINELAND ROAD, SUITE 200  
ORLANDO, FLORIDA 32817  
PHONE: (407) 529-3000

**Park Square HOMES**

**MECHANICAL/GENERAL NOTES**

- PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL
- 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1
  - 2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.
    - A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION M1305.1
  - 3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.
  - 4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.
  - 5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.
  - 6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND LAUNDRY ROOM SHALL BE GFCI
  - 7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL\* TO BE USED ON THIS JOB TO BE:
    - BRK: SMOKE-9120B, C/O- SC9120B
    - KIDDE: SMOKE-21007581, C/O 21006377-N
  - 8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED. P280.1
  - 9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED.
  - 10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3
  - 11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-NEC 2020
  - 12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2)
  - 12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

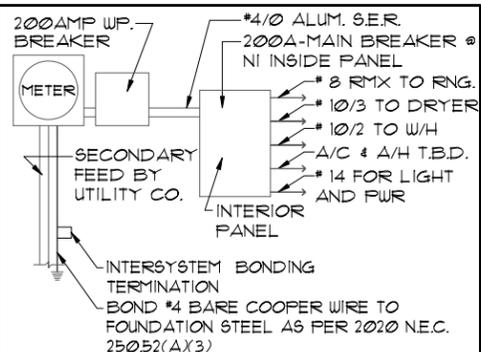

**ELECTRICAL RISER DIAGRAM**  
N.T.S.

NOTE:  
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.


250.52(A)3) Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes:  
(1) steel reinforcing bars or rods which are not less than 1/4 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete;  
(2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.


The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available in those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

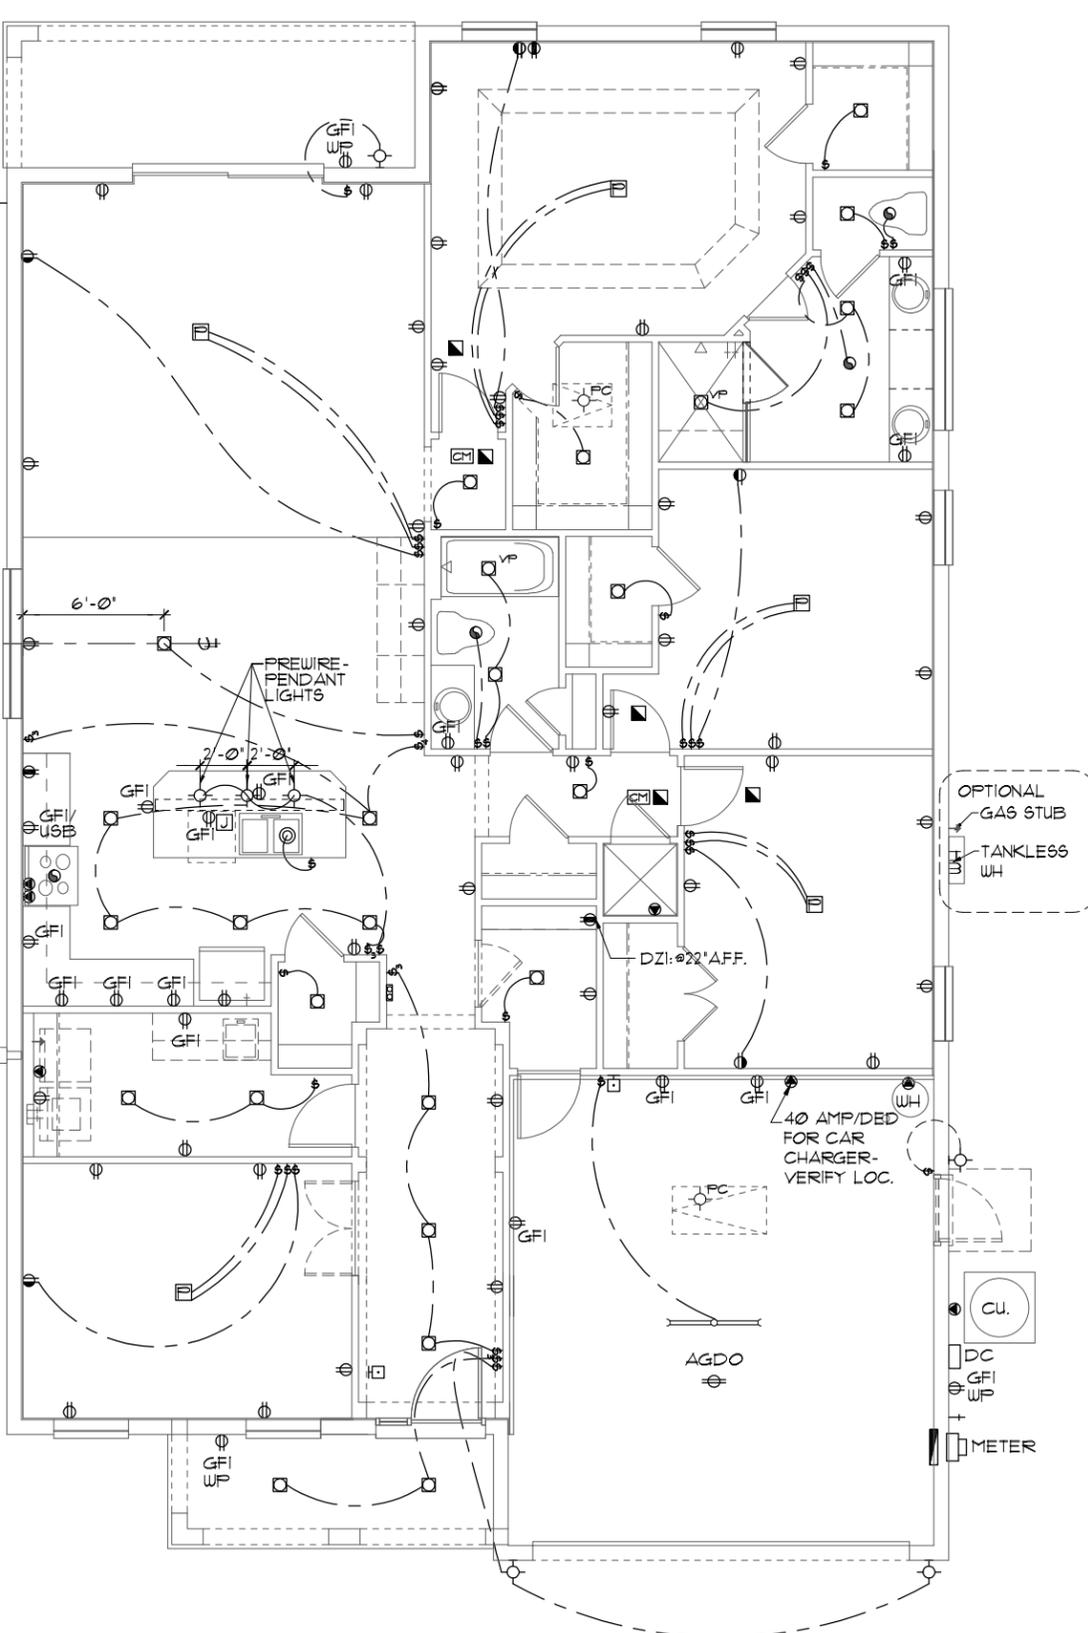


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL PLAN**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

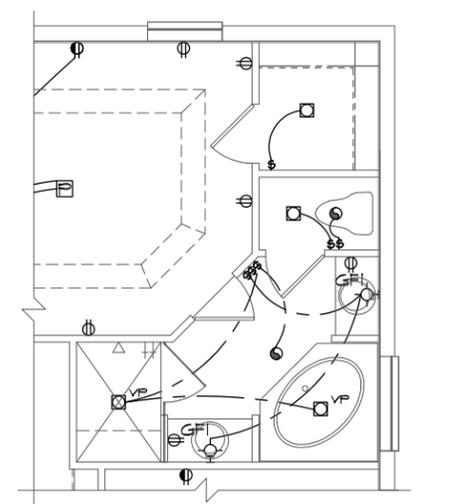

**M. BA. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

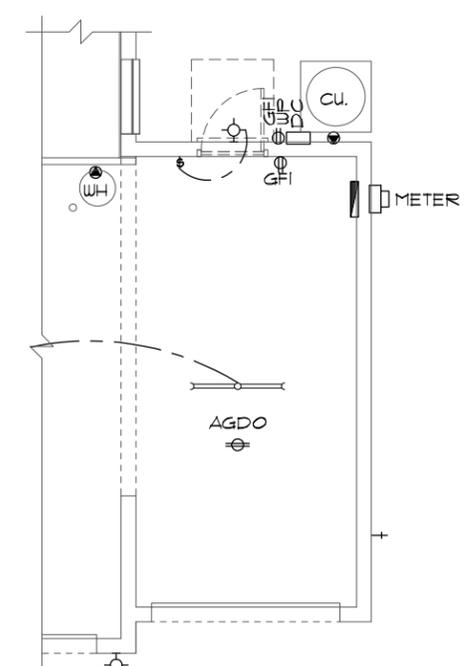

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS

ELECTRICAL LEGEND			
⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	⊞	CHIMES
⊞	OUT. 110-115, W/ USB	⊞	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	⊞	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	⊞	PUSH BUTTON
⊞	SPL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., FULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

LOT: 000, COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 FLORIDA SERIES  
 IATEC  
 ILLIUMINATIONS ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 734-1790  
 www.iatec.com

REVISIONS	BY
05-16-19	JF

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

**Park Square HOMES**  
 ELECTRICAL PLAN  
 EXTENDED FOYER

1966  
 MARGATE II

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 07 OF 00 SHEETS

**MECHANICAL/GENERAL NOTES**

PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL  
 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE  
 COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE  
 FOR BUILDING CONSTRUCTION 610.1 ABC.1

2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION,  
 SERVICE, REPAIR AND REPLACEMENT WITHOUT  
 REMOVING PERMANENT CONSTRUCTION.

A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION  
 M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY  
 BALANCED. ALL ROOMS ISOLATED FROM THE RETURN  
 AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH  
 SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.

4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH  
 CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE  
 FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION-  
 KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS,  
 PARLORS, LIBRARIES, BEDROOMS, DEN, CLOSETS,  
 SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR  
 AREAS SHALL BE PROTECTED BY A LISTED AFCI  
 DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V  
 RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.

6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND  
 LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS,  
 SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF  
 PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-  
 STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS  
 MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS  
 & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3  
 & R314.4. MODEL\* TO BE USED ON THIS JOB TO BE:  
 BRK: SMOKE-9120B, C/O- SC9120B  
 KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO  
 BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS  
 MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER  
 HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION  
 RESISTANT. IAW FBCR 2023,  
 8TH ED. P2801.1


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER  
 HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED  
 SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18"  
 ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS  
 FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023,  
 8TH ED.

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL  
 BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN  
 SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER  
 NFPA70-NEC 2020

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN  
 ACCORDANCE WITH NEC 250.53(A)2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN  
 ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

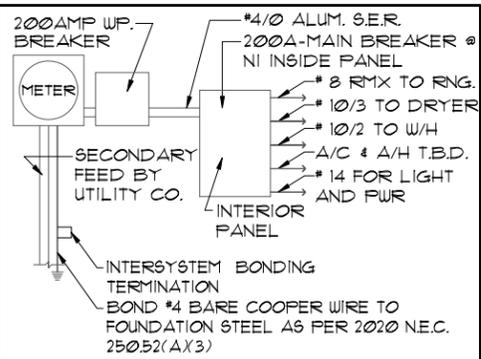

**ELECTRICAL RISER DIAGRAM**

NOTE:  
 N.T.S.  
 ELECTRICAL MATERIALS AND INSTALLATIONS  
 SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE  
 NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL  
 CODES, AND THE LOCAL POWER COMPANY.

250.52(A)3) Concrete-Encased  
 Electrode. Concrete-encased  
 electrodes can be  
 horizontal or vertical and must be  
 at least 20 ft. long.

Concrete-encased electrodes can  
 be horizontal or vertical and must  
 be at least 20 ft. long.

There are two types of  
 concrete-encased electrodes:  
 (1) steel reinforcing bars  
 or rods which are not less than  
 1/2 inch in diameter and at least  
 20 ft. long, encased in 2 inches  
 of concrete; (2) 20 ft. of bare  
 copper conductor not  
 smaller than No. 4 AWG encased in  
 2 inches of concrete.

The steel reinforcing rods must be  
 in a location that is in direct  
 contact with the earth.  
 The reinforcing rods can be  
 connected with tie wires, and a  
 single length of rod can be used  
 as the concrete-encased electrode.  
 The reinforcing rods cannot be  
 coated with non-conductive material.

Section 250.50 requires a  
 concrete-encased electrode to be  
 connected to the grounding  
 electrode system if it is present.  
 Several states have modified this  
 requirement to say a  
 concrete-encased electrode must  
 be used as a grounding electrode  
 only if it is available in those  
 jurisdictions, if the  
 footings or foundations have been  
 poured before the electrical  
 contractor arrives at the site,  
 and a reinforcing  
 rod is not available for use as a  
 grounding electrode, then a  
 grounding connection to the  
 reinforcing rod is NOT  
 required.

**ELECTRICAL LEGEND**



⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	⊞	CHIMES
⊞	OUT. 110-115, W/ USB	⊞	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	⊞	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	⊞	PUSH BUTTON
⊞	SPL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., FULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

**BEDROOM 4 OPT.**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)


**ELECTRICAL PLAN**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

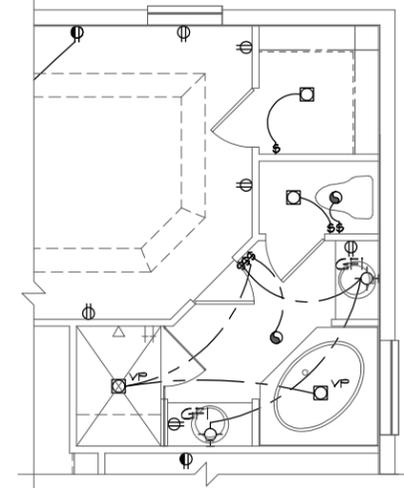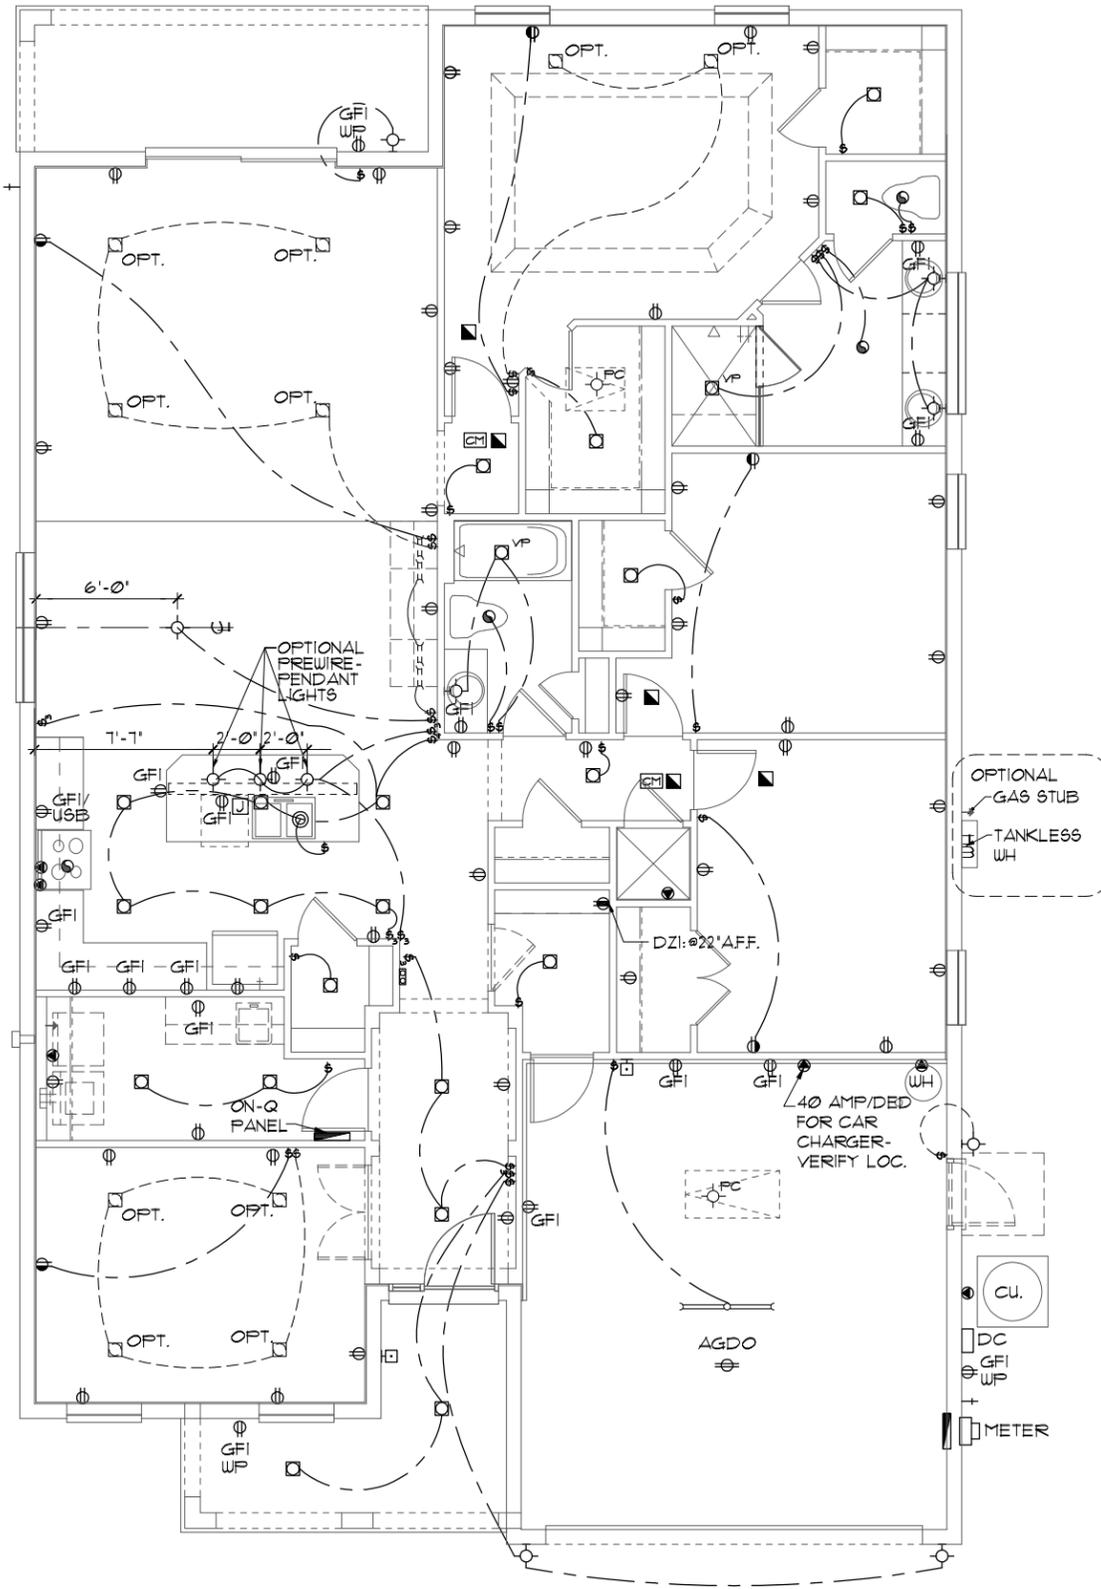

**M. B.A. OPTION**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

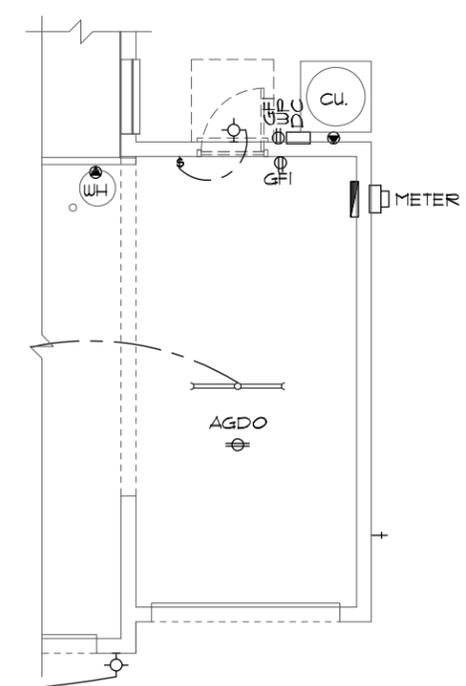

**3-CAR GAR. OPT.**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTE: SEE FINAL COLOR SHEET FOR  
 TV, FANS & PHONE LOCATIONS

LOT: 0000, COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 FLORIDA SERIES  
 IATEC  
 IATEC ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 734-1790  
 www.iatec.com  
 A DIVISION OF PARK SQUARE  
 ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000  
 Park Square  
 HOMES  
 ELECTRICAL PLAN  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 07  
 OF 00 SHEETS  
 COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and designs. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.



**MECHANICAL/GENERAL NOTES**

PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL  
 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE  
 COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE  
 FOR BUILDING CONSTRUCTION 610.1 ABC.1

2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION,  
 SERVICE, REPAIR AND REPLACEMENT WITHOUT  
 REMOVING PERMANENT CONSTRUCTION.  
 A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION  
 M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY  
 BALANCED. ALL ROOMS ISOLATED FROM THE RETURN  
 AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH  
 SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.

4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH  
 CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE  
 FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION-  
 KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS,  
 PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS,  
 SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR  
 AREAS SHALL BE PROTECTED BY A LISTED AFCI  
 DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V  
 RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.  
 6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND  
 LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS,  
 SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3'  
 OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-  
 STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS  
 MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS  
 & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3  
 & R314.4. MODEL\* TO BE USED ON THIS JOB TO BE:  
 BRK: SMOKE-9120B, C/O- SC9120B  
 KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO  
 BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS  
 MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER  
 HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION  
 RESISTANT. IAW FBCR 2023,  
 8TH ED. P2801.1


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER  
 HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED  
 SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18"  
 ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS  
 FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023,  
 8TH ED.

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL  
 BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN  
 SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER  
 NFPA70-NEC 2020

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN  
 ACCORDANCE WITH NEC 250.53(A)2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN  
 ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

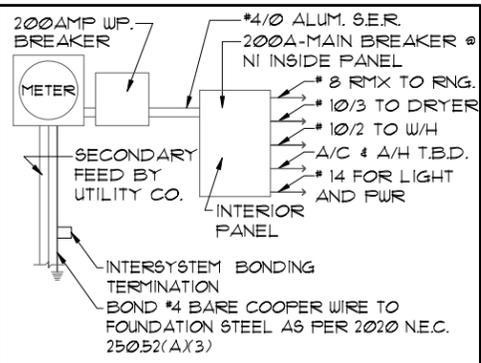


**ELECTRICAL RISER DIAGRAM**  
 NOTE:  
 N.T.S.  
 ELECTRICAL MATERIALS AND INSTALLATIONS  
 SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE  
 NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL  
 CODES, AND THE LOCAL POWER COMPANY.

250.52(A)3) Concrete-Encased  
 Electrode. Concrete-encased  
 electrodes can be  
 horizontal or vertical and must be  
 at least 20 ft. long.  
 Concrete-encased electrodes can  
 be horizontal or vertical and must  
 be at least 20 ft. long.

There are two types of  
 concrete-encased electrodes:  
 (1) steel reinforcing bars  
 or rods which are not less than  
 1/4 inch in diameter and at least  
 20 ft. long, encased in 2 inches  
 of concrete; (2) 20 ft. of bare  
 copper conductor not  
 smaller than No. 4 AWG encased in  
 2 inches of concrete.


The steel reinforcing rods must be  
 in a location that is in direct  
 contact with the earth.  
 The reinforcing rods can be  
 connected with tie wires, and a  
 single length of rod can be used  
 as the concrete-encased electrode.  
 The reinforcing rods cannot be  
 coated with non-conductive material.

Section 250.50 requires a  
 concrete-encased electrode to be  
 connected to the grounding  
 electrode system if it is present.  
 Several states have modified this  
 requirement to say a  
 concrete-encased electrode must  
 be used as a grounding electrode  
 only if it is available in those  
 jurisdictions, if the  
 footings or foundations have been  
 poured before the electrical  
 contractor arrives at the site,  
 and a reinforcing  
 rod is not available for use as a  
 grounding electrode, then a  
 grounding connection to the  
 reinforcing rod is  
 required.

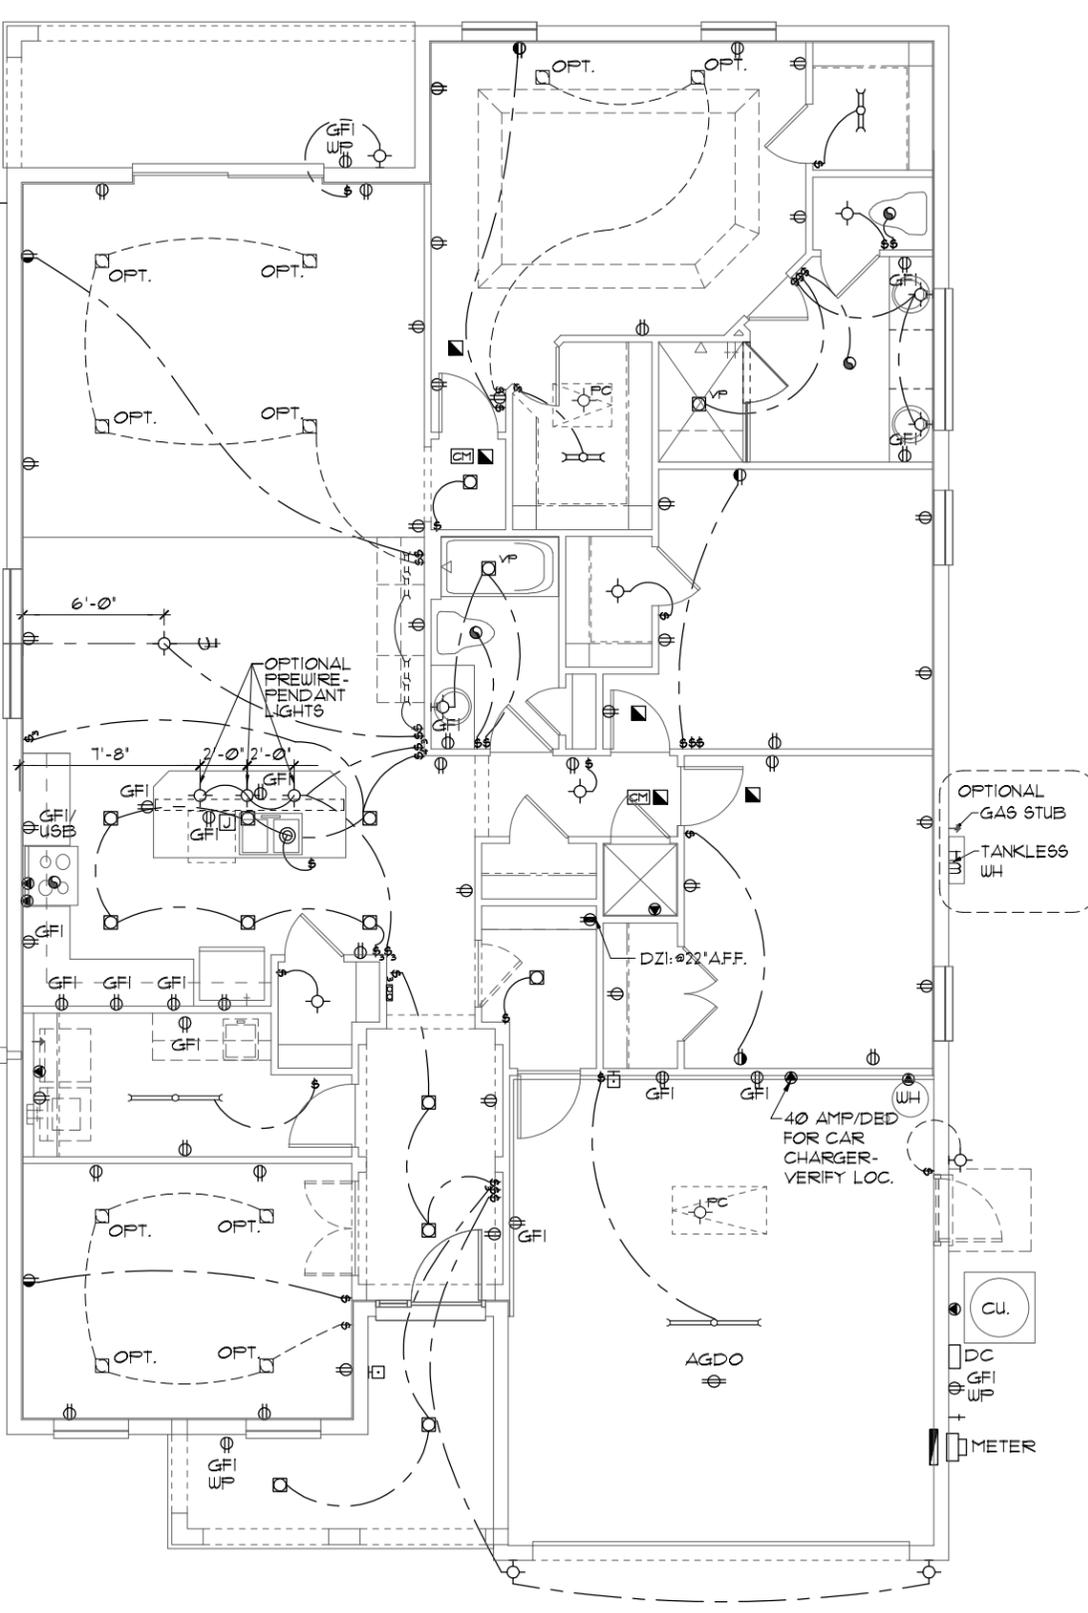


**BEDROOM 4 OPT.**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL PLAN**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

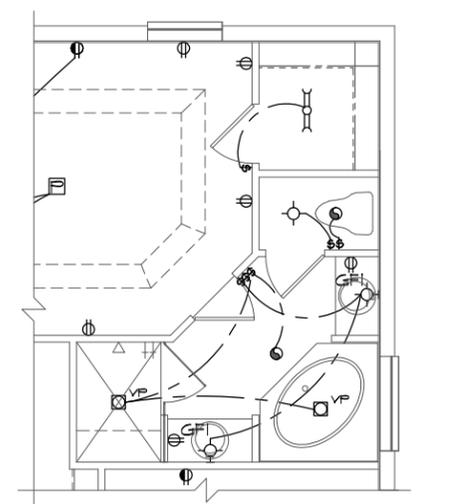

**M. B.A. OPTION**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

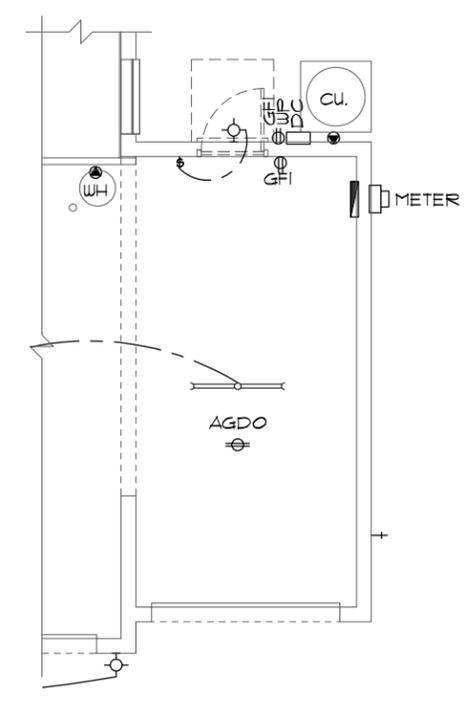


**3-CAR GAR. OPT.**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

ELECTRICAL LEGEND			
⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	⊞	CHIMES
⊞	OUT. 110-115, W/ USB	⊞	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	⊞	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	⊞	PUSH BUTTON
⊞	SPL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., PULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

NOTE: SEE FINAL COLOR SHEET FOR  
 TV, FANS & PHONE LOCATIONS

LOT: 0000, COMMUNITY NAME  
 FLORIDA SERIES  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 COPYRIGHT 2022 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and designs. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.  
 IITEG  
 ILLUMINON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iiteg.com  
 A DIVISION OF PARK SQUARE  
 ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000  
 Park Square  
 Homes  
 ELECTRICAL PLAN  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 07  
 OF 00 SHEETS

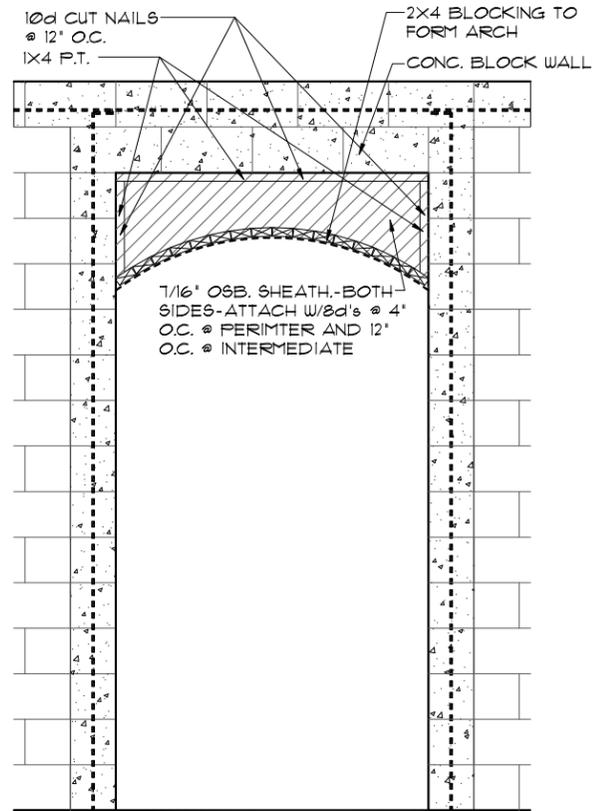

4  
8A  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL: ----- 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F. /VENT.  
(VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
(.50 LF. @ 0.0878S.F. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCS1.1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4069 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - LOMANCO: (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL: 2-1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.

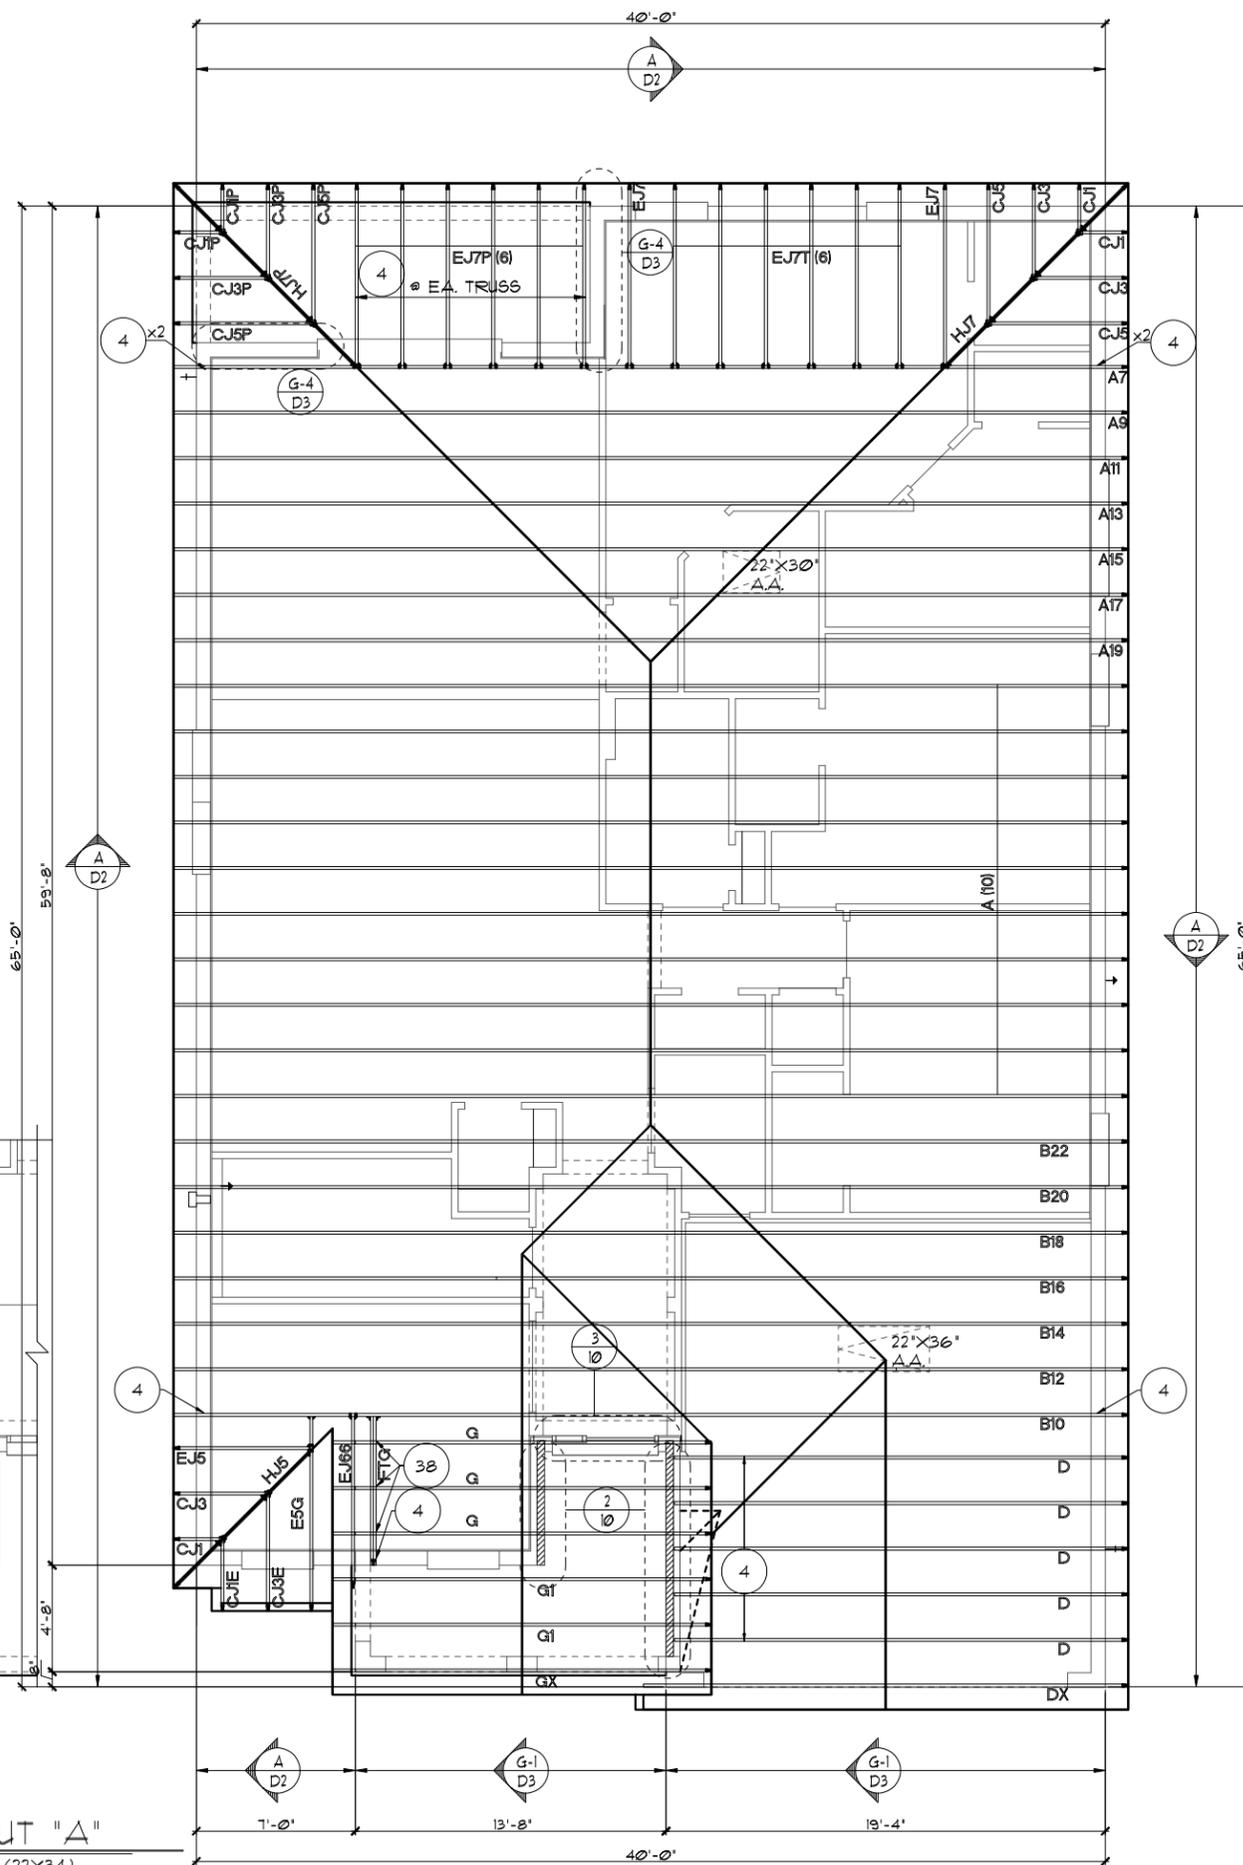

TRUSS LAYOUT "A"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000 COMMUNITY NAME

© COPYRIGHT 2023 Park Square Homes. Park Square Homes, its common law copyrights and other copyrights in these plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	SH

**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
4001 Westwood Road, Suite 400, Orlando, FL 32811  
Phone: (407) 241-1700  
www.iteg.com


A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529-3000

**Park Square HOMES**

TRUSS LAYOUT

1966  
MARGATE II

DATE 04-05-2011  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
08A  
OF 00 SHEETS

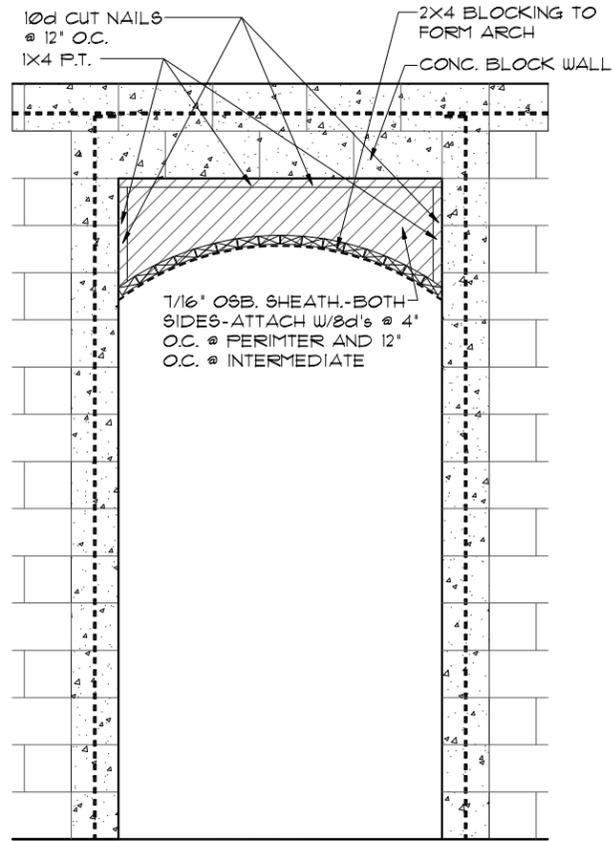

4  
8A  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{SF.}}{300} = 8.64\text{SF.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- 4.68SF.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78SF. /VENT.  
(VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 4.32SF.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( 50 LF. @ 0.087SF. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA ECSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1

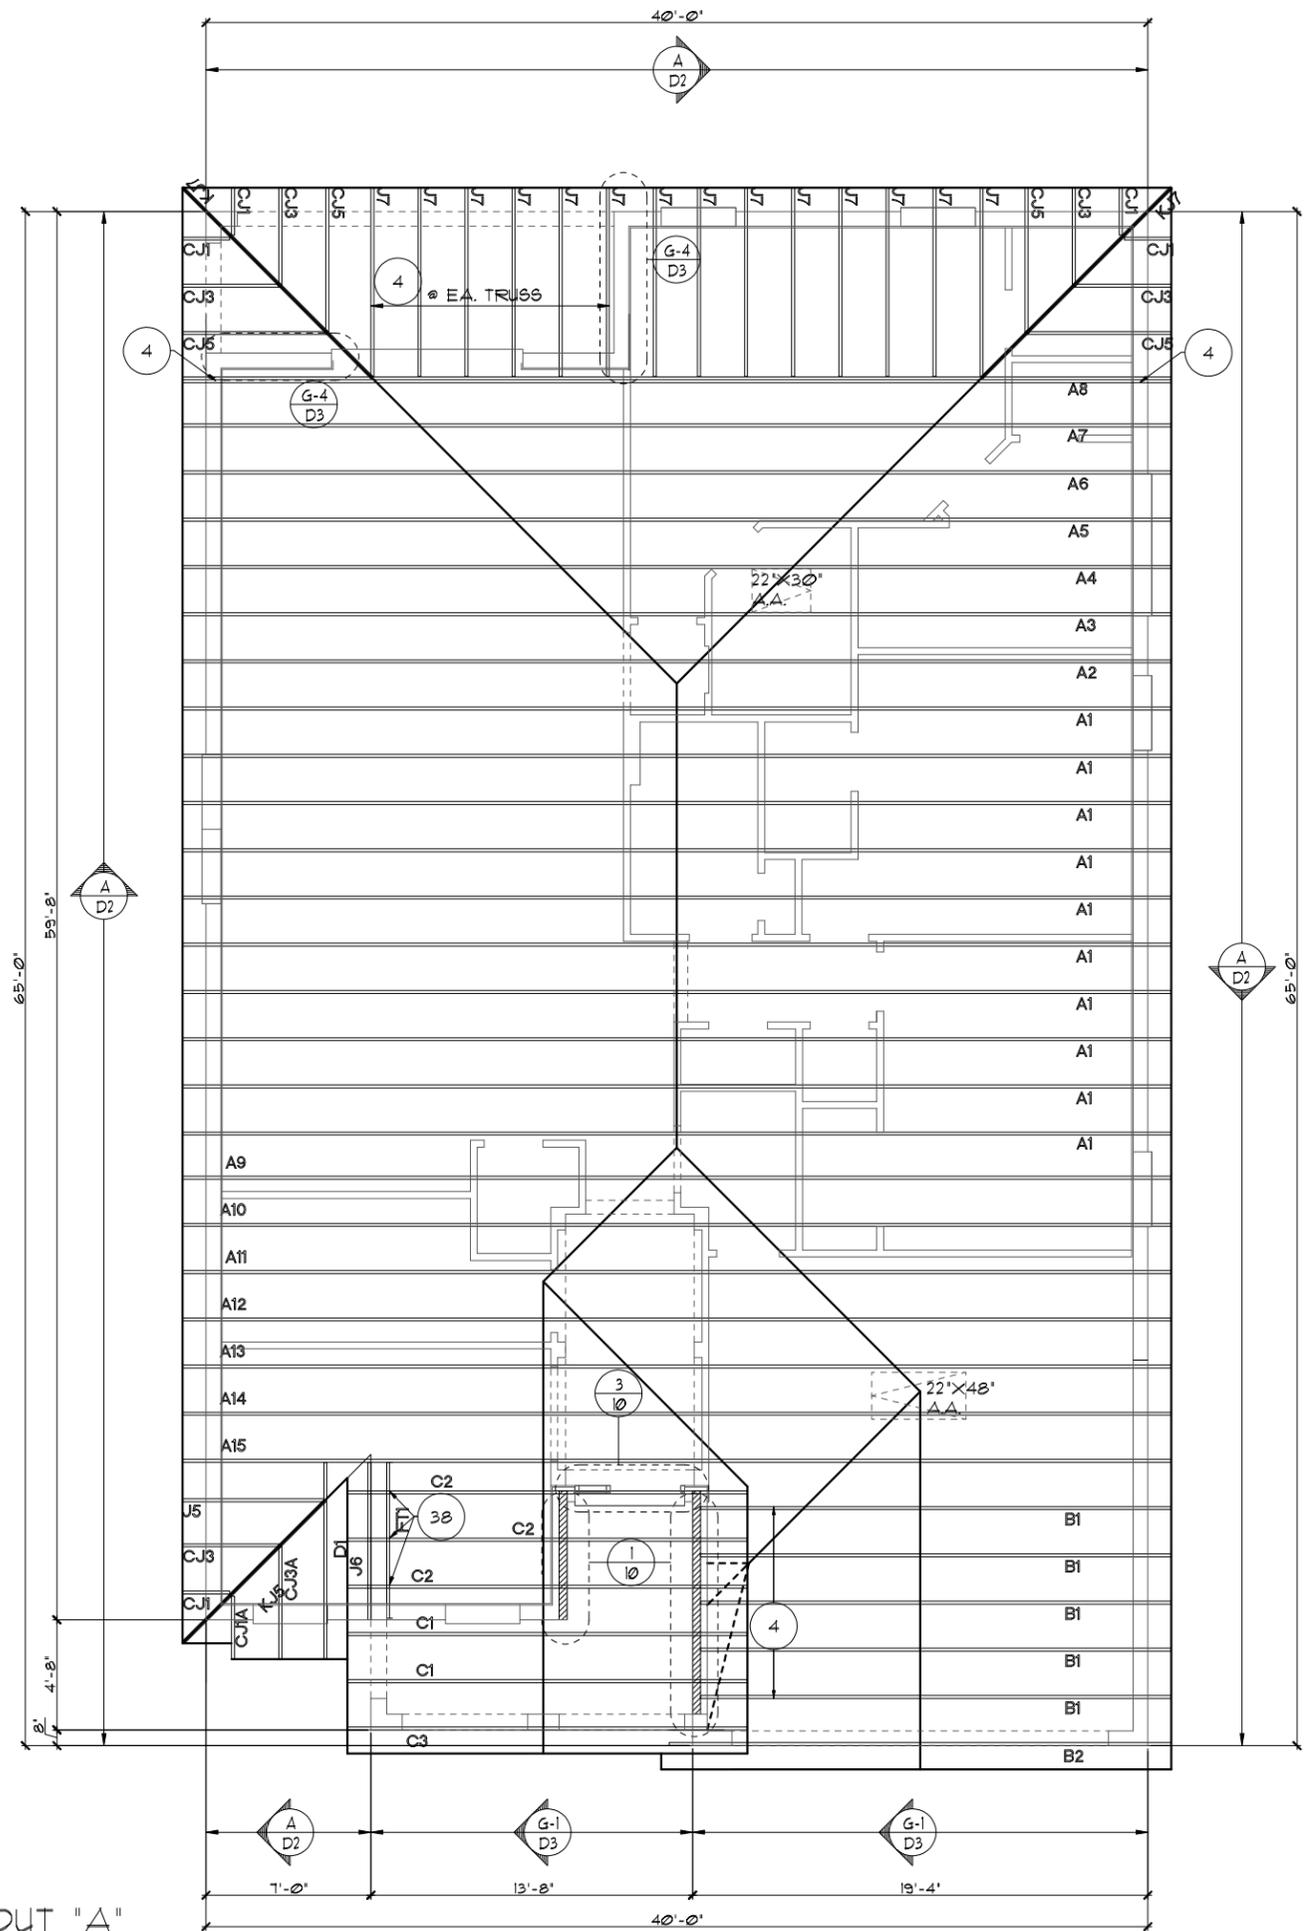

TRUSS LAYOUT "A"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

REVISIONS	BY
05-16-19	JF


**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
1400 W. UNIVERSITY AVENUE, SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1400  
FAX: (407) 734-1790  
WWW.ITEG.COM

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529 - 3000

**Park Square HOMES**

1966  
MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET 08A OF 00 SHEETS

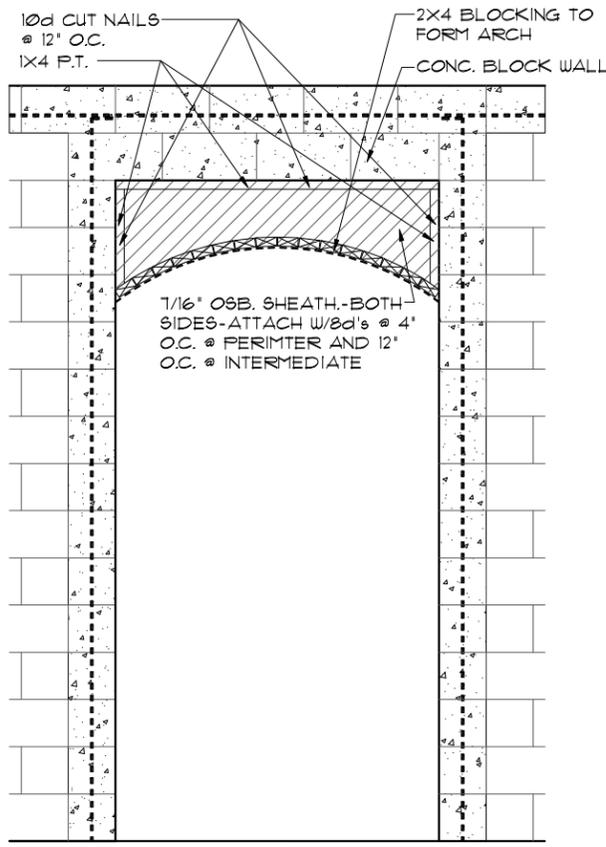

**4** **DETAIL**  
 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

- ### NOTES
- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 11TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
  - ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  - TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTC A BCS1.1.
  - REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  - SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 11TH EDITION R905.1.1 - Underlayment materials required to comply with ASTM D226, D4069 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
  - OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  - ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R905.1.1.1

### ATTIC VENTILATION CALCULATIONS

PER FBC2020 11TH EDITION R906: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).


THE MINIMUM NET VENTILATION AREA SHALL BE 1/50 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593 \text{ SF.}}{300} = 8.64 \text{ SF.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- 468 SF.  
 PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78 SF. /VENT.  
 (VENT TYPE: O'HAGIN MODEL 'S')

LOWER PORTION VENTILATION TOTAL: ----- 432 SF.  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:  
 ( 50 L.F. @ 0.087 SF. VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

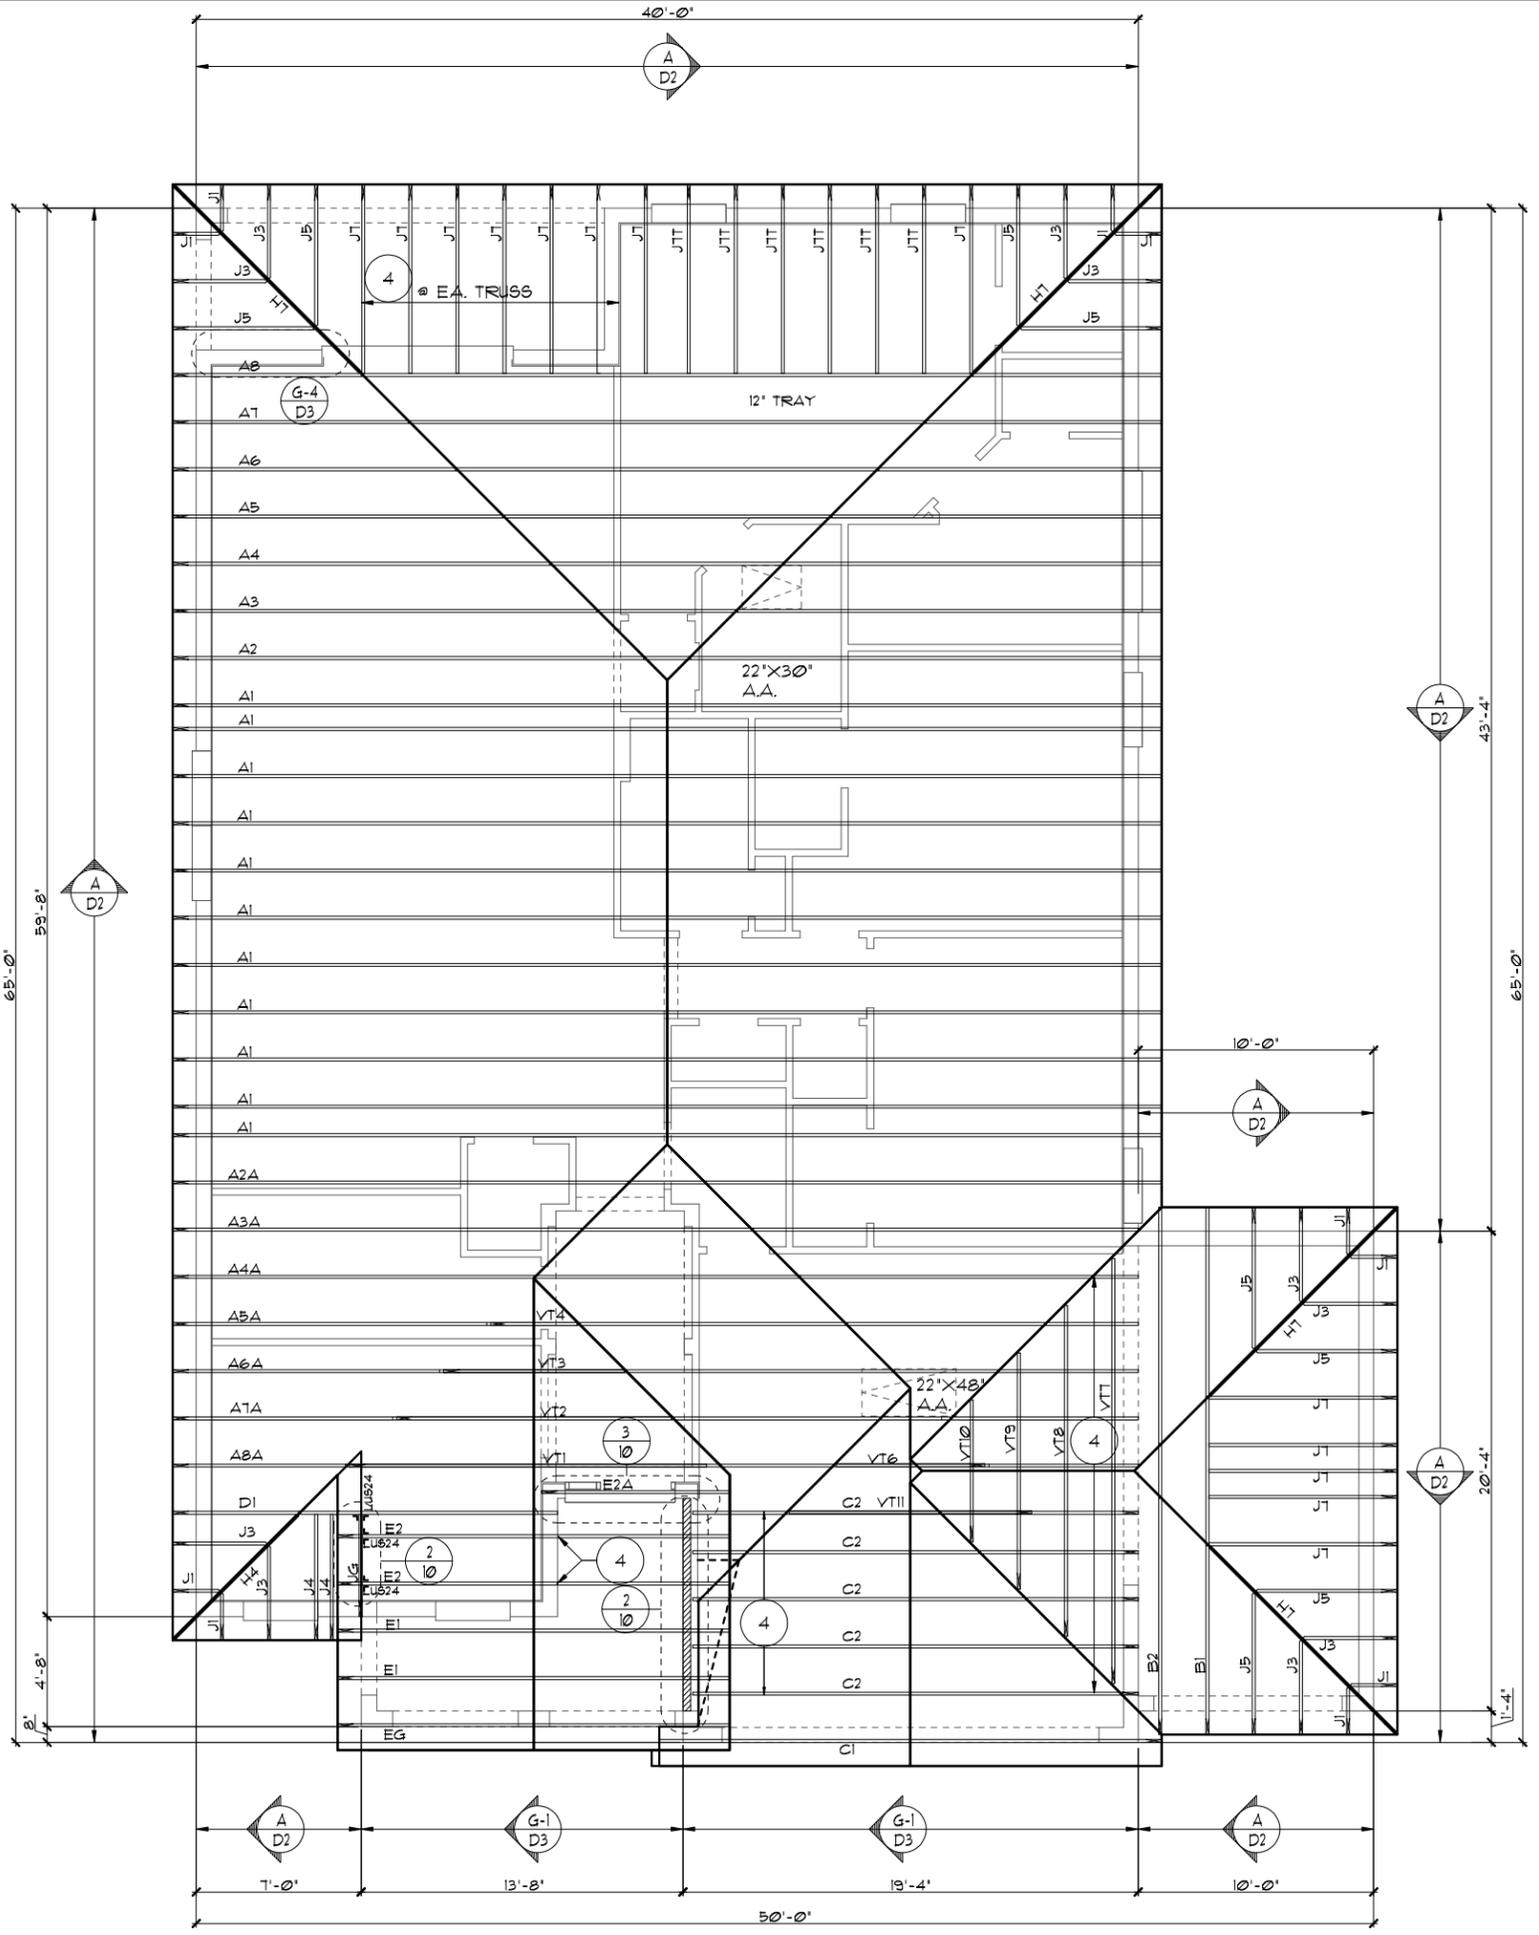

**TRUSS LAYOUT "A"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**3-CAR GARAGE OPTION**  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH


**LOT: 0000, COMMUNITY NAME**  
 1966  
**MARGATE II**

**FLORIDA SERIES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 528 - 3000

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 10000 Lake Nona Blvd., Suite 100  
 Lake Nona, FL 32157  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com

REVISIONS	BY
05-16-19	JF

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
**08A.3**  
 OF 00 SHEETS

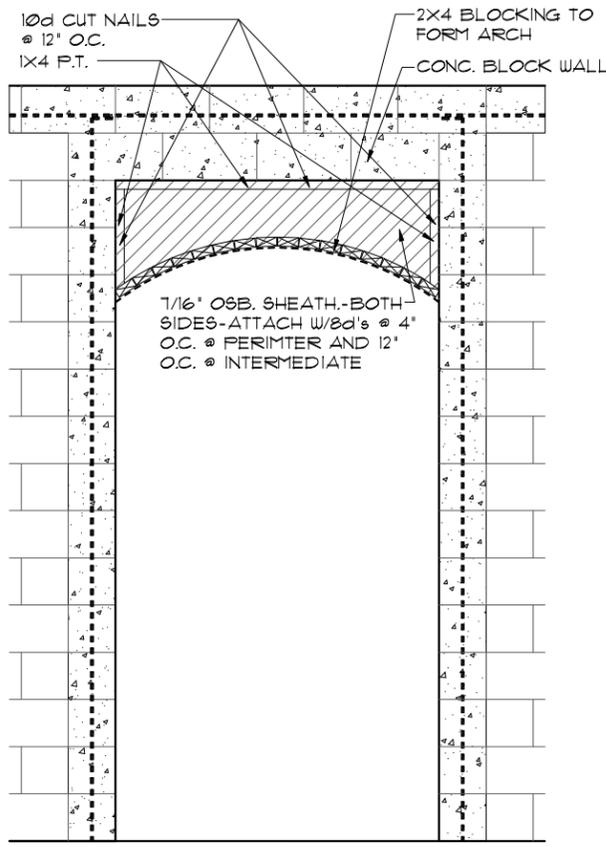

**4**  
8A  
**DETAIL**  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL: ----- **4.68S.F.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78S.F.** /VENT.  
 (VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **4.32S.F.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50** L.F. @ **0.087S.F.** VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

**NOTES**

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCS1.1.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.1

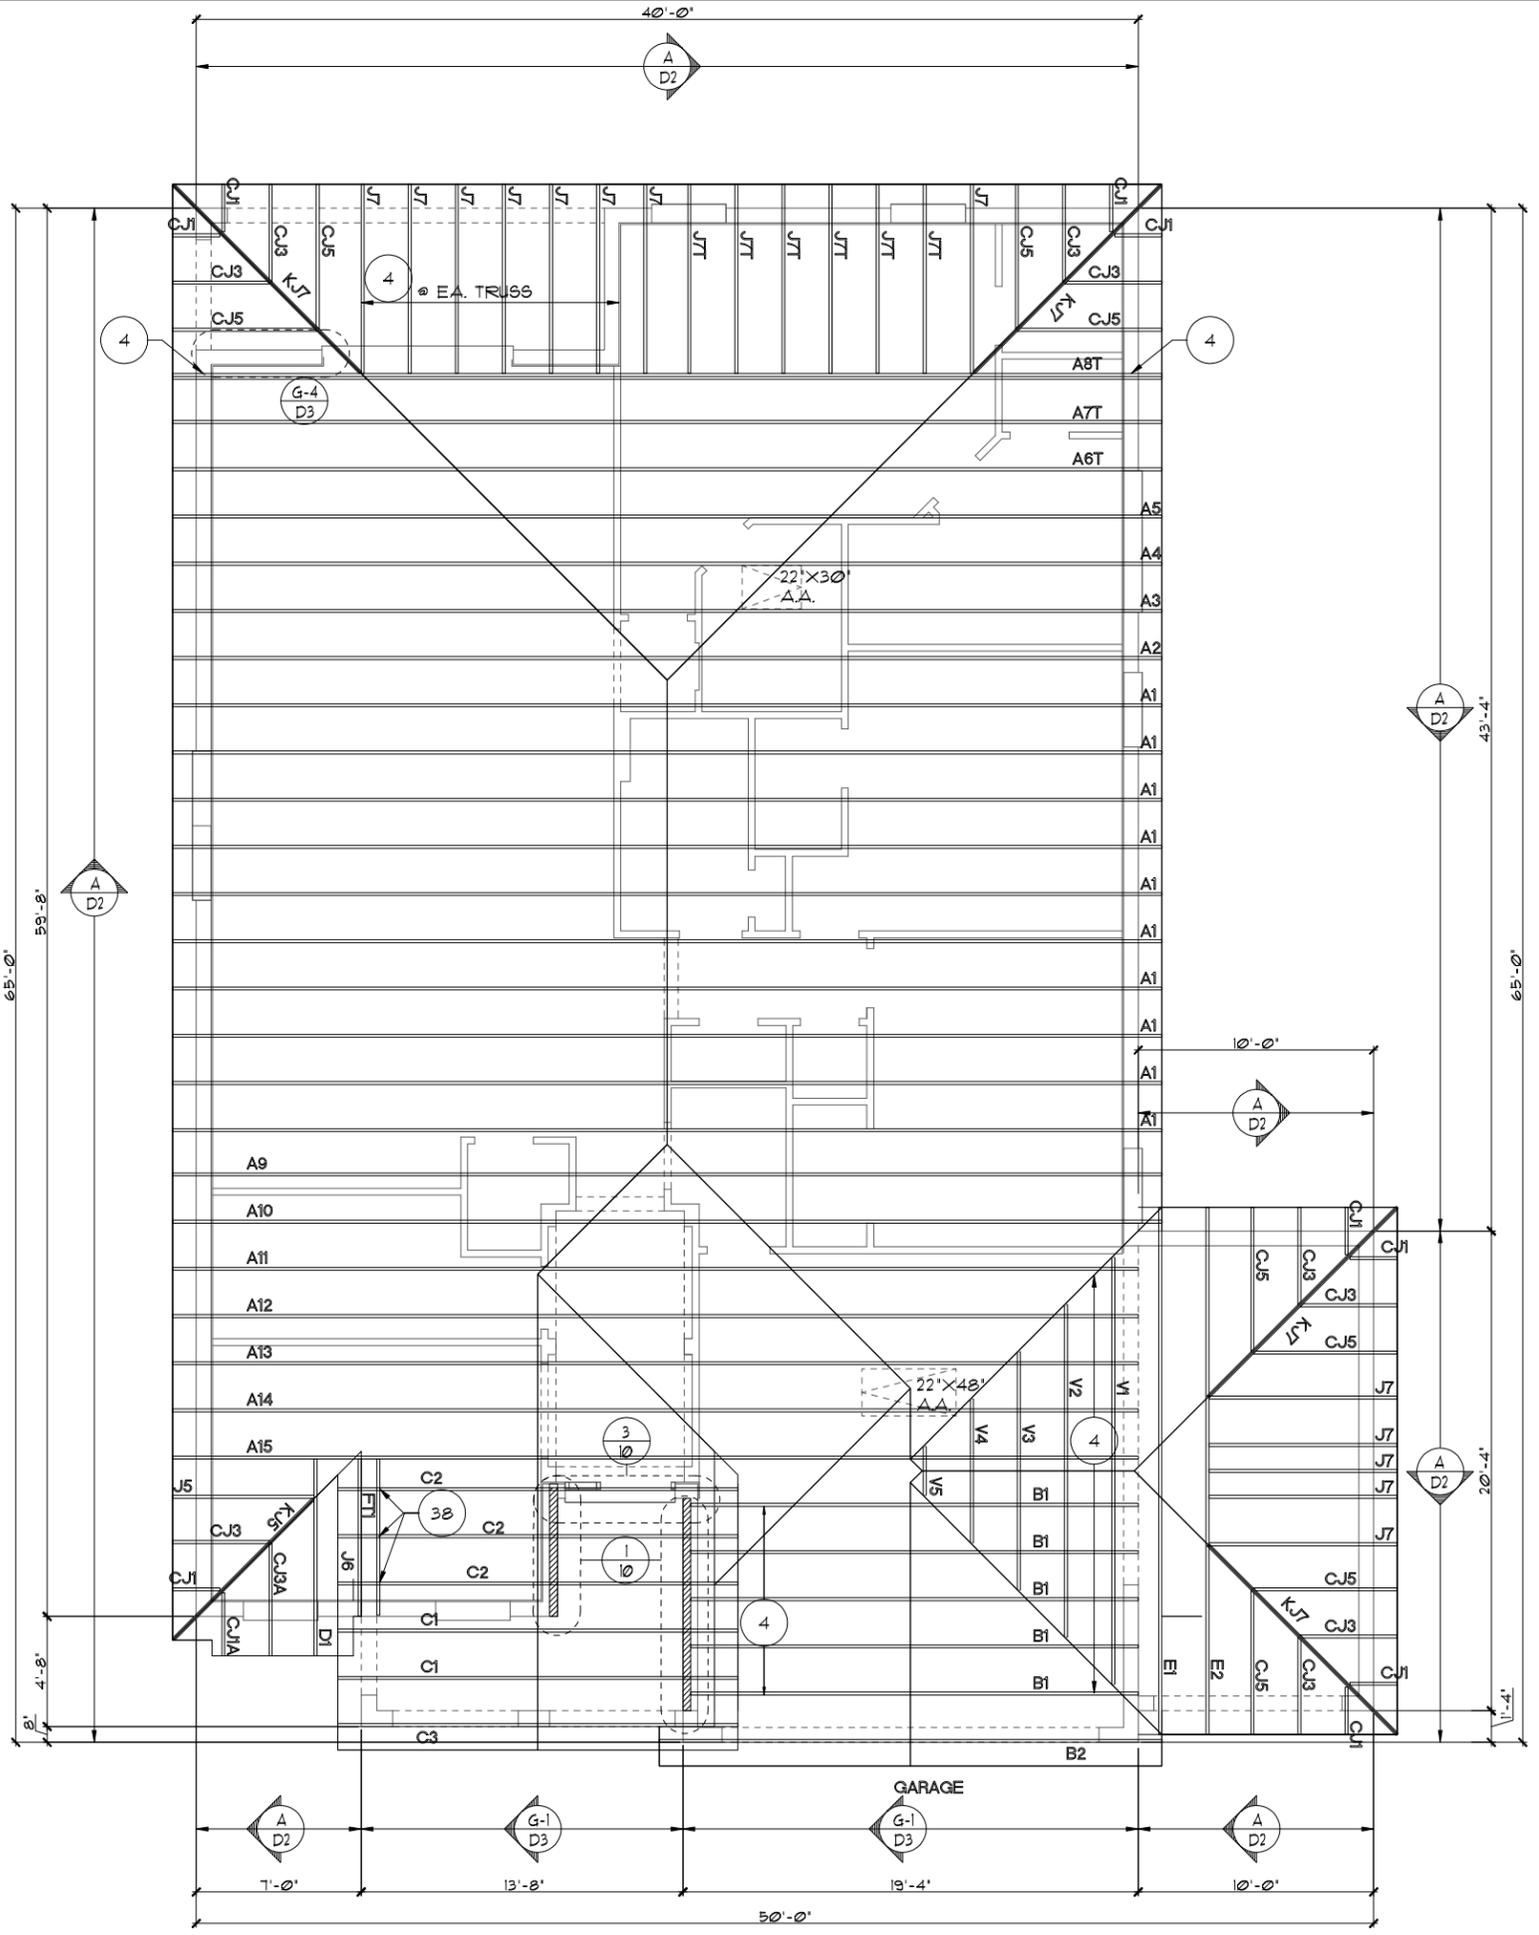

**TRUSS LAYOUT "A"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

3-CAR GARAGE OPTION

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

1966

MARGATE II

08A.3  
OF 00 SHEETS

FLORIDA SERIES


REVISIONS BY 05-16-19 JF

**ITEG**  
HOBBS ENGINEERING GROUP, INC.  
1400 S. WINDY HILL RD. SUITE 100  
ORLANDO, FL 32811  
TEL: (407) 734-1400  
FAX: (407) 734-1790  
www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 528 - 3000

**Park Square HOMES**

TRUSS LAYOUT

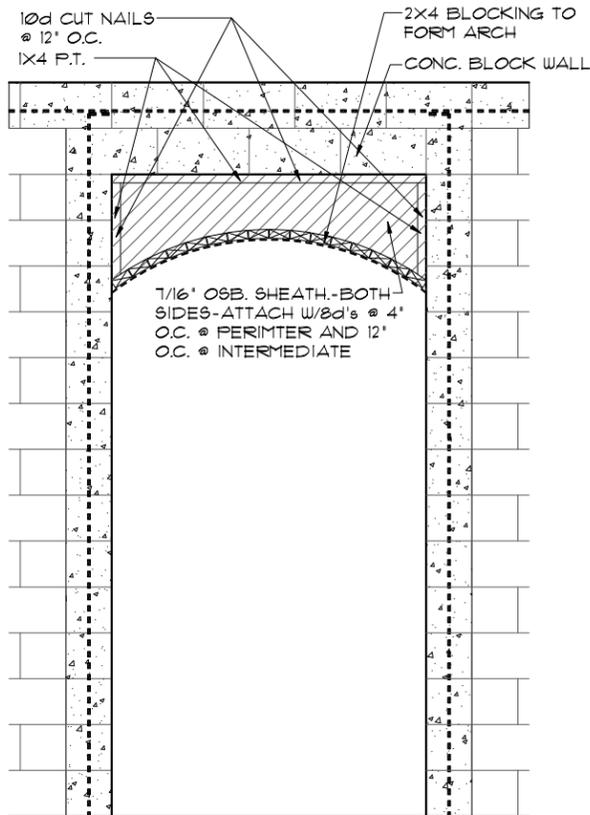

**4**  
8B  
**DETAIL**  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R806: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593SF}{300} = 8.64SF$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- **468SF.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **78SF.** /VENT.  
(VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)


LOWER PORTION VENTILATION TOTAL: ----- **432SF.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( **50 LF.** @ **0.087SF.** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/ATCA BCS1.1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC 2023, 8TH EDITION R905.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - LOMANCO: (2) 9 1/2" DIA. CIRCLES
  - MILLENNIUM METAL: 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R905.1.1

**TRUSS LAYOUT "B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

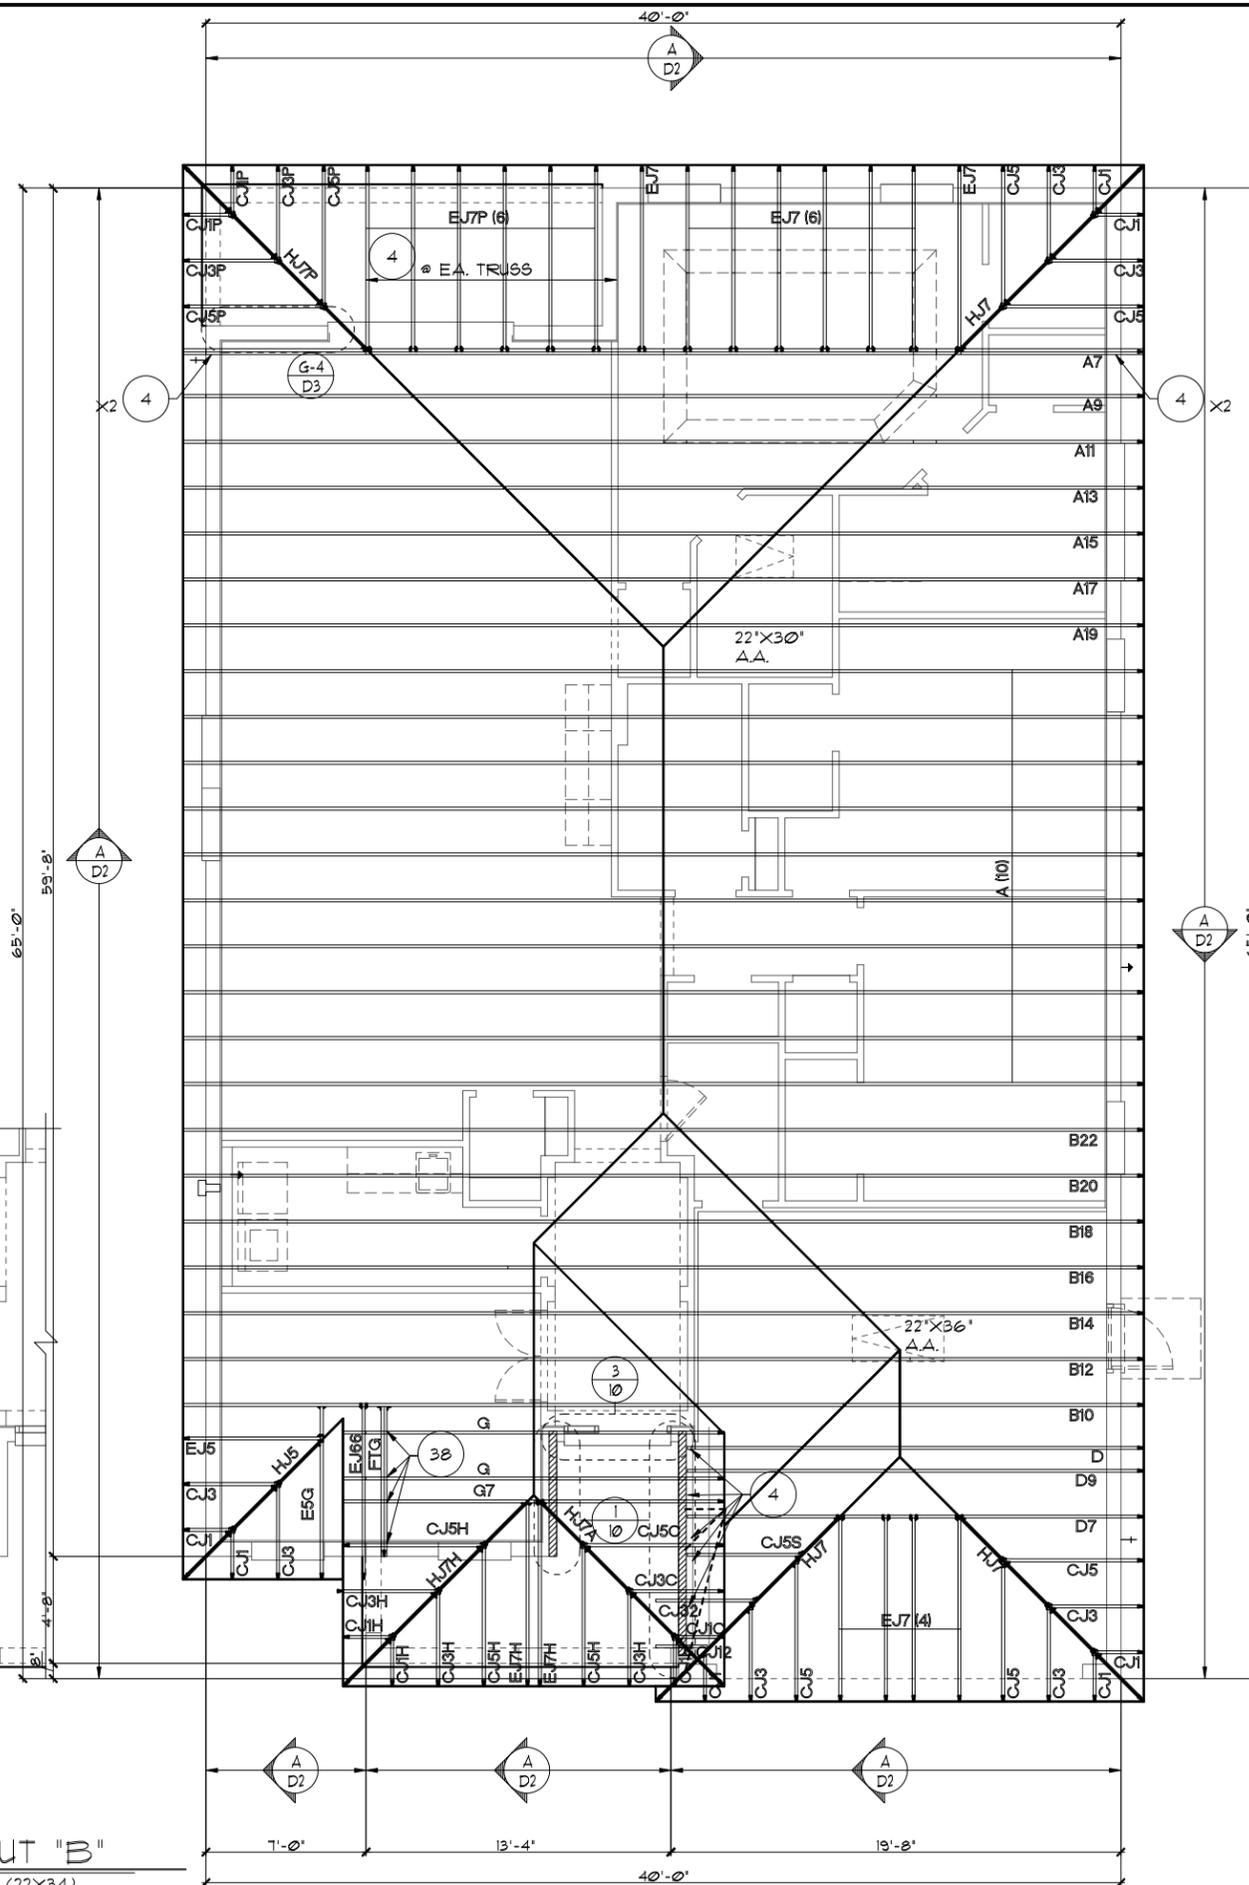

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

REVISIONS	BY
05-16-19	JF

**ITTEG**  
THOMPSON ENGINEERING GROUP, INC.  
4401 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529-3000  
www.itteg.com


**Park Square HOMES**  
A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529-3000

**TRUSS LAYOUT**

1966  
MARGATE II

DATE	04-05-2011
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	
08B	
OF 08 SHEETS	



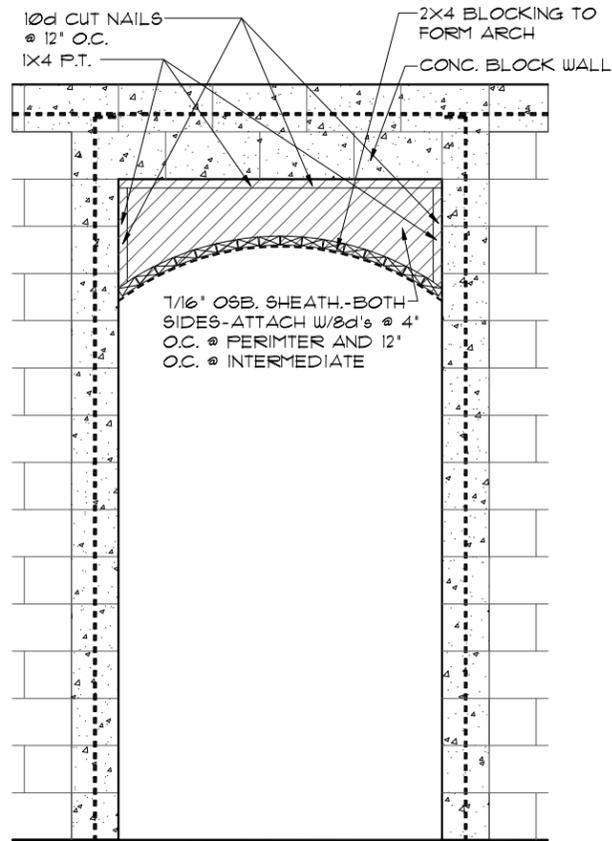

**4**  
**8B** **DETAIL**  
1/2'-1'-0" (11X17) 1'-1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R206: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- **4.68S.F.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78S.F.** /VENT.  
(VENT TYPE: LOMANCO MODEL 770-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32S.F.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:---  
( **50** L.F. @ **0.087S.F.** VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA ECSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1

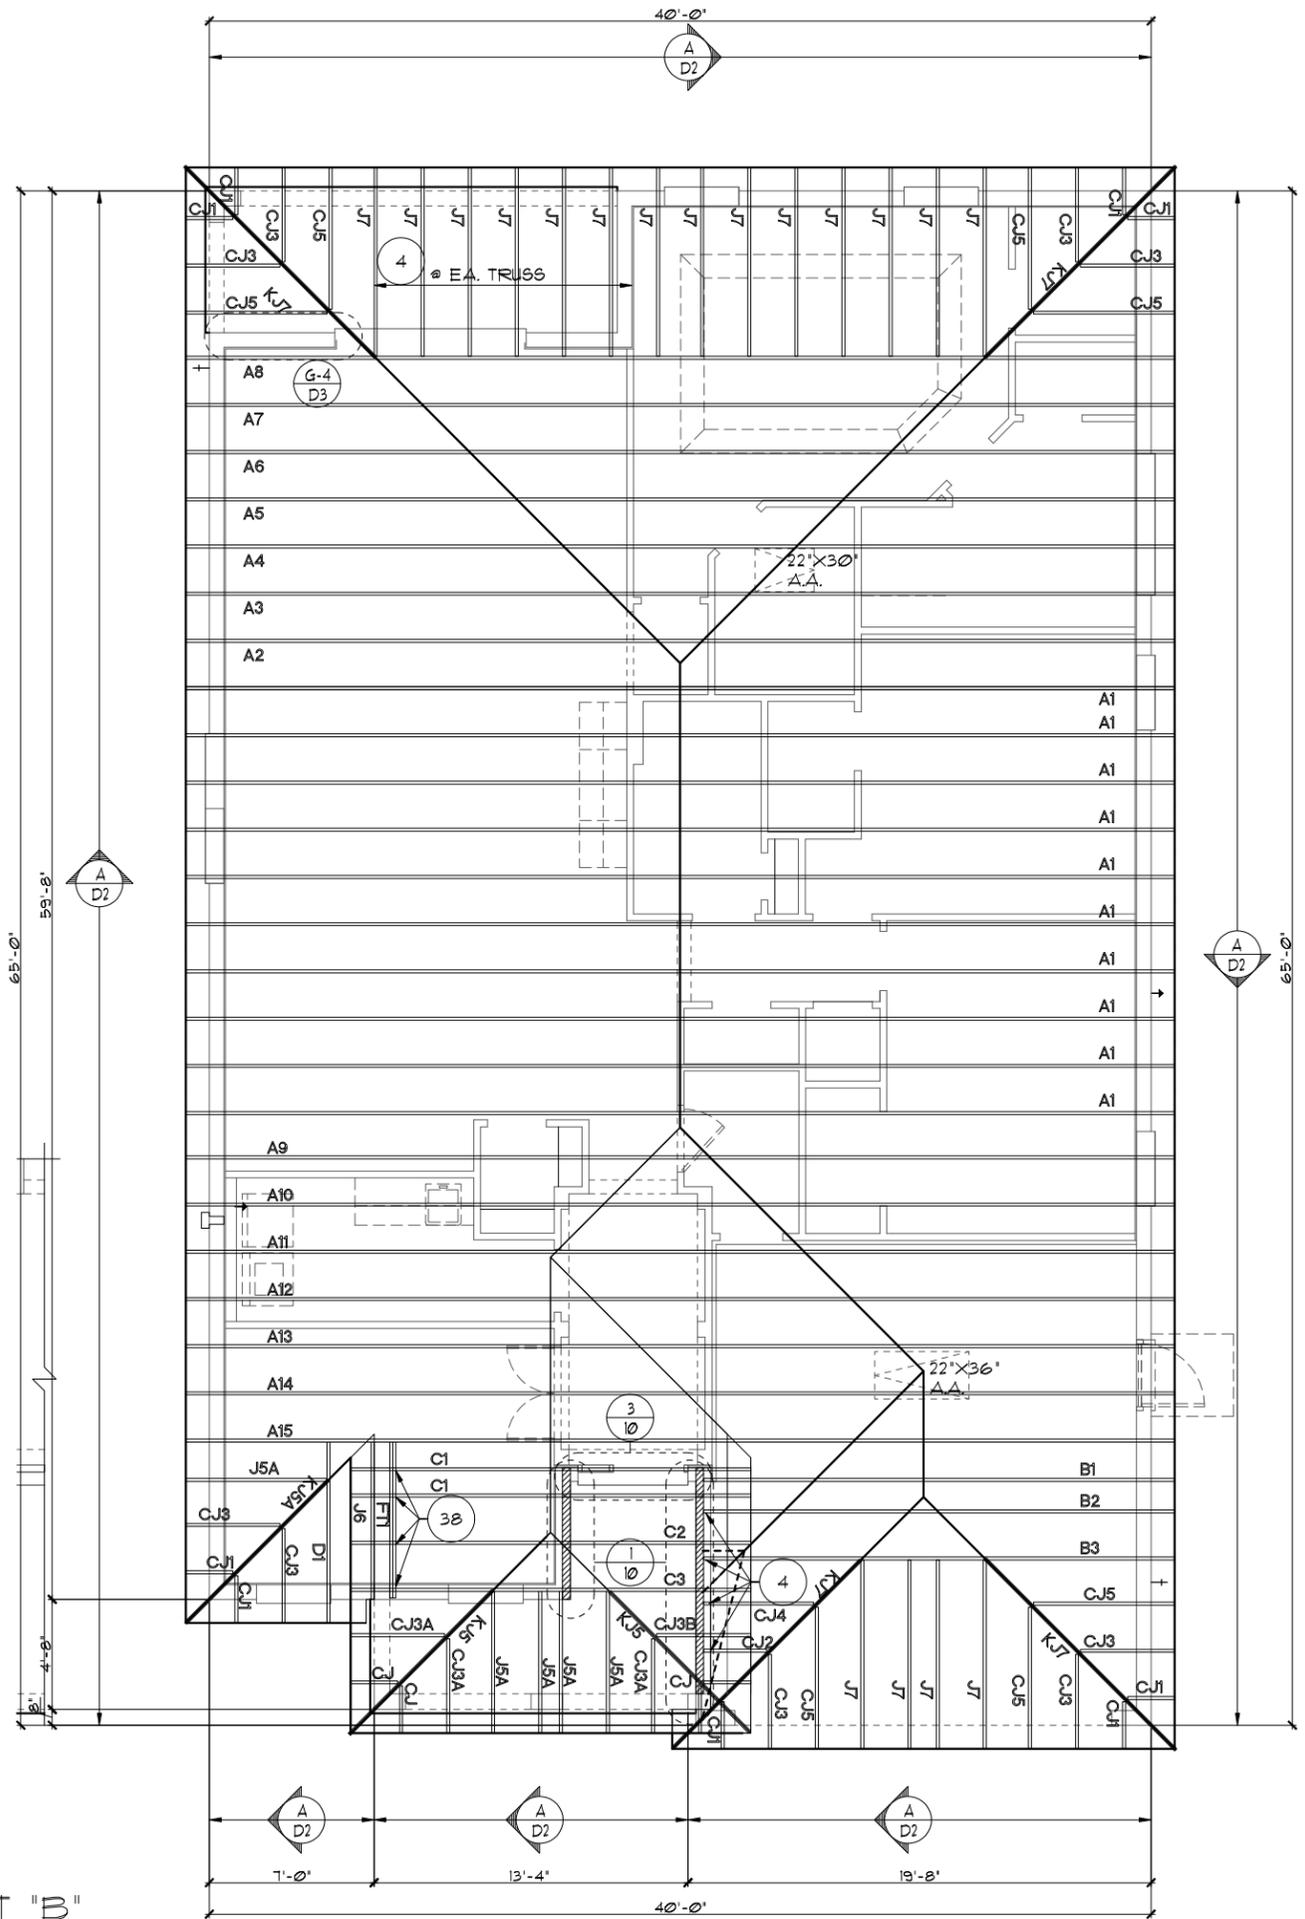

**TRUSS LAYOUT "B"**  
1/8'-1'-0" (11X17) 1/4'-1'-0" (22X34)

FLORIDA SERIES

LOT: 0000, COMMUNITY NAME

1966  
MARGATE II

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

REVISIONS	BY
05-16-19	JF


**ITEG**  
HARRISON ENGINEERING GROUP, INC.  
1401 WINDY HILL RD  
ORLANDO, FL 32811  
TEL: (407) 734-1400  
WWW.ITEG.COM

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529 - 3000

**Park Square HOMES**

TRUSS LAYOUT

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
008 OF 00 SHEETS

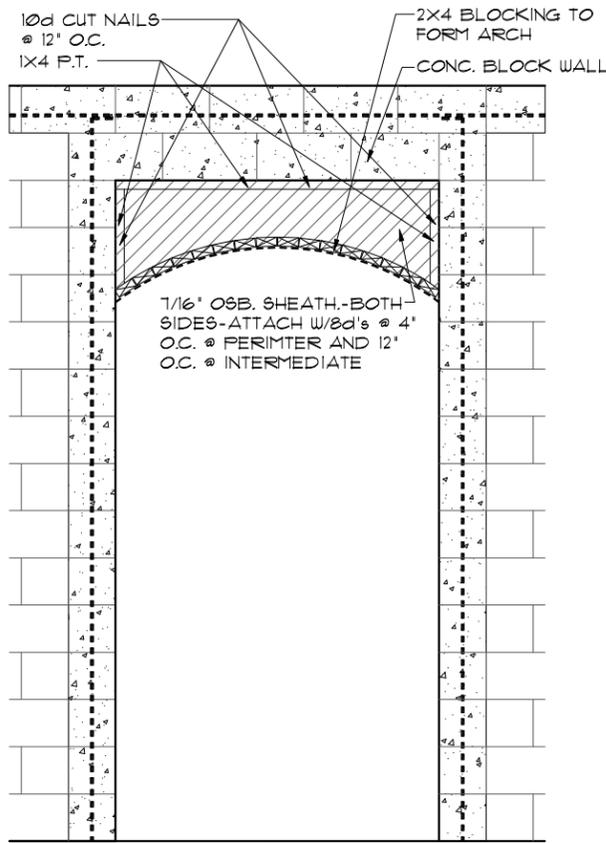

**4**  
**8B** DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R806: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{SF}}{300} = 8.64\text{SF}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL: ----- **4.68SF.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF.** /VENT.  
(VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **4.32SF.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( **50** LF. @ **0.087SF.** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCS1.1.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 at Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
    - LOMANCO : (2) 9 1/2" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.1

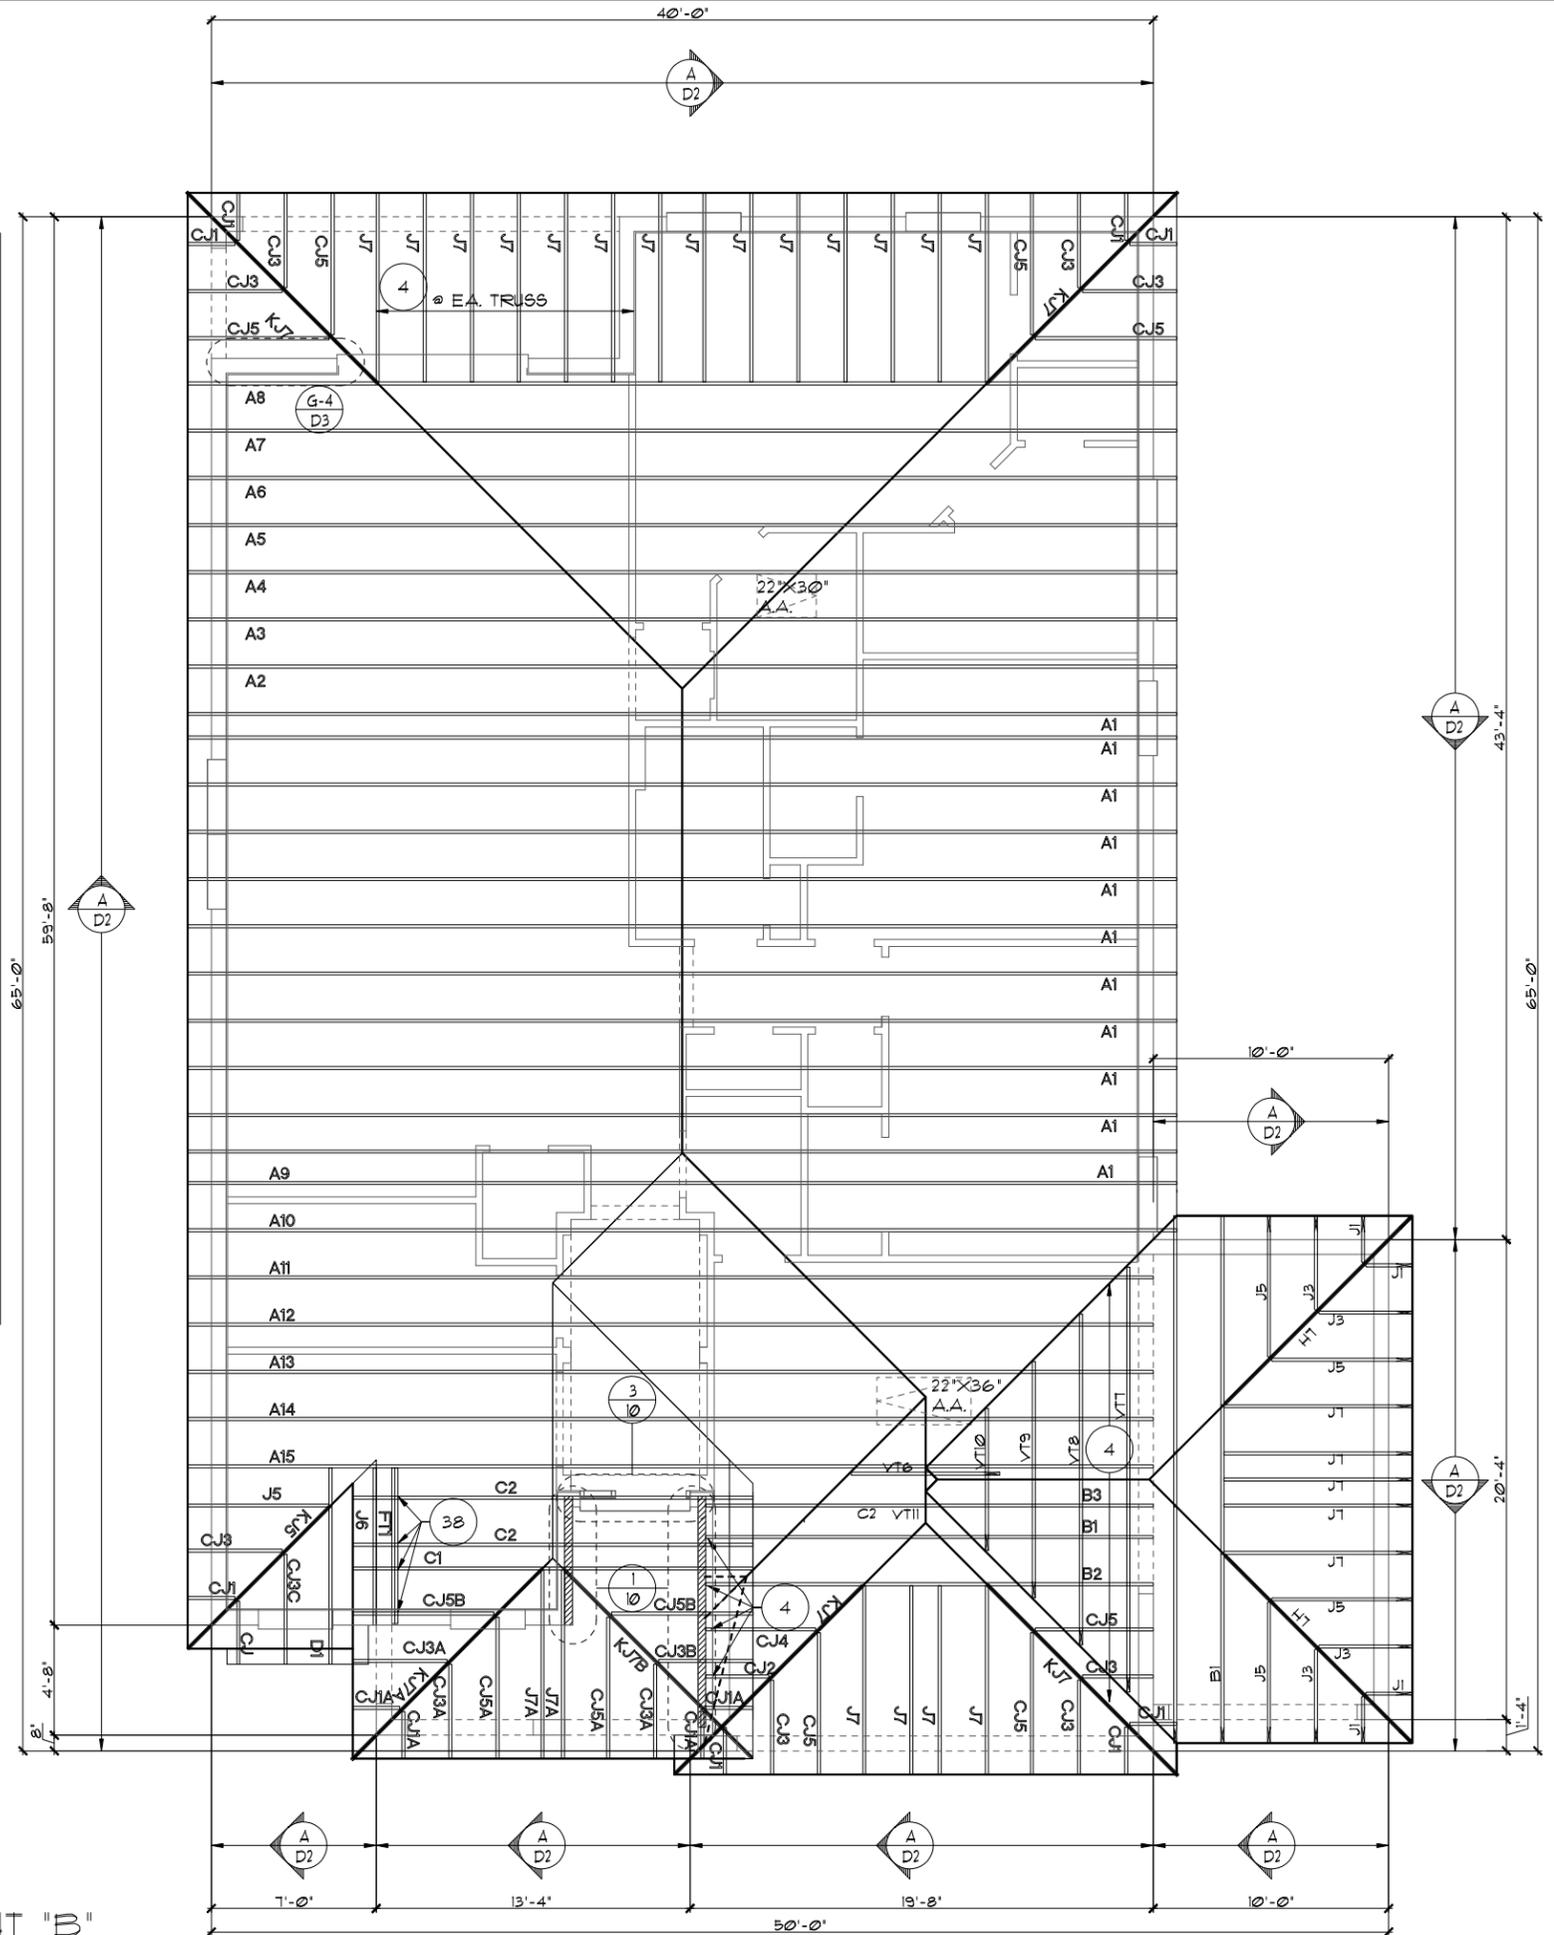

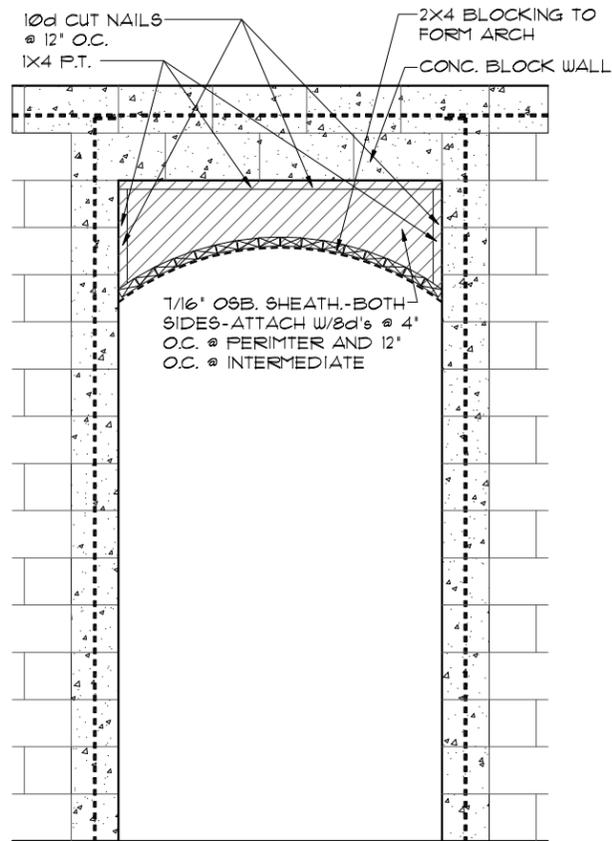

4  
8B  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = \underline{8,643\text{S.F.}}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- 468S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F./VENT.  
(VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 432S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
(.50 L.F. @ 0.087S.F. VENTING PER L.F.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61.1.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.11 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.11. Underlayment shall be applied and attached in accordance with Table R305.11.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.11.

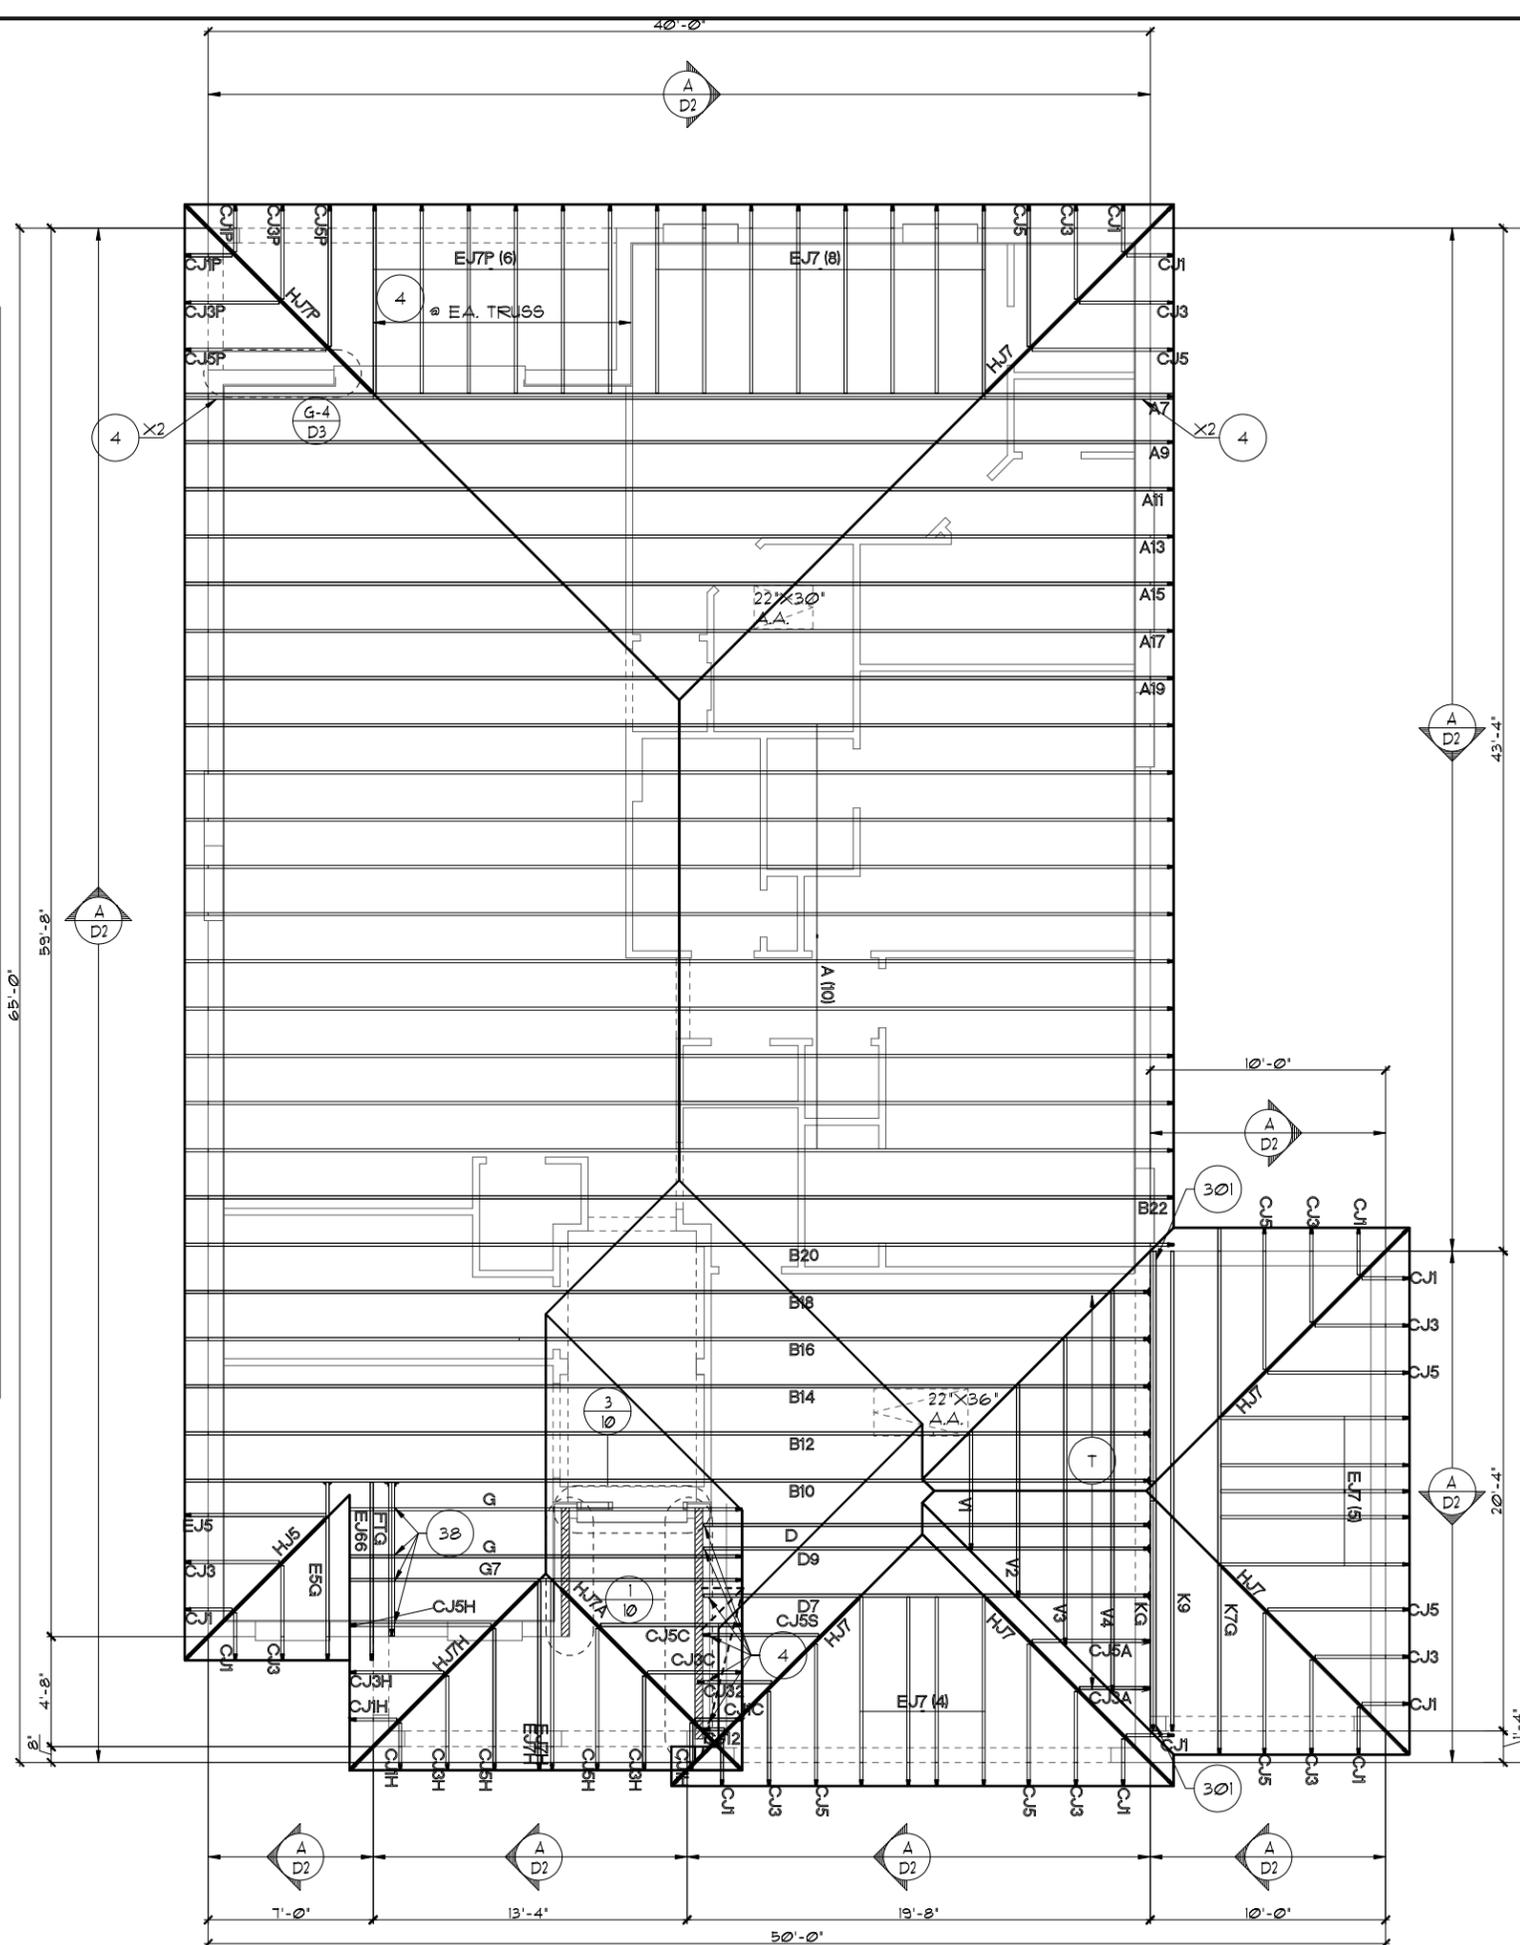

TRUSS LAYOUT "B"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

REVISIONS	BY
05-16-19	JF



A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineyard Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 528 - 3000




TRUSS LAYOUT

1966

MARGATE II

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	08B.3
OF	08 SHEETS

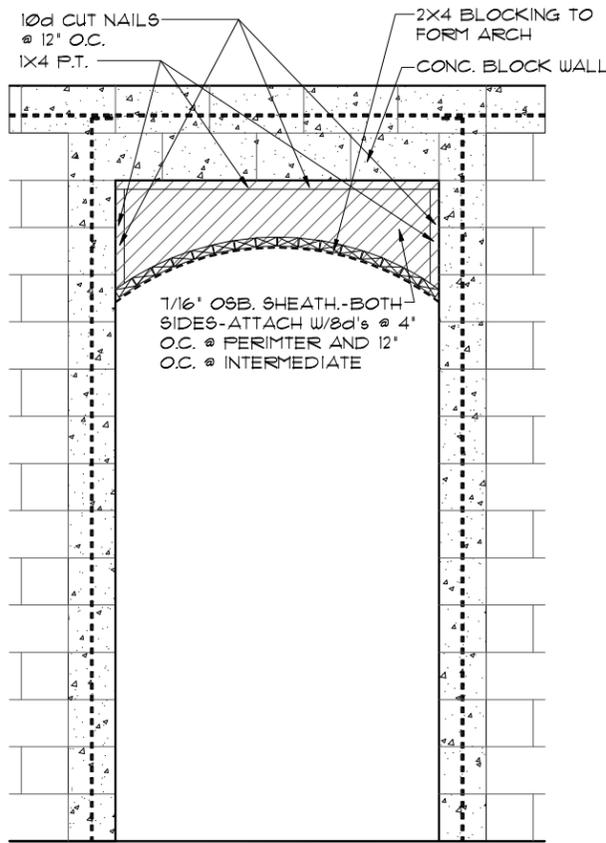

**4** **8B** **DETAIL**  
 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R806: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{SF}}{300} = 8.64\text{SF}$ . NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- **4.68SF.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF.** /VENT.  
 (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32SF.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50 LF.** @ **0.0878SF.** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC81 I.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R905.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R905.1.1.

**TRUSS LAYOUT "B"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

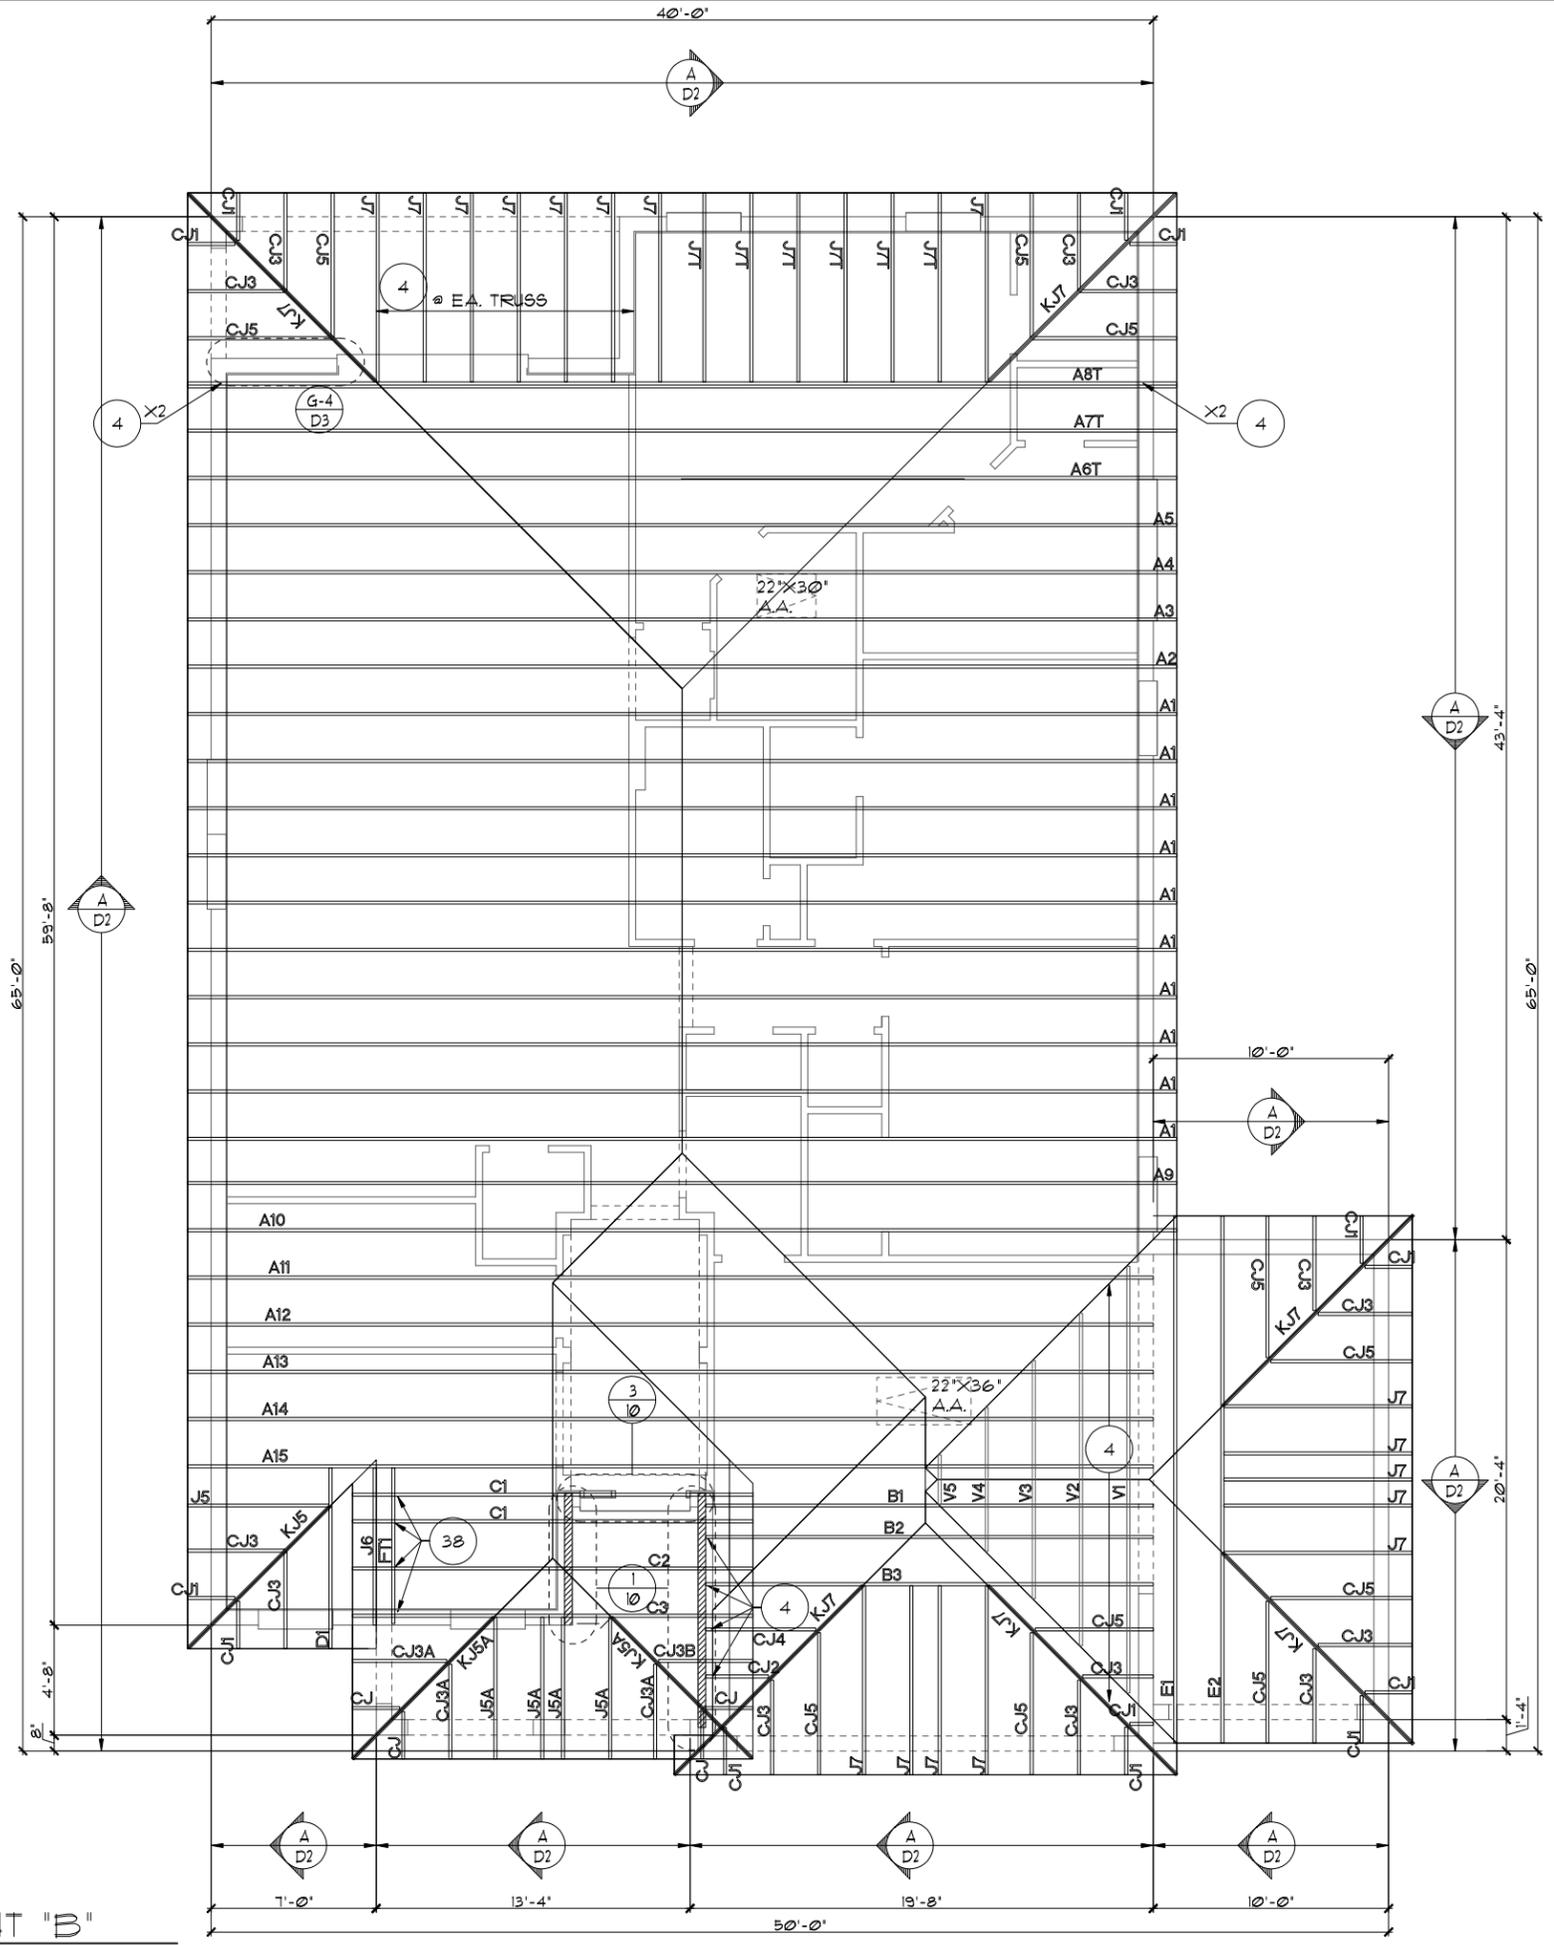


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
**LOT: 0000, COMMUNITY NAME**  
**FLORIDA SERIES**

Park Square Homes  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000

REVISIONS	BY
05-16-19	JF

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET **08B.3**  
 OF 08 SHEETS

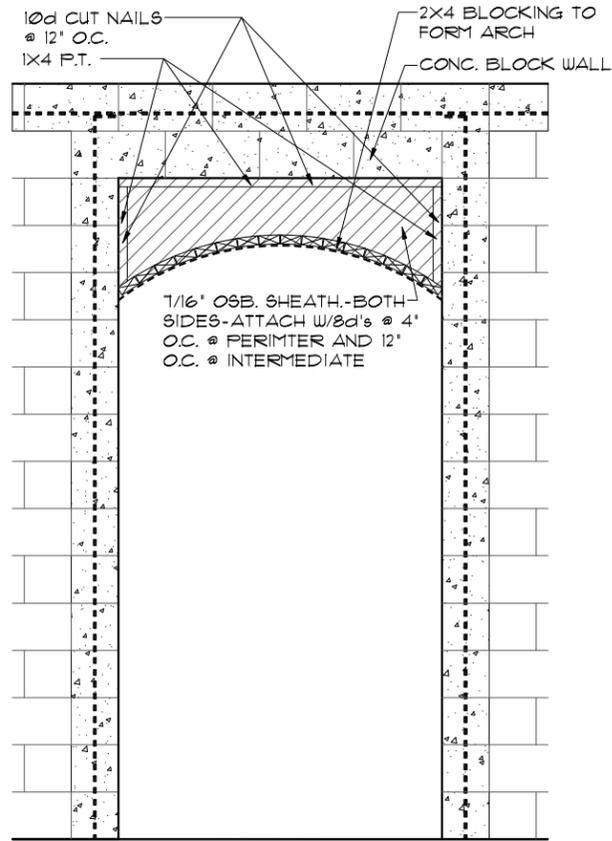

4  
8C  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{SF.}}{300} = \frac{8.64\text{SF.}}{\text{REQUIRED}}$


UPPER PORTION VENTILATION TOTAL:----- 4.68SF.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78SF./VENT.  
(VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 4.32SF.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( 50 LF. @ 0.087SF. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTC A ECSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1

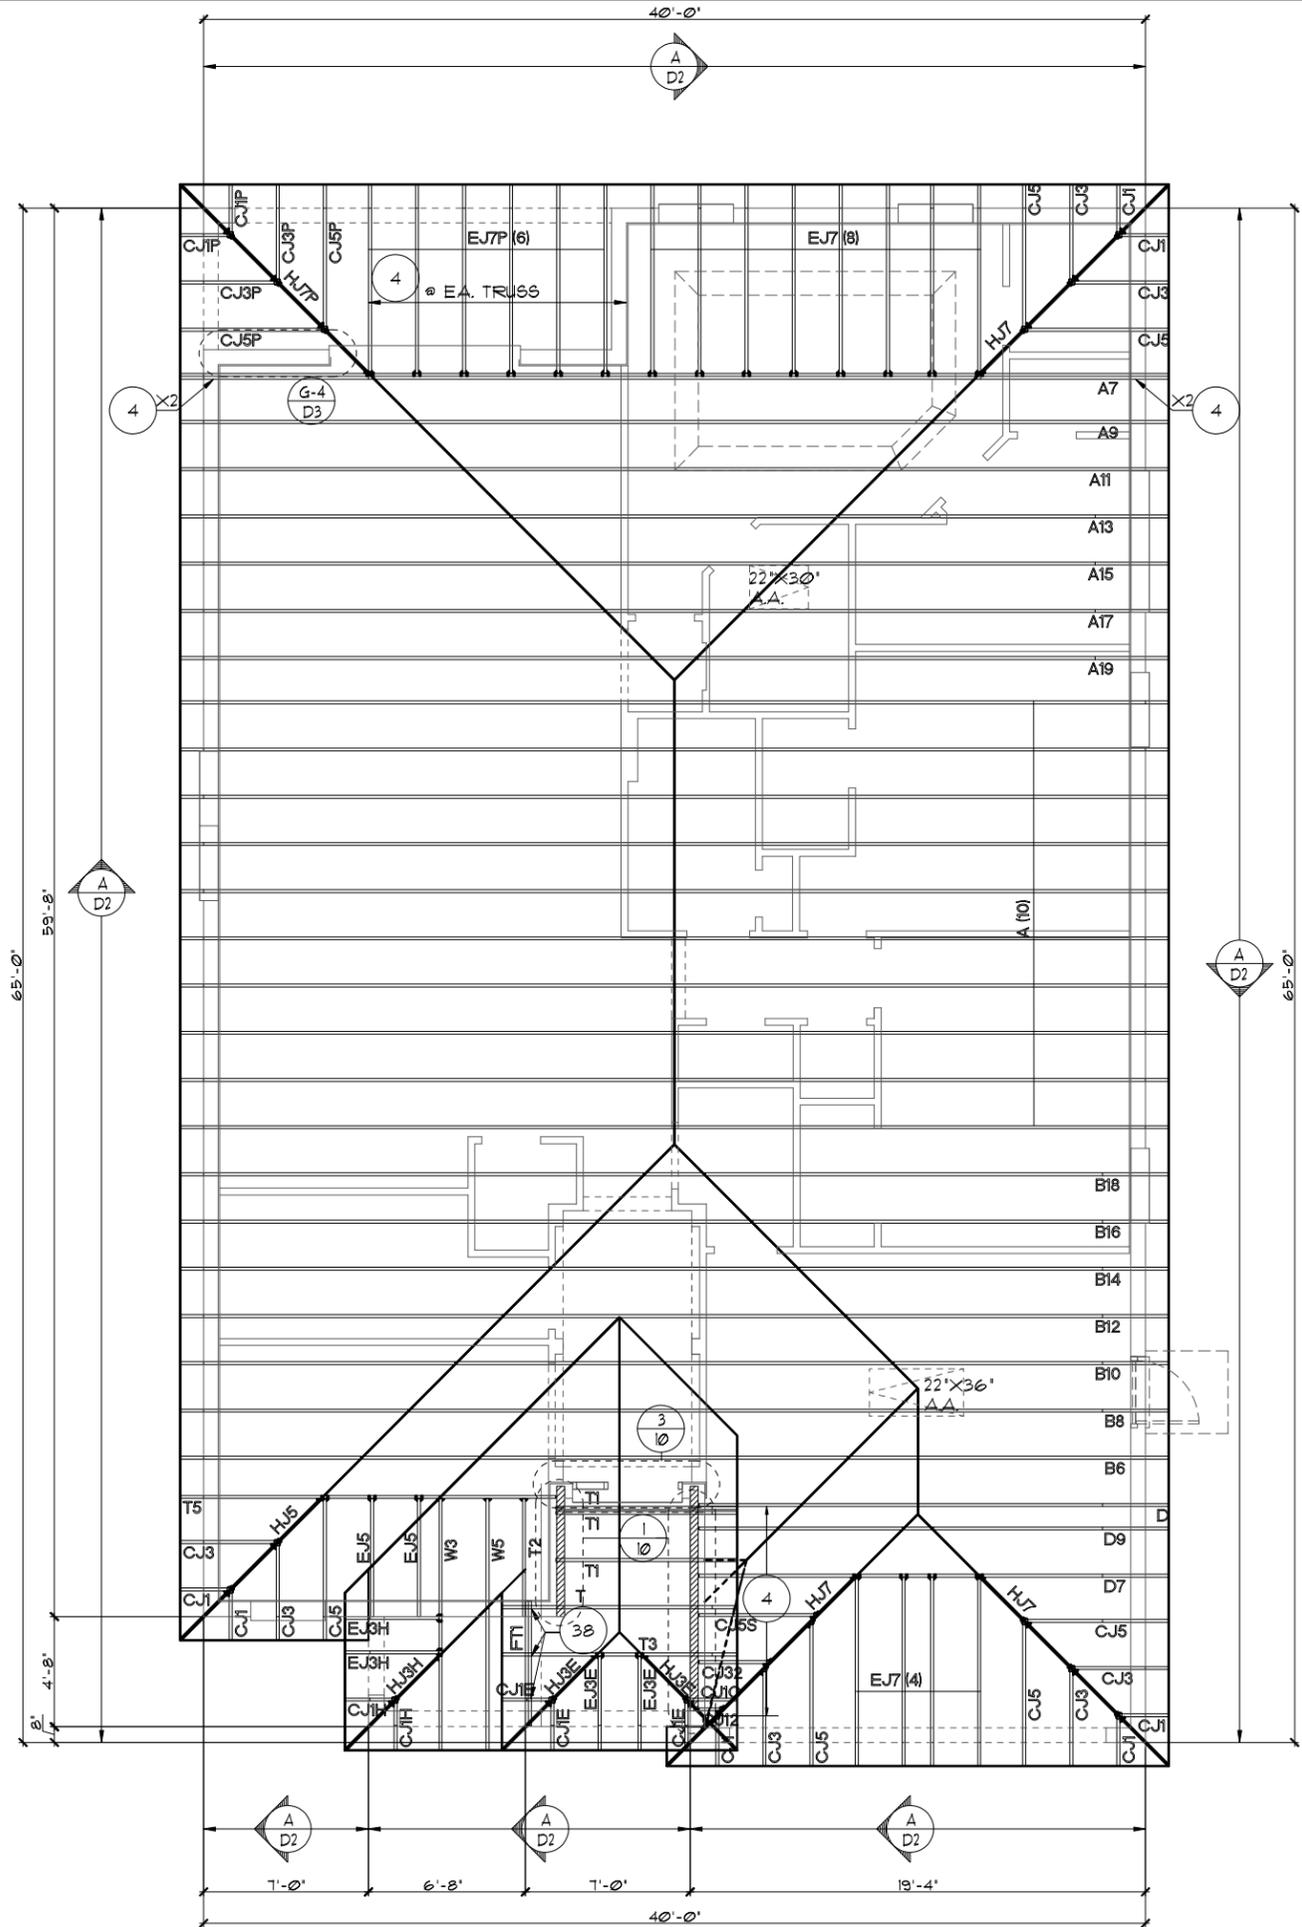

TRUSS LAYOUT "C"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

FLORIDA SERIES

A DIVISION OF PARK SQUARE ENTERPRISES, INC.

PARK SQUARE HOMES

TRUSS LAYOUT

1966

MARGATE II

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET

REVISIONS	BY
05-16-19	JF

**ITEG**  
HOBSON ENGINEERING GROUP, INC.  
1401 W. US HWY 1  
ORLANDO, FL 32817  
TEL: (407) 734-1400  
WWW.ITEG.COM

Park Square HOMES  
A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529 - 3000

DATE 04-05-2017


SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET

08C  
OF 00 SHEETS

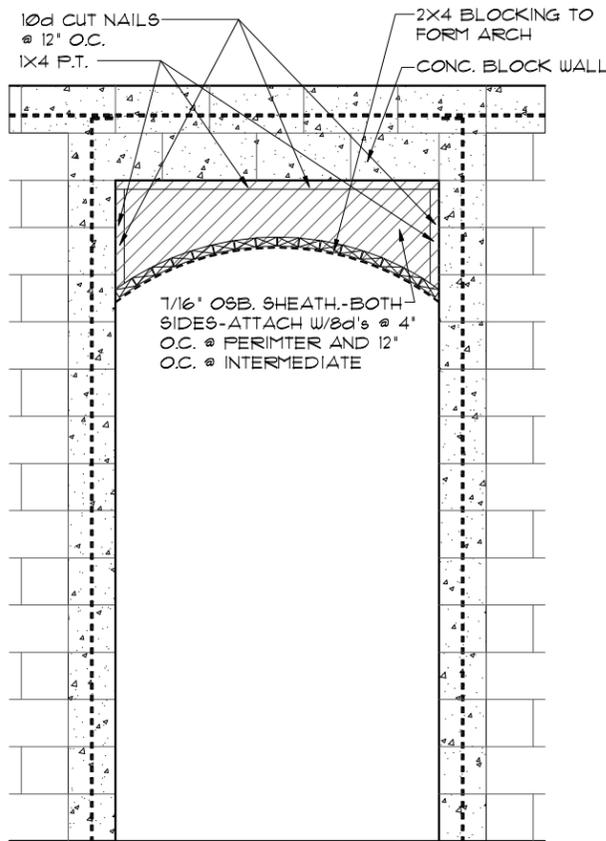

**4** **DETAIL**  
 8C 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{SF.}}{300} = \underline{8.64\text{SF.}}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- **4.68SF.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF.** /VENT.  
 (VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32SF.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50** LF. @ **0.087SF.** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA ECSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1

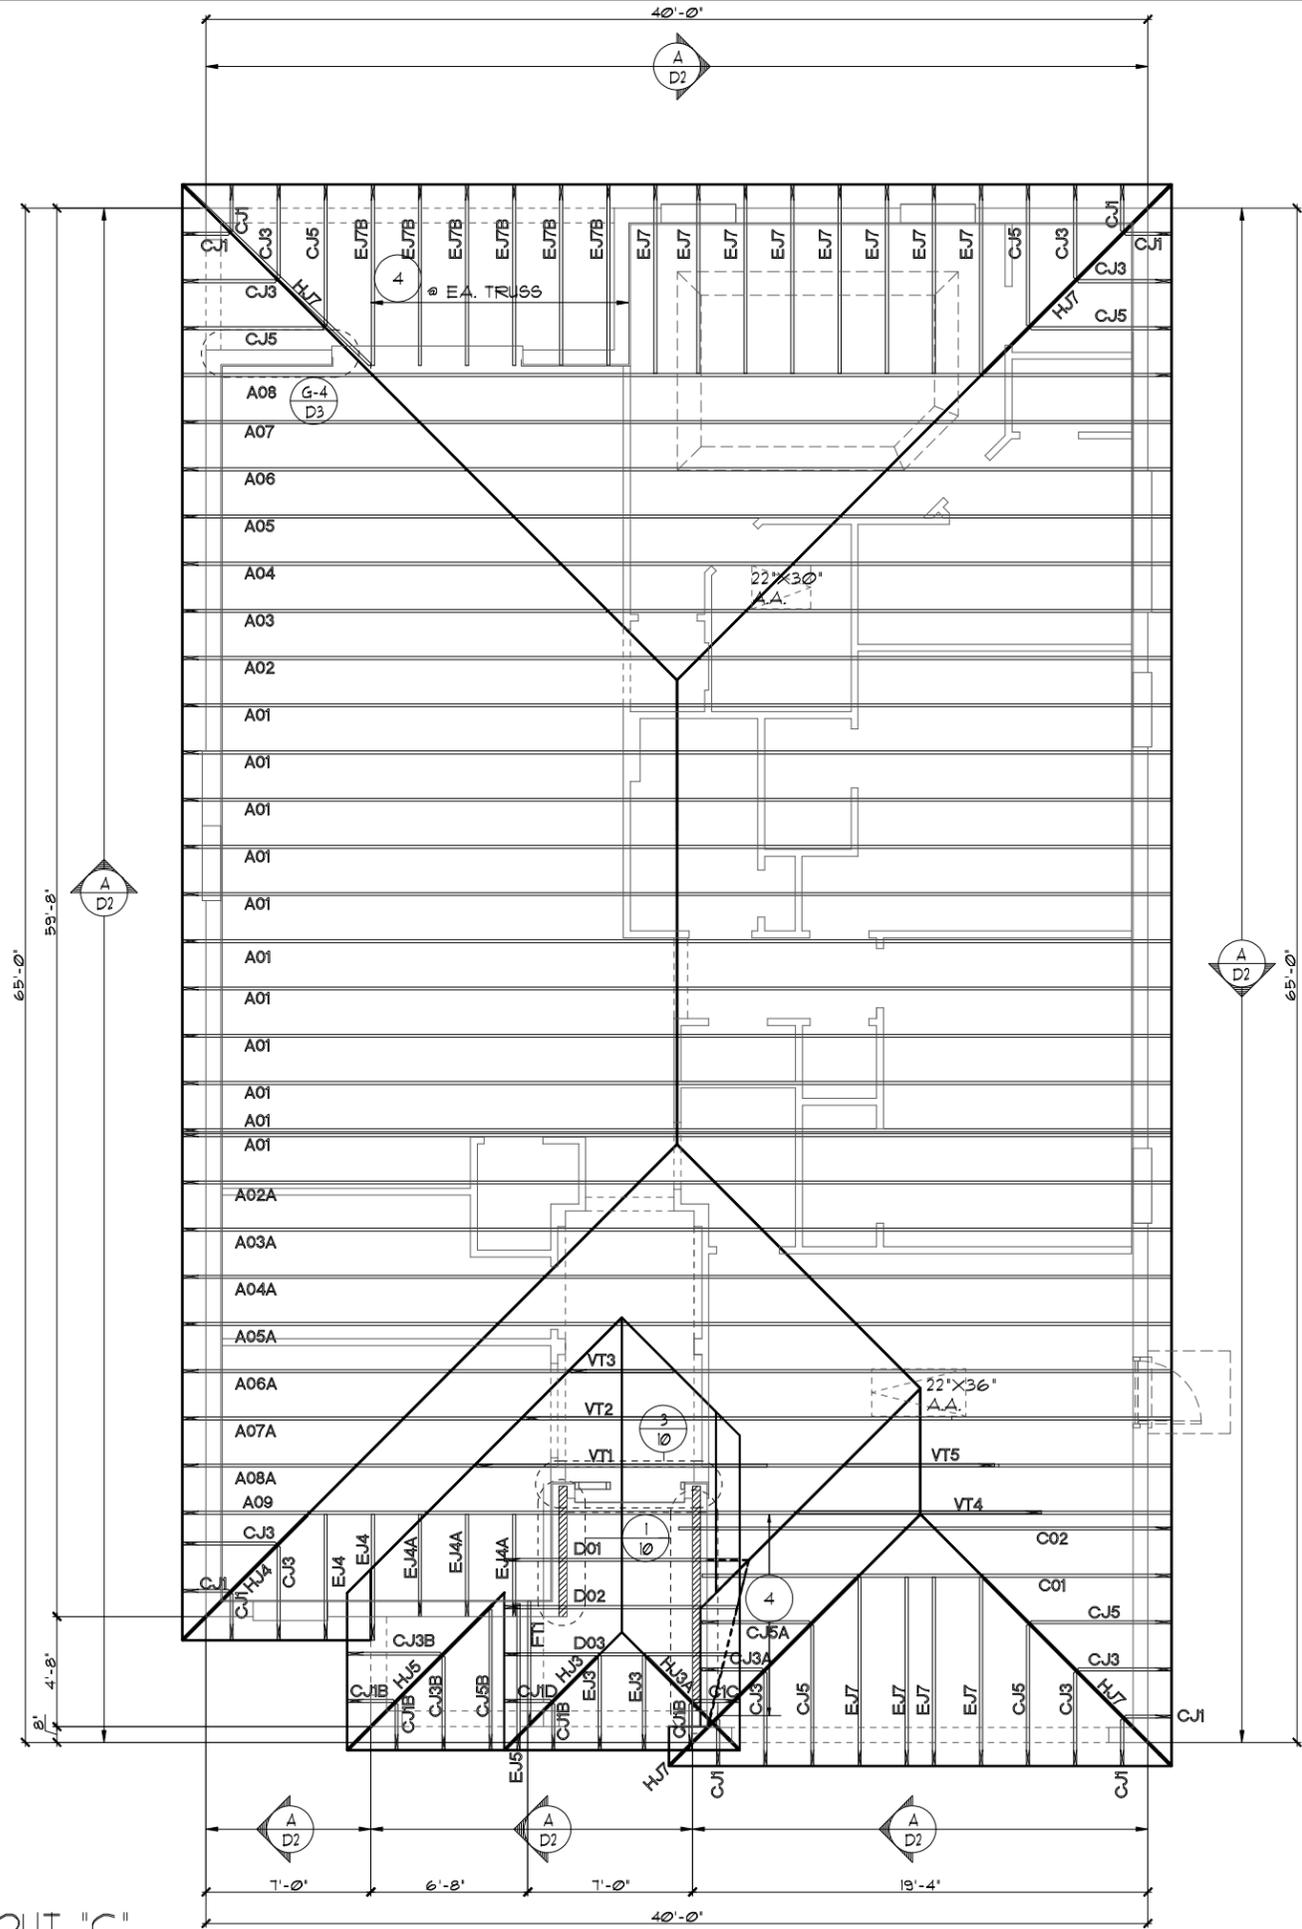

**TRUSS LAYOUT "C"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000


TRUSS LAYOUT

1966

MARGATE II

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	
OF	08 SHEETS



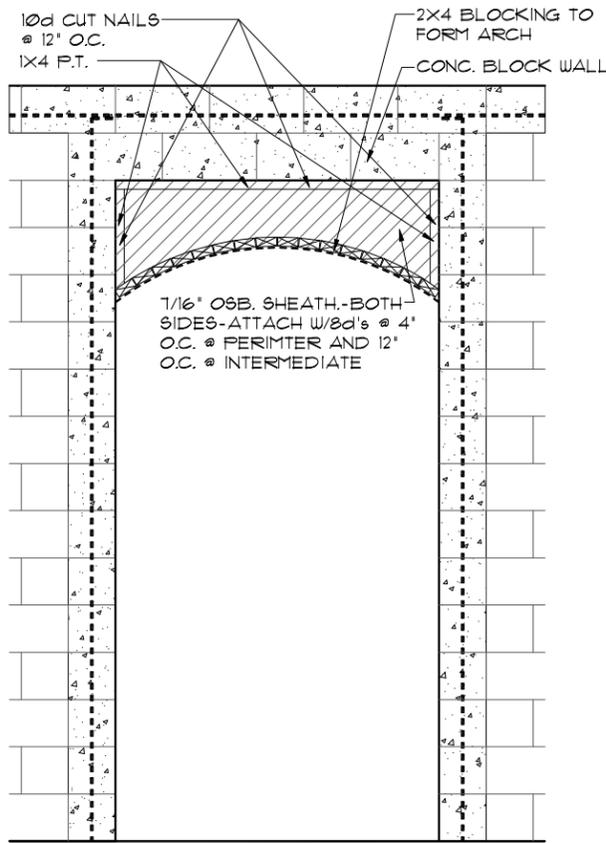

**4**  
**8C** DETAIL  
1/2"x1'-0" (11X17) 1"x1'-0" (22X34)

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61 I.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.1

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{SF.}}{300} = 8.64\text{SF.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- **4.68SF.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF.** /VENT.  
(VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **4.32SF.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( **50 L.F.** @ **0.087SF.** VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

**TRUSS LAYOUT "C"**  
1/8"x1'-0" (11X17) 1/4"x1'-0" (22X34)

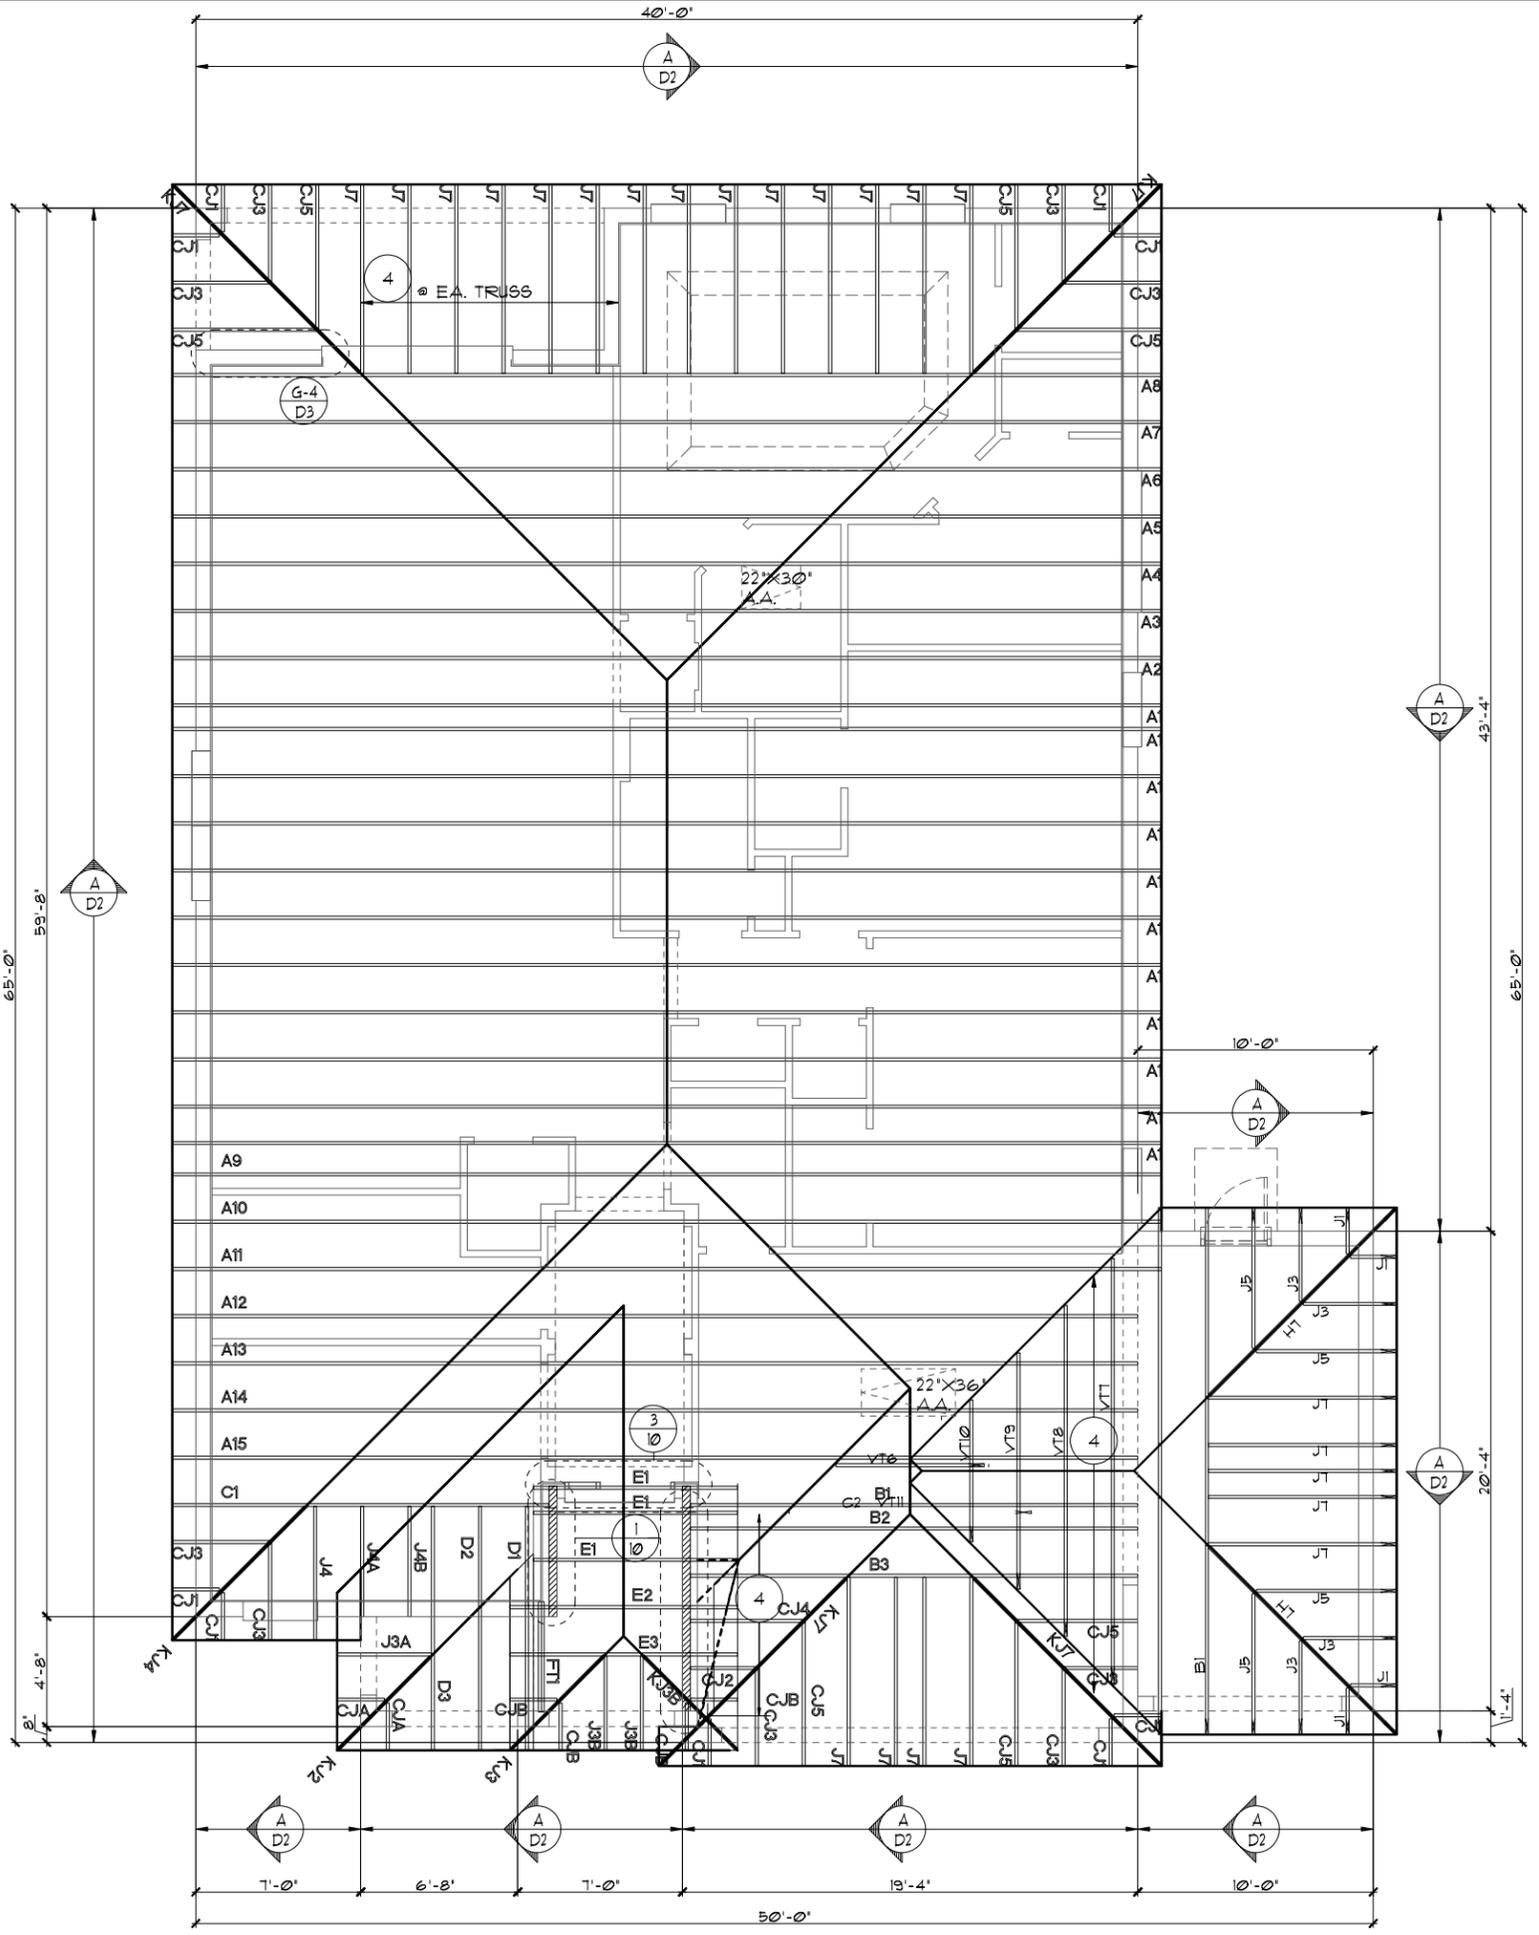

**3-CAR GARAGE OPTION**  
THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**LOT: 0000, COMMUNITY NAME**  
1966  
MARGATE II

**FLORIDA SERIES**


**ITEG**  
HOBBSON ENGINEERING GROUP, INC.  
1400 W. UNIVERSITY AVENUE, SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1400  
FAX: (407) 734-1790  
WWW.ITEG.COM

**Park Square HOMES**  
A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 528 - 3000

**TRUSS LAYOUT**

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
08C.3  
OF 08 SHEETS

REVISIONS BY  
05-16-19 JF

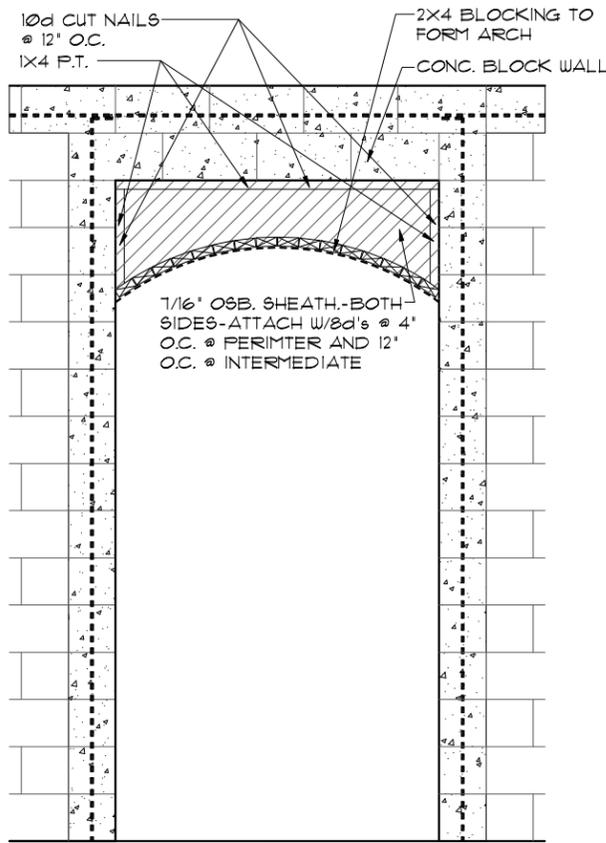

4  
8C  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC 2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL:----- 4.68S.F.  
 PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F. /VENT.  
 (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 4.32S.F.  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 (.50 L.F. @ 0.087S.F. VENTING PER L.F.)

UPPER PORTION PERCENTAGE: 50%  
 LOWER PORTION PERCENTAGE: 50%

- NOTES**
- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  - ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  - TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
  - REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  - SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.11 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.11. Underlayment shall be applied and attached in accordance with Table R305.11.
  - OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  - ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.11.1

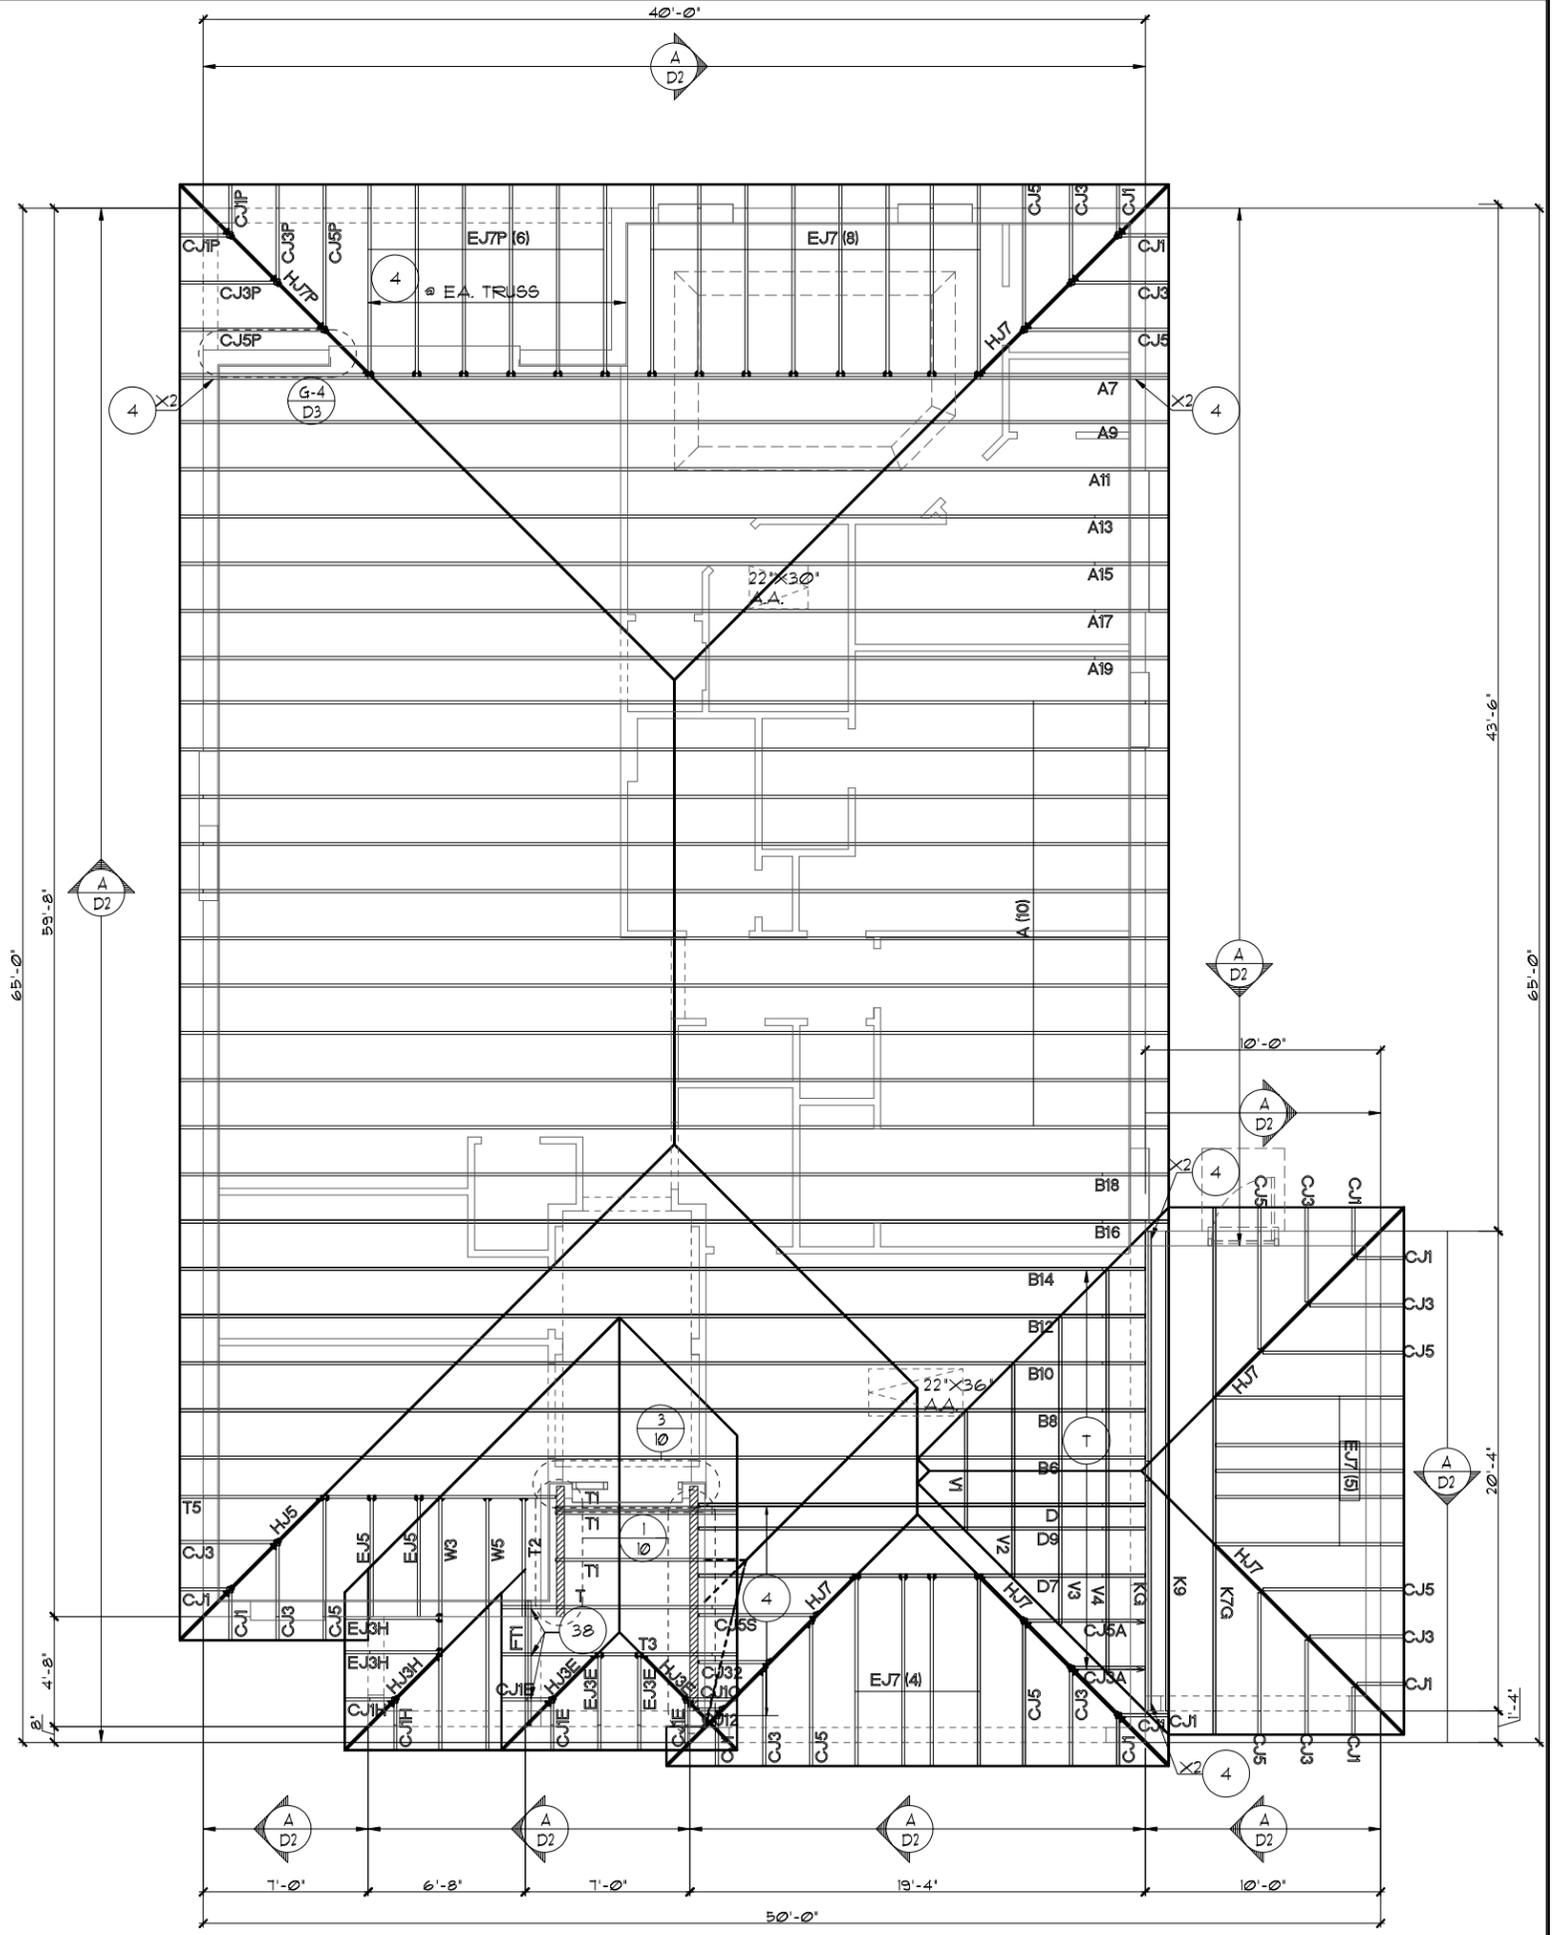

TRUSS LAYOUT "C"  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 08C OF 08 SHEETS


1966  
 MARGATE II

FLORIDA SERIES  
 IITEG  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 794-1790  
 www.iiteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 528-3000

Park Square HOMES

REVISIONS BY  
 05-16-19 JF

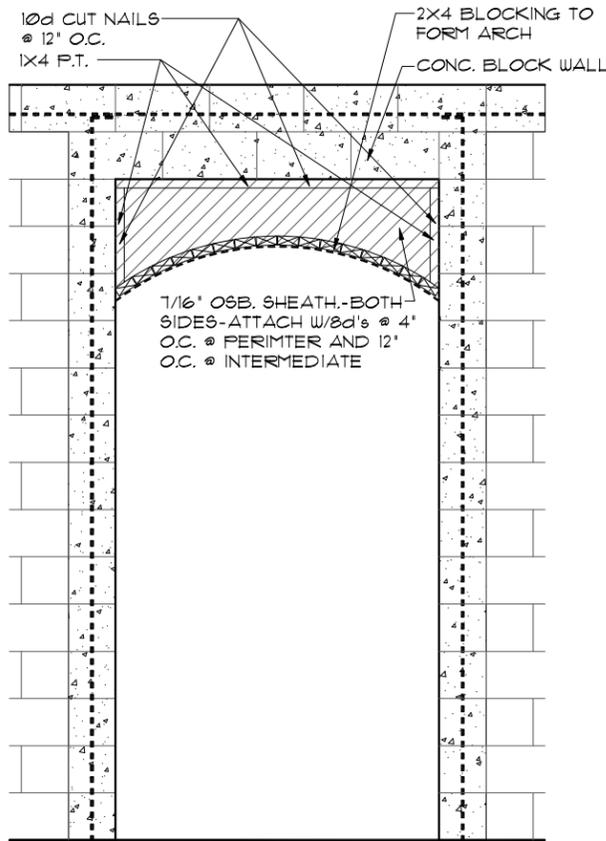

**4** **DETAIL**  
 8C 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC 2023 8TH EDITION R206: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL:----- **4.68S.F.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78S.F.** VENT.  
 (VENT TYPE: LOMANCO MODEL 770-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32S.F.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50** L.F. @ **0.087S.F.** VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

- NOTES**
- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  - ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  - TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCS1 I.
  - REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  - SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  - OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  - ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.

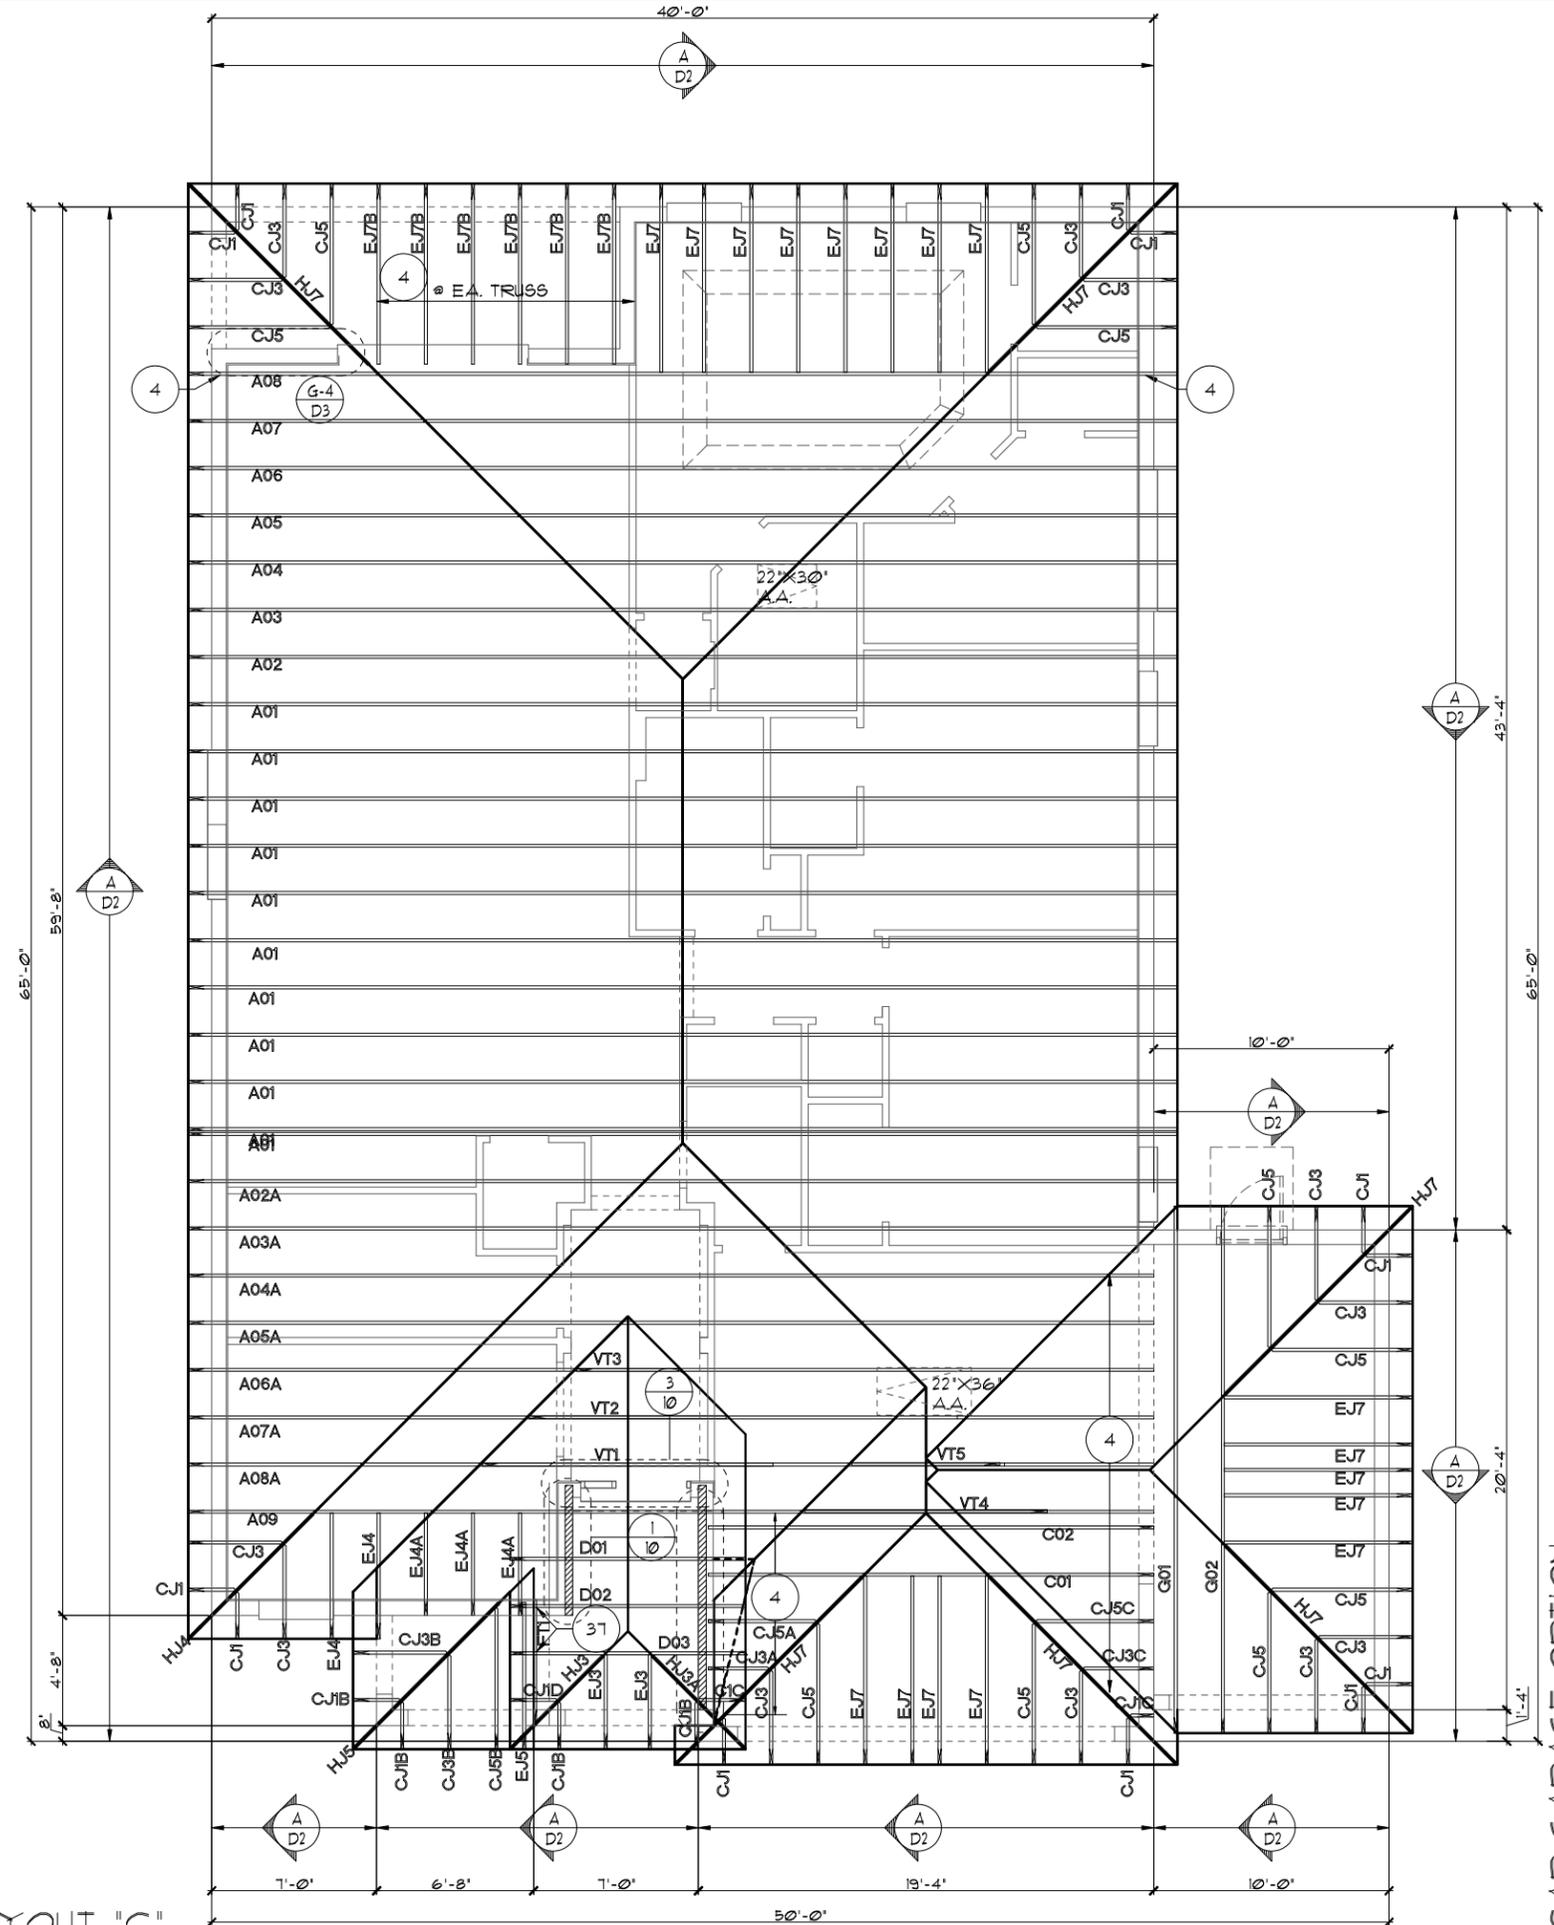

**TRUSS LAYOUT "C"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

3-CAR GARAGE OPTION

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET

08C-3  
 OF 08 SHEETS

1966

MARGATE II


TRUSS LAYOUT

FLORIDA SERIES

**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vlneland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000


REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 10000 W. Colonial Ave., Suite 100  
 Orlando, FL 32817  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com

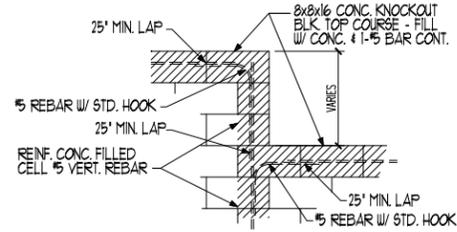



**BLOCK WALL HT. TRANSITION DETAIL**

CAST CRETE LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F32-1B/IT	GARAGE DOOR
L 2	4'-6"	8F16-0B/IT	SH25
L 3	4'-6"	8F16-0B/IT	SH25
L 4	7'-6"	8F12-0B/IT	6/0X1/0 F.G.
L 5	4'-6"	8F16-0B/IT	SH25
L 6	4'-6"	8F16-0B/IT	SH25
L 7	11'-4"	8F16-1B/IT	REAR LANAI
L 8	5'-10"	8F16-0B/IT	REAR LANAI
L 9	9'-4"	8F16-0B/IT	8/0X8/0 S.G.D.
L 10	7'-6"	8F16-0B/IT	FR SH25
L 11	4'-6"	8F16-0B/IT	SH25
L 12	4'-6"	8F16-0B/IT	SH25
L 13	5'-10"	8RF12-0B/IT	FRONT DOOR
L 14	5'-4"	8F48-0B/IT	FRONT ENTRY
L 15	6'-6"	8F48-0B/IT	FRONT ENTRY
L 16	6'-6"	8F48-0B/IT	FRONT ENTRY
L 17			
L 18			
L 19			
L 20	5'-4"	8F16-0B/IT	4040 OPT MASTER BATH
L 21	9'-4"	8F32-1B/IT	GARAGE DOOR
L 22	16'-0"	8F16-1B/IT	GARAGE
L 23			
L 24			
L 25			
L 26	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 27	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 28			
L 29			
L 30			
L 31			
L 32			
L 33			
L 34			
L 35			
L 36			
L 37			
L 38			
L 39			

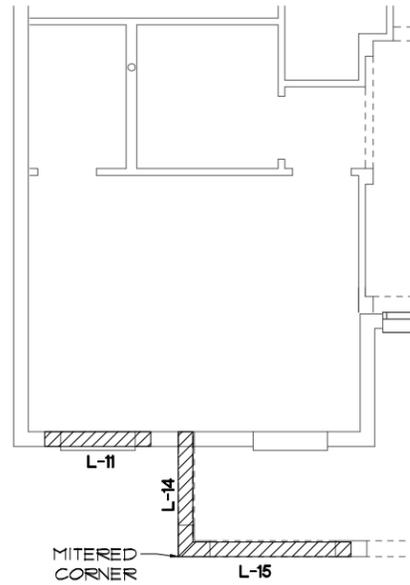


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**PRE CAST LINTEL LAYOUT A & "B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

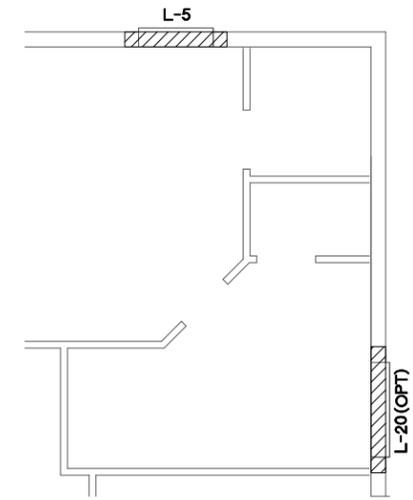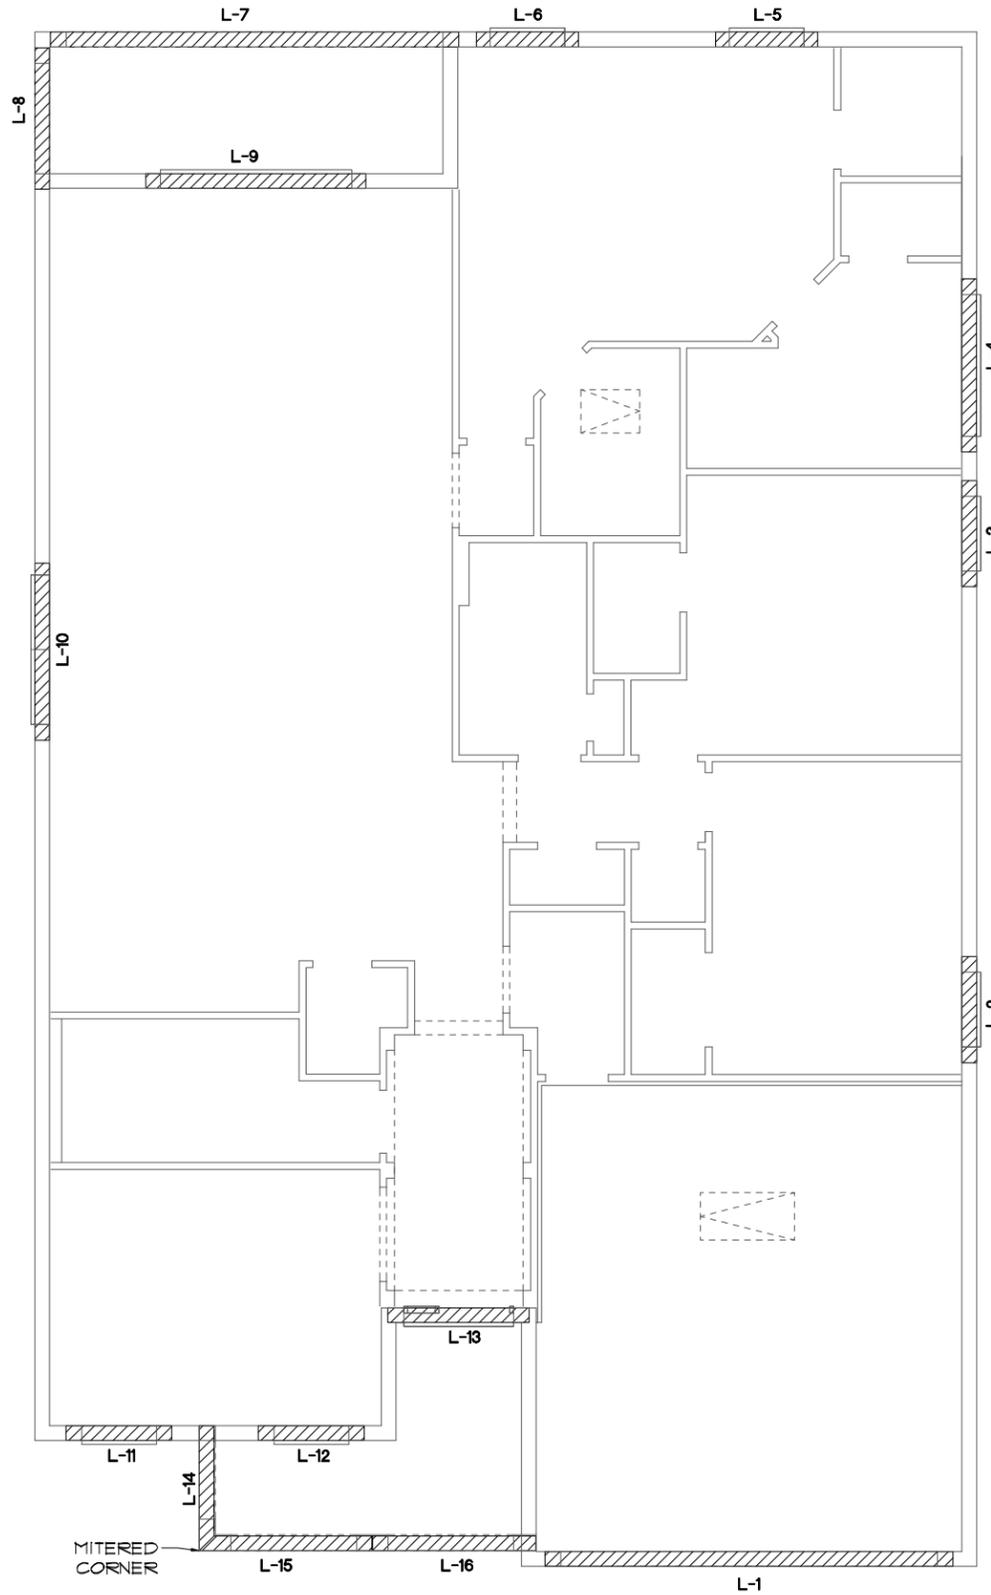

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

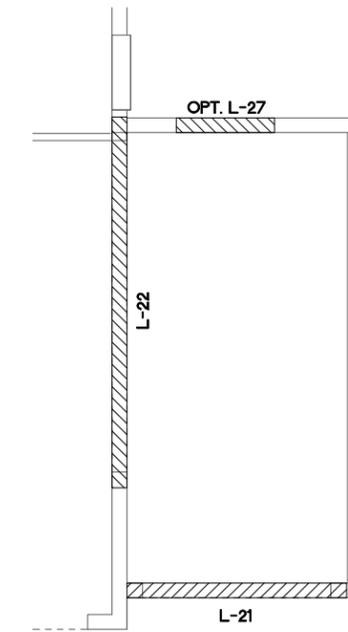

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH


LOT: 0000, COMMUNITY NAME: MARGATE II, 1966

DATE 04-05-2017, SCALE AS NOTED, DRAWN RDC, JOB N/A, SHEET 09AB OF 00 SHEETS





**PRE CAST LINTEL LAYOUT**  
**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000

**FLORIDA SERIES**  
 IITEG  
 THOMPSON ENGINEERING GROUP, INC.  
 1400 W. Colonial Ave., Suite 100  
 Orlando, FL 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com

REVISIONS	BY
05-16-19	JF

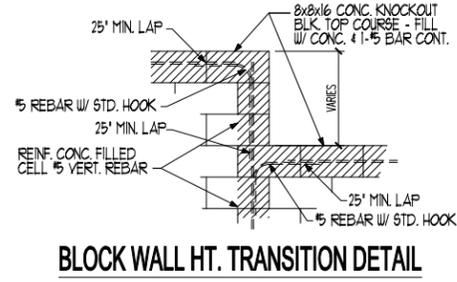

CAST CRETE LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F32-1B/IT	GARAGE DOOR
L 2	4'-6"	8F16-0B/IT	S425
L 3	4'-6"	8F16-0B/IT	S425
L 4	7'-6"	8F12-0B/IT	6/0X1/0 F.G.
L 5	4'-6"	8F16-0B/IT	S425
L 6	4'-6"	8F16-0B/IT	S425
L 7	11'-4"	8F16-1B/IT	REAR LANAI
L 8	5'-10"	8F16-0B/IT	REAR LANAI
L 9	9'-4"	8F16-0B/IT	8/0X8/0 S.G.D.
L 10	7'-6"	8F16-0B/IT	FR S425
L 11	4'-6"	8F16-0B/IT	S425
L 12	4'-6"	8F16-0B/IT	S425
L 13	5'-10"	8RF12-0B/IT	FRONT DOOR
L 14	5'-4"	8F48-0B/IT	FRONT ENTRY
L 15	6'-6"	8F48-0B/IT	FRONT ENTRY
L 16	6'-6"	8F48-0B/IT	FRONT ENTRY
L 17			
L 18			
L 19			
L 20	5'-4"	8F16-0B/IT	4040 OPT MASTER BATH
L 21	9'-4"	8F32-1B/IT	GARAGE DOOR
L 22	16'-0"	8F16-1B/IT	GARAGE
L 23			
L 24			
L 25			
L 26	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 27	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 28			
L 29			
L 30			
L 31			
L 32			
L 33			
L 34			
L 35			
L 36			
L 37			
L 38			
L 39			

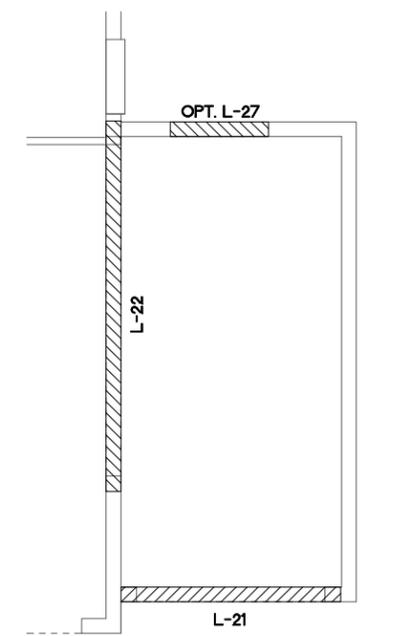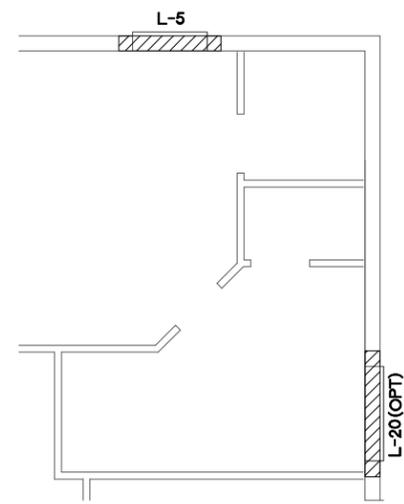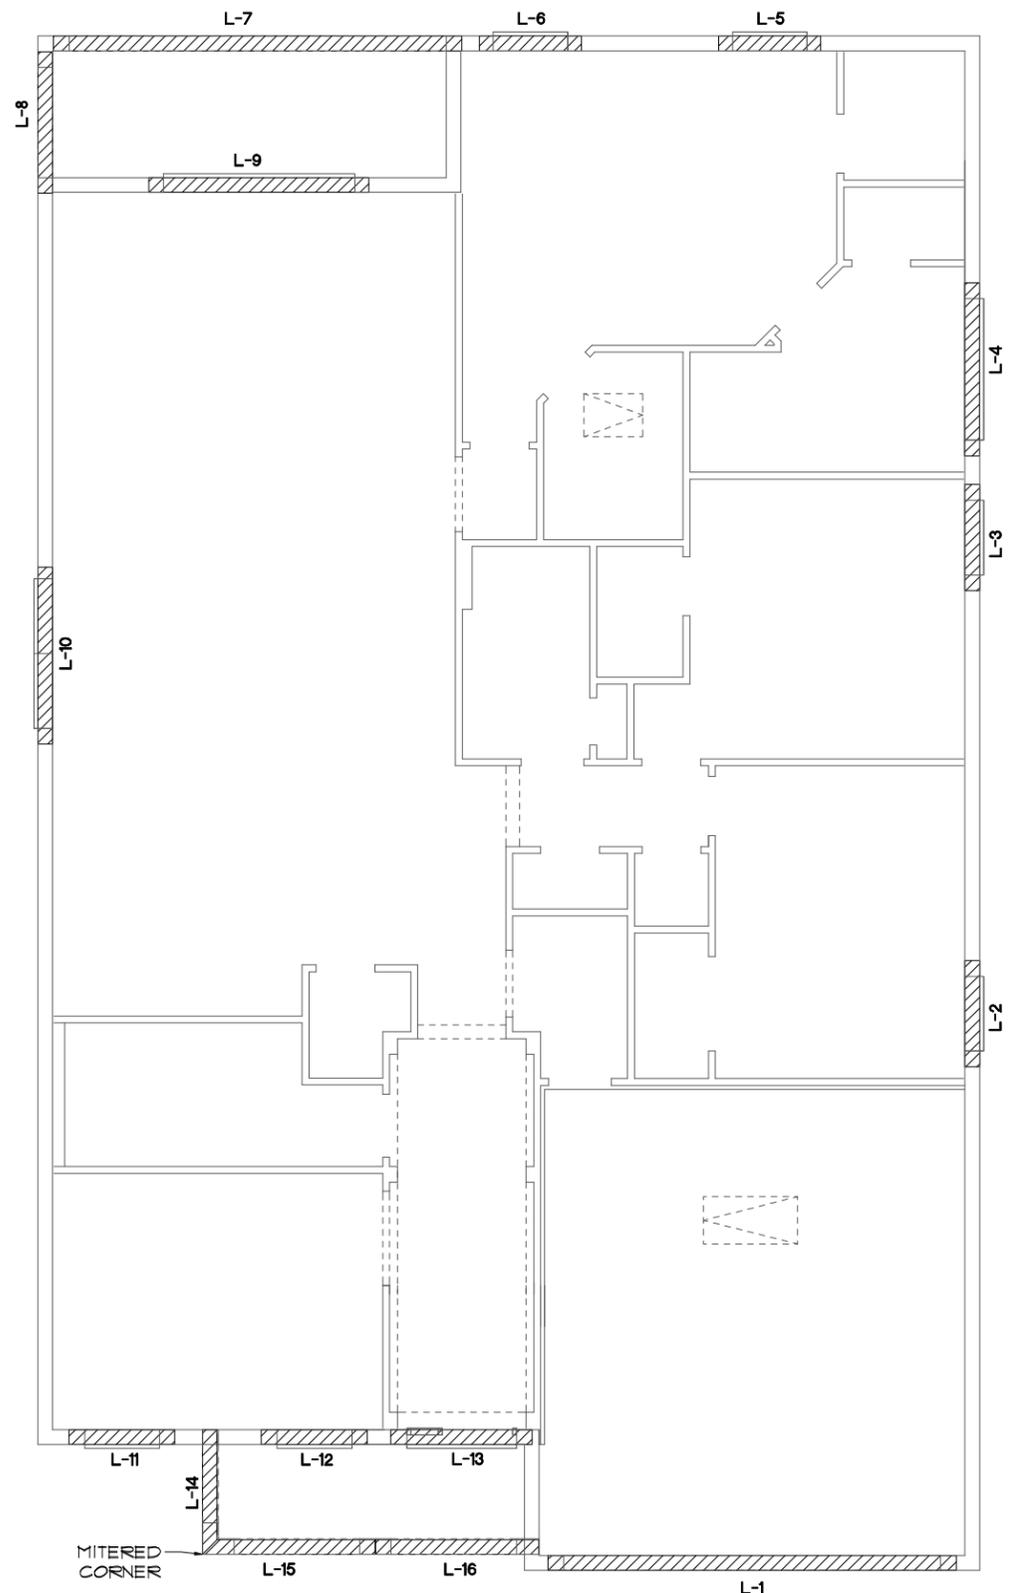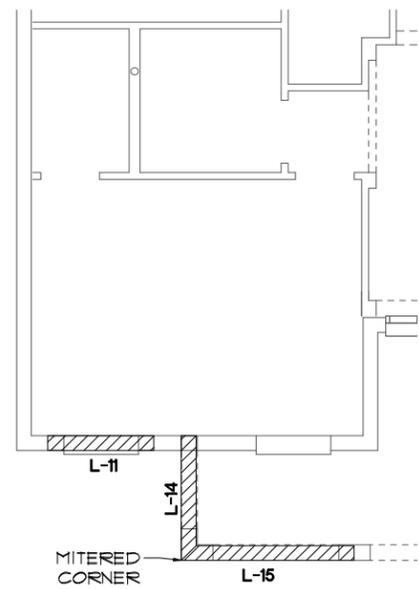

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**LOT: 0000, COMMUNITY NAME**  
 1966  
**MARGATE II**


**FLORIDA SERIES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000

**PRE CAST LINTEL LAYOUT EXTENDED FOYER**

DATE 04-05-2011  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 09AB OF 00 SHEETS


REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 10000 W. Colonial Blvd., Suite 100  
 Orlando, FL 32817  
 Tel: (407) 734-1400  
 Fax: (407) 734-1700  
 www.iteg.com

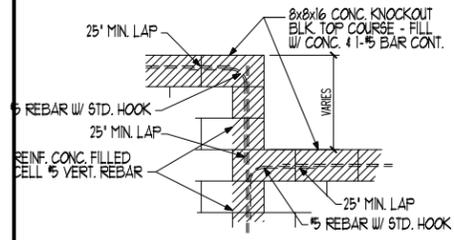



**BLOCK WALL HT. TRANSITION DETAIL**

CAST CRETE LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F32-1B/IT	GARAGE DOOR
L 2	4'-6"	8F16-0B/IT	SH25
L 3	4'-6"	8F16-0B/IT	SH25
L 4	7'-6"	8F12-0B/IT	6/0X1/0 F.G.
L 5	4'-6"	8F16-0B/IT	SH25
L 6	4'-6"	8F16-0B/IT	SH25
L 7	11'-4"	8F16-1B/IT	REAR LANAI
L 8	5'-10"	8F16-0B/IT	REAR LANAI
L 9	9'-4"	8F16-0B/IT	8/0X8/0 S.G.D.
L 10	7'-6"	8F16-0B/IT	FR SH25
L 11	4'-6"	8F16-0B/IT	SH25
L 12			
L 13	5'-10"	8RF12-0B/IT	FRONT DOOR
L 14	5'-4"	8F16-0B/IT	FRONT ENTRY
L 15	6'-6"	8F16-0B/IT	FRONT ENTRY
L 16	6'-6"	8F36-0B/IT	FRONT ENTRY
L 17			
L 18			
L 19			
L 20	5'-4"	8F16-0B/IT	4040 OPT MASTER BATH
L 21	9'-4"	8F32-1B/IT	GARAGE DOOR
L 22	16'-0"	8F16-1B/IT	GARAGE
L 23			
L 24			
L 25			
L 26	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 27	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 28			
L 29			
L 30			
L 31			
L 32			
L 33			
L 34			
L 35			
L 36			
L 37			
L 38			
L 39			

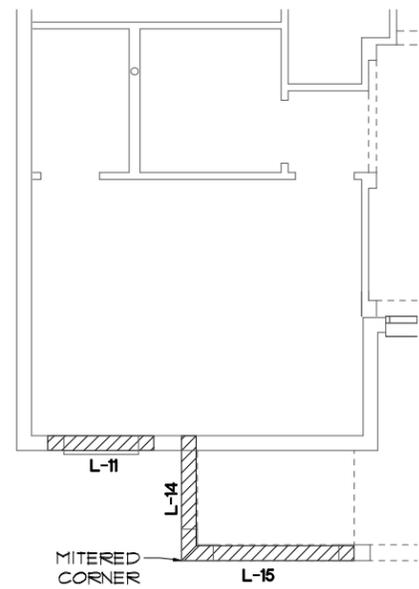


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**PRE CAST LINTEL LAYOUT "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

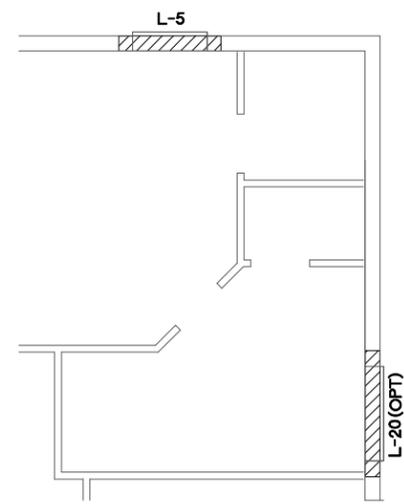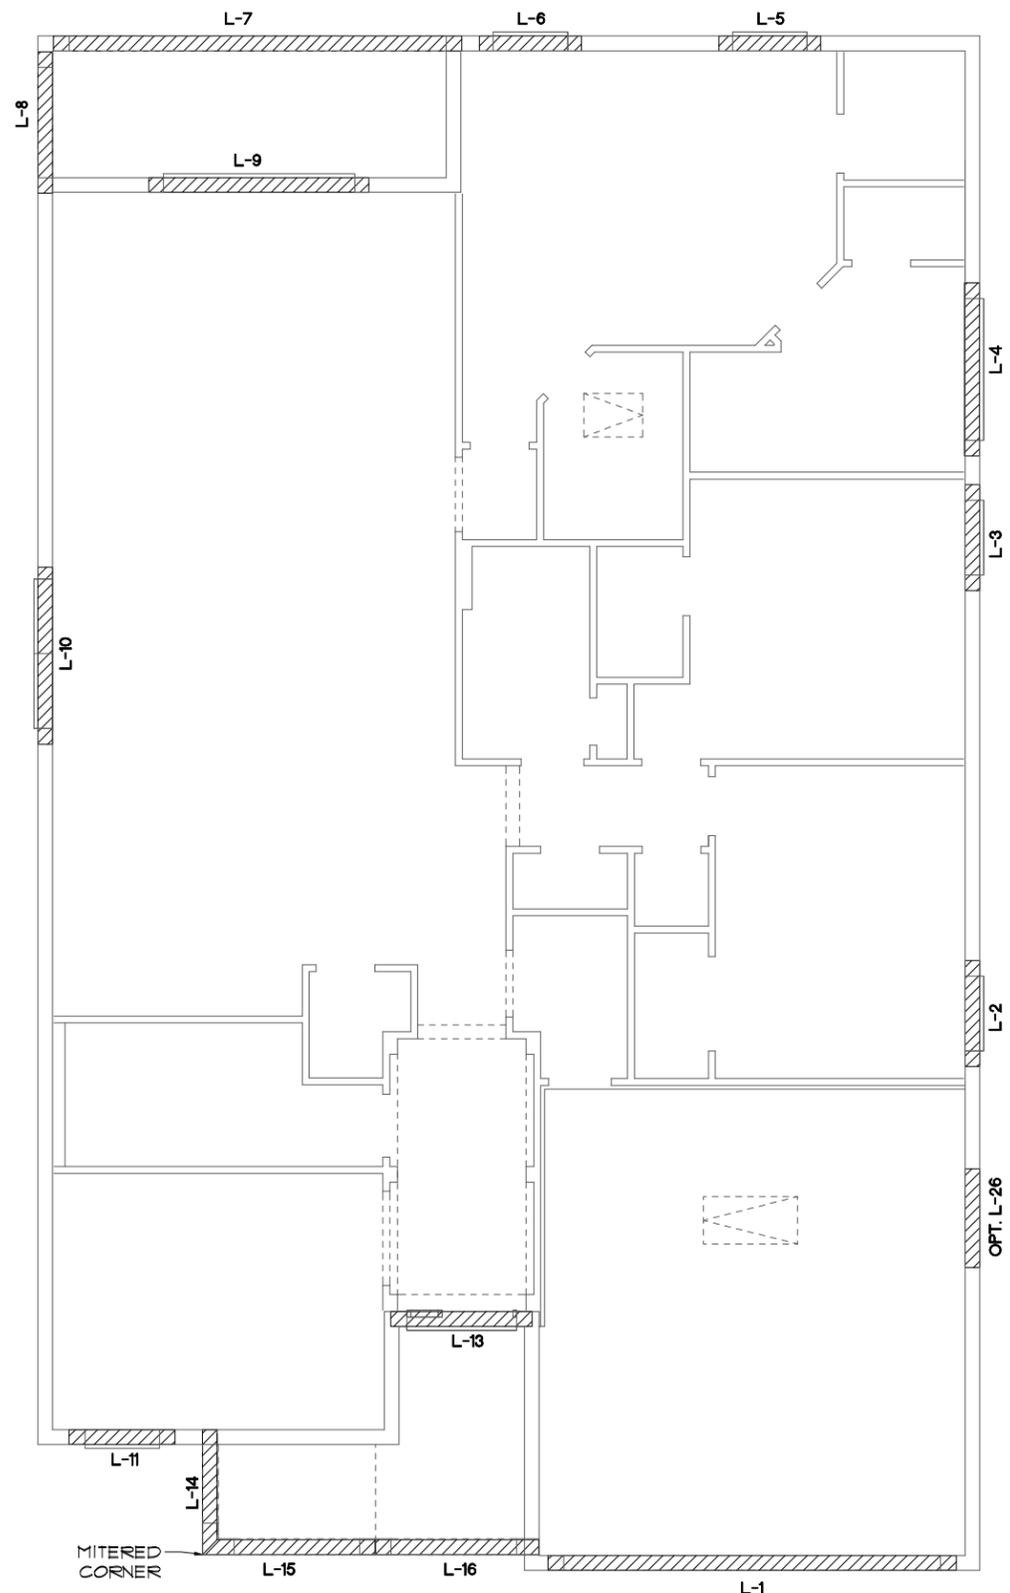

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

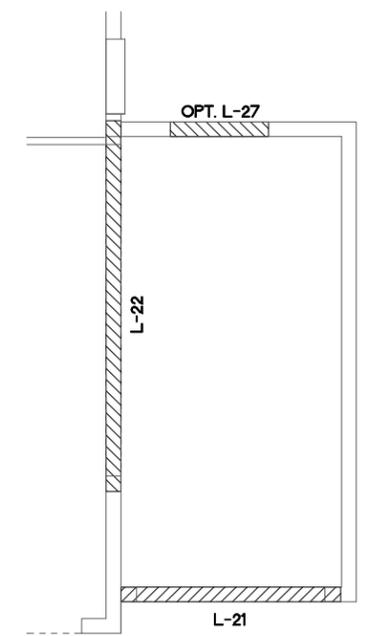

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2003 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

FLORIDA SERIES

LOT: 0000, COMMUNITY NAME

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
10000 W. Colonial Blvd., Suite 200  
Orlando, Florida 32811  
Tel: (407) 734-1400  
Fax: (407) 734-1790  
www.iteg.com


A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529 - 3000

**Park Square HOMES**

PRE CAST LINTEL LAYOUT


1966  
MARGATE II

DATE 04-05-2011  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
09C  
OF 00 SHEETS

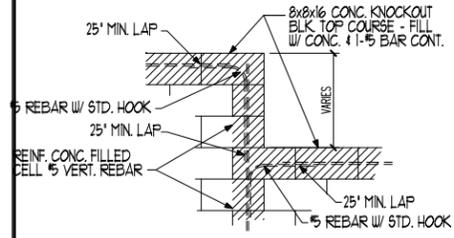



**BLOCK WALL HT. TRANSITION DETAIL**

CAST CRETE LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F32-1B/IT	GARAGE DOOR
L 2	4'-6"	8F16-0B/IT	SH25
L 3	4'-6"	8F16-0B/IT	SH25
L 4	7'-6"	8F12-0B/IT	6/0X1/0 F.G.
L 5	4'-6"	8F16-0B/IT	SH25
L 6	4'-6"	8F16-0B/IT	SH25
L 7	11'-4"	8F16-1B/IT	REAR LANAI
L 8	5'-10"	8F16-0B/IT	REAR LANAI
L 9	9'-4"	8F16-0B/IT	8/0X8/0 S.G.D.
L 10	7'-6"	8F16-0B/IT	FR SH25
L 11	4'-6"	8F16-0B/IT	SH25
L 12			
L 13	5'-10"	8RF12-0B/IT	FRONT DOOR
L 14	5'-4"	8F16-0B/IT	FRONT ENTRY
L 15	6'-6"	8F16-0B/IT	FRONT ENTRY
L 16	6'-6"	8F56-0B/IT	FRONT ENTRY
L 17			
L 18			
L 19			
L 20	5'-4"	8F16-0B/IT	4040 OPT MASTER BATH
L 21	9'-4"	8F32-1B/IT	GARAGE DOOR
L 22	16'-0"	8F16-1B/IT	GARAGE
L 23			
L 24			
L 25			
L 26	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 27	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 28			
L 29			
L 30			
L 31			
L 32			
L 33			
L 34			
L 35			
L 36			
L 37			
L 38			
L 39			

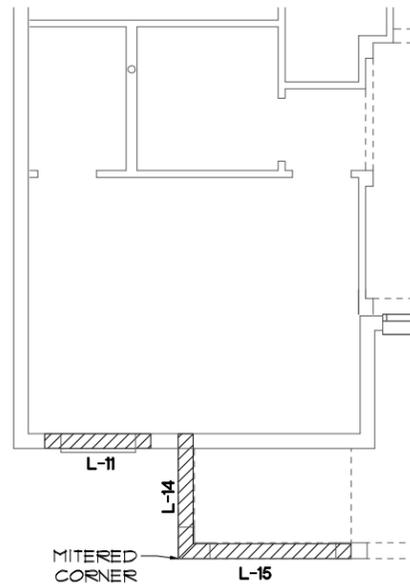


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**PRE CAST LINTEL LAYOUT "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

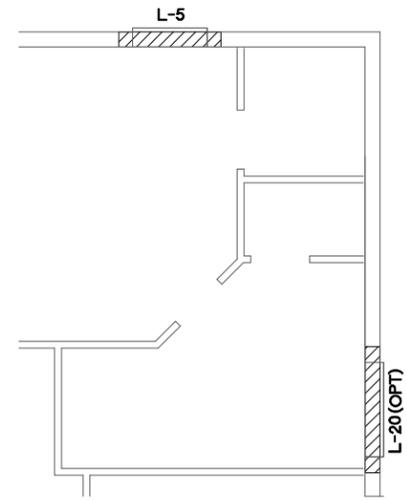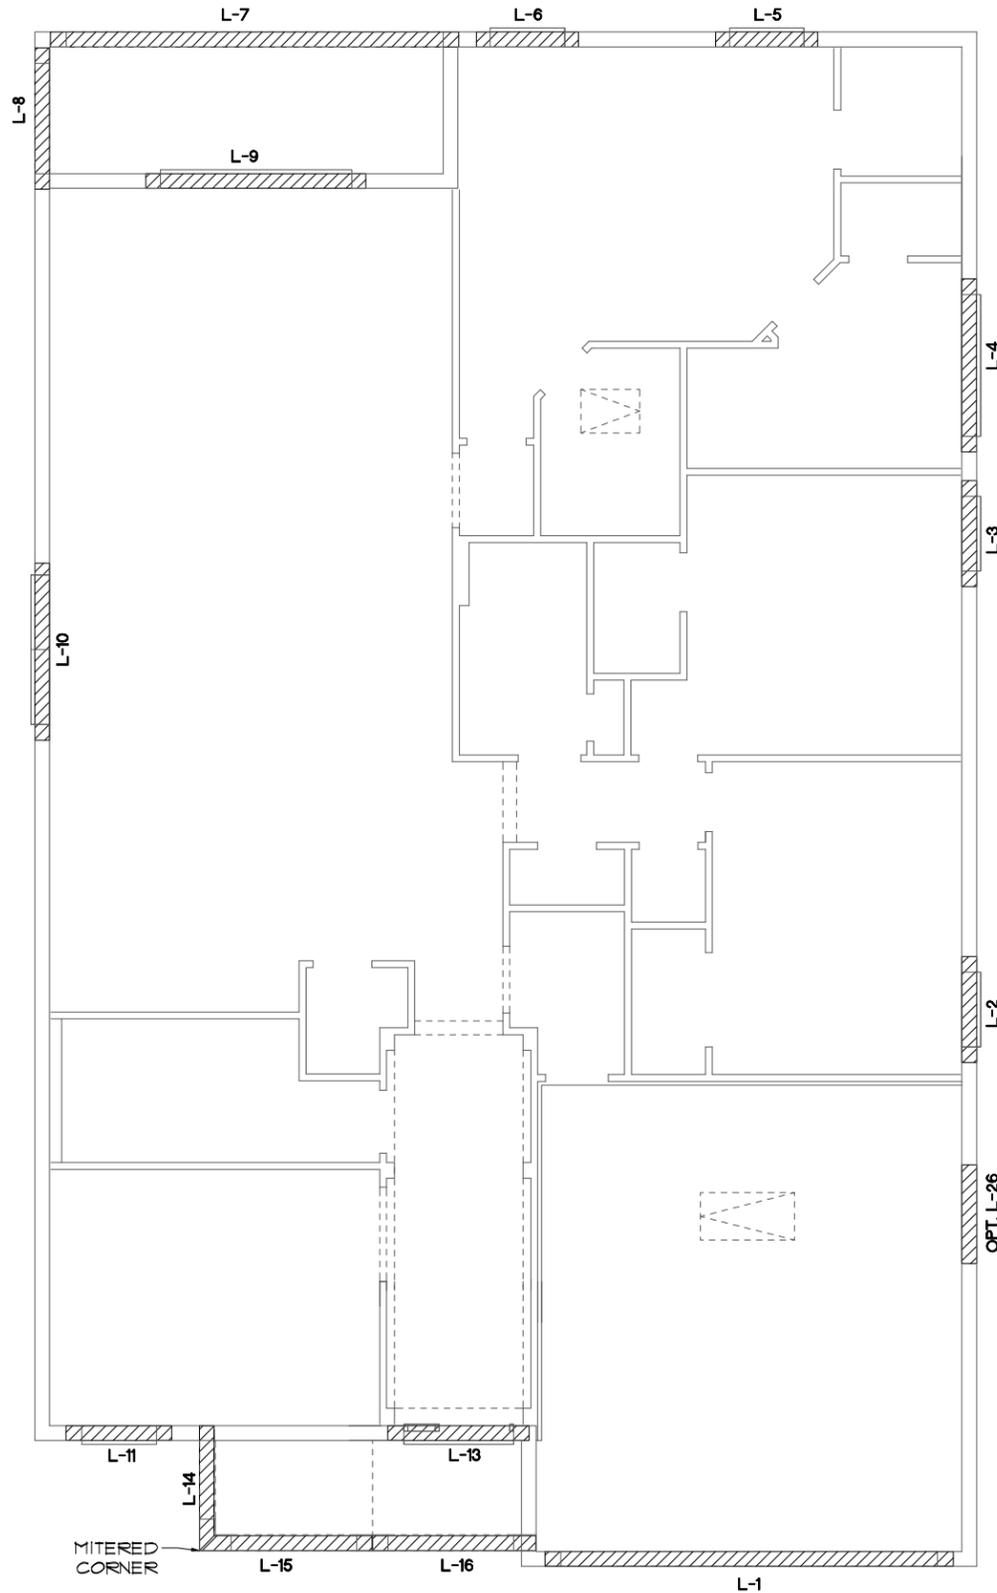

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

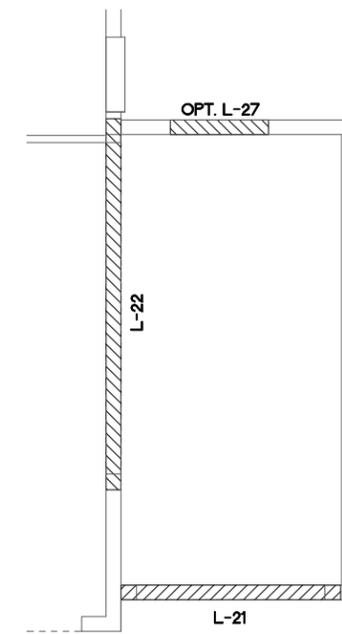

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

FLORIDA SERIES

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
10000 W. Colonial Ave., Suite 200  
Orlando, Florida 32811  
Tel: (407) 734-1400  
Fax: (407) 734-1790  
www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529 - 3000

**Park Square HOMES**

PRE CAST LINTEL LAYOUT  
EXTENDED FOYER

1966  
MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
09C  
OF 00 SHEETS

# SAFE LOAD TABLES FOR GRAVITY, UPLIFT & LATERAL LOADS

## 8' PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	GRAVITY											
		8F8-0B	8F10-0B	8F12-0B	8F14-0B	8F16-0B	8F18-0B	8F20-0B	8F22-0B	8F24-0B	8F26-0B	8F28-0B	8F30-0B
2'-10" (34") PRECAST	2302	316e	4473	6039	7526	9004	10472	11936					
		316e	4473	6039	7526	9004	10472	11936					
3'-6" (42") PRECAST	2302	316e	4473	6039	7526	9004	10472	11936					
		2325	2496	3461	4438	5410	6384	7358					
4'-0" (48") PRECAST	2029	2646	4473	6039	7526	9004	10472	11936					
		1787	1913	2657	3403	4149	4896	5644					
4'-6" (54") PRECAST	1651	2170	4027	6039	7526	9004	10472	11936					
		1223	1301	1809	2311	2816	3336	3846					
5'-4" (64") PRECAST	1184	1665	2889	5097	6796	8490	10184	11878					
		1000	1059	1474	1889	2304	2721	3137					
5'-10" (70") PRECAST	972	1459	2464	4144	5458	6772	8086	9400					
		1255	1201	1633	2065	2497	2929	3361					
6'-6" (78") PRECAST	937	1255	2101	3763	4977	6191	7405	8619					
		1025	1075	1405	1735	2065	2395	2725					
7'-6" (90") PRECAST	767	1025	1675	2610	3545	4480	5415	6350					
		767	827	1088	1349	1610	1871	2132					
9'-4" (112") PRECAST	573	632	1049	1469	1889	2309	2729	3149					
		482	502	652	802	952	1102	1252					
10'-6" (126") PRECAST	456	656	1075	1514	1953	2392	2831	3270					
		598	638	838	1038	1238	1438	1638					
11'-4" (136") PRECAST	448	548	964	1384	1804	2224	2644	3064					
		427	476	627	776	927	1076	1227					
12'-0" (144") PRECAST	414	485	748	1076	1404	1732	2060	2388					
		381	448	578	708	838	968	1098					
14'-0" (168") PRECAST	338	455	700	1003	1306	1609	1912	2215					
		NR											
14'-8" (176") PRESTRESSED	NR	465	765	1100	1435	1770	2105	2440					
		NR											
15'-4" (184") PRESTRESSED	NR	420	695	1020	1345	1670	2000	2325					
		NR											
17'-4" (208") PRESTRESSED	NR	310	530	750	970	1190	1410	1630					
		NR											
19'-4" (232") PRESTRESSED	NR	240	400	560	720	880	1040	1200					
		NR											
21'-4" (256") PRESTRESSED	NR	183	330	480	630	780	930	1080					
		NR											
22'-0" (264") PRESTRESSED	NR	160	300	450	600	750	900	1050					
		NR											
24'-0" (288") PRESTRESSED	NR	130	240	350	460	570	680	790					
		NR											



## 8' PRECAST W/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	GRAVITY											
		8RF8-0B	8RF10-0B	8RF12-0B	8RF14-0B	8RF16-0B	8RF18-0B	8RF20-0B	8RF22-0B	8RF24-0B	8RF26-0B	8RF28-0B	8RF30-0B
4'-4" (52") PRECAST	1489	1991	3029	4267	5505	6743	7981	9219					
		1449	1782	2114	2446	2778	3110	3442					
4'-6" (54") PRECAST	1351	1702	2472	3242	4012	4782	5552	6322					
		832	1002	1172	1342	1512	1682	1852					
5'-8" (68") PRECAST	785	1153	1662	2171	2680	3189	3698	4207					
		779	800	1049	1298	1547	1796	2045					
5'-10" (70") PRECAST	735	1103	2051	3000	3949	4898	5847	6796					
		907	1071	1235	1399	1563	1727	1891					
6'-8" (80") PRECAST	822	907	1671	2435	3199	3963	4727	5491					
		761	1371	2252	3133	4014	4895	5776					
7'-6" (90") PRECAST	665	764	1371	2329	3287	4245	5203	6161					
		420	834	1253	1672	2091	2510	2929					
9'-8" (116") PRECAST	371	535	928	1497	2166	2835	3504	4173					

## 8' PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	UPLIFT												LATERAL	
		8F8-0B	8F10-0B	8F12-0B	8F14-0B	8F16-0B	8F18-0B	8F20-0B	8F22-0B	8F24-0B	8F26-0B	8F28-0B	8F30-0B	8F8	8F8
2'-10" (34") PRECAST	2721	2818	4101	5332	6563	7794	9025						2021	2021	
		2721	2784	3381	3978	4575	5172	5769							
3'-6" (42") PRECAST	2165	2289	3260	4231	5202	6173	7144						1291	1291	
		2165	2275	2865	3455	4045	4635	5225							
4'-0" (48") PRECAST	1878	1993	2832	3680	4528	5376	6224						938	938	
		1878	1925	2350	2775	3200	3625	4050							
4'-6" (54") PRECAST	1660	1762	2501	3257	4013	4769	5525						721	721	
		1660	1709	2135	2561	2987	3413	3839							
5'-4" (64") PRECAST	1393	1484	2110	2741	3372	4003	4634						509	509	
		1393	1431	1857	2283	2709	3135	3561							
5'-10" (70") PRECAST	1272	1351	1930	2509	3088	3667	4246						418	418	
		1272	1315	1741	2167	2593	3019	3445							
6'-6" (78") PRECAST	1141	1200	1733	2266	2799	3332	3865						707	881	
		1141	1182	1608	2034	2460	2886	3312							
7'-6" (90") PRECAST	997	1079	1466	1853	2240	2627	3014						591	657	
		997	1039	1465	1884	2303	2722	3141							
9'-4" (112") PRECAST	807	875	1182	1489	1796	2103	2410						454	630	
		807	849	1273	1664	2055	2446	2837							
10'-6" (126") PRECAST	716	761	1039	1317	1595	1873	2151						396	493	
		716	758	1149	1540	1931	2322	2713							
11'-4" (136") PRECAST	666	693	936	1179	1422	1665	1908						363	556	
		666	708	1137	1576	2015	2454	2893							
12'-0" (144") PRECAST	607	634	846	1058	1270	1482	1694						340	494	
		607	649	1008	1447	1886	2325	2764							
13'-4" (160") PRECAST	500	527	709	891	1073	1255	1437						302	398	
		500	542	932	1371	1810	2249	2688							
14'-0" (168") PRECAST	458	485	643	801	959	1117	1275						286	360	
		458	499	852	1291	1730	2169	2608							
14'-8" (176") PRESTRESSED	243	243	285	327	369	411	453						NR	357	
		243	285	327	369	411	453	495							
15'-4" (184") PRESTRESSED	228	228	270	312	354	396	438						NR	327	
		228	270	312	354	396	438	480							
17'-4" (208") PRESTRESSED	188	188	230	272	314	356	398						NR	255	
		188	230	272	314	356	398	440							
19'-4" (232") PRESTRESSED	165	165	207	249	291	333	375						NR	204	
		165	207	249	291	333	375	417							
21'-4" (256") PRESTRESSED	142	142	184	226	268	310	352						NR	172	
		142	184	226	268	310	352	394							
22'-0" (264") PRESTRESSED	140	140	182	224	266	308	350						NR	161	
		140	182	224	266	308	350	392							
24'-0" (288") PRESTRESSED	124	124	166	208	250	292	334						NR	135	
		124	166	208	250	292	334	376							

\*REDUCE VALUE BY 25% FOR GRADE 40 FIELD REBAR

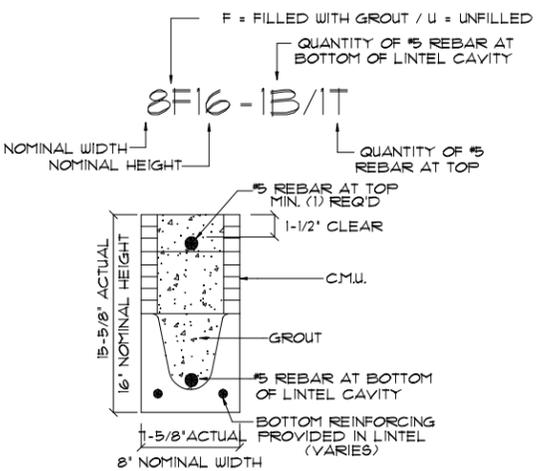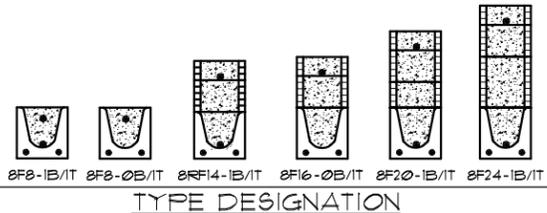

### MATERIALS





1. f'c precast lintels = 3500 psi.
2. f'c prestressed lintels = 6000 psi.
3. f'c grout = 3000 psi w/ maximum 3/8" aggregate.
4. Concrete masonry units (CMU) per ASTM C90 w/ minimum net area compressive strength = 1900 psi.
5. Rebar provided in precast lintel per ASTM A615 GR60. Field rebar per ASTM A615 GR40 or GR60.
6. Prestressing strand per ASTM A416 grade 270 low relaxation.
7. T/32 wire per ASTM A510.
8. Mortar per ASTM C270 type M or S.

### GENERAL NOTES

1. Provide full mortar head and bed joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural drawings.
4. Lintels are manufactured with 5-1/2' long notches at the ends to accommodate vertical cell reinforcing and grouting.
5. All lintels meet or exceed L/360 vertical deflection, except lintels 17'-4" and longer with a nominal height of 8' meet or exceed L/180.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. T/32 diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load ratings based on rational design analysis per ACI 318 and ACI 530.


### SAFE LOAD TABLE NOTES

1. All values based on minimum 4' bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6-1/2'. Safe loads for all recessed lintels based on 8' nominal bearing.
2. N.R. = Not Rated.
3. Safe loads are total superimposed allowable load on the section specified.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. Additional lateral load capacity can be obtained by the designer by providing additional reinforced masonry above the precast lintel.
6. One #1 rebar may be substituted for two #5 rebars in 8' lintels only.
7. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-away from the face of support.
8. For composite lintel heights not shown, use safe load from next lower height.
9. All safe loads in units

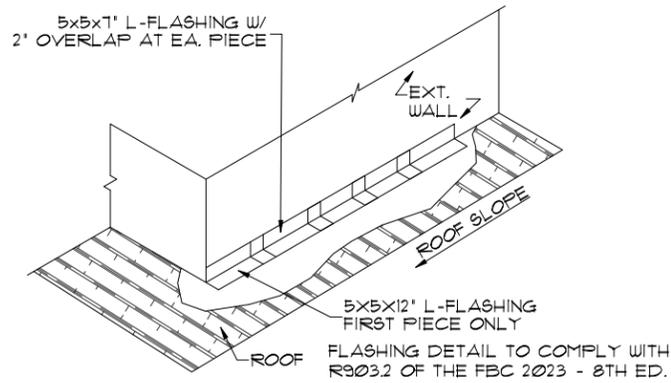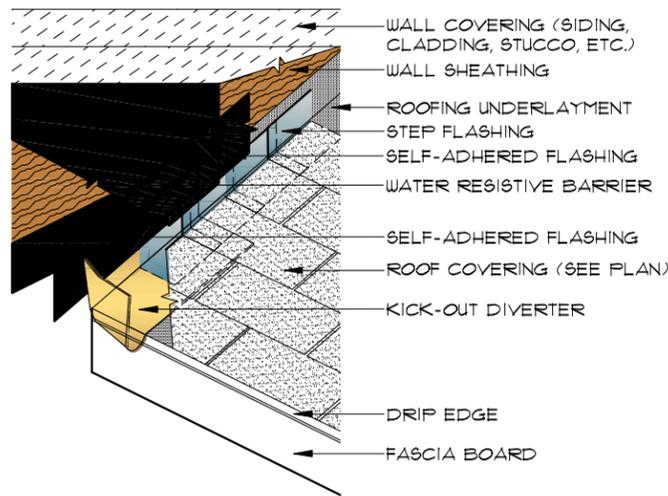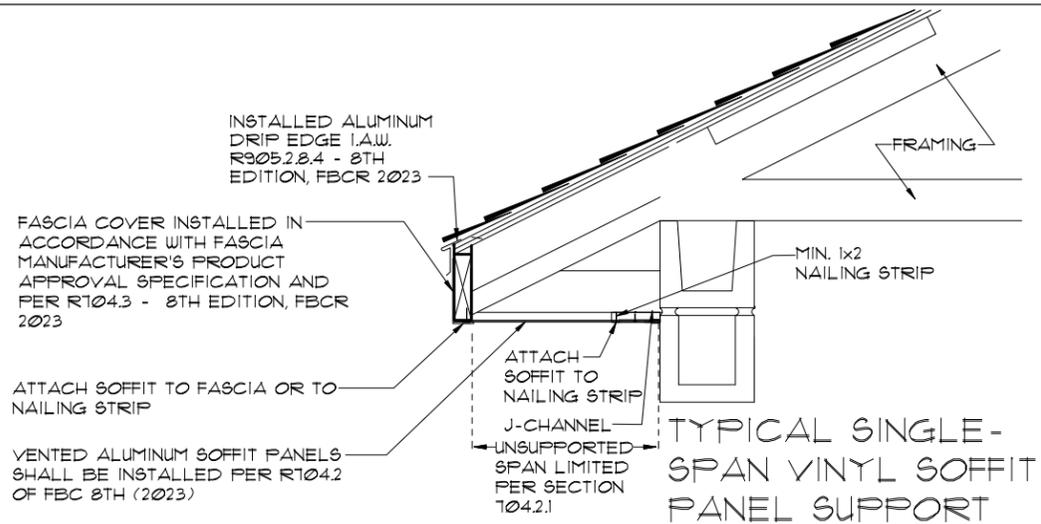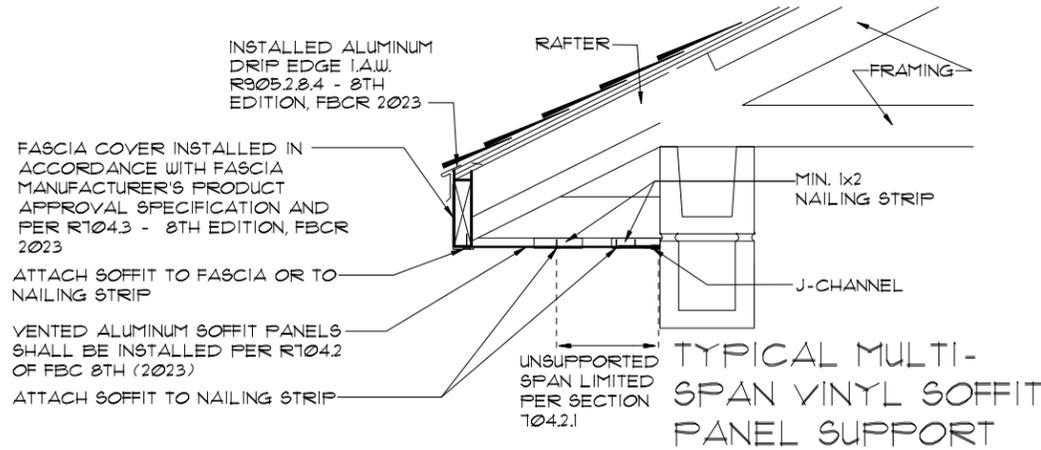

1 STEP WALL FLASHING

11 N.T.S.

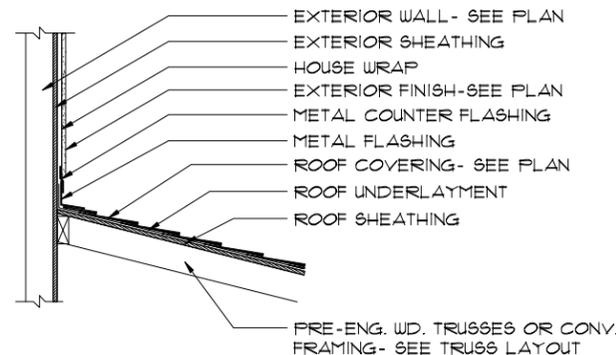

3 HEAD WALL FLASHING

11 N.T.S.

2 KICK-OUT FLASHING

11 N.T.S.

CONNECTOR SCHEDULE						
CONNECT. TYPE	SIMPSON		USP		MAX. UPLIFT	LAT. LDS. FI / F2
	DESCRIPTION	FASTENERS PER CONNECTOR	DESCRIPTION	FASTENERS PER CONNECTOR		
4	HETA20	14-10d x 1 1/2"	ETA20	14-10d	1,810	65 / 960
5	DETAL20	18-10d x 1 1/2"	N/A	N/A	2,480	2000 / 1370
20	H3	RFT: 4-8d / PLT: 4-8d	RT3	RFT: 4-8d / PLT: 4-8d	455	125 / 160
21	H1	RFT: 6-8dx1 1/2" / PLT: 4-8d	RT15	RFT: 5-8dx1 1/2" / PLT: 5-8d	475	485 / 165
22	H10A	RFT: (9)10d x 1 1/2" / PLT: (9)10d x 1 1/2"	RT16	RFT: 8-8d x 1 1/2" / PLT: 8-8d	990	585 / 525
23	LUS26	HDR: 4-10d / JST: 4-10d / RFT / TRS: (4)8d	JUS26	HDR: 4-10d / JST: 4-10d	935	N/A
24	H1Z	PLT / STD: (2)8dx1 1/2" (8)8d	RT20	RFT / TRS: 9-10d / PLT / STD: 13-10d	985	400 / N/A
26	H2.5A	RFT: 5-8d / PLT: 5-8d	RT1	RFT: 5-8d / PLT: 5-8d	415	150 / 150
34	A34	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MP34	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	365	280 / 303
35	A35F	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MPAIF	H: 6-8dx1 1/2" / P: 6-8dx1 1/2"	440	440 / N/A
37	MTS12	14-10d	MTW12	14-10d	1,000	N/A
38	MTS16	14-10d	MTW16	14-10d	1,000	N/A
43	LSTA12	10-10d	LSTA12	10-10d	905	N/A
45	ST18	14-16d	ST18	14-16d	1,200	N/A
47	LSTA24	18-10d	LSTA24	18-10d	1,295	N/A
71	MSTA36	26-10d	MSTA36	26-10d	2,135	N/A
72	MSTC66	64-16d SINKERS	N/A	N/A	5,495	N/A
79	SPI	STD: 6-10d / PLT: 4-10d	SPT22	STD: 4-10d / PLT: 4-10d	535	560 / 260
80	SP2	STD: 6-10d / PLT: 6-10d	SPT224	STD: 6-10d / PLT: 6-10d	605	560 / 260
81	SPH4.6.8	12-10d x 1 1/2"	TP4.6.8	12-10d x 1 1/2"	885	N/A
90	ABU66	12-16d	PAU66	12-16d	2,240	N/A
93	CB66	(2) 3/8" BOLTS	PA8X8	4-10d	2,300	985
92	ABU44	12-16d	PAU44	12-16d	2,200	N/A
93	AC6 (MAX)	28-16d	PBS66	24-16d	1,815	1,070
94	AC4 (MAX)	28-16d	PBS44	24-16d	1,815	1,070
95	HTS20	20-10d	HTW20	20-10d	1,450	N/A
96	HD8A	SILL: 1/8" BOLT / STUD: (3) 3/8" x 5 1/2" BOLTS	HHD8A	SILL: 1/8" BOLT / STUD: (3) 3/8" x 5 1/2" BOLTS	7,910	N/A
99	A35	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MPAI	H: 6-8dx1 1/2" / P: 6-8dx1 1/2"	440	440 / N/A
98-101	HTT4	3/8" BOLT / 18-16dx2 1/2"	N/A	N/A	3,640	N/A
97-100-102	HTT5	3/8" BOLT / 26-10d	N/A	N/A	4,275	N/A
103	VGTR/L	32-SDS 1/4" x 3" / (2) 3/8" BLT	N/A	N/A	3,990	N/A
104	HDUB-SDS2.5	7/8" BLT / 20-SDS 1/4" x 2 1/2"	N/A	N/A	5,020	N/A
110	HCP2	12-10d x 1 1/2"	HHCP2	20-10d x 1 1/2"	520	260 / N/A
167	HHUS46	H: 14-16d / J: 6-16d	THD46	H: 8-18d / J: 12-10d	1,550	N/A
168	U46	H: 8-10d / J: 4-10d	SUH46	H: 8-16d / J: 4-16d	710	N/A
181	HUS26	20-16d	THD26	H: 20-16d / J: 10-10d	1,550	N/A
184	HHUS28-2	G: 28-16d / T: 8-16d	EHUH28-2	12-16d	2,000	N/A
214	HUC212-3TF	HD: 16-3/16" x 1 1/2" TAPCON / BM: 6-16d	HDO212-3	HD: 18-3/16" x 1 1/2" TAPCON / BM: 6-10d	1,135	N/A
215	HGUS210-2	HDR: 46-16d / JST: 10-16d	EHUH210-2	HDR: 40-16d / JST: 16-10d	2,720	N/A
216	HUS412	BLOCK: 10-1/4" x 1 1/2" TC / JOIST: 10-16d	HUS412	BLOCK: 10-1/4" x 1 1/2" TC / JOIST: 10-16d	3,240	N/A
217	HUS212-2	BLOCK: 10-1/4" x 1 1/2" TC / JOIST: 10-16d	HUS212-2	BLOCK: 10-1/4" x 1 1/2" TC / JOIST: 10-16d	2,630	N/A
219	MBHA412	H: 1-ATR 3/4" x 8" TOP FACE / JOIST: 18-10d	NFM35x12U	H: 1-1/2" J-BOLT / J: 5-1/2" BOLTS	3,145	N/A
220	N/A	N/A	NFM13x12	BLK: 1/2" x J / JST: 14-10d	1,620	N/A
226	MBHA4.75/12	HDR: (2) 3/4" x 8" / JOIST: 18-10d	NFM145U	HDR: MIN. 1/2" x J-BOLT / JOIST: (5) 1/2" x BOLTS	2,160	N/A
231	MBHA3.56/16	HDR: (2) 3/4" x 8" / JOIST: 18-10d	NFM3.5x16U	HDR: MIN. 1/2" x J-BOLTS / JOIST: (5) 1/2" x BOLTS	3,450	N/A
232	MBHA5.50/16	HDR: (2) 3/4" x 8" / JOIST: 18-10d	NFM5.5x16U	HDR: MIN. 1/2" x J-BOLTS / JOIST: (5) 1/2" x BOLTS	3,450	N/A
240	H15	R: 4-10dx1 1/2" / P: 4-10dx1 1/2"	N/A	N/A	1,300	480 / N/A
241	LGT2	30-16d-sinker	LUGT2	32-10d	2,000	1015 / 440
301	MGT	(1) 3/4" BOLTS / GIR: 22-10d	N/A	N/A	3,965	N/A
302	HGT-2 or 3	LTL: 3/4" BOLTS / GIR: 8-10d	USC63	LTL: 3/4" BOLTS / GIR: 8-16d	6,485	N/A
303	HGT-4	LTL: 3/4" BOLTS / GIR: 16-10d	N/A	N/A	9,250	N/A
401	SUR/L414	FACE: 18-16d / JST: 8-16d	N/A	N/A	1,700	N/A
T	CONNECTORS TO BE SPECIFIED AND PROVIDED BY TRUSS MANUFACTURERS					


LOT: 0000, COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 FLORIDA SERIES  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 528-3000  
 WWW.PARKSQUAREHOMES.COM

REVISIONS	BY
05-16-19	JF

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 11 OF 20 SHEETS  
 1966  
 MARGATE II

**MECHANICAL/GENERAL NOTES**

- PER 6TH ED. 2011 FLA BLD. CODE-RESIDENTIAL
- 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1
  - 2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.
    - A) CHAPTER 13 OF THE FBC-R 2011 6TH SECTION M1305.1
  - 3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2011 6TH EDITION.
  - 4.) IAW NEC 2014- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DEN, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.
  - 5.) IAW NEC 2014- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.
  - 6.) ALL OUTLETS IN BATHROOMS AND LAUNDRY ROOM SHALL BE GFCI
  - 7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL # TO BE USED ON THIS JOB TO BE:
    - BRK: SMOKE-9120B, C/O- SC9120B
    - KIDDE: SMOKE-21007581, C/O 21006377-N
  - 8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2011, 6TH ED. P2801.1
  - 9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2011, 6TH ED.
  - 10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3
  - 11.) ALL ELECTRICAL WORK TO BE DONE PER NEC 2014
  - 12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2

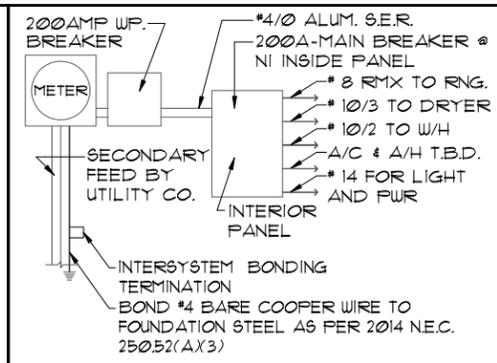

**ELECTRICAL RISER DIAGRAM**

NOTE: N.T.S.  
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)1 TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.



250.52(A)3 Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes: (1) steel reinforcing bars or rods which are not less than 1/2 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete; (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.

The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

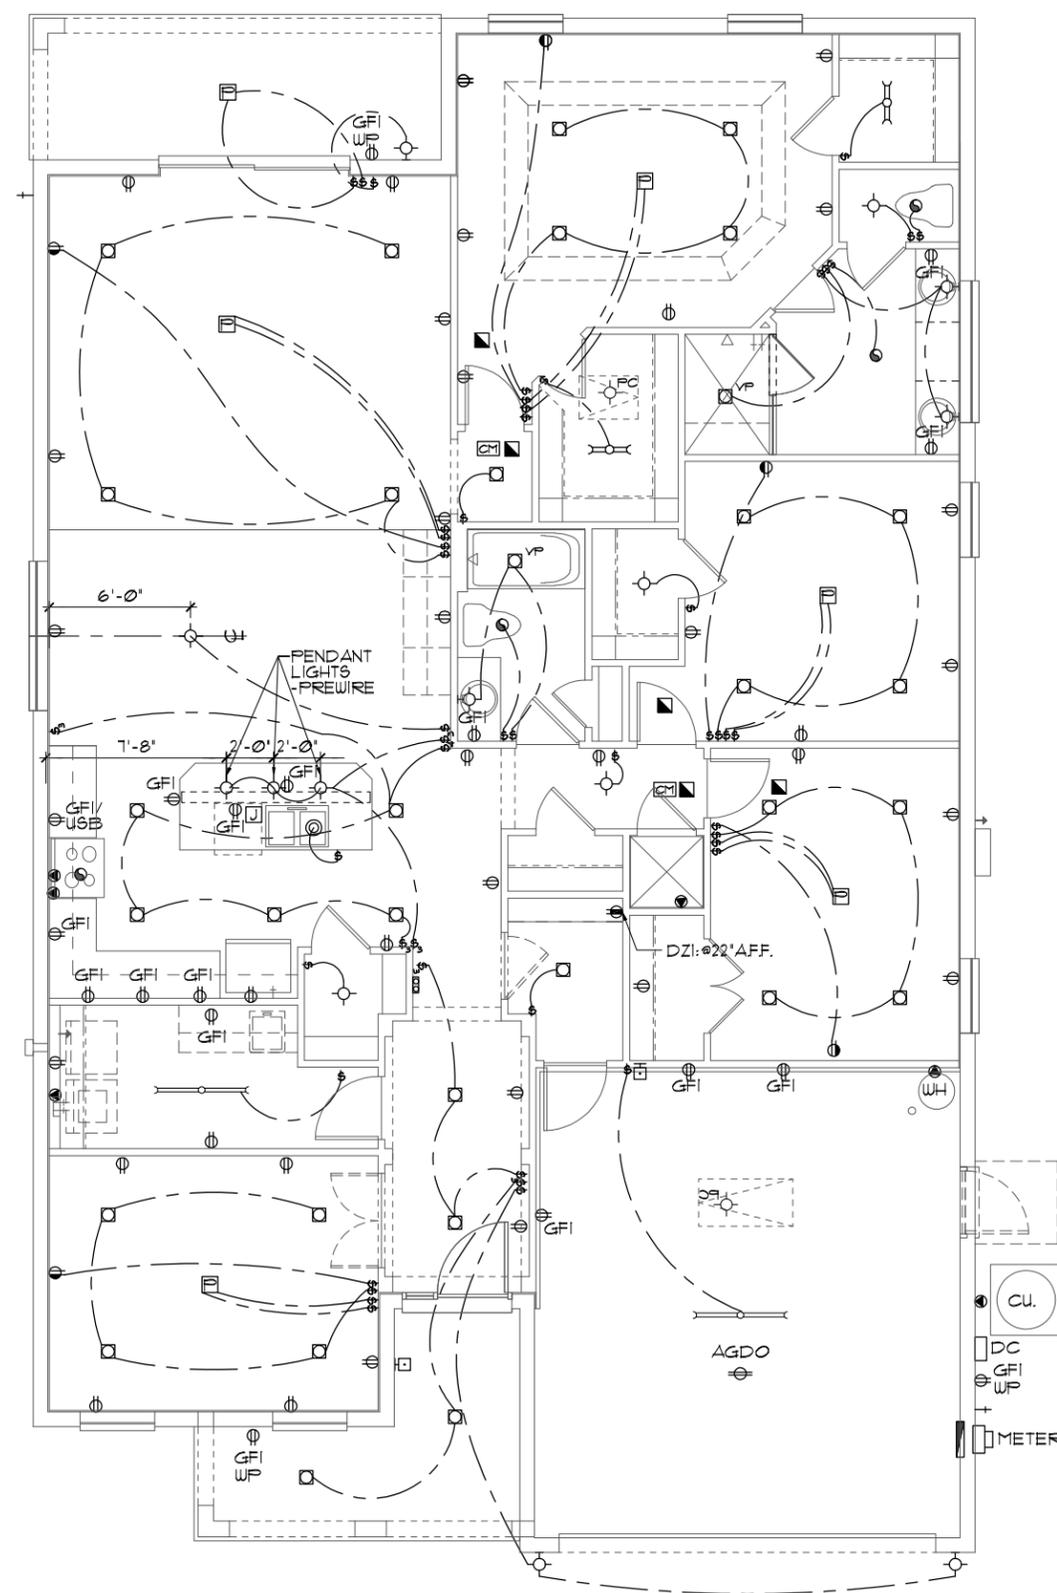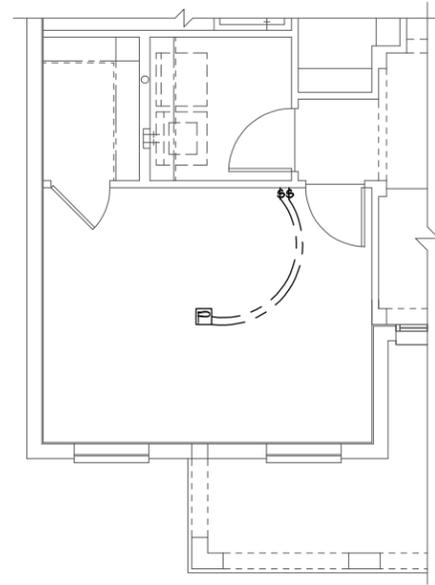

**ELECTRICAL PLAN**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL LEGEND**

⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	◻	CHIMES
⊞	OUT. 110-115, W/ USB	◻	SMOKE DETECTOR
⊞	OUT. 110-115, CLG. MOUNT.	◻	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	◻	PUSH BUTTON
⊞	SPCL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., PULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

LOT: 0000, COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2003 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 FLORIDA SERIES  
 1966  
 MARGATE II  
 DATE 04-05-2011  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 OF 00 SHEETS

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000  
 www.park-square.com

**ITEG**  
 ITC ENGINEERING GROUP, INC.  
 10000 W. Colonial Blvd., Suite 100  
 Orlando, FL 32817  
 Tel: (407) 754-1400  
 Fax: (407) 754-1790  
 www.iteg.com

REVISIONS BY  
 05-16-19 JF

ELECTRICAL PLAN  
 OPTIONS