

REVISION SUMMARY table with columns: NO., DATE, REVISION DESCRIPTION, DESIGNER.

ABBREVIATIONS table listing various abbreviations and their corresponding full names for structural elements.

TERMITE SPECIFICATIONS

SECTION R318 PROTECTION AGAINST TERMITES. TERMITE PROTECTION SHALL BE PROVIDED BY REGISTERED TERMITICIDES, INCLUDING SOIL APPLIED PESTICIDES, BAITING SYSTEMS, AND PESTICIDES APPLIED TO WOOD, OR OTHER APPROVED METHODS OF TERMITE PROTECTION LABELED FOR USE AS PREVENTIVE TREATMENT TO NEW CONSTRUCTION (SEE SECTION 202, REGISTERED TERMITICIDES).

-NOTICE TO BUILDER AND ALL SUBCONTRACTORS-

IT IS THE INTENT OF THE ENGINEER LISTED IN THE TITLEBLOCK OF THESE DOCUMENTS THAT THESE DOCUMENTS BE ACCURATE, PROVIDING LICENSED PROFESSIONALS CLEAR INFORMATION. EVERY ATTEMPT HAS BEEN MADE TO PREVENT ERROR. THE BUILDER AND ALL SUBCONTRACTORS ARE REQUIRED TO: 1. REVIEW ALL THE INFORMATION CONTAINED IN THESE DOCUMENTS, PRIOR TO THE COMMENCEMENT OF ANY WORK.

HOME MAINTENANCE & INSPECTIONS. YEARLY MAINTENANCE AND INSPECTIONS BY THE BUILDER/HOMEOWNER ARE NECESSARY FOR THE FUTURE LIFE OF THIS HOME. CARE MUST BE TAKEN TO CHECK WINDOWS AND DOORS FOR CAULKING, REMOVE LEAVES AND DEBRIS OFF ROOFS, MAKE SURE THAT WATER FLOW IS AWAY FROM THE HOUSE AND HAVE YOUR HOME REPAINTED EVERY 3 - 5 YEARS TO PROTECT THE COATINGS.

PARK SQUARE HORIZONS WEST MEZZANO-BLDG _ (LOTS _ _) 4 UNIT

GENERAL STRUCTURAL NOTES

CAST IN PLACE REINFORCED CONCRETE. 1. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS OF 2500 PSI (SLABS) 3000 PSI (COLUMNS AND BEAMS), A SLUMP OF 5" PLUS OR MINUS 1", AND HAVE 2 TO 5% AIR ENTRAINMENT, AND A MAXIMUM WATER/CEMENT RATIO OF 0.63. 2. HOOKS SHALL BE PROVIDED AT DISCONTINUOUS ENDS OF ALL TOP BARS OF BEAMS.

MASONRY. 1. HOLLOW LOAD BEARING UNITS SHALL BE NORMAL WEIGHT, GRADE N, TYPE 2, CONFORMING TO ASTM C90-014, WITH A MINIMUM NET COMPRESSIVE STRENGTH OF 2000 PSI (m = 2000 PSI).

WOOD. 1. ALL EXTERIOR WOOD STUDS WALLS, BEARING WALLS, SHEAR WALLS, AND MISC. STRUCTURAL WOOD FRAMING MEMBERS (I.E. BLOCKING OR GABLE END BRACING) SHALL BE EITHER AS SPECIFIED IN PLAN OR IN DETAILS. IF CONFLICTS OCCUR BETWEEN PLAN AND DETAILS, THE STRONGEST MATERIAL SHALL BE USED.

FIELD REPAIR NOTES. 1. MISSED "J" BOLTS FOR WOOD BEARING WALLS MAY BE SUBSTITUTED WITH 1/2" DIA. EPOXY ANCHORS WITH 7" EMBEDMENT. SIMPSON "SET" EPOXY ADHESIVE BINDER FOLLOWING ALL MANUFACTURER'S RECOMMENDATIONS OR SIMPSON 1/2" TITEN HD BOLTS WITH MINIMUM 7" EMBEDMENT.

LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIALS. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED TO WOOD SHEATHING WITH 1 1/2" LONG, 11 GAGE NAILS HAVING A 7/16" HEAD, OR 1 1/2" LONG, 16 GAGE STAPLES, SPACED IN ACCORDANCE WITH ASTM C1062 OR C1787, OR AS OTHERWISE APPROVED (REF. 2020 FBC-R/703.7.1).

STRUCTURAL DESIGN CRITERIA

- FLORIDA BUILDING CODE 7TH EDITION (2020) RESIDENTIAL.
FLORIDA FIRE PREVENTION CODE 7TH EDITION (2020)
FLORIDA BUILDING CODE ACCESSIBILITY 7TH EDITION (2020)
NFPA 70-17. NATIONAL ELECTRICAL CODES, (NEC 2017)
BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE - (ACI 318-14).
SPECIFICATIONS FOR STRUCTURAL CONCRETE - (ACI 301-16).

GENERAL ROOF LOADING table with columns: SHINGLE / METAL ROOF (PSF), FLAT ROOF (PSF), TILE ROOF (PSF), HEAVY ROOF (PSF). Rows include TOP CHORD LL, BOTTOM CHORD LL, and ATTICS W/ LIMITED STORAGE.

NOTE: LL REDUCTIONS ARE ALLOWED PER CODE BUT ONLY WITH WRITTEN APPROVAL FROM EOR OR INDICATED ON PLAN.

GENERAL FLOOR LOADING table with columns: TOP CHORD LL, TOP CHORD DL, BOTTOM CHORD LL, BOTTOM CHORD DL. Includes comments for TOP CHORD DL and BOTTOM CHORD DL.

SPECIAL FLOOR LOADING table with columns: GAME ROOM / READING ROOMS, BALCONIES / DECKS, GARAGES, SLEEPING ROOMS. Includes comments for each category.

DEFLECTION CRITERIA table with columns: ROOF TRUSSES*, ROOF RAFTERS, ROOF FIFTERS (W/O CLG), FLOOR TRUSSES/ BEAMS**, FLOOR JOISTS. Includes comments and load limits.

WIND LOADING CRITERIA table with columns: WIND SPEED (ULTIMATE), WIND SPEED (ALLOWABLE), EXPOSURE CATEGORY, BUILDING TYPE, ENCLOSURE CLASSIFICATION, INTERNAL PRESSURE COEFFICIENT. Includes wind speed and pressure values.

ASCE 7-16 WALL DESIGN ALLOWABLE COMPONENTS AND CLADDING WIND PRESSURES AND SUCTIONS FOR MEAN ROOF HEIGHT ≤ 60 ft



Table for ASCE 7-16 wind design allowable components. Columns include Effective Wind Area, Wind Pressure and Suction, and Wind Pressure and Suction Diagram. Includes a 3D diagram of wind pressure and suction on a building.

GENERAL PRESSURE NOTES

- MULTIPLY THE ABOVE PRESSURES BY 1.67 TO GET ULTIMATE WIND PRESSURES.
3' x 6' END ZONE IS ONLY WITHIN 4'-0" OF ALL EXTERIOR BUILDING CORNERS. INDICATED PRESSURES CAN BE INTERPOLATED FOR OTHER DOOR SIZES. OTHERWISE USE LOAD ASSOCIATED WITH THE LOWER EFFECTIVE AREA.

SHEET INDEX table with columns: NO., NOTES & SCHEDULES, NO., NOTES & SCHEDULES. Lists sheets S0 through L2.


NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

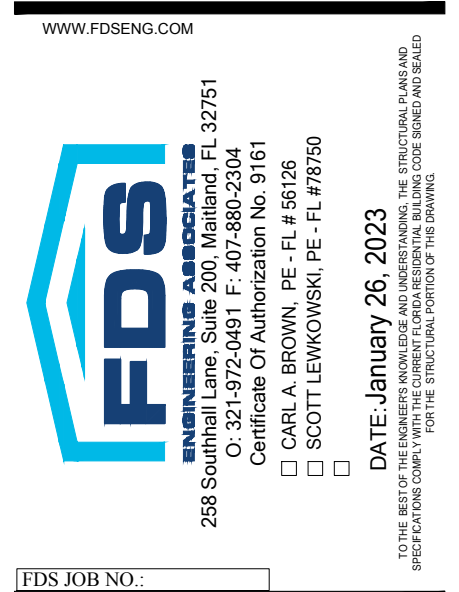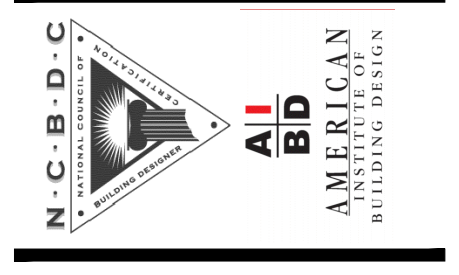

PARK SQUARE HORIZONS WEST 4-UNIT - ADAMS END UNITS

project no: 2022142
checked:
drawn: AB
date: 05-17-22
scale:

SO

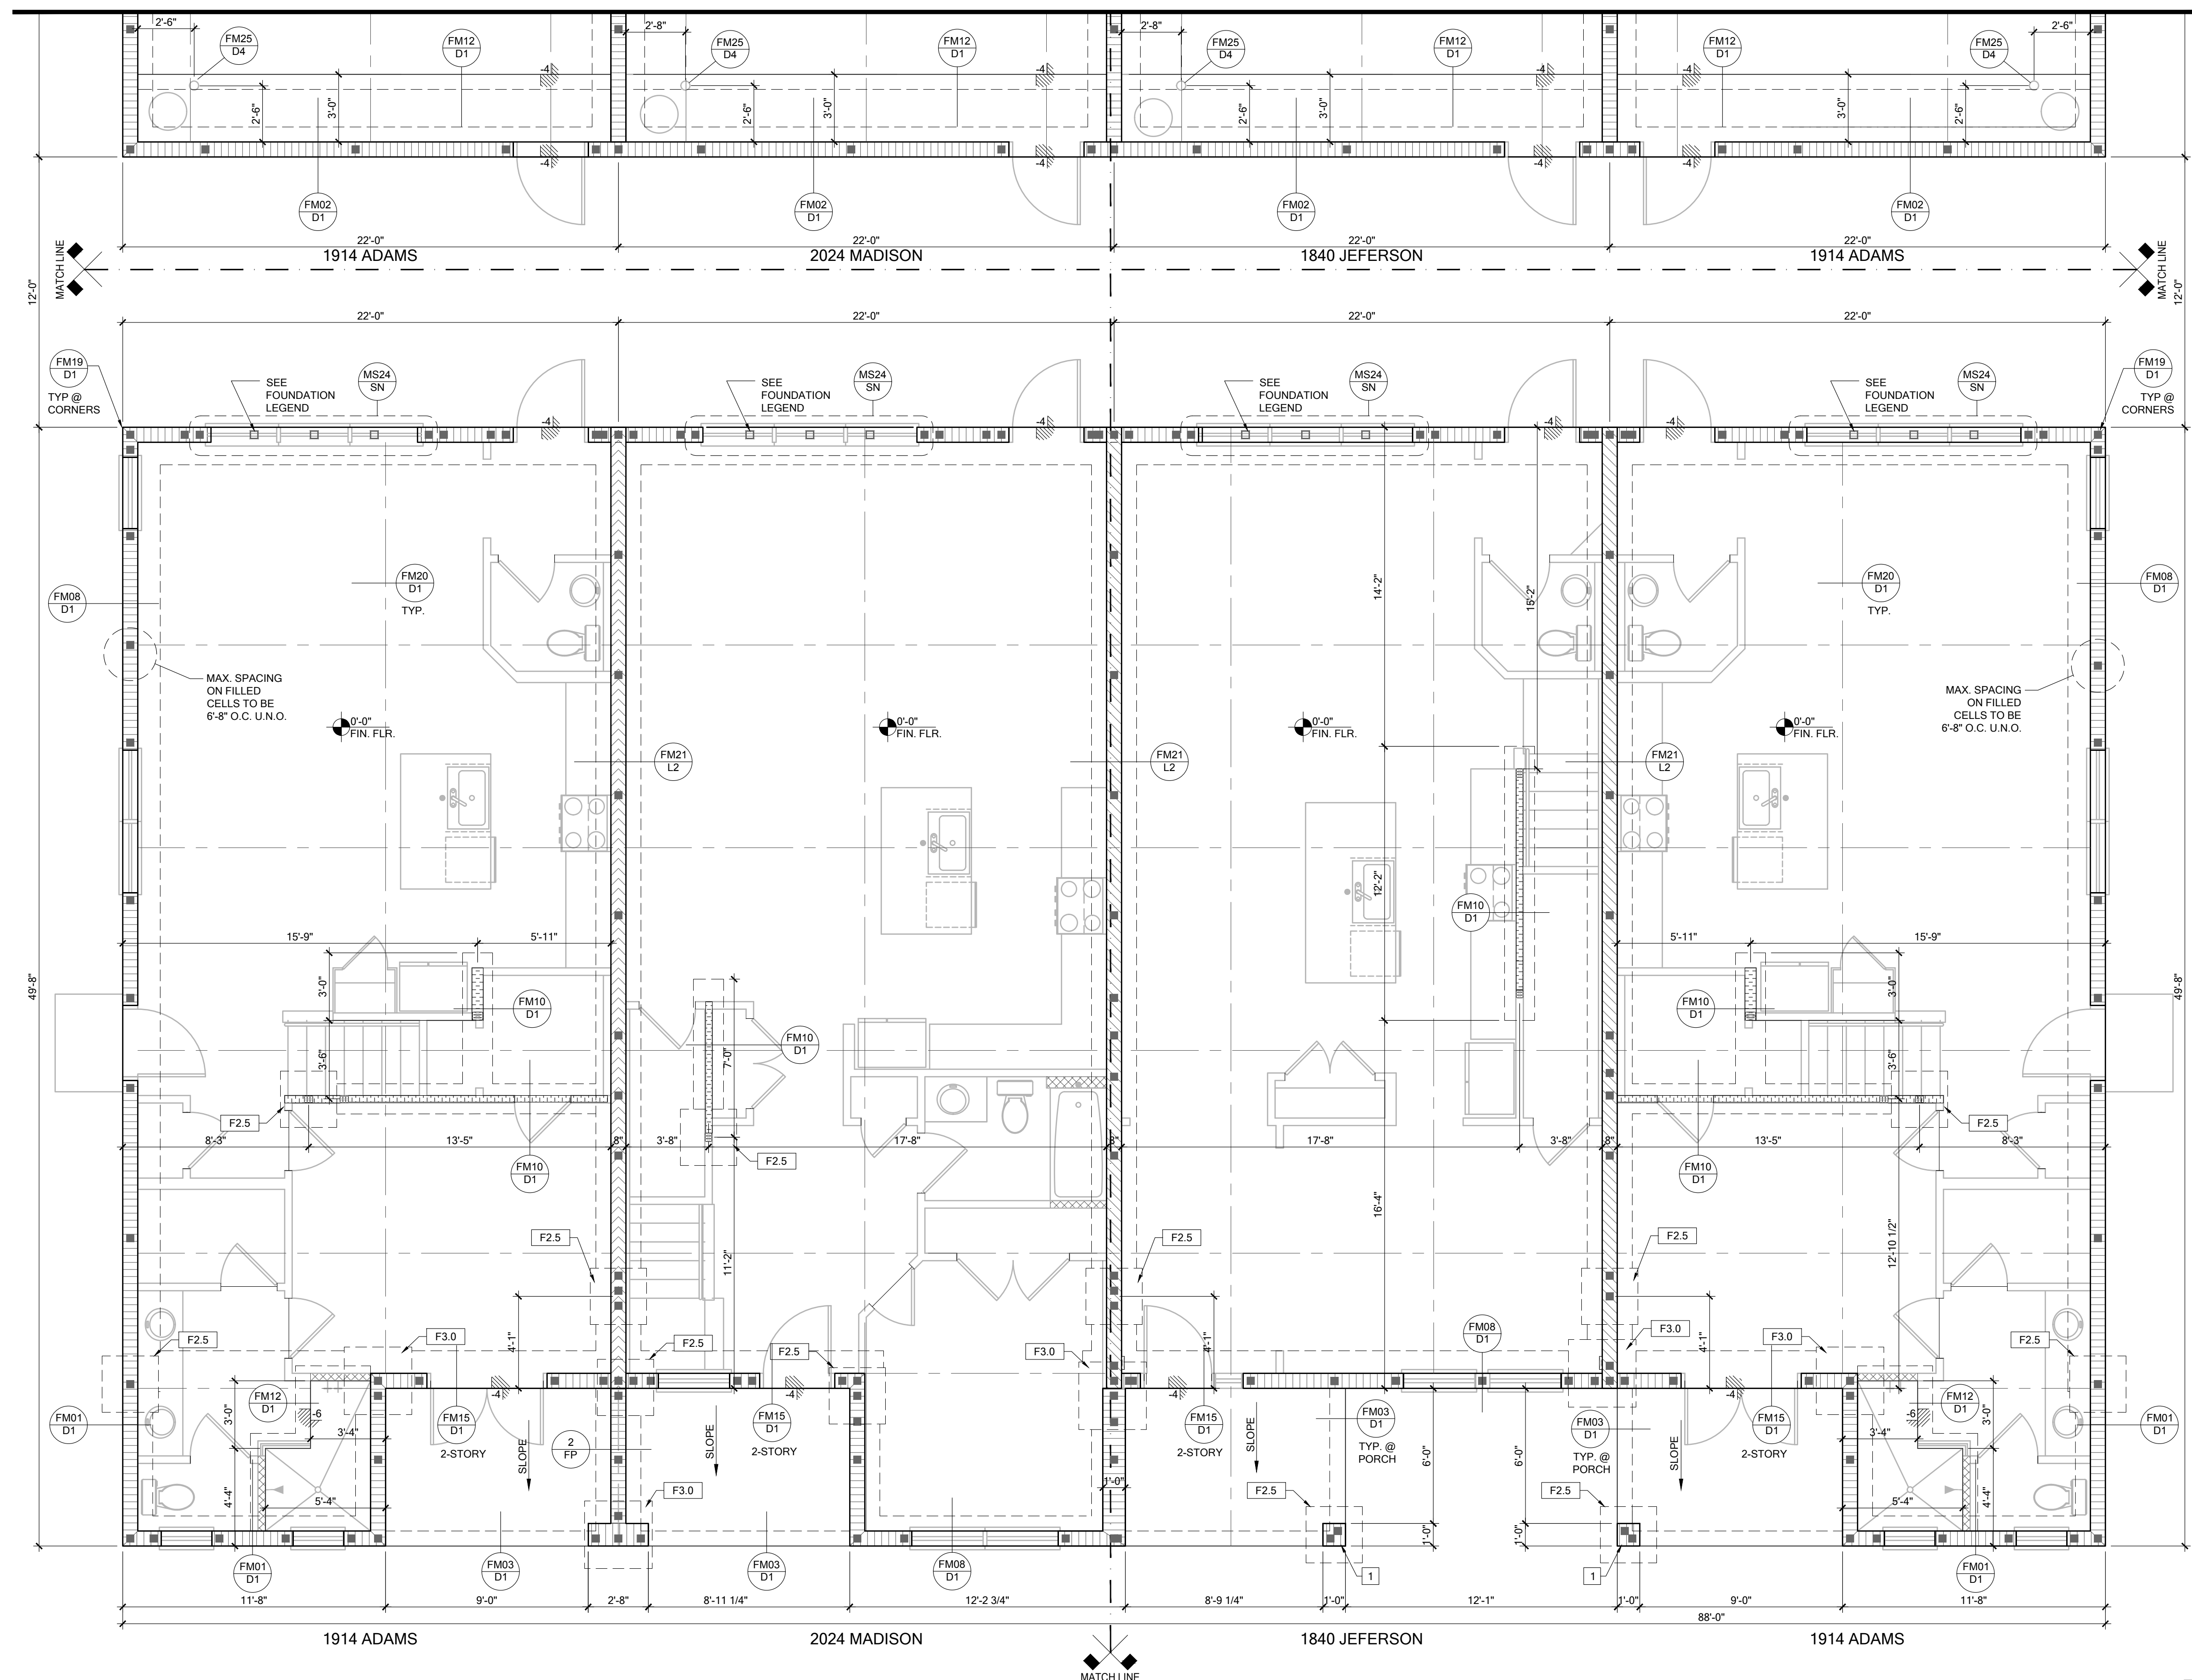

FOUNDATION LEGEND	
SYMBOL	DESIGN DESCRIPTION
	INDICATES FILLED CELL w/3000 PSI CONCRETE CONSTRUCTED PER DETAIL MS01/SN AND SPACED PER PLAN
	INDICATES FILLED CELL BELOW WINDOWS w/3000 PSI CONCRETE CONSTRUCTED PER DETAIL MS01/SN AND SPACED PER PLAN
	INDICATES CONCRETE FOOTING w/ MINIMUM SOIL BEARING CAPACITY OF 2000 PSF. REINFORCE PER GENERAL FOUNDATIONS SCHEDULE ON SHEET SN FOR DESIGN SPECIFICATIONS.
	INDICATES CONSTRUCTION JOINT (IF SHOWN) SHALL BE 1/2" x 1" SAW CUTS FILLED WITH APPROVED SLAB JOINT MATERIAL COVERING A 12'x12' SQUARE MAXIMUM
	INDICATES STEP IN FOUNDATION. VERIFY PER ARCHITECTURAL PLANS CONSTRUCT PER PLAN SECTION CUT AND DETAIL SHEET D1
	4" 2500 PSI CONC. SLAB w/ REIN. PER SO w/ 6 MIL VISQUEEN VAPOR BARRIER & TREATED FOR TERMITES. SEE FOUNDATION SCHEDULE ON SN
	INDICATES BUILT UP COLUMN, SEE FRAMING PLAN FOR SIZE, DETAIL WF37/SN FOR PLY ATTACHMENT, AND UPLIFT CONNECTION SCHEDULE ON SN FOR CONNECTION TO SLAB
GENERAL NOTES: 1. TYPICAL CORNER FRAMING PER DETAIL FM19/D1 2. SEE ARCHITECTURAL PLANS FOR ALL SLAB STEP DEPTHS IF SHOW SHOWN WITHIN THESE DOCUMENTS.	
FILLED CELL NOTES: 1. SEE PLAN FOR ZONE MIDDLE AND END DESIGNATIONS 2. PLACE FILLED CELLS AT ALL BUILDING CORNER, UNDER GIRDERS, BOTH ENDS OF EXTERIOR WALL OPENING, AND WHERE INTERIOR BEARING WALLS ARE PERPENDICULAR TO EXTERIOR MASONRY WALL. 3. PLACE 1-#5 IN FIRST TWO CELLS ADJACENT TO GARAGE DOOR OPENING & ALL OPENINGS 8'-0" & LARGER. FILL CELLS SOLID. 4. PLACE 1-#5 WHERE WOOD BEAMS CONNECT TO MASONRY WALL 5. NO NOT PLACE FILLED CELLS DIRECTLY IN LINE w/ STOVE VENT	
PLAN KEY NOTES	
1 12" x 12" CMU COL. w/ (2) #5 - T/COL. EL. 9'-4" A.F.F.	

WALL TYPE	
SYMBOL	DESIGN DESCRIPTION
	2x INTERIOR BEARING SHEARWALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN
	MASONRY WALL TOP @ 9'-4"
	MASONRY WALL TOP @ 10'-8" ABV. GRADE
	MASONRY WALL TOP @ 10'-8" ABV. GRADE

BUILDER NOTE:
 ANY DISCREPANCY OR ERROR IN DIMENSIONS OR NOTES SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL FOR CLARIFICATION PRIOR TO COMMENCEMENT OF CONSTRUCTION

KEY PLAN	
SYMBOL	DESIGN DESCRIPTION
	KEY PLAN

FOUNDATION PLAN
 SCALE: 1/4" = 1'-0"

KEY PLAN

title: _____

project no. 2022142
 checked: AB
 drawn: AB
 date: 05-17-22
 scale: _____

S1.1


B&A Design Studio, Inc.
 4017 W. 1st Street
 Sanford, FL 32771
 ph 407 829 8900
 fax 407 829 2040
 www.badesignstudios.com

FDS
 Florida Design Studio, Inc.
 258 Southhall Lane, Suite 200, Maitland, FL 32751
 C-32-1972-0491 F-407-880-2304
 Certificate of Authorization No. 9161
 State of Florida
 PROFESSIONAL ENGINEER - PE - FL #72759
 DATE: January 26, 2023

PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED


The structural design of this building is in accordance with the FLORIDA BUILDING CODE 7TH EDITION (2020) RESIDENTIAL and is certified as such.

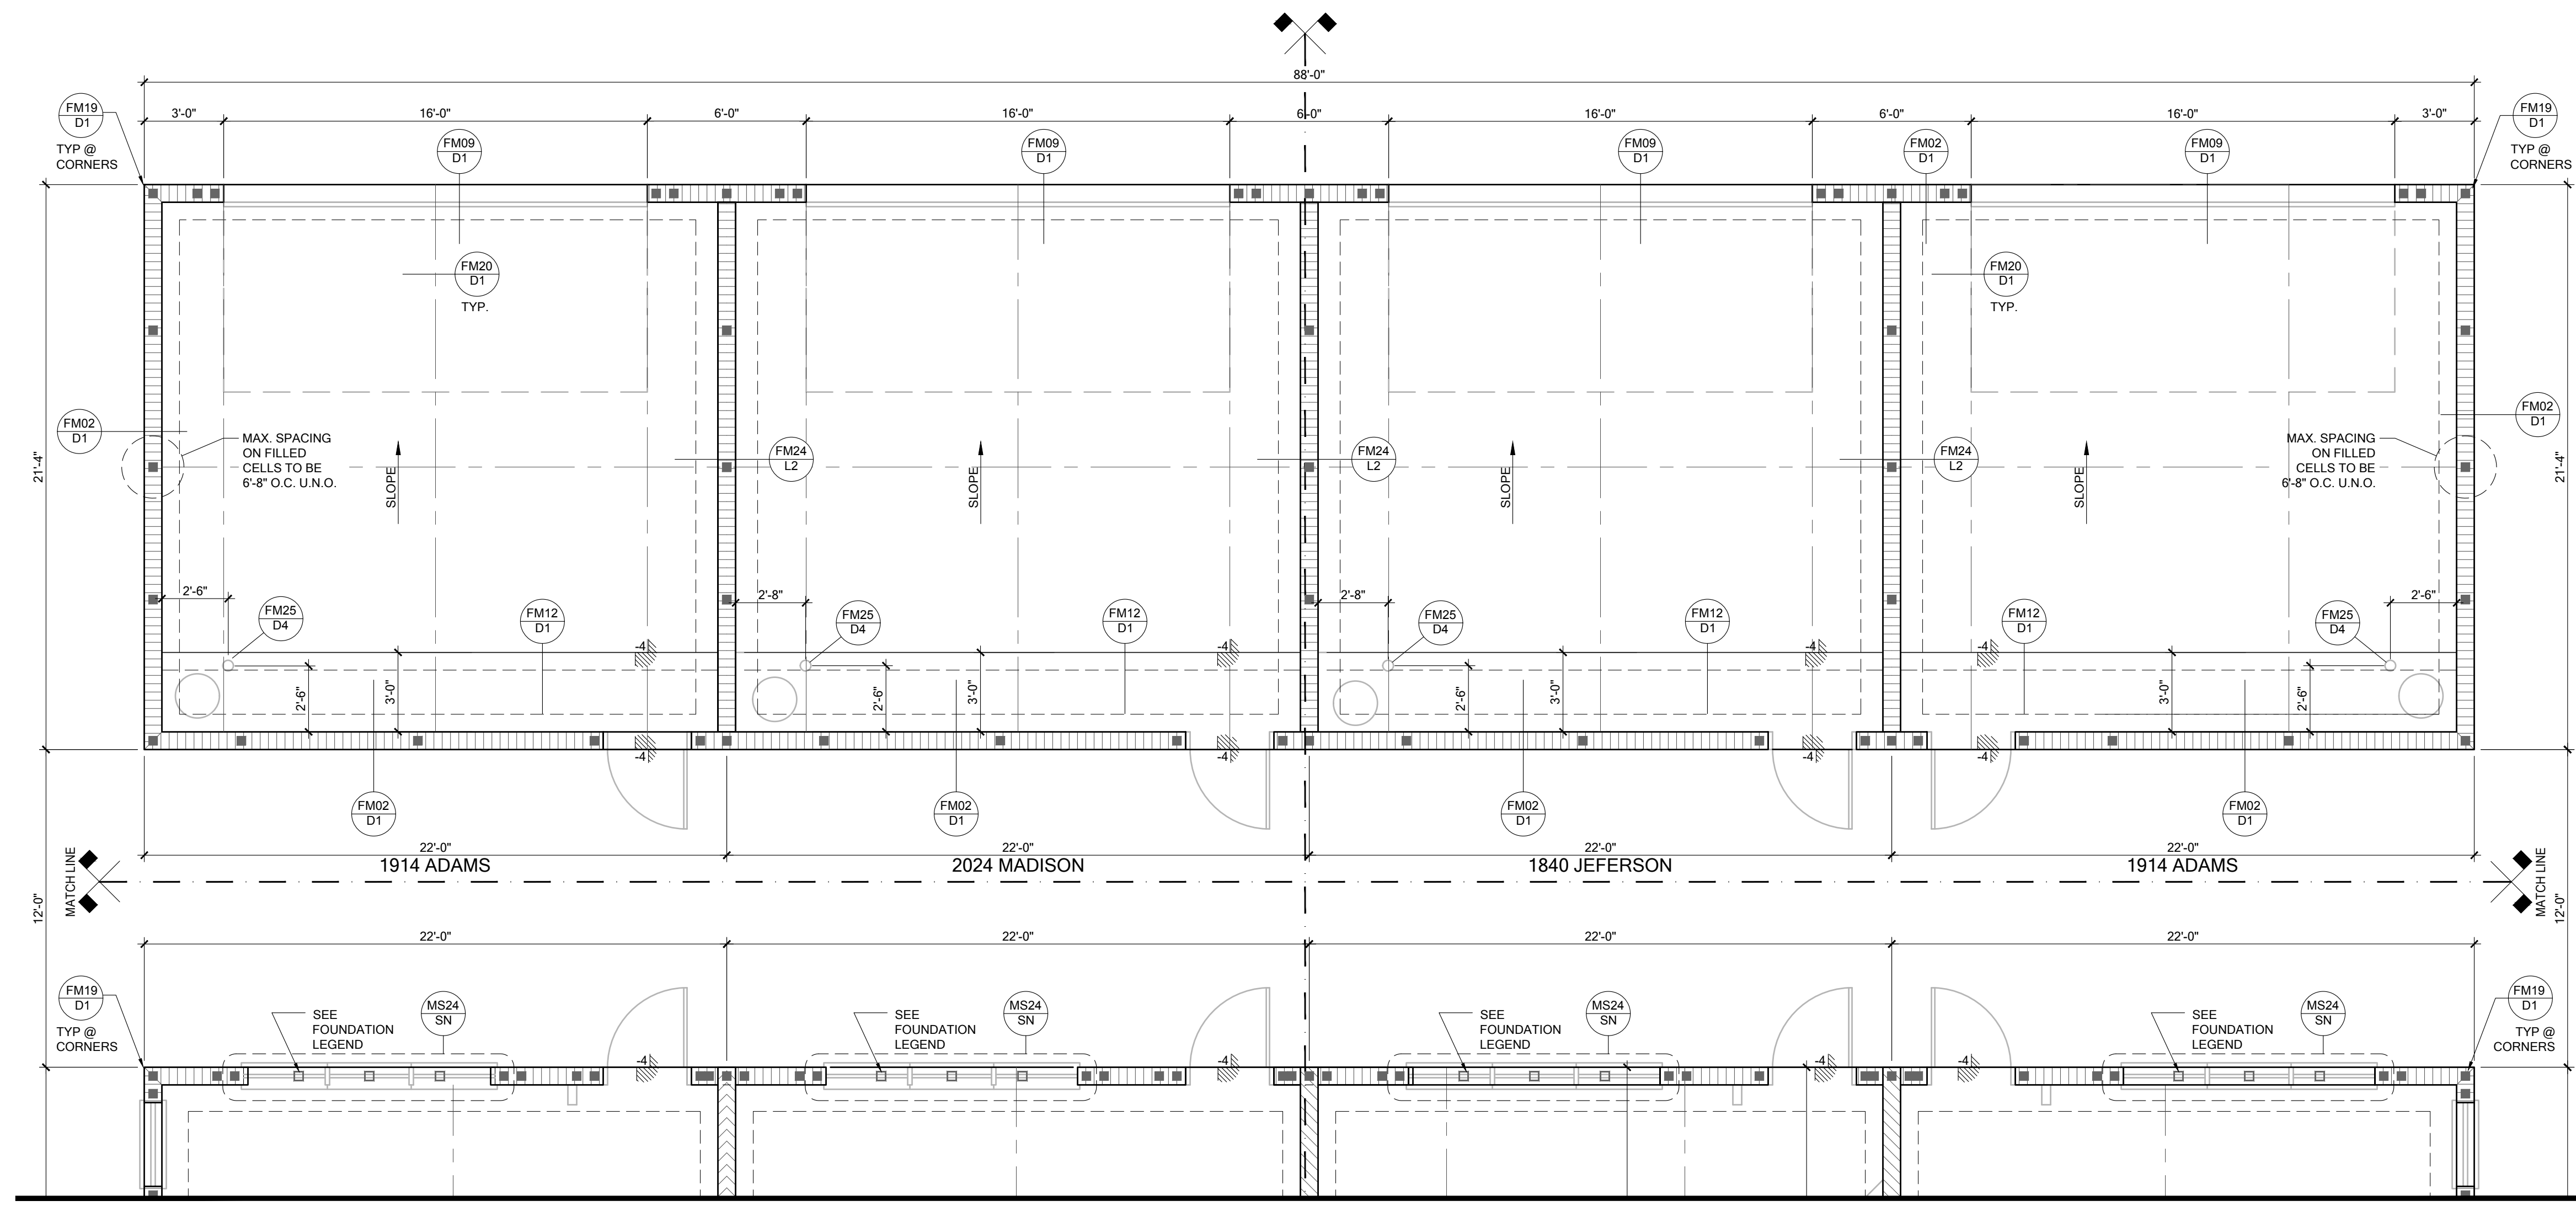

FOUNDATION LEGEND	
SYMBOL	DESIGN DESCRIPTION
	INDICATES FILLED CELL w/3000 PSI CONCRETE CONSTRUCTED PER DETAIL MS01/SN AND SPACED PER PLAN
	INDICATES FILLED CELL BELOW WINDOWS w/3000 PSI CONCRETE CONSTRUCTED PER DETAIL MS01/SN AND SPACED PER PLAN
	INDICATES CONCRETE FOOTING w/ MINIMUM SOIL BEARING CAPACITY OF 2000 PSF. REINFORCE PER GENERAL FOUNDATIONS SCHEDULE ON SHEET SN FOR DESIGN SPECIFICATIONS.
	INDICATES CONSTRUCTION JOINT (IF SHOWN) SHALL BE 1/2" x 1" SAW CUTS FILLED WITH APPROVED SLAB JOINT MATERIAL COVERING A 12"x12" SQUARE MAXIMUM
	INDICATES STEP IN FOUNDATION, VERIFY PER ARCHITECTURAL PLANS CONSTRUCT PER PLAN SECTION CUT AND DETAIL SHEET D1
	4" 2500 PSI CONC. SLAB W/ REINF. PER S0 w/6 MIL VISQUEEN VAPOR BARRIER & TREATED FOR TERMITES. SEE FOUNDATION SCHEDULE ON SN
	INDICATES BUILT UP COLUMN, SEE FRAMING PLAN FOR SIZE, DETAIL WF37/SN FOR PLY ATTACHMENT, AND UPLIFT CONNECTION SCHEDULE ON SN FOR CONNECTION TO SLAB
GENERAL NOTES: 1. TYPICAL CORNER FRAMING PER DETAIL FM19/D1 2. SEE ARCHITECTURAL PLANS FOR ALL SLAB STEP DEPTHS IF SHOW SHOWN WITHIN THESE DOCUMENTS.	
FILLED CELL NOTES: 1. SEE PLAN FOR ZONE MIDDLE AND END DESIGNATIONS 2. PLACE FILLED CELLS AT ALL BUILDING CORNER, UNDER GIRDERS, BOTH ENDS OF EXTERIOR WALL OPENING, AND WHERE INTERIOR BEARING WALLS ARE PERPENDICULAR TO EXTERIOR MASONRY WALL. 3. PLACE 1-4# IN FIRST TWO CELLS ADJACENT TO GARAGE DOOR OPENING & ALL OPENINGS 8'-0" & LARGER. FILL CELLS SOLID. 4. PLACE 1-4# WHERE WOOD BEAMS CONNECT TO MASONRY WALL 5. NO NOT PLACE FILLED CELLS DIRECTLY IN LINE w/ STOVE VENT	
PLAN KEY NOTES	

BUILDER NOTE:
 ANY DISCREPANCY OR ERROR IN DIMENSIONS OR NOTES SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL FOR CLARIFICATION PRIOR TO COMMENCEMENT OF CONSTRUCTION

WALL TYPE	
SYMBOL	DESIGN DESCRIPTION
	2x INTERIOR BEARING SHEARWALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN
	MASONRY WALL TOP @ 9'-4"
	MASONRY WALL TOP @ 10'-8" ABV. GRADE
	MASONRY WALL TOP @ 10'-8" ABV. GRADE

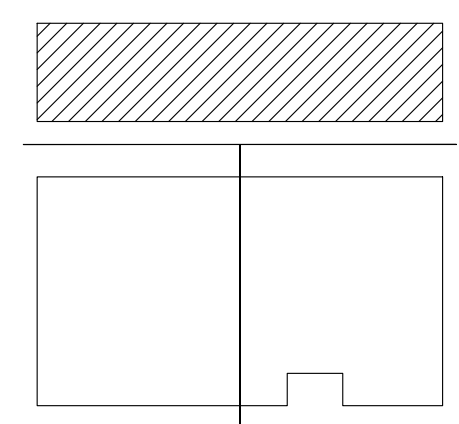

KEY PLAN

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

B&A Design Studio, Inc.

4017 W. 1st Street
 Sanford, FL 32771
 ph 407 829 8900
 fax 407 829 2040
 www.badesignstudios.com

A.I. B.D. AMERICAN BUILDING DESIGN

FDS

258 Southhall Lane, Suite 200, Maitland, FL 32751
 O: 321-972-0491 F: 407-880-2304
 Certificate of Authorization No. 9161
 SCOTT LEWIS/PE, FE, LE #78759
 DATE: January 26, 2023

PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS


title: _____

project no. 2022142
 checked: _____
 drawn: AB
 date: 05-17-22
 scale: _____

S1.2

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

RSH	ENGINEERED ROOF PER ASCE 7-16 ROOF DESIGN ALLOWABLE COMPONENTS AND CLADDING WIND PRESSURES AND SUCTIONS FOR MEAN ROOF HEIGHT ≤ 25 ft							
WIND SPEED (ULTIMATE)	140.0 MPH							
WIND SPEED (ALLOWABLE)	108.4 MPH							
EXPOSURE CATEGORY	C							
EFFECTIVE WIND AREA (SQ FEET)	WIND PRESSURE AND SUCTION (PSF) (+) VALUE DENOTES PRESSURE (-) VALUE DENOTES SUCTION							
AREA	ROOF	1	2e	2n	2r	3	3e	3r
10	HIP	-35.94	-49.57	-49.57	-49.57	-49.57	-60.99	-78.58
	GABLE	-38.22	-38.22	-60.99	-60.99			
ROOF NAILING SCHEDULE/ NAILING ZONES (SHINGLE AND TILE):								
ZONE 1: ASTM F1667 RSR-01 (8d) NAILS @ 6" O.C. ON EDGE AND 6" O.C. IN FIELD								
ZONE 2e, 2n, 2r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ZONE 3, 3e, 3r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ROOF SHEATHING: SHINGLE: 1/2" EXP. 1 (2%) or 1/2" EXP. 1 (2%)								
TILE: 1/2" EXP. 1 (2%)								
NOTE: 1. PER CODE ASTM F1667 RSR-01 REFERENCE TO 8d (2 3/4" x 0.113") NAILS 2. WHERE THE SHEATHING THICKNESS IS GREATER THAN 1/2", SHEATHING SHALL BE FASTENED WITH ASTM F1667 RSR-03 10d (2 1/2" x 0.131") NAILS OR ASTM F1667 RSR-04 (3" x 120") NAILS 3. CABLES- DROP GABLE END & (1) ADDITIONAL DROPPED TRUSS 2x4 #2 SYP OUTLOOKER RAFTER W/ BLOCKING @ 16" O.C. IF NO DROPPED GABLE END, ATTACH 2x4 #2 SYP BLOCKING @ 16" O.C. FIRST 4 BAYS WITH (2) 12d NAILS EA. END. ATTACH ROOF SHEATHING TO RAFTERS W/ BLOCKING PER NAILING SCHEDULE.								
HIP ROOF >20 TO 27 DEG. [4-12]-[6-12]								
GABLE ROOF > 20 TO 27 DEG. [4-12]-[6-12]								

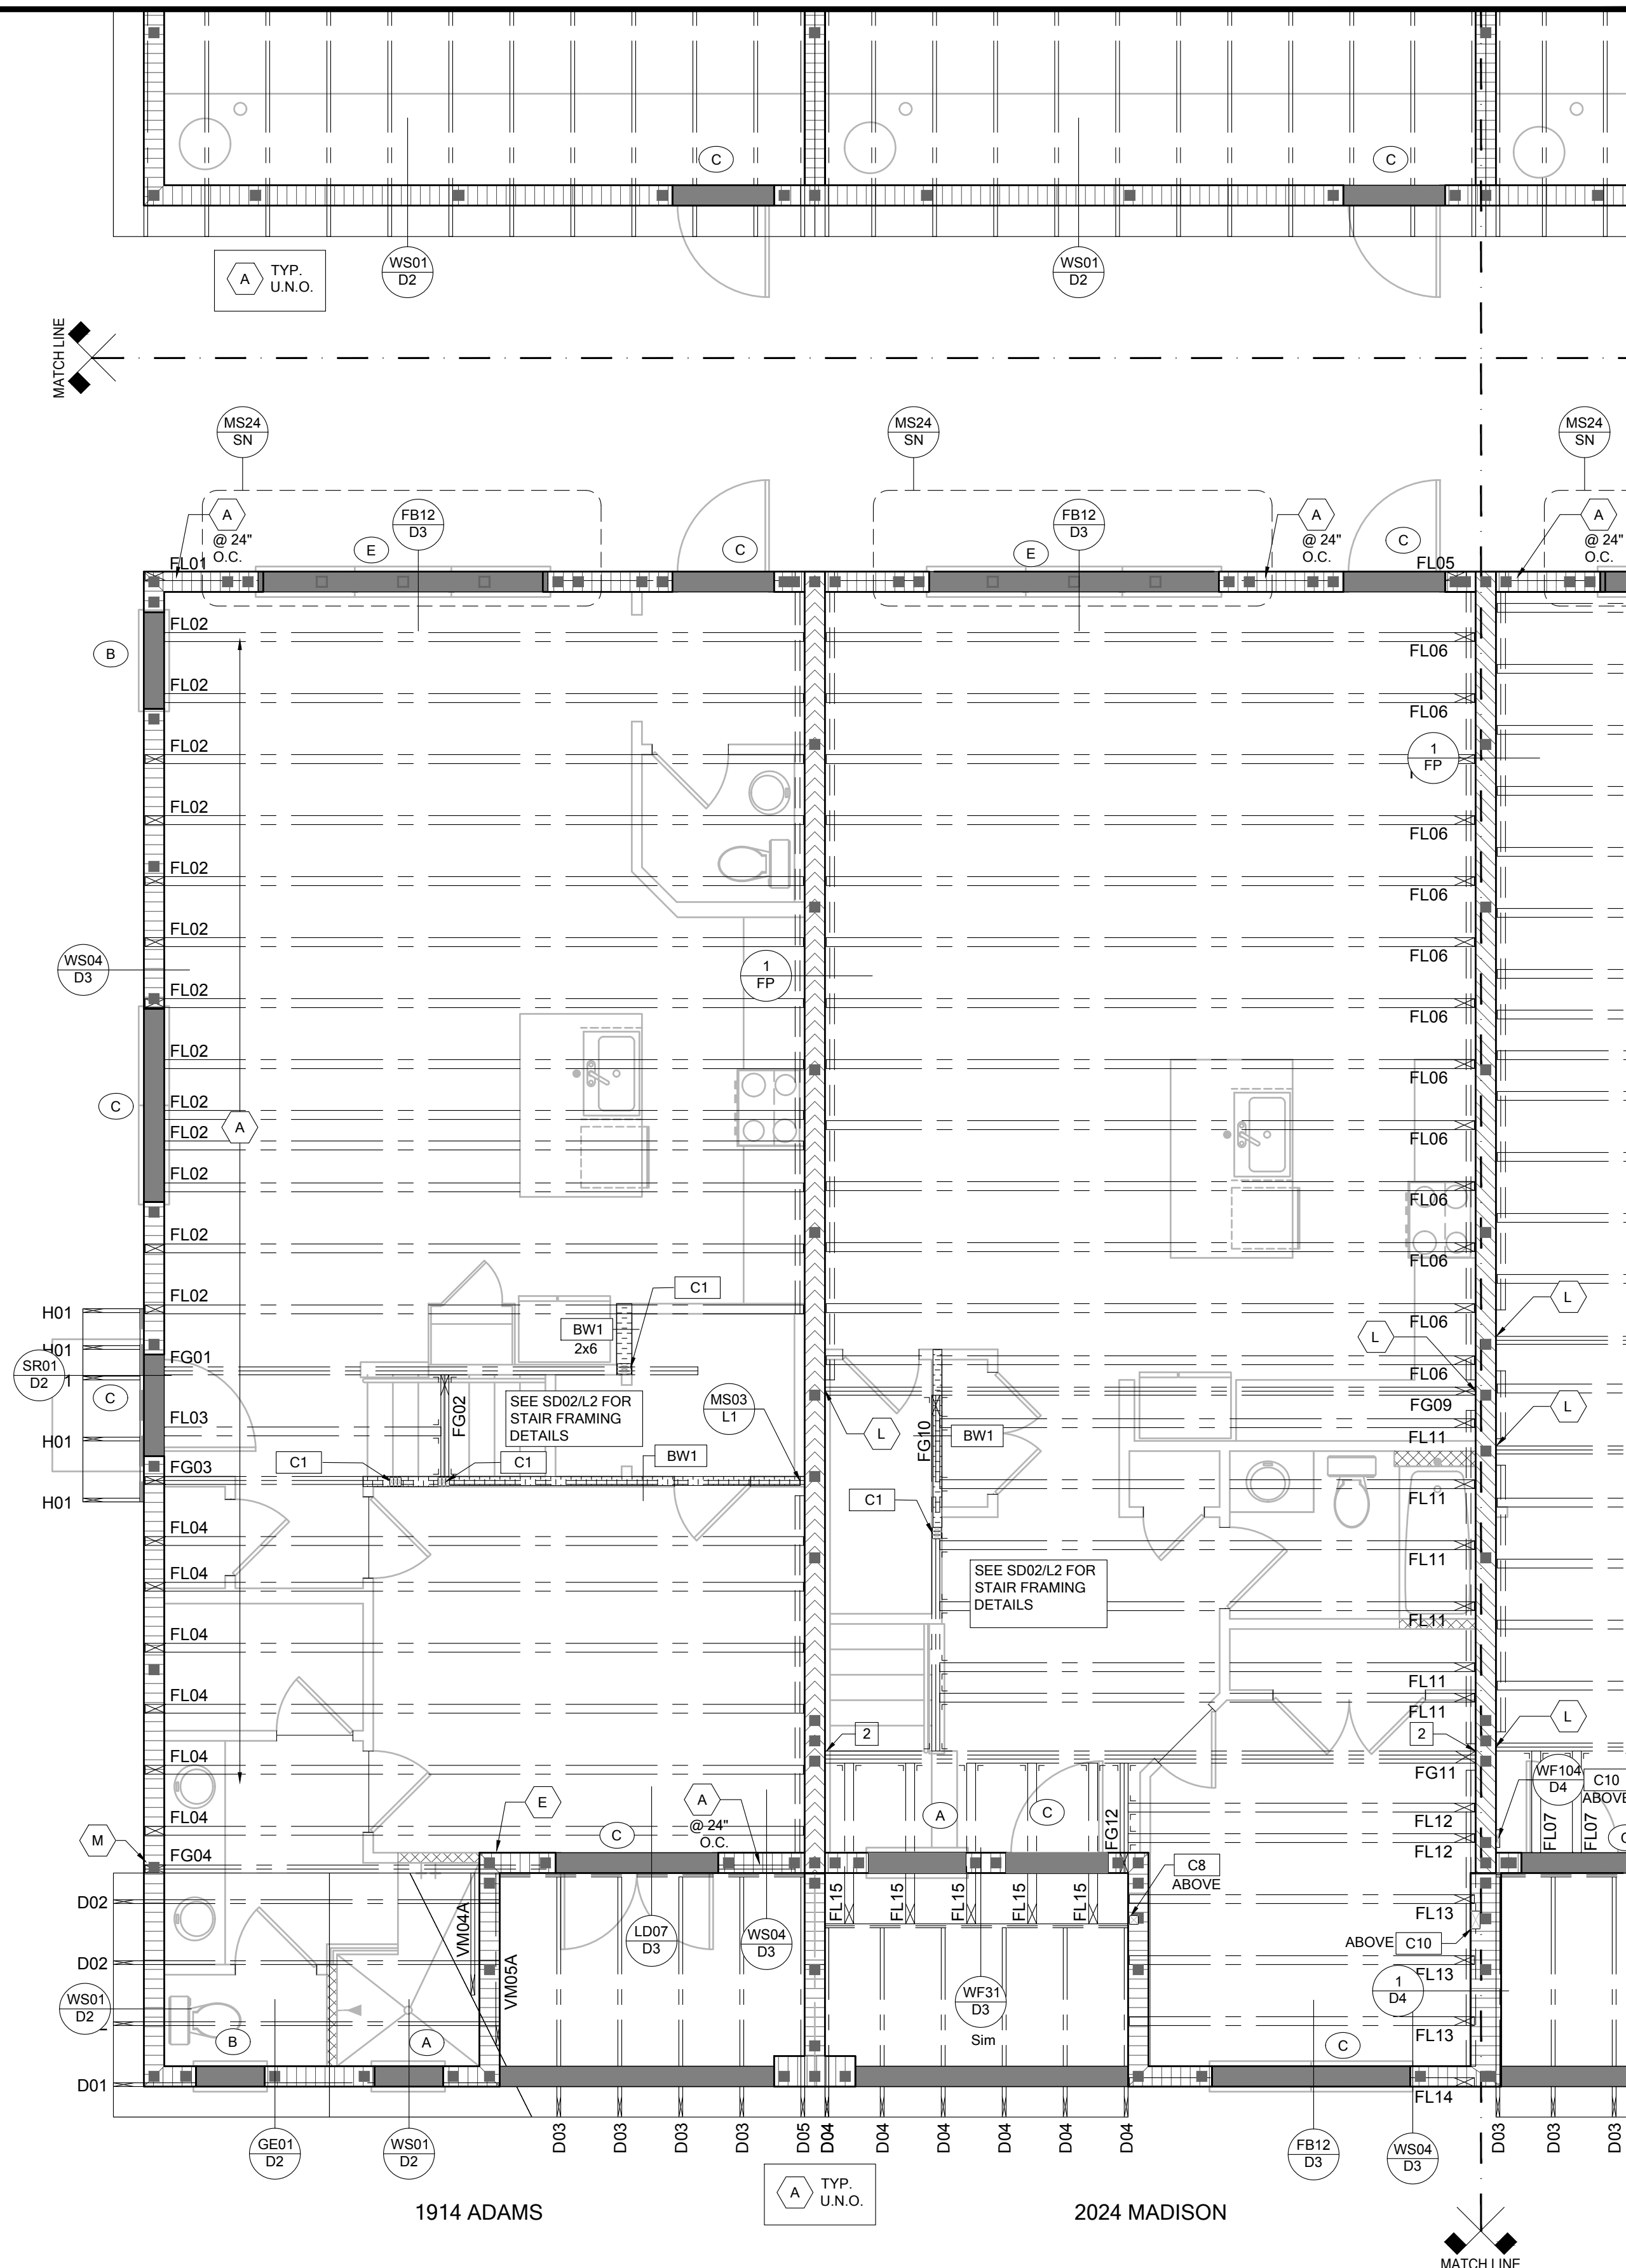

SYMBOL	DESIGN DESCRIPTION
2x	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
	INDICATES PERFORATED SHEAR WALL, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
	INDICATES BUILT UP COLUMN, SEE FRAMING PLAN FOR SIZE, DETAIL WF37/SN FOR PLY ATTACHMENT AND UPLIFT CONNECTION SCHEDULE ON SN FOR CONNECTION TO SLAB
	INDICATES NO BOTTOM CONNECTOR REQUIRED
	INDICATES UPLIFT CONNECTION CONSTRUCTED PER DETAIL UPLIFT CONNECTOR SCHEDULE ON SHEET SN
# symbol"/>	INDICATES WINDOW PRESSURE - SEE S0 FOR MORE INFORMATION.
	INDICATES LINTEL PER LINTEL PLAN


- FRAMING NOTES:**
- SEE WIND SPEED CHART ON S0 FOR WINDOW PRESSURES
 - AT SECOND FLOOR FOR TYPICAL CORNER FRAMING SEE DETAIL FB06/D3
- GENERAL NOTES:**
- THE FRAMING PLAN SHOWN INDICATES THE "TRUSS SYSTEM" AND IS THE RESPONSIBILITY OF THE TRUSS SYSTEM ENGINEER (DESIGN PROFESSIONAL OF RECORD), THE TRUSS DESIGN ENGINEER (DELEGATED ENGINEER) HAS FINAL, RESPONSIBILITY FOR EACH INDIVIDUAL TRUSS AND TRUSS PROFILE, AND IS TO SUBMIT A FINAL SET OF TRUSS ENGINEERING SIGNED AND SEALED TRUSS DRAWINGS TO DESIGN PROFESSIONAL OF RECORD FOR REVIEW PRIOR TO FABRICATION
 - ANY DISCREPANCY OR ERROR IN DIMENSIONS OR NOTES WITH IN THIS PLAN SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL FOR CLARIFICATION PRIOR TO CONSTRUCTION.
 - SEE SHEET SN FOR DESIGN SCHEDULES AND NOTES: FOUNDATION SCHEDULE / COLUMN SCHEDULE / BEARING WALL SCHEDULE / BEAM SCHEDULE / HEADER SCHEDULE / CONNECTION SCHEDULE / FLOOR AND ROOF NOTES.

- PLAN KEY NOTES**
- 12" SQ CMU COLUMN W/(2)#5 FULLY GROUTED
 - LQUM26-3-SDS CONNECTOR BY SIMPSON STRONG TIE w/(4) 3/8"x4" TITEN HD ANCHORS TO MASONRY AND (4) 1/4"x2-1/2" STRONG DRIVE SDS SCREWS

BUILDER NOTE:
TRUSS LAYOUT, CONNECTORS & ENGINEERING BASED ON TRUSSES PROVIDED BY MID FLORIDA LUMBER ACQUISITIONS. PROJECT NAME PSR6U w/ TRUSS DESIGN DATED 4/3/19 IF THE TRUSS LAYOUT SHOWN DOES NOT MATCH THE TRUSS MANUFACTURERS LAYOUT AND DATE ABOVE

---STOP---
AND CALL THE ENGINEER OF RECORD PRIOR TO PLACEMENT OF ANY TRUSSES.

SYMBOL	DESIGN DESCRIPTION
	2x INTERIOR BEARING SHEARWALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN
	MASONRY WALL TOP @ 9'-4"
	MASONRY WALL TOP @ 10'-8" ABV. GRADE
	MASONRY WALL TOP @ 10'-8" ABV. GRADE

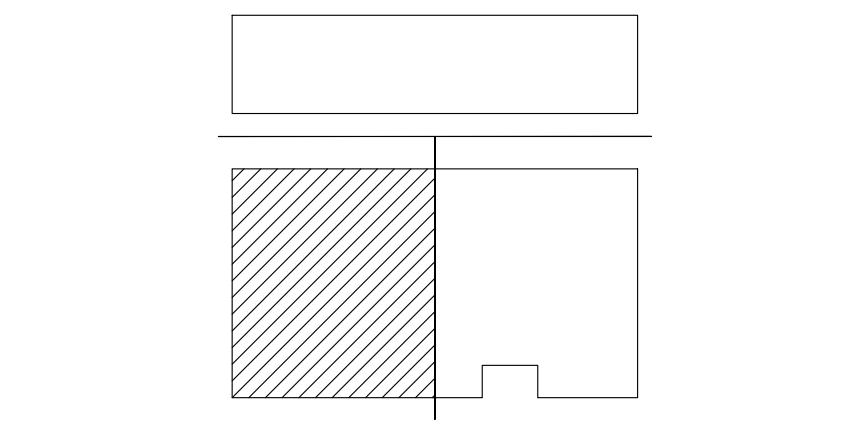

KEY PLAN
LOW ROOF & FLOOR FRAMING PLAN
SCALE: 1/4" = 1'-0"

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
C-321-972-0491 F-407-880-2304
Certificate of Authorization No. 9161
Professional Seal: SCOTT LEWIS/PE - FL #78759
DATE: January 26, 2023


PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS


title: _____

project no. 2022142
checked: _____
drawn: AB
date: 05-17-22
scale: _____

S2.1

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

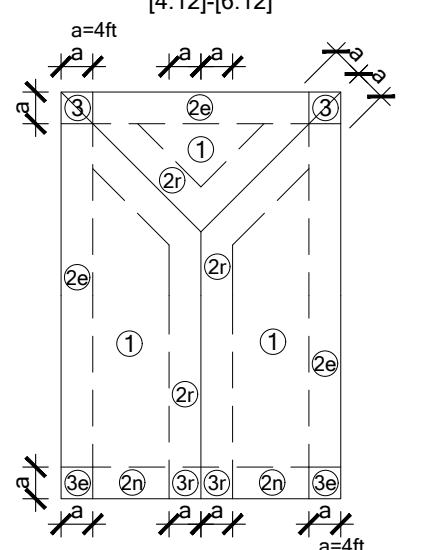RSH	ENGINEERED ROOF PER ASCE 7-16 ROOF DESIGN ALLOWABLE COMPONENTS AND CLADDING WIND PRESSURES AND SUCTIONS FOR MEAN ROOF HEIGHT ≤ 25 ft							
WIND SPEED (ULTIMATE)	140.0 MPH							
WIND SPEED (ALLOWABLE)	108.4 MPH							
EXPOSURE CATEGORY	C							
EFFECTIVE WIND AREA (SQ FEET)	WIND PRESSURE AND SUCTION (PSF) (+) VALUE DENOTES PRESSURE (-) VALUE DENOTES SUCTION							
AREA	ROOF	1	2e	2n	2r	3	3e	3r
10	HIP	-35.94	-49.57		-49.57	-49.57		
	GABLE	-38.22	-38.22	-60.99	-60.99		-60.99	-78.58
ROOF NAILING SCHEDULE/ NAILING ZONES (SHINGLE AND TILE):								
ZONE 1: ASTM F1667 RSR-01 (8d) NAILS @ 6" O.C. ON EDGE AND 6" O.C. IN FIELD								
ZONE 2e, 2n, 2r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ZONE 3, 3e, 3r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ROOF SHEATHING: SHINGLE: 7/16" EXP. 1 (2%) or 1 1/2" EXP. 1 (2%)								
TILE: NOTE: 1 1/2" EXP. 1 (2%)								
1. PER CODE ASTM F1667 RSR-01 REFERENCE TO 8d (2 1/2" x 0.113") NAILS								
2. WHERE THE SHEATHING THICKNESS IS GREATER THAN 1 1/2", SHEATHING SHALL BE FASTENED WITH ASTM F1667 RSR-03 10d (2 1/2" x 0.131") NAILS OR ASTM F1667 RSR-04 (3" x 120") NAILS								
3. CABLES- DROP GABLE END & (1) ADDITIONAL DROPPED TRUSS 2x4 #2 SYP OUTLOOKER RAFTER W/ BLOCKING @ 16" O.C. IF NO DROPPED GABLE END, ATTACH 2x4 #2 SYP BLOCKING @ 16" O.C. FIRST 4 BAYS WITH (2) 12d NAILS EA. END. ATTACH ROOF SHEATHING TO RAFTERS W/ BLOCKING PER NAILING SCHEDULE.								
HIP ROOF >20 TO 27 DEG. [4:12]-[6:12]								
								
GABLE ROOF > 20 TO 27 DEG. [4:12]-[6:12]								

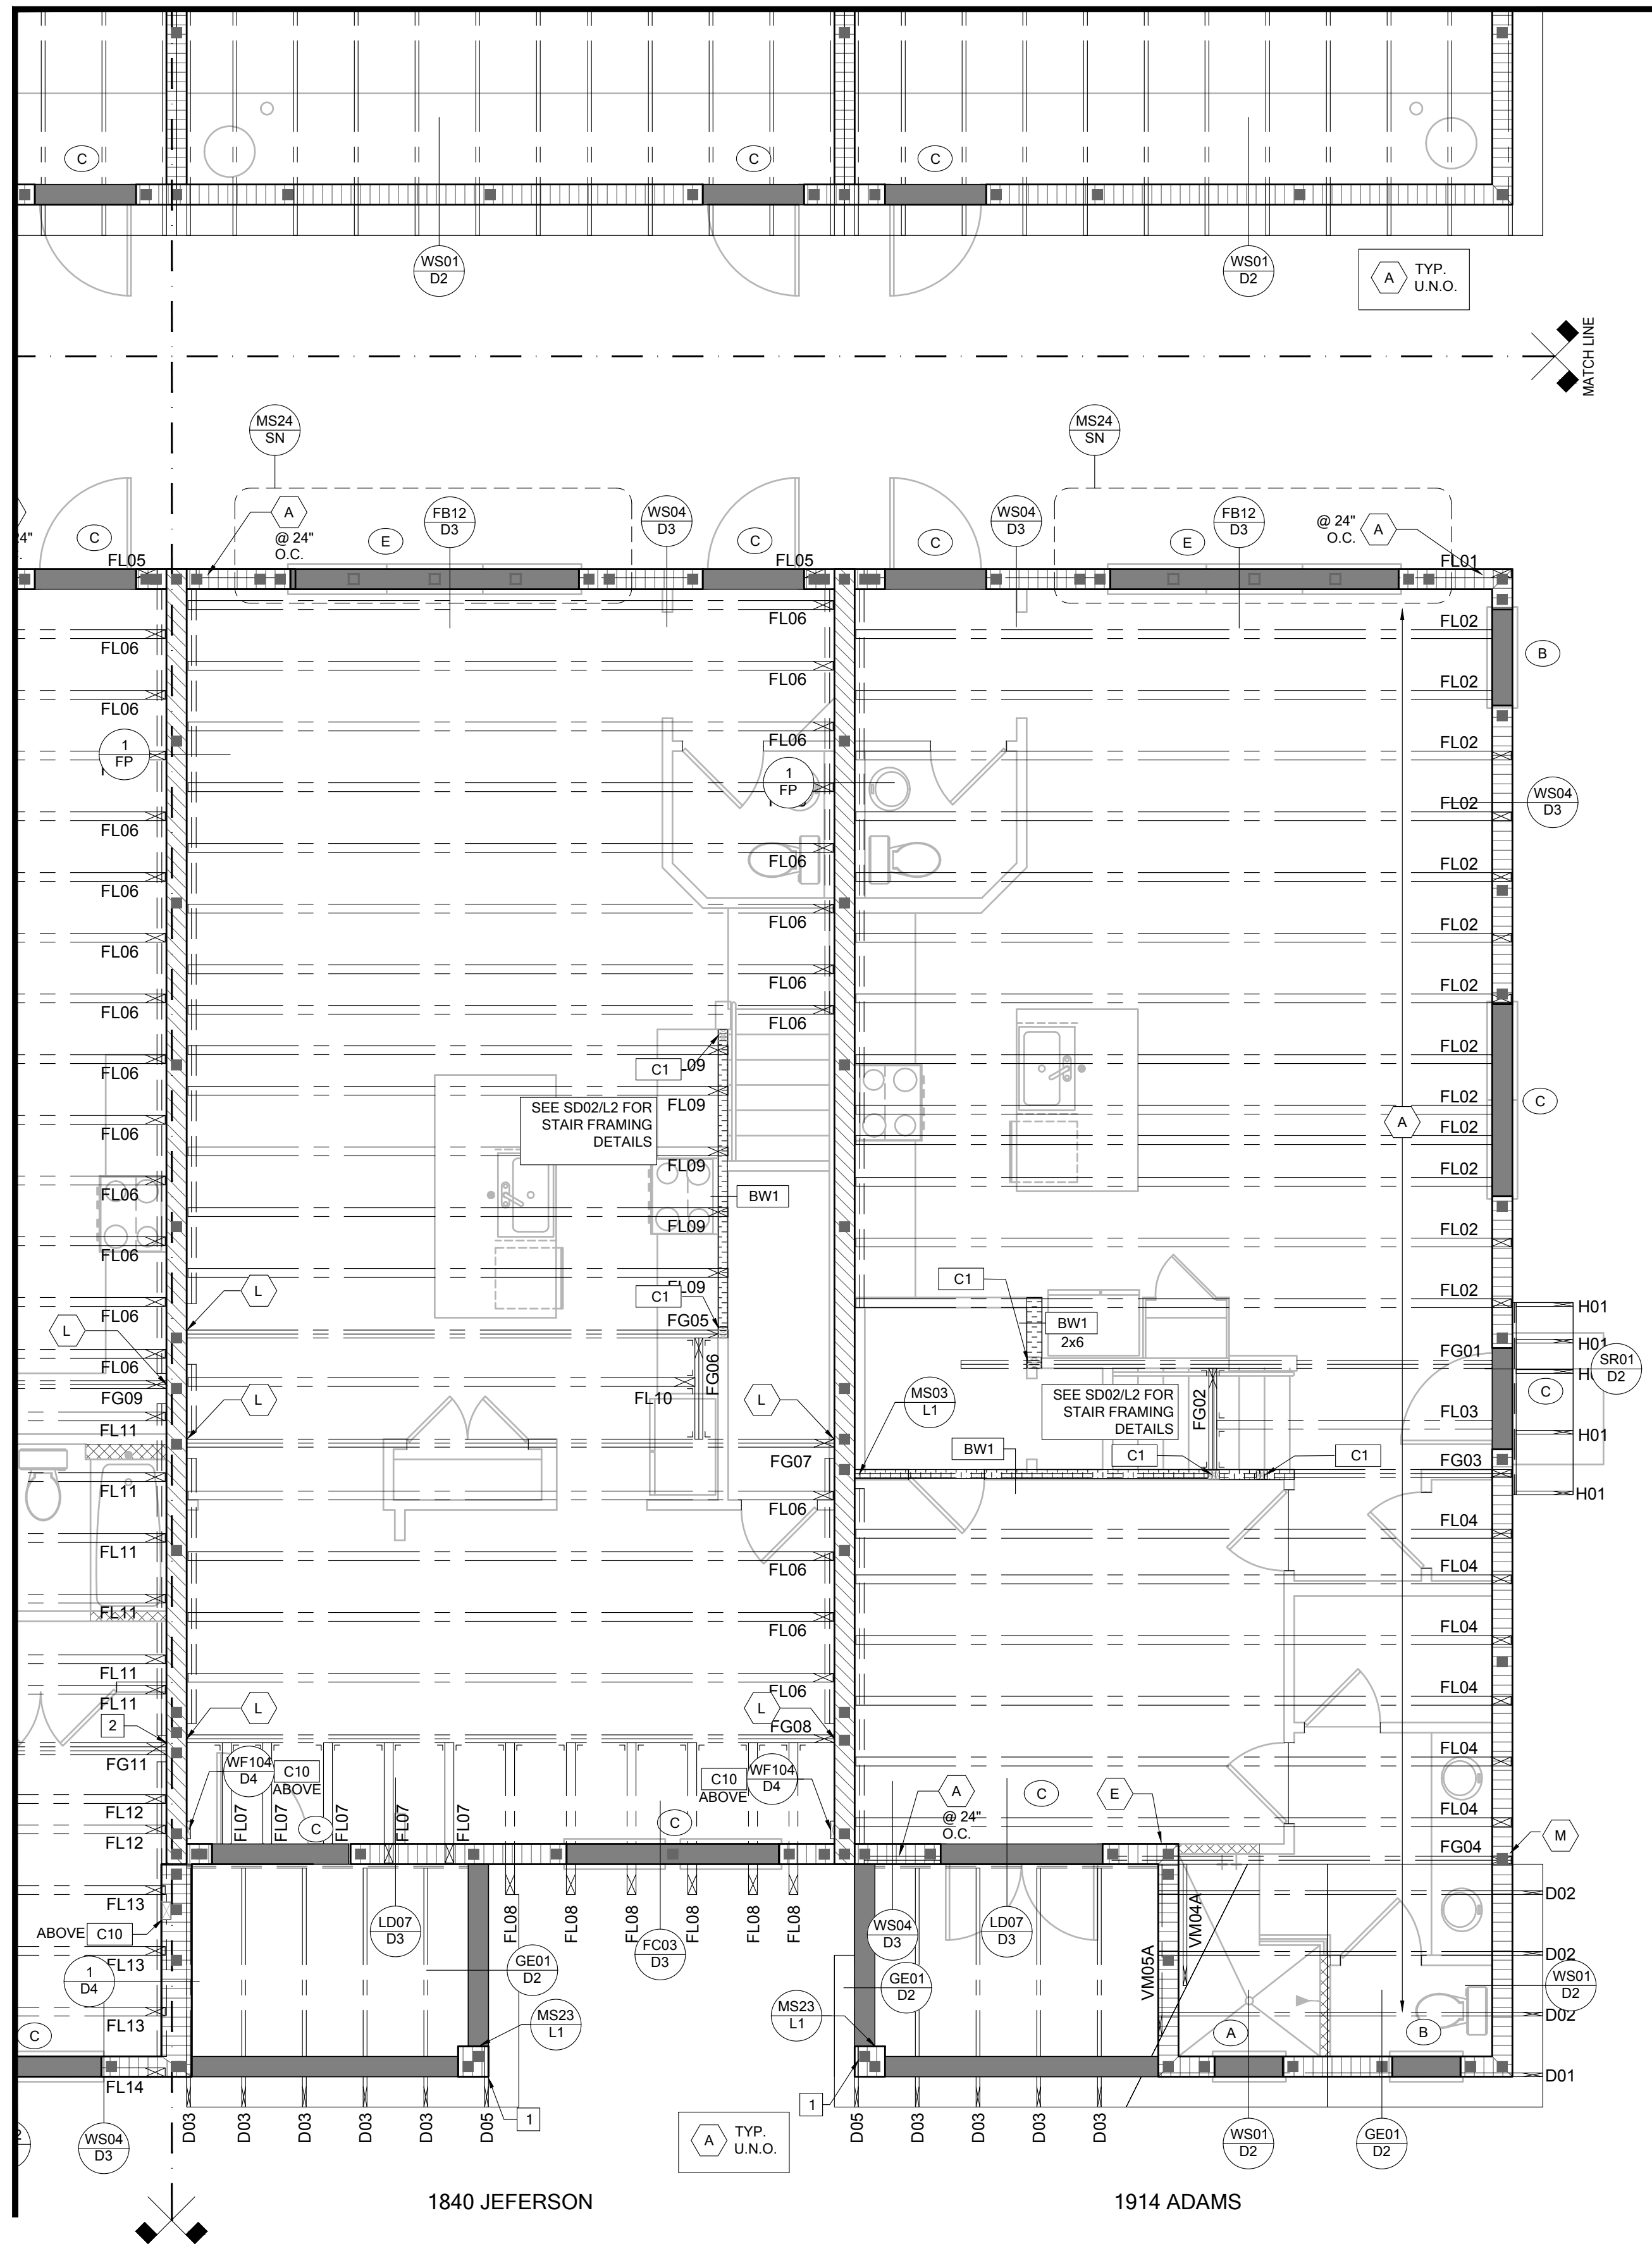

SYMBOL	DESIGN DESCRIPTION
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
	INDICATES PERFORATED SHEAR WALL, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
	INDICATES BUILT UP COLUMN, SEE FRAMING PLAN FOR SIZE, DETAIL WF37/SN FOR PLY ATTACHMENT AND UPLIFT CONNECTION SCHEDULE ON SN FOR CONNECTION TO SLAB
	INDICATES NO BOTTOM CONNECTOR REQUIRED
	INDICATES UPLIFT CONNECTION CONSTRUCTED PER DETAIL UPLIFT CONNECTOR SCHEDULE ON SHEET SN
	INDICATES WINDOW PRESSURE - SEE S0 FOR MORE INFORMATION.
	INDICATES LINTEL PER LINTEL PLAN


- FRAMING NOTES:**
- SEE WIND SPEED CHART ON S0 FOR WINDOW PRESSURES
 - AT SECOND FLOOR FOR TYPICAL CORNER FRAMING SEE DETAIL FB06/D3
- GENERAL NOTES:**
- THE FRAMING PLAN SHOWN INDICATES THE "TRUSS SYSTEM" AND IS THE RESPONSIBILITY OF THE TRUSS SYSTEM ENGINEER (DESIGN PROFESSIONAL OF RECORD), THE TRUSS DESIGN ENGINEER (DELEGATED ENGINEER) HAS FINAL, RESPONSIBILITY FOR EACH INDIVIDUAL TRUSS AND TRUSS PROFILE, AND IS TO SUBMIT A FINAL SET OF TRUSS ENGINEERING SIGNED AND SEALED TRUSS DRAWINGS TO DESIGN PROFESSIONAL OF RECORD FOR REVIEW PRIOR TO FABRICATION
 - ANY DISCREPANCY OR ERROR IN DIMENSIONS OR NOTES WITH IN THIS PLAN SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL FOR CLARIFICATION PRIOR TO CONSTRUCTION.
 - SEE SHEET SN FOR DESIGN SCHEDULES AND NOTES: FOUNDATION SCHEDULE / COLUMN SCHEDULE / BEARING WALL SCHEDULE / BEAM SCHEDULE / HEADER SCHEDULE / CONNECTION SCHEDULE / FLOOR AND ROOF NOTES.

- PLAN KEY NOTES**
- 12" SQ CMU COLUMN W/2#5 FULLY GROUTED
 - LGUM26-3-SDS CONNECTOR BY SIMPSON STRONG TIE w/(4) 3/8"x4" TITEN HD ANCHORS TO MASONRY AND (4) 1/4"x2-1/2" STRONG DRIVE SDS SCREWS

BUILDER NOTE:
TRUSS LAYOUT, CONNECTORS & ENGINEERING BASED ON TRUSSES PROVIDED BY MID FLORIDA LUMBER ACQUISITIONS, PROJECT NAME PSR6U w/ TRUSS DESIGN DATED 4/3/19 IF THE TRUSS LAYOUT SHOWN DOES NOT MATCH THE TRUSS MANUFACTURERS LAYOUT AND DATE ABOVE

---STOP---
AND CALL THE ENGINEER OF RECORD PRIOR TO PLACEMENT OF ANY TRUSSES.

SYMBOL	DESIGN DESCRIPTION
	2x INTERIOR BEARING SHEARWALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN
	MASONRY WALL TOP @ 9'-4"
	MASONRY WALL TOP @ 10'-8" ABV. GRADE
	MASONRY WALL TOP @ 10'-8" ABV. GRADE

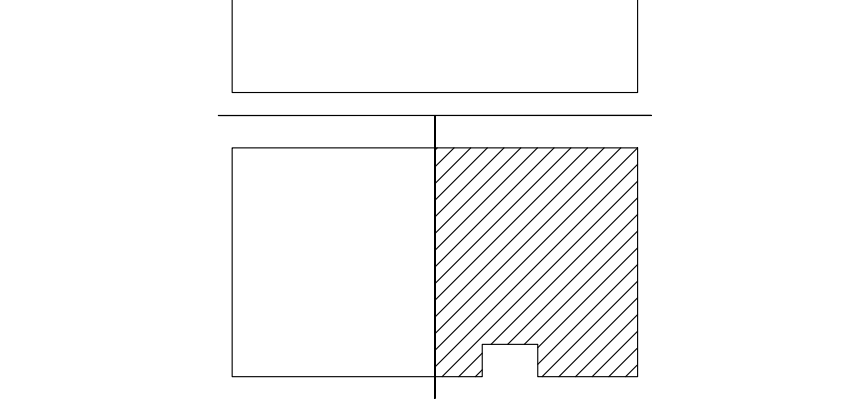

KEY PLAN
LOW ROOF & FLOOR FRAMING PLAN
SCALE: 1/4" = 1'-0"

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
C: 321-972-0491 F: 407-880-2304
Certificate of Authorization No. 9161
DATE: January 26, 2023


PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS

title: _____

project no. 2022142
checked: _____
drawn: AB
date: 05-17-22
scale: _____

S2.2

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

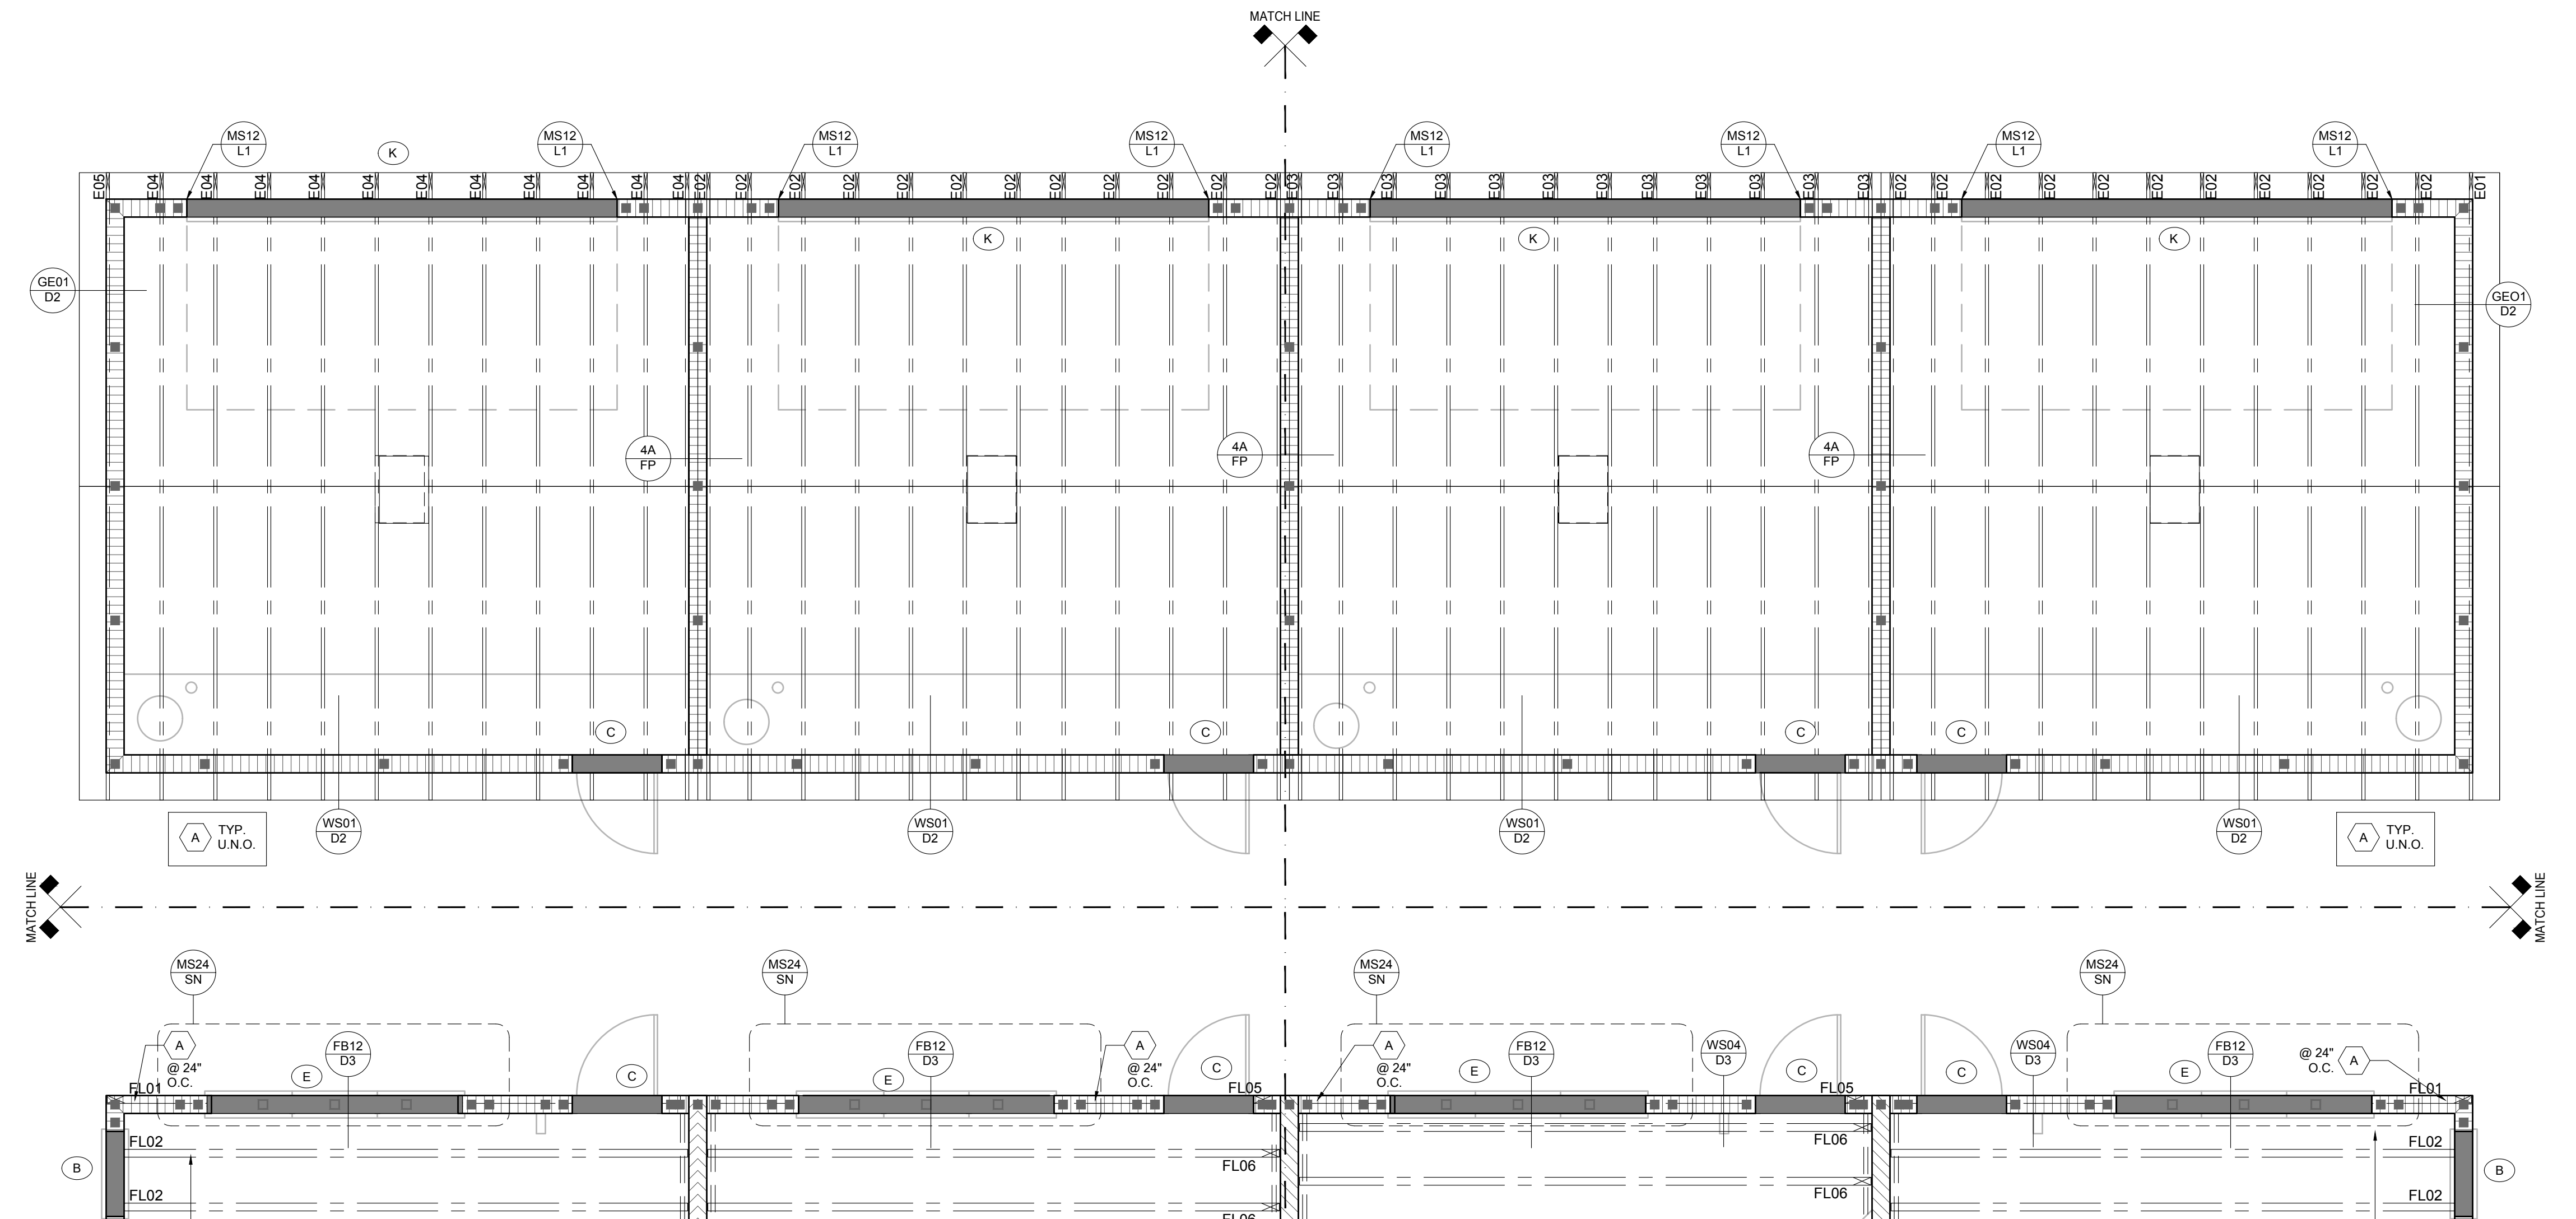

SYMBOL	DESIGN DESCRIPTION
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
	INDICATES PERFORATED SHEAR WALL, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
	INDICATES BUILT UP COLUMN, SEE FRAMING PLAN FOR SIZE, DETAIL WF37/SN FOR PLY ATTACHMENT AND UPLIFT CONNECTION SCHEDULE ON SN FOR CONNECTION TO SLAB
	INDICATES NO BOTTOM CONNECTOR REQUIRED
	INDICATES UPLIFT CONNECTION CONSTRUCTED PER DETAIL UPLIFT CONNECTOR SCHEDULE ON SHEET SN
	INDICATES WINDOW PRESSURE - SEE S0 FOR MORE INFORMATION.
	INDICATES LINTEL PER LINTEL PLAN

- FRAMING NOTES:**
- SEE WIND SPEED CHART ON S0 FOR WINDOW PRESSURES
 - AT SECOND FLOOR FOR TYPICAL CORNER FRAMING SEE DETAIL FB06/D3
- GENERAL NOTES:**
- THE FRAMING PLAN SHOWN INDICATES THE "TRUSS SYSTEM" AND IS THE RESPONSIBILITY OF THE TRUSS SYSTEM ENGINEER (DESIGN PROFESSIONAL OF RECORD). THE TRUSS DESIGN ENGINEER (DELEGATED ENGINEER) HAS FINAL RESPONSIBILITY FOR EACH INDIVIDUAL TRUSS AND TRUSS PROFILE, AND IS TO SUBMIT A FINAL SET OF TRUSS ENGINEERING SIGNED AND SEALED TRUSS DRAWINGS TO DESIGN PROFESSIONAL OF RECORD FOR REVIEW PRIOR TO FABRICATION
 - ANY DISCREPANCY OR ERROR IN DIMENSIONS OR NOTES WITH IN THIS PLAN SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL FOR CLARIFICATION PRIOR TO CONSTRUCTION.
 - SEE SHEET SN FOR DESIGN SCHEDULES AND NOTES: FOUNDATION SCHEDULE / COLUMN SCHEDULE / BEARING WALL SCHEDULE / BEAM SCHEDULE / HEADER SCHEDULE / CONNECTION SCHEDULE / FLOOR AND ROOF NOTES.

PLAN KEY NOTES

1 12" SQ CMU COLUMN W(2)#5 FULLY GROUTED


BUILDER NOTE:
TRUSS LAYOUT, CONNECTORS & ENGINEERING BASED ON TRUSSES PROVIDED BY MID FLORIDA LUMBER ACQUISITIONS. PROJECT NAME PSR6 w/ TRUSS DESIGN DATED 4/3/19 IF THE TRUSS LAYOUT SHOWN DOES NOT MATCH THE TRUSS MANUFACTURERS LAYOUT AND DATE ABOVE

STOP
AND CALL THE ENGINEER OF RECORD PRIOR TO PLACEMENT OF ANY TRUSSES.


SYMBOL	DESIGN DESCRIPTION
	2x INTERIOR BEARING SHEARWALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN
	MASONRY WALL TOP @ 9'-4"
	MASONRY WALL TOP @ 10'-8" ABV. GRADE
	MASONRY WALL TOP @ 10'-8" ABV. GRADE

KEY PLAN
LOW ROOF & FLOOR FRAMING PLAN
SCALE: 1/4" = 1'-0"

RSH		ENGINEERED ROOF PER ASCE 7-16 ROOF DESIGN ALLOWABLE COMPONENTS AND CLADDING WIND PRESSURES AND SUCTIONS FOR MEAN ROOF HEIGHT ≤ 25 ft						
WIND SPEED (ULTIMATE)	140.0 MPH							
WIND SPEED (ALLOWABLE)	108.4 MPH							
EXPOSURE CATEGORY	C							
EFFECTIVE WIND AREA (SQ FEET)	WIND PRESSURE AND SUCTION (PSF)							
	(+) VALUE DENOTES PRESSURE (-) VALUE DENOTES SUCTION							
AREA	ROOF	1	2e	2n	2r	3	3e	3r
10	HIP	-35.94	-49.57		-49.57	-49.57		
	GABLE	-38.22	-38.22	-60.99	-60.99		-60.99	-78.58
ROOF NAILING SCHEDULE/ NAILING ZONES (SHINGLE AND TILE):								
ZONE 1: ASTM F1667 RSR-01 (8d) NAILS @ 6" O.C. ON EDGE AND 6" O.C. IN FIELD								
ZONE 2e, 2n, 2r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ZONE 3, 3e, 3r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ROOF SHEATHING:								
SHINGLE: 1/2" EXP. 1 (3/16) or 1/2" EXP. 1 (3/16)								
TILE: 1/2" EXP. 1 (3/16)								
NOTE:								
1. PER CODE ASTM F1667 RSR-01 REFERENCE TO 8d (2 3/4" x 0.113") NAILS								
2. WHERE THE SHEATHING THICKNESS IS GREATER THAN 1/2", SHEATHING SHALL BE FASTENED WITH ASTM F1667 RSR-03 10d (2 1/2" x 0.131") NAILS OR ASTM F1667 RSR-04 (3" x .120") NAILS								
3. GABLES- DROP GABLE END & (1) ADDITIONAL DROPPED TRUSS 2x4 #2 SYP OUTLOOKER RAFTER W/ BLOCKING @ 16" O.C. IF NO DROPPED GABLE END, ATTACH 2x4 #2 SYP BLOCKING @ 16" O.C. FIRST 4 BAYS WITH (2) 12d NAILS EA. END. ATTACH ROOF SHEATHING TO RAFTERS W/ BLOCKING PER NAILING SCHEDULE.								

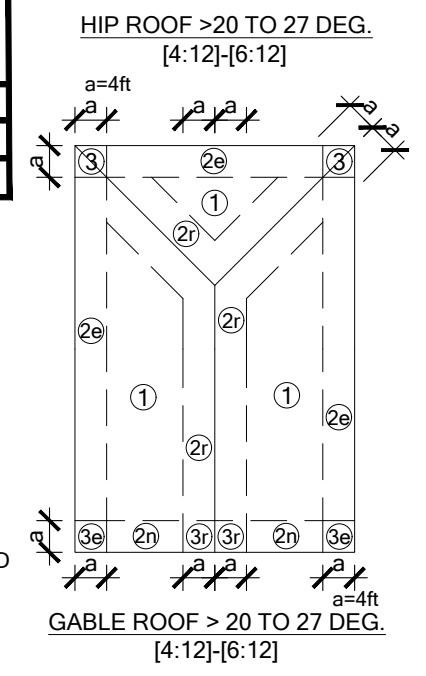

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

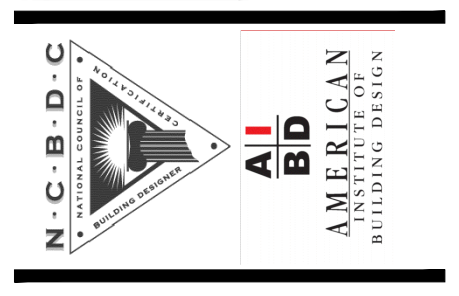

FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
C: 321-972-0491 F: 407-880-2304
Certificate of Authorization No. 9161
DATE: January 26, 2023


**PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS**

project no. 2022142
checked:
drawn: AB
date: 05-17-22
scale:

S2.3

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

RSH	ENGINEERED ROOF PER ASCE 7-16 ROOF DESIGN ALLOWABLE COMPONENTS AND CLADDING WIND PRESSURES AND SUCTIONS FOR MEAN ROOF HEIGHT ≤ 25 ft							
WIND SPEED (ULTIMATE)	140.0 MPH							
WIND SPEED (ALLOWABLE)	108.4 MPH							
EXPOSURE CATEGORY	C							
EFFECTIVE WIND AREA (SQ FEET)	WIND PRESSURE AND SUCTION (PSF) (+) VALUE DENOTES PRESSURE (-) VALUE DENOTES SUCTION							
AREA	ROOF	1	2e	2n	2r	3	3e	3r
10	HIP	-35.94	-49.57	-49.57	-49.57	-49.57	-60.99	-78.58
	GABLE	-38.22	-38.22	-60.99	-60.99			
ROOF NAILING SCHEDULE/ NAILING ZONES (SHINGLE AND TILE):								
ZONE 1: ASTM F1667 RSR-01 (8d) NAILS @ 6" O.C. ON EDGE AND 6" O.C. IN FIELD								
ZONE 2e, 2n, 2r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ZONE 3, 3e, 3r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ROOF SHEATHING: SHINGLE: 1/2" EXP. 1 (2%) or 1/2" EXP. 1 (2%)								
TILE: 1/2" EXP. 1 (2%)								
NOTE: 1. PER CODE ASTM F1667 RSR-01 REFERENCE TO 8d (2 3/4" x 0.113") NAILS 2. WHERE THE SHEATHING THICKNESS IS GREATER THAN 1/2", SHEATHING SHALL BE FASTENED WITH ASTM F1667 RSR-03 10d (2 1/2" x 0.131") NAILS OR ASTM F1667 RSR-04 (3" x 120") NAILS 3. GABLES- DROP GABLE END & (1) ADDITIONAL DROPPED TRUSS 2x4 #2 SYP OUTLOOKER RAFTER W/ BLOCKING @ 16" O.C. IF NO DROPPED GABLE END, ATTACH 2x4 #2 SYP BLOCKING @ 16" O.C. FIRST 4 BAYS WITH (2) 12d NAILS EA. END. ATTACH ROOF SHEATHING TO RAFTERS W/ BLOCKING PER NAILING SCHEDULE.								
HIP ROOF >20 TO 27 DEG. [4:12]-[6:12]								
GABLE ROOF > 20 TO 27 DEG. [4:12]-[6:12]								

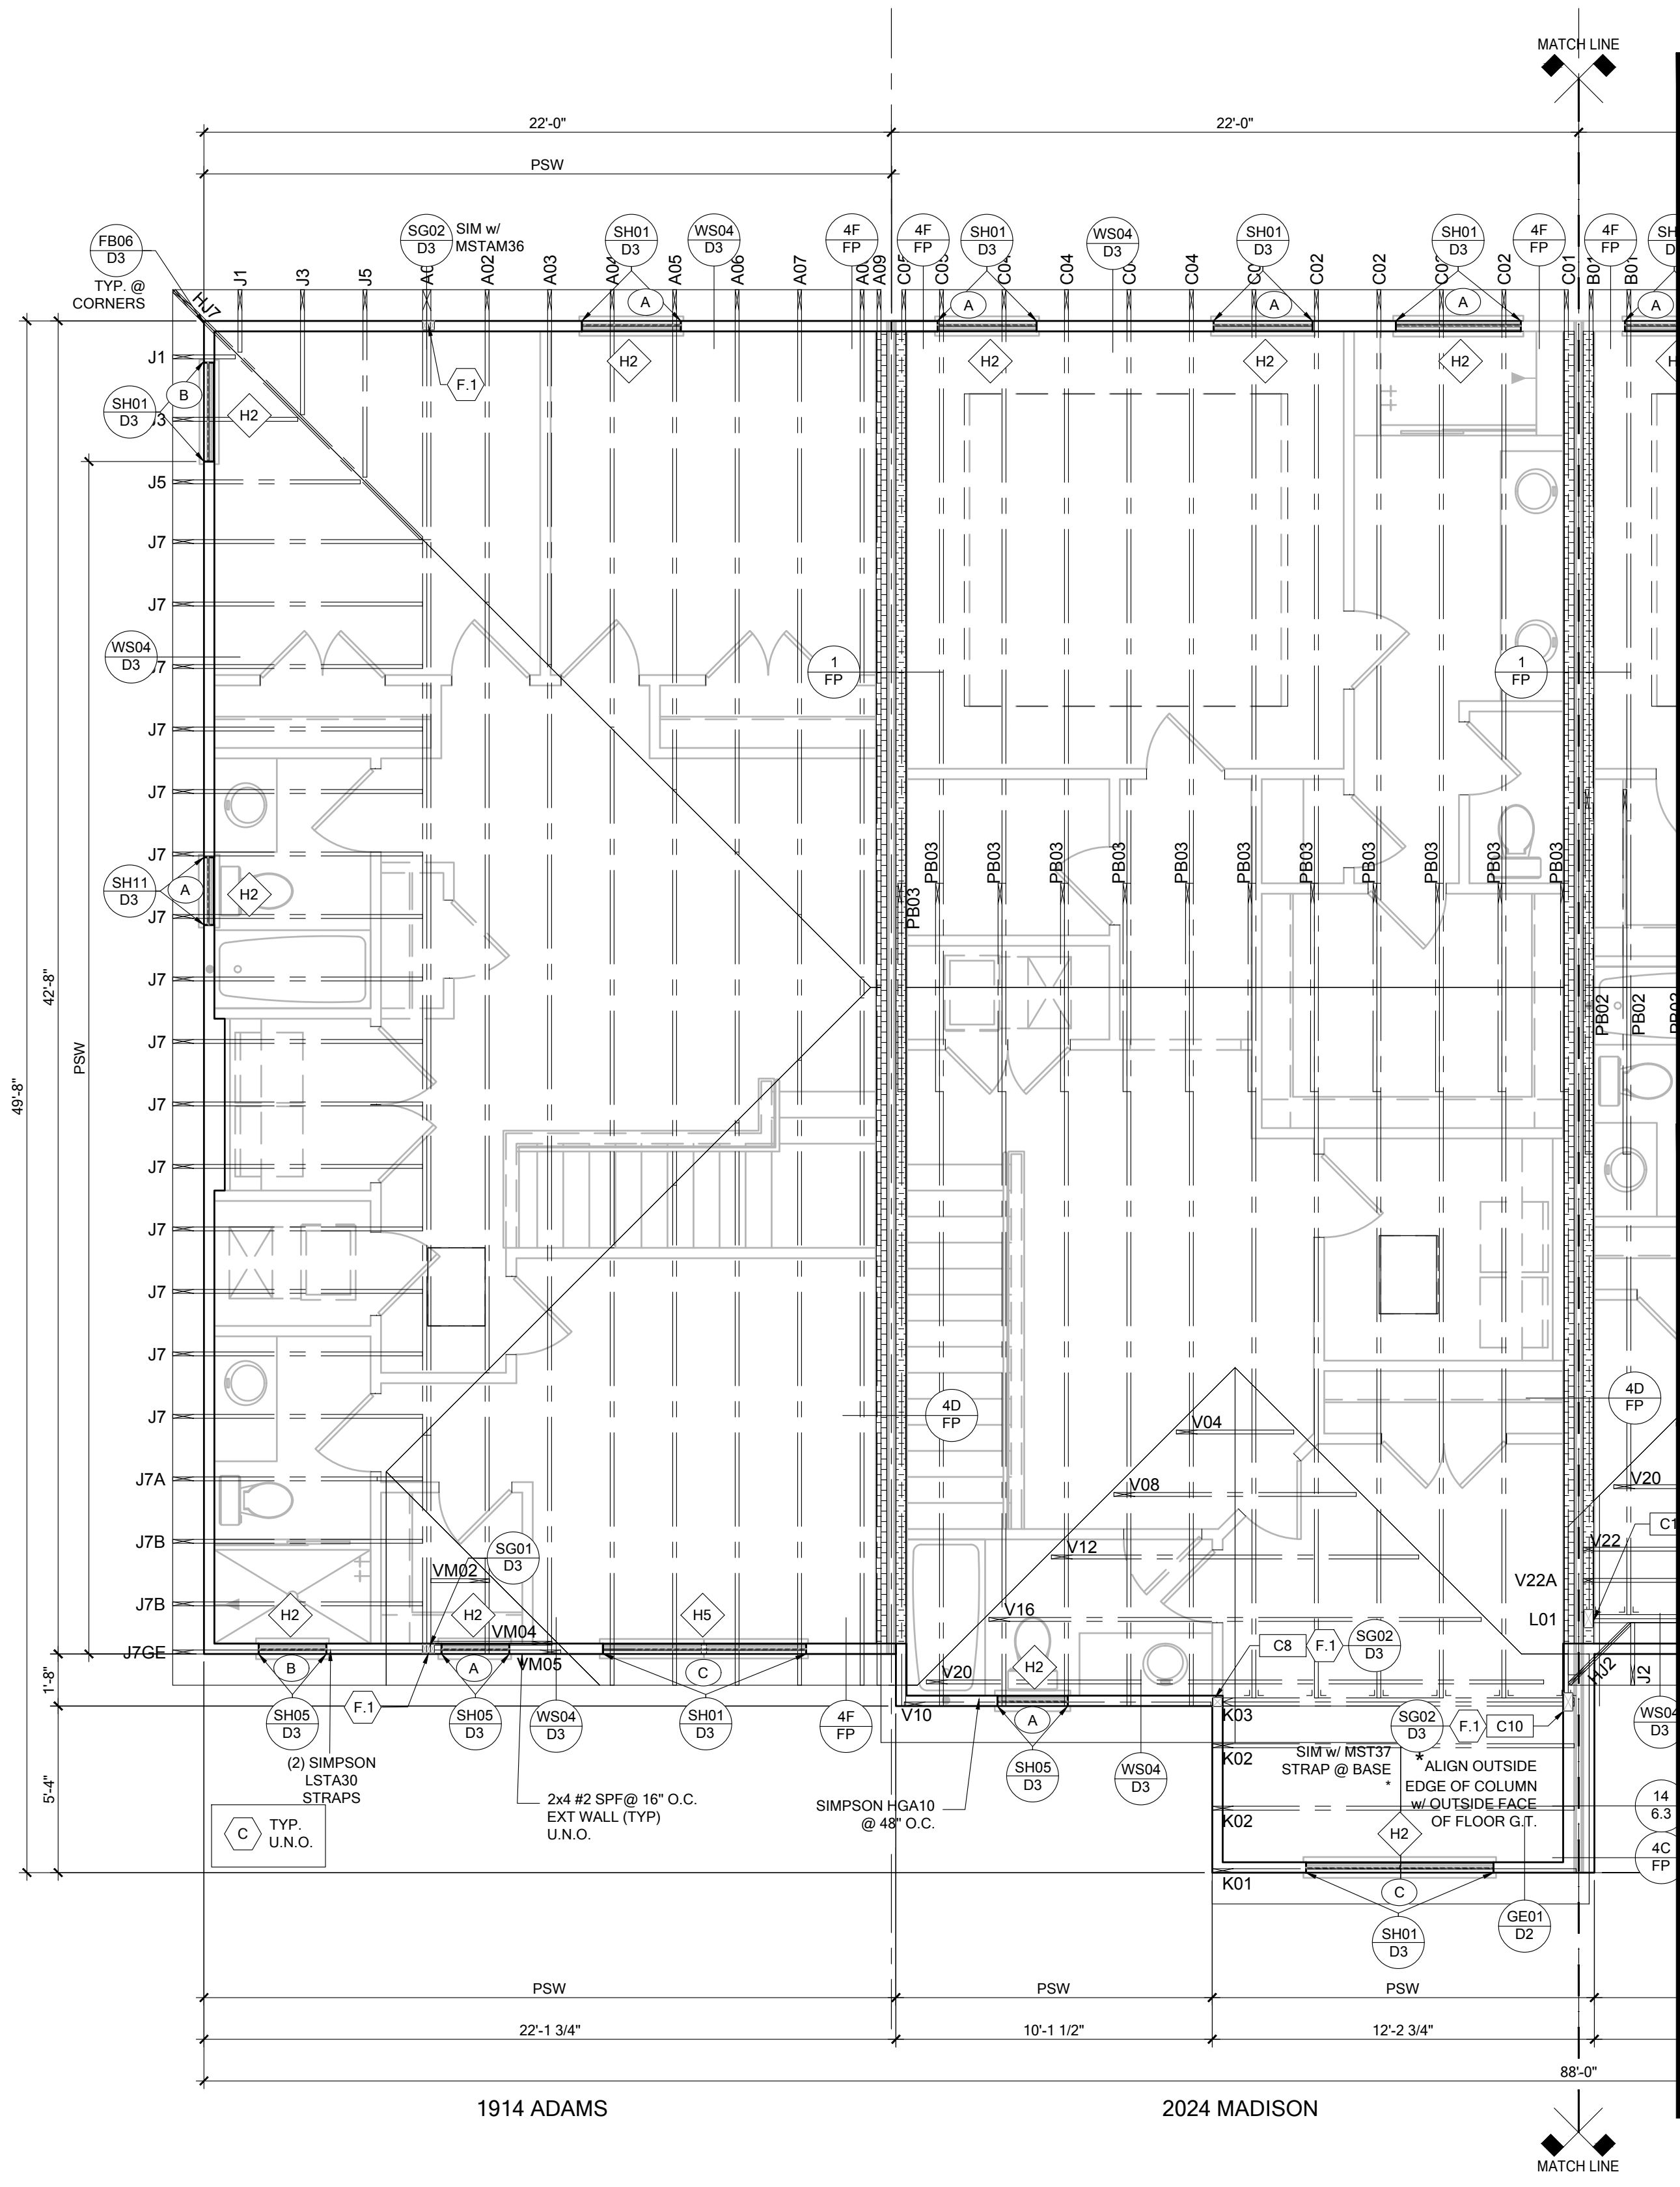

SYMBOL	DESIGN DESCRIPTION
BW# 2x	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
PSW	INDICATES PERFORATED SHEAR WALL, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
C#	INDICATES BUILT UP COLUMN, SEE FRAMING PLAN FOR SIZE, DETAIL WF37/SN FOR PLY ATTACHMENT AND UPLIFT CONNECTION SCHEDULE ON SN FOR CONNECTION TO SLAB
C#*	INDICATES NO BOTTOM CONNECTOR REQUIRED
#	INDICATES UPLIFT CONNECTION CONSTRUCTED PER DETAIL UPLIFT CONNECTOR SCHEDULE ON SHEET SN
#	INDICATES WINDOW PRESSURE - SEE S0 FOR MORE INFORMATION.
	INDICATES LINTEL PER LINTEL PLAN


- FRAMING NOTES:**
- SEE WIND SPEED CHART ON S0 FOR WINDOW PRESSURES
 - AT SECOND FLOOR FOR TYPICAL CORNER FRAMING SEE DETAIL FB06/D3
- GENERAL NOTES:**
- THE FRAMING PLAN SHOWN INDICATES THE "TRUSS SYSTEM" AND IS THE RESPONSIBILITY OF THE TRUSS SYSTEM ENGINEER (DESIGN PROFESSIONAL OF RECORD). THE TRUSS DESIGN ENGINEER (DELEGATED ENGINEER) HAS FINAL RESPONSIBILITY FOR EACH INDIVIDUAL TRUSS AND TRUSS PROFILE, AND IS TO SUBMIT A FINAL SET OF TRUSS ENGINEERING SIGNED AND SEALED TRUSS DRAWINGS TO DESIGN PROFESSIONAL OF RECORD FOR REVIEW PRIOR TO FABRICATION
 - ANY DISCREPANCY OR ERROR IN DIMENSIONS OR NOTES WITH IN THIS PLAN SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL FOR CLARIFICATION PRIOR TO CONSTRUCTION.
 - SEE SHEET SN FOR DESIGN SCHEDULES AND NOTES: FOUNDATION SCHEDULE / COLUMN SCHEDULE / BEARING WALL SCHEDULE / BEAM SCHEDULE / HEADER SCHEDULE / CONNECTION SCHEDULE / FLOOR AND ROOF NOTES.

PLAN KEY NOTES

BUILDER NOTE:
TRUSS LAYOUT, CONNECTORS & ENGINEERING BASED ON TRUSSES PROVIDED BY MID FLORIDA LUMBER ACQUISITIONS, PROJECT NAME PSR6U W/ TRUSS DESIGN DATED 4/3/19 IF THE TRUSS LAYOUT SHOWN DOES NOT MATCH THE TRUSS MANUFACTURERS LAYOUT AND DATE ABOVE

STOP
AND CALL THE ENGINEER OF RECORD PRIOR TO PLACEMENT OF ANY TRUSSES.

SYMBOL	DESIGN DESCRIPTION
2x	INTERIOR BEARING SHEAR WALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN
2x	WOOD FRAME WALL @ 9'-0"

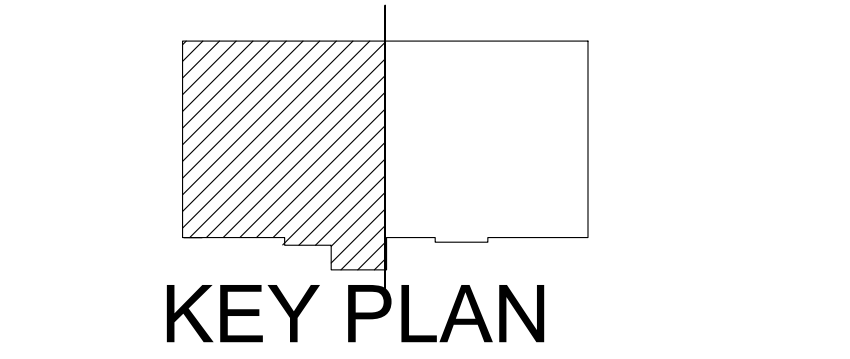

ROOF FRAMING PLAN
SCALE: 1/4" = 1'-0"

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

AI BUILD AMERICAN BUILDING DESIGN


FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
C: 321-972-0491 F: 407-880-2304
Certificate of Authorization No. 9161
SCOTT LEWIS/CSK, PE - FL #79759
DATE: January 26, 2023

**PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS**

title:
project no. 2022142
checked:
drawn: AB
date: 05-17-22
scale:
S3.1

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

RSH	ENGINEERED ROOF PER ASCE 7-16 ROOF DESIGN ALLOWABLE COMPONENTS AND CLADDING WIND PRESSURES AND SUCTIONS FOR MEAN ROOF HEIGHT ≤ 25 ft							
WIND SPEED (ULTIMATE)	140.0 MPH							
WIND SPEED (ALLOWABLE)	108.4 MPH							
EXPOSURE CATEGORY	C							
EFFECTIVE WIND AREA (SQ FEET)	WIND PRESSURE AND SUCTION (PSF) (+) VALUE DENOTES PRESSURE (-) VALUE DENOTES SUCTION							
AREA	ROOF	1	2e	2n	2r	3	3e	3r
10	HIP	-35.94	-49.57		-49.57	-49.57		
	GABLE	-38.22	-38.22	-60.99	-60.99		-60.99	-78.58
ROOF NAILING SCHEDULE/ NAILING ZONES (SHINGLE AND TILE):								
ZONE 1: ASTM F1667 RSR-01 (8d) NAILS @ 6" O.C. ON EDGE AND 6" O.C. IN FIELD								
ZONE 2e, 2n, 2r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ZONE 3, 3e, 3r: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE AND 4" O.C. IN FIELD								
ROOF SHEATHING: SHINGLE: 1/2" EXP. 1 (2%) or 1/2" EXP. 1 (2%)								
TILE: NOTE: 1/2" EXP. 1 (2%)								
1. PER CODE ASTM F1667 RSR-01 REFERENCE TO 8d (2 3/4" x 0.113") NAILS								
2. WHERE THE SHEATHING THICKNESS IS GREATER THAN 1/2", SHEATHING SHALL BE FASTENED WITH ASTM F1667 RSR-03 10d (2 1/2" x 0.131") NAILS OR ASTM F1667 RSR-04 (3" x 120") NAILS								
3. CABLES- DROP GABLE END & (1) ADDITIONAL DROPPED TRUSS 2x4 #2 SYP OUTLOOKER RAFTER W/ BLOCKING @ 16" O.C. IF NO DROPPED GABLE END, ATTACH 2x4 #2 SYP BLOCKING @ 16" O.C. FIRST 4 BAYS WITH (2) 12d NAILS EA. END. ATTACH ROOF SHEATHING TO RAFTERS W/ BLOCKING PER NAILING SCHEDULE.								
HIP ROOF > 20 TO 27 DEG. [4-12]-[6-12]								
GABLE ROOF > 20 TO 27 DEG. [4-12]-[6-12]								

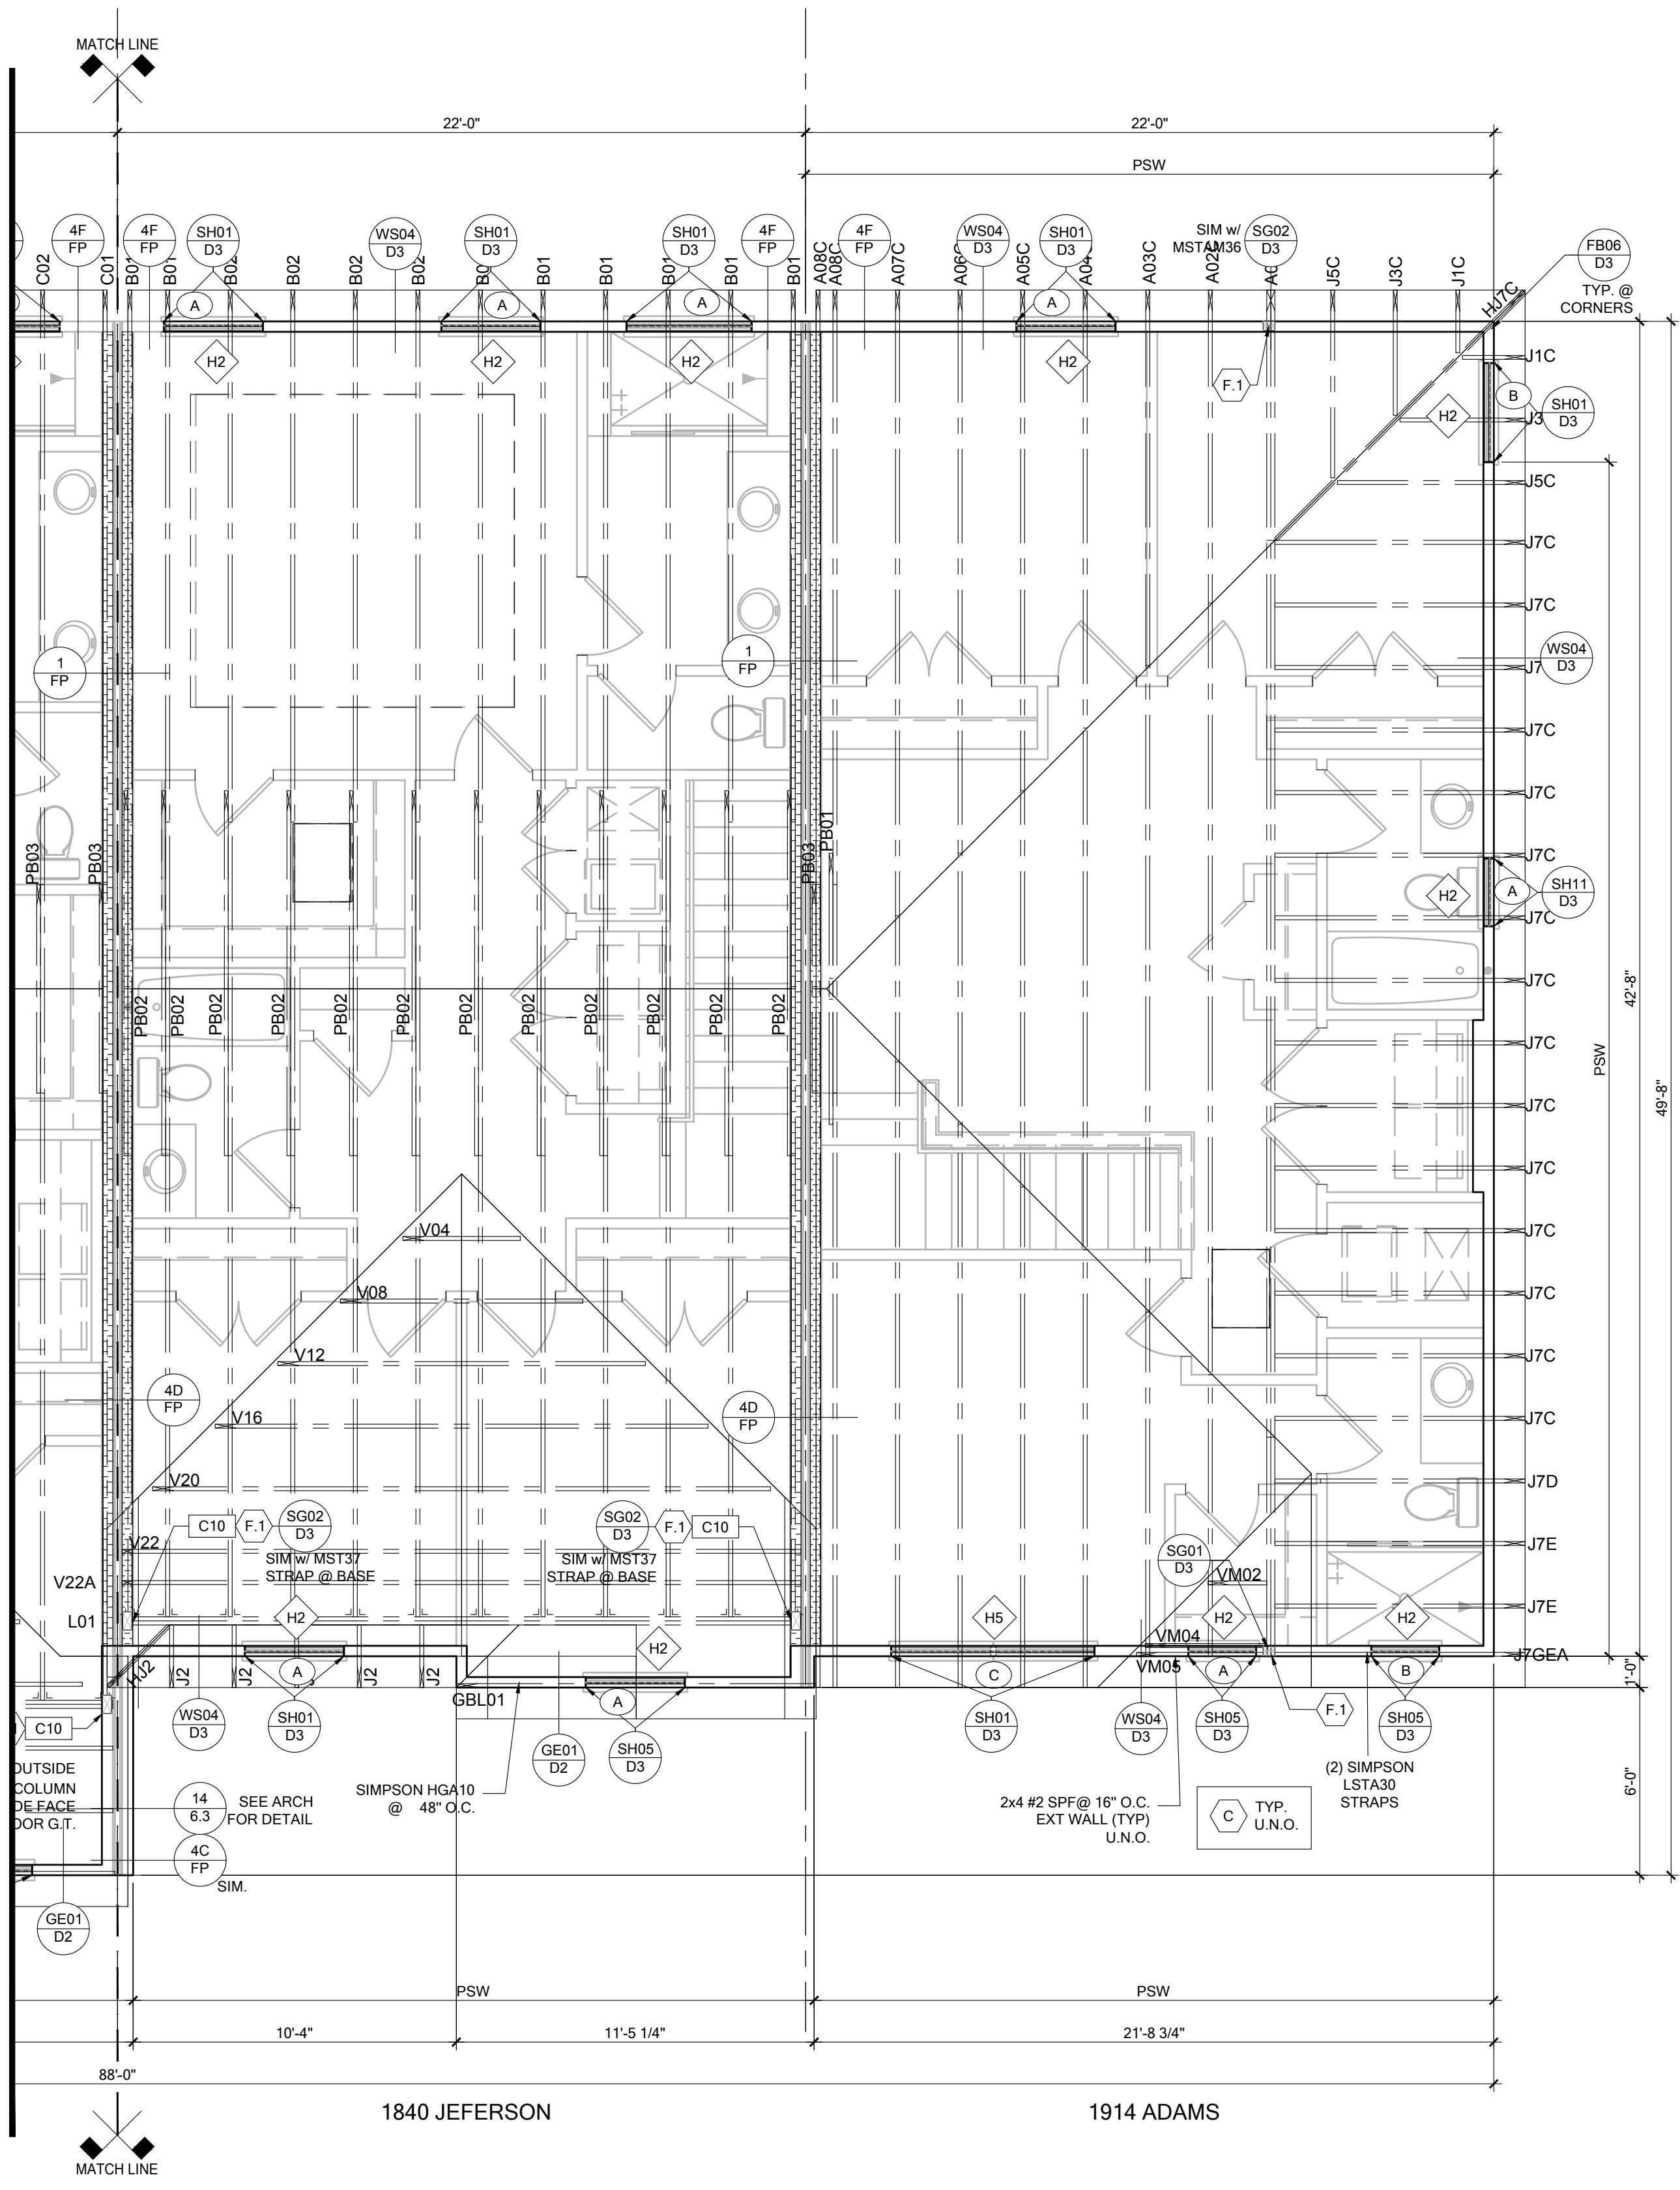

SYMBOL	DESIGN DESCRIPTION
BW 2x	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN. SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
PSW	INDICATES PERFORATED SHEAR WALL, SEE ARCHITECTURAL PLANS FOR WALL WIDTH, 2x4 MINIMUM U.O.N.
C#	INDICATES BUILT UP COLUMN, SEE FRAMING PLAN FOR SIZE, DETAIL WF37/SN FOR PLY ATTACHMENT AND UPLIFT CONNECTION SCHEDULE ON SN FOR CONNECTION TO SLAB
C#*	INDICATES NO BOTTOM CONNECTOR REQUIRED
#	INDICATES UPLIFT CONNECTION CONSTRUCTED PER DETAIL UPLIFT CONNECTOR SCHEDULE ON SHEET SN
#	INDICATES WINDOW PRESSURE - SEE S0 FOR MORE INFORMATION.
#	INDICATES LINTEL PER LINTEL PLAN

- FRAMING NOTES:**
- SEE WIND SPEED CHART ON S0 FOR WINDOW PRESSURES
 - AT SECOND FLOOR FOR TYPICAL CORNER FRAMING SEE DETAIL FB06/D3


- GENERAL NOTES:**
- THE FRAMING PLAN SHOWN INDICATES THE "TRUSS SYSTEM" AND IS THE RESPONSIBILITY OF THE TRUSS SYSTEM ENGINEER (DESIGN PROFESSIONAL OF RECORD). THE TRUSS DESIGN ENGINEER (DELEGATED ENGINEER) HAS FINAL, RESPONSIBILITY FOR EACH INDIVIDUAL TRUSS AND TRUSS PROFILE, AND IS TO SUBMIT A FINAL SET OF TRUSS ENGINEERING SIGNED AND SEALED TRUSS DRAWINGS TO DESIGN PROFESSIONAL OF RECORD FOR REVIEW PRIOR TO FABRICATION
 - ANY DISCREPANCY OR ERROR IN DIMENSIONS OR NOTES WITH IN THIS PLAN SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL FOR CLARIFICATION PRIOR TO CONSTRUCTION.
 - SEE SHEET SN FOR DESIGN SCHEDULES AND NOTES: FOUNDATION SCHEDULE / COLUMN SCHEDULE / BEARING WALL SCHEDULE / BEAM SCHEDULE / HEADER SCHEDULE / CONNECTION SCHEDULE / FLOOR AND ROOF NOTES.

PLAN KEY NOTES

BUILDER NOTE:
TRUSS LAYOUT, CONNECTORS & ENGINEERING BASED ON TRUSSES PROVIDED BY MID FLORIDA LUMBER ACQUISITIONS. PROJECT NAME: PARK SQUARE W/ TRUSS DESIGN DATED 4/3/19 IF THE TRUSS LAYOUT SHOWN DOES NOT MATCH THE TRUSS MANUFACTURERS LAYOUT AND DATE ABOVE

---STOP---
AND CALL THE ENGINEER OF RECORD PRIOR TO PLACEMENT OF ANY TRUSSES.

SYMBOL	DESIGN DESCRIPTION
2x INTERIOR BEARING SHEARWALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.	
INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN	
2x WOOD FRAME WALL @ 9'-0"	

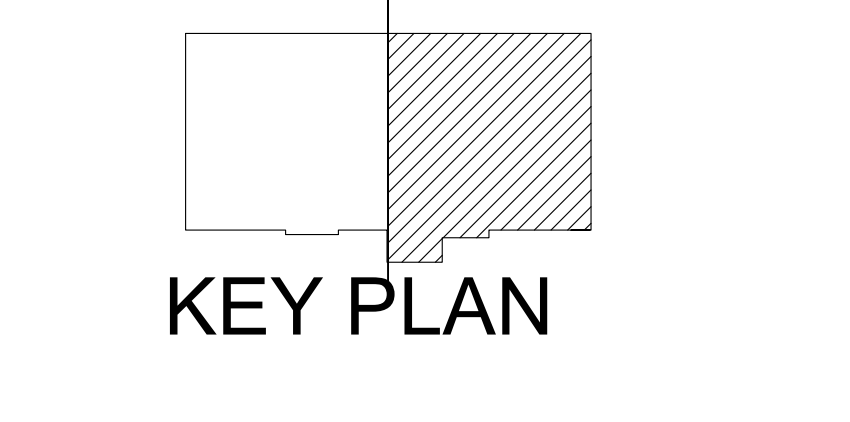

ROOF FRAMING PLAN
SCALE: 1/4" = 1'-0"

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
C: 321-972-0491 F: 407-880-2304
Certificate of Authorization No. 9161
Professional Engineer License No. 12579
DATE: January 26, 2023

PARK SQUARE HORIZONS WEST 4-UNIT - ADAMS END UNITS

title: _____



project no. 2022142
checked: _____
drawn: AB
date: 05-17-22
scale: _____

S3.2



NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

GENERAL CONCRETE LINTEL SCHEDULE

APPROVED LINTEL MANUFACTURERS: CASTE-CRETE, QUALITY AND LOTTS.

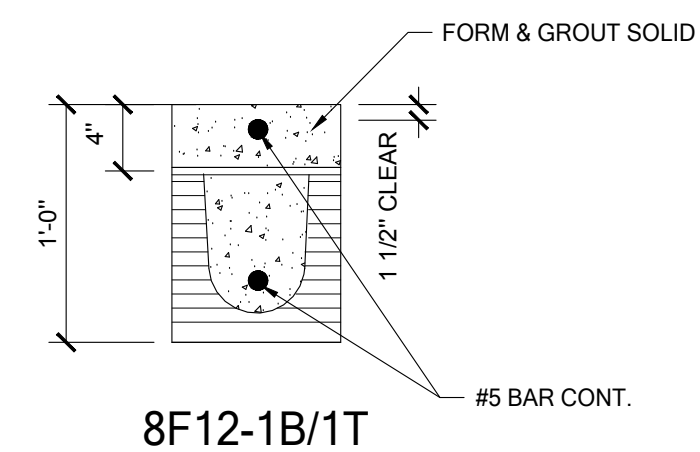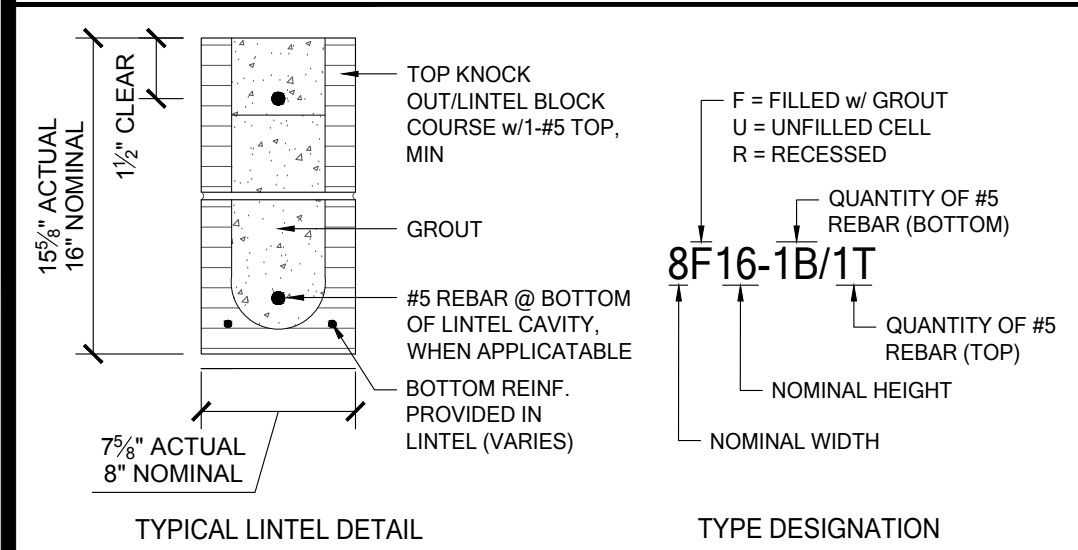

LINTEL MINIMUM DEPTHS ARE CALLED OUT ON LINTEL PLAN. IF CONTRACTOR INSTALLS A DEEPER LINTEL THAN INDICATED ON THE PLAN, DOING THIS INCREASES THE STRENGTH OF THE LINTEL AND IS APPROVED WITHOUT ENGINEERING LETTER. IF A SMALLER LINTEL IS INSTALLED CONTACT EOR FOR APPROVAL (SEE SHEET L1 FOR LINTEL SCHEDULE).

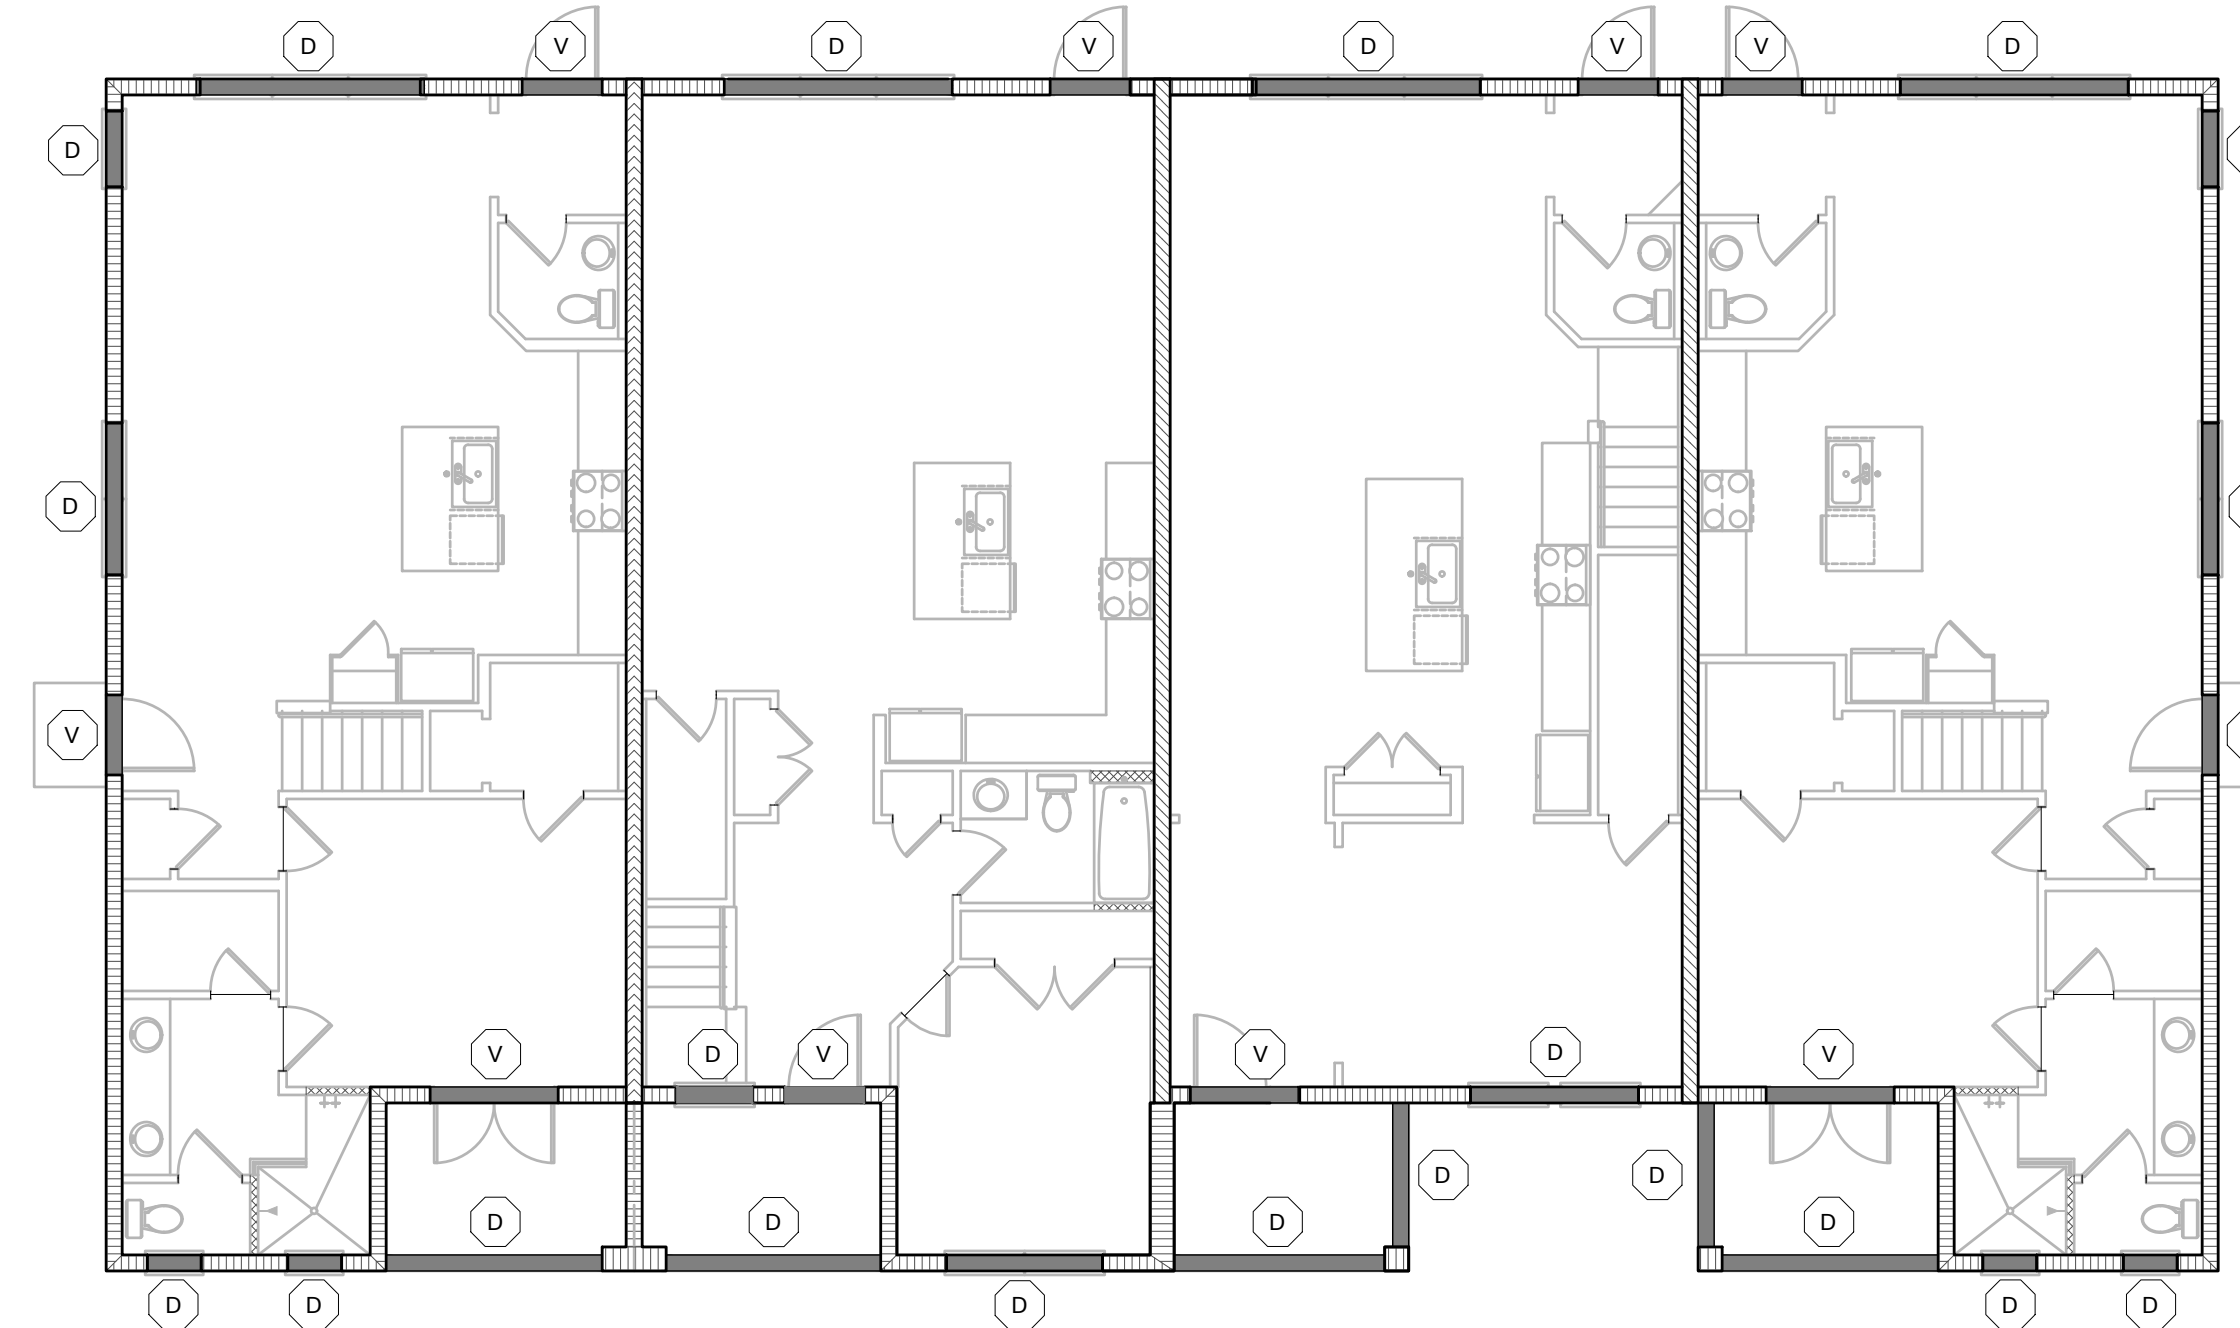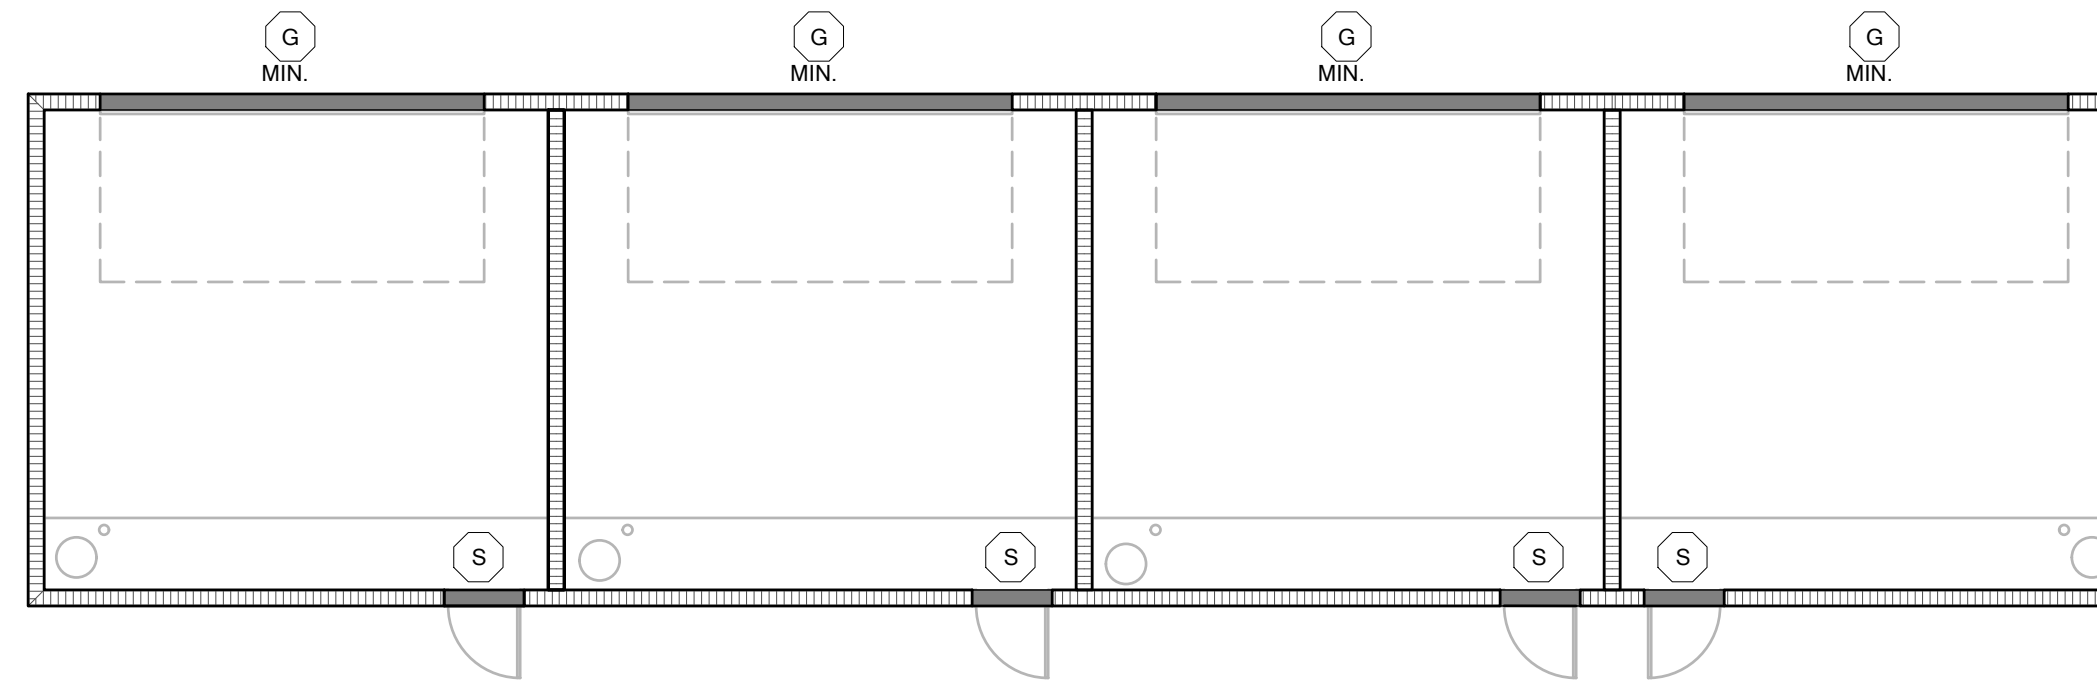


LINTEL PLAN

SCALE: 1/8" = 1'-0"

LINTEL DESIGNATION SCHEDULE

MARK	LINTEL DESIGN	MARK	LINTEL DESIGN	MARK	LINTEL DESIGN
A	8RF6-0B/1T	H	8RF30-1B/1T	Q	8RF30-0B/1T
B	8F8-0B/1T	J	8F32-1B/1T	R	8F32-0B/1T
C	8RF14-1B/1T	K	8RF14-0B/1T	S	8F28-1B/1T
D	8F16-1B/1T	L	8F16-0B/1T	T	8F40-1B/1T
E	8F20-1B/1T	M	8F20-0B/1T	U	8F16-2B/2T
F	8RF22-1B/1T	N	8RF22-0B/1T	V	8F12-1B/1T
G	8F24-1B/1T	P	8F24-0B/1T		

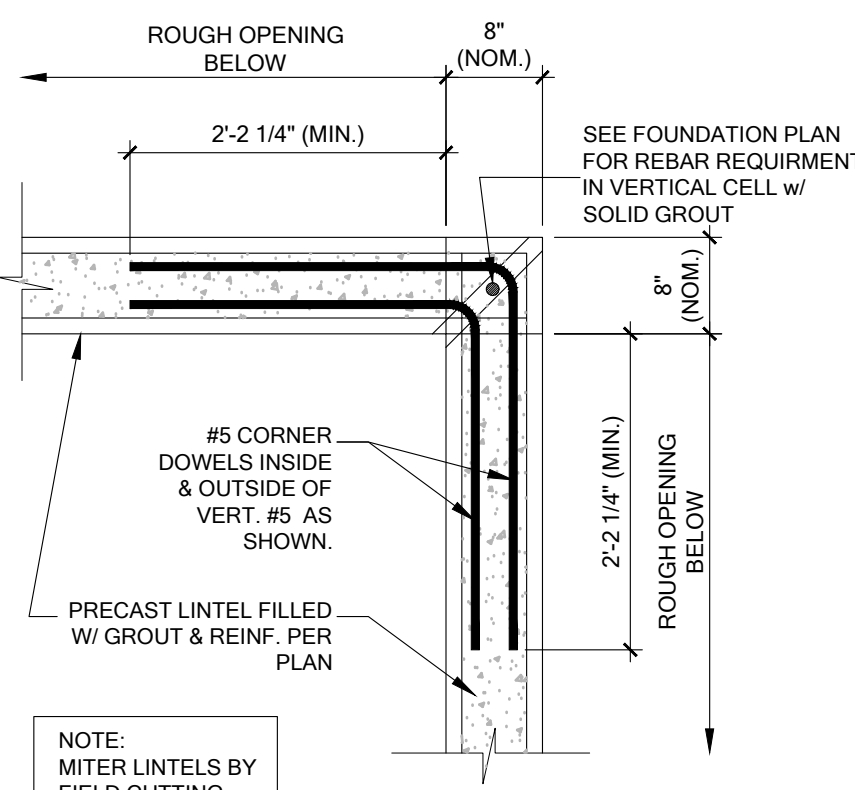





- GENERAL INSTALLATION NOTES:**
- PROVIDE FULL MORTAR HEAD AND BED JOINTS.
 - SHARE FILLED LINTELS ARE REQUIRED
 - INSTALLATION OF LINTEL MUST COMPLY w/ THE ARCHITECTURAL AND STRUCTURAL DRAWINGS
 - U-LINTELS ARE LOCATED MANUFACTURED w/ 5/8" LONG NOTCHES AT THE END TO ACCOMMODATE VERTICAL CELL REINFORCING AND GROUTING.
 - ALL LINTELS MEET OR EXCEED L/360 VERTICAL DEFLECTION, EXCEPT LINTELS 17'-4" AND LONGER w/ NOMINAL HEIGHT OF 8" MEET OR EXCEED L/180
 - BOTTOM FIELD ADDED REBAR TO BE LOCATED AT THE BOTTOM OF THE LINTEL CAVITY.
 - 3/8" Ø WIRE STIRRUPS ARE WELDED TO THE BOTTOM STEEL FOR MECHANICAL ANCHORAGE
 - CAST-IN-PLACE CONC. MAY BE PROVIDED IN COMPOSITE LINTELS IN LIEU OF CMU
 - SAFE LOAD RATING BASED ON RATIONAL DESIGN ANALYSIS PER ACI 318 AND ACI 530 FLORIDA APPROVAL NUMBER 158.1
 - THE EXTERIOR SURFACE OF LINTELS INSTALLED IN EXTERIOR CONCRETE MASONRY WALLS SHALL HAVE A COATING OF STUCCO APPLIED IN ACCORDANCE WITH ASTM C-926 OR OTHER APPROVED COATING
 - LINTELS LOADED SIMULTANEOUSLY w/ VERTICAL (GRAVITY AND UPLIFT) AND HORIZONTAL (LATERAL) LOADS SHOULD BE FOR COMBINE LOADING WITH THE FOLLOWING EQUATIONS:

$$\frac{\text{APPLIED VERTICAL LOAD}}{\text{SAFE VERTICAL LOAD}} + \frac{\text{APPLIED HORIZONTAL LOAD}}{\text{SAFE HORIZONTAL LOAD}} \leq 1.0$$

- GENERAL MATERIAL NOTES:**
- f_c PRECAST LINTEL = 3500 P.S.I.
 - f_c PRESTRESSED LINTEL = 6000 P.S.I.
 - GROUTED PER ASTM C476 (f_c = 3000 P.S.I. w/ MAX 3/4" AGGREGATE AND 8" TO 11" SUMP
 - CMU PER ASTM C90 w/ MIN NET AREA COMPRESSION STRENGTH = 2000 P.S.I
 - REBAR PER ASTM A615 GRADE 60
 - 270 LOW RELAXATION 7/8" WIRE PER ASTM A510
 - MORTAR PER ASTM C270 TYPE M OR S
- GENERAL LINTEL NOTES:**
- AREAS OF BLOCK ABV. MASONRY OPENINGS ARE TO BE GROUTED SOLID TO THE BEAM.
 - 1-#5 REBAR IN TIE BEAM IS TO BE CONT. THROUGH OUT INCLUDING ABV. MASONRY OPENINGS. U.N.O.
 - ALL STANDARD LINTELS TO HAVE MIN. 4" BEARING EACH END BASED ON CAST CRETE, LOTTS, AND QUALITY LINTEL SPECS.
 - LINTEL MINIMUM DEPTHS ARE CALLED OUT ON LINTEL PLAN. IF CONTRACTOR INSTALLS A DEEPER LINTEL THAN INDICATED ON THE PLAN, DOING THIS INCREASES THE STRENGTH OF THE LINTEL AND IS APPROVED WITHOUT ENGINEERING LETTER. IF A SMALLER LINTEL IS INSTALLED CONTACT EOR FOR APPROVAL.
 - (*) ANY LINTEL DEEPER THAN 32" HAS BEEN VERIFIED TO WORK AS A MIN. 32" FOR THE LOAD CONDITIONS. ANY LINTEL GREATER THAN 32" HAS A GREATER CAPACITY AND THEREFORE IS ADEQUATE FOR THE LOADS.
 - G.C. TO VERIFY ALL LINTEL DIMENSIONS IN FIELD. DIMENSIONS SHOWN ARE CLEAR SPAN ONLY

WALL TYPE

SYMBOL	DESIGN DESCRIPTION
	2x INTERIOR BEARING SHEARWALL - SEE BEARING WALL SCHEDULE ON SHEET SN FOR REQUIREMENTS.
	INDICATES BEARING WALL SEE BEARING WOOD BEARING SCHEDULE ON SN
	MASONRY WALL TOP @ 9'-4"
	MASONRY WALL TOP @ 10'-8" ABV. GRADE
	MASONRY WALL TOP @ 10'-8" ABV. GRADE

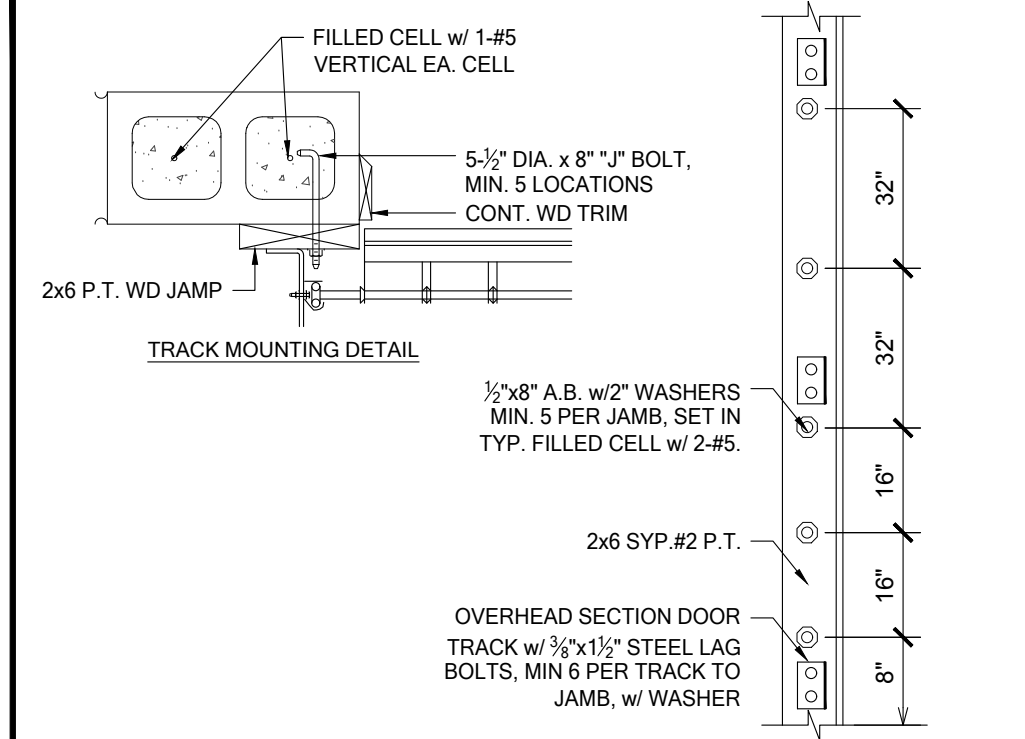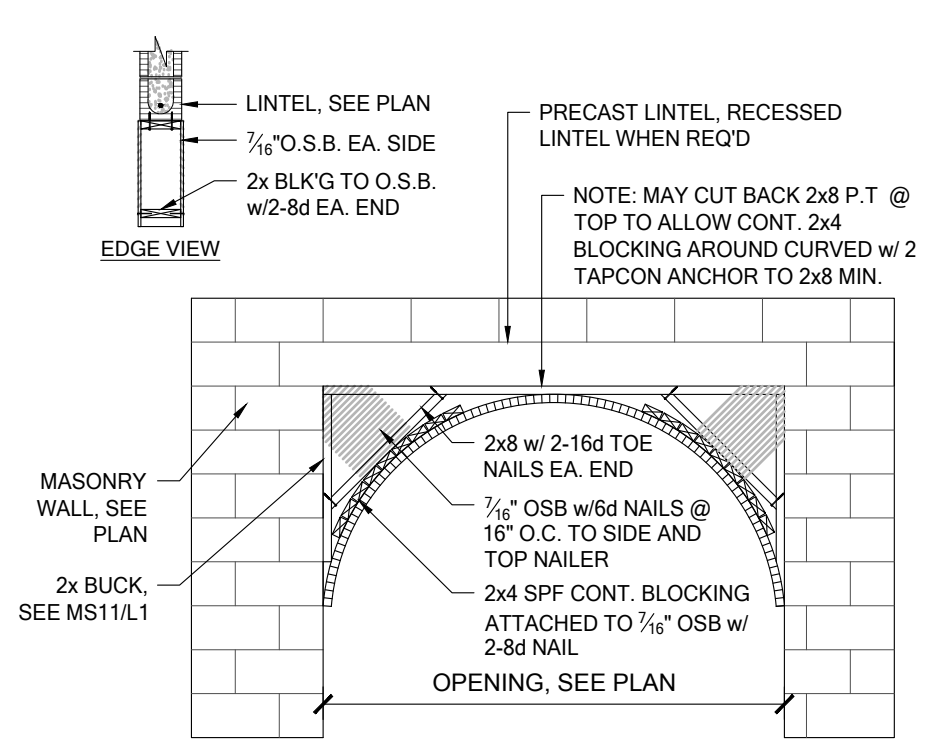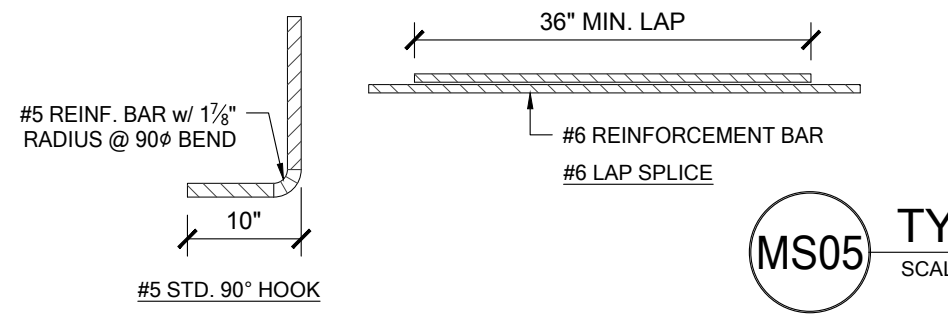
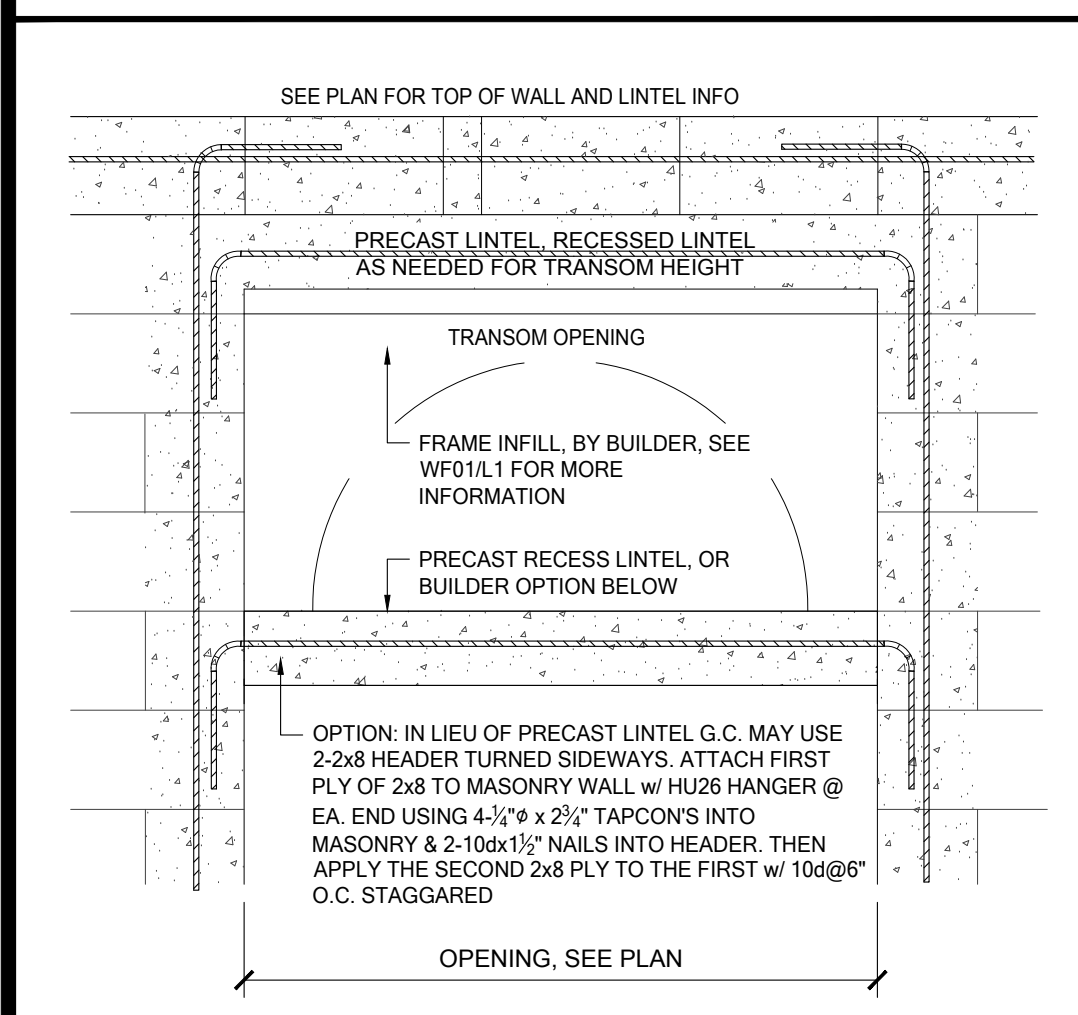


ATTACHMENT REQUIREMENTS

SIZE	TAPCONS	SPACING	# ROWS
2 x 4	3/16" X 3"	12" O.C.	1
2 x 6	3/16" X 3"	12" O.C.	2
2 x 8	3/16" X 3"	12" O.C.	2

NOTES:

- TAPCONS TO BE 6" FROM END
- FASTENING TO WINDOW TO BUCK RESPONSIBILITY OF WINDOW MANUFACTURER
- 1x BUCKS ARE NOT STRUCTURAL AND SHALL BE USED ONLY AS BLOCKING

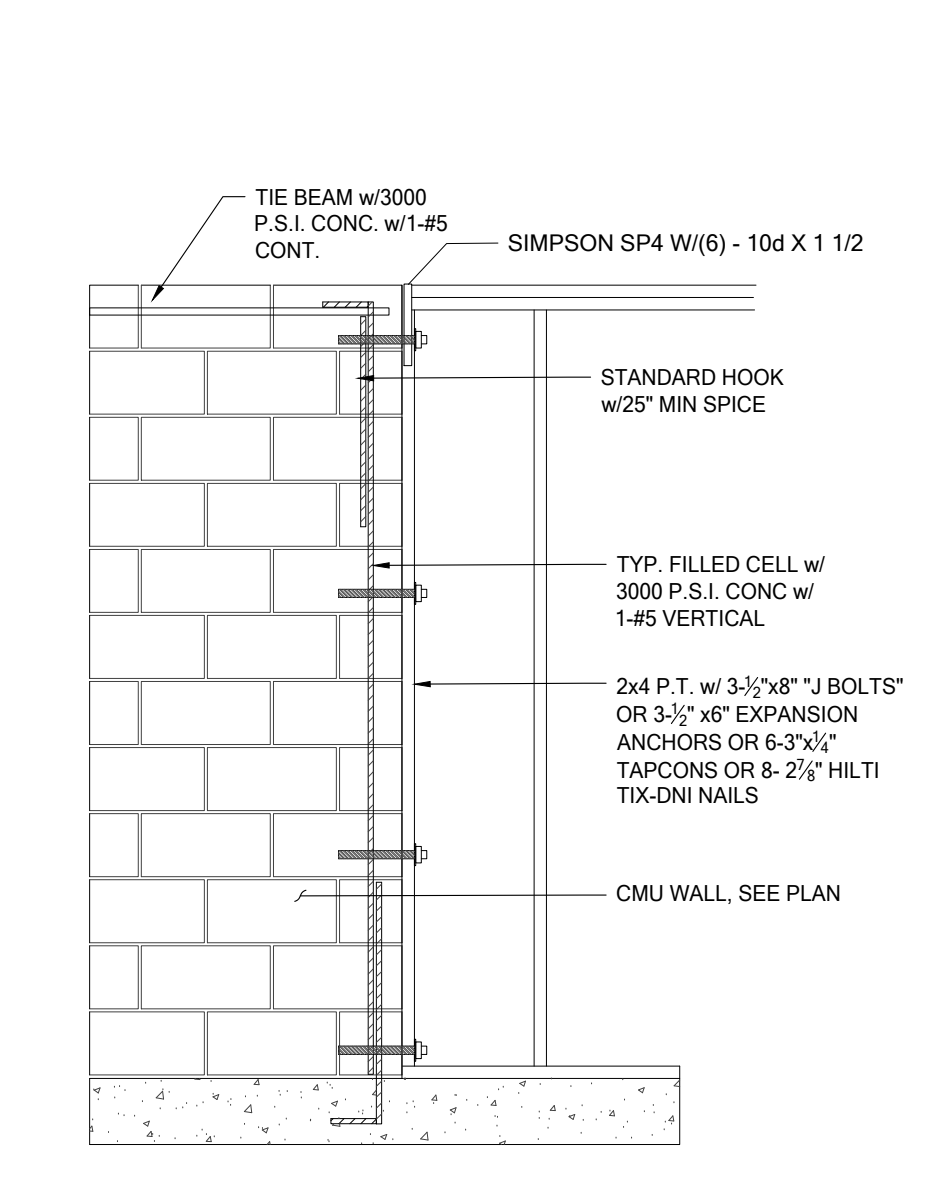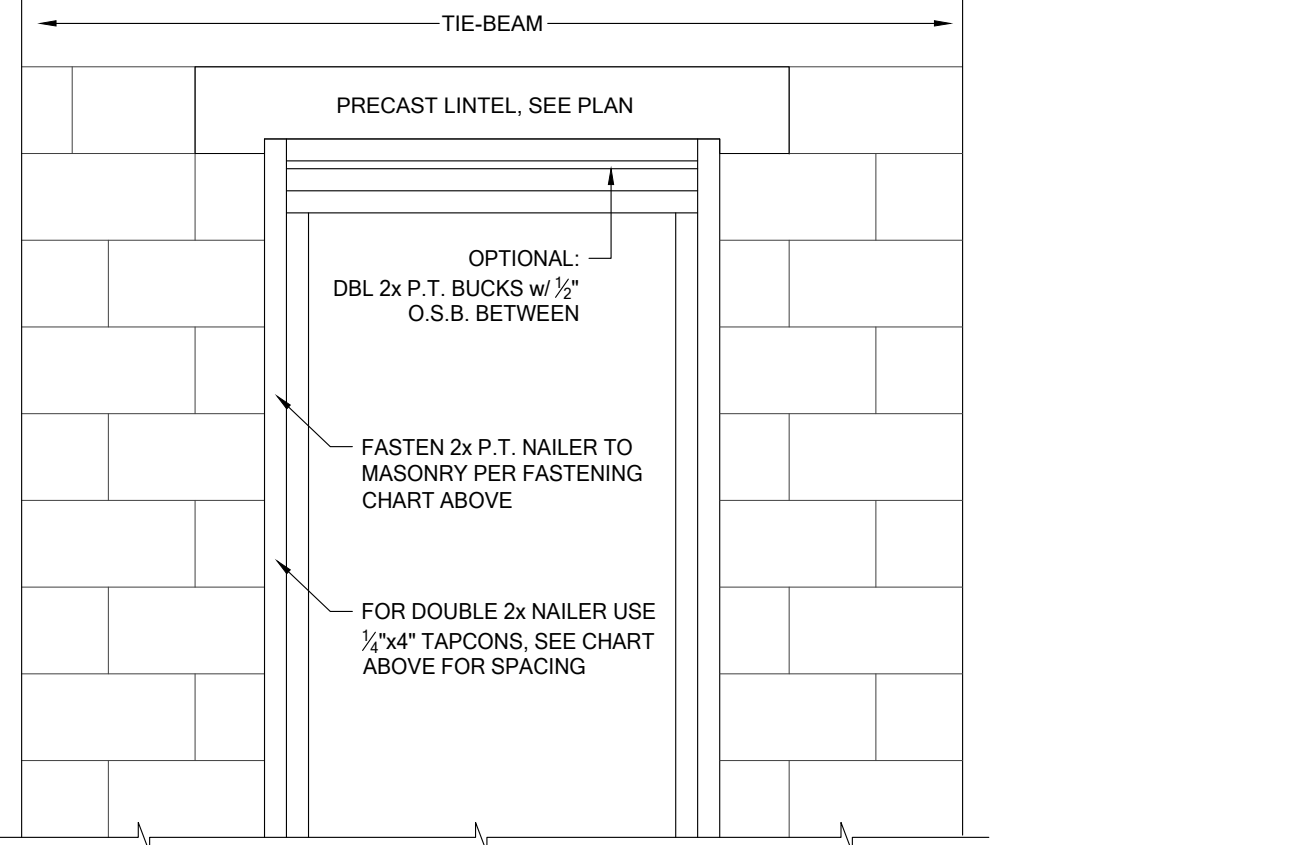

B&A Design Studio, Inc.

4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

A.I. BUILD AMERICAN BUILDING DESIGN

FDS


258 Southhall Lane, Suite 200, Maitland, FL 32751
C: 321-972-0491 F: 407-880-2304
Certificate of Authorization No. 9161
P.E. A. LEWIS/MSK, P.E. - FL #78759
DATE: January 26, 2023

PARK SQUARE HORIZONS WEST 4-UNIT - ADAMS END UNITS


project no. 2022142
checked: AB
drawn: AB
date: 05-17-22
scale:

L1


NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

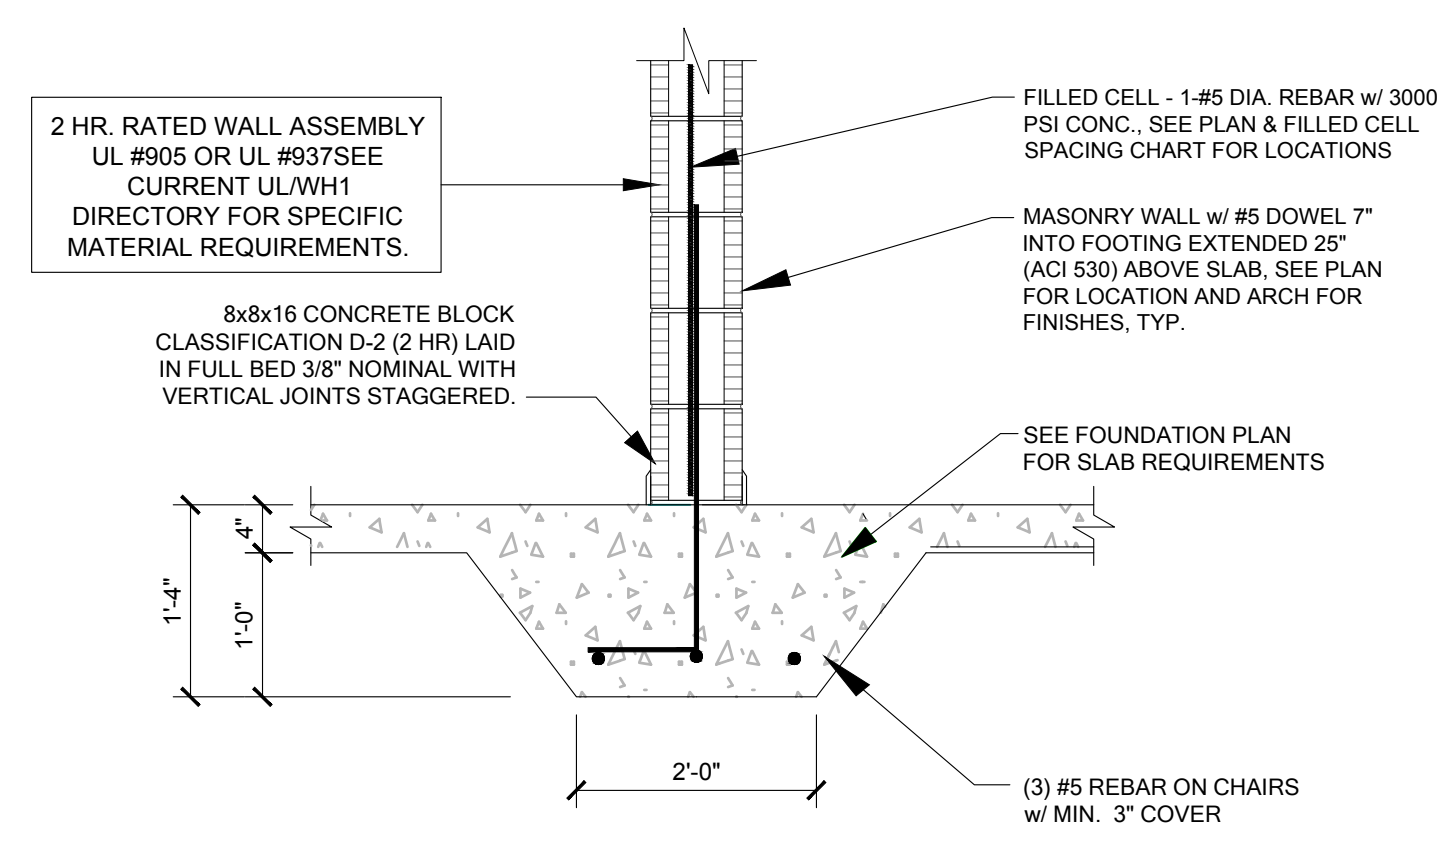

FM21 PARTY WALL FOOTING
SCALE: 3/4" = 1'-0"

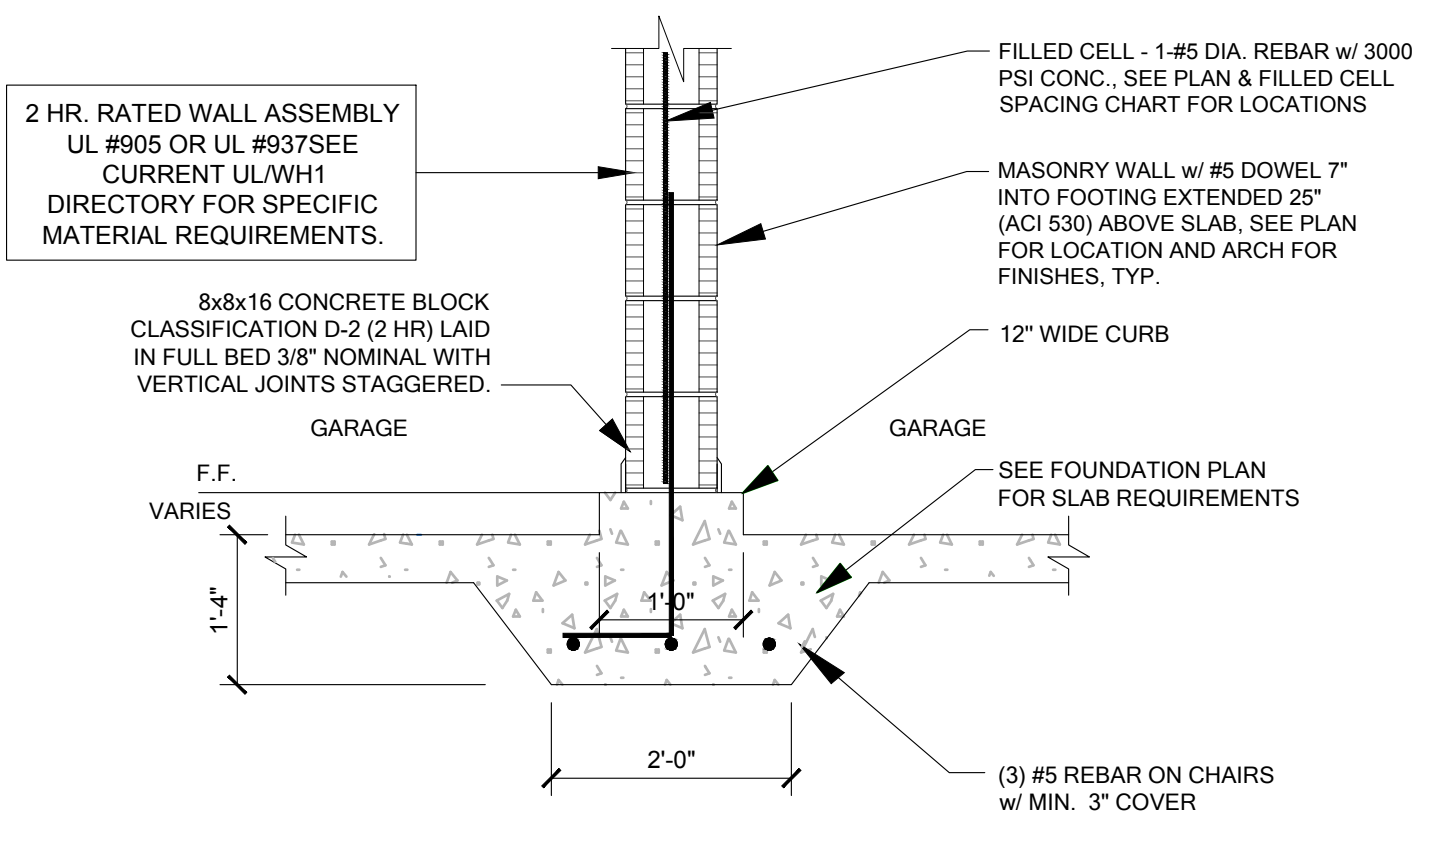

FM24 GARAGE PARTY WALL FOOTING
SCALE: 3/4" = 1'-0"

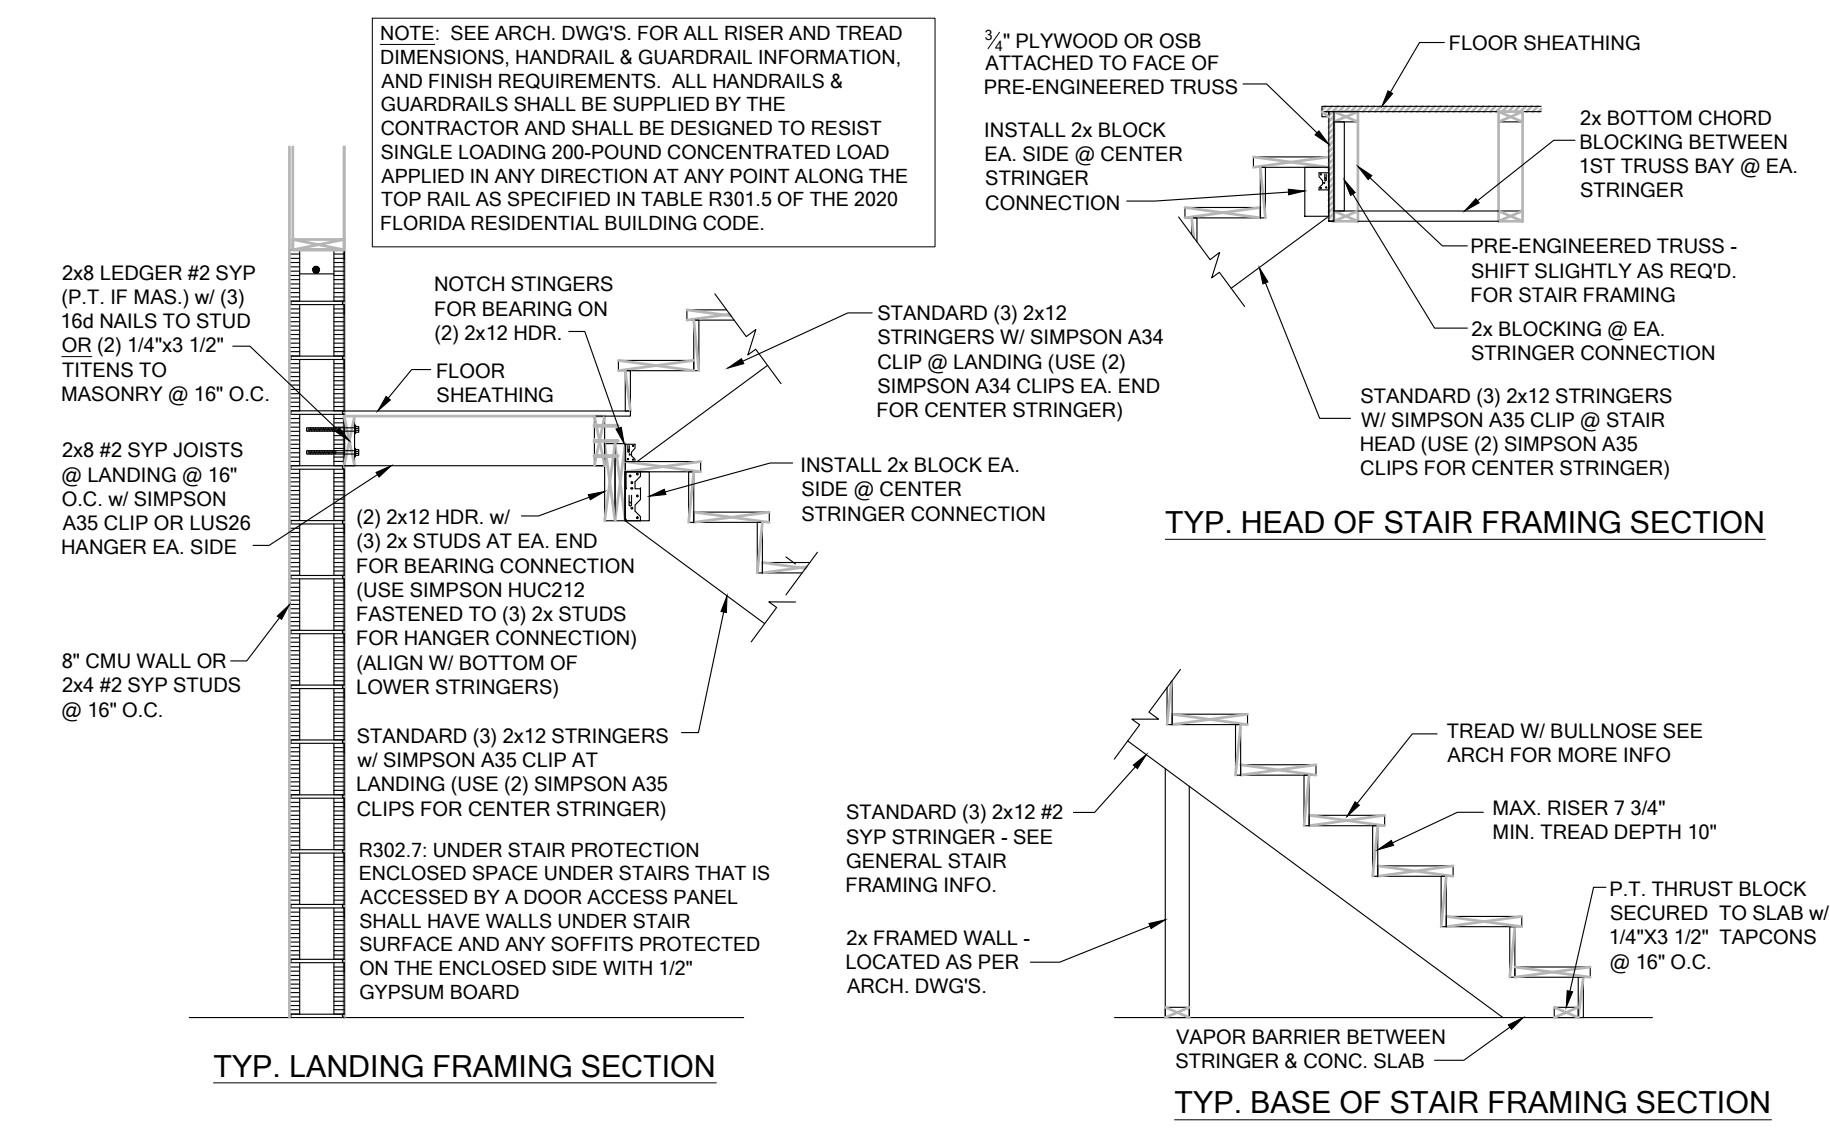

SD02 GENERAL STAIR SECTIONS & PLAN
SCALE: 3/4"=1'-0"

CAST CRETE OR QUALITY/ LOTTS LINTEL LOAD SPECIFICATIONS

SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENG.T.H	TYPE	8U8	SAFE LOAD - POUNDS PER LINEAR FOOT							
			8F8-0B	8F12-0B	8F16-0B	8F20-0B	8F24-0B	8F28-0B	8F32-0B	
2'-10" (34")	PRECAST	2231	3069	4605	6113	7547	8974	10394	11809	
3'-6" (42")	PRECAST	2231	3069	3719	5163	6607	8054	9502	10951	
4'-0" (48")	PRECAST	1966	2561	2751	3820	4890	5961	7034	8107	
4'-6" (54")	PRECAST	1599	1969	2110	2931	3753	4576	5400	6224	
5'-4" (64")	PRECAST	1217	1349	1438	1999	2560	3123	3686	4249	
5'-10" (70")	PRECAST	1062	1105	1173	1631	2090	2549	3009	3470	
6'-6" (78")	PRECAST	908	1238	2177	3480	3031	3707	4383	5061	
7'-6" (90")	PRECAST	743	1011	1729	2632	2205	2698	3191	3685	
9'-4" (112")	PRECAST	554	752	1245	1843	2564	3486	4705	6390	
10'-6" (126")	PRECAST	475	535	890	1247	2093	2777	3713	5036	
11'-4" (136")	PRECAST	362	422	706	1002	1326	1697	2316	3127	
12'-0" (144")	PRECAST	337	343	540	873	1254	1684	2193	2805	
13'-4" (160")	PRECAST	296	296	471	755	1075	1428	1838	2316	
14'-0" (168")	PRECAST	279	279	424	706	1002	1326	1697	2127	
14'-8" (176")	PRESTRESSED	N.R.	NR	NR	NR	NR	NR	NR	NR	
15'-4" (184")	PRESTRESSED	N.R.	458	783	1370	1902	2245	2517	2712	
17'-4" (208")	PRESTRESSED	N.R.	NR	NR	NR	NR	NR	NR	NR	
19'-4" (232")	PRESTRESSED	N.R.	300	548	950	1326	1609	1849	2047	
21'-4" (256")	PRESTRESSED	N.R.	NR	NR	NR	NR	NR	NR	NR	
22'-0" (264")	PRESTRESSED	N.R.	180	340	598	845	1114	1359	1468	
24'-0" (288")	PRESTRESSED	N.R.	NR	NR	NR	NR	NR	NR	NR	

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRA4 FIELD ADDED REBAR.

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENG.T.H	TYPE	SAFE LOAD - POUNDS PER LINEAR FOOT							
		8F8-1T	8F12-1T	8F16-1T	8F20-1T	8F24-1T	8F28-1T	8F32-1T	
2'-10" (34")	PRECAST	1972	3173	4460	5747	7034	8321	9608	
3'-6" (42")	PRECAST	1569	2524	3547	4569	5591	6613	7636	
4'-0" (48")	PRECAST	1363	2192	3079	3966	4853	5740	6627	
4'-6" (54")	PRECAST	1207	1940	2724	3508	4292	5077	5861	
5'-4" (64")	PRECAST	1016	1632	2290	2949	3607	4265	4924	
5'-10" (70")	PRECAST	929	1492	2093	2694	3295	3897	4498	
6'-6" (78")	PRECAST	835	1340	1880	2419	2959	3498	4038	
7'-6" (90")	PRECAST	727	1166	1634	2102	2571	3039	3508	
9'-4" (112")	PRECAST	591	851	1133	1471	1811	2152	2494	
10'-6" (126")	PRECAST	530	686	914	1185	1458	1732	2007	
11'-4" (136")	PRECAST	474	485	798	1034	1272	1510	1749	
12'-0" (144")	PRECAST	441	441	723	936	1151	1366	1582	
13'-4" (160")	PRECAST	418	373	606	783	962	1141	1321	
14'-0" (168")	PRECAST	384	346	559	723	887	1052	1218	
14'-8" (176")	PRESTRESSED	246	390	655	968	1324	1625	1874	
15'-4" (184")	PRESTRESSED	224	302	485	626	767	909	1052	
17'-4" (208")	PRESTRESSED	187	255	404	520	637	754	872	
19'-4" (232")	PRESTRESSED	162	222	347	446	546	646	746	
21'-4" (256")	PRESTRESSED	142	198	306	393	480	567	654	
22'-0" (264")	PRESTRESSED	137	192	295	378	461	545	629	
24'-0" (288")	PRESTRESSED	124	175	267	341	416	491	566	

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRA4 FIELD ADDED REBAR.

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

A.I. BUILD AMERICAN BUILDING DESIGN


FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
O: 321-972-0491 F: 407-880-2304
Certificate of Authorization No. 9161
SCOTT LEWICKSKI, P.E. #72759
DATE: January 26, 2023

**PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS**


project no. 2022142
checked:
drawn: AB
date: 05-17-22
scale:

L2


NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

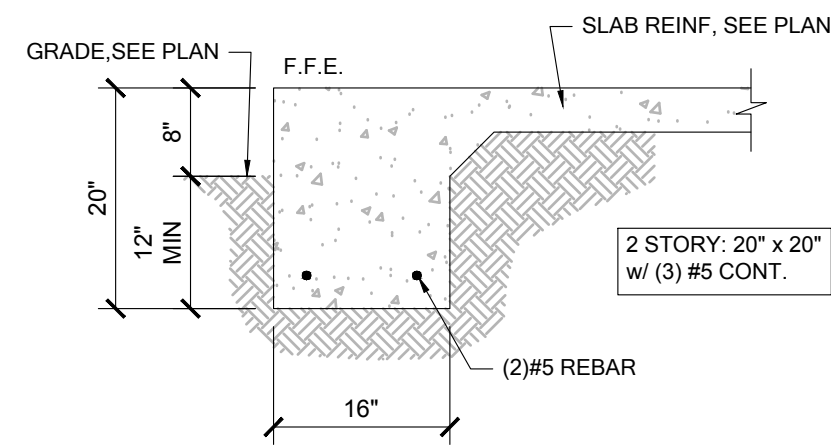


FM01 SINGLE STORY FTG
SCALE: 3/4" = 1'-0"

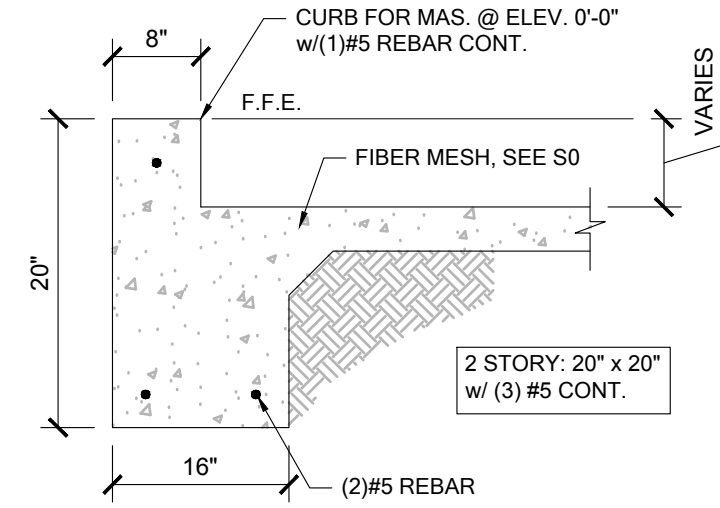


FM02 SECTION @ GARAGE
SCALE: 3/4" = 1'-0"

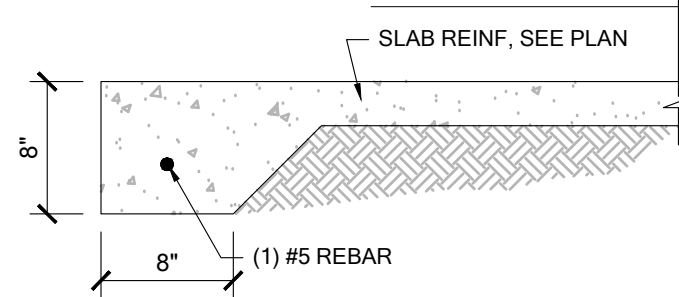


FM03 THICKENED EDGE
SCALE: 3/4" = 1'-0"

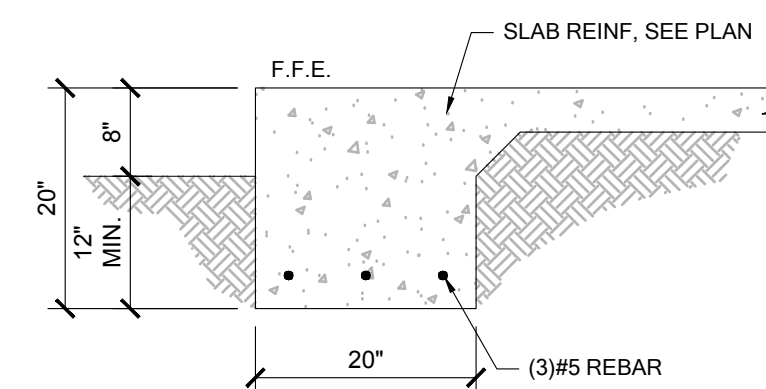


FM08 2-STORY FOOTING
SCALE: 3/4" = 1'-0"

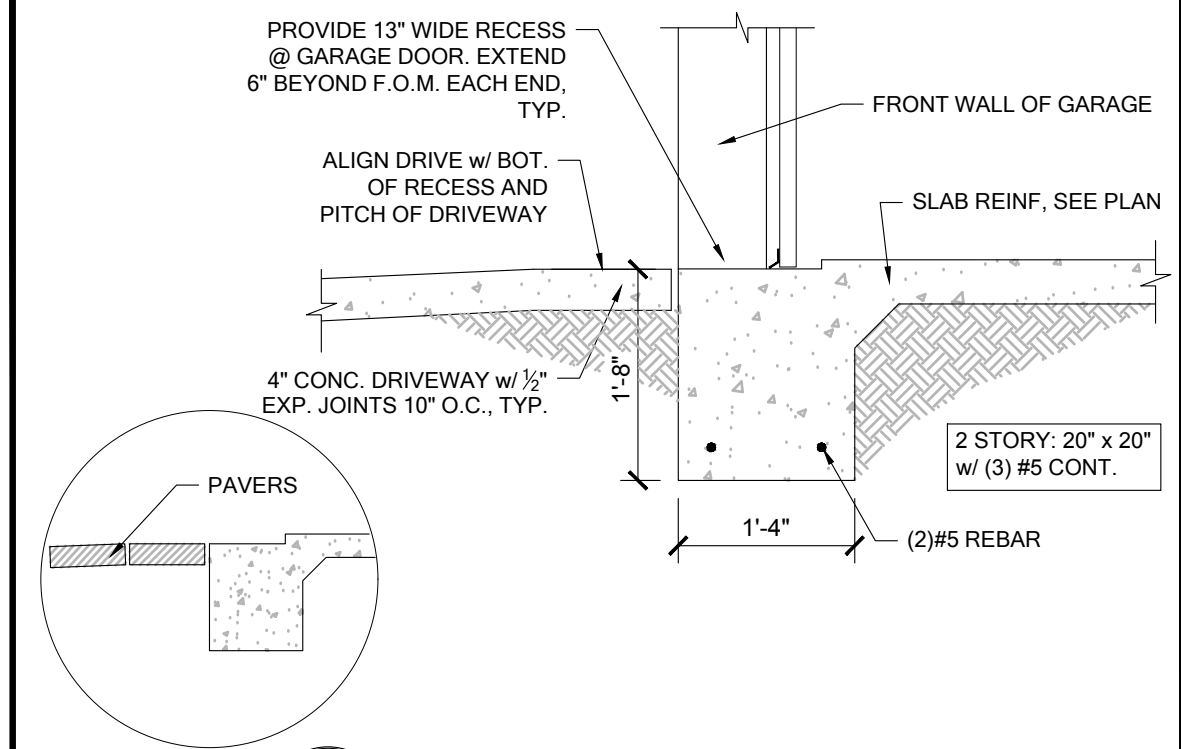


FM09 SECTION @ GARAGE DOOR
SCALE: 3/4" = 1'-0"

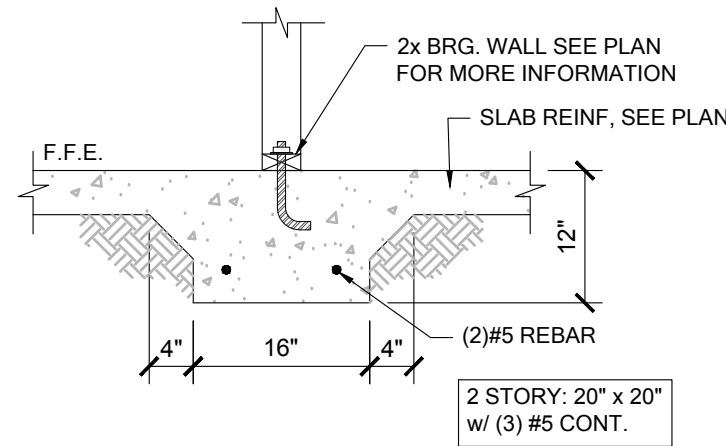


FM10 INTERIOR BEARING WALL
SCALE: 3/4" = 1'-0"

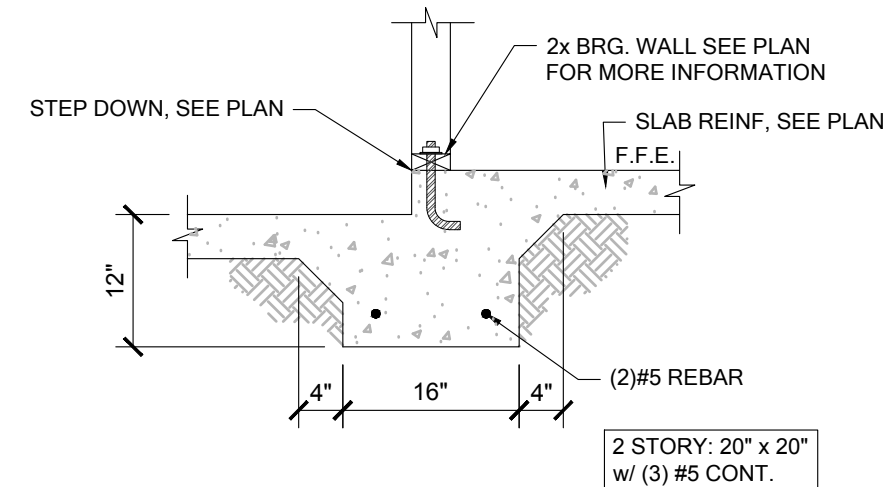


FM11 STEP DOWN BEARING
SCALE: 3/4" = 1'-0"

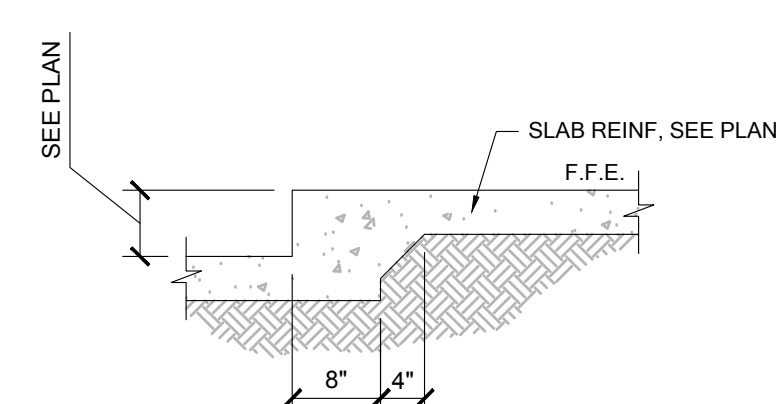


FM12 STEP DOWN NON-BEARING
SCALE: 3/4" = 1'-0"

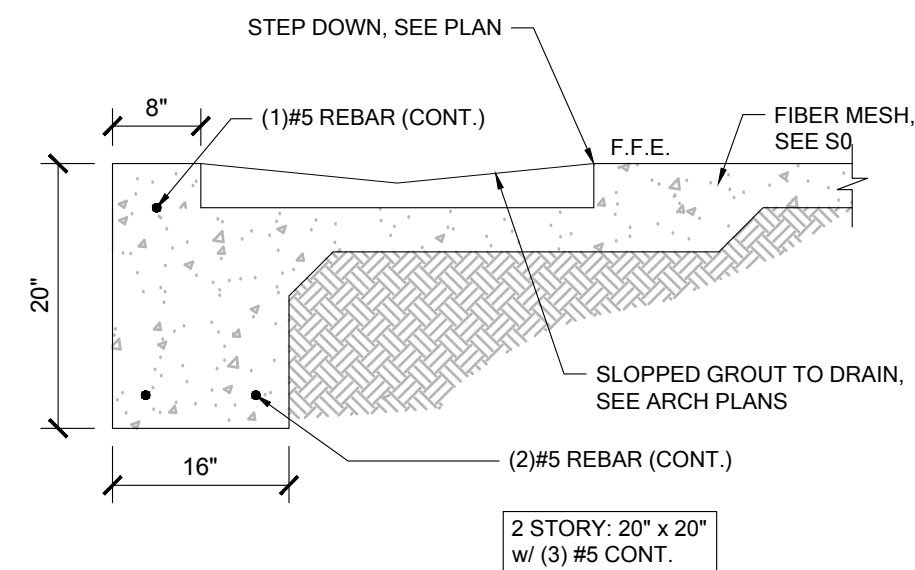


FM14 SECTION @ SHOWER
SCALE: 3/4" = 1'-0"

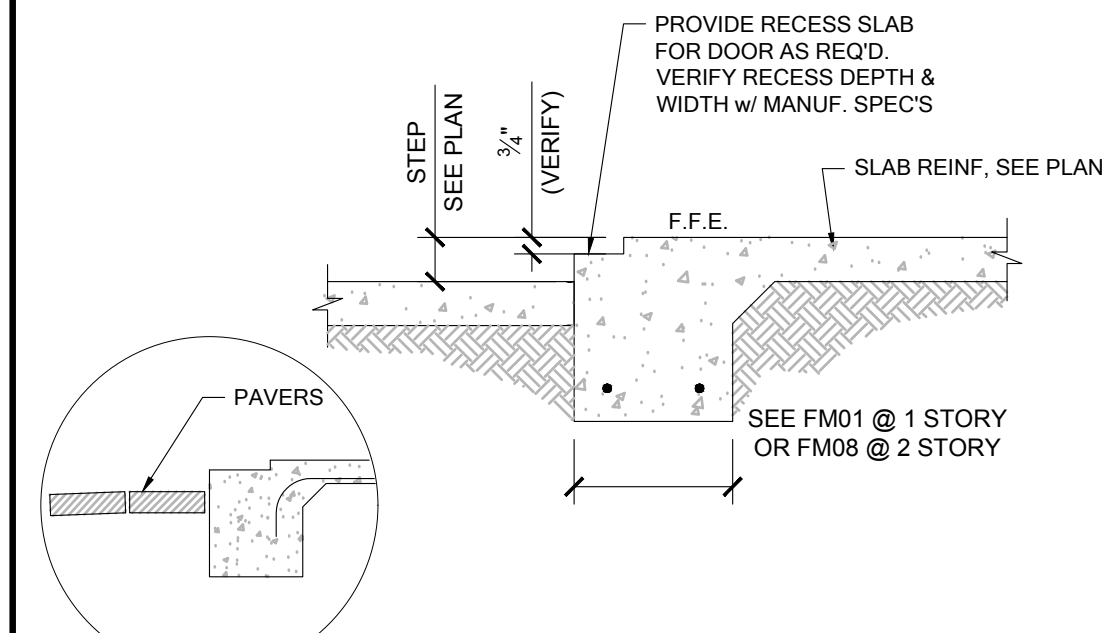


FM15 EXTERIOR BEARING @ RECESS
SCALE: 3/4" = 1'-0"

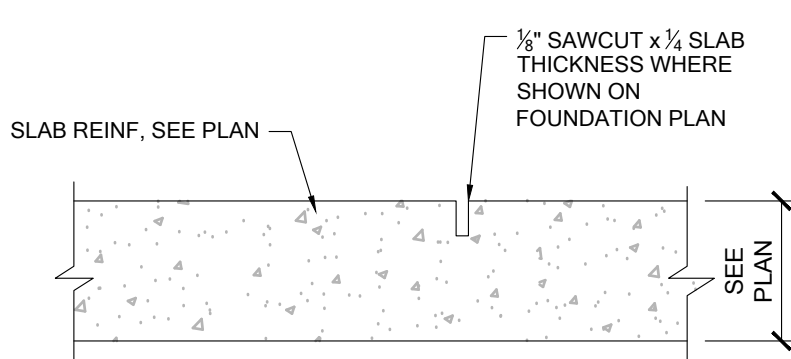


FM20 CONTROL JOINT
SCALE: 3/4" = 1'-0"

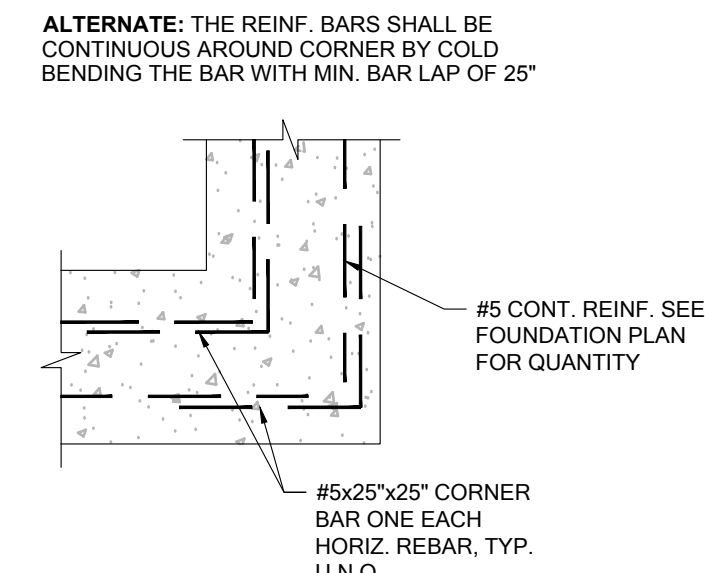


FM19 TYP. CORNER BAR DETAIL
SCALE: 3/4" = 1'-0"

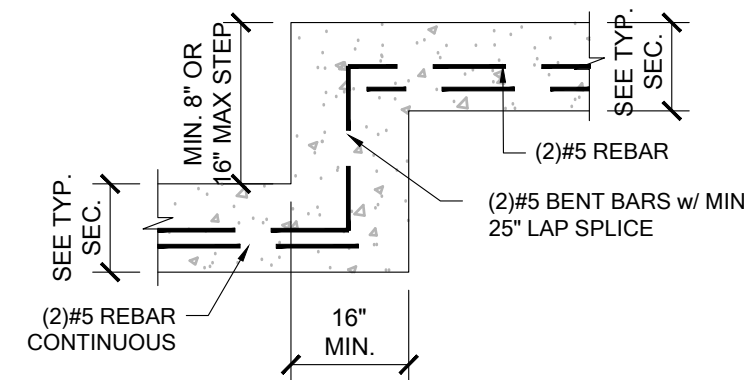

FM18 TYP. STEP FOOTING DETAIL
SCALE: 3/4" = 1'-0"

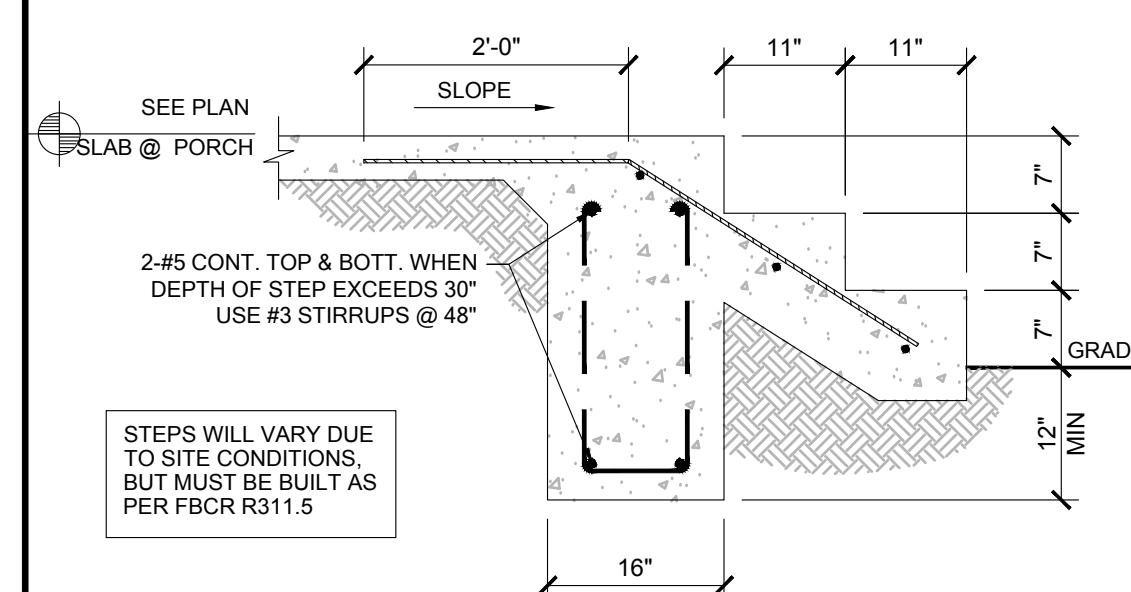


FM22 PORCH STEP
SCALE: 3/4" = 1'-0"

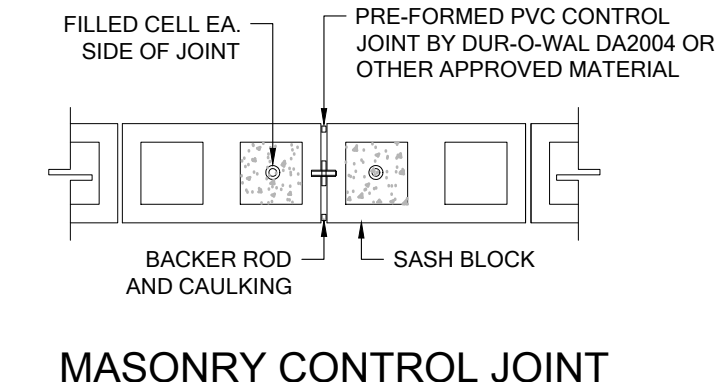


MASONRY CONTROL JOINT


SITE WALL SCHEDULE				
SITE WALL HEIGHT (ft)	FOOTING SIZE		NUMBER/SIZE OF BARS	MAXIMUM DOWEL SPACING
	WIDTH	DEPTH		
0'-0" - 2'-8"	2'-0"	1'-0"	w/ (3) #5 CONT.	#5 @ 72" O.C.
>2'-8" - 5'-0"	3'-0"	1'-0"	w/ (3) #5 CONT.	#5 @ 48" O.C.
>5'-0" - 7'-0"	3'-4"	1'-0"	w/ (5) #5 CONT.	#5 @ 24" O.C.
>7'-0" - 8'-0"	4'-0"	1'-4"	w/ (5) #5 CONT. & #5 @ 32" O.C. TRANSV.	#6 @ 24" O.C.

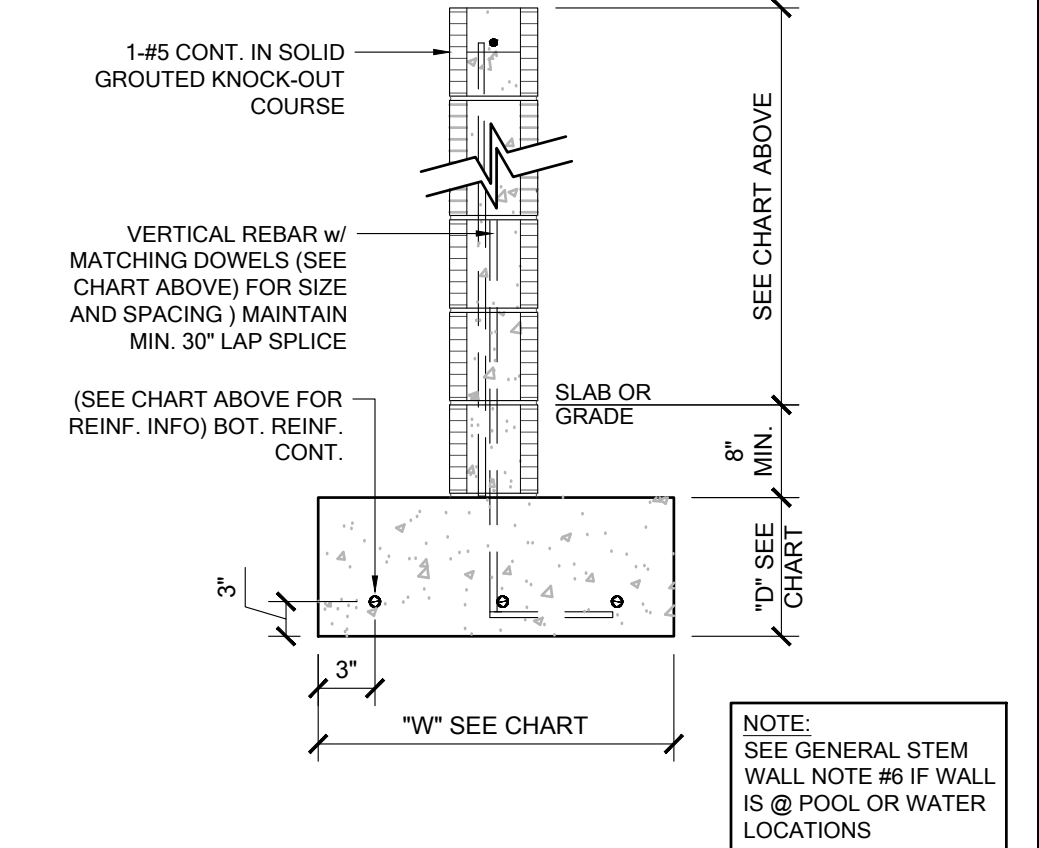

FM15 EXTERIOR BEARING @ RECESS
SCALE: 3/4" = 1'-0"

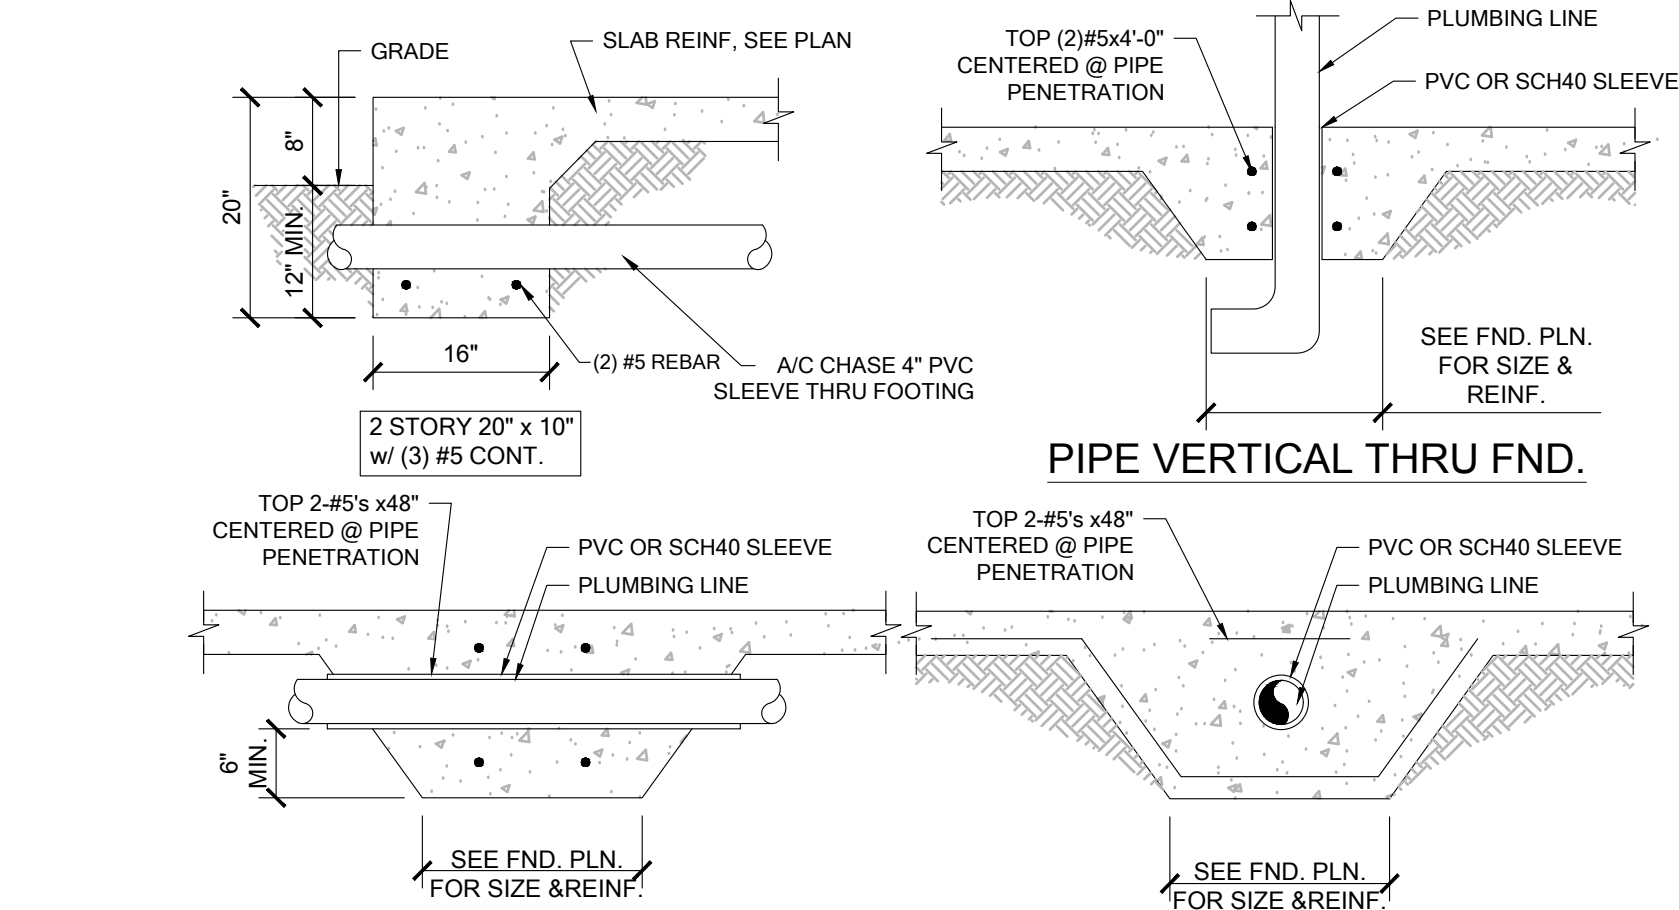

FM23 FOUNDATION PENETRATIONS, TYPICAL
SCALE: 3/4" = 1'-0"

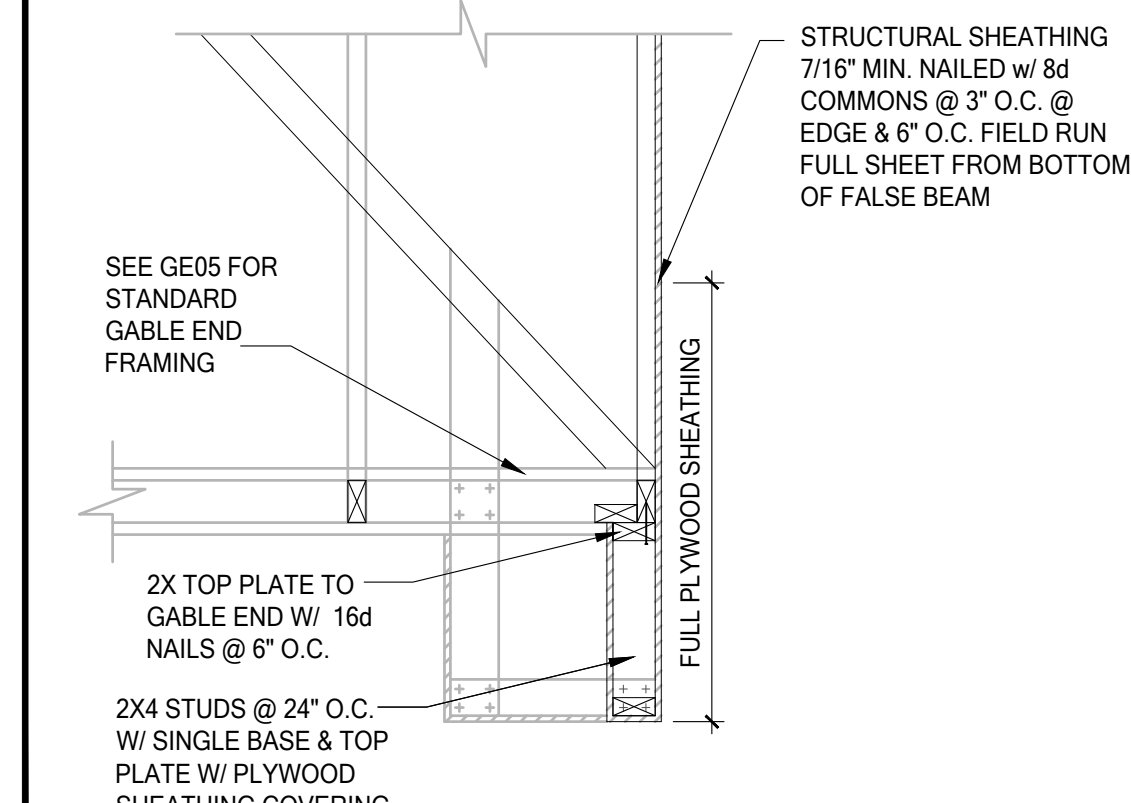

GE15 FALSE BEAM @ GABLE END
SCALE: 3/4" = 1'-0"

- CONTROL JOINTS TO BE LOCATED AT 20' O.C. MAX AND @ ALL CHANGES IN WALL WIDTHS.
- G.C TO COORDINATE ALL UTILITIES IN EASEMENT

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

A.I. BUILDING DESIGN
AMERICAN BUILDING DESIGN


FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
C-321-972-0491 F-407-880-2304
Certificate of Authorization No. 9161
SCOTT LEWIS/PE-FL-#79759
DATE: January 26, 2023
FOR THE BEST OF THE FUTURE PLEASE PRINT AND USE ENVIRONMENTAL INK. PRINTED ON RECYCLED PAPER WITH 10% POST CONSUMER WASTE. PLEASE RECYCLE.

**PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS**


title:
project no. 2022142
checked:
drawn: AB
date: 05-17-22
scale:

D1


NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

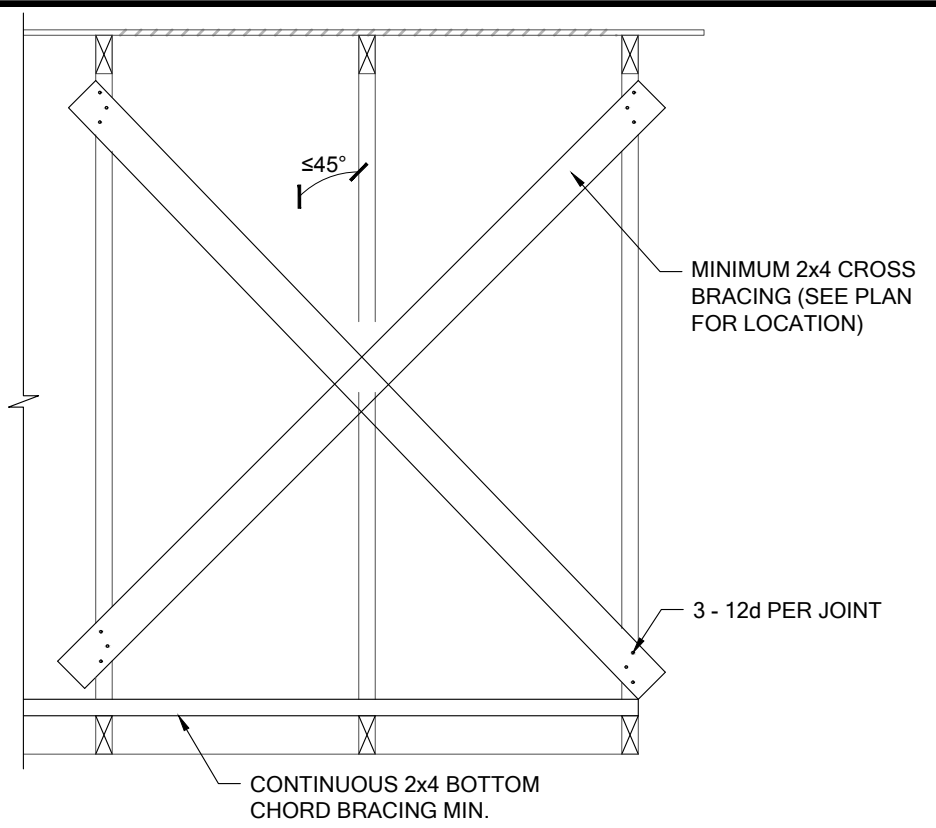


TB01 CROSS BRACING, TYP.
SCALE: 3/4" = 1'-0"

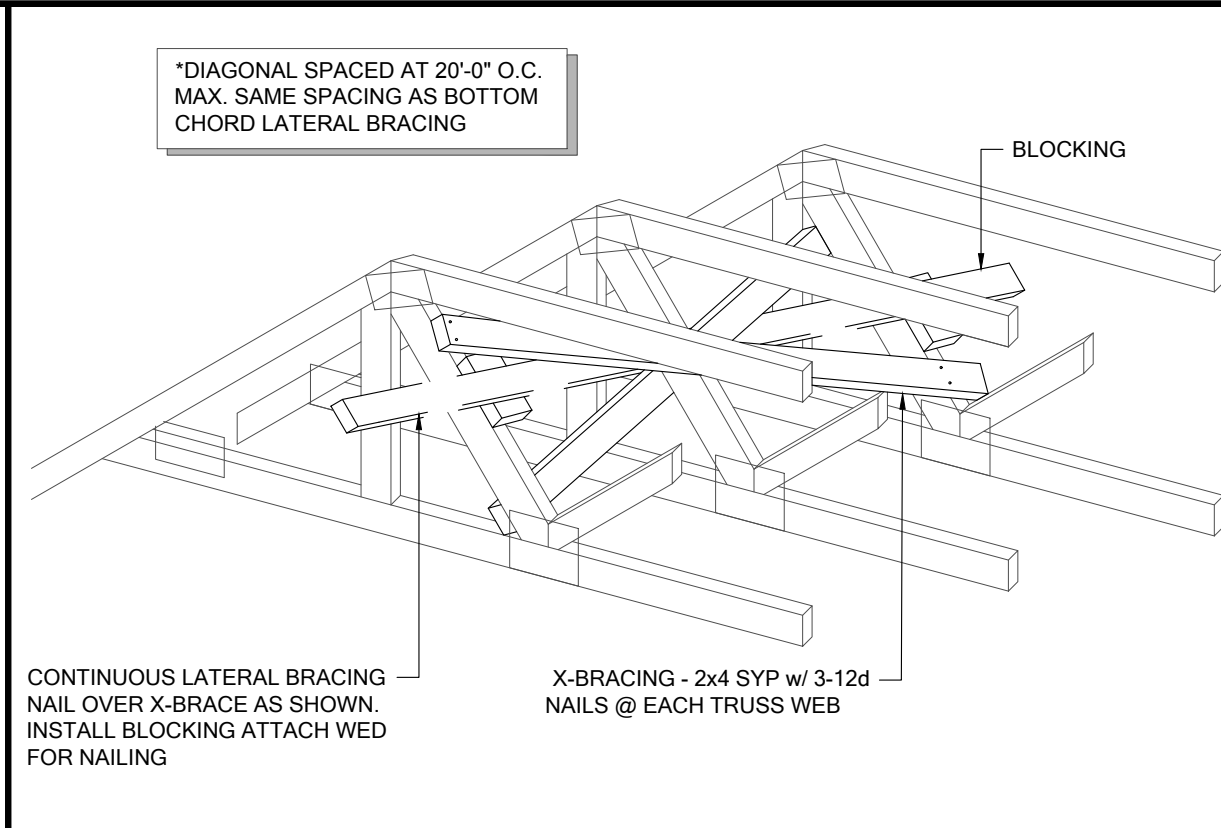


TB02 CROSS BRACING TYPICAL
SCALE: N.T.S.

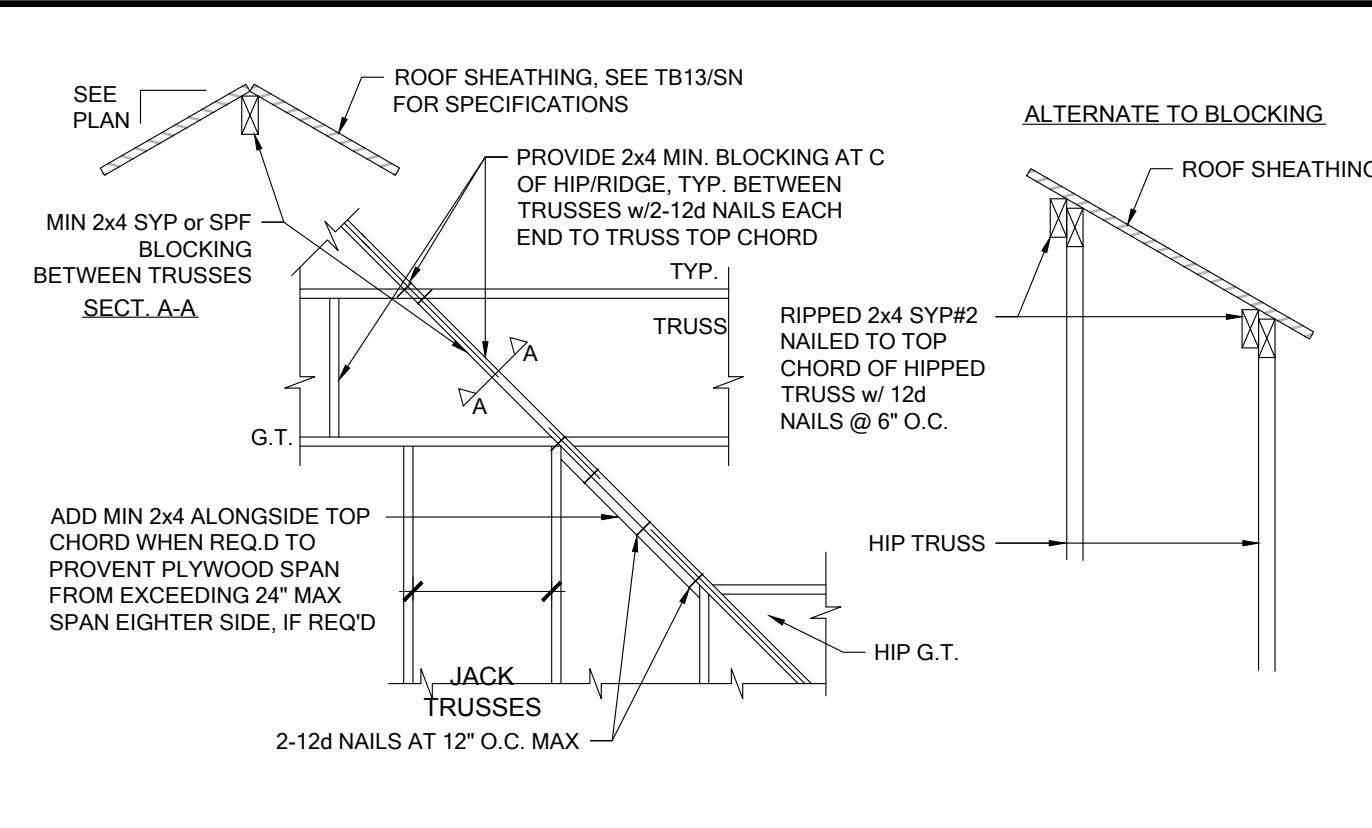


TB03 HIP/RIDGE BLOCKING
SCALE: 3/4" = 1'-0"

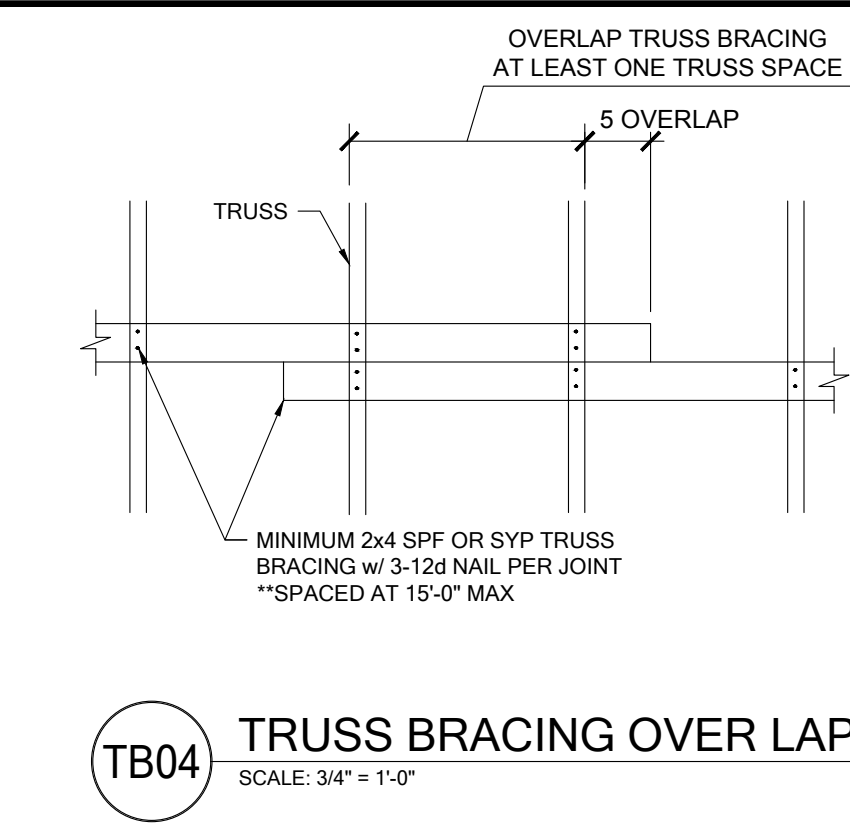


TB04 TRUSS BRACING OVER LAP
SCALE: 3/4" = 1'-0"

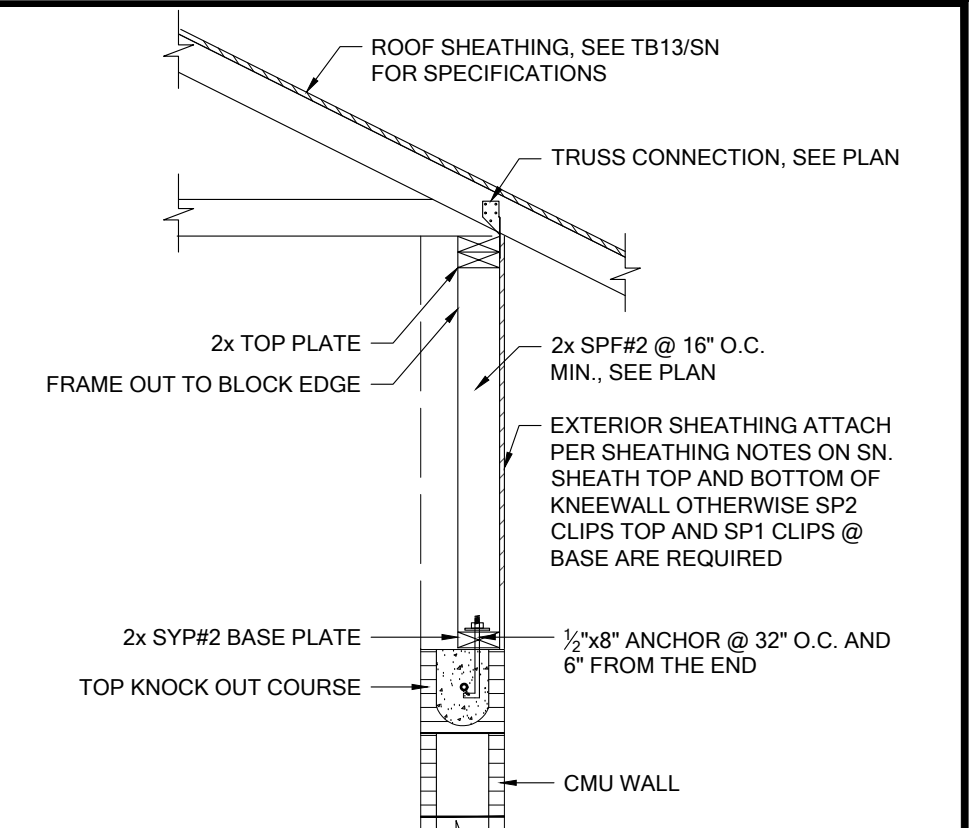


WF21 KNEE WALL @ ENTRY (OPTION)
SCALE: 3/4" = 1'-0"

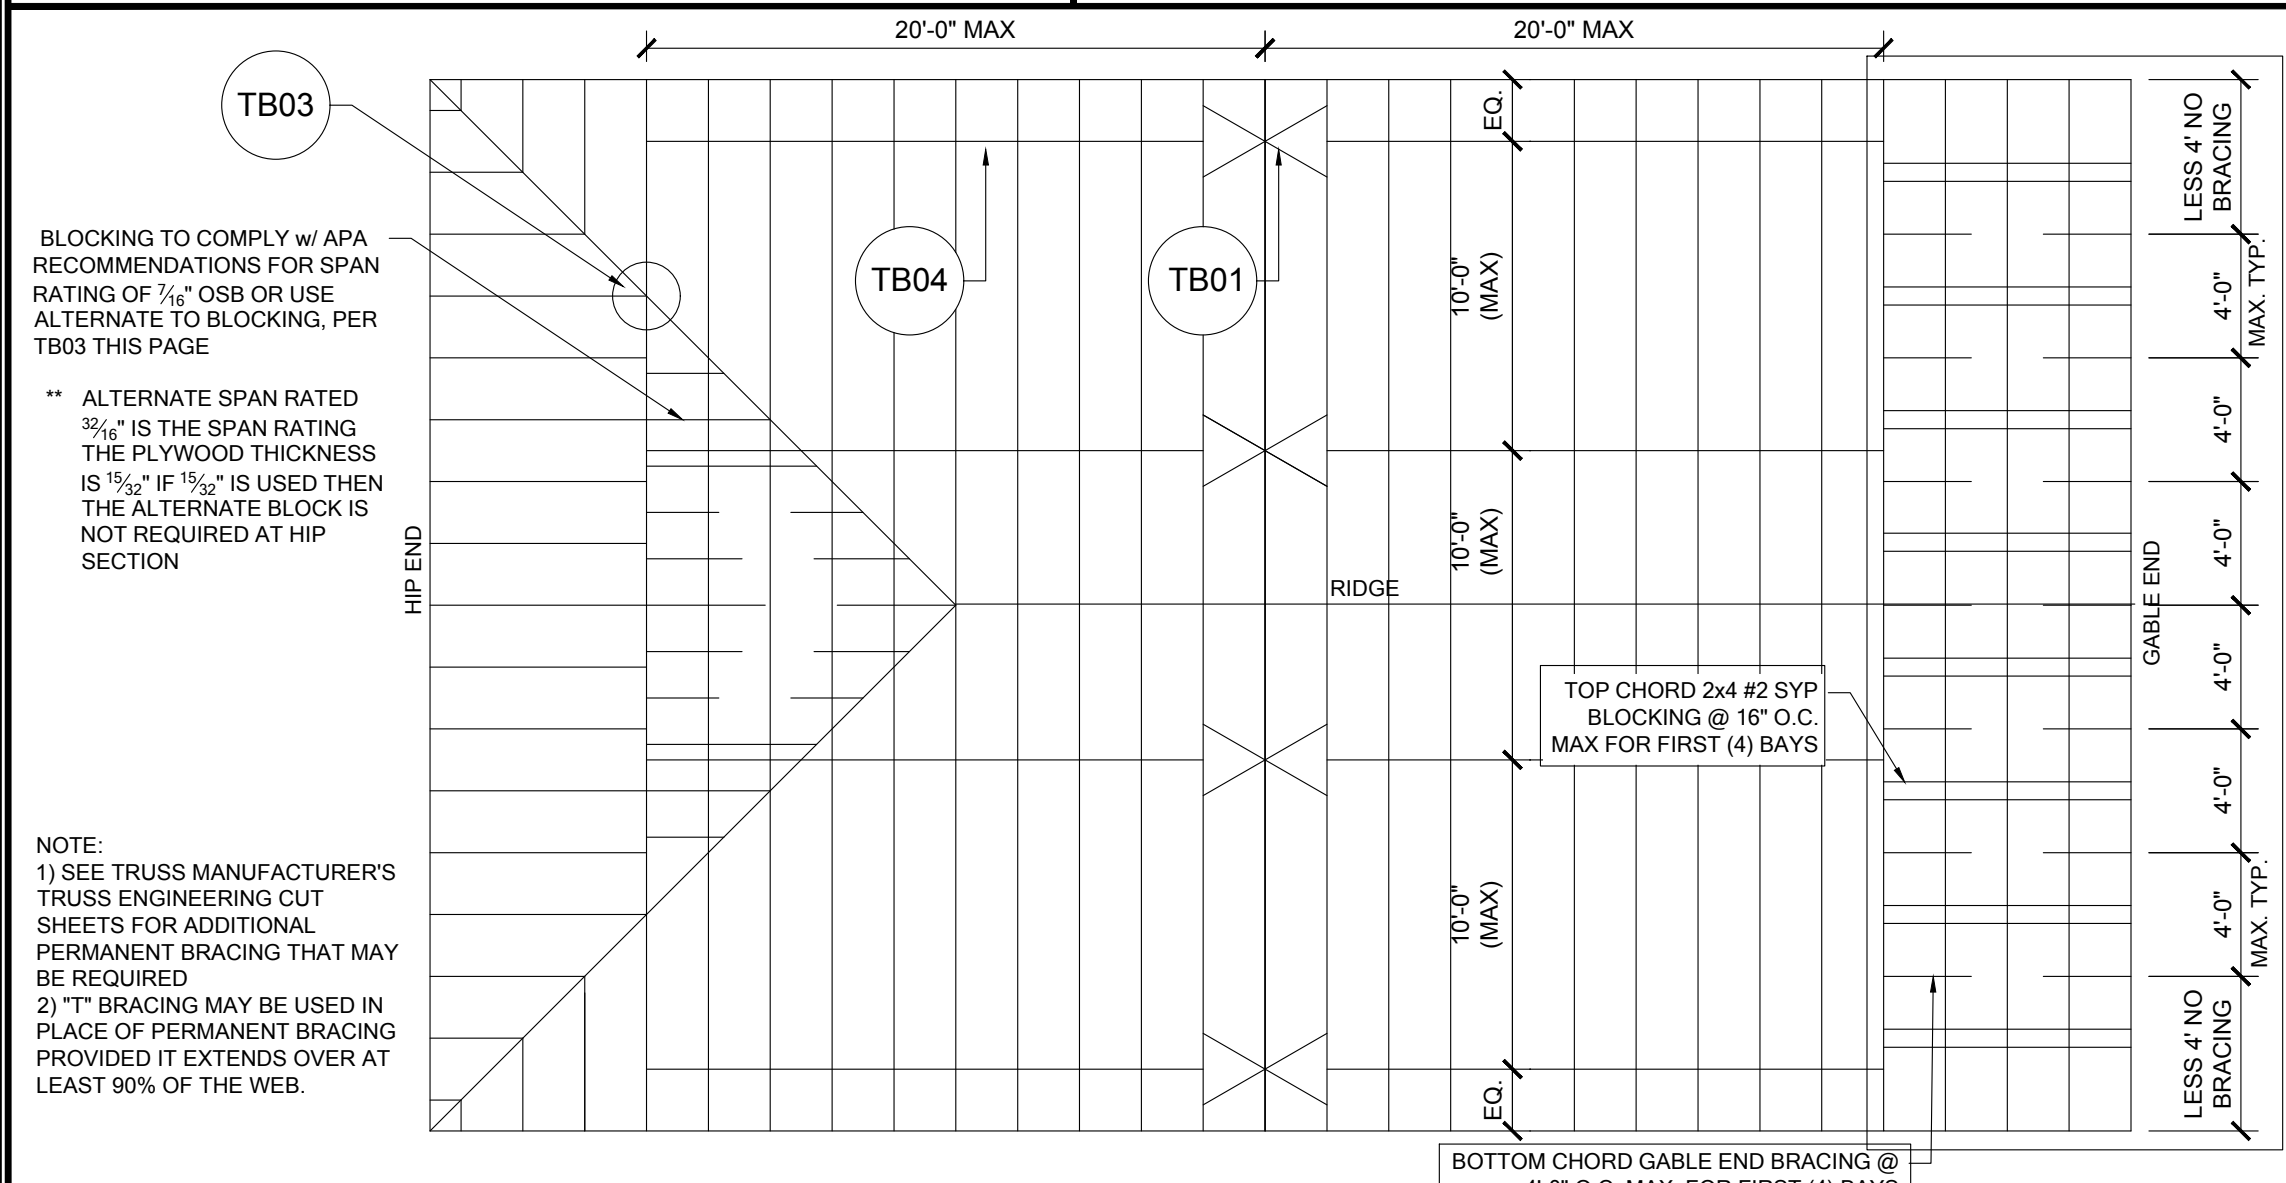


TB03 REQUIRED MIN. PERMANENT TRUSS BRACING PLAN
SCALE: N.T.S.

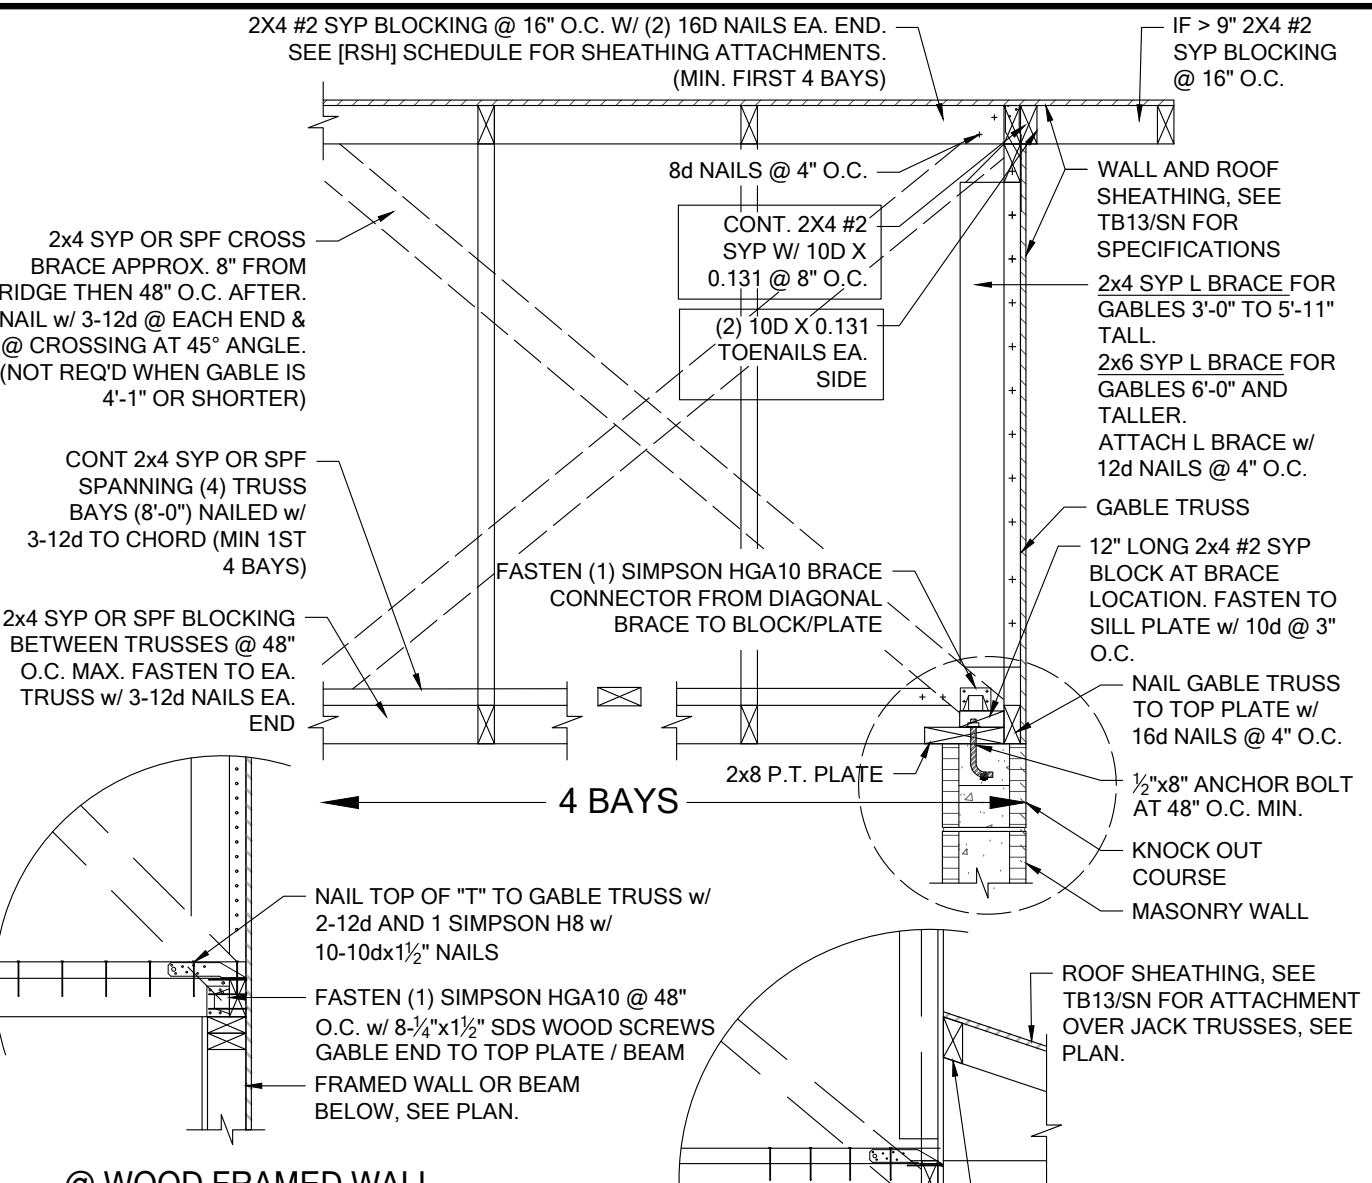


GE01 GABLE END BRACE
SCALE: 3/4" = 1'-0"

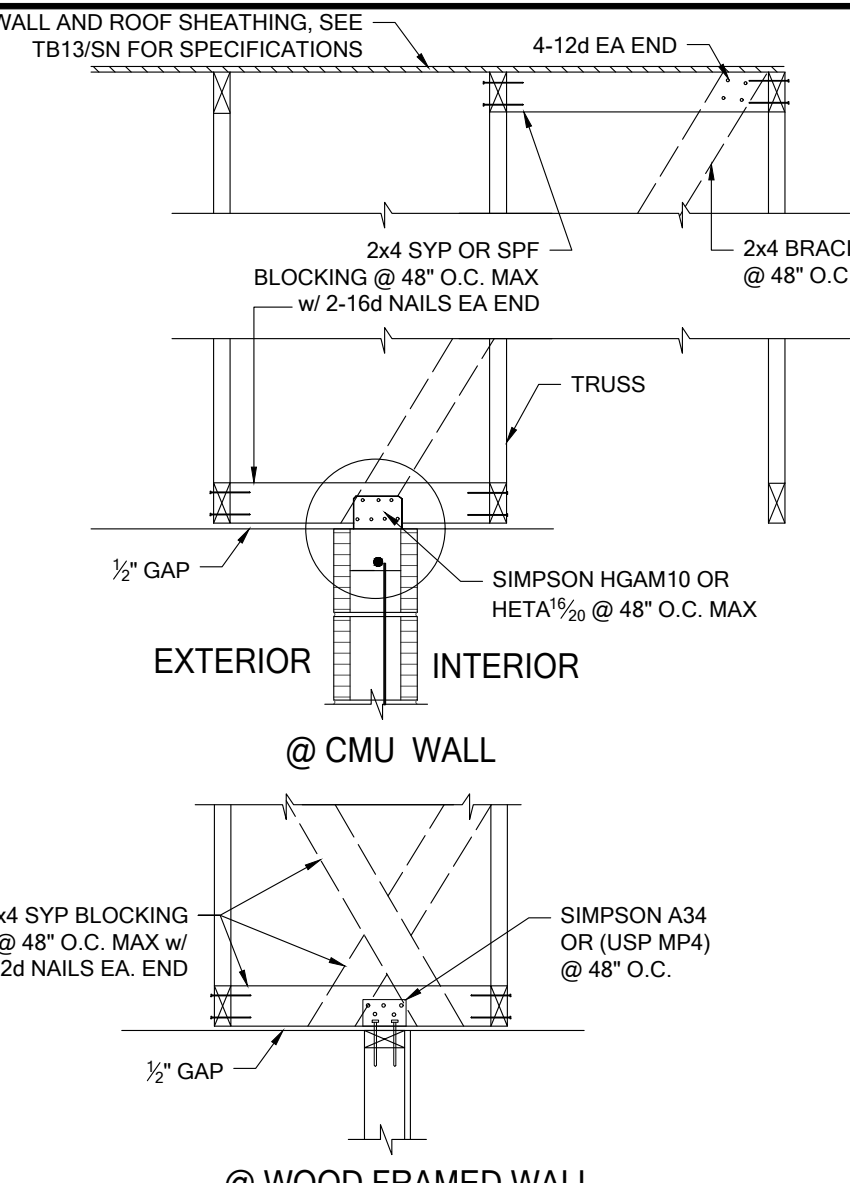


TB14 NON-BEARING EXTERIOR WALL
SCALE: 3/4" = 1'-0"

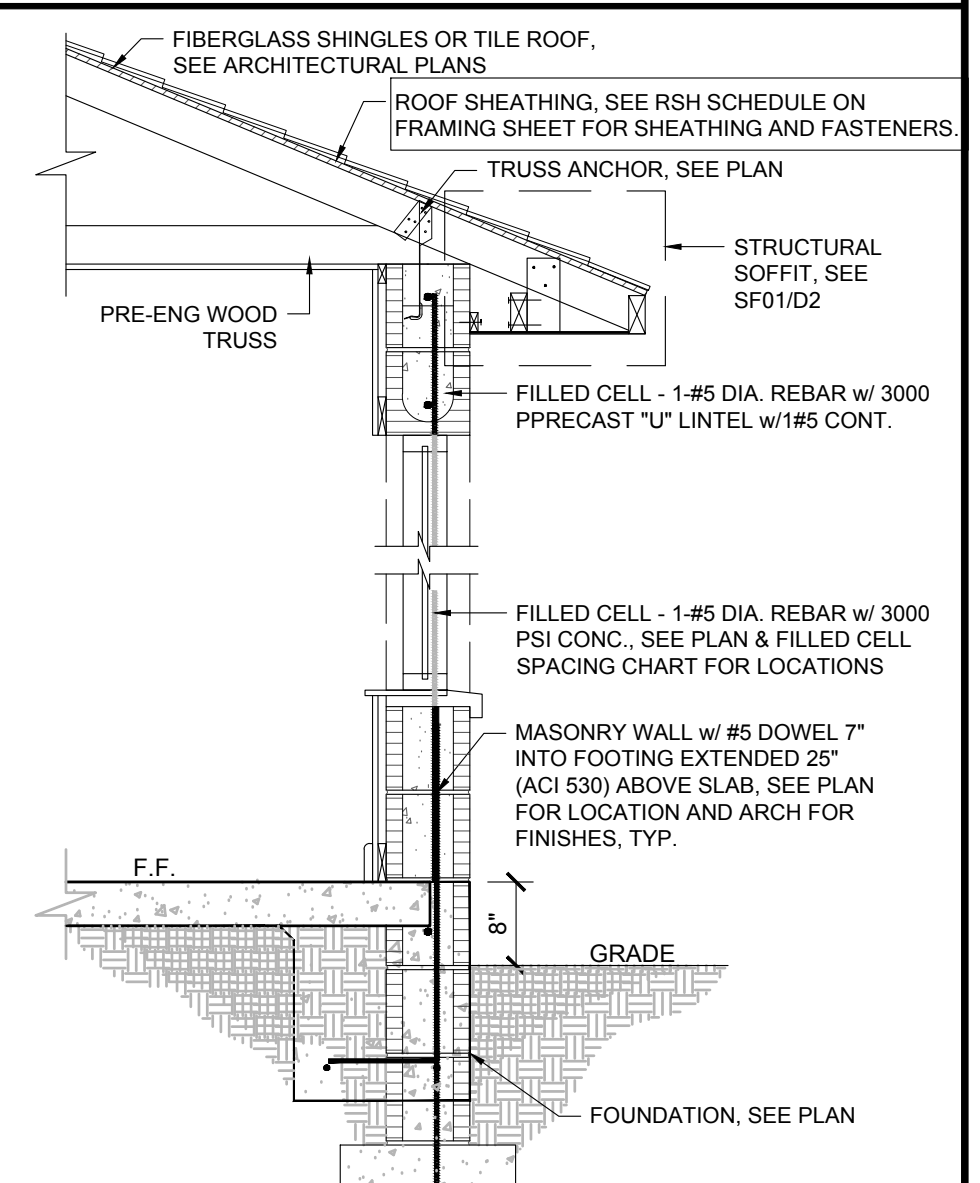


WS01 1-STORY WALL SECTION
SCALE: 3/4" = 1'-0"

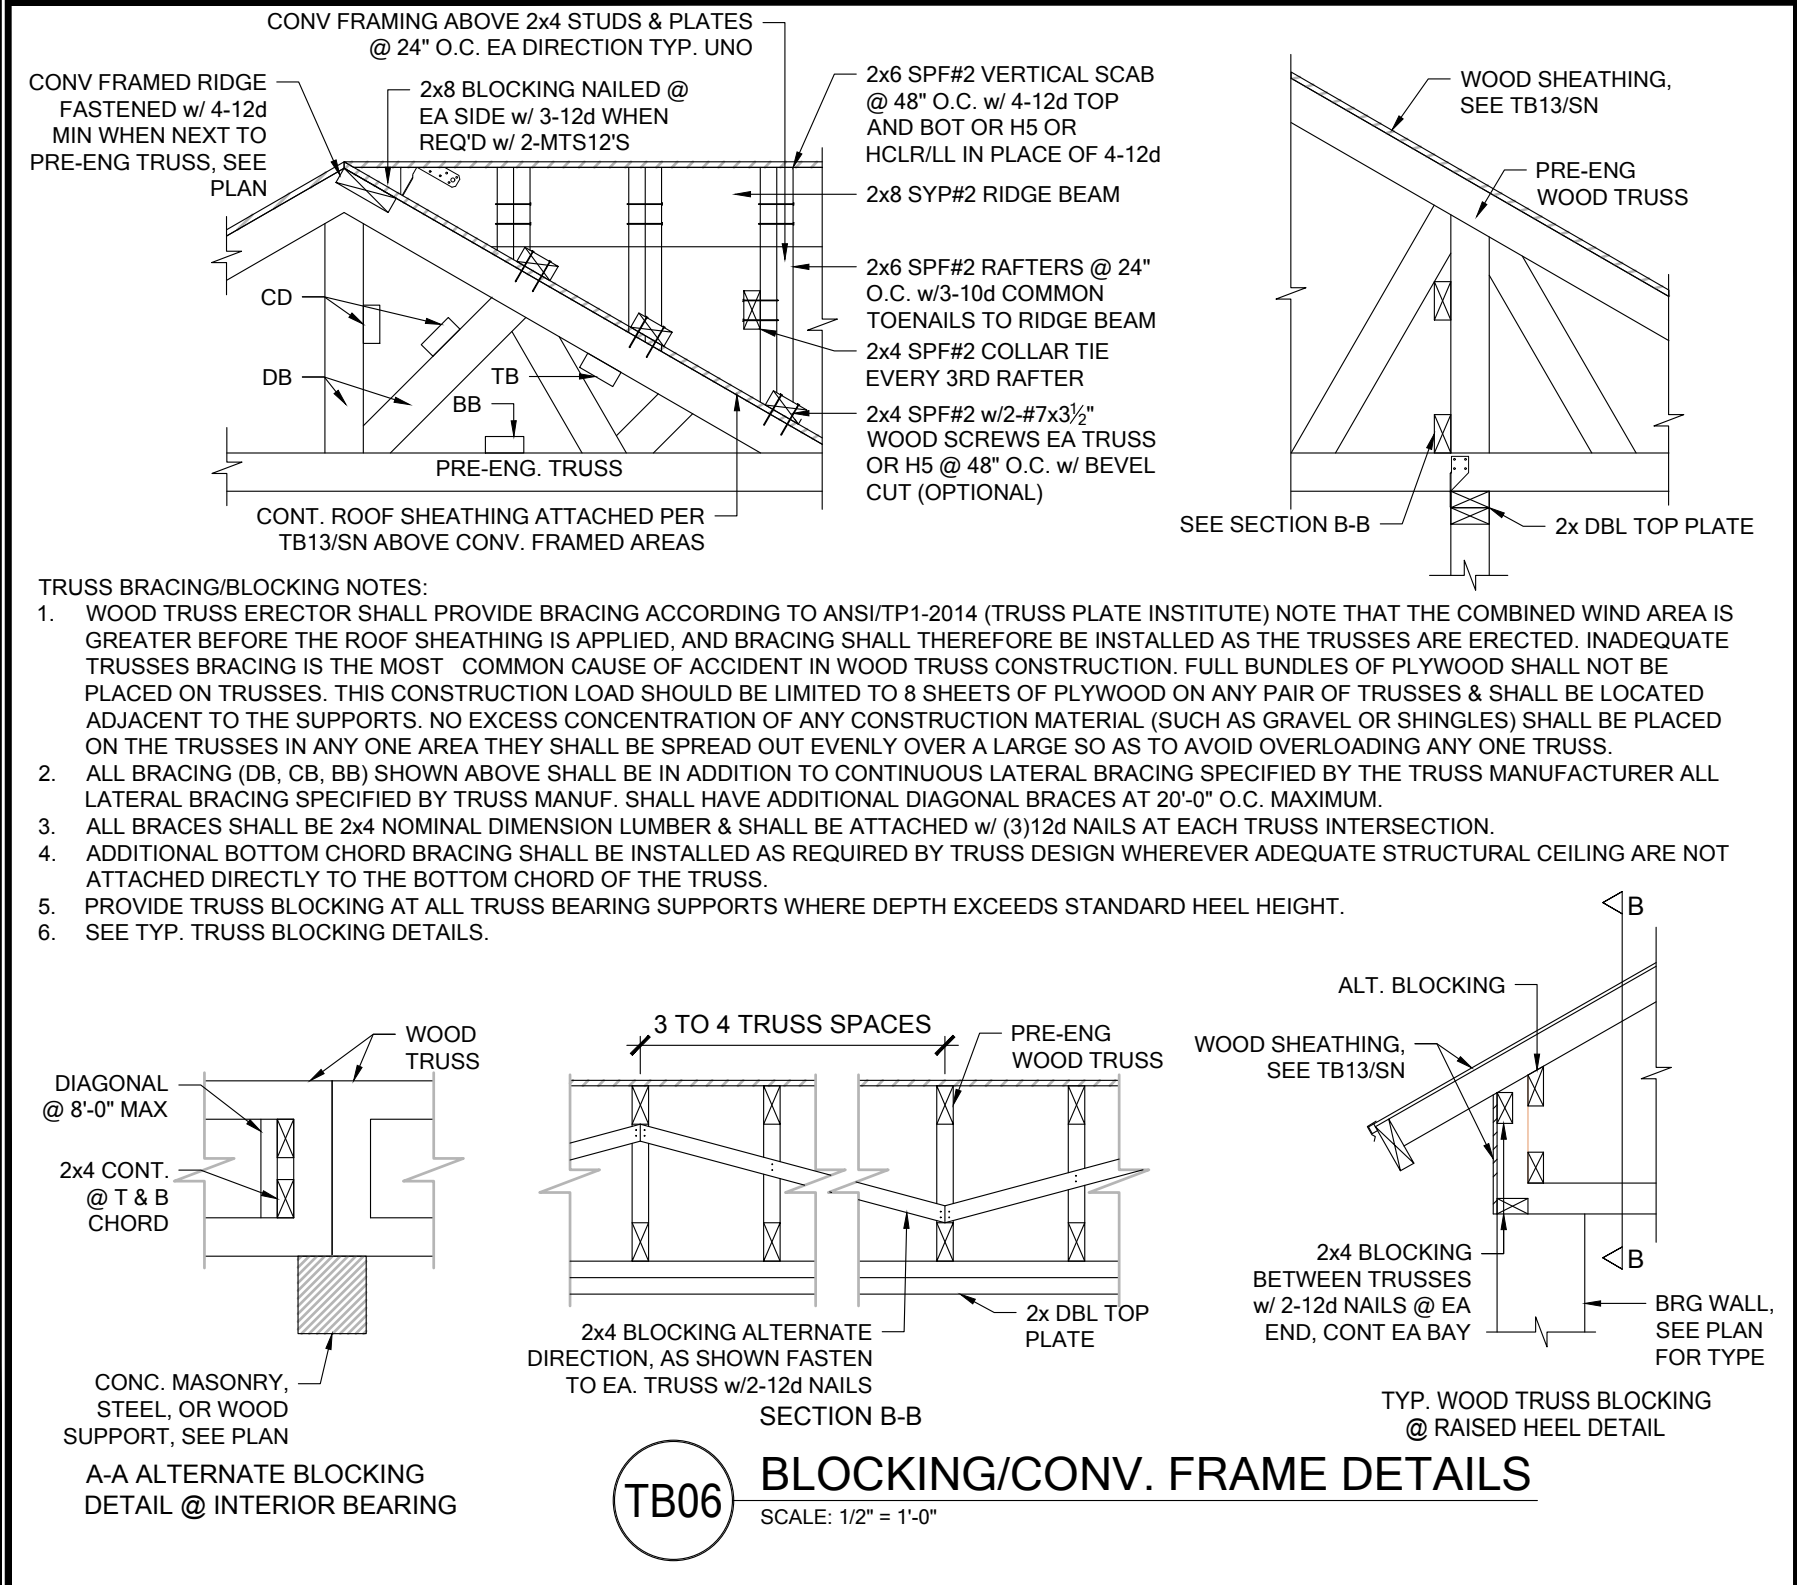


TB06 BLOCKING/CONV. FRAME DETAILS
SCALE: 1/2" = 1'-0"

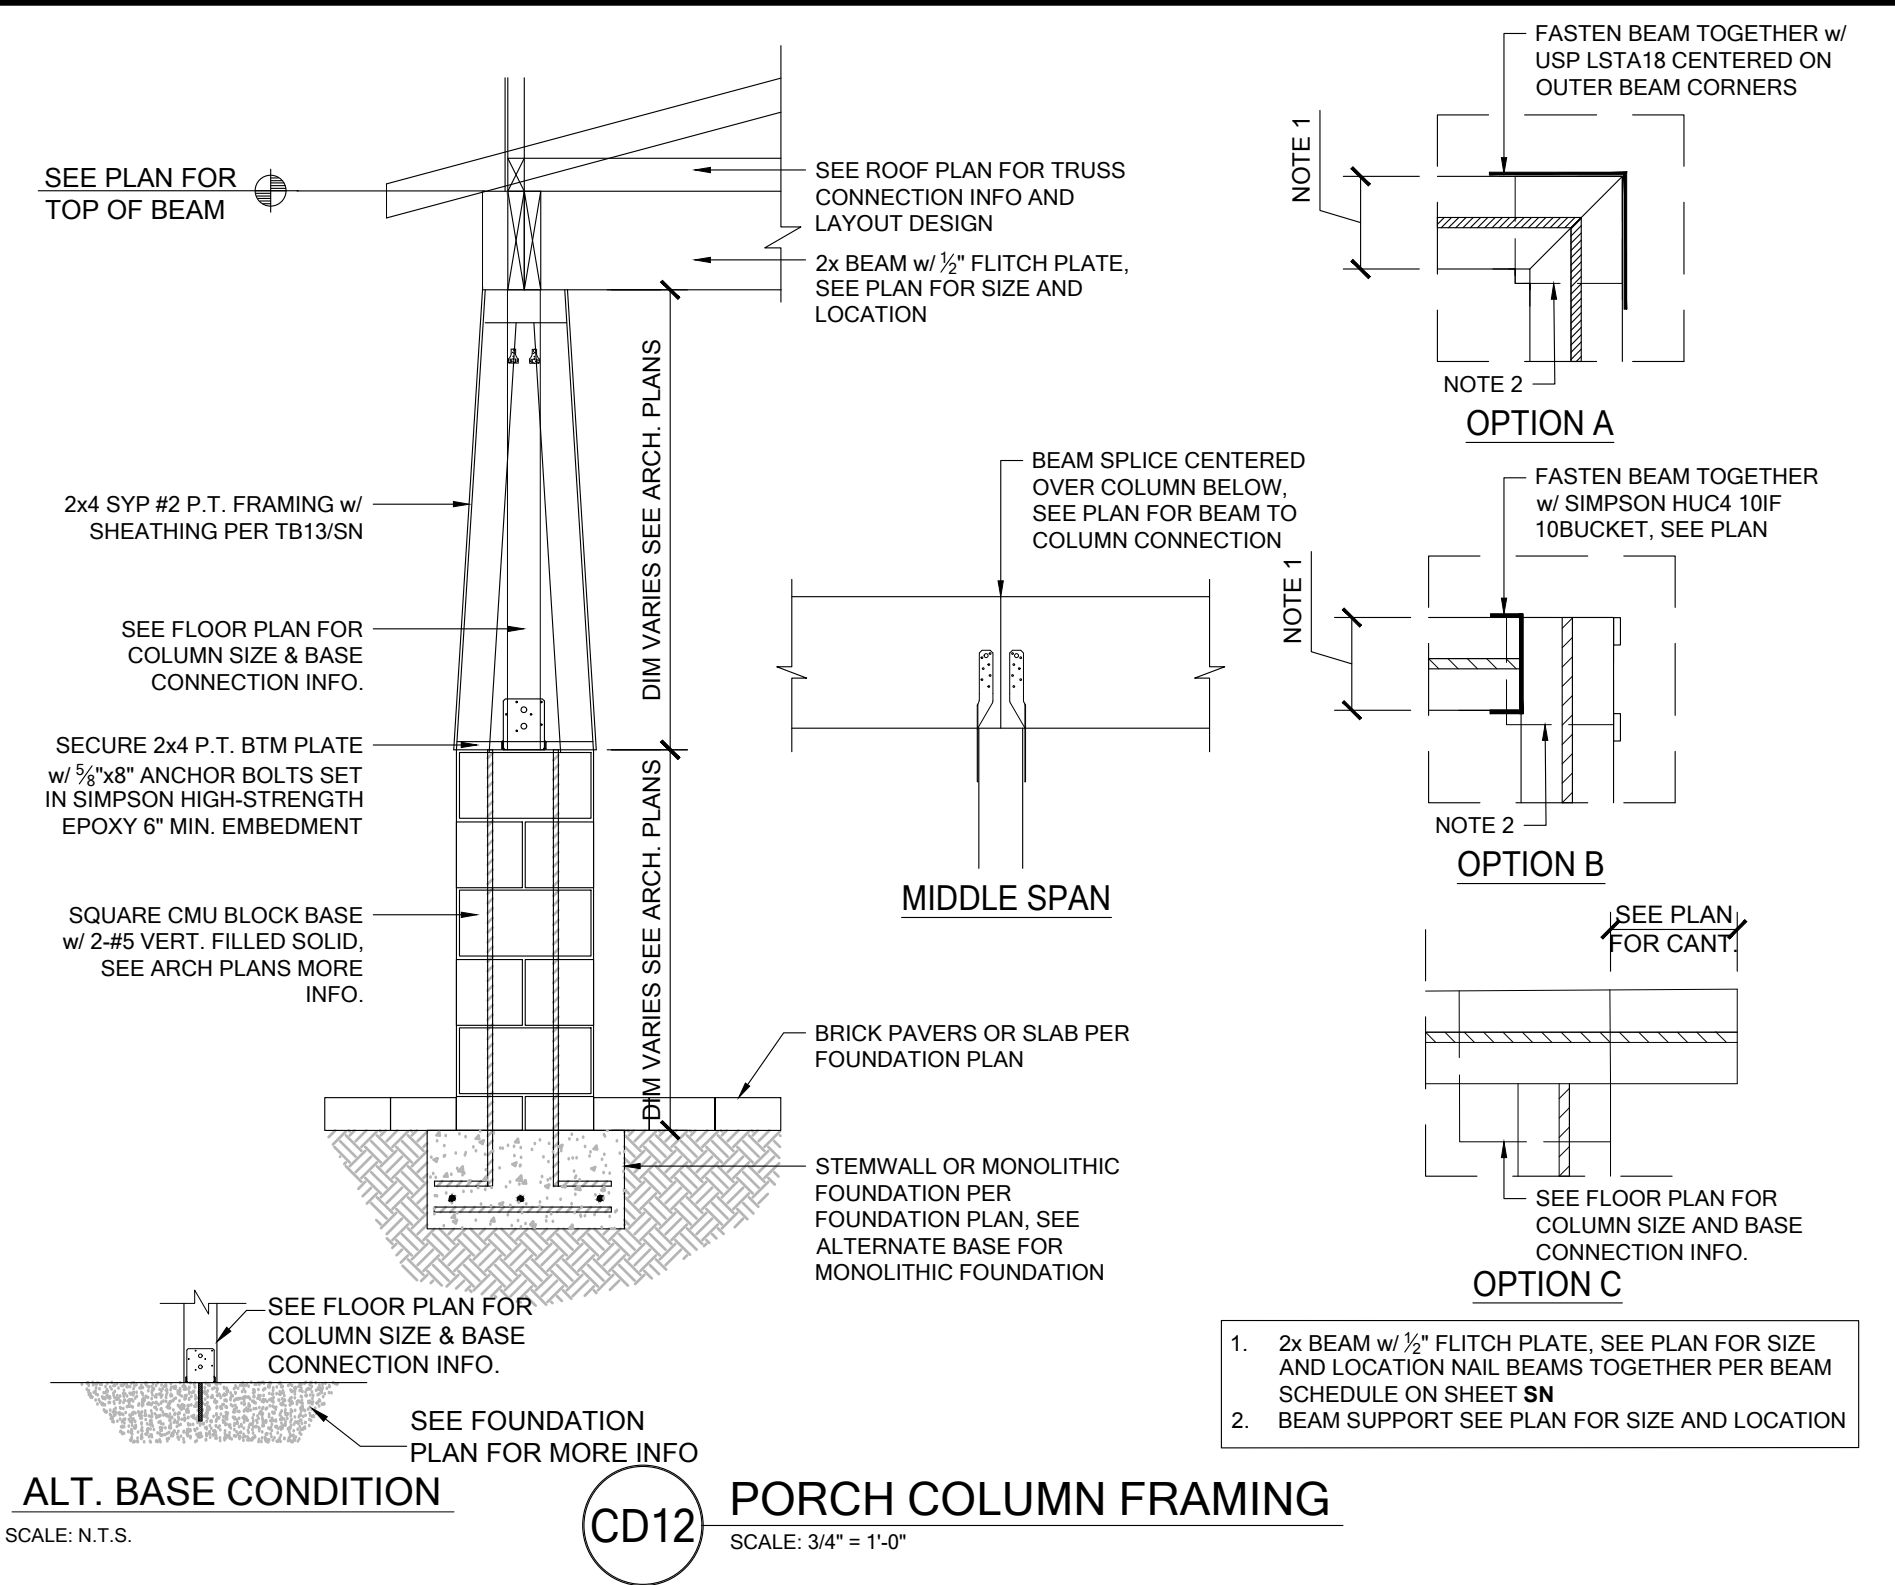


CD12 PORCH COLUMN FRAMING
SCALE: 3/4" = 1'-0"

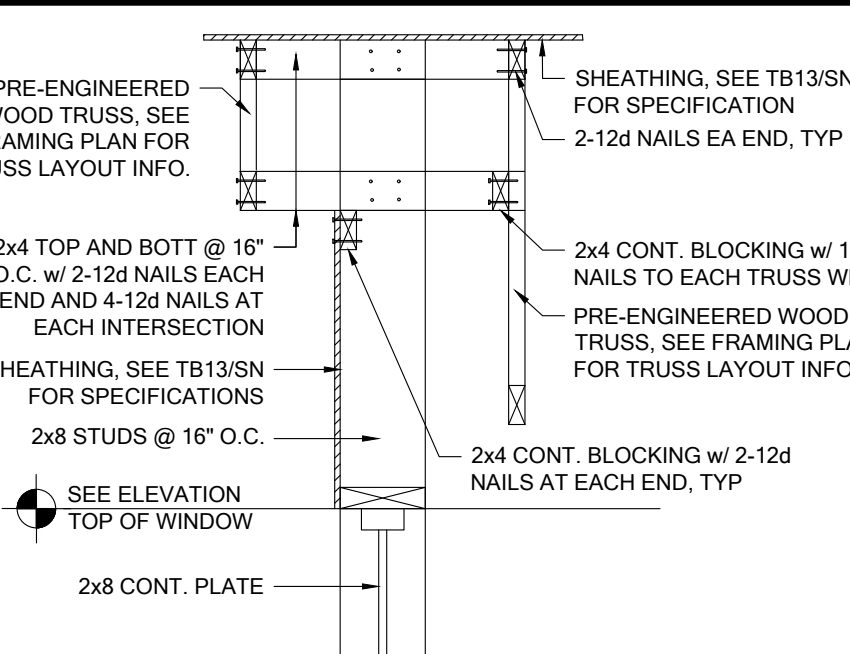


WF27 KNEEWALL @ ENTRY
SCALE: 3/4" = 1'-0"

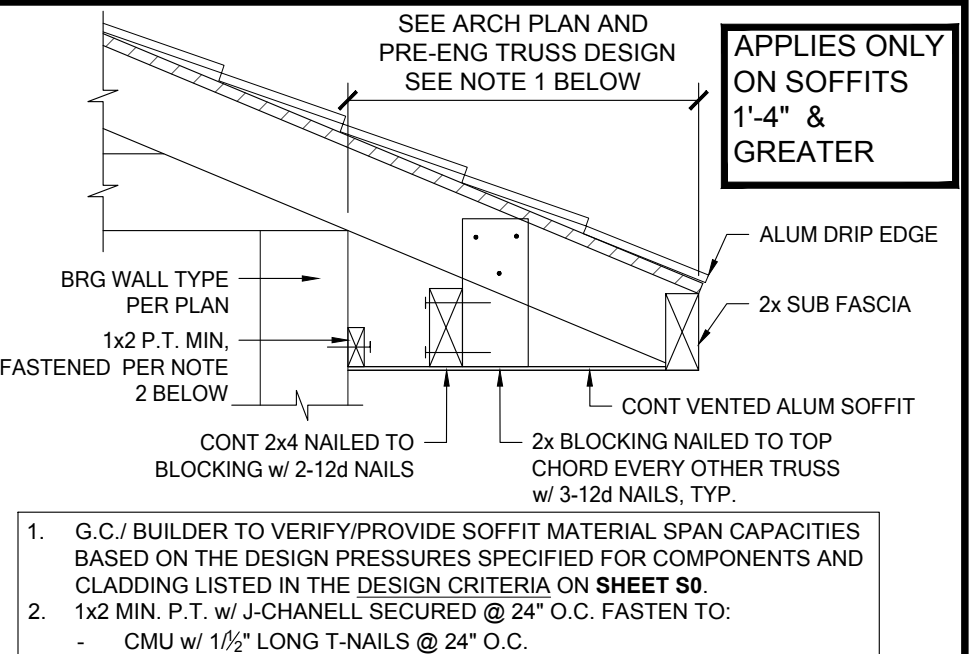

SF01 STRUCTURAL SOFFIT
SCALE: 3/4" = 1'-0"

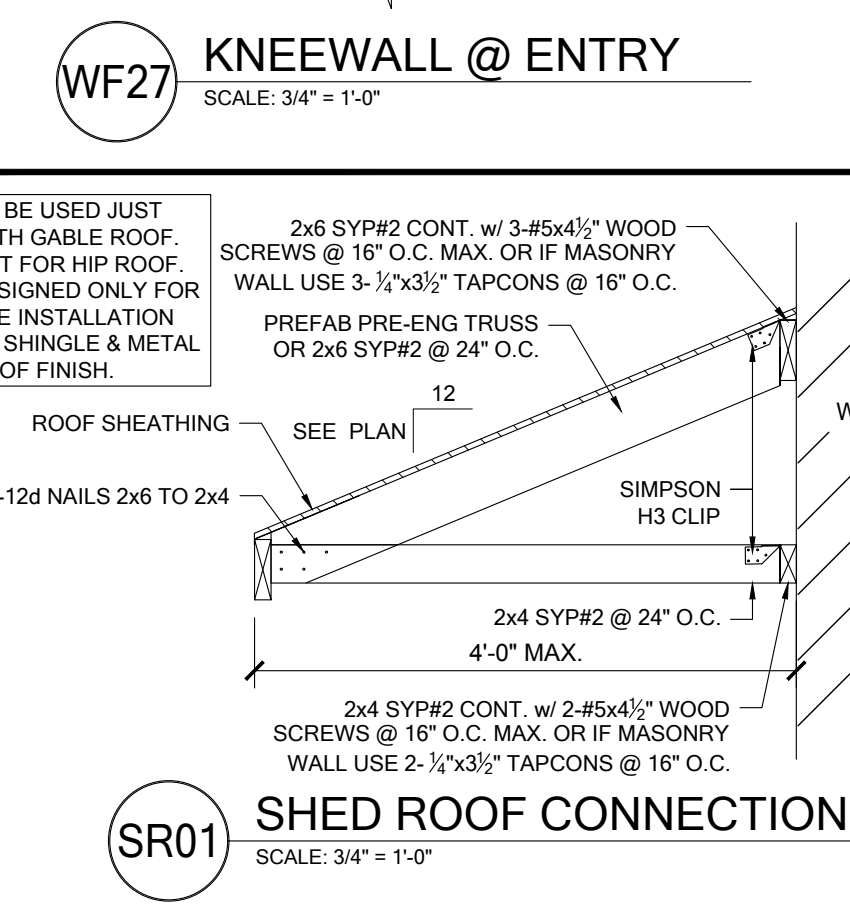

SR01 SHED ROOF CONNECTION
SCALE: 3/4" = 1'-0"

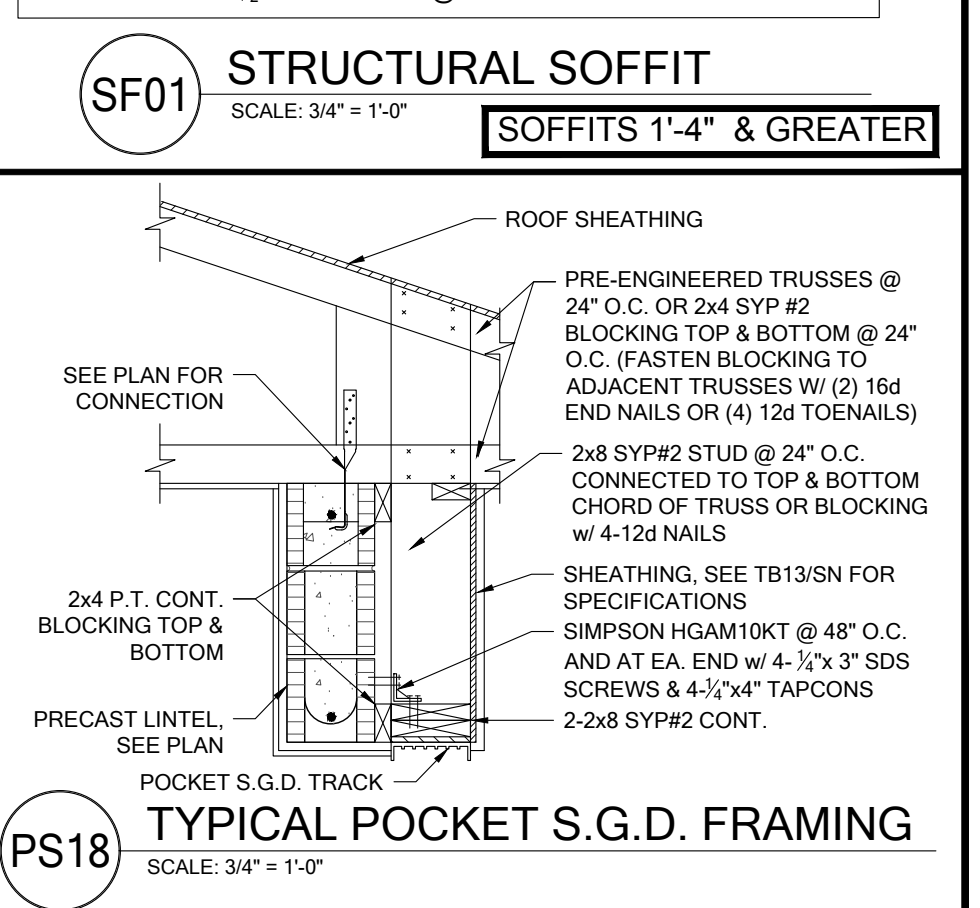

PS18 TYPICAL POCKET S.G.D. FRAMING
SCALE: 3/4" = 1'-0"

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

A.I. BUILD AMERICAN BUILDING DESIGN


















FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
O: 321-972-2491 F: 407-880-2304
Certificate of Authorization No. 9161
SCOTT LEWIS/CSK, PE - FL #77959

**PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS**

project no. 2022142
checked: AB
date: 05-17-22
scale:

D2

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

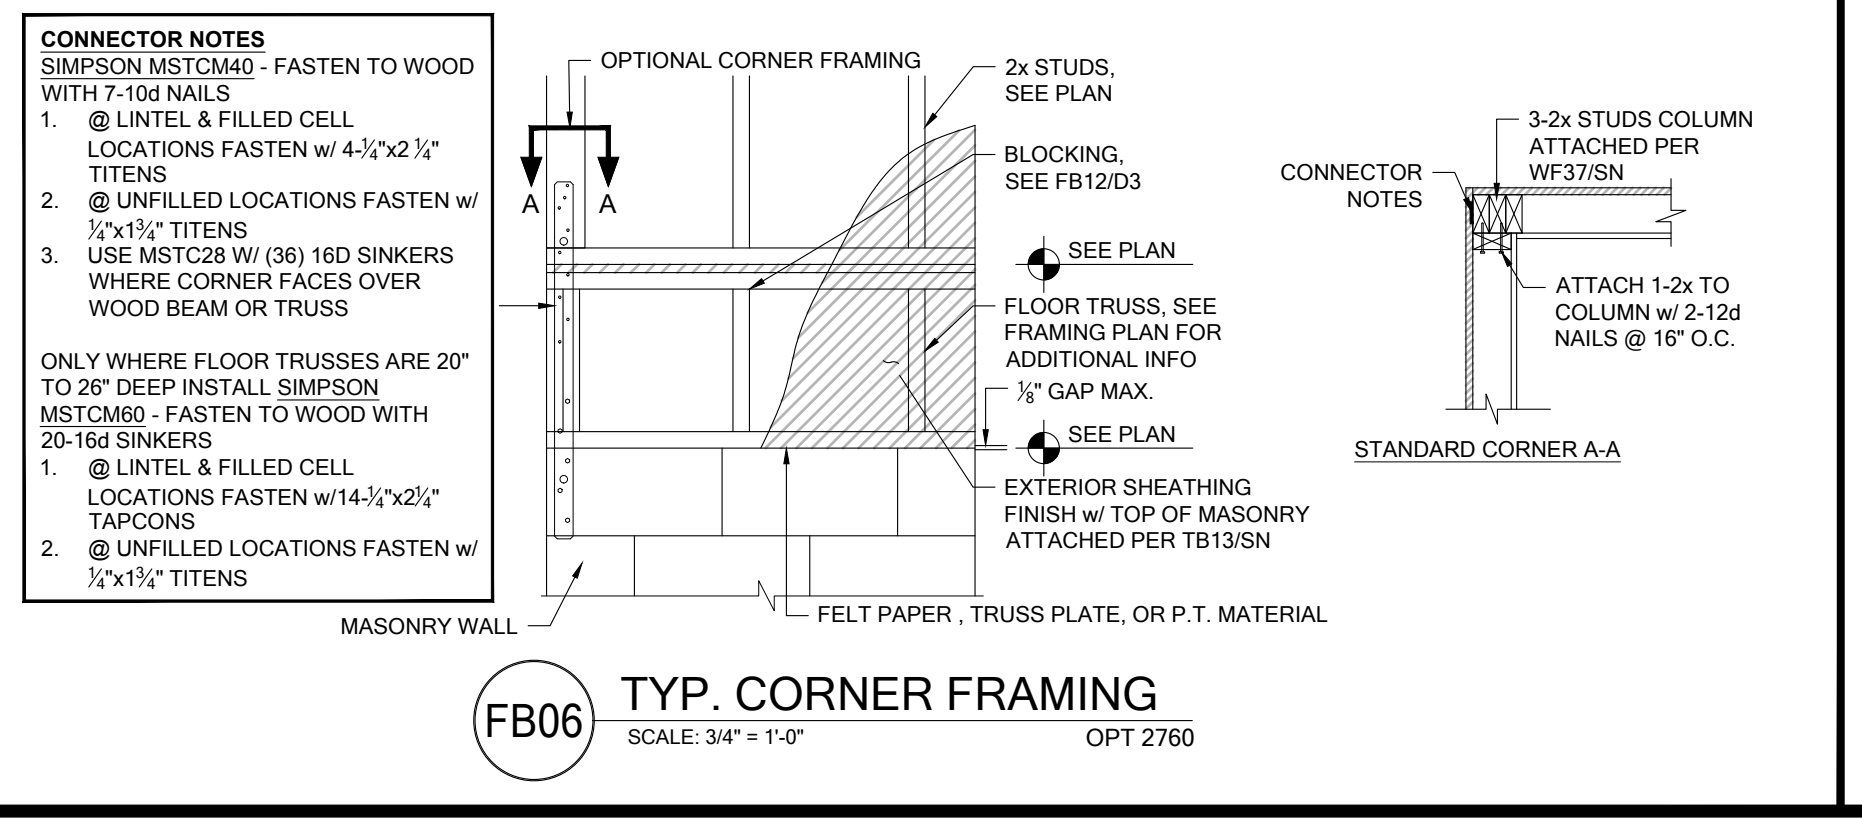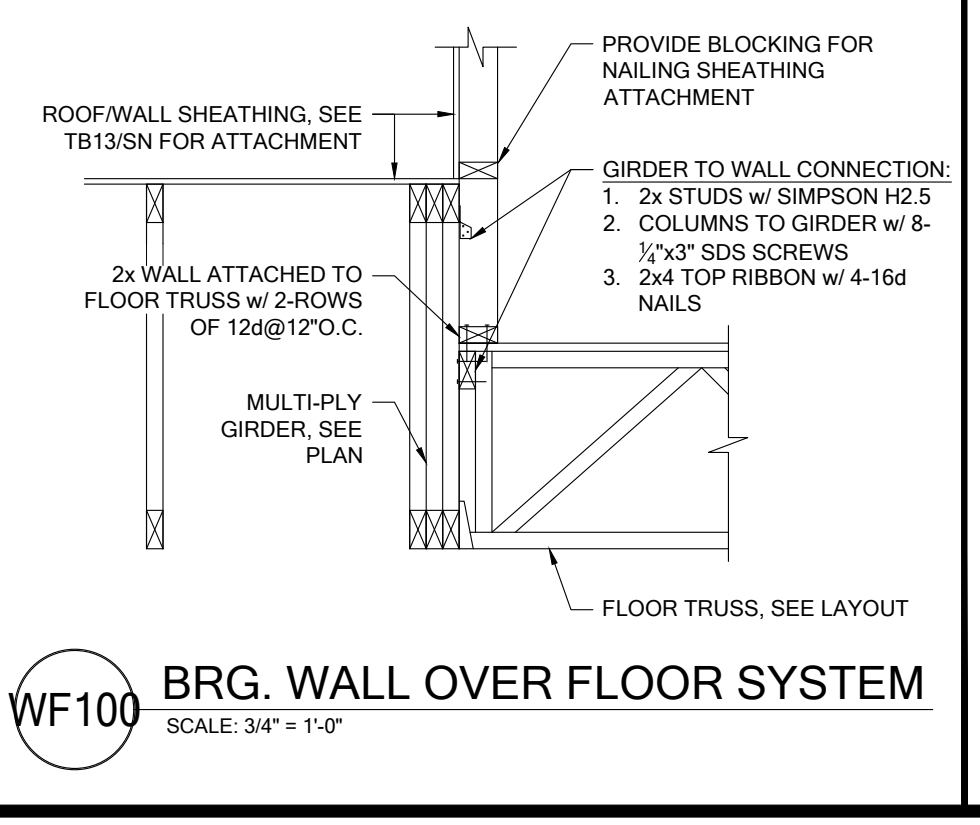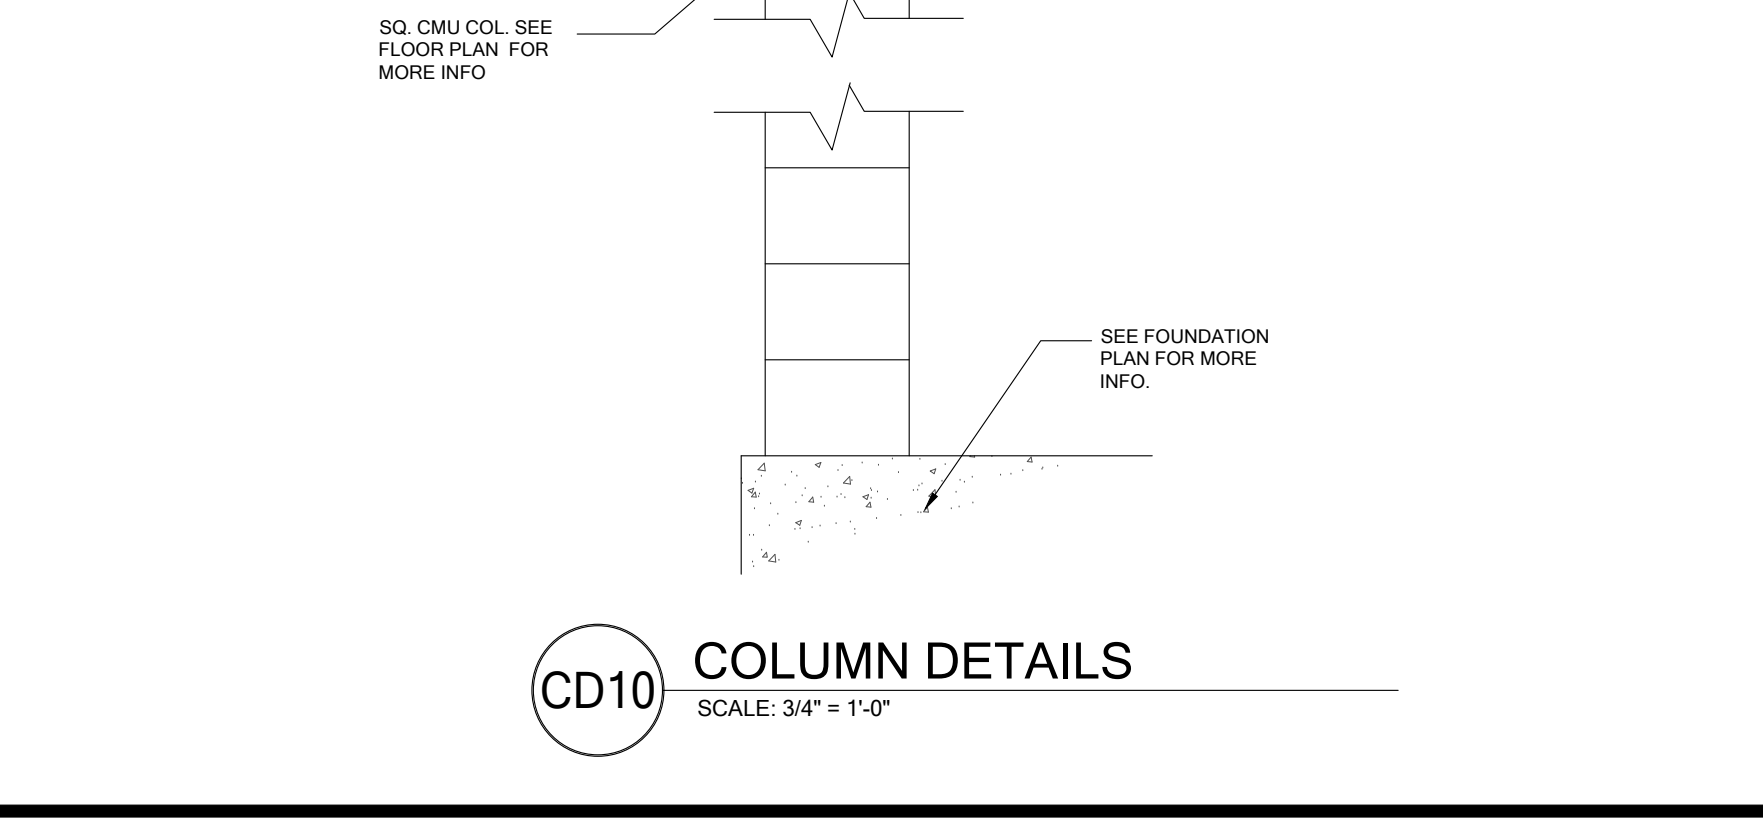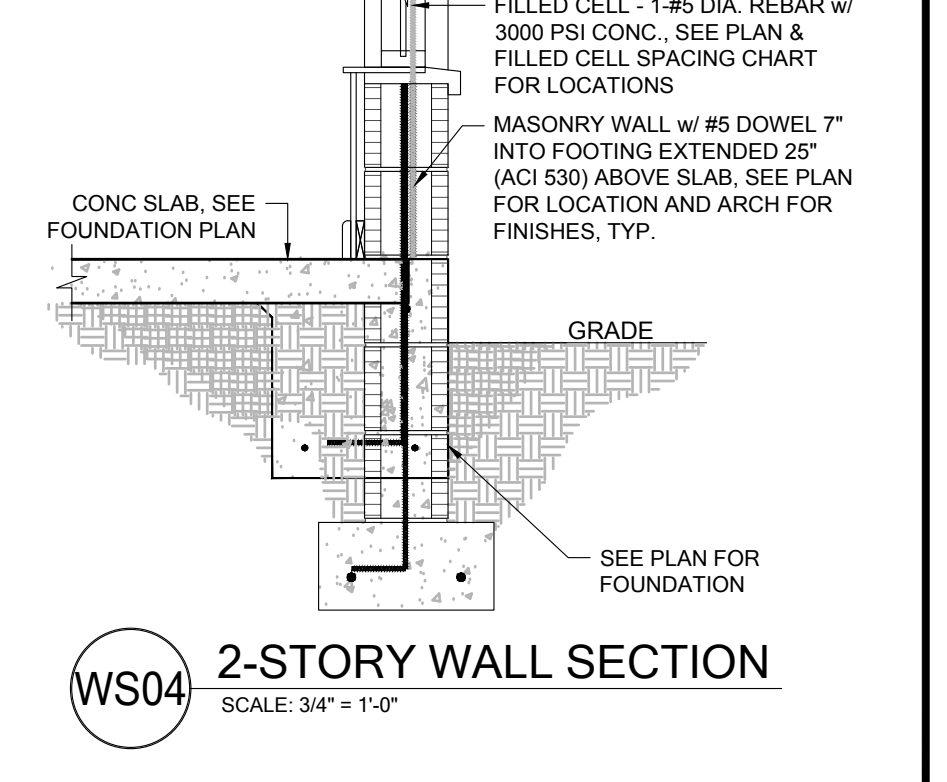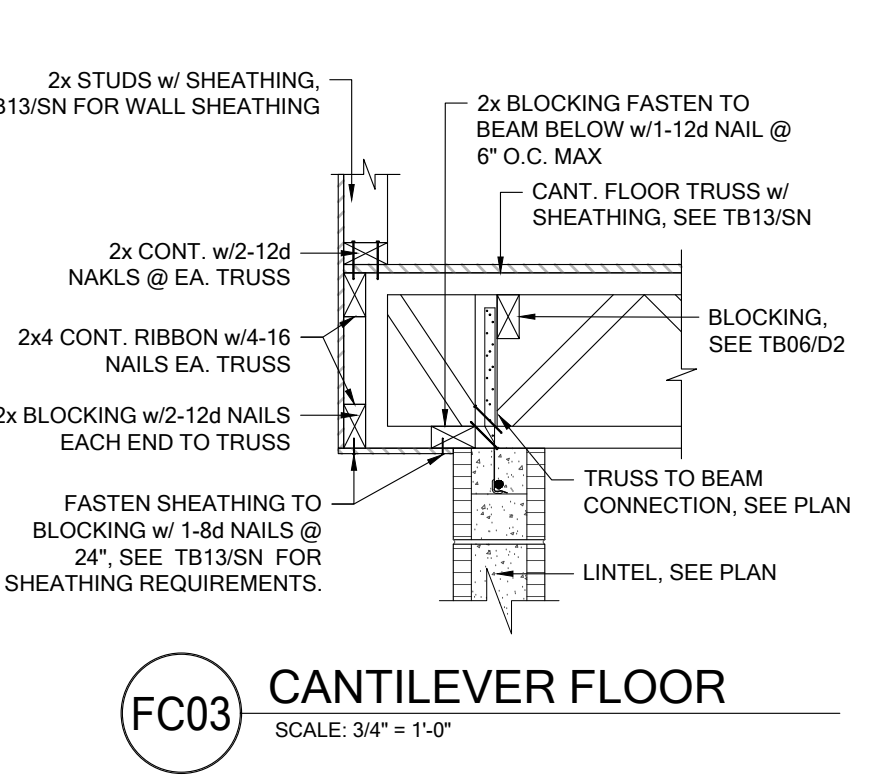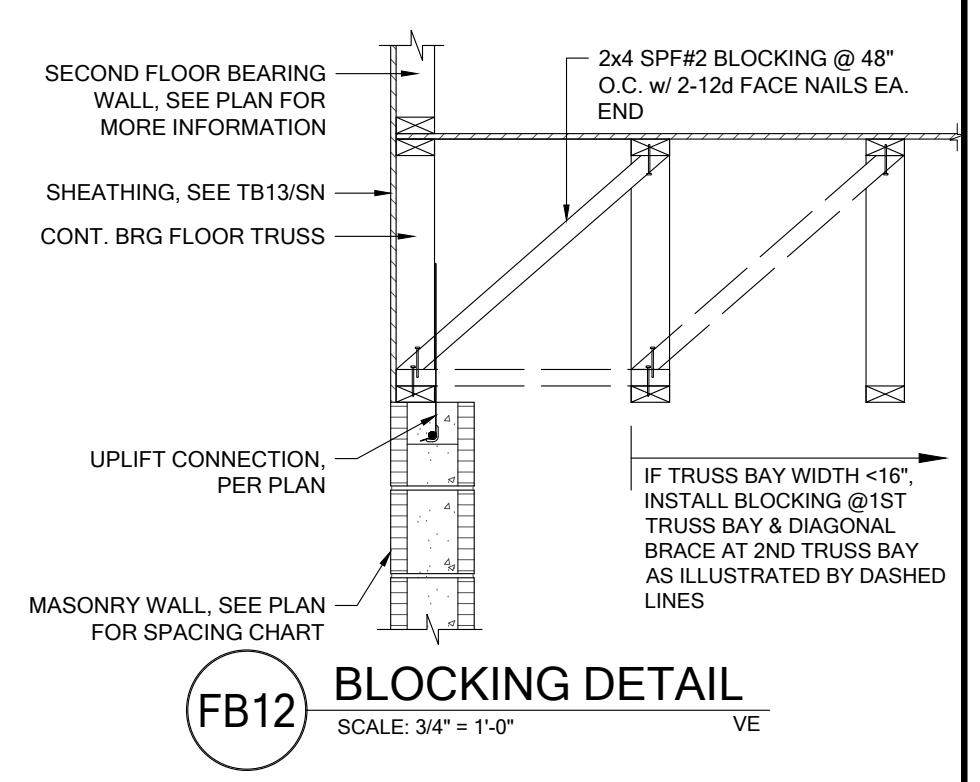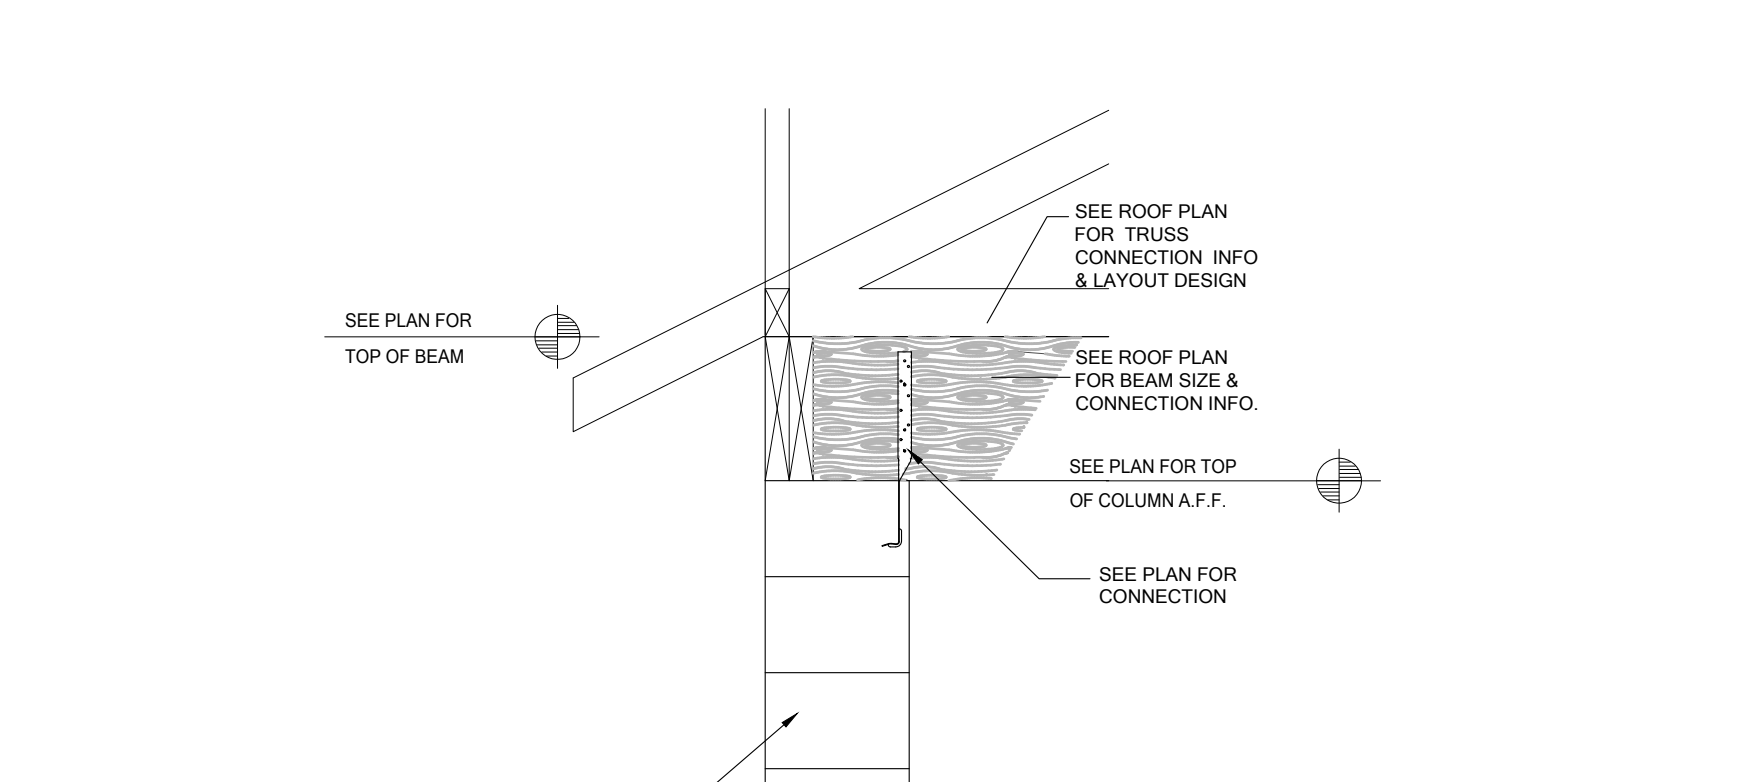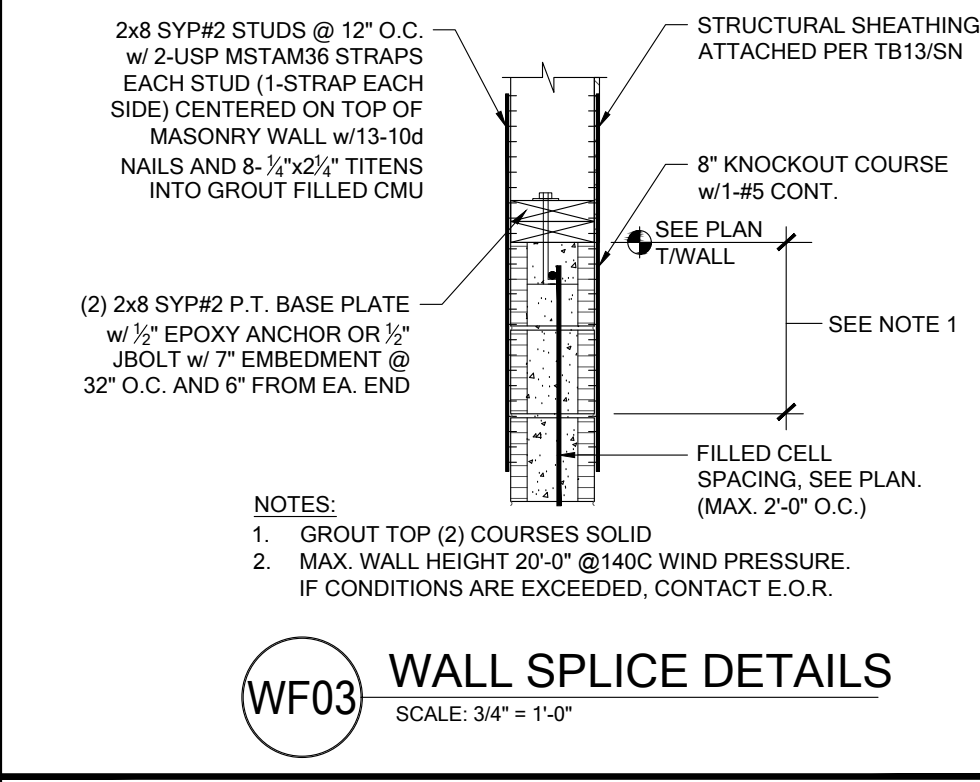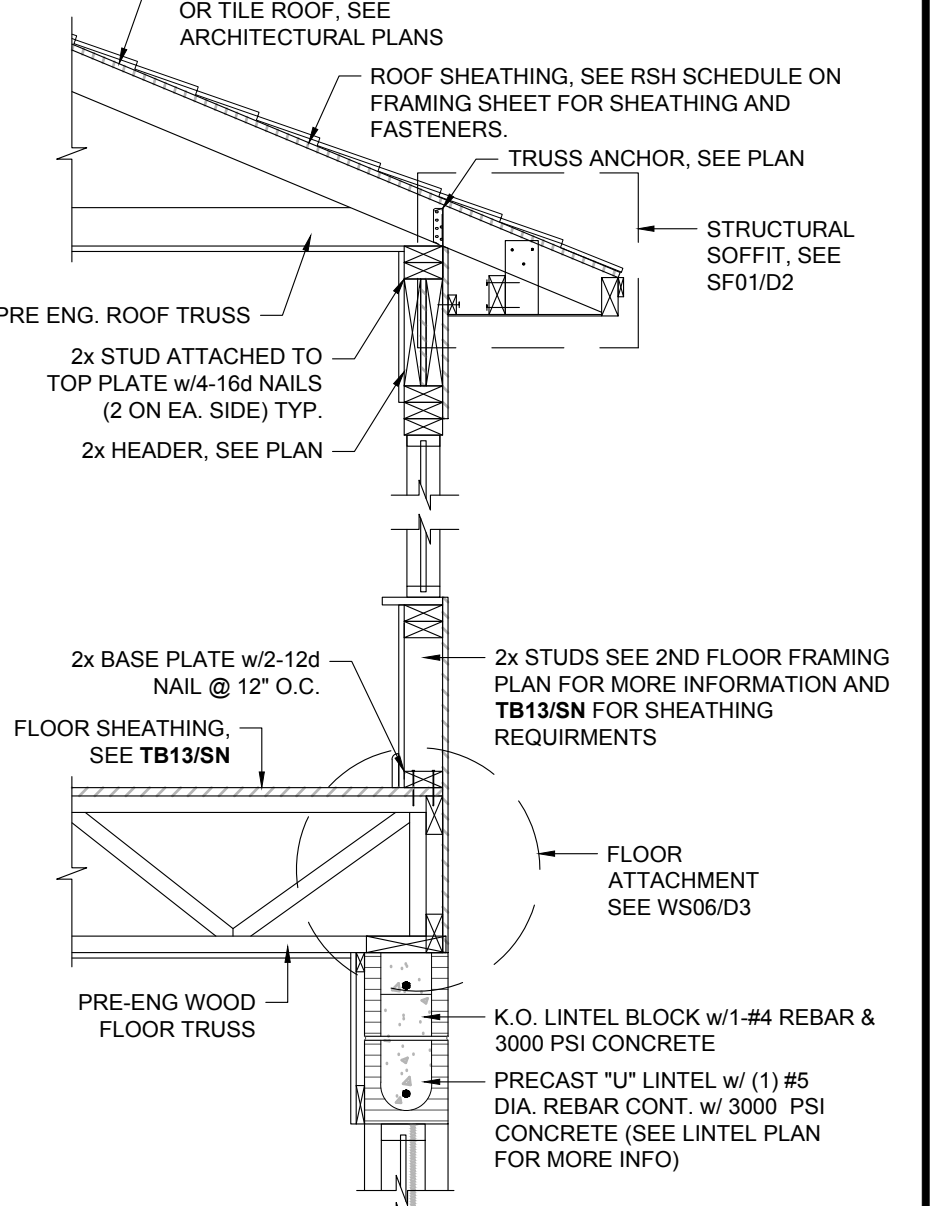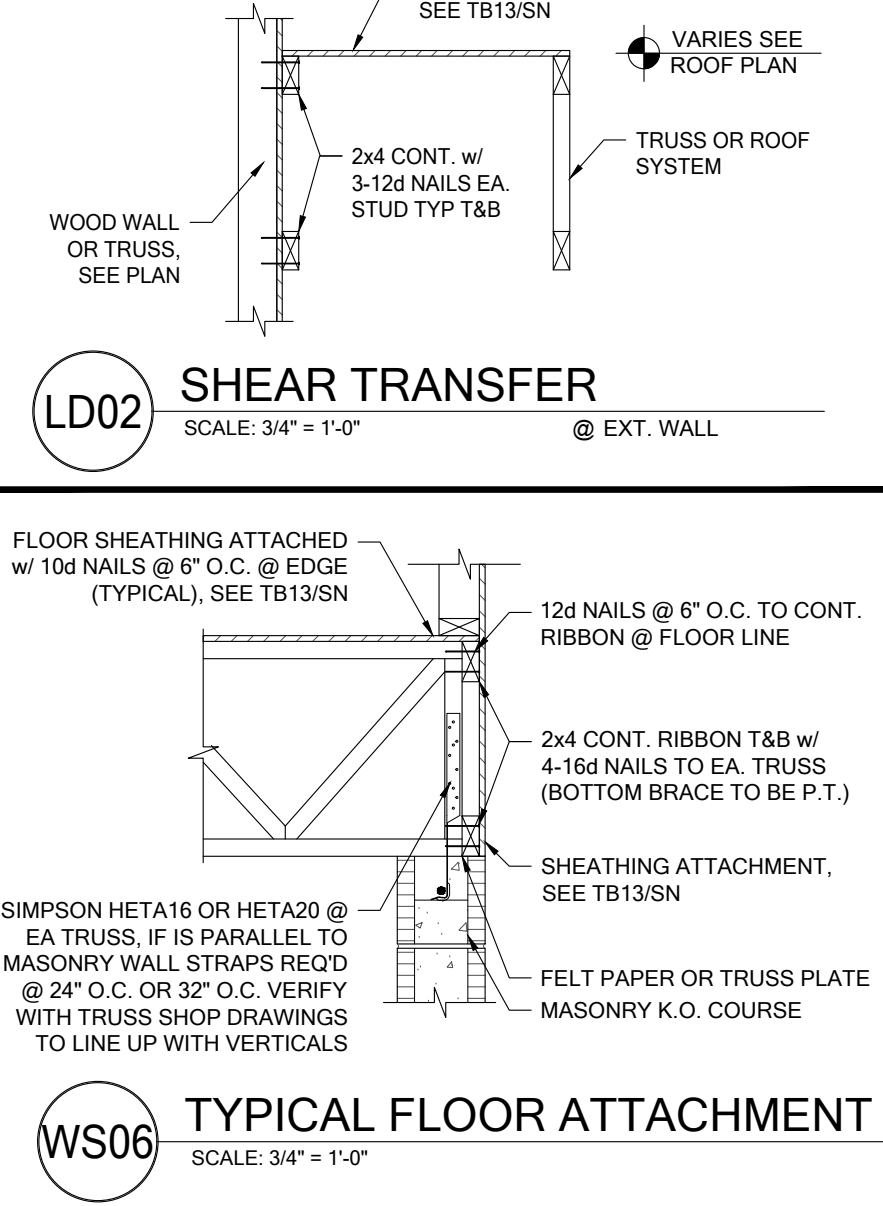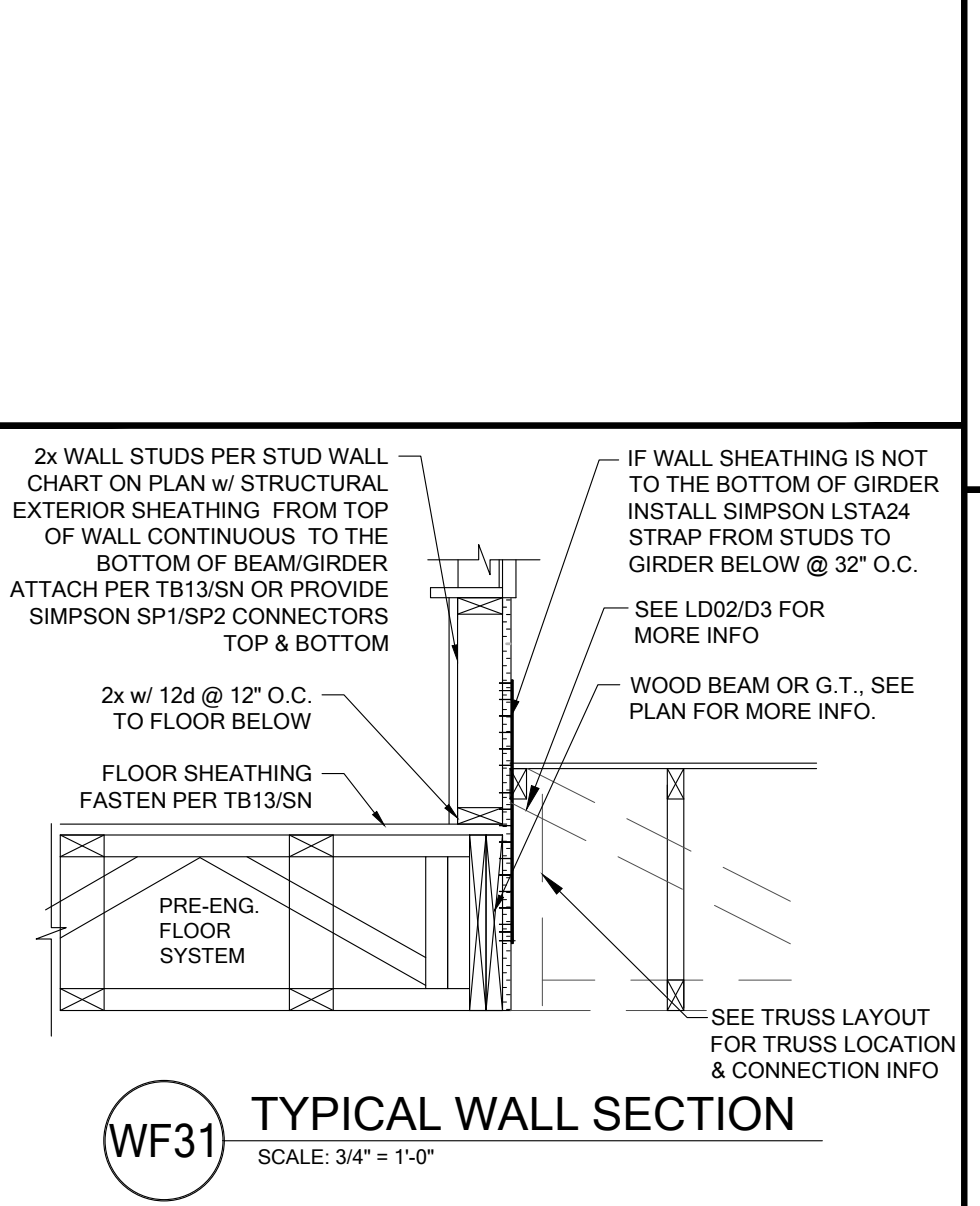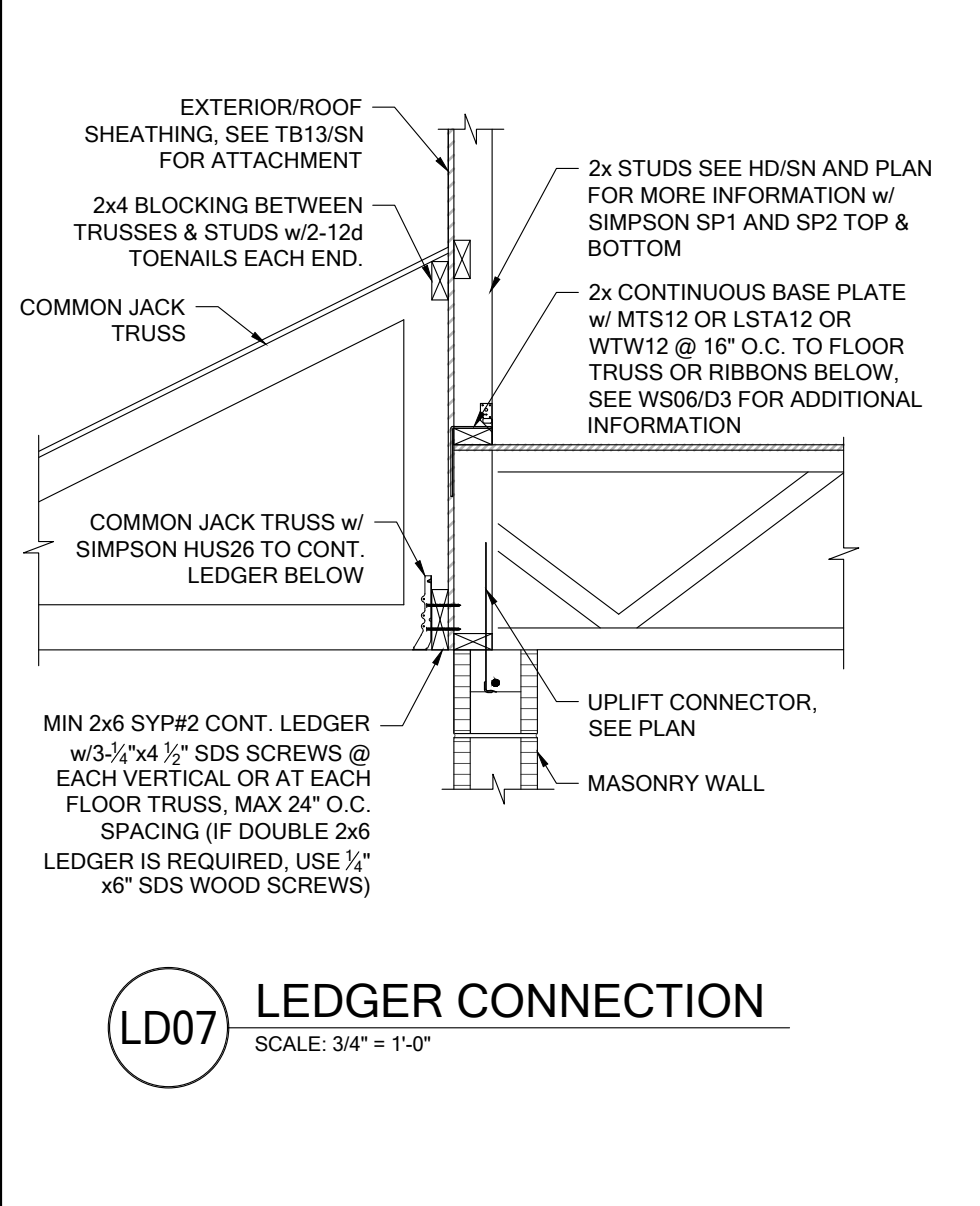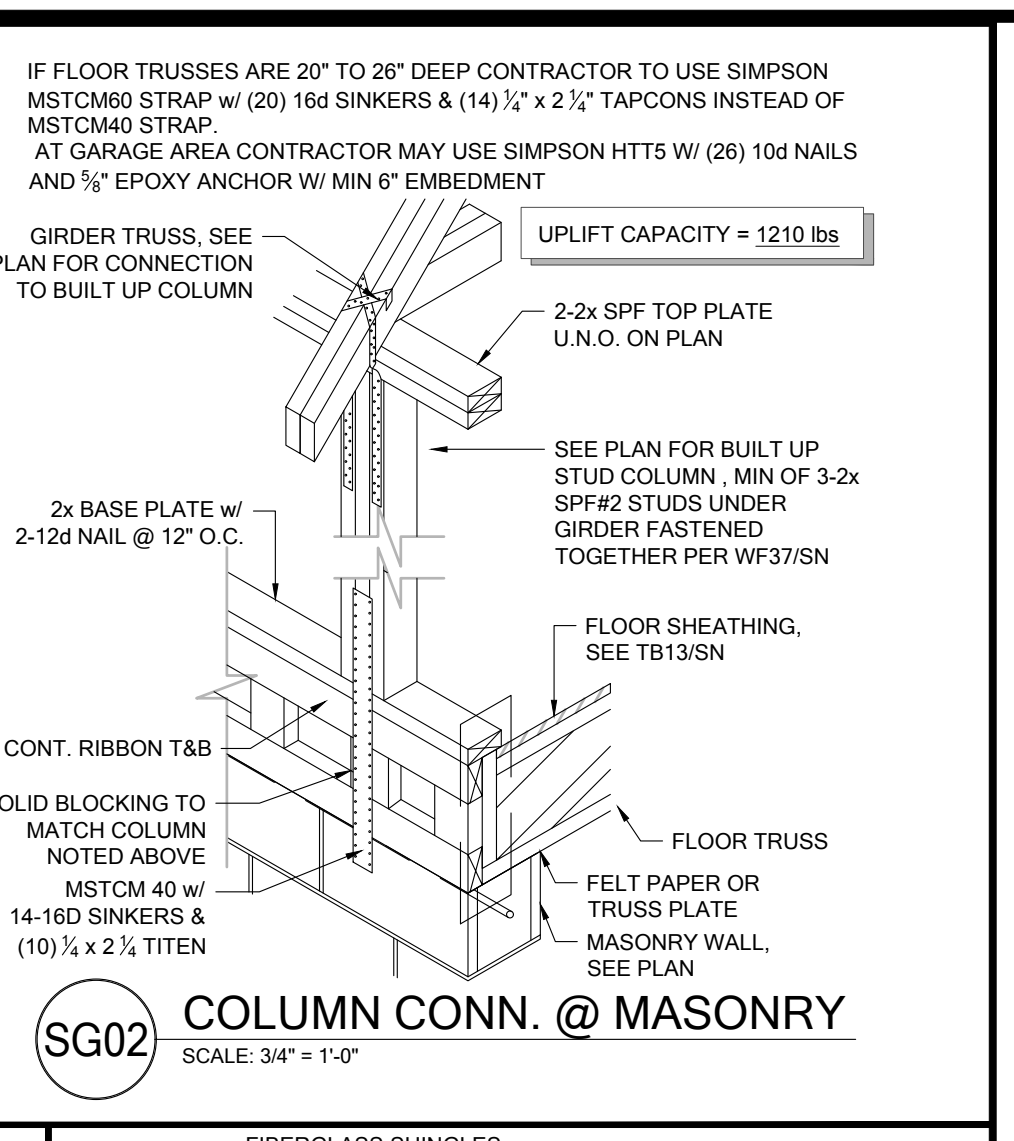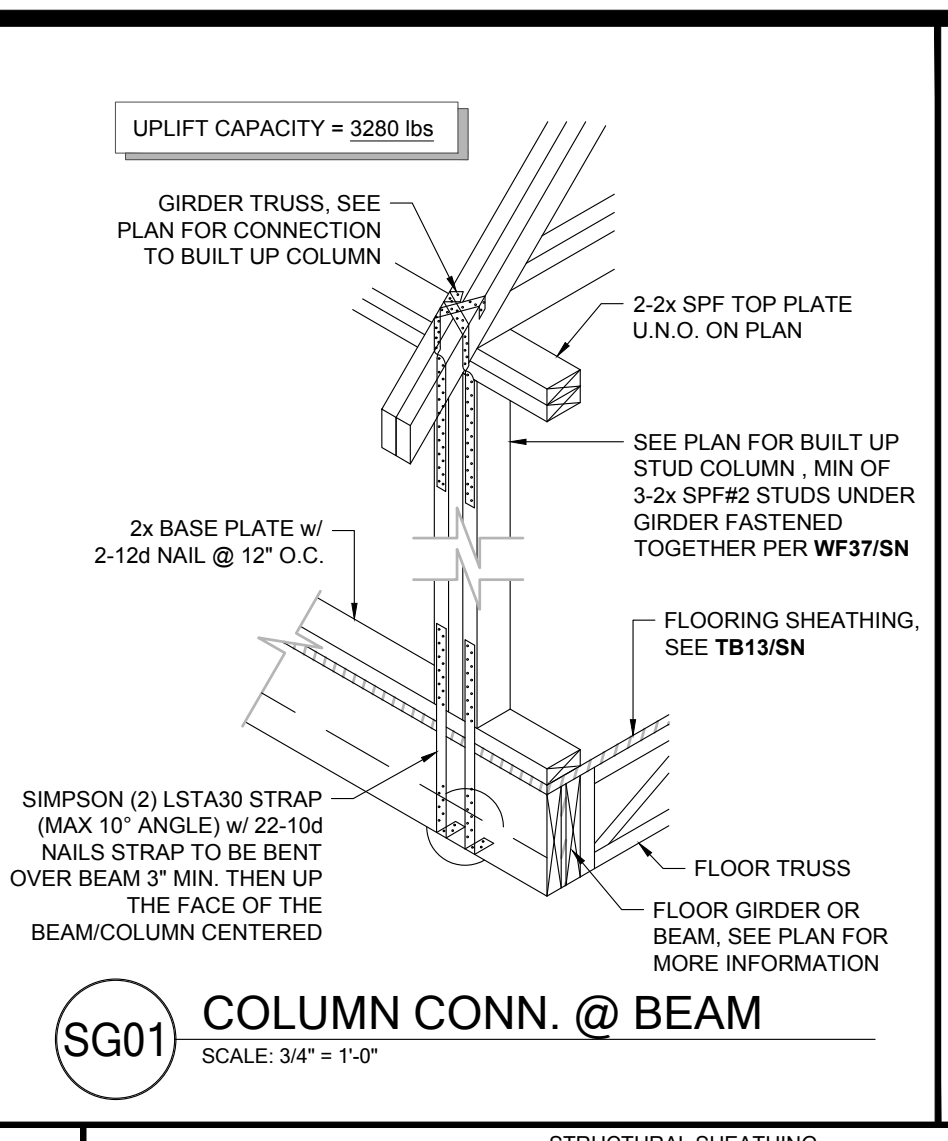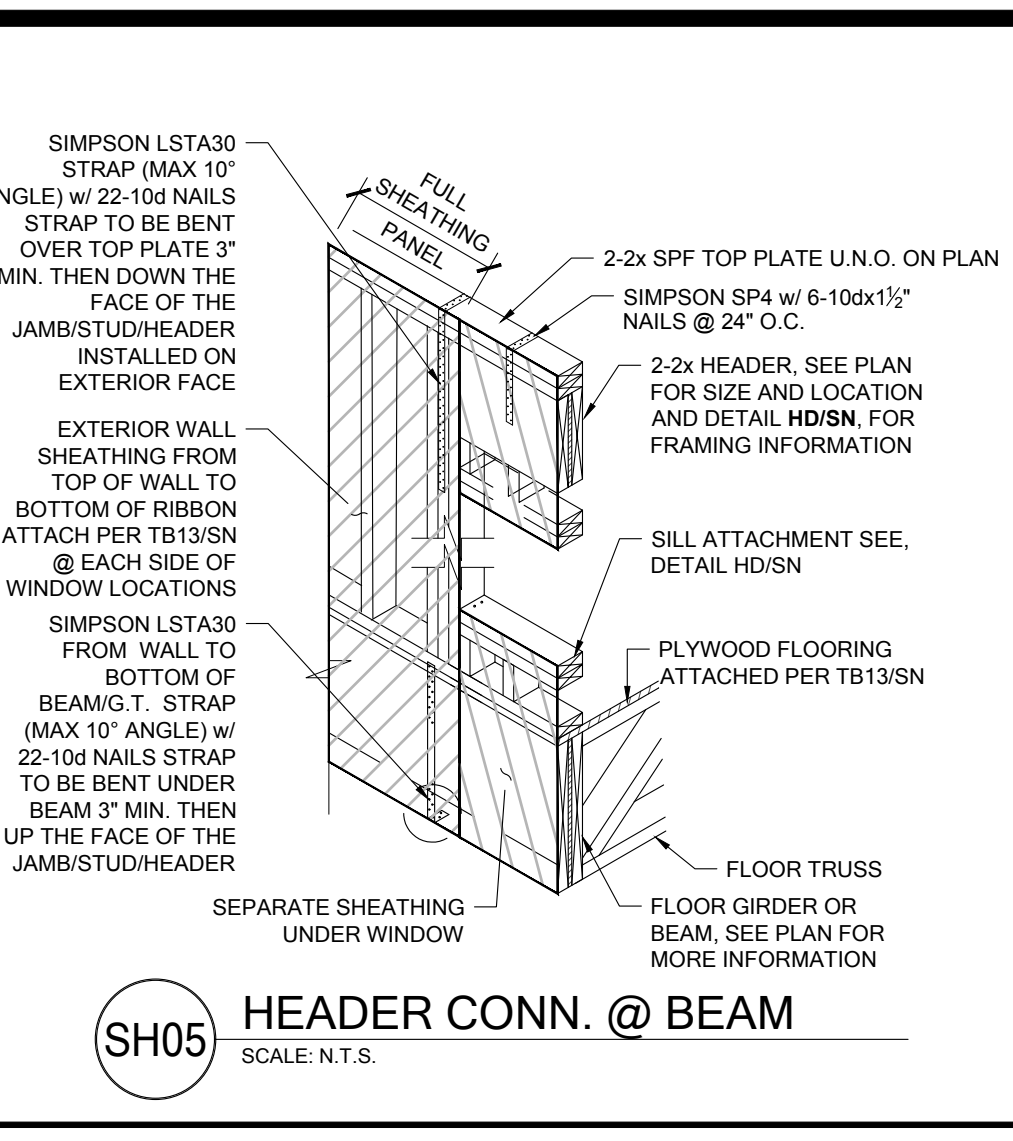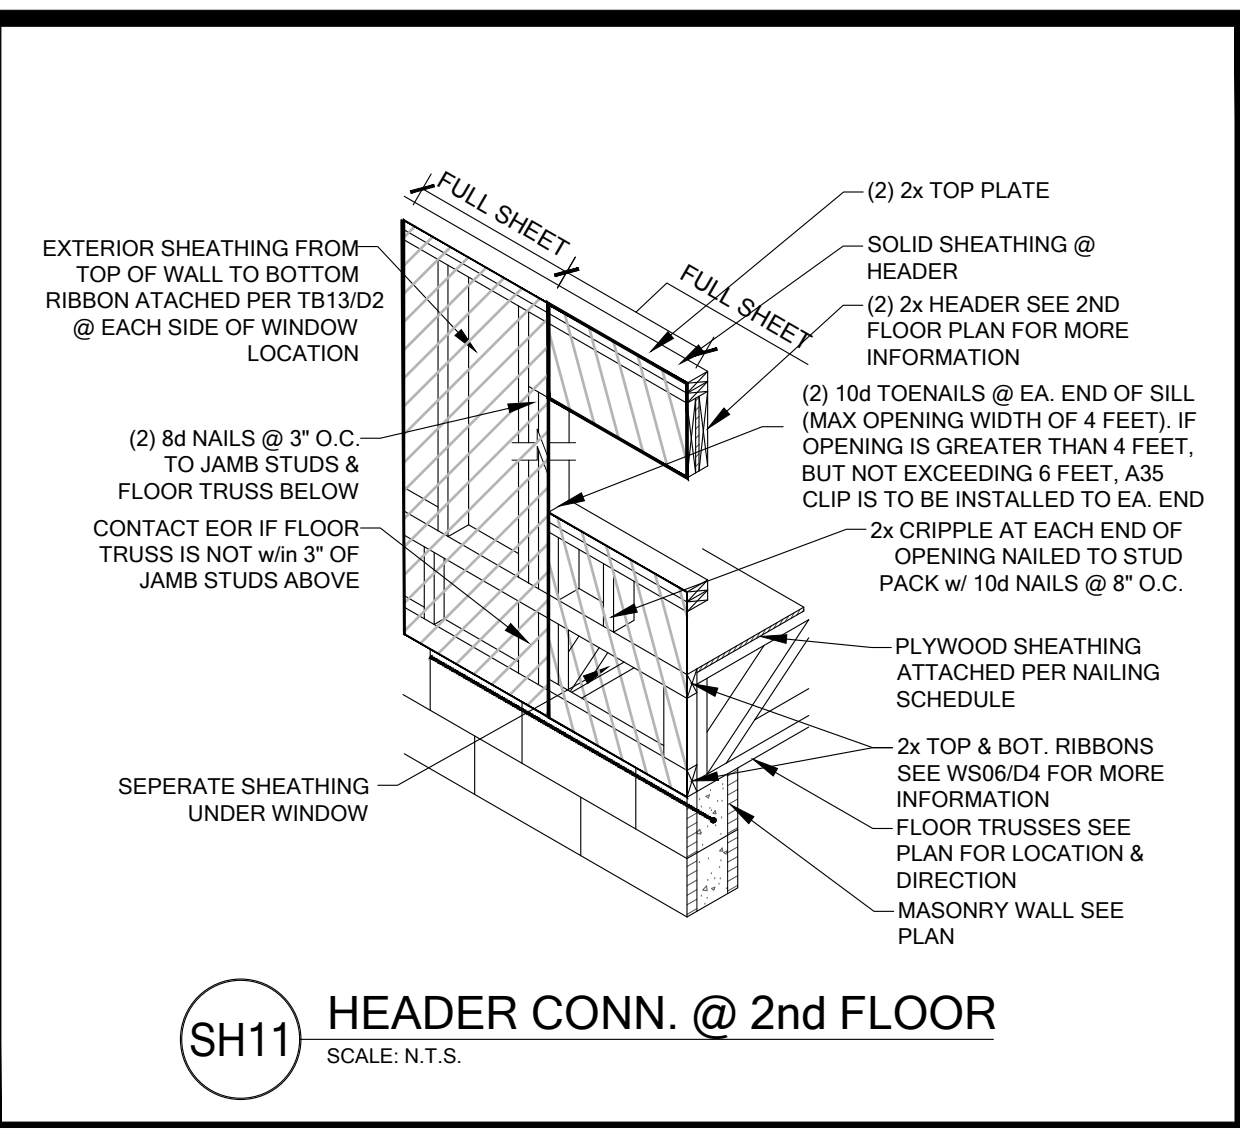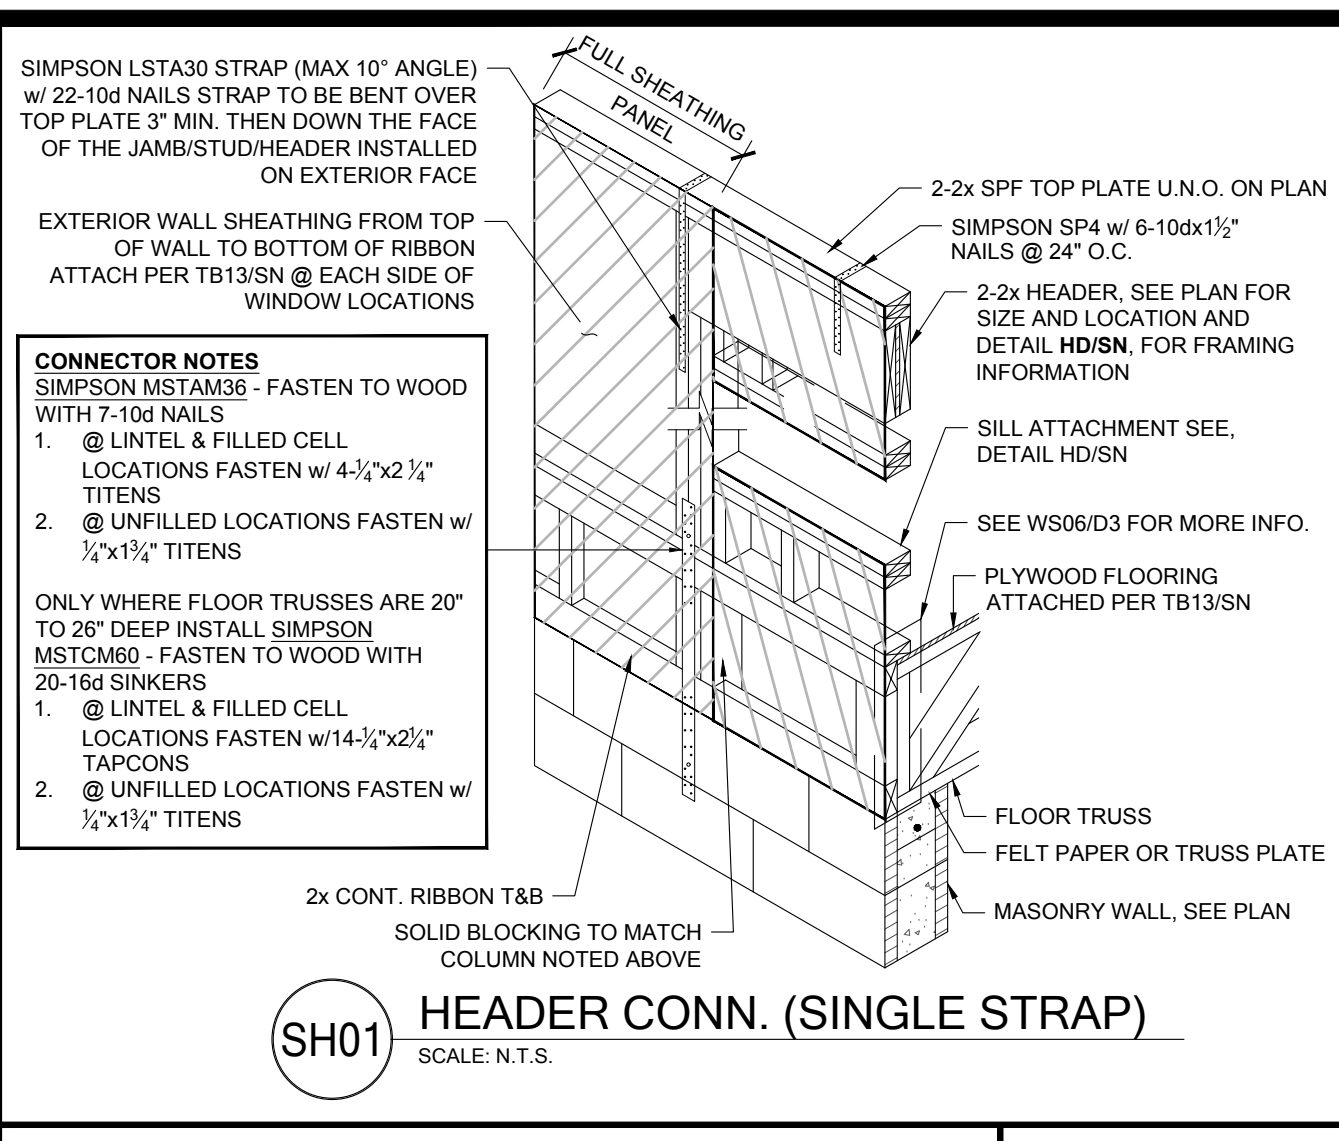

B&A Design Studio, Inc.
 4017 W. 1st Street
 Sanford, FL 32771
 ph 407 829 8900
 fax 407 829 2040
 www.badesignstudios.com


FDS
 258 Southhall Lane, Suite 200, Maitland, FL 32751
 O: 321-972-0491 F: 407-880-2304
 Certificate of Authorization No. 9161
 SCOTT BECKOWSKI, P.E. - F.L.#72759
 DATE: January 26, 2023
 FOR THE STRUCTURAL DESIGN OF THIS DRAWING

**PARK SQUARE
 HORIZONS WEST
 4-UNIT - ADAMS END UNITS**


title: _____
 project no. 2022142
 checked: _____
 drawn: AB
 date: 05-17-22
 scale: _____

D3


NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

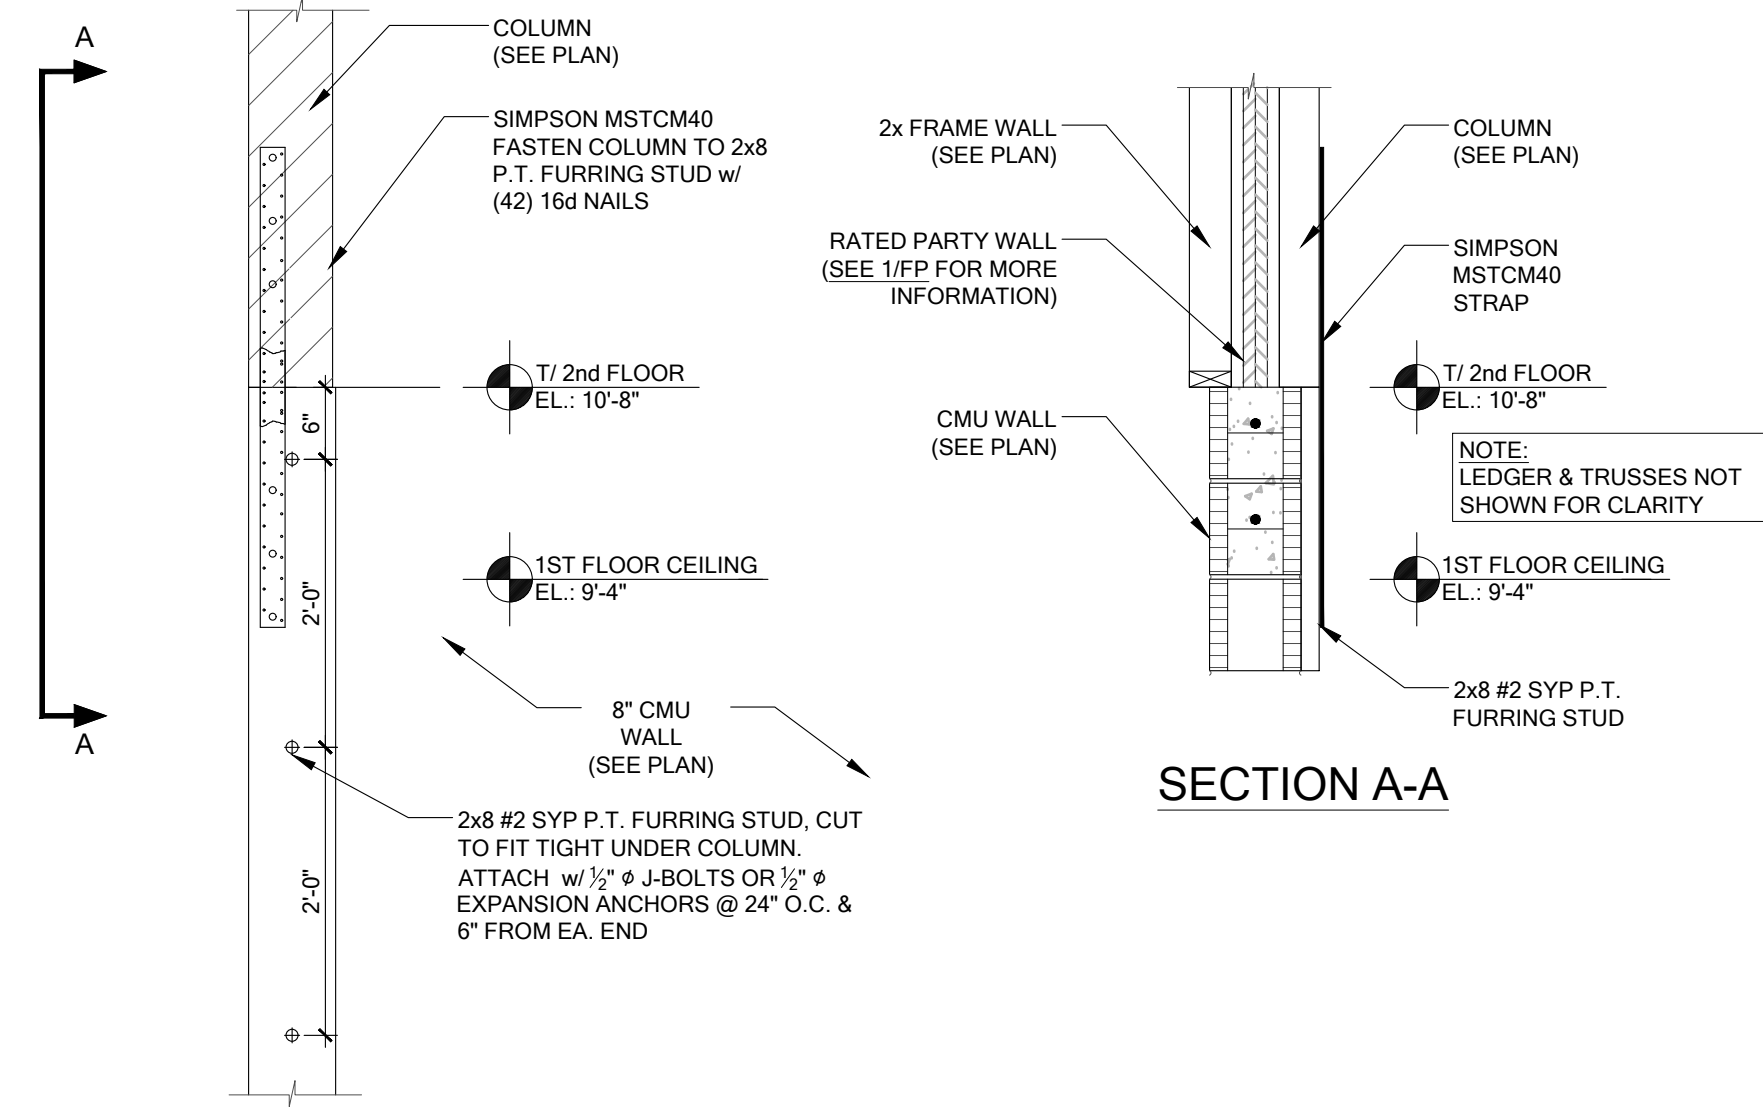

WF104 ELEVATION @ COLUMN
SCALE: 3/4" = 1'-0"


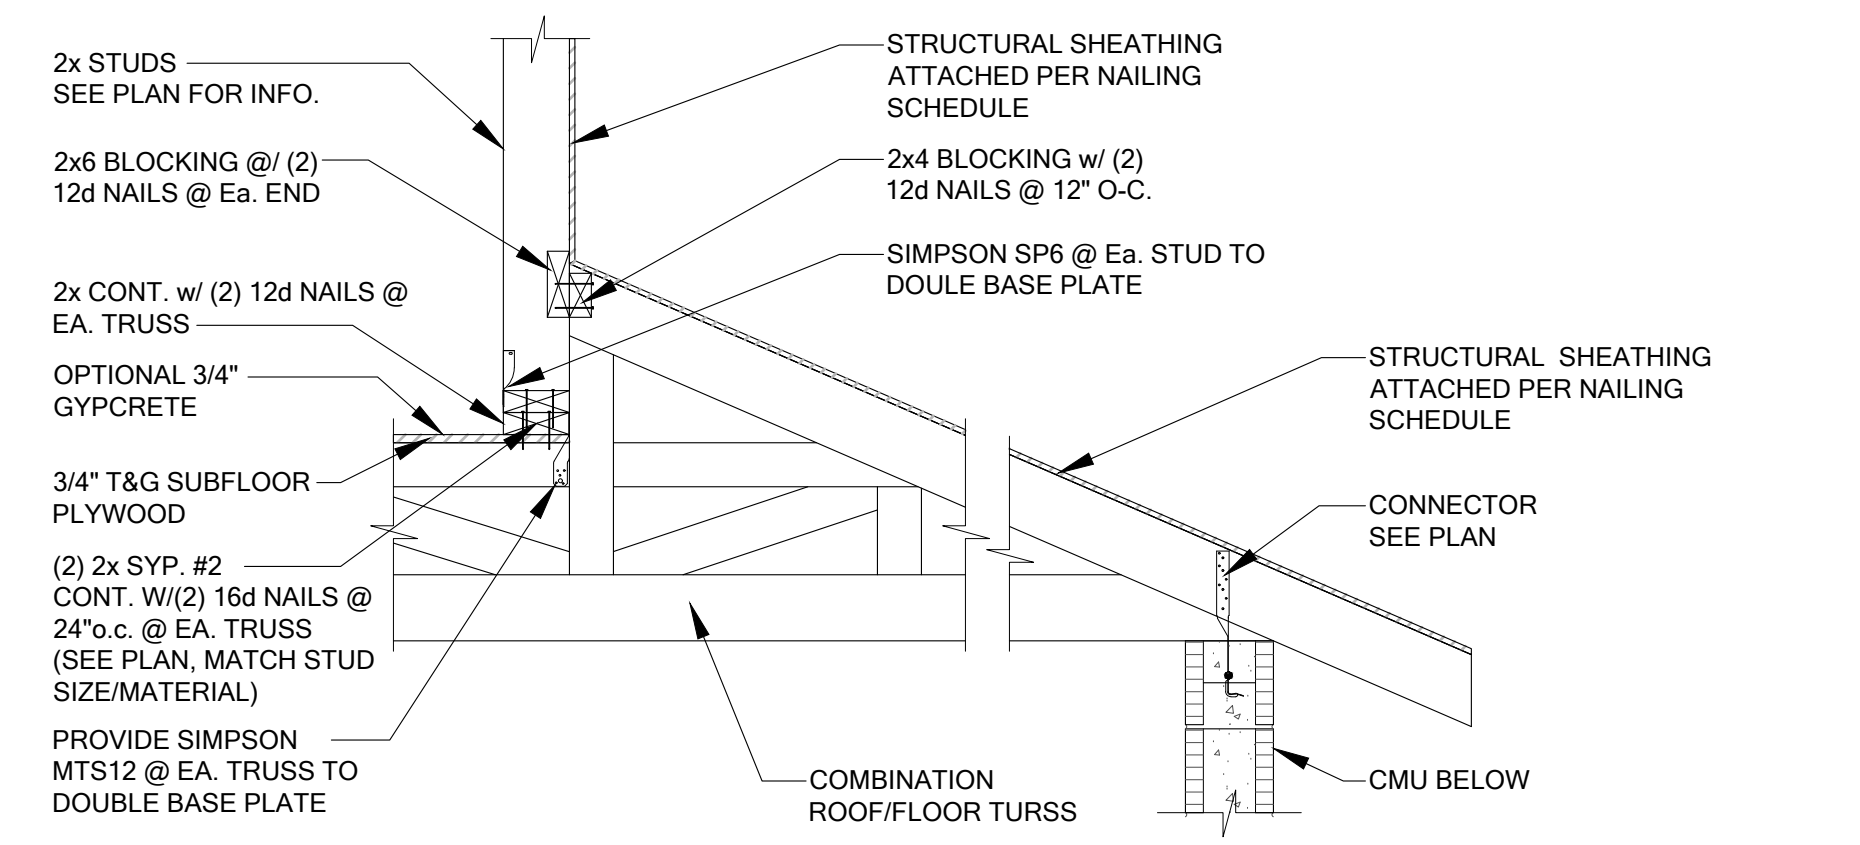


CT04 SECTION @ COMBINATION TRUSS
SCALE: 3/4" = 1'-0"

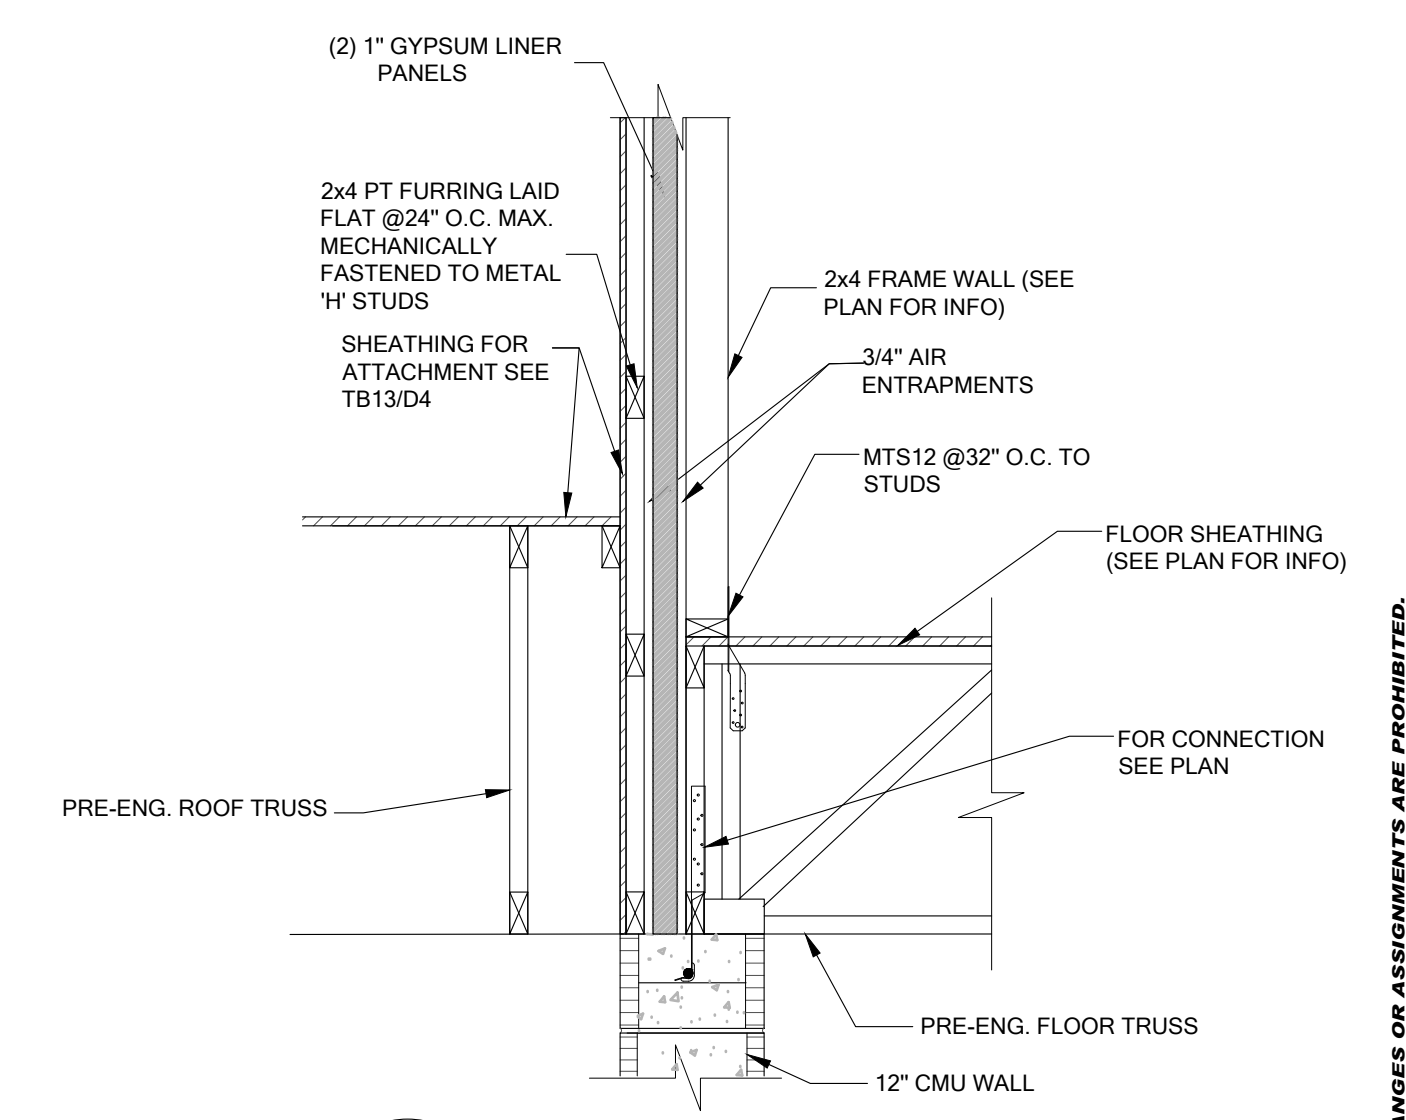


1 D4 OFFSET EXTERIOR WALL DETAIL
SCALE: 3/4" = 1'-0"


LOCATION OF BARRIER TO BE 1'-0" IN FRONT OF MECH. OR APP. WHEN REQUIRED

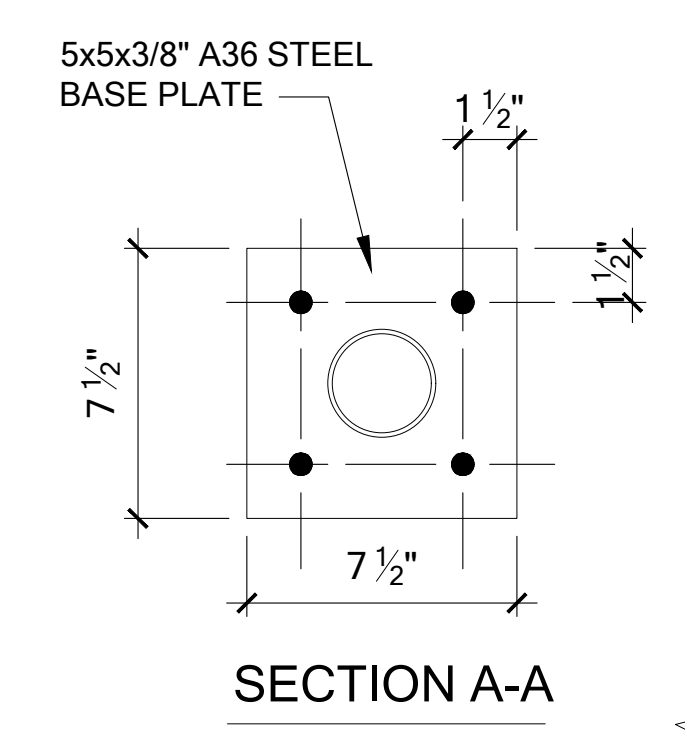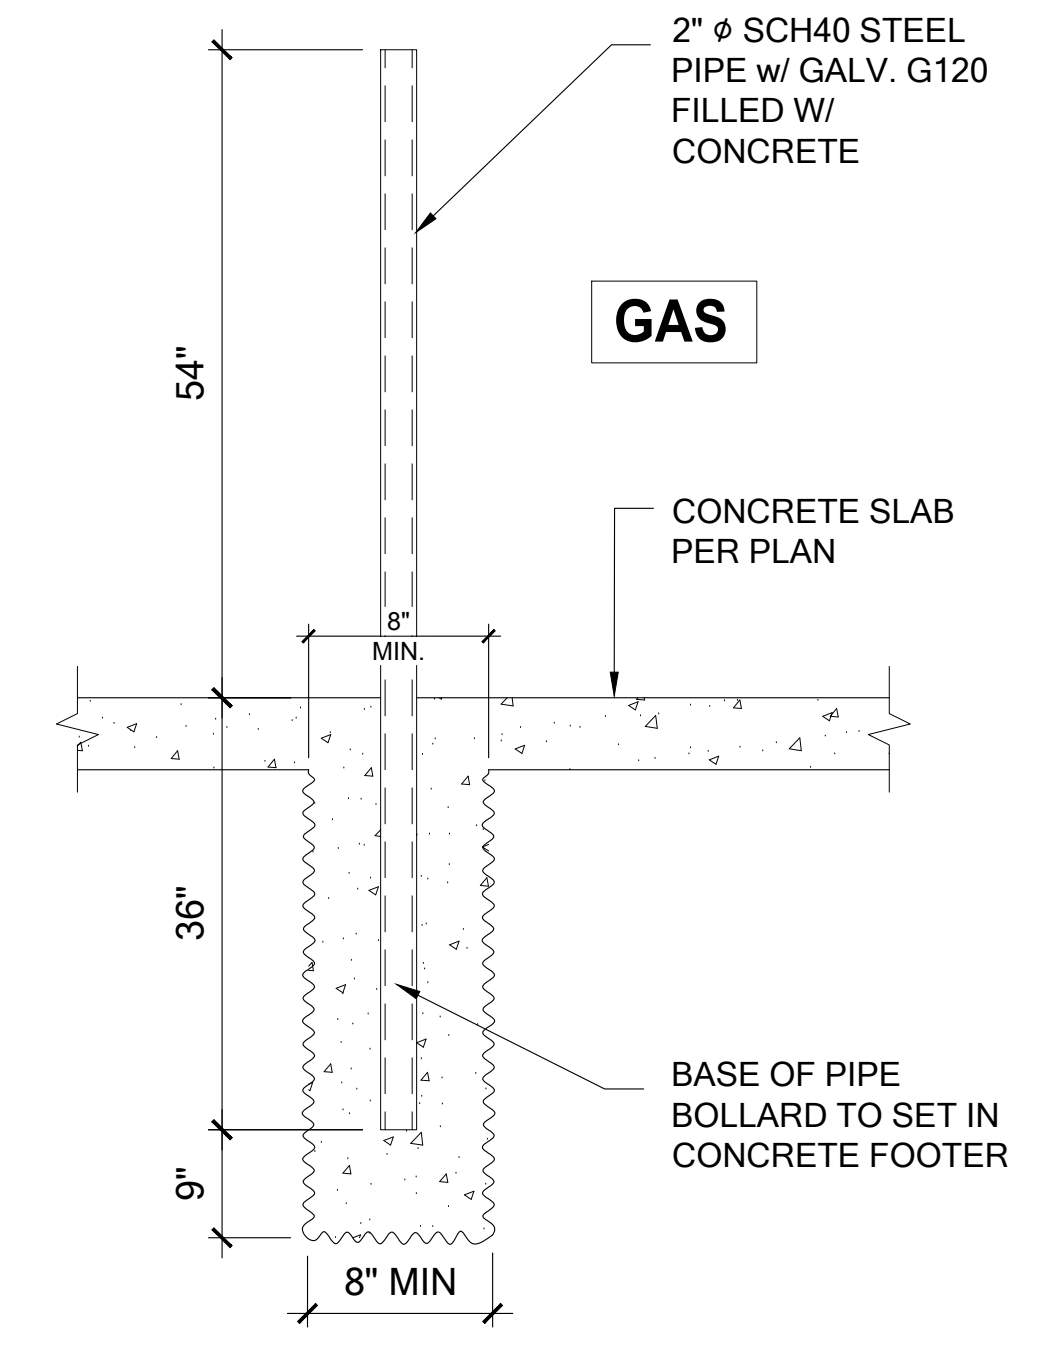

SECTION A-A

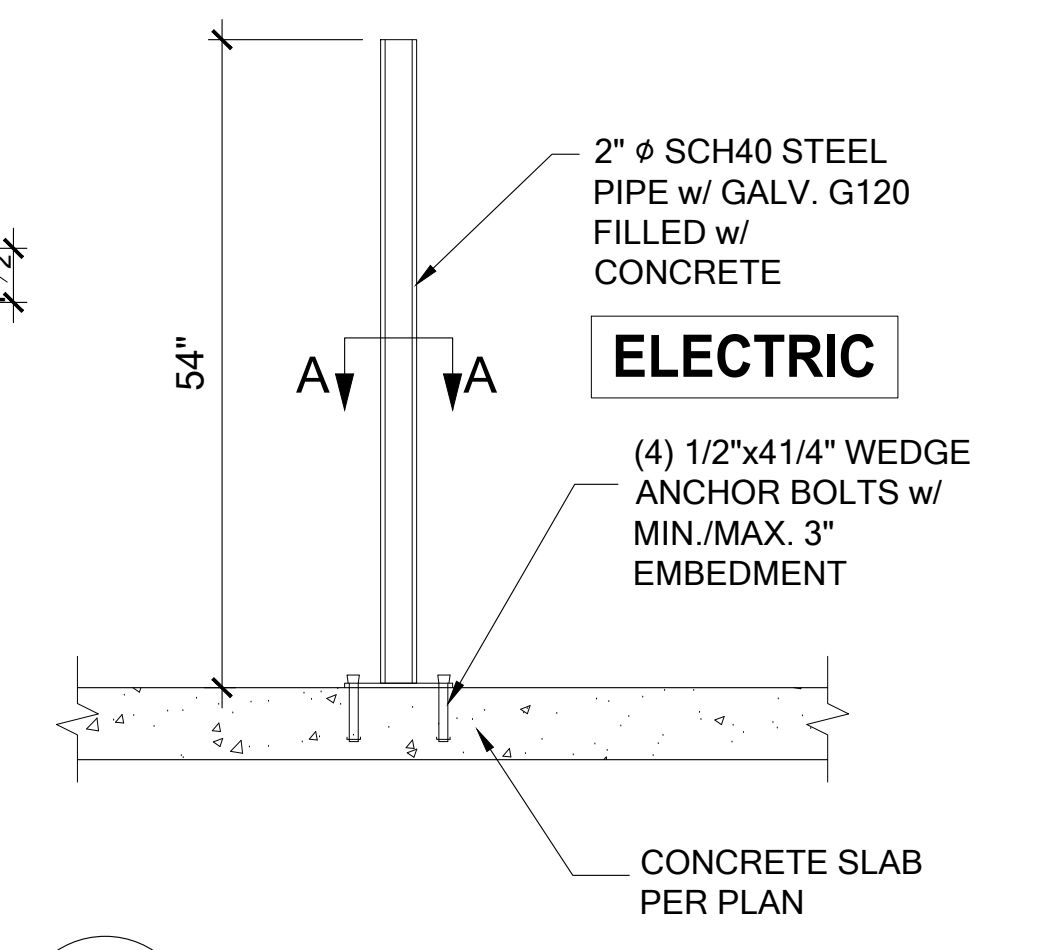

FM25 BOLLARD DETAIL
SCALE: 3/4" = 1'-0"

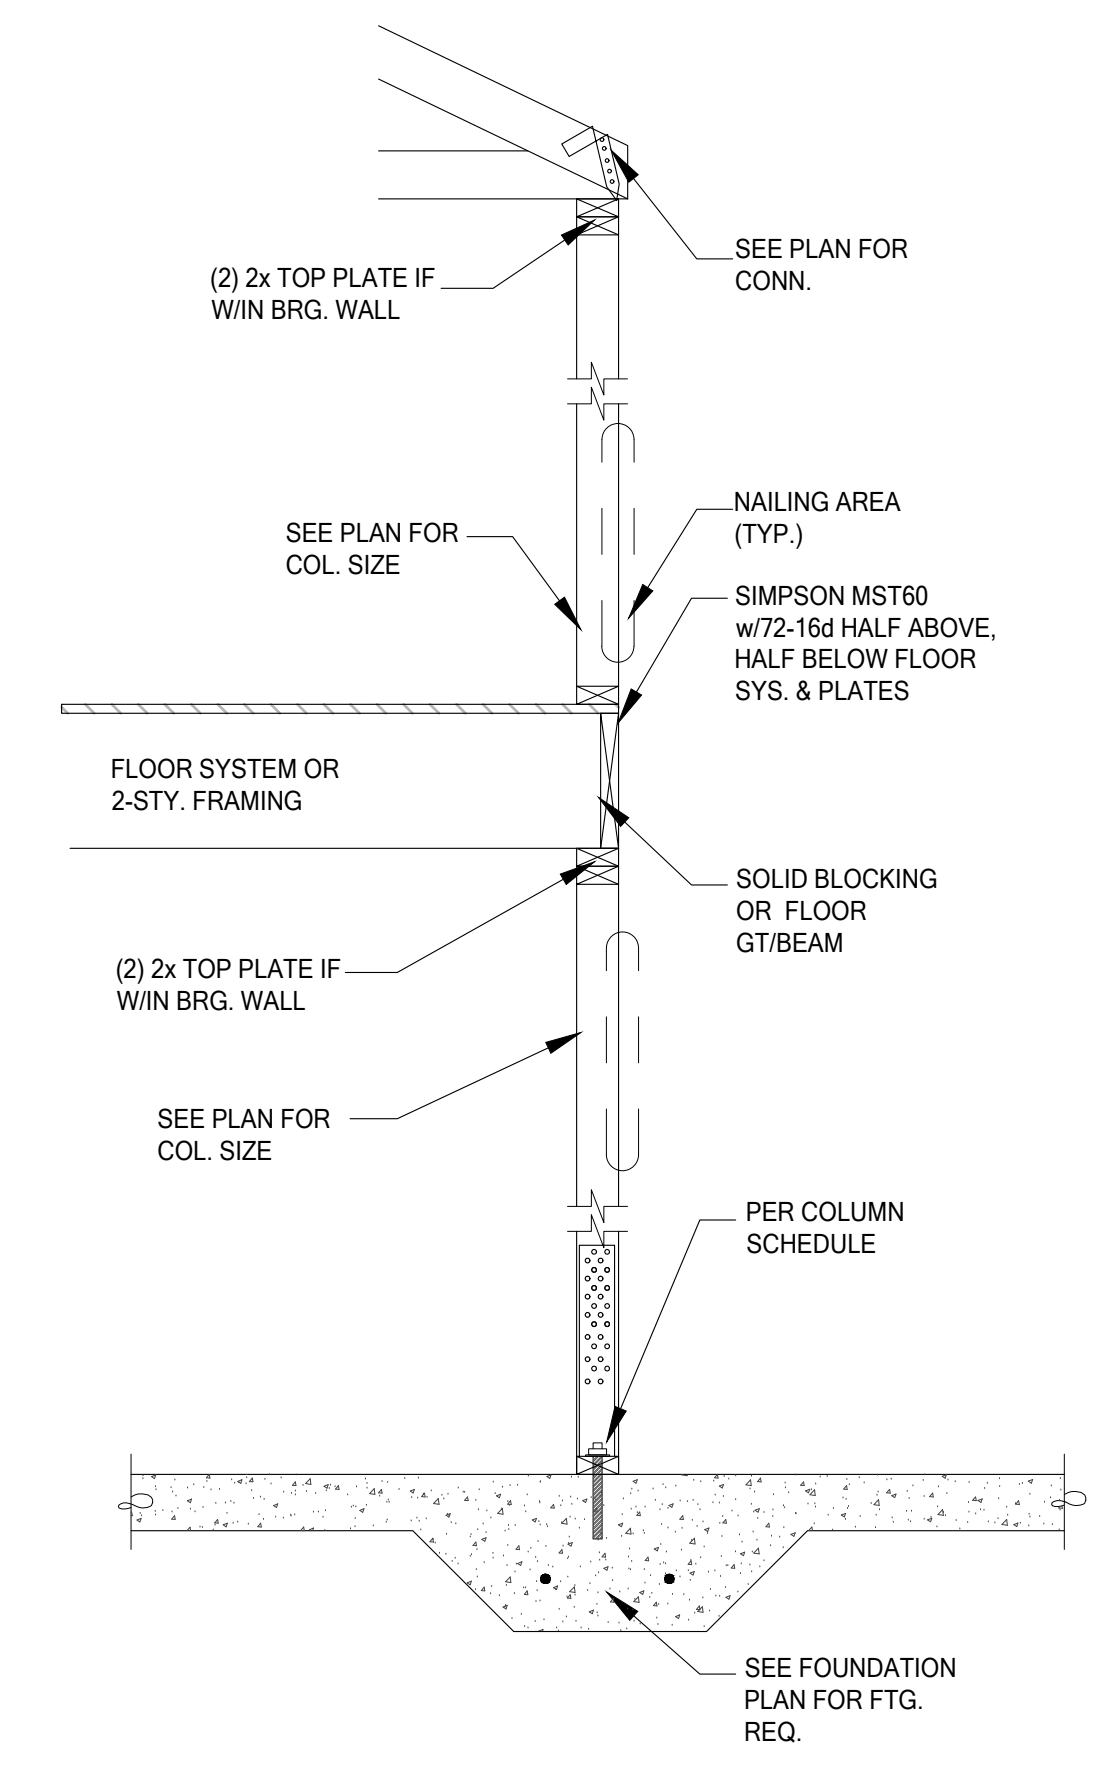

SG07 2 STORY COL. @ GIRDER
SCALE: 3/4" = 1'-0"

B&A Design Studio, Inc.
 4017 W. 1st Street
 Sanford, FL 32771
 ph 407 829 8900
 fax 407 829 2040
 www.badesignstudios.com


FDS
 258 Southhall Lane, Suite 200, Maitland, FL 32751
 O: 321-972-0491 F: 407-880-2304
 Certificate of Authorization No. 9161
 State of Florida
 PROFESSIONAL ENGINEER
 DATE: January 26, 2023

**PARK SQUARE
 HORIZONS WEST
 4-UNIT - ADAMS END UNITS**


title:
 project no. 2022142
 checked:
 drawn: AB
 date: 05-17-22
 scale:

D4


NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED

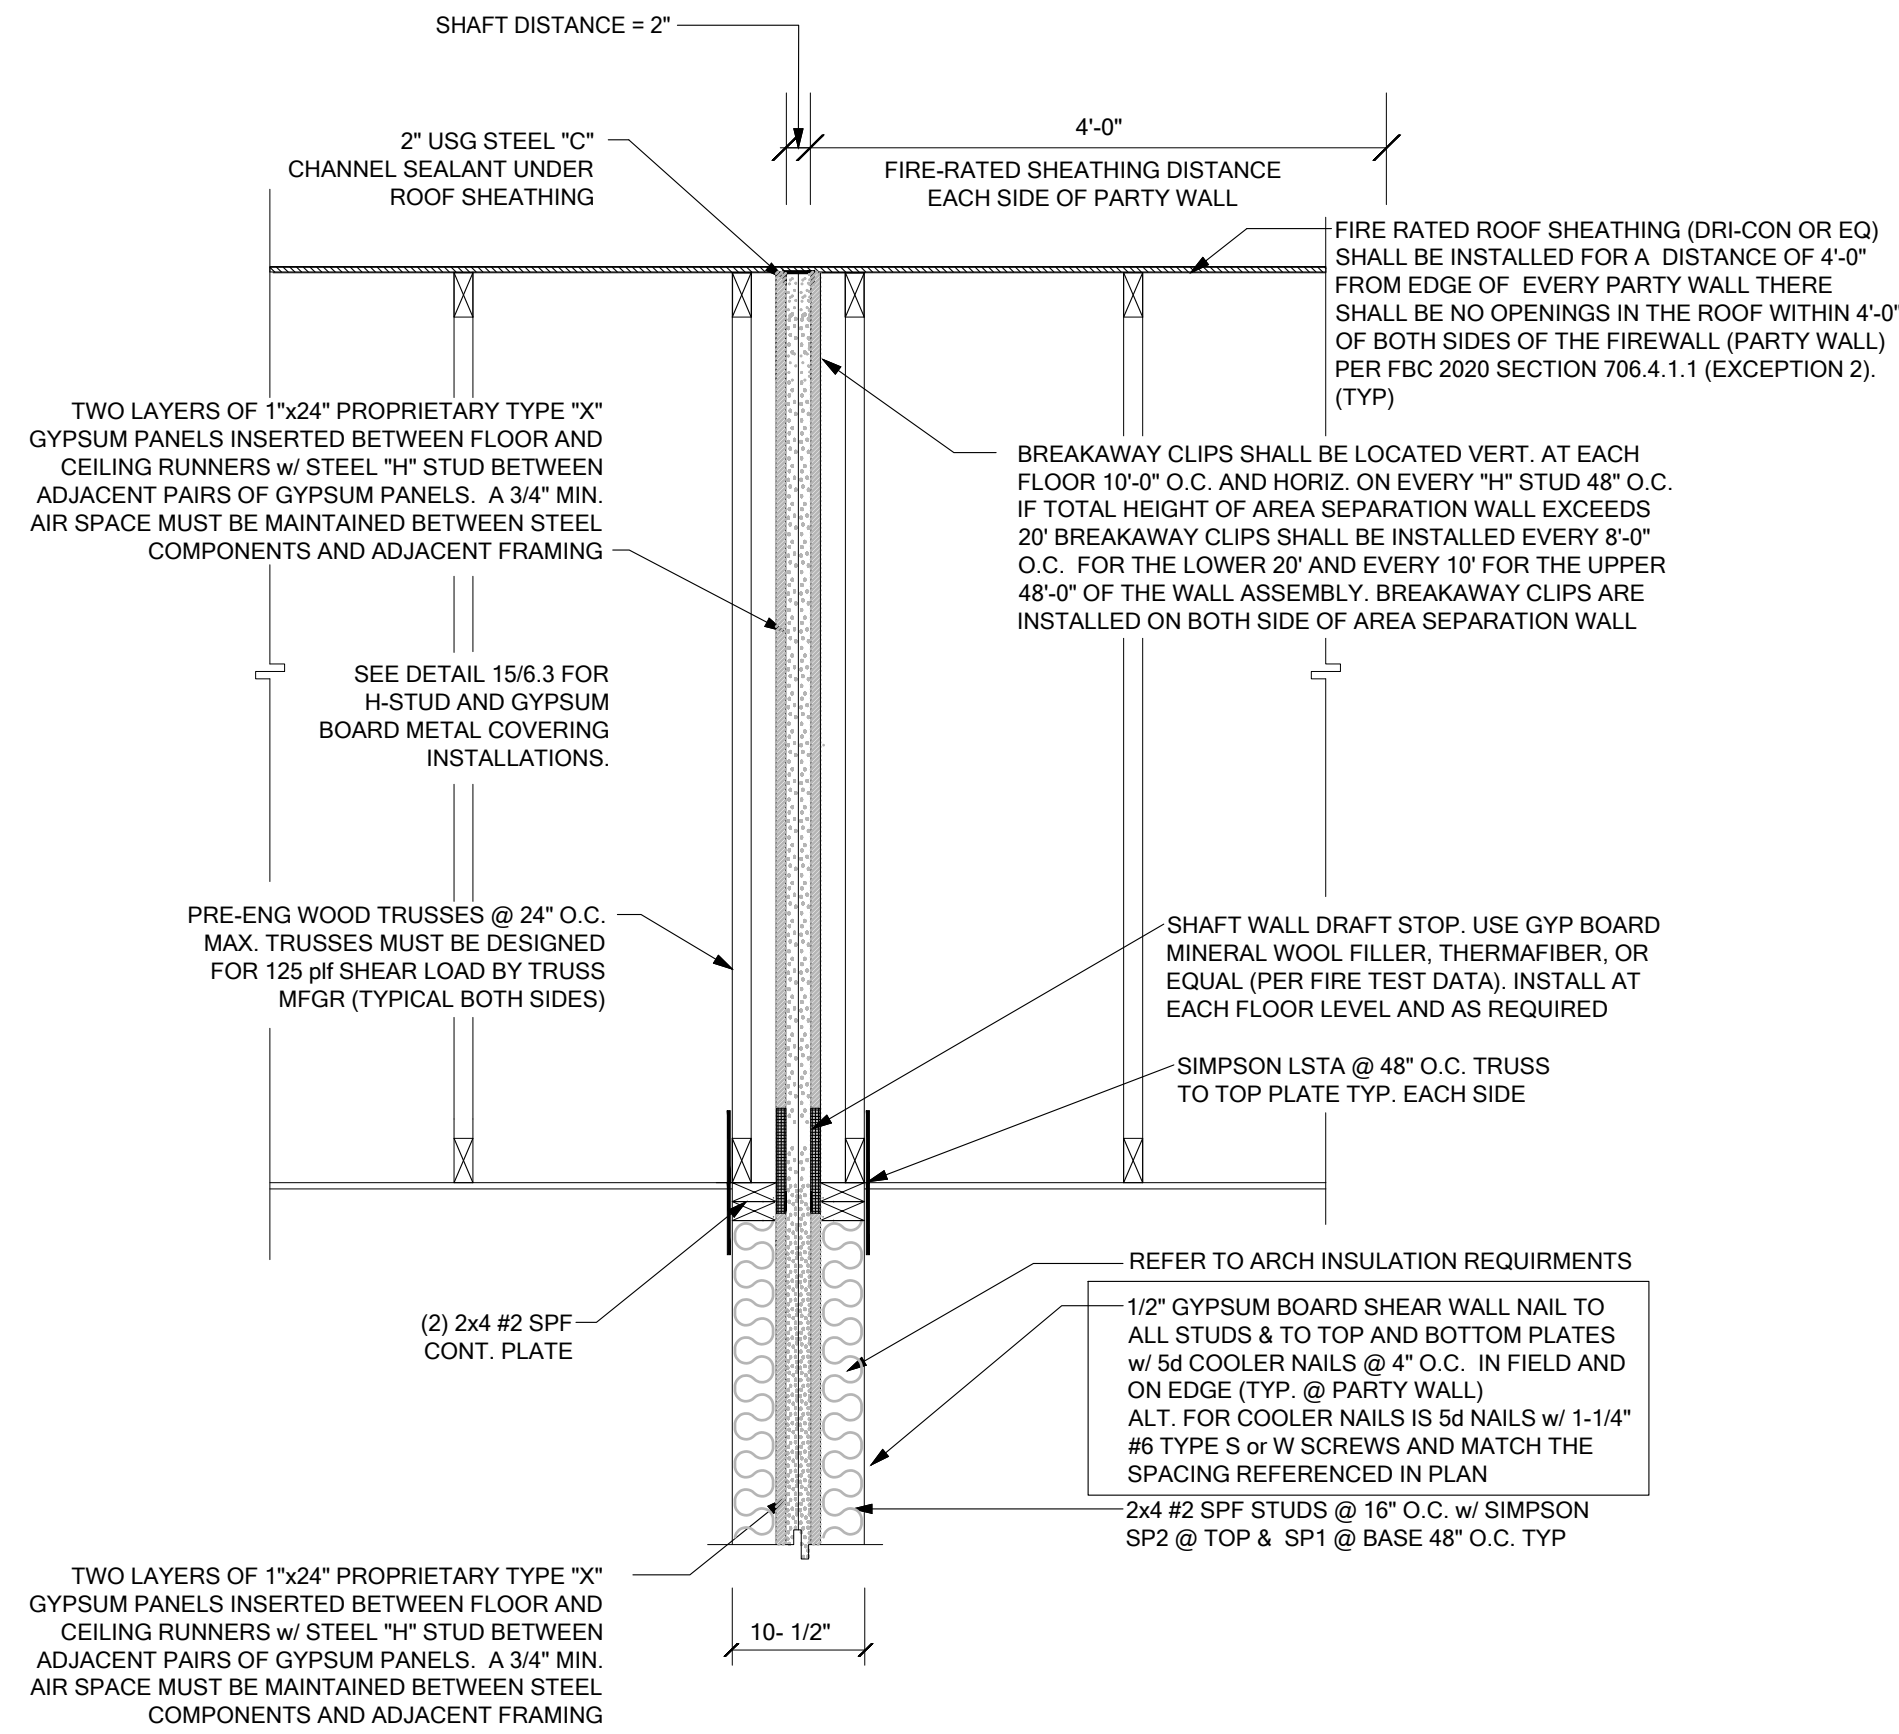


4 TYPICAL 2 STORY 2-HR. RATED PARTY WALL AT ROOF SYSTEM
SCALE: 3/4" = 1'-0"

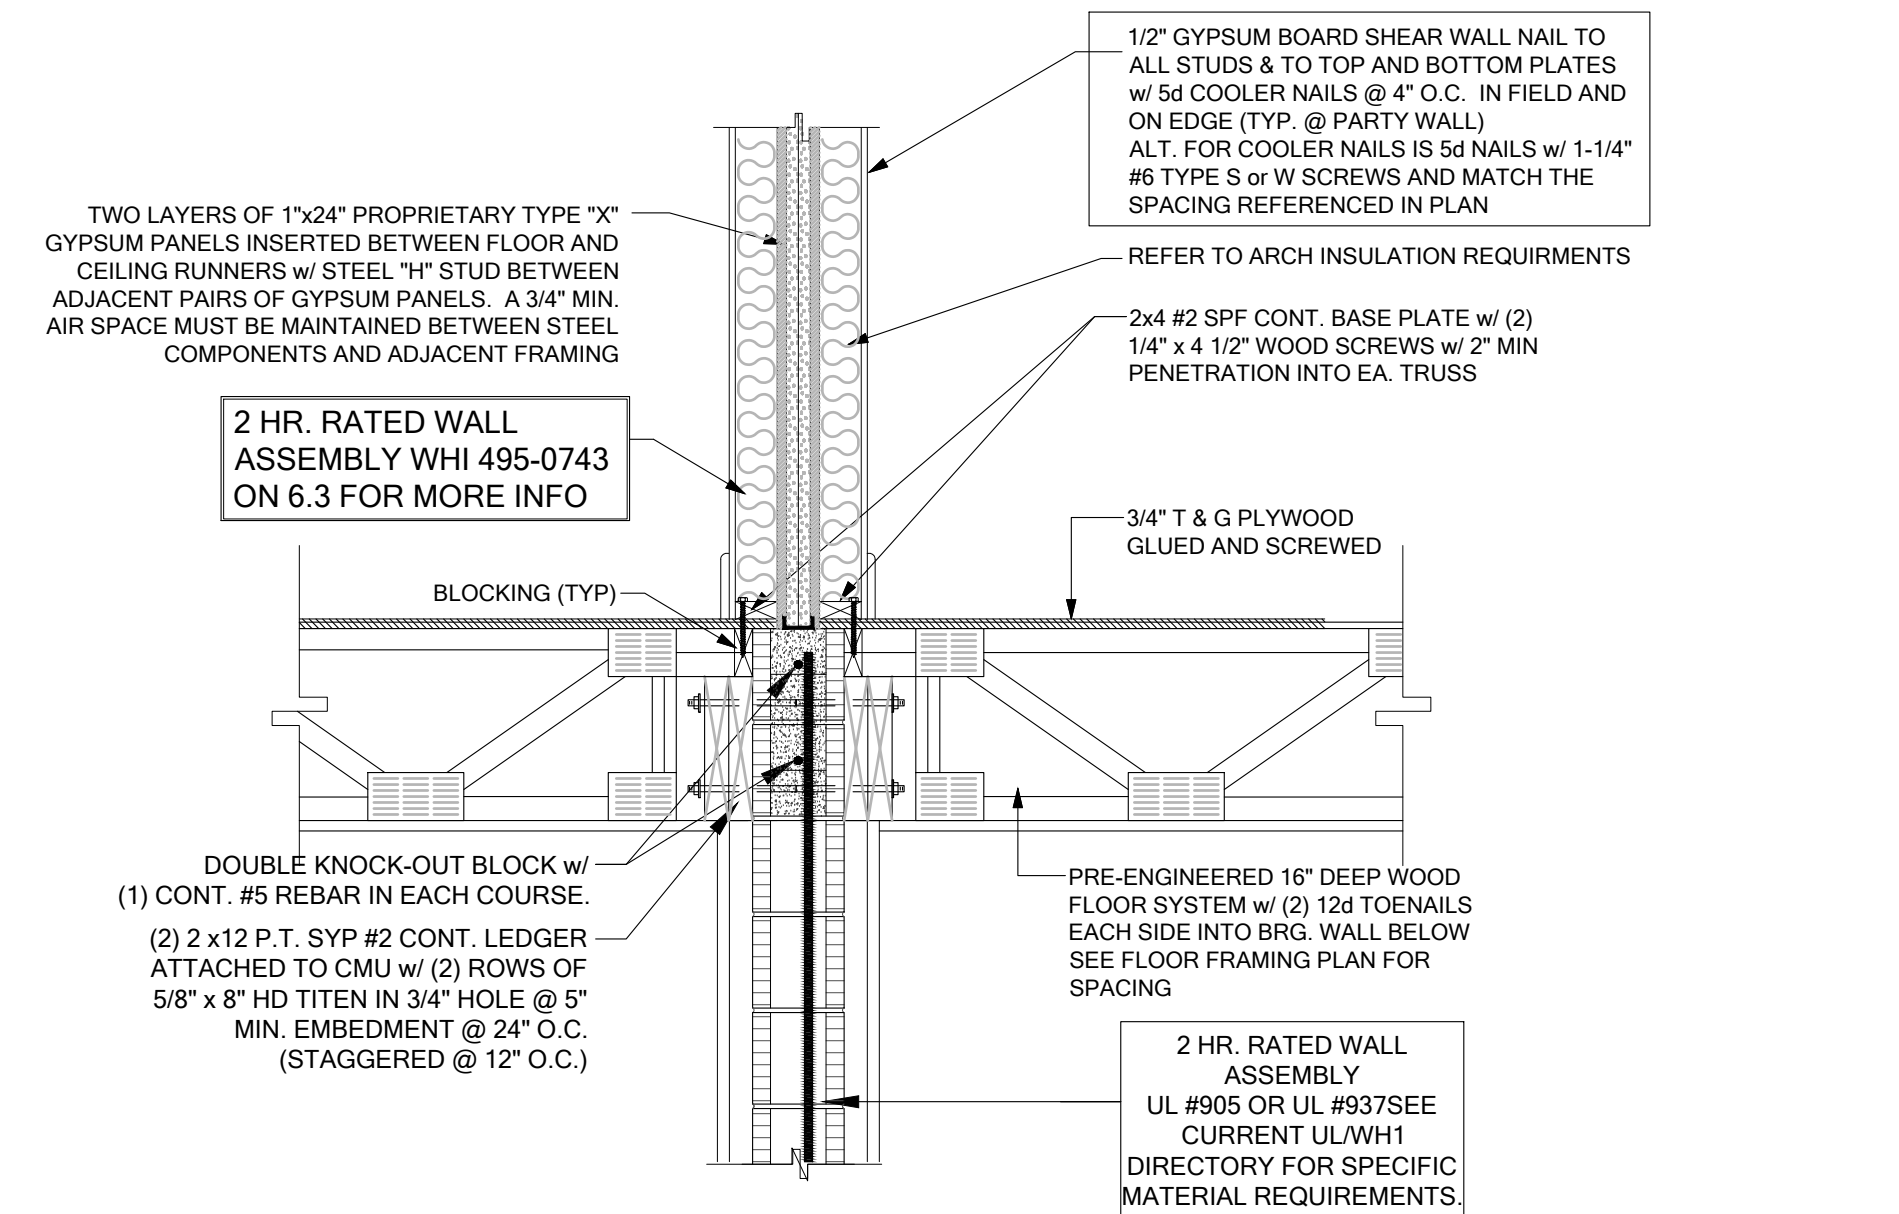


3 TYPICAL 2 STORY 2-HR. RATED PARTY WALL AT FLOOR SYSTEM
SCALE: 1/2" = 1'-0"

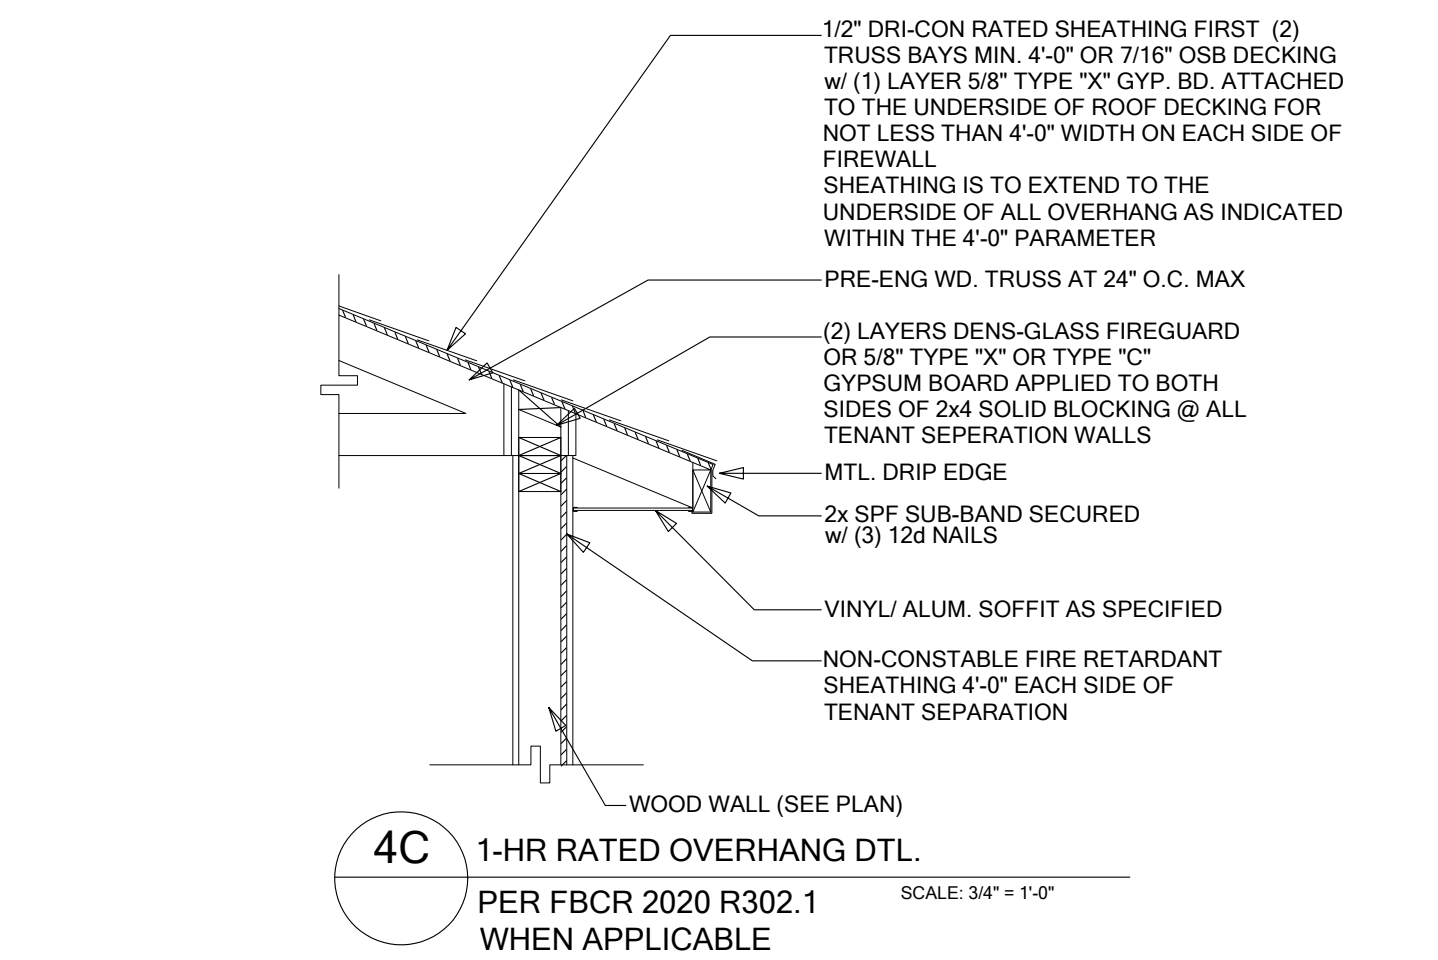


4C 1-HR RATED OVERHANG DTL.
PER FBCR 2020 R302.1 WHEN APPLICABLE
SCALE: 3/4" = 1'-0"

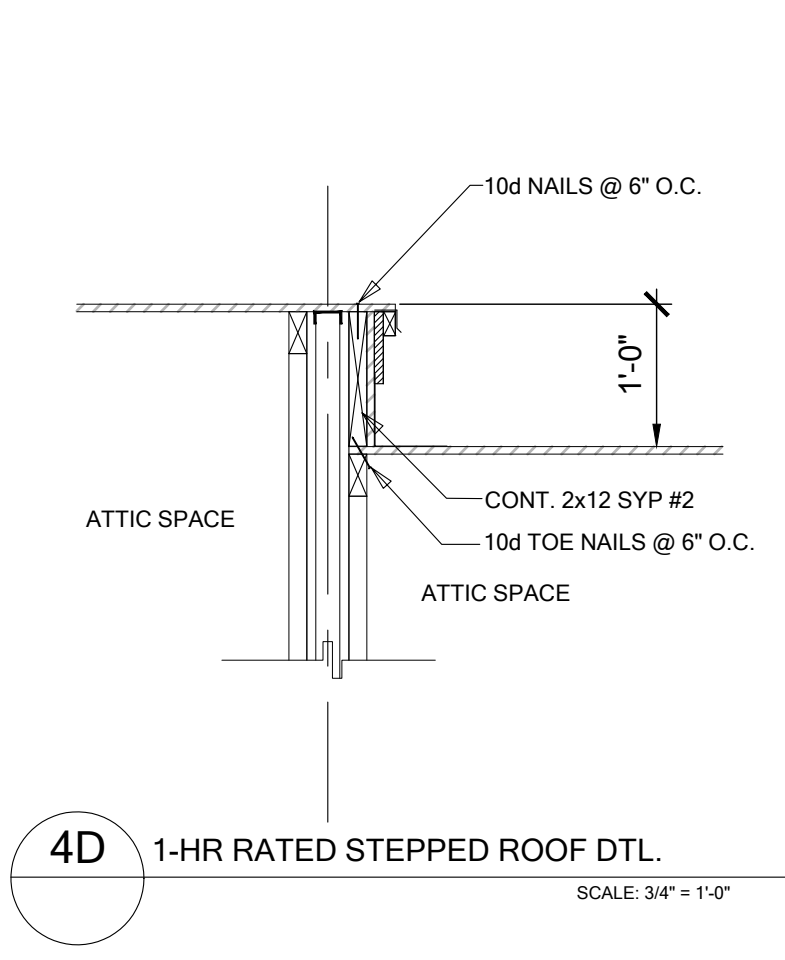


4D 1-HR RATED STEPPED ROOF DTL.
SCALE: 3/4" = 1'-0"

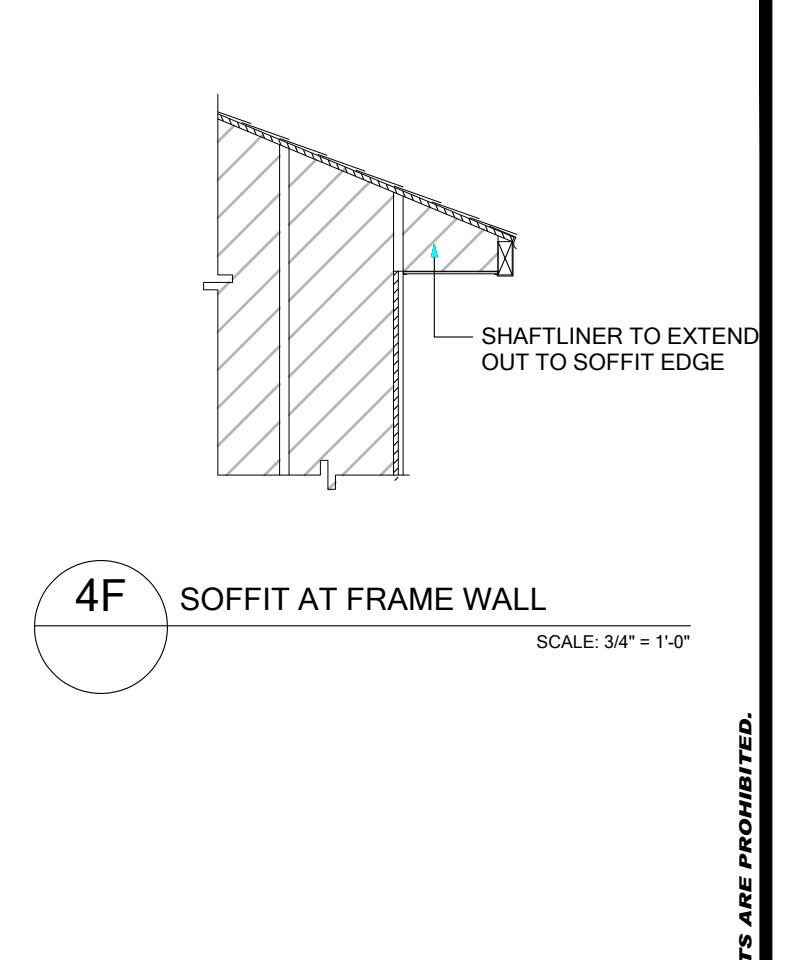


4F SOFFIT AT FRAME WALL
SCALE: 3/4" = 1'-0"

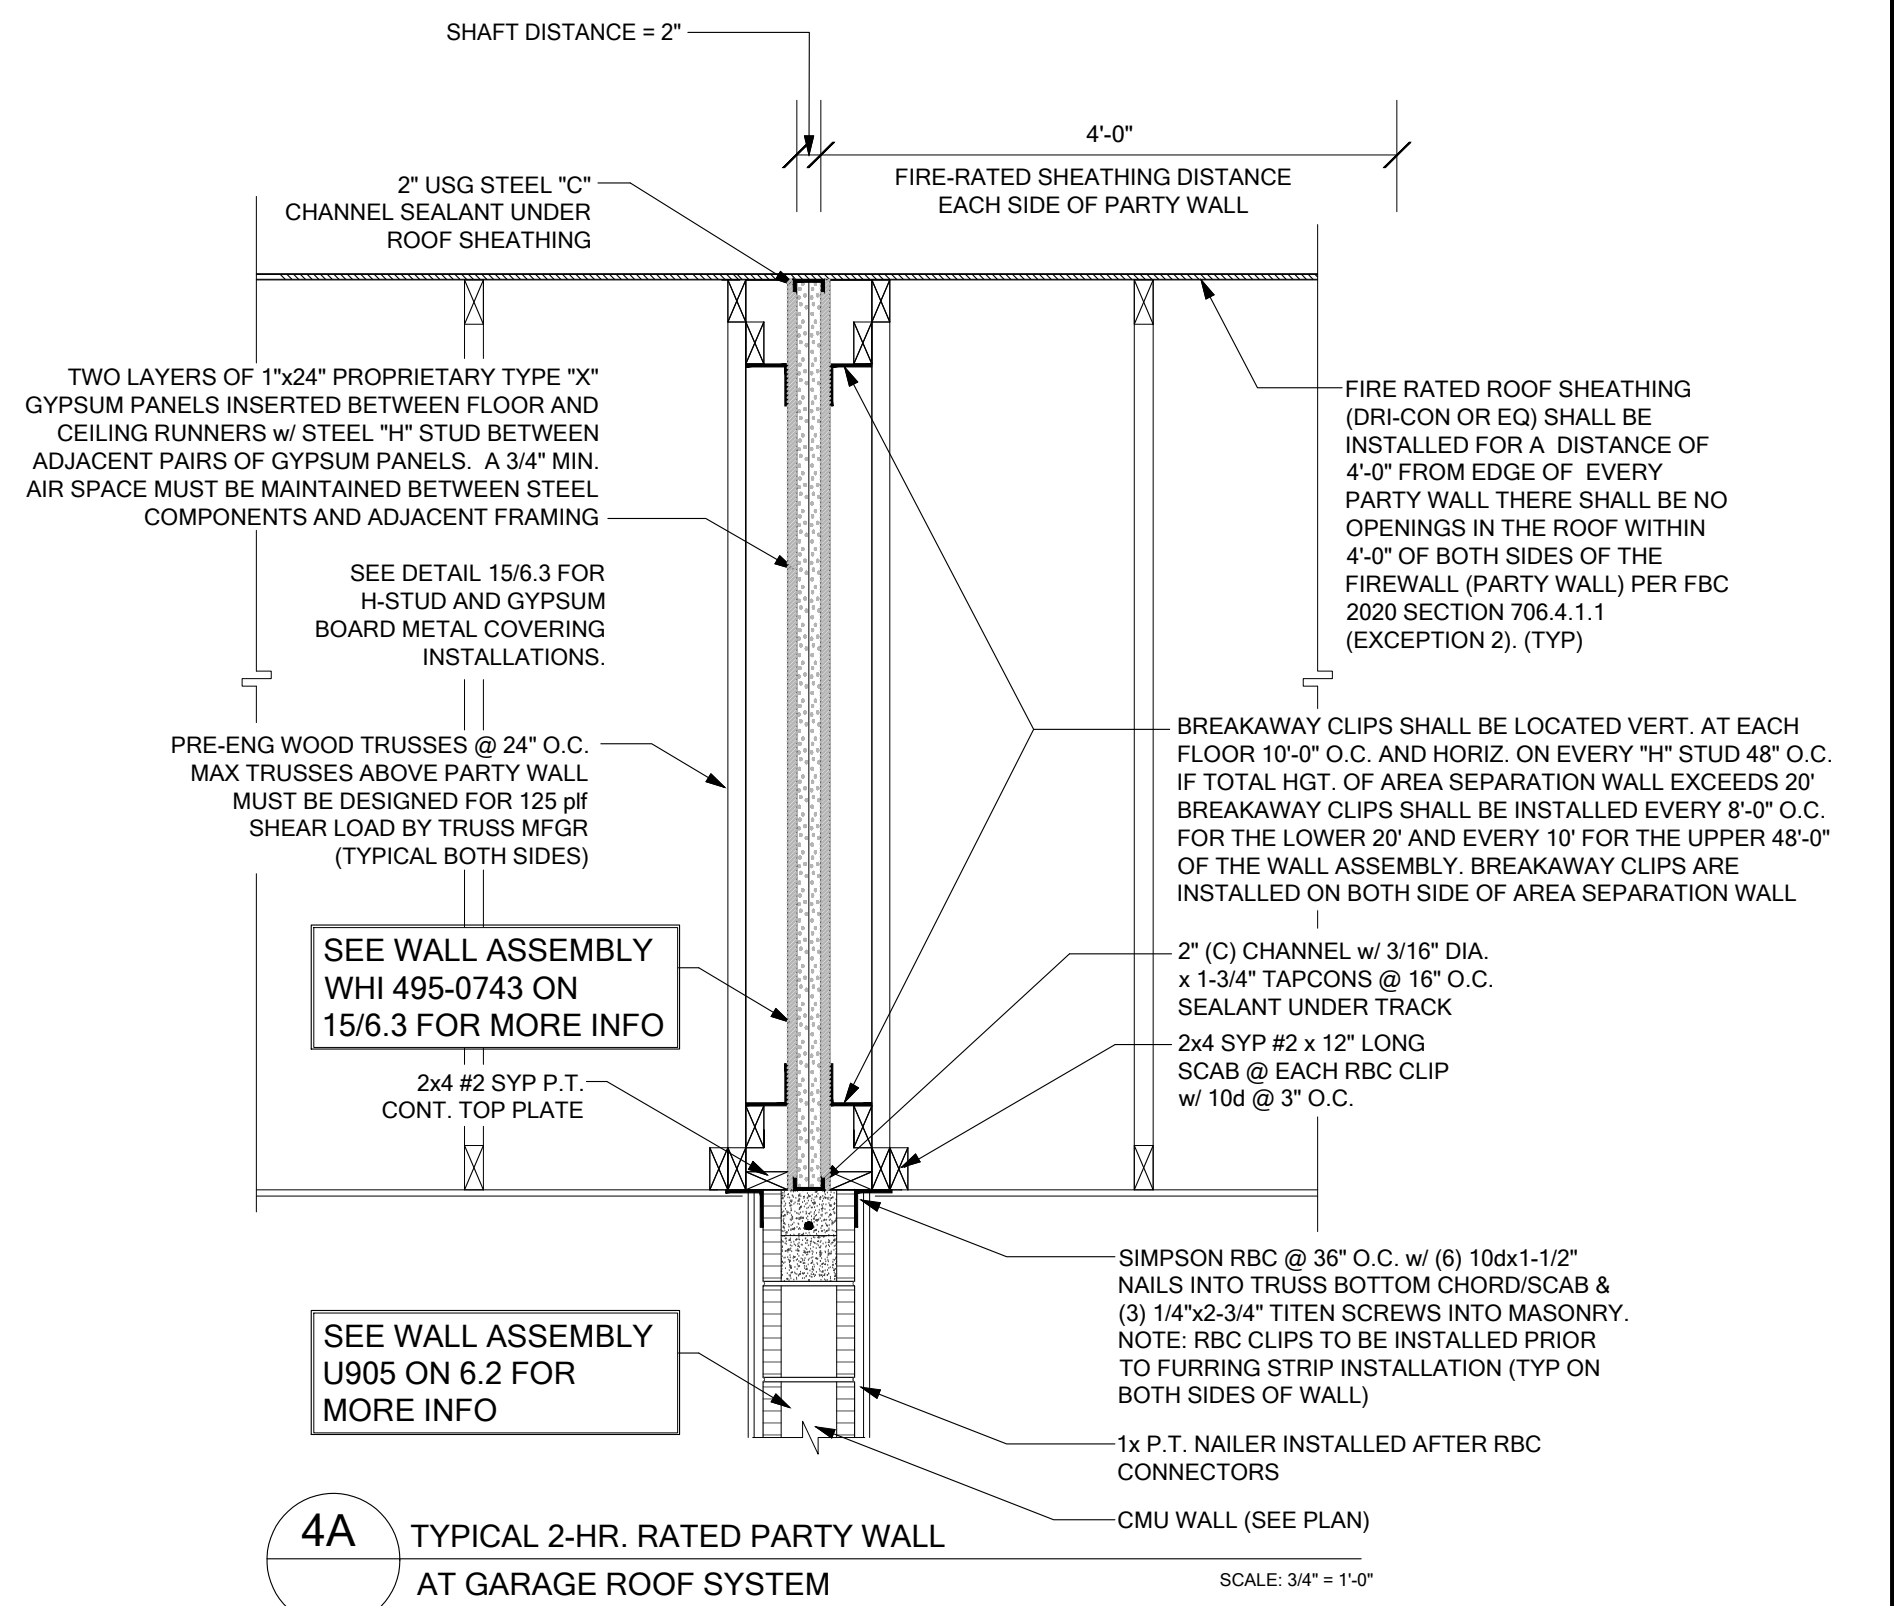

4A TYPICAL 2-HR. RATED PARTY WALL AT GARAGE ROOF SYSTEM
SCALE: 3/4" = 1'-0"

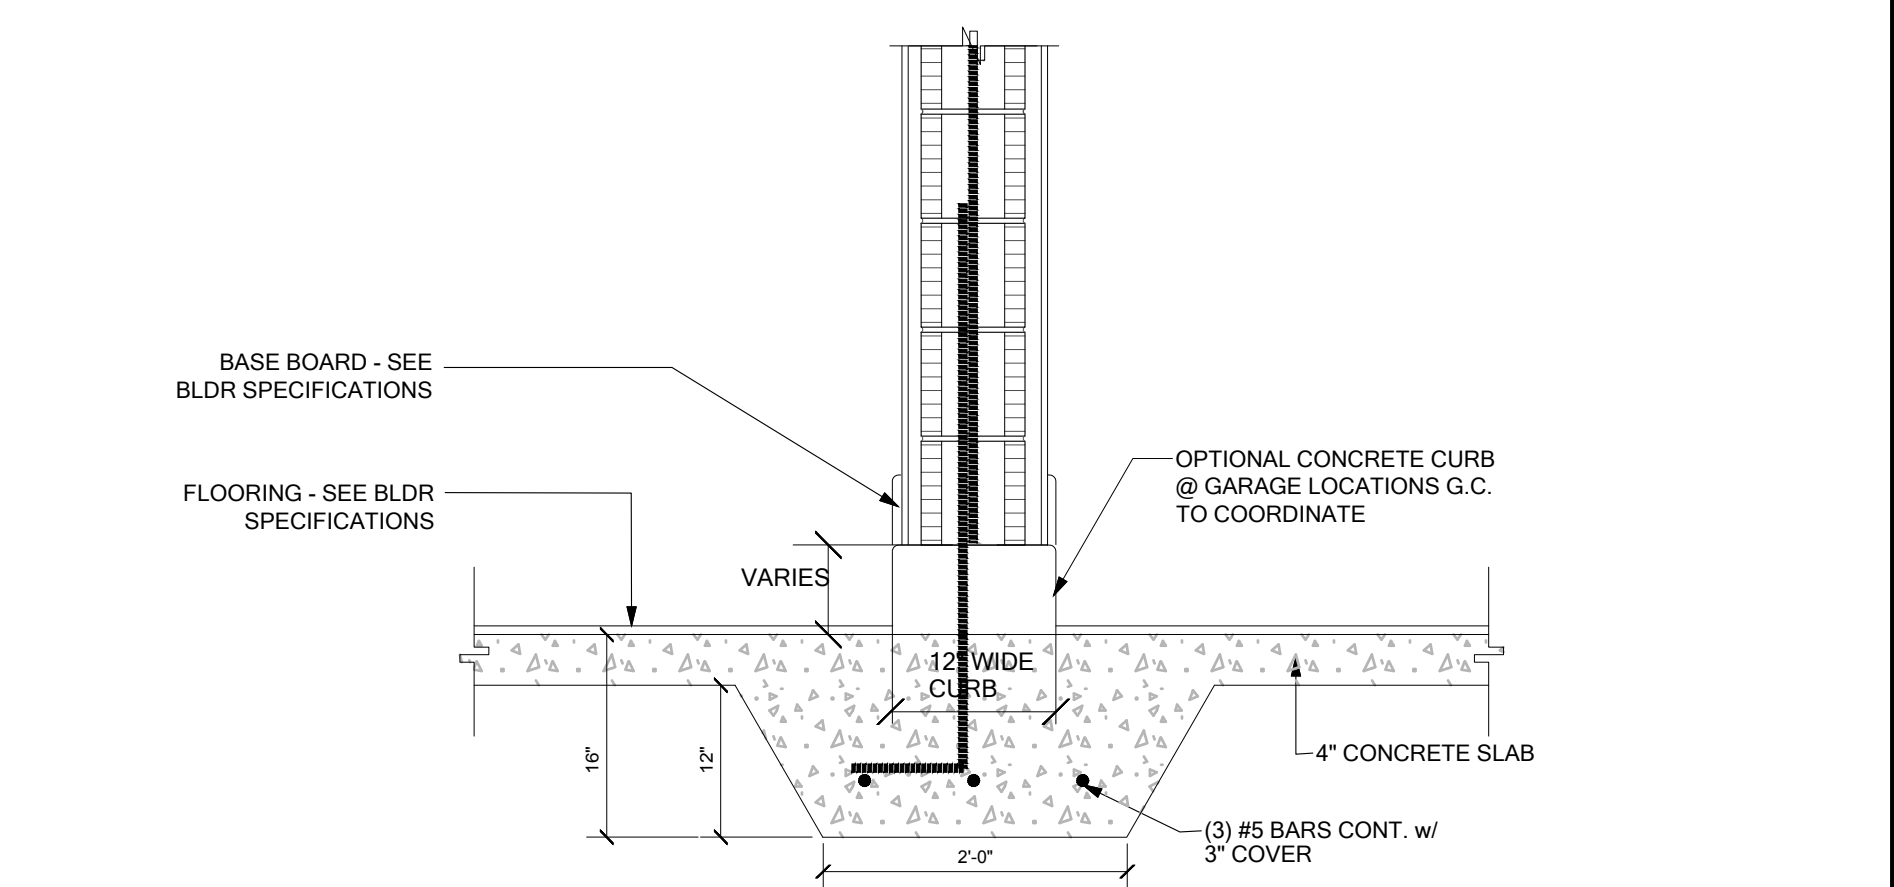

2 TYPICAL 2 STORY 2-HR. RATED PARTY WALL AT FOUNDATION
SCALE: 1/2" = 1'-0"

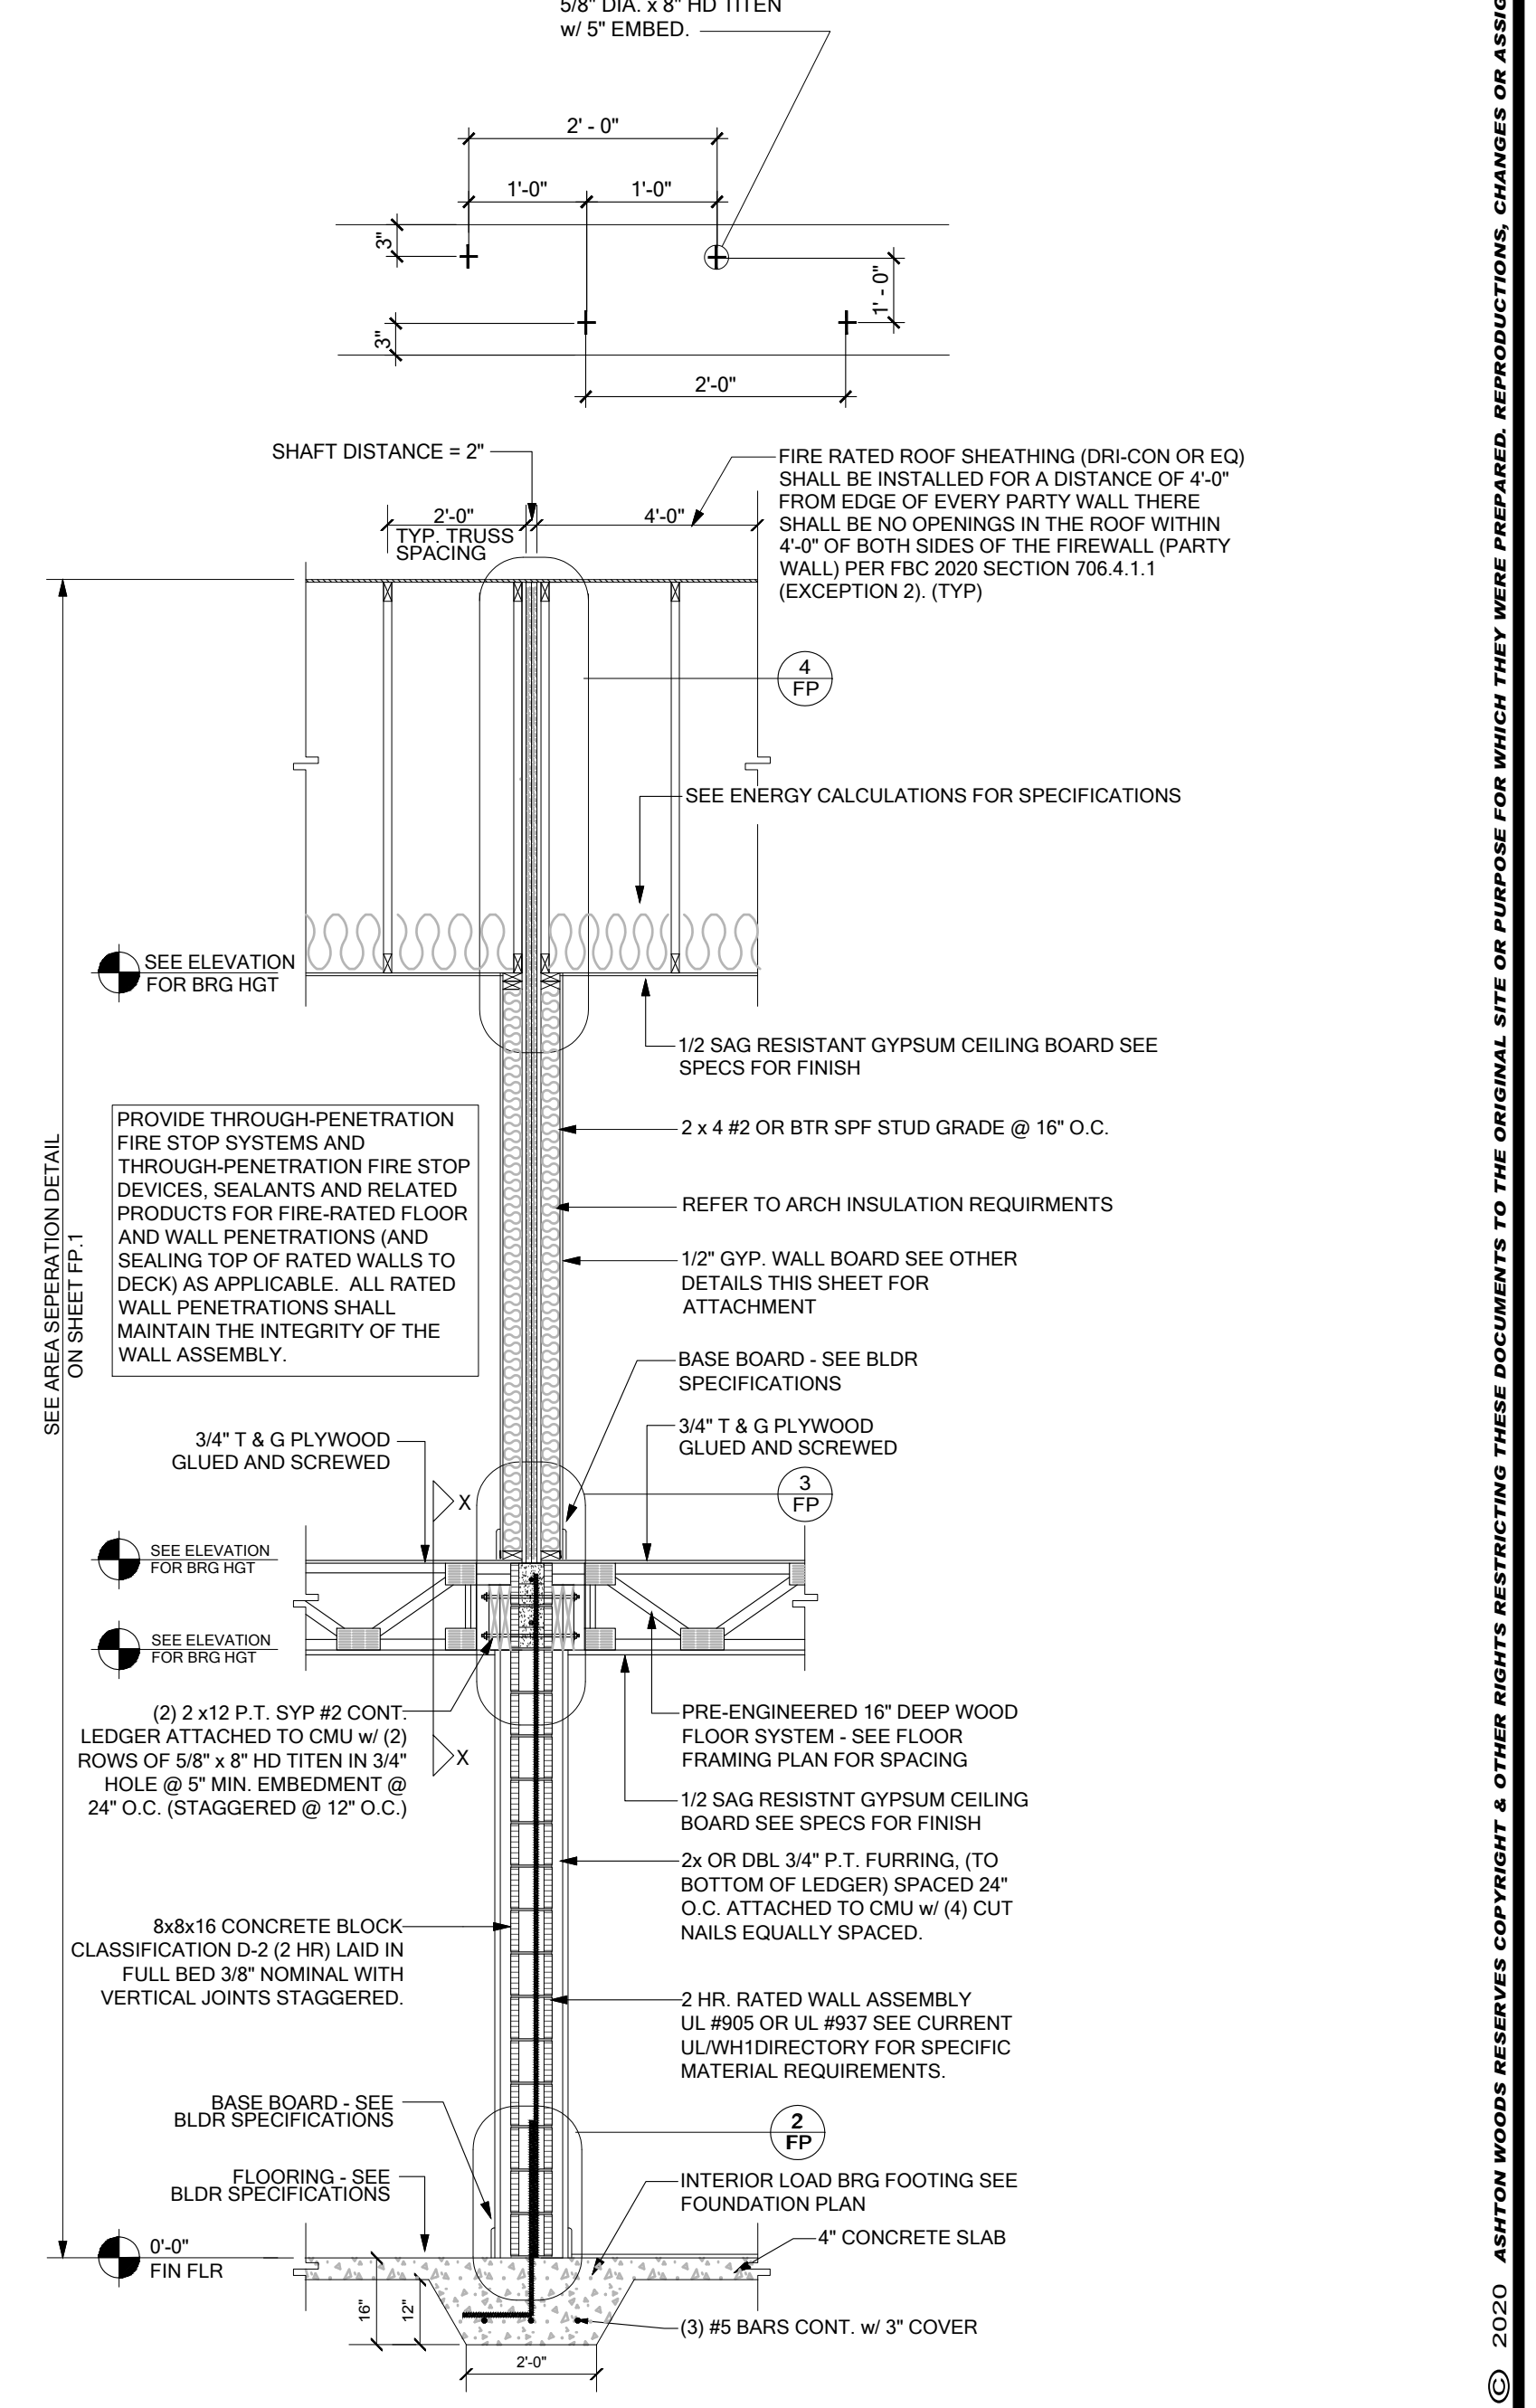

1 TYPICAL 2 STORY 2-HR. RATED PARTY WALL ASSEMBLY
SCALE: 1/2" = 1'-0"

B&A Design Studio, Inc.
4017 W. 1st Street
Sanford, FL 32771
ph 407 829 8900
fax 407 829 2040
www.badesignstudios.com

FDS
258 Southhall Lane, Suite 200, Maitland, FL 32751
O: 321-972-0491 F: 407-880-2304
Certificate of Authorization No. 9161
P.E. T. A. BROWN, P.E. - FL #77959
DATE: January 26, 2023
FOR THE STRUCTURAL DESIGN OF THIS DRAWING

**PARK SQUARE
HORIZONS WEST
4-UNIT - ADAMS END UNITS**

title:
project no. 2022142
checked:
drawn: AB
date: 05-17-22
scale:

FP
STRUCTURAL

NOTE: DRAWINGS ON 11"x17" SHEET WILL BE ONE HALF THE SCALE NOTED