



PARADISO GRANDE TOWNHOMES



5-UNIT:

(NAUTILUS, LATITUDE, LATITUDE II)

PAD SIZE 110'-0" x 70'-0"

SHEET INDEX:

A0	COVER SHEET
A1	SLAB PLAN
A2	FIRST FLOOR OVERALL
A3	SECOND FLOOR OVERALL
A4	FLOOR PLAN- "NAUTILUS"
A5	FLOOR PLAN- "LATITUDE"
A6	FLOOR PLAN- "LATITUDE II"
A7	ELEVATIONS- ELEV. "A"
A8	ELEVATIONS- ELEV. "B"
A9	BUILDING SECTIONS & ROOF LAYOUT- ELEV. "A&B"
A10	UNIT & STAIR SECTION- ELEV. "A&B"
A11	ARCHITECTURAL DETAILS
E1	ELECTRICAL LAYOUT- "NAUTILUS"
E2	ELECTRICAL LAYOUT- "LATITUDE"
E3	ELECTRICAL LAYOUT- "LATITUDE II"
S1	FOUNDATION PLAN
S1.2	2ND FLOOR DOWEL PLAN
S2	FIRST FLR. LINTEL PLAN
S3	SECOND FLR. LINTEL PLAN
S4	FLOOR TRUSSES
S5	ROOF TRUSSES- ELEV. "A"
S6	DETAILS
S7	FIREWALL DETAIL
D1	STRUCTURAL DETAILS
D2	STRUCTURAL DETAILS
D3	STRUCTURAL DETAILS
D4	STRUCTURAL DETAILS
D5	STRUCTURAL DETAILS
D6	STRUCTURAL DETAILS

REVISION SCHEDULE:

NO.	DATE	DESCRIPTION	BY:
1	05/25/22	CREATED MASTER	M.C.
2	09/2/22	ADDED WATER PROOFING NOTE	A.M.
3	09/09/22	REMOVED STUCCO TRIM OVER GARAGE DOOR.	C.C.
4	04/10/23	MASTER REVISIONS RECEIVED FROM PSH- SEE PARK SQUARE REDLINE FOLDER MARKED 03/30, 04/04, 04/05, 04/06/23	C.C.
5	05/19/23	PERMIT REJECTIONS	C.C.
6	07/27/23	REVISED BANDING ON FRONT ELEVATION BUMP-OUT FOR ELEV. A	C.C.
7	09/26/23	SHOW A FIBER GLASS UNIT SHOWER IN BATH #5 ILO RECESS.	G.P.
8	10/10/23	PROTOTYPE FRAME WALK REVISIONS	G.P.
9	01/22/24	ROOF CRICKETS UPDATE	C.C.
10	1/24/24	WP, OUTLET AND COACH LIGHT MOVED	G.P.
11	3/4/24	3 SHELVES WERE ADDED TO ALL PANTRIES, AGAINST THE WALL OF ALL UNITS.	G.P.

DISTRIBUTED LIVE LOAD

(N POUNDS PER SQ. FT.)	
10	UNINHABITABLE ATTICS WITHOUT STORAGE
20	UNINHABITABLE ATTICS WITH LIMITED STORAGE
30	HABITABLE ATTICS & ATTICS SERVED WITH FIXED STAIRS
40	BALCONIES (EXTERIOR) AND DECKS
200	GUARDS AND HANDRAILS
50	GUARD INFILL COMPONENTS
40	PASSENGER VEHICLE GARAGES
30	ROOMS OTHER THAN SLEEPING ROOMS
30	SLEEPING ROOMS
40	STAIRS

ANSI STANDARD FOR MEASURING HOUSES

THE ANSI STANDARD FOR MEASURING HOUSES: NATIONAL STANDARD Z765-1996 REVISION CONSTRUCTION THE ANSI STANDARD BASE FLOOR AREA CALCULATIONS ON THE EXTERIOR DIMENSIONS OF THE BUILDING AT EACH FLOOR LEVEL AND INCLUDE ALL INTERIOR WALLS AND VOIDS FOR ATTACHED UNITS. THE OUTSIDE DIMENSION IS THE CENTER LINE OF THE COMMON WALLS. INTERNAL ROOM DIMENSIONS ARE NOT USED IN THIS SYSTEM OF MEASURING. THE ANSI STANDARD BASE FLOOR AREA CALCULATIONS ON THE EXTERIOR DIMENSIONS OF THE BUILDING AT EACH FLOOR LEVEL AND INCLUDE ALL INTERIOR WALLS AND VOIDS FOR ATTACHED UNITS. THE OUTSIDE DIMENSION IS THE CENTER LINE OF THE COMMON WALLS. INTERNAL ROOM DIMENSIONS ARE NOT USED IN THIS SYSTEM OF MEASURING.

THE ANSI STANDARD BASE FLOOR AREA CALCULATIONS ON THE EXTERIOR DIMENSIONS OF THE BUILDING AT EACH FLOOR LEVEL AND INCLUDE ALL INTERIOR WALLS AND VOIDS SEPARATED INTO TWO AREAS:

- AIR-CONDITIONED SPACE
- NON-AIR-CONDITIONED SPACE (GARAGES, PATIOS, PORCHES, BREEZEWAYS)

THE ANSI STANDARDS DEFINE "FINISHED AREA" AS "AN ENCLOSED AREA IN A HOUSE SUITABLE FOR YEAR-ROUND USE. EMBODYING WALLS, FLOORS, AND CEILINGS THAT ARE LIKE THE REST OF THE MEASUREMENTS MUST BE TAKEN TO THE NEAREST INCH OR TENTH OF A FOOT, AND FLOOR AREA MUST BE REPORTED TO THE NEAREST SQUARE FOOT. THESE WOULD INCLUDE BONUS/ATTIC SPACES AND ARE USUALLY LISTED SEPARATELY."

AREA (SQ. FT.)	(+) VALUE DENOTES PRESSURE	(-) VALUE DENOTES SUCTION
10	(+) 29.4 / (-) 31.9	(+) 29.4 / (-) 39.4
20	(+) 28.1 / (-) 30.6	(+) 28.1 / (-) 38.7
50	(+) 26.3 / (-) 28.8	(+) 26.3 / (-) 33.2
100	(+) 25.0 / (-) 27.5	(+) 25.0 / (-) 30.6

AREA	(+) VALUE DENOTES PRESSURE	(-) VALUE DENOTES SUCTION
16'-0" x 8'-0"	(+) 21.7	(-) 24.4
16'-0" x 7'-0"	(+) 20.3	(-) 27.2
9'-0" x 8'-0"	(+) 25.80	(-) 25.9
9'-0" x 7'-0"	(+) 24.10	(-) 27.2
8'-0" x 8'-0"	(+) 22.9	(-) 23.1
8'-0" x 7'-0"	(+) 21.1	(-) 28.0

WIND PRESSURE AND SUCTION DIAGRAM

GENERAL CONTRACTOR:

IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO INSTALL ALL MATERIALS MEETING FLORIDA APPROVAL, COMPLIANCE TO AVOID WATER INTRUSION AND MOISTURE INTRUSION ON WINDOWS, DOORS, ROOF, AND ANY OTHER AREA AROUND EACH UNIT/ HOUSE/ APARTMENT/ CONDOMINIUM/ TOWNHOUSE.

ENGINEERING KEY

DESIGN REQUIREMENTS

- ROOF LIVE LOAD IS 20 PSF
- FLOORS LIVE LOAD IS 40 PSF. BALCONIES, DECKS, STAIRS, LIVE LOAD IS 80PSF

NOTE: THIS STRUCTURE HAS BEEN DESIGNED TO MEET OR EXCEED REQUIREMENTS OF THE (2023) FLORIDA BUILDING CODE (RESIDENTIAL, 8TH EDITION)

- WIND EXPOSURE - CATEGORY (C)
- ULTIMATE WIND SPEED - 140MPH
- NOMINAL WIND SPEED - 108MPH
- WIND IMPORTANCE FACTOR - 1.0
- INTERNAL PRESSURE COEFFICIENT - 18
- MAXIMUM PRESSURE FOR COMPONENTS AND CLADDING, 21.0 p.s.f./28.1 p.s.f. UNLESS NOTED OTHERWISE.
- SINGLE FAMILY RESIDENCE TO BE RISK CATEGORY II.

DESIGN STATEMENT

THIS STRUCTURE HAS BEEN DESIGNED TO MEET OR EXCEED REQUIREMENTS OF THE (2023) FLORIDA BUILDING CODE (RESIDENTIAL, 8TH EDITION)

EFFECTIVE WIND AREA (SQ. FT.)	WIND PRESSURE AND SUCTION (PSF)
AREA	(+) VALUE DENOTES PRESSURE (-) VALUE DENOTES SUCTION

AREA	(+) VALUE DENOTES PRESSURE	(-) VALUE DENOTES SUCTION
16'-0" x 8'-0"	(+) 21.7	(-) 24.4
16'-0" x 7'-0"	(+) 20.3	(-) 27.2
9'-0" x 8'-0"	(+) 25.80	(-) 25.9
9'-0" x 7'-0"	(+) 24.10	(-) 27.2
8'-0" x 8'-0"	(+) 22.9	(-) 23.1
8'-0" x 7'-0"	(+) 21.1	(-) 28.0

GENERAL PRESSURE NOTES
<p>NOTES:</p> <ul style="list-style-type: none"> 1. 7'-0" END ZONE IS ONLY WITHIN 5'-0" OF ALL EXTERIOR BUILDING CORNERS. 2. INDICATED PRESSURES CAN BE INTERPOLATED FOR OTHER DOOR SIZES, OTHERWISE USE LOAD ASSOCIATED WITH THE LOWER EFFECTIVE AREA.

FLORIDA BUILDING CODE: (FBC) 2023 (8TH EDITION)

- DESIGN CRITERIA:
- 2023 FLORIDA BUILDING CODE (BUILDING) - 8TH EDITION
 - 2023 FLORIDA BUILDING CODE (RESIDENTIAL) - 8TH EDITION
 - 2023 FLORIDA BUILDING CODE (PLUMBING) - 8TH EDITION
 - 2023 FLORIDA BUILDING CODE (MECHANICAL) - 8TH EDITION
 - 2023 FLORIDA BUILDING CODE (FUELS/GAS) - 8TH EDITION
 - 2023 FLORIDA BUILDING CODE (EXISTING BUILDING) 8TH EDITION
 - 2023 FLORIDA BUILDING CODE (ENERGY CONSERVATION) 8TH EDITION
 - 2023 FLORIDA BUILDING CODE (ACCESSIBILITY) 8TH EDITION
 - 2020 NATIONAL ELECTRICAL CODE (NEC)
 - 2021 NFPA 1012 - LIFE SAFETY CODE
 - 2020 FLORIDA FIRE PREVENTION CODE (7TH EDITION)
 - 2021 INTERNATIONAL RESIDENTIAL CODE (IRC)
 - CONSTRUCTION TYPE: TYPE IIB (FBC-R 602.3)
 - SPRINKLED: NO (FBC-8 SECTION 803)
 - NUMBER OF STORIES: 2 STORIES
- SPECIFIC PARAMETERS FROM FBC 2023 USED FOR DESIGN INCLUDE:
- CONCRETE MASONRY RESIDENTIAL
 - CONSTRUCTION WOOD FRAME CONSTRUCTION
 - AMERICAN SOCIETY OF CIVIL ENGINEERS

815 Orienta Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignsgroup.com

401 Vineland Road, Suite 46 Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1750
www.mjsdesignsgroup.com

THOMPSON ENGINEERING GROUP, INC.
All designs/plans in this publication are protected under the copyright law. Reproduction of the illustrations or working drawings by any means is strictly prohibited unless licensed by M.J.S., Inc.

MJS designers group
residential-commercial-architecture

AI BD
GOBA
GUILD OF PROFESSIONAL BUILDERS ASSOCIATION


5-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Per # XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A Division of Park Square Enterprises, Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Mar 04, 2025, 3:00pm
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

ISSUE DATE: 04/13/2023
REVISIONS

COVER PAGE
A0

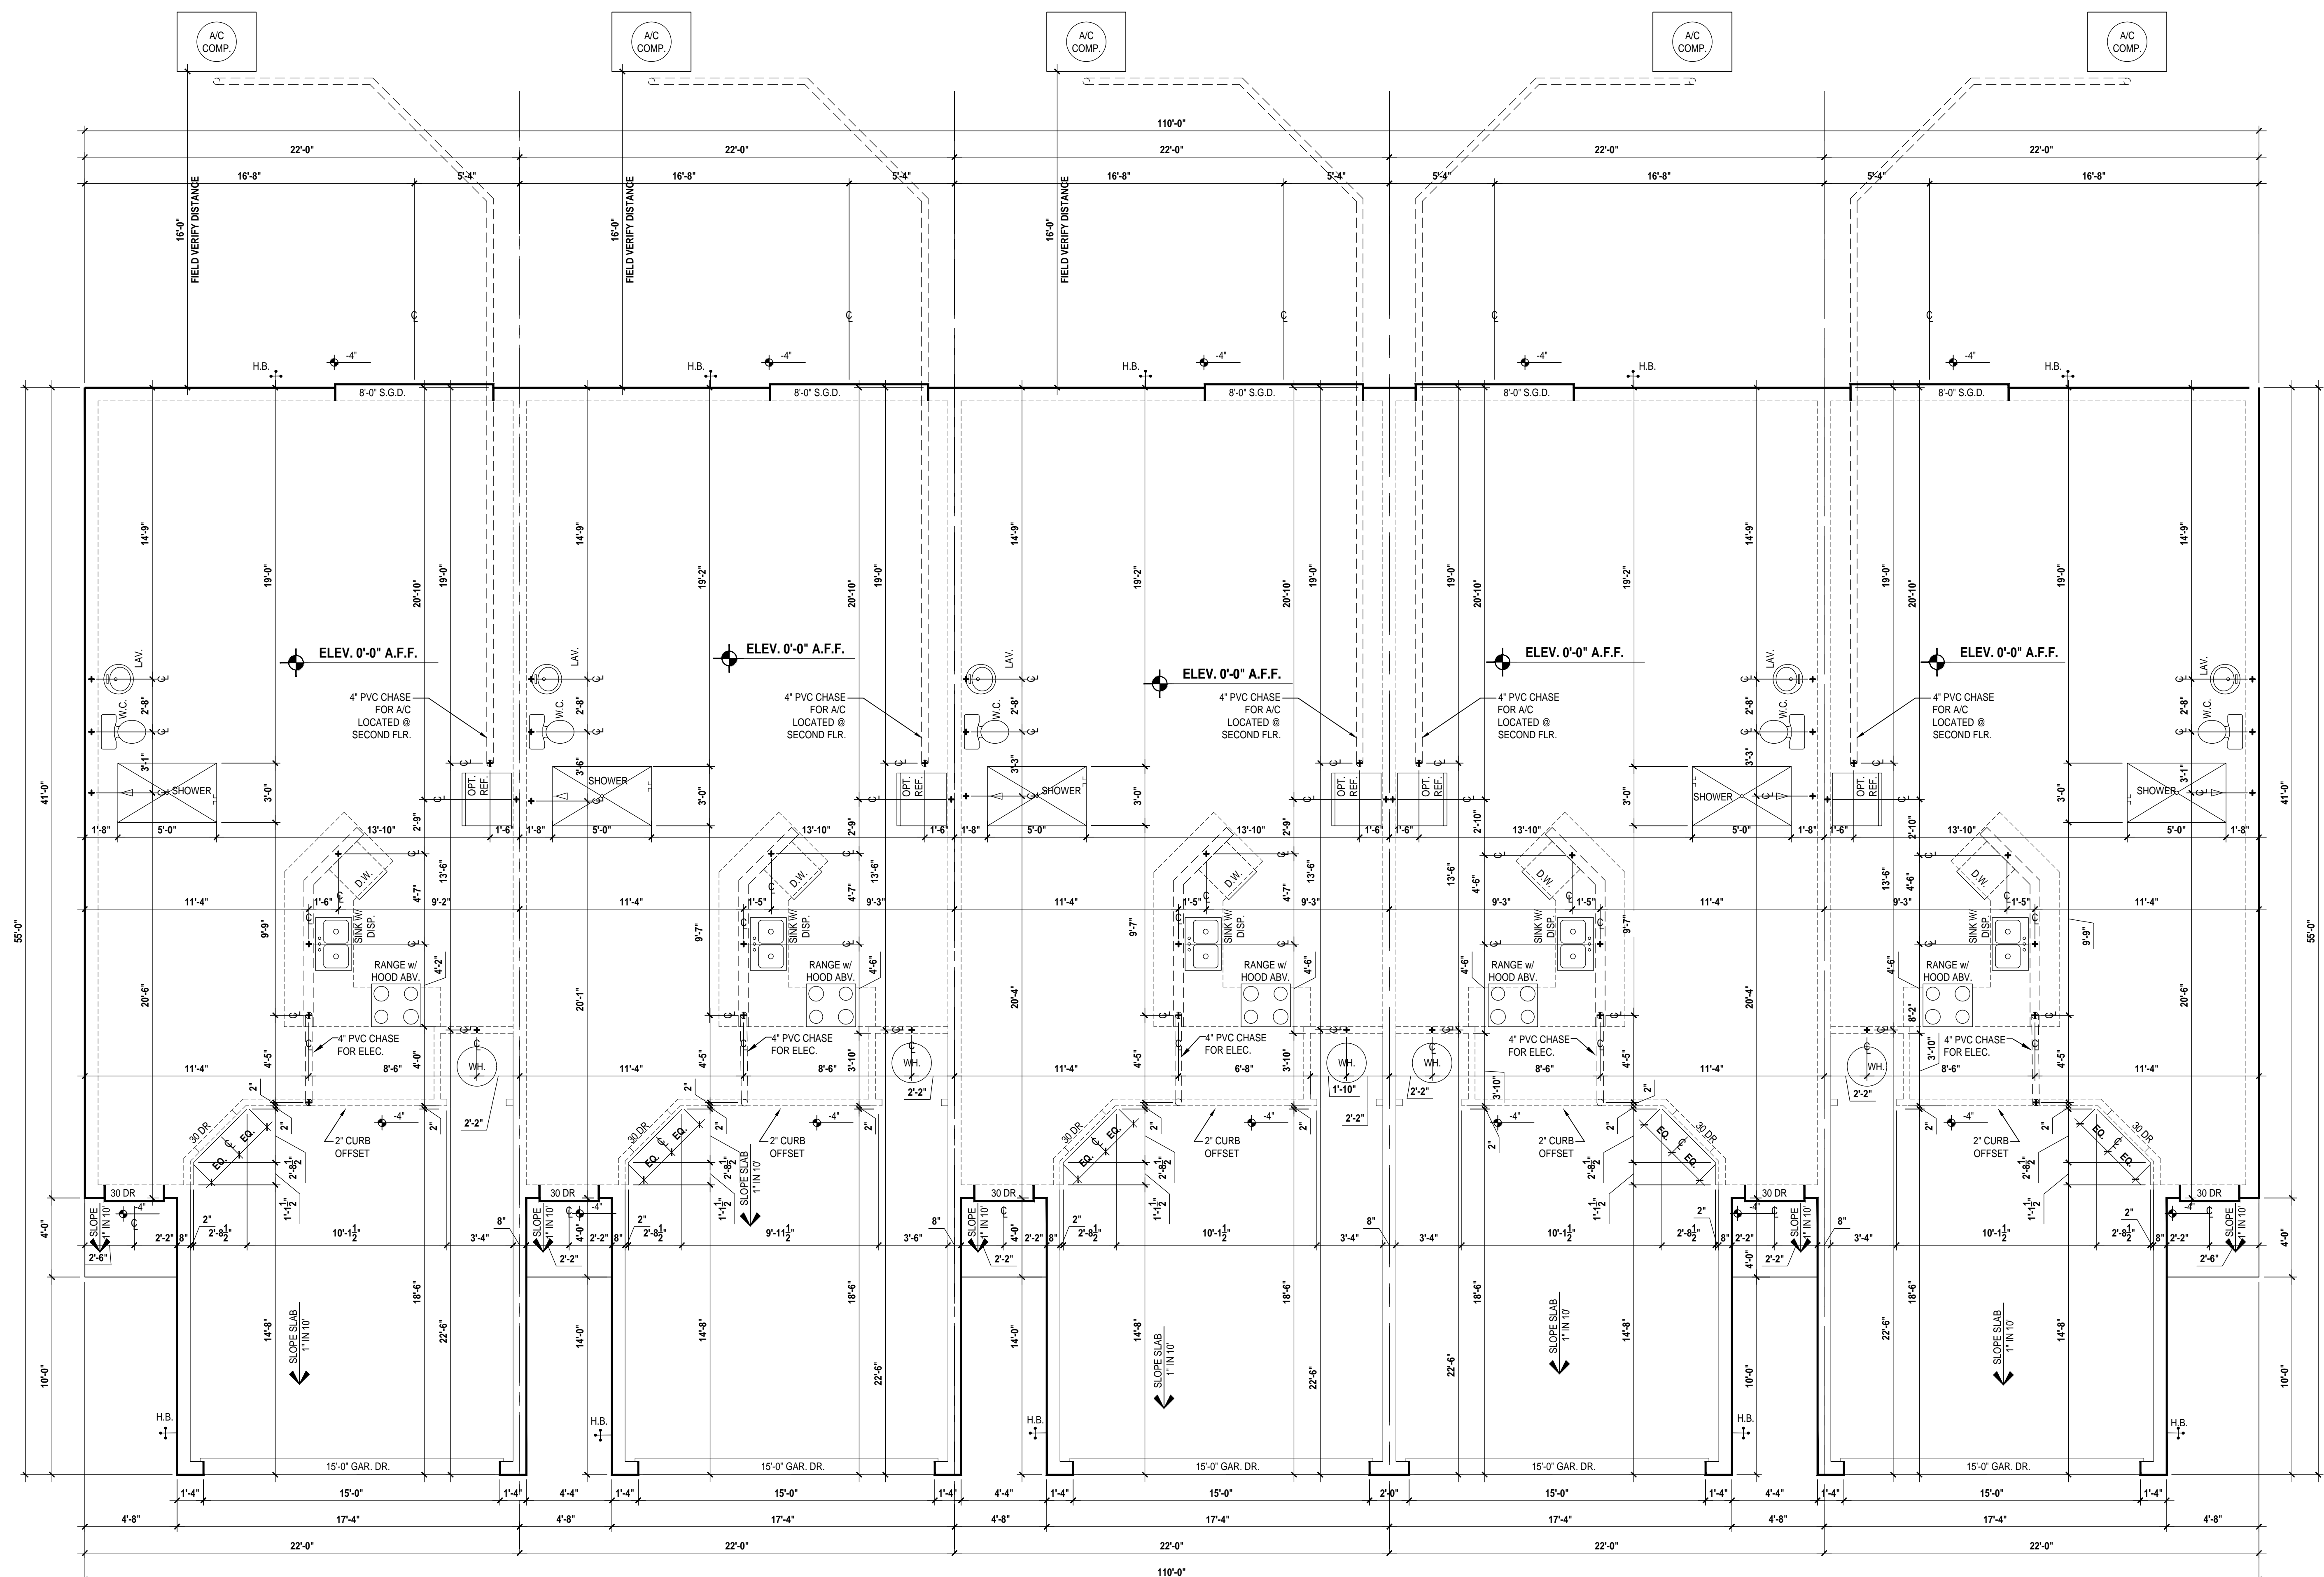

Nautilus
LOT# XX

Latitude II
LOT# XX

Latitude
LOT# XX

Latitude (Rev.)
LOT# XX

Nautilus (Rev.)
LOT# XX

GENERAL NOTES KEY:

- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
- DO NOT SCALE FRONTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
- WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATED AT OR ABOVE FLOOR LEVEL. SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE AN APPROVED THERMAL EXPANSION DEVICE.
- PAVERS MAY BE USED LO CONCRETE SLAB AT PATIO, PORCH, DRIVE AND WALKWAY.
- IN LIEU OF TREATING THE SOIL AN ALTERNATIVE TO TREATMENT TREATED SOIL CAN BE TERMICIDE.
- BORA-CARE TO BE APPLIED ON INTERIOR WALLS IAW MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS. PURSUANT TO FBC-R318.
- EQUIPMENT AND APPLIANCES SUPPORTED FROM THE GROUND SHALL BE LEVEL AND FIRMLY SUPPORTED ON A CONCRETE SLAB PER FBC-R M305.1.4.1
- GRADE TO SLOPE AWAY FROM FOUNDATION WALLS AT A RATE OF NOT LESS THAN 8 INCHES PER FOOT.
- ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH QUICKFLASH PANELS (OR SIMILAR).

DOOR NOTE KEY:

- DOOR SIZE CALL-OUT:
- 30 = 2'-0" 40 B.F. = 4'-0" BI-FOLD
 - 34 = 2'-4" 50 B.F. = 5'-0" BI-FOLD
 - 36 = 2'-6" 60 B.F. = 6'-0" BI-FOLD
 - 38 = 2'-8" 70 B.F. = 7'-0" BI-FOLD
 - 39 = 2'-9"

Slab Plan
SCALE: 1/4" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vineland Road, Suite 46, Ocala, FL 32811
Ph: (407) 734-1450 Fax: (407) 734-1750
www.iteg.com

MJS
designers group
residential-commercial-architecture

A.I.D.
BD

GOBA
GOLF BUILDERS ASSOCIATION

5-Unit: (Paradise TH)
Models: Nautilus, Latitude
Building Path #XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

Park Square HOMES
A Division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Ocala, FL 32811
Phone: (407) 529-3000

PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

ISSUE DATE: 04/13/2023
REVISIONS:

Mar 03, 2025 8:34am

GENERAL NOTES KEY:

THIS STRUCTURE HAS BEEN DESIGNED TO MEET OR EXCEED REQUIREMENTS OF THE (2023) FLORIDA BUILDING CODE (8TH EDITION)

- ABBREVIATIONS:**
- PKT - POCKET DOOR
 - OBS - OBSCURED GLASS
 - TEMP - TEMPERED GLASS
 - SH - SINGLE HUNG
 - FR - FRENCH DOORS
 - FR - FRENCH DOORS
 - SL - SIDE LIGHT
 - FG - FIXED GLASS
 - TR - TRANSOM
 - GB - GLASS BLOCK
 - MT - METAL THRESHOLD
 - DH - DOUBLE HUNG
 - HR - HORIZONTAL ROLLER
 - BP - BYPASS
 - BF - BIFOLD
 - TYP. - TYPICAL

- NOTES:**
1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
 2. DO NOT SCALE PRINTED CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
 4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE FBC-R 1107.2 & FBC-M 304.
 5. PROVIDE RECESS H&C WATER W/ DRAIN @ WASHER SPACE.
 6. VENT DRYER THRU EXTERIOR WALL U.O.
 7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
 8. PROVIDE RECESS H&C WATER W/ DRAIN @ WASHER SPACE.
 9. S&S RESISTANT DRYWALL ON ALL CEILINGS WITH FRAMING MEMBER AT 30" O.C. SHALL HAVE DRYWALL INSTALLED PERPENDICULAR TO FRAMING TO MINIMIZE SAGGING PER FBC-R 703.3.
 10. FILL ALL DIMENSIONS FROM THE REAR OF PLAN.
 11. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISHES.
 12. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
 13. ALL EXTERIOR FRAME WALL DIMENSIONS TO BE 3/16" U.O.
 14. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1/2" U.O.
 15. ALL INT. FIRST FLOOR CEILINGS AT 8'-0" U.O.
 16. ALL INT. SECOND FLOOR CEILINGS AT 8'-0" U.O.
 17. CAULK & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SYS. - SHEAR WALL SEGMENTS.
 18. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED W/ A 30 MIN. FIRE RATED SOLID WOOD OR FIBERGLASS CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R 803.5.1.
 19. METALL. 50# TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TY).
 20. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
 21. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SLIP DEVICES INSTALLED.
 22. ALL OPERABLE WINDOWS LOCATED MORE THAN 17" ABV. SURFACE BELOW SHALL HAVE THE LONGEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVED PER FBC-R 102.2.
 23. ALL BRIDG. FIBERS OPENING SHALL BE IN ACCORDANCE W/ SECTION FBC-R 10.
 24. ALL INT. DOORS TO BE 6" TALL U.O. OR PER BUILDER / CLIENT.
 25. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DOORING.
 26. 1/2" GYPSUM BOARD APPLIED TO THE ACCESSIBLE AREA UNDER STAIR SURFACE AND SIDES.
 27. THERMAL BARRIER FROM PLASTIC SHALL BE SEPARATED FROM THE EXTERIOR OF A BUILDING BY NOT LESS THAN 1/2" MIN. GYPSUM WALLBOARD, 2X2" INCH (1/2" MIN. WOOD STRUCTURAL PANEL OR A MATERIAL THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE INTEGRITY FIRE TEST OF WPA 276.
 28. ADDRESS IDENTIFICATION SHALL BE IN ACCORDANCE W/ SECTION FBC-R 19.
 29. ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH QUICFLASH PANELS OR SIMILAR.
 30. SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.
 31. ATTC ACCESS OPENINGS SHOULD BE WEATHERSTRIPPED AND INSULATED TO LEVEL EQUIVALENT TO INSULATION ON THE SURROUNDING AREAS PER FBC-R 702.4.
 32. FILL WOODS OF UNDERSIDE OF TUBS & SHOWERS WITH INSULATION FOR ACOUSTIC DAMPING.
 33. ADD ACOUSTIC OR VIBRATION ISOLATION DEVICES AT GARAGE DOOR OPENERS THAT ARE ADJACENT TO HABITABLE SPACES ABOVE.
 34. WHERE WALL TILE IS INSTALLED IN TUB AND SHOWER AREAS GLASS MAT OVER BACKING PANELS WITH STYRO. FIBER REINFORCED GYPSUM PANELS (ASTM C776), NON-ASBESTOS FIBER CEMENT BACKER BOARD WITH GYPSUM OR NON-ASBESTOS FIBER MAT REINFORCED CONCRETE BACKER UNITS (ASTM C1205) SHALL BE USED PER FBC-R 702.4. PAPER-FACED GYPSUM BOARD SHALL NOT BE USED.

WINDOW NOTE KEY:

WINDOW SIZE CALLOUT:	ALL WINDOW CALLOUTS ARE MEASURED IN FEET & INCHES AS PER THE EXAMPLE TABLE ABOVE.
2000 x 2'-0" x 4'-0"	
2050 x 2'-0" x 5'-0"	
2000 x 2'-0" x 6'-0"	

DOOR NOTE KEY:

DOOR SIZE CALLOUT:	
30 x 2'-0"	60 B.F. = 4'-0" BIFOLD
24 x 2'-4"	50 B.F. = 5'-0" BIFOLD
28 x 2'-8"	60 B.F. = 6'-0" BIFOLD
30 x 3'-0"	

BRG. HT. LEGEND


	INDICATES BRG. WALL
	BRG. HT.
	FRAME WALL PER PLAN

Area Tabulations

Living:	
1st floor:	4,065 sf
2nd floor:	5,670 sf
Total Living:	9,735 sf
entry:	90 sf
garage:	1,655 sf
Total Area:	11,480 sf

First Floor Plan

SCALE: 1/4" = 1'-0"

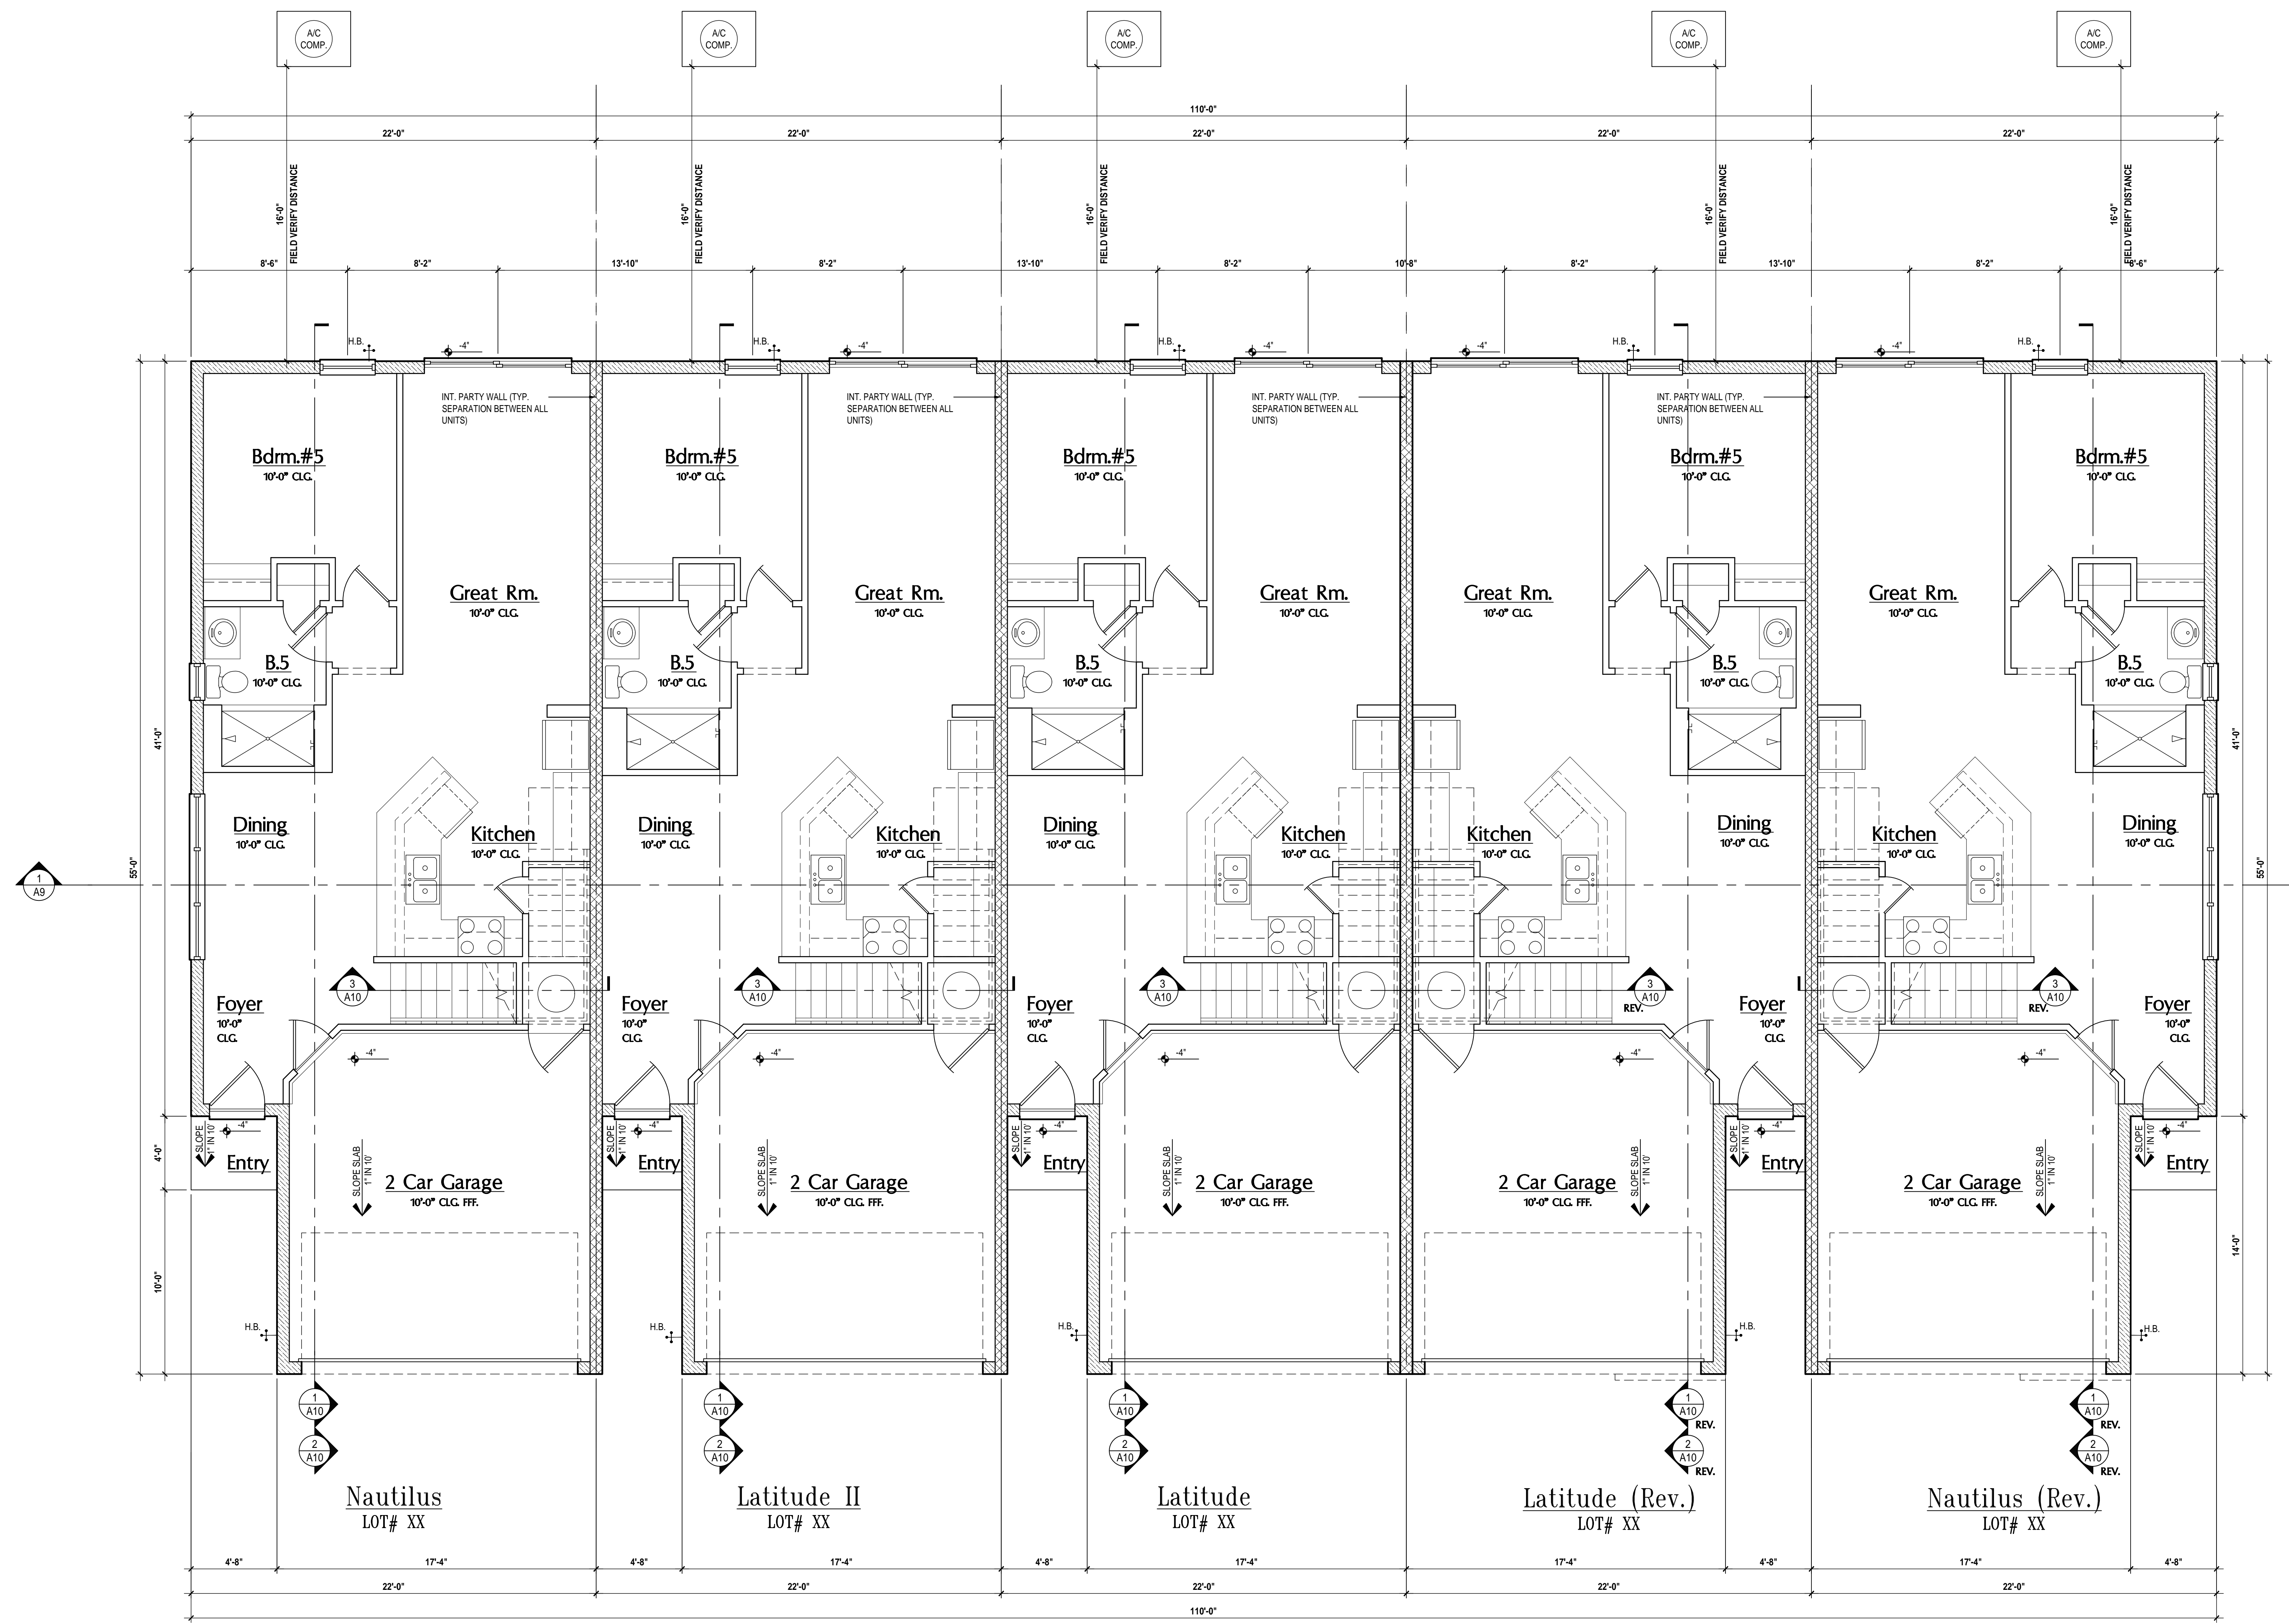

ITEG
THOMPSON ENGINEERING GROUP, INC.
4401 Vineland Road, Suite 46, Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1750
www.iteg.com

MJS designers group
residential-commercial-architecture

AI **BD**

GOBA
CREATING BRANDS BUILDS ASSOCIATION

5-Unit: (Paradise TH)
Models: Nautilus, Latitude
Building Path #XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A Division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

ISSUE DATE: 04/13/2023
REVISIONS:

FIRST FLOOR
A2

GENERAL NOTES KEY:

THIS STRUCTURE HAS BEEN DESIGNED TO MEET OR EXCEED REQUIREMENTS OF THE (2023) FLORIDA BUILDING CODE (8TH EDITION)

- ABBREVIATIONS:**
- 2 - # OF DOORS
 - 2 - # OF WINDOWS
 - MT - METAL THRESHOLD
 - FR - FRENCH DOORS
 - SL - SLIDE LIGHT
 - FG - FIXED GLASS
 - TR - TRANSOM
 - GB - GLASS BLOCK
 - PKT - POCKET DOOR
 - OBS - OBSCURED GLASS
 - TEMP - TEMPERED GLASS
 - SH - SINGLE HUNG
 - DH - DOUBLE HUNG
 - HR - HORIZONTAL ROLLER
 - BF - BIFOLD
 - TYP - TYPICAL

- NOTES:**
1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
 2. DO NOT SCALE PRINTED CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS. ALL DIMENSIONS ON DRAWINGS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
 4. A/C CONDENSATE LINES TO BE ANCHORED TO SLAB PER CODE FBC-R M307.2 & FBC-M 304.
 5. PROVIDE RECESS H&C WATER W/ DRAIN & WASHER SPACE.
 6. VENT DRYER THRU EXTERIOR WALL U.N.O.
 7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
 8. PROVIDE RECESS H&C WATER W/ DRAIN & WASHER SPACE.
 9. BAG RESISTANT DRYWALL ON ALL CEILING WITH FRAMING MEMBER AT 24" O.C. SHALL HAVE DRYWALL INSTALLED PERPENDICULAR TO FRAMING TO MINIMIZE SAGGING PER FBC-R 702.3.5.
 10. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
 11. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPEC.
 12. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
 13. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 1 1/2" U.N.O.
 14. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" U.N.O.
 15. ALL INT. FIRST FLOOR CEILING AT 8'-0" U.N.O.
 16. ALL INT. SECOND FLOOR CEILING AT 8'-0" U.N.O.
 17. CMU & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12' OR MORE SHALL BE CONSIDERED SHEAR WALL SVCS - SHEAR WALL SEGMENTS.
 18. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R 702.3.1.
 19. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING HABITABLE ROOMS (TYP).
 20. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 14 M.P.H.
 21. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
 22. ALL OPERABLE WINDOWS LOCATED MORE THAN 7" ABV. SURFACE BELOW SHALL HAVE THE LOWEST POSITION OF WINDOW CLEAR OPENING A MIN. OF 2" ABOVE FINISHED FLOOR BEING SERVED PER FBC-R 702.3.2.
 23. ALL EXTER. EGRESS OPENINGS SHALL BE IN ACCORDANCE W/ SECTION FBC-R 703.
 24. ALL INT. DOORS TO BE 6" TALL U.N.O. OR PER BUILDER / CLIENT.
 25. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF BECHING.
 26. 1/2" GYPSUM BOARD APPLIED TO THE ACCESSIBLE AREA UNDER STAIR SURFACE AND SIDES.
 27. THERMAL BARRIER: FOAM PLASTIC SHALL BE SEPARATED FROM THE INTERIOR OF A BUILDING BY NOT LESS THAN 1/2" MIN. GYPSUM WALLBOARD, 2 1/2" MIN. OR 1/2" MIN. WOOD STRUCTURAL PANEL OR A MATERIAL THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE WEATHERY FIRE TEST OF APF-215.
 28. ADDRESS IDENTIFICATION SHALL BE IN ACCORDANCE W/ SECTION FBC-R 703.1.
 29. ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH GROUNDING PANELS (OR SMARLS).
 30. SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.
 31. ATTC ACCESS OPENING SHOULD BE WEATHERSTRIPPED AND INSULATED TO LEVEL EQUATING TO INSULATION ON THE SURROUNDING AREAS PER FBC-R 702.2.4.
 32. FILL VOID OF UNDERSIDE OF TUBS & SHOWERS WITH INSULATION FOR ACUSTIC DAMPENING.
 33. ADD ACUSTIC OR VIBRATION ISOLATION DEVICES AT GARAGE DOOR OPENERS THAT ARE ADJACENT TO HABITABLE SPACES ABOVE.
 34. WHERE WALL TILE IS INSTALLED IN TUB AND SHOWER AREAS GLASS MAT GYPSUM BACKING PANELS (ASTM C127), FIBER REINFORCED GYPSUM PANELS (ASTM C127), NON-ARRESTED FIBER-CEMENT BACKER BOARD (ASTM C127), NON-ARRESTED FIBER MAT REINFORCED CEMENTitious BACKER UNITS (ASTM C127) SHALL BE USED PER FBC-R 702.4. PAPER-FACED GYPSUM BOARD SHALL NOT BE USED.


WINDOW NOTE KEY:

WINDOW SIZE CALLOUT: ALL WINDOW CALLOUTS ARE MEASURED IN FEET & INCHES AS PER THE EXAMPLE TABLE ABOVE.

DOOR NOTE KEY:

DOOR SIZE CALLOUT: 24 = 2'-0" 40 B.F. = 4'-0" BIFOLD 24 = 2'-4" 50 B.F. = 5'-0" BIFOLD 28 = 2'-8" 60 B.F. = 6'-0" BIFOLD 28 = 2'-8" 30 = 3'-0"

BRG. HT. LEGEND

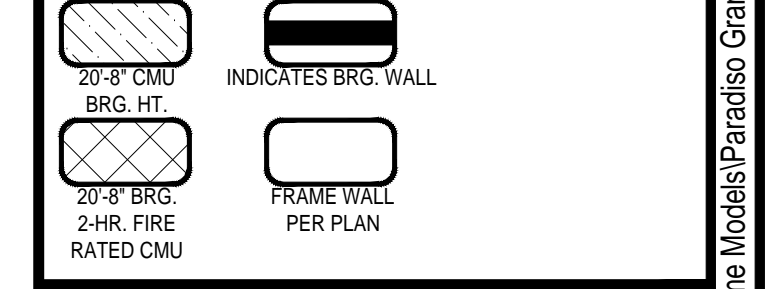

5-Unit: (Paradiso TH)


Models: Nautilus, Latitude
 Building Plat # XX
 Lot# XX-XX, Subdivision
 Street Address
 City, State, Zip Code

A division of Park Square Enterprises Inc.
 5200 Vineland Rd, Suite #200
 Orlando, FL 32811
 Phone: (407) 529-3000

ISSUE DATE	04/13/2023
REVISIONS	
PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS

Second Floor Plan

SCALE: 1/4" = 1'-0"

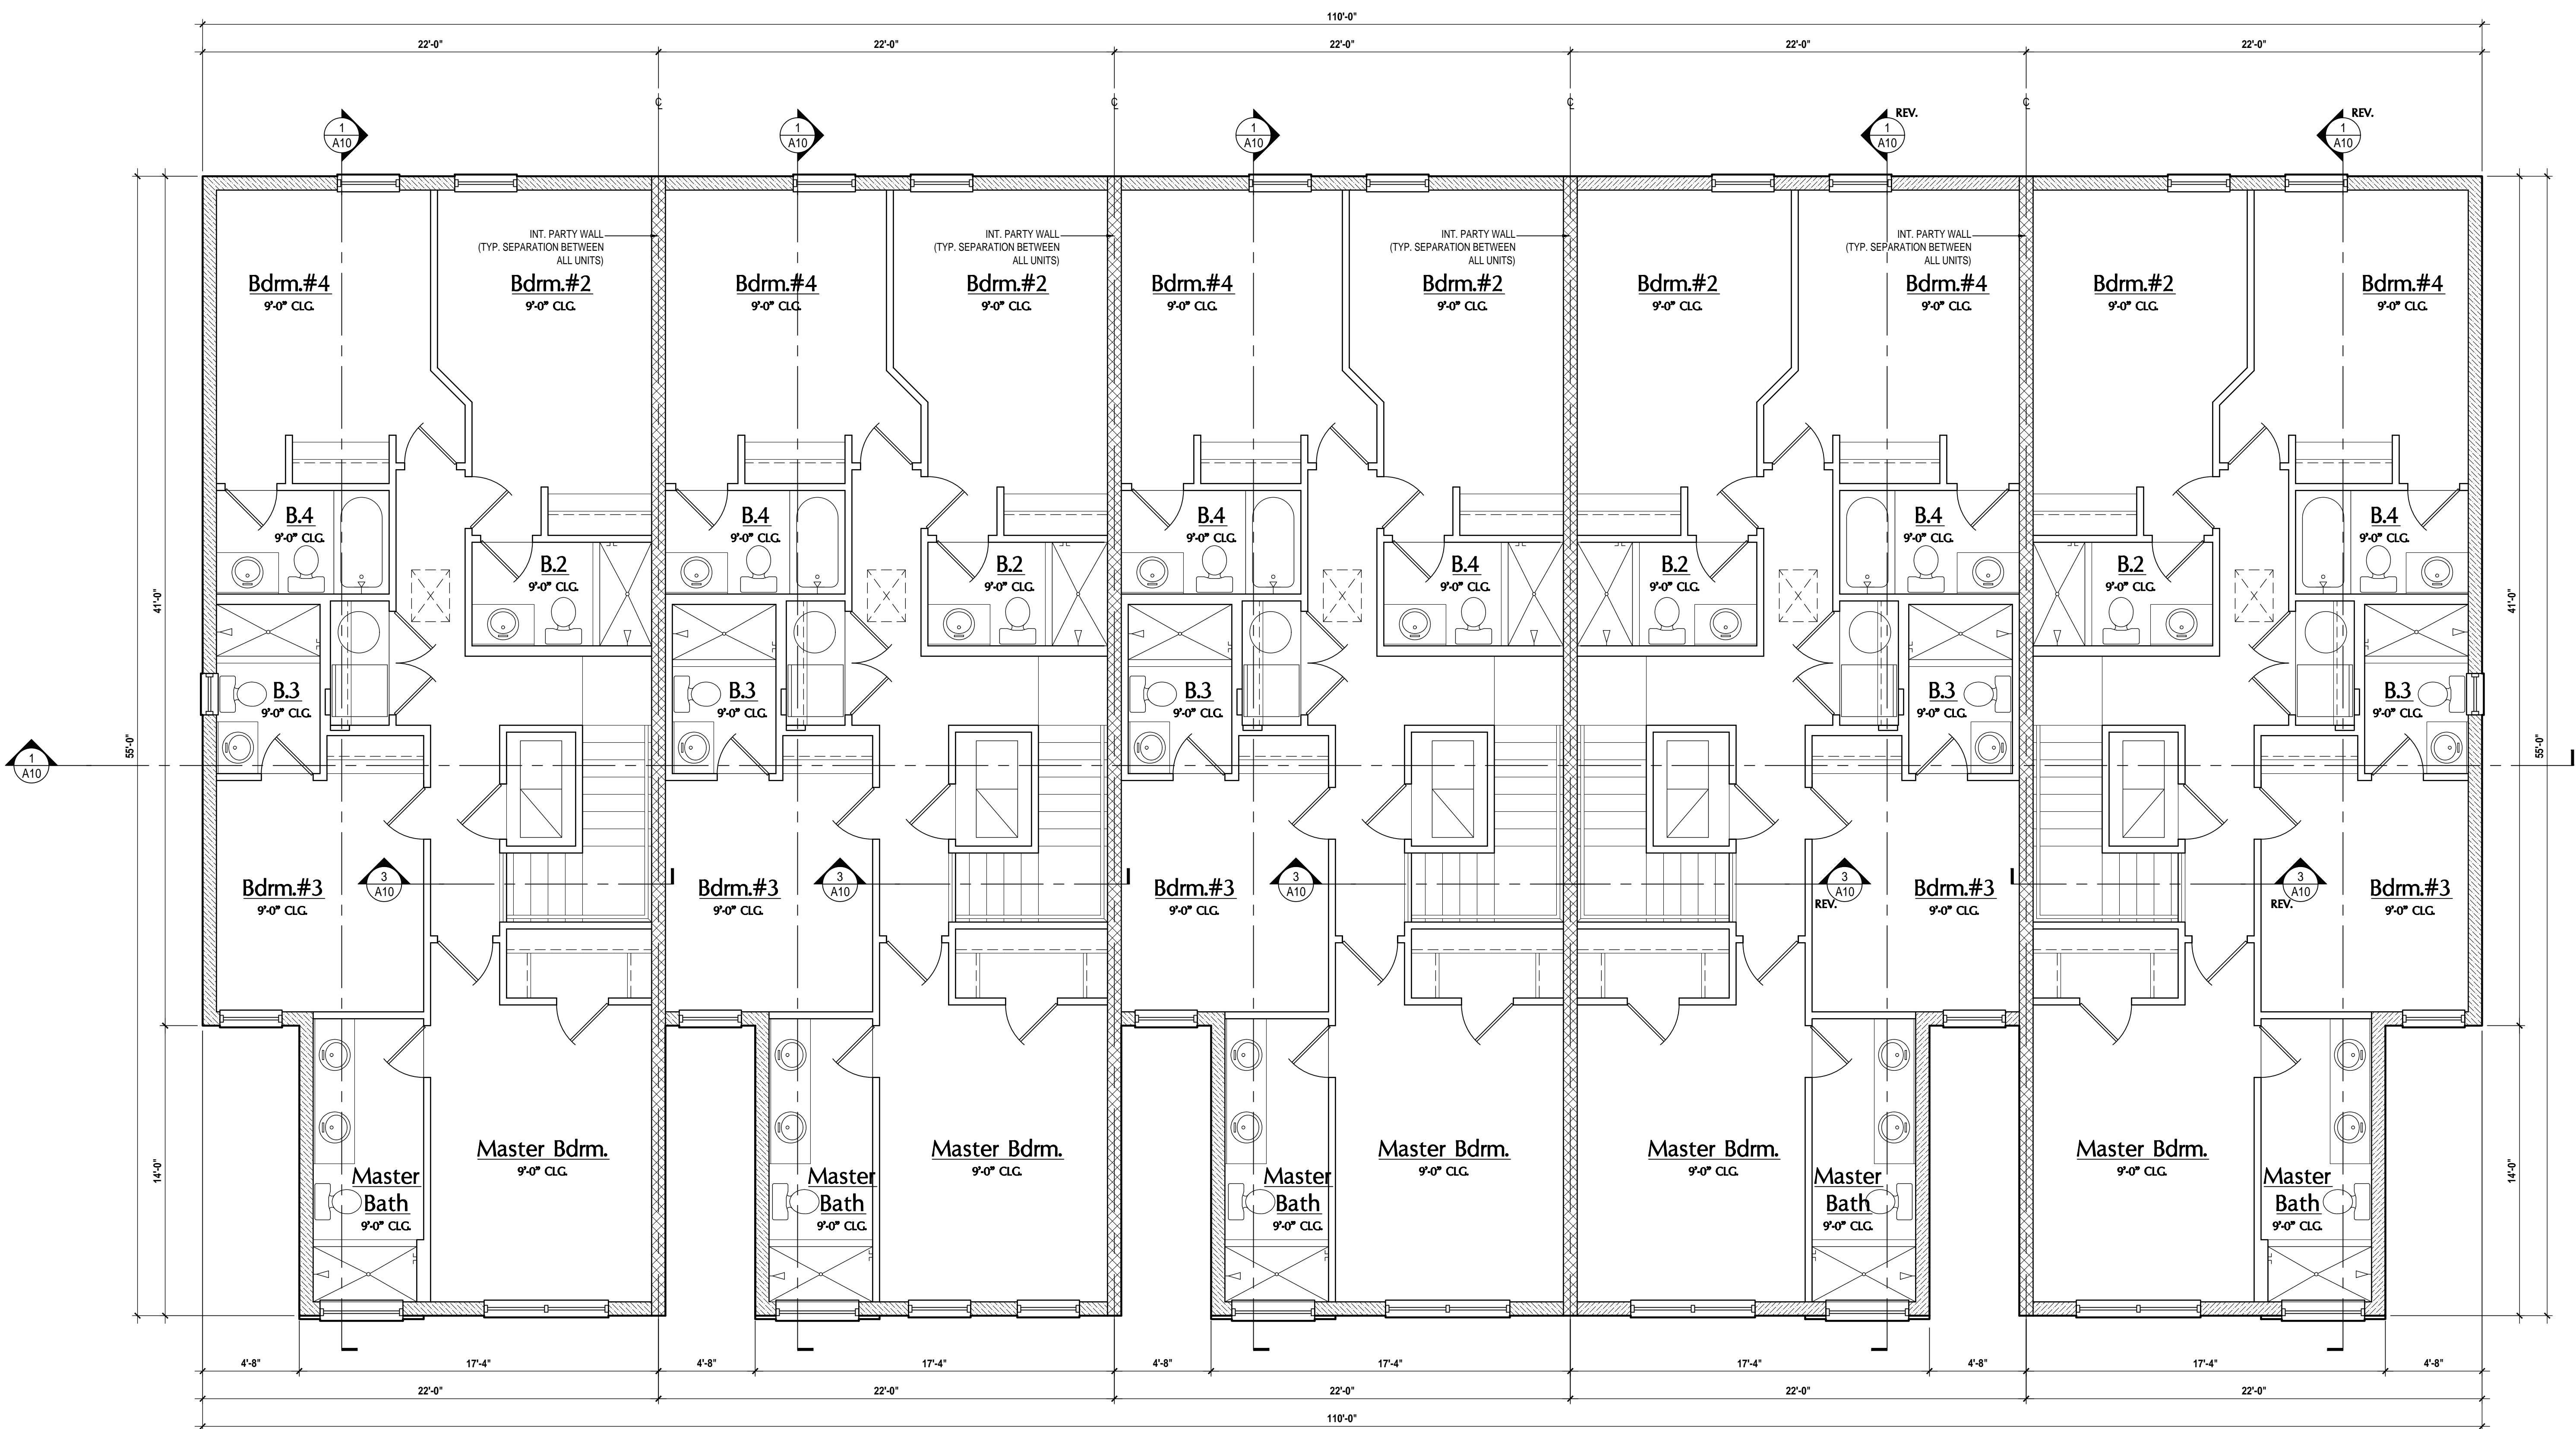

Nautilus
LOT# XX

Latitude II
LOT# XX

Latitude
LOT# XX

Latitude (Rev.)
LOT# XX

Nautilus (Rev.)
LOT# XX

MJS designers group
 residentialcommercialarchitecture

ATEG THOMPSON ENGINEERING GROUP, INC.
 401 Vineland Road Suite #6 Orlando, FL 32811
 Ph: (407) 629-6711
 Fax: (407) 724-1750
 www.ateg.com

AI **BD**

GOBA
 GROUP BY DESIGN

5-Unit: (Paradiso TH)
 Models: Nautilus, Latitude
 Building Plat # XX
 Lot# XX-XX, Subdivision
 Street Address
 City, State, Zip Code

A division of Park Square Enterprises Inc.
 5200 Vineland Rd, Suite #200
 Orlando, FL 32811
 Phone: (407) 529-3000


Park Square HOMES

ISSUE DATE 04/13/2023
 REVISIONS
 PROJECT: 22-1151
 SCALE: AS NOTED
 DRAWN BY: M.C.
 DESIGNED BY: MJS


Second Floor Plan
 SCALE: 1/4" = 1'-0"

SECOND FLOOR
A3


WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes in the dimensions, conditions and specifications appearing on these plans.

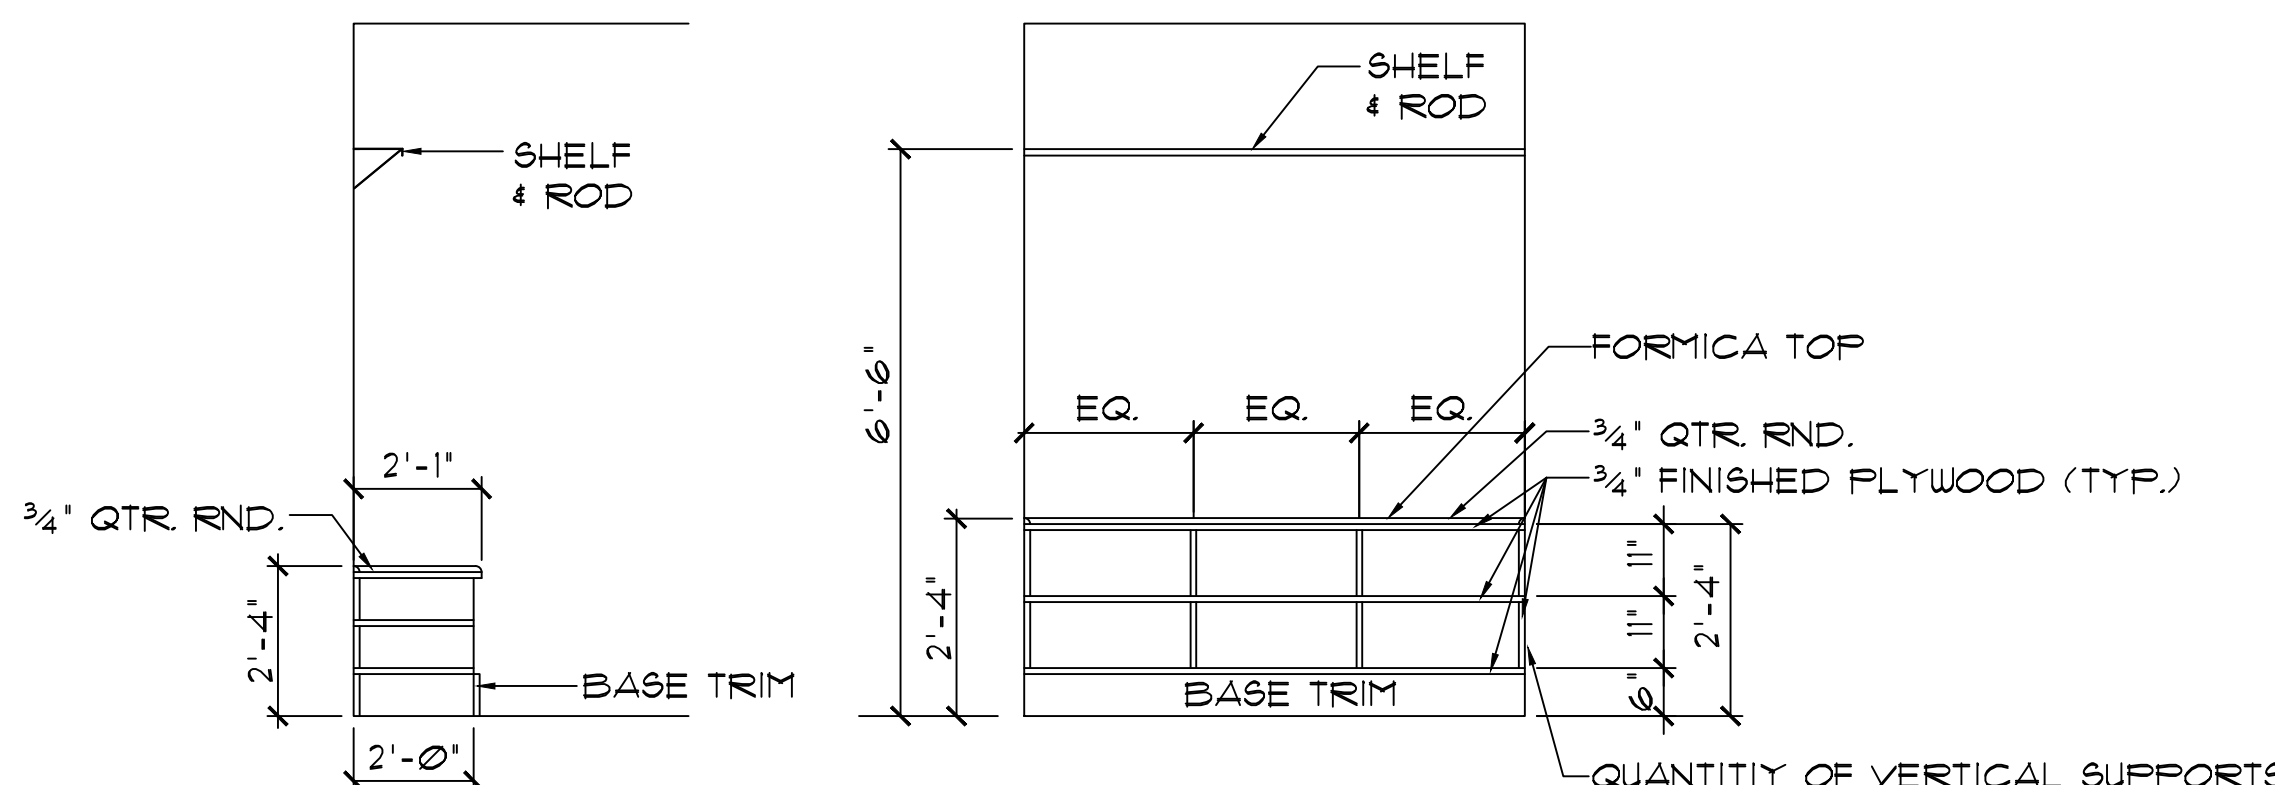


1 Luggage Shelf Detail
SCALE: N.T.S.

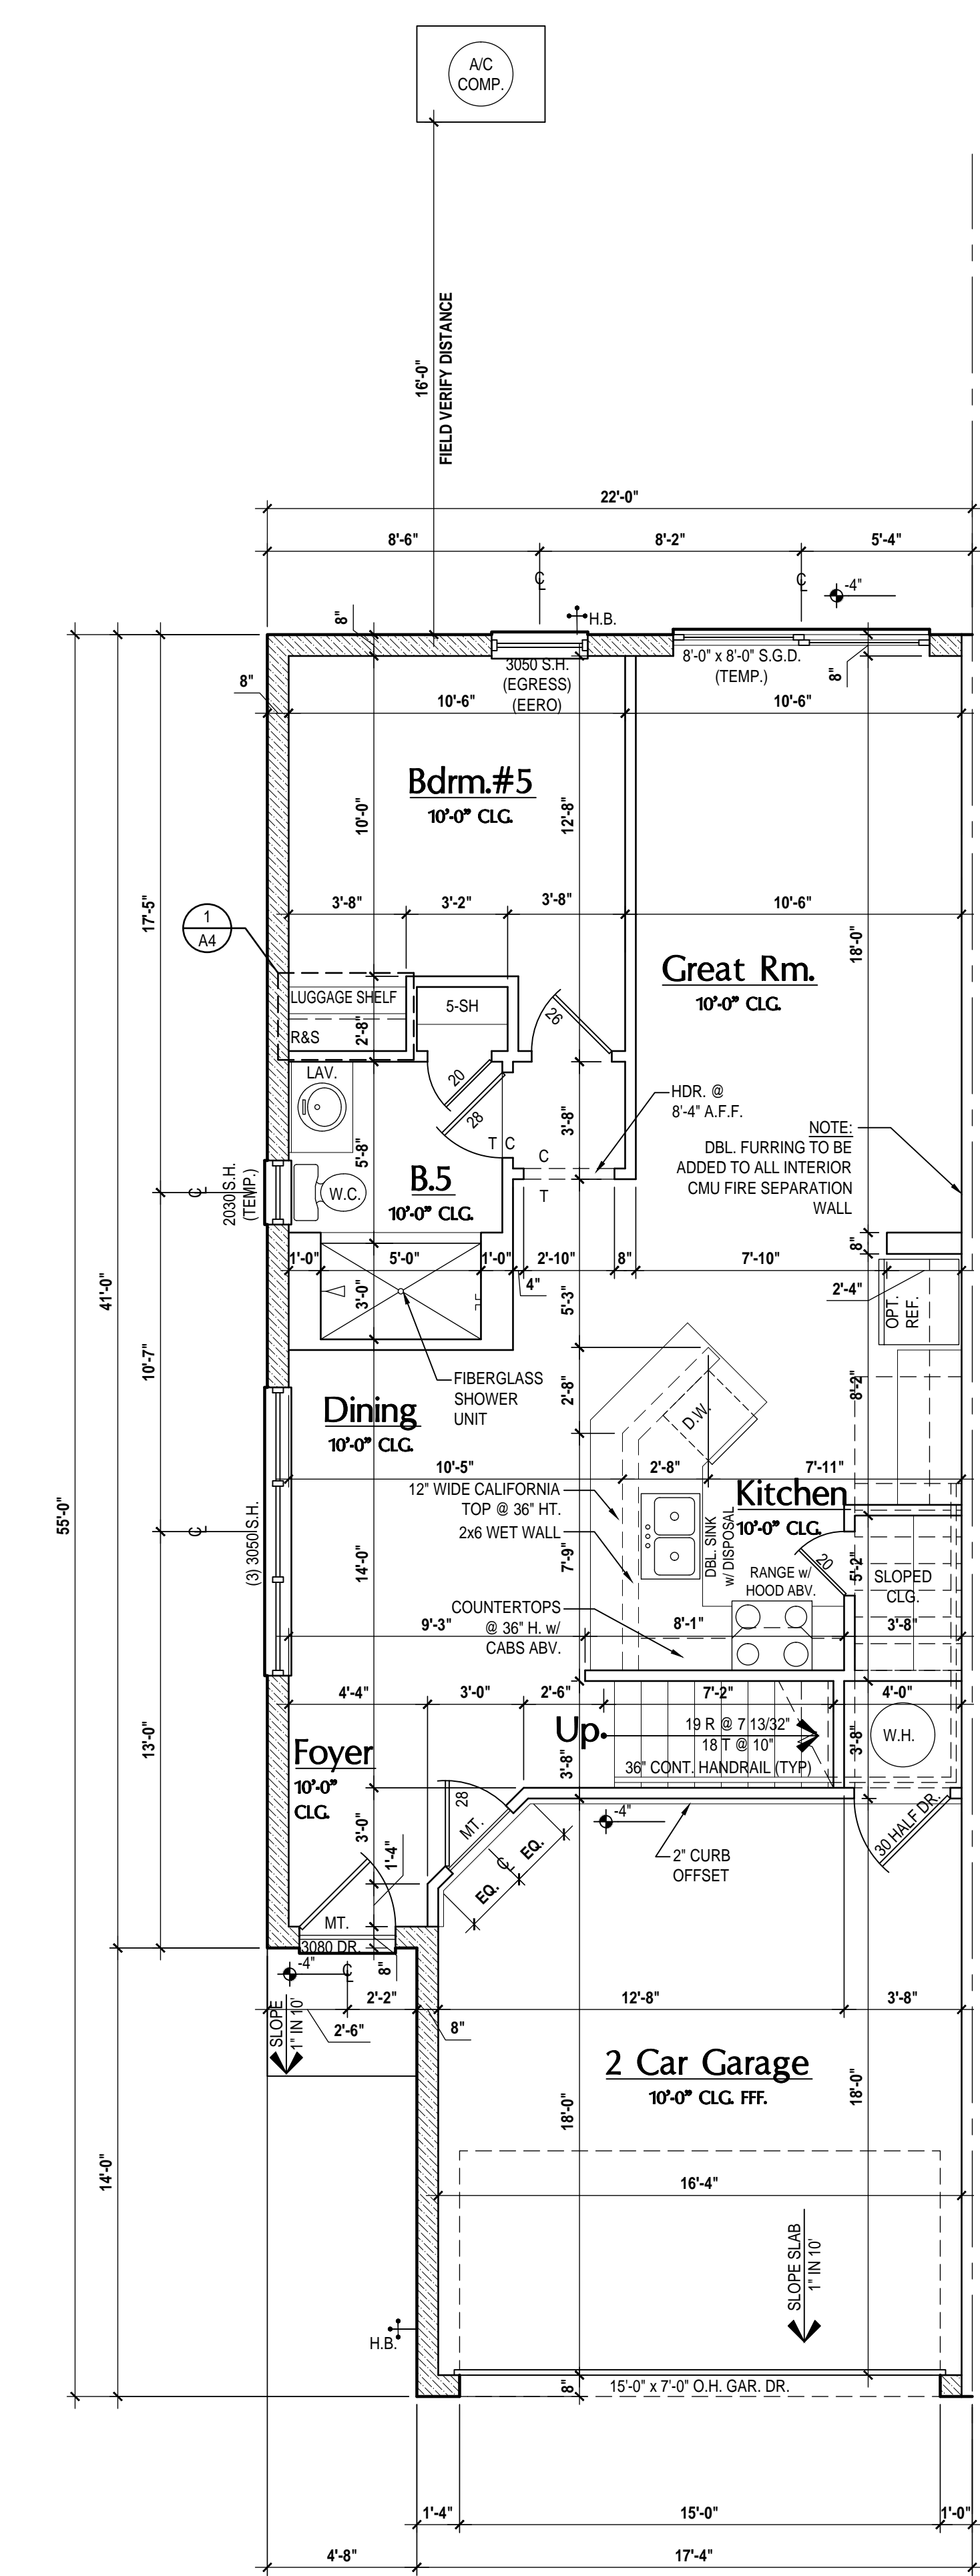


First Floor
SCALE: 1/4" = 1'-0"

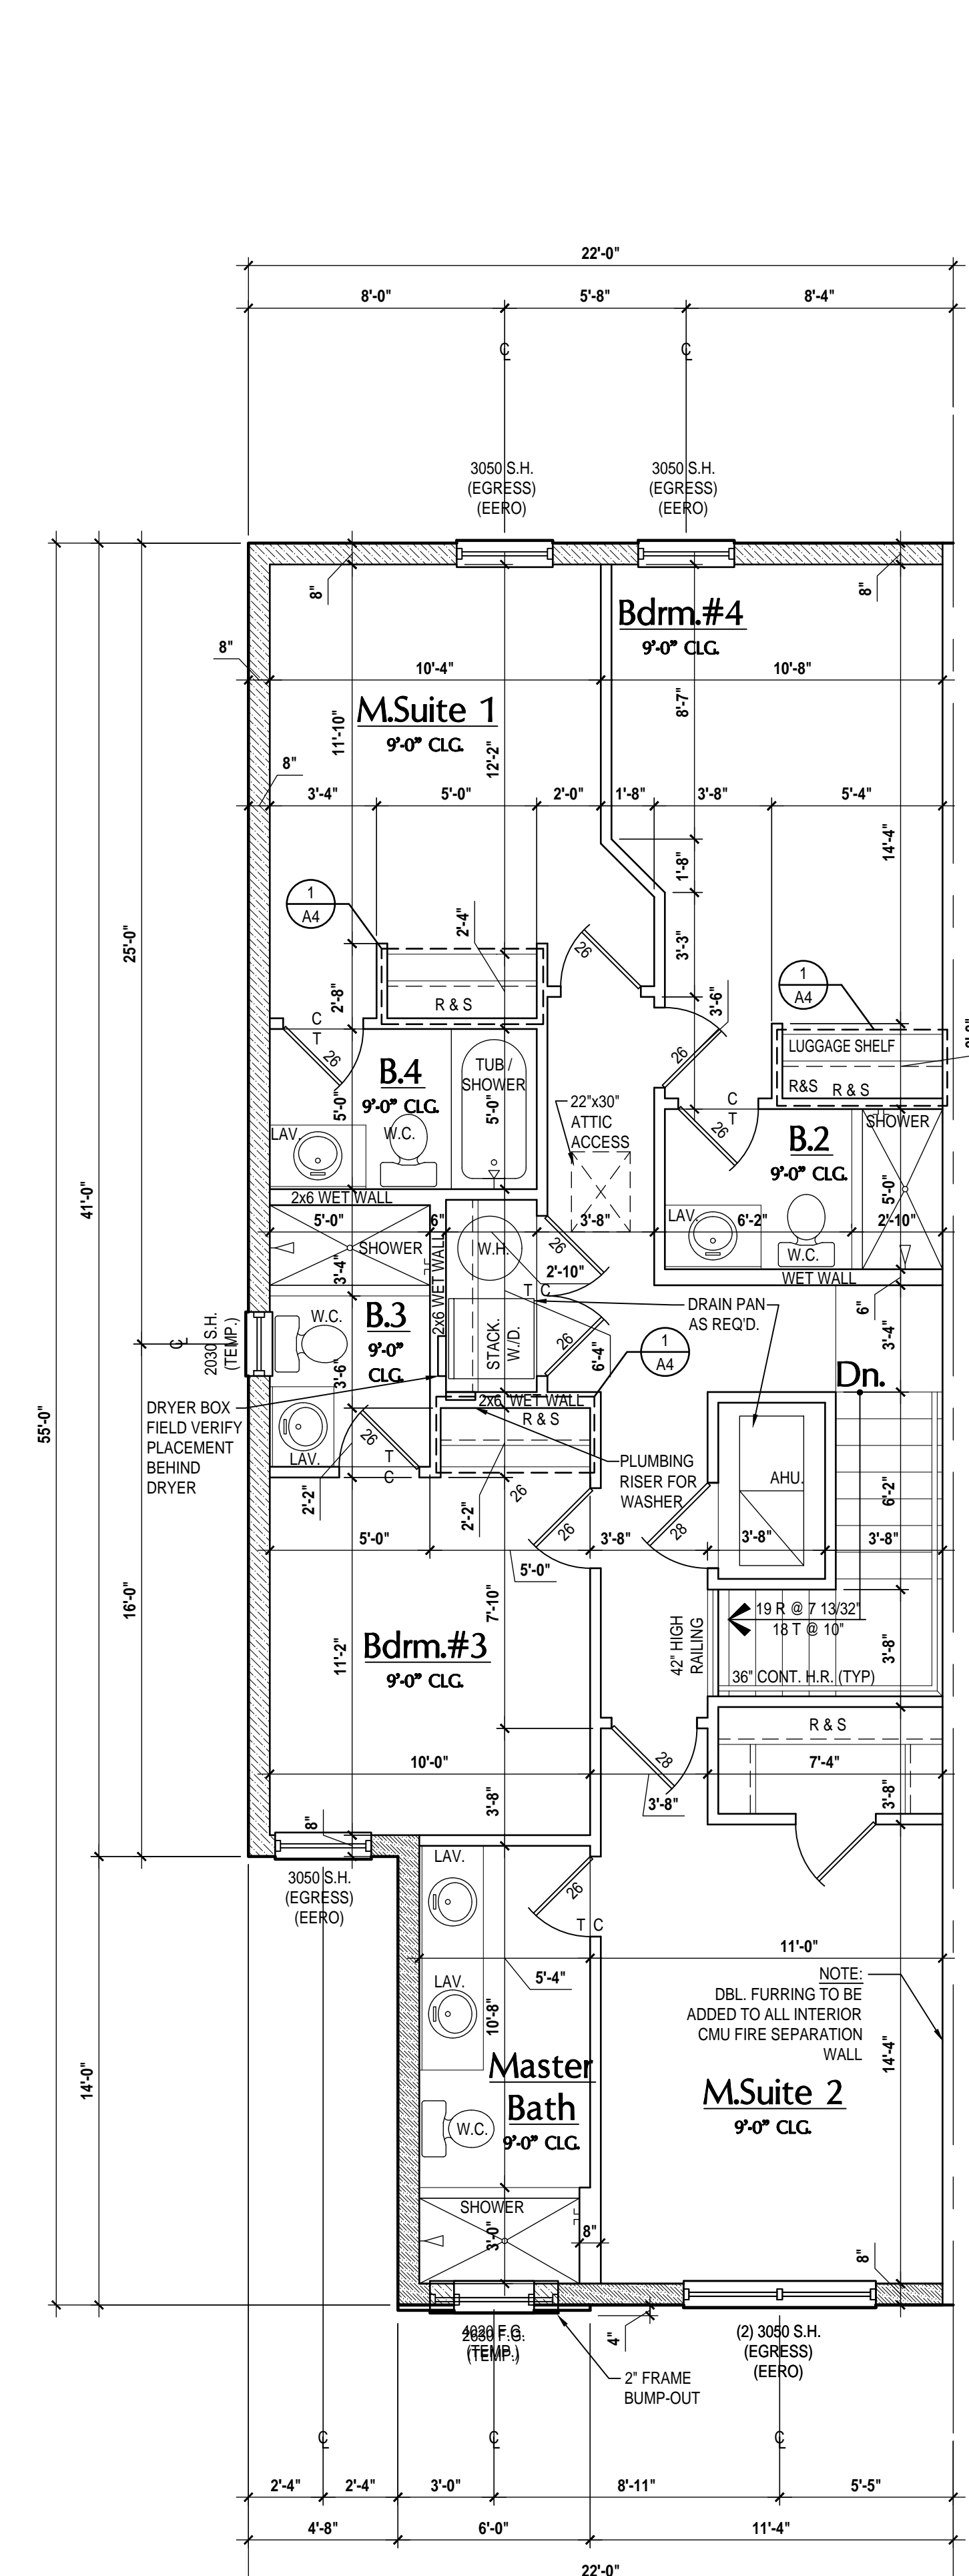

Second Floor - "Elev. A"
SCALE: 1/4" = 1'-0"

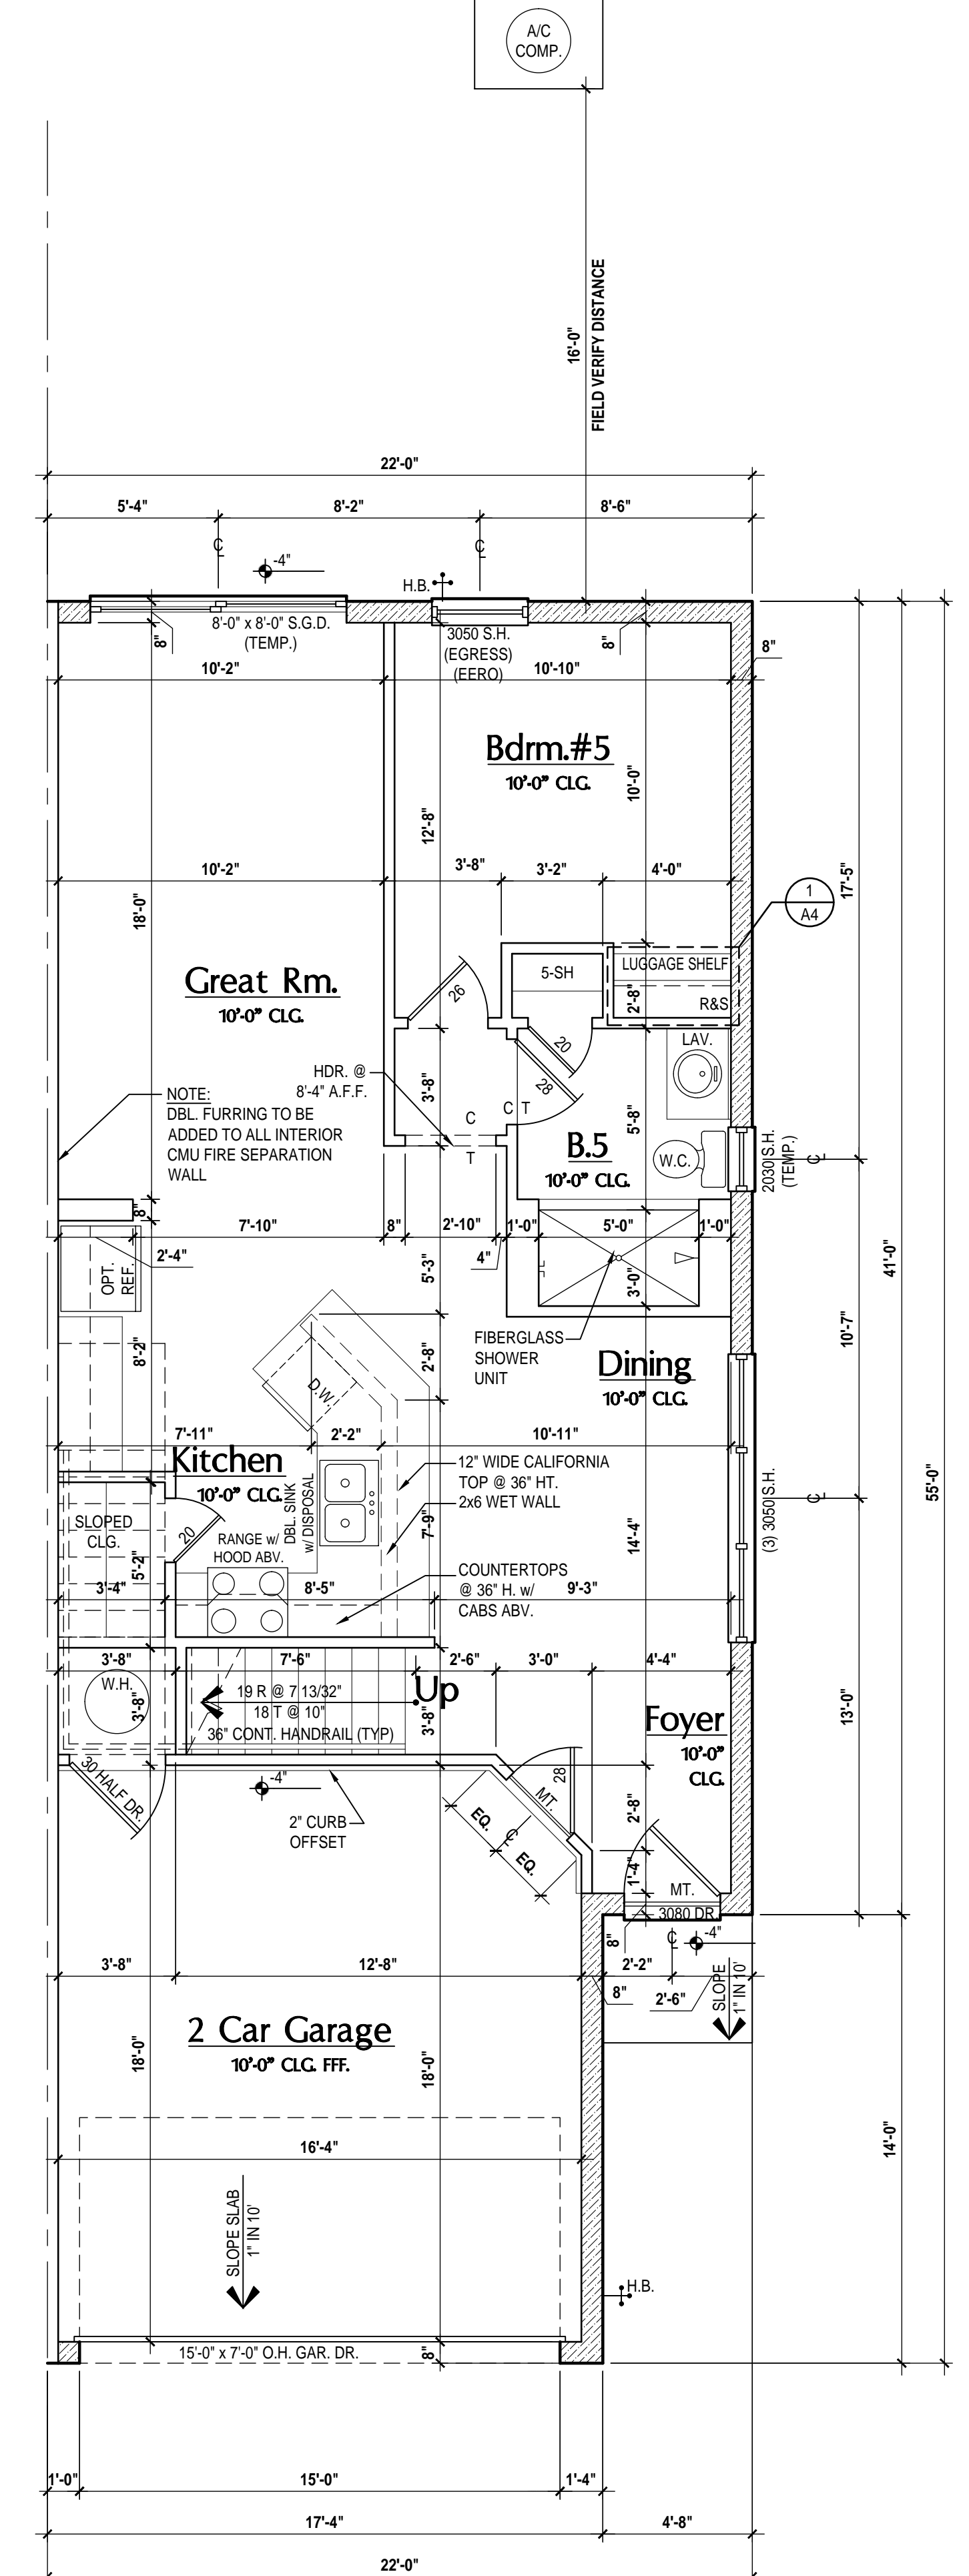

First Floor - Rev.
SCALE: 1/4" = 1'-0"

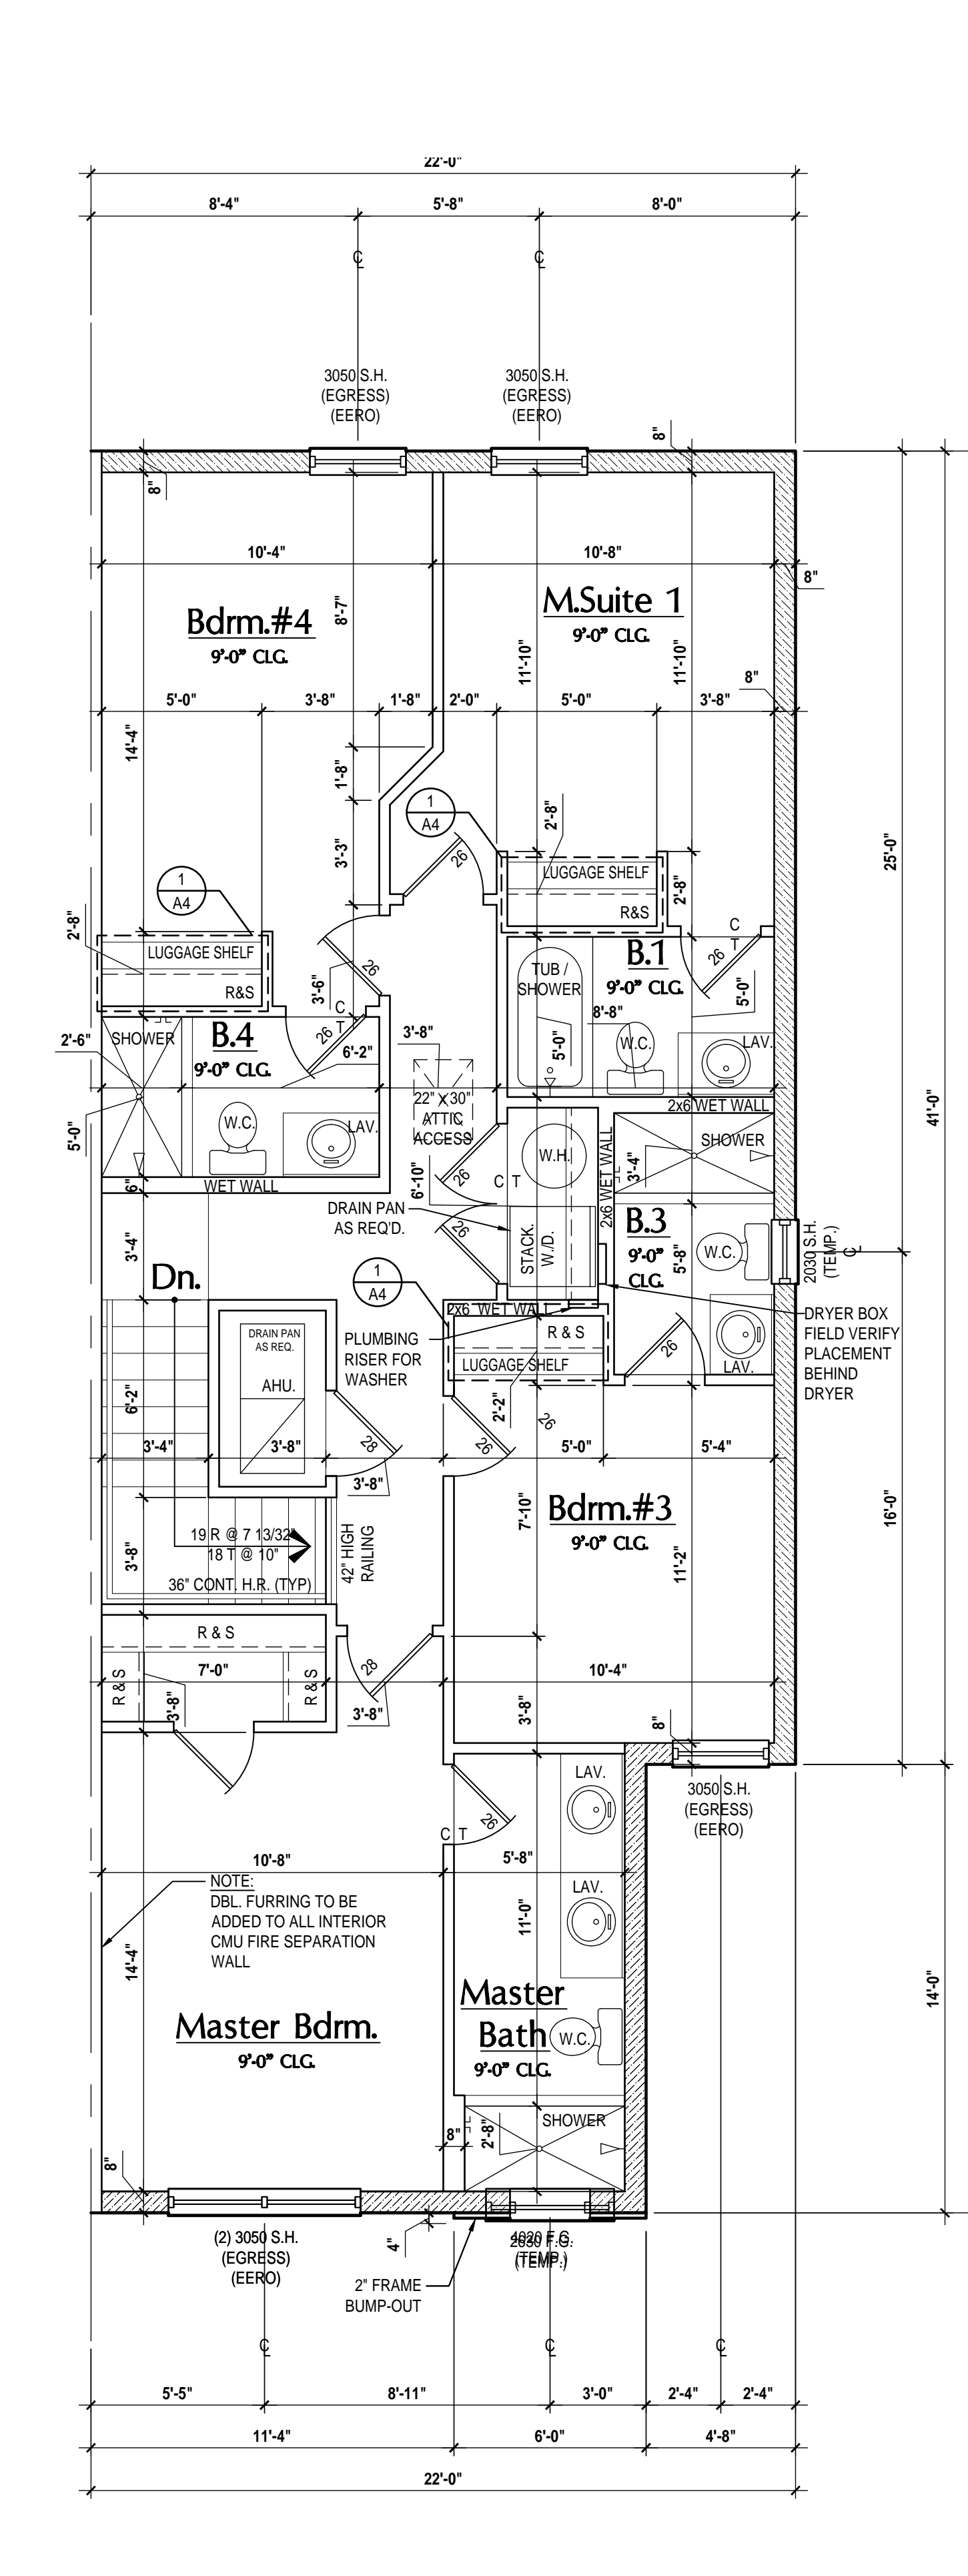

Second Floor - Rev. - "Elev. A"
SCALE: 1/4" = 1'-0"

GENERAL NOTES KEY:

- THIS STRUCTURE HAS BEEN DESIGNED TO MEET OR EXCEED REQUIREMENTS OF THE (2023) FLORIDA BUILDING CODE (8TH EDITION)
- ABBREVIATIONS:
 - 2 - # OF DOORS
 - 2 - # OF WINDOWS
 - MT - METAL THRESHOLD
 - FR - FRENCH DOORS
 - SL - SIDE LIGHT
 - FG - FIXED GLASS
 - TR - TRANSOM
 - GB - GLASS BLOCK
 - PKT - POCKET DOOR
 - OBS - OBSCURED GLASS
 - TEMP - TEMPERED GLASS
 - SH - SINGLE HUNG
 - DH - DOUBLE HUNG
 - HR - HORIZONTAL ROLLER
 - BF - BYPASS
 - BF - BIFOLD
 - TYP - TYPICAL
 - NOTES:
 1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
 2. DO NOT SCALE PRINTED CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS. ONLY DIMENSIONS OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMPANY AND COUNTY CODES.
 4. AC CONDENSATE LINT TO BE ANCHORED TO SLAB PER CODE FC-R M307.2 & FC-M 304.
 5. PROVIDE RECESS H2O WATER W DRAIN & WASHER SPACE.
 6. VENT DRYER THRU EXTERIOR WALL U.N.O.
 7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
 8. PROVIDE RECESS H2O WATER W DRAIN & WASHER SPACE.
 9. BAG RESISTANT DRYWALL ON ALL CEILING WITH FRAMING MEMBER AT 3" C.C. SHALL HAVE DRYWALL INSTALLED PERPENDICULAR TO FRAMING TO MINIMIZE SAGGING PER FC-R 702.3.5.
 10. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
 11. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISHES.
 12. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
 13. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 1/2" U.N.O.
 14. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1/2" U.N.O.
 15. ALL INT. FIRST FLOOR CEILING AT 8'-0" U.N.O.
 16. ALL INT. SECOND FLOOR CEILING AT 8'-0" U.N.O.
 17. CMU & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNTERMINATED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SVS - SHEAR WALL SEGMENTS.
 18. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED W/ 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FC-R 702.5.1.
 19. INSTALL 1/2" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP).
 20. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
 21. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
 22. ALL OPERABLE WINDOWS LOCATED MORE THAN 27" MIN. SURFACE BELOW SHALL HAVE THE LOWER PORTION OF WINDOW CLOSING A MIN. OF 2" ABOVE FINISHED FLOOR BEING SERVED PER FC-R 702.3.2.
 23. ALL EGRESS OPENINGS SHALL BE IN ACCORDANCE W/ SECTION FC-R 703.
 24. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT.
 25. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DOORING.
 26. 1/2" GYPSUM BOARD APPLIED TO THE ACCESSIBLE AREA UNDER STAIR SURFACE AND SIDES.
 27. THERMAL BARRIER FOAM PLASTIC SHALL BE SEPARATED FROM THE INTERIOR OF A BUILDING AND NOT LESS THAN 1/2" MIN. OVERLAP WALLBOARD, 2 1/2" MIN. OVERLAP WOOD STRUCTURAL PANEL OR A MATRIA THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE INTEGRITY FIRE TEST OF ASTM E 213.
 28. ADDRESS IDENTIFICATION SHALL BE IN ACCORDANCE W/ SECTION FC-R 703.5.
 29. ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH GROMMETS (OR SMILARS).
 30. SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.
 31. ATTIC ACCESS OPENINGS SHOULD BE WEATHERSTRIPPED AND INSULATED TO LEVEL EQUIVALENT TO INSULATION ON THE SURROUNDING AREAS PER FC-R 702.4.
 32. FILL VOID OF UNDERSIDE OF TUBS & SHOWERS WITH INSULATION FOR ACUSTIC DAMPENING.
 33. ADD ACUSTIC OR VIBRATION ISOLATION DEVICES AT GARAGE DOOR OPENERS THAT ARE ADJACENT TO HABITABLE SPACES ABOVE.
 34. WHERE WALL TILE IS INSTALLED IN TUB AND SHOWER AREAS GLASS MAT BACKING PANELS (ASTM C127), FIBER-REINFORCED GYPSUM PANELS (ASTM C127), NON-ABSORBENT FIBER-CEMENT BACKER BOARD (ASTM C120) OR NON-ABSORBENT FIBER REINFORCED CONCRETE BACKER UNITS (ASTM C120) SHALL BE USED PER FC-R 702.4. WATER-RESISTANT BOARD SHALL NOT BE USED.

WINDOW NOTE KEY:

- WINDOW SIZE CALLOUT: ALL WINDOW CALLOUTS ARE MEASURED IN FEET & INCHES AS PER THE EXAMPLE TABLE ABOVE.
- | | |
|------------------|------------------|
| 2000 S.H. (EERO) | 2000 S.H. (EERO) |
| 2000 S.H. (EERO) | 2000 S.H. (EERO) |

DOOR NOTE KEY:

- DOOR SIZE CALLOUT: ALL DOOR CALLOUTS ARE MEASURED IN FEET & INCHES AS PER THE EXAMPLE TABLE ABOVE.
- | | |
|------------------|------------------|
| 2000 S.H. (EERO) | 2000 S.H. (EERO) |
| 2000 S.H. (EERO) | 2000 S.H. (EERO) |

BRG. HT. LEGEND

- POURED CONCRETE FLEED CELL WITHIN AN 8" CMU WALL, U.N.O. 4" VERT. AS REBAR CONT. FROM FOUNDATION SLAB TO SOING BEAM (MIN. OF 2" LAP ON ALL STEEL REINFORCING BARS)
- 20" BRG. CMU INDICATES BRG. WALL
 - 20" BRG. CMU PER PLAN
 - 20" BRG. CMU PER PLAN

Area Tabulations

Living:	Nautilus
1st floor:	813 sf
2nd floor:	1,134 sf
Total Living:	1,947 sf
entry:	18 sf
garage:	331 sf
Total Area:	2,296 sf

Floor Plan

SCALE: 1/4" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vineland Road Suite #6 Orlando, FL 32811
Ph: (407) 629-6711
Fax: (407) 734-1750
www.iteg.com

815 Oriole Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignersgroup.com
www.mjsdesignersgroup.com
DESIGNERS GROUP
residentialcommercialarchitecture

MJS
designers group
residentialcommercialarchitecture

AI
BD

GOBA
GENERAL OVERSIGHT BOARD

5-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Plat # XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code


A division of Park Square
Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES


ISSUE DATE: 04/13/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

NAUTILUS FLR. PLAN
A4


WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified in writing of any changes in the dimensions, conditions and specifications appearing on these plans.

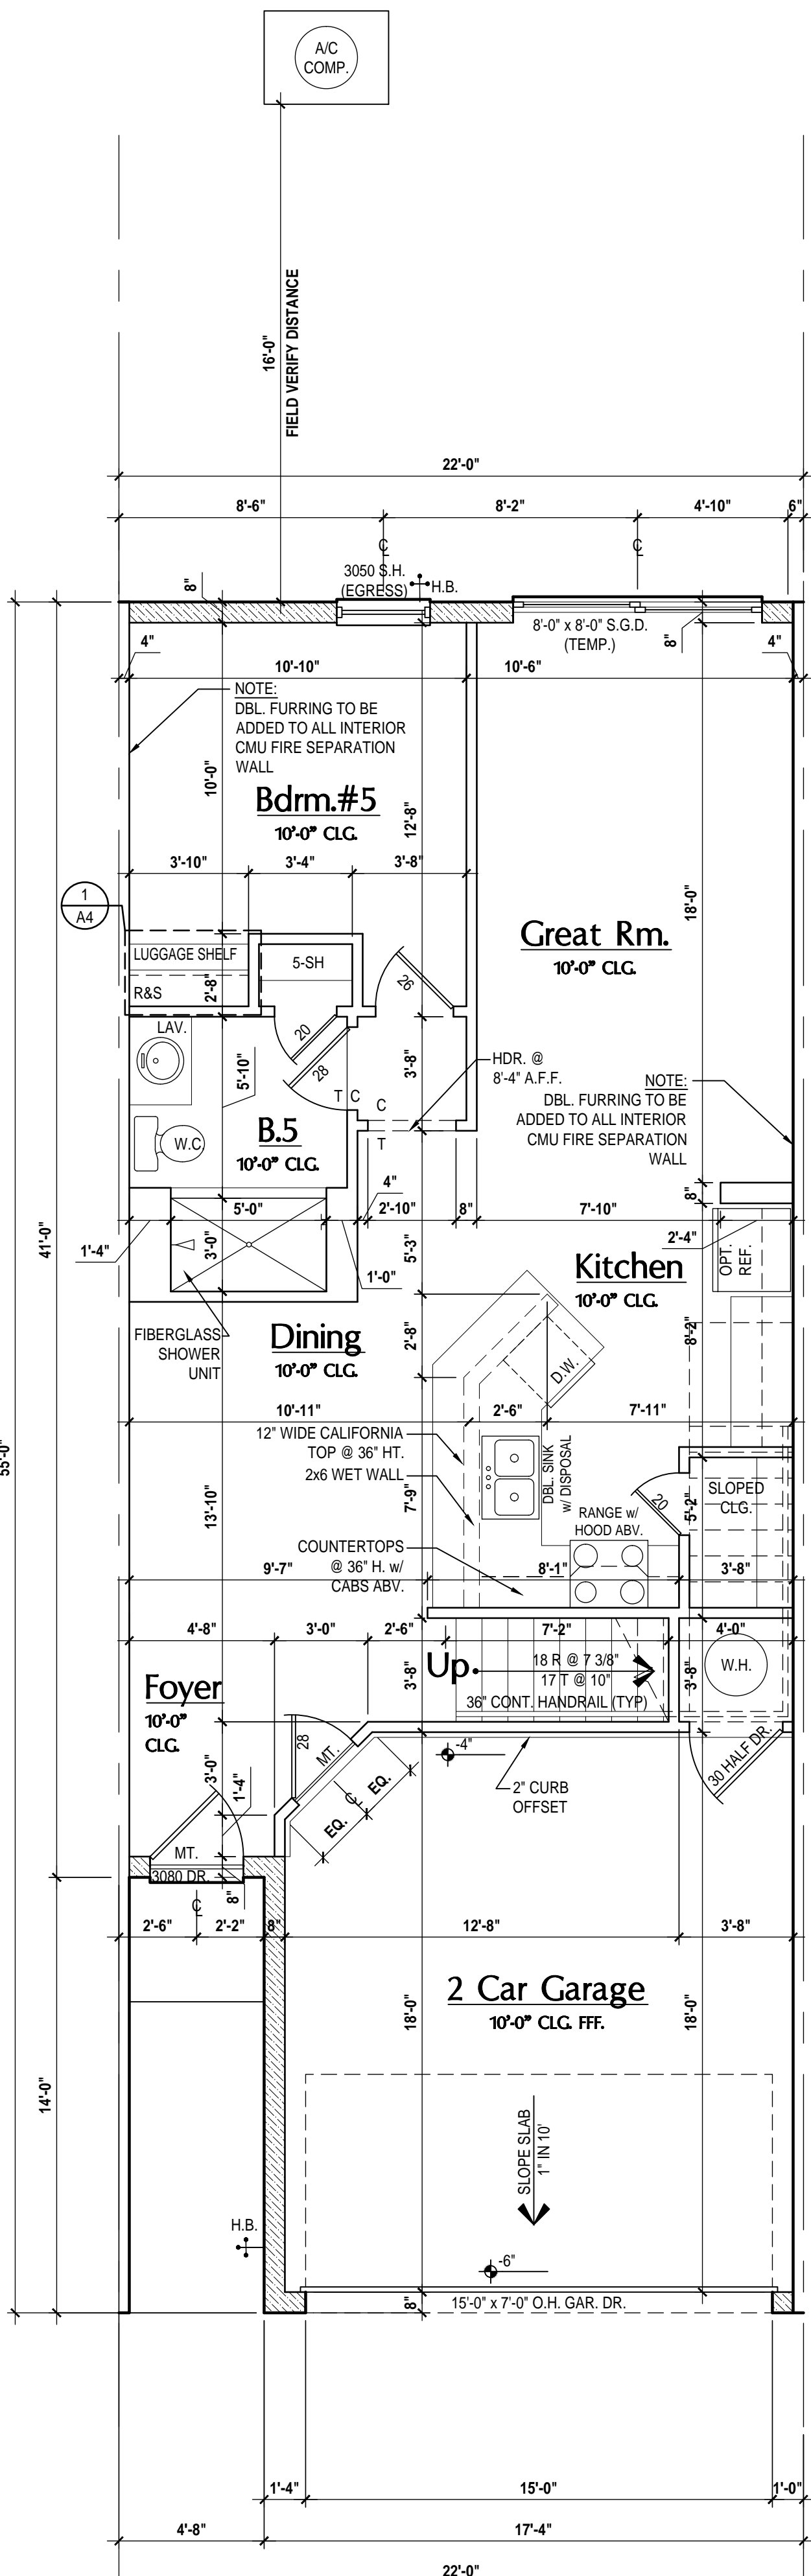


First Floor
SCALE: 1/4" = 1'-0"

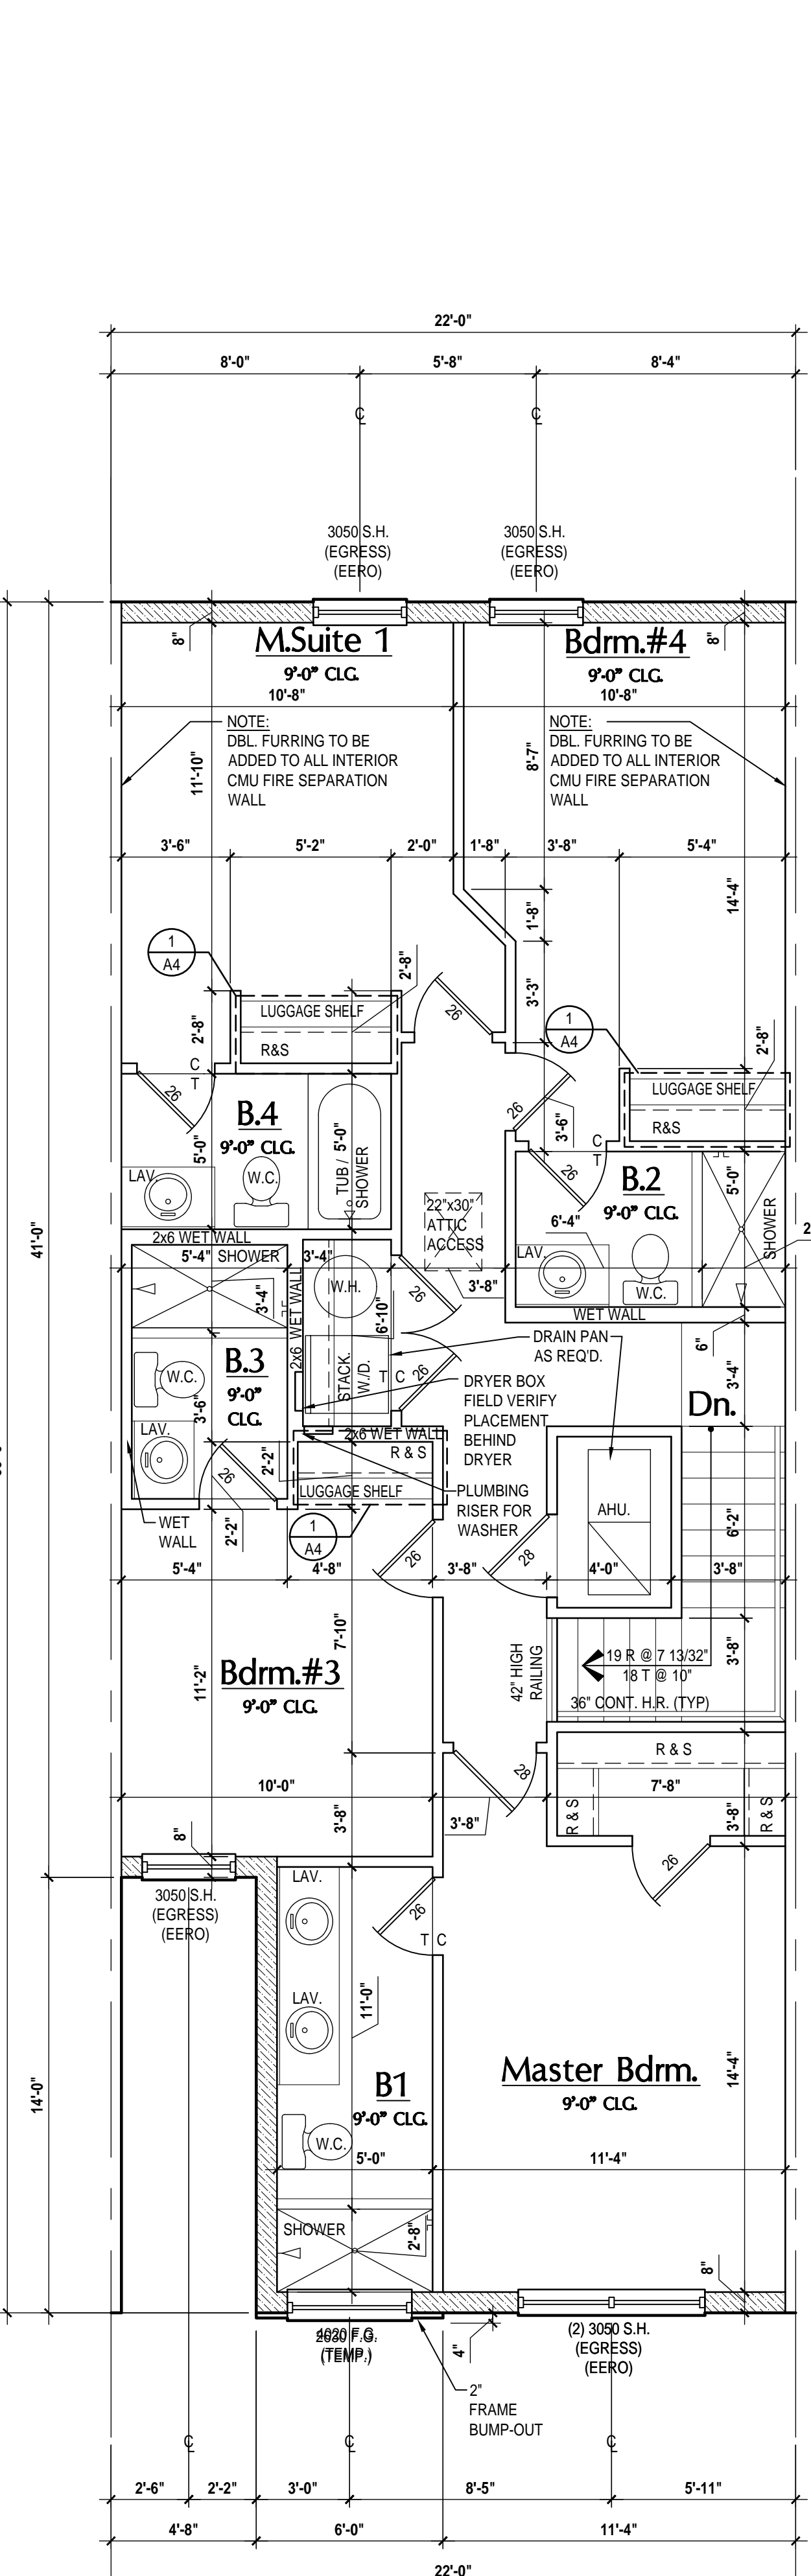

Second Floor- "Elev. A"
SCALE: 1/4" = 1'-0"

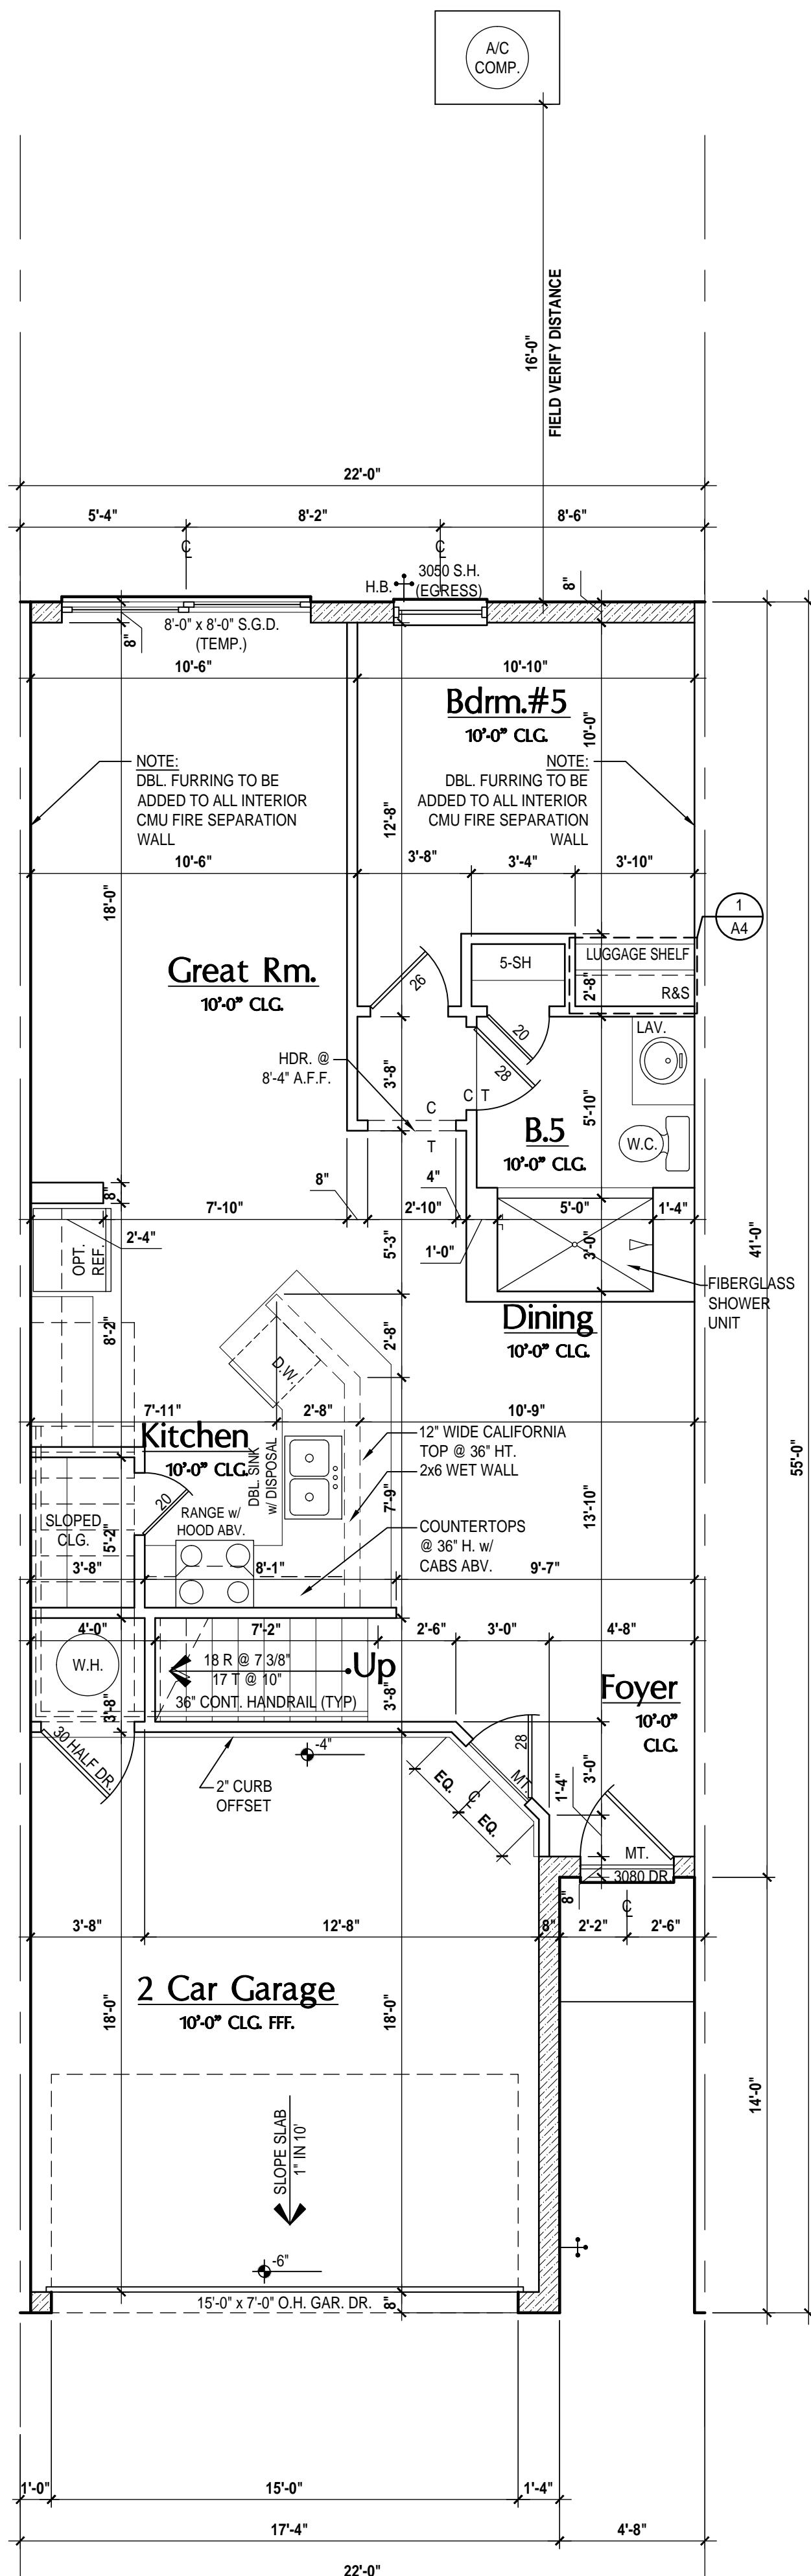

First Floor- Rev.
SCALE: 1/4" = 1'-0"

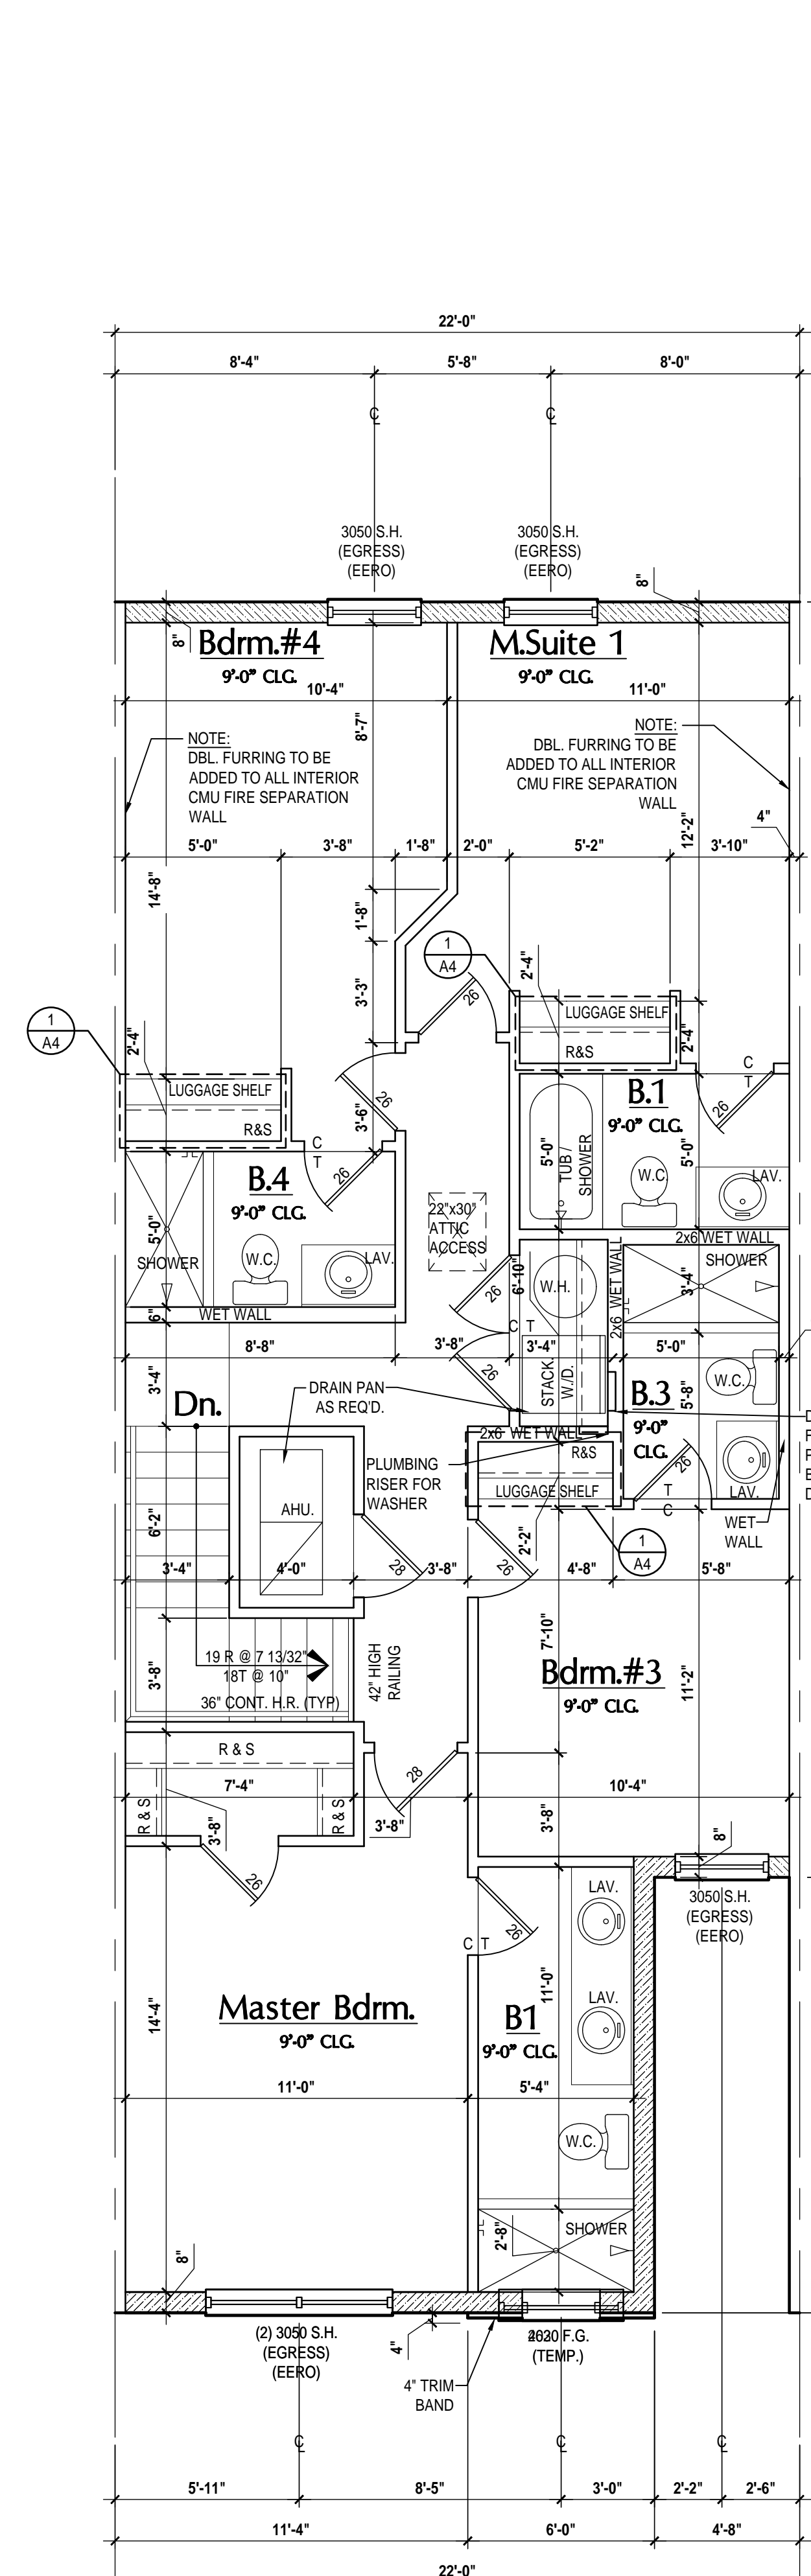

Second Floor- Rev. - "Elev. A"
SCALE: 1/4" = 1'-0"

GENERAL NOTES KEY:

- THIS STRUCTURE HAS BEEN DESIGNED TO MEET OR EXCEED REQUIREMENTS OF THE (2023) FLORIDA BUILDING CODE (8TH EDITION)
- ABBREVIATIONS:**
- 2 - # OF DOORS
 - 2 - # OF WINDOWS
 - MT - METAL THRESHOLD
 - FR - FRENCH DOORS
 - SL - SIDE LIGHT
 - FG - FIXED GLASS
 - TR - TRANSOM
 - GB - GLASS BLOCK
 - PKT - POCKET DOOR
 - OBS - OBSCURED GLASS
 - TEMP - TEMPERED GLASS
 - SH - SINGLE HUNG
 - DH - DOUBLE HUNG
 - HR - HORIZONTAL ROLLER
 - BF - BYPASS
 - BF - BIFOLD
 - TYP - TYPICAL
- NOTES:**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
 - DO NOT SCALE PRINTED CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS. ONLY DIMENSIONS ON DRAWINGS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 - MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMPANY AND COUNTY CODES.
 - A/C CONDENSATE LINES TO BE ANCHORED TO SLAB PER CODE FC-R 1307.2 & FC-M 354.
 - PROVIDE RECESS H2O WATER W/ DRAIN & WASHER SPACE.
 - VENT DRYER THRU EXTERIOR WALL U.N.O.
 - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
 - PROVIDE RECESS H2O WATER W/ DRAIN & WASHER SPACE.
 - SAG RESISTANT DRYWALL ON ALL CEILING WITH FRAMING MEMBER AT 3" C.C. SHALL HAVE DRYWALL INSTALLED PERPENDICULAR TO FRAMING TO MINIMIZE SAGGING PER FC-R 702.3.5.
 - PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
 - REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH PRICES.
 - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
 - ALL EXTERIOR FRAME WALL DIMENSIONS TO BE 1/2" U.N.O.
 - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1/2" U.N.O.
 - ALL INT. FIRST FLOOR CEILING AT 8'-0" U.N.O.
 - ALL INT. SECOND FLOOR CEILING AT 8'-0" U.N.O.
 - CMU & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12' OR MORE SHALL BE CONSIDERED SHEAR WALL SVS - SHEAR WALL SEGMENTS.
 - OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED W/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FC-R302.5.1.
 - INSTALL 5/8" TYP. X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP).
 - GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
 - ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
 - ALL OPERABLE WINDOWS LOCATED MORE THAN 12" AOV. SURFACE BELOW SHALL HAVE THE LOWEST POSITION OF WINDOW CLOSING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVED PER FC-R312.3.
 - ALL EXTERIOR EGRESS OPENING SHALL BE IN ACCORDANCE W/ SECTION FC-R310.
 - ALL INT. DOORS TO BE 6" TALL U.N.O. OR PER BUILDER / CLIENT.
 - 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING.
 - 1/2" GYPSUM BOARD APPLIED TO THE ACCESSIBLE AREA UNDER STAIR SURFACE AND SIDES.
 - THERMAL BARRIER: FOAM PLASTIC SHALL BE SEPARATED FROM THE INTERIOR OF A BUILDING BY NOT LESS THAN 1/2" MIN. 3/4" MINIMUM WALLBOARD, 2x10 INCH (12.5 MM) WOOD STRUCTURAL PANEL OR A MATERIAL THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE INTERESTER FIRE TEST OF APP. 215.
 - ADDRESS IDENTIFICATION SHALL BE IN ACCORDANCE W/ SECTION FC-R315.
 - ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH GROUNDING PANELS (OR SIMILAR).
 - SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.
 - ATTC ACCESS OPENING SHOULD BE WEATHERSTRIPPED AND INSULATED TO THE EXTERIOR TO INSULATE ON THE SURROUNDING AREAS PER FC-R302.4.
 - FILL VOID OF UNDERSIDE OF TUBS & SHOWERS WITH INSULATION FOR ACUSTIC DAMPENING.
 - ADD ACUSTIC OR VIBRATION ISOLATION DEVICES AT GARAGE DOOR OPENERS THAT ARE ADJACENT TO HABITABLE SPACES ABOVE.
 - WHERE WALL TILE IS INSTALLED IN TUB AND SHOWER AREAS GLASS MAT DRYWALL BACKING PANELS (ASTM C715), FIBER-REINFORCED GYPSUM PANELS (ASTM C715), NON-ARRESTOR FIBER-CEMENT BACKER BOARD (ASTM C715), NON-ARRESTOR FIBER-REINFORCED GYPSUM BACKER UNITS (ASTM C715) SHALL BE USED PER FC-R 702.4. PAPER-FACED GYPSUM BOARD SHALL NOT BE USED.

WINDOW NOTE KEY:

WINDOW SIZE CALLOUT: 2000 x 2'-0" x 4'-0" 2000 x 2'-0" x 5'-0" 2000 x 2'-0" x 6'-0"	ALL WINDOW CALLOUTS ARE MEASURED IN FEET & INCHES AS PER THE EXAMPLE TABLE ABOVE.
--	---

DOOR NOTE KEY:

DOOR SIZE CALLOUT: 24 x 2'-0" 40 B.F. 4'-0" BIFOLD 24 x 2'-4" 50 B.F. 5'-0" BIFOLD 24 x 2'-8" 60 B.F. 6'-0" BIFOLD 24 x 2'-8" 60 B.F. 6'-0" BIFOLD 30 x 3'-0"	
--	--

BRG. HT. LEGEND

- POURED CONCRETE FLEED CELL WITHIN AN 8" CMU WALL, U.N.O. 4" VERT. AS REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM (MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS)
- INDICATES BRG. WALL
- BRG. HT.
- INDICATES BRG. WALL
- FRAME WALL PER PLAN

Area Tabulations

	Latitude
1st floor:	813 sf
2nd floor:	1,134 sf
Total Living:	1,947 sf
entry:	18 sf
garage:	331 sf
Total Area:	2,296 sf

Floor Plan

SCALE: 1/4" = 1'-0"

815 Orianta Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesigns.com
www.mjsdesignsgroup.com
DESIGNS ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

MJS designs group
residential/commercial/architecture

AI **BD**

GOBA
GENERAL OVERSIGHT BOARD

5-Unit: (Paradiso TH)
Models: N/A, Latitude
Building Plat # XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code


A division of Park Square Enterprises Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES


ISSUE DATE: 04/13/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

LATITUDE FLR. PLAN
A5


WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR DIMENSIONS AND CONDITIONS OF THE JOB AND MJS, INC. SHALL BE NOTIFIED IN WRITING OF ANY CHANGES TO THE DIMENSIONS, CONDITIONS AND SPECIFICATIONS APPEARING ON THESE PLANS.

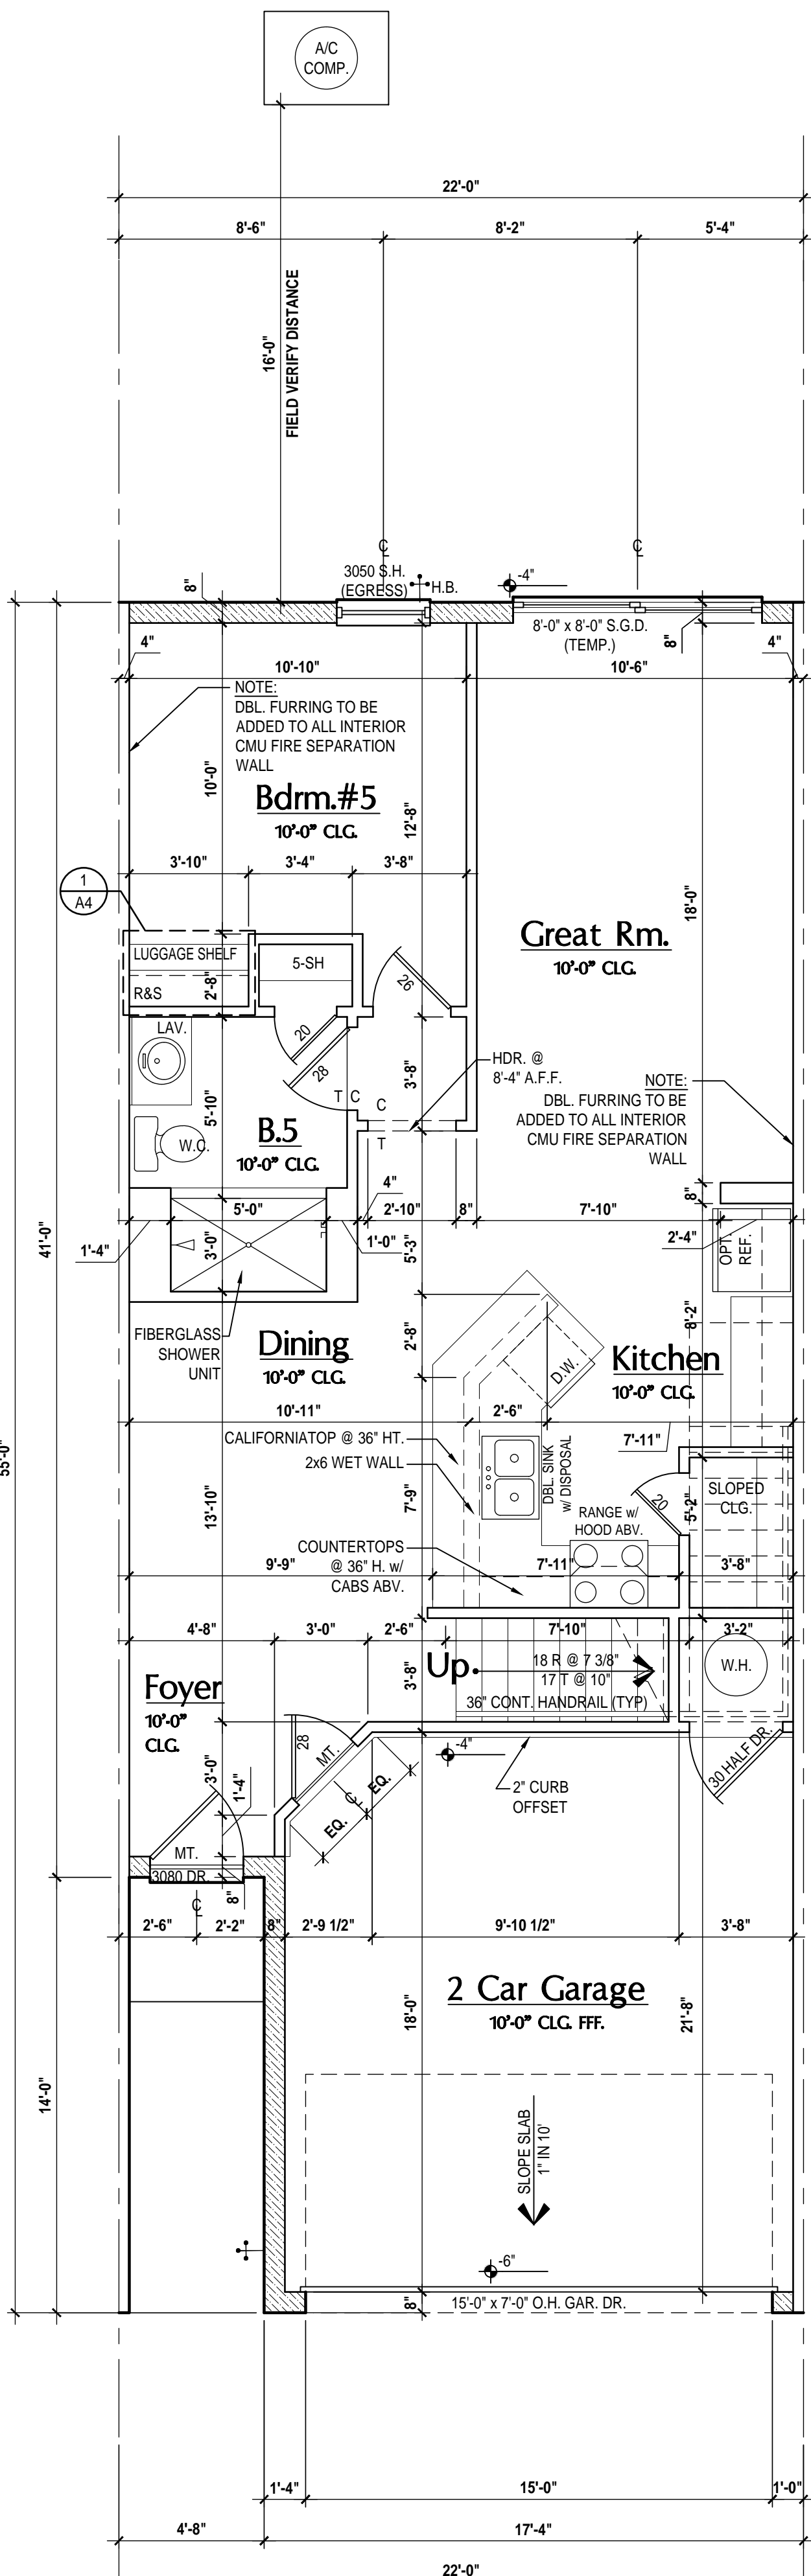


Latitude II First Floor
SCALE: 1/4" = 1'-0"

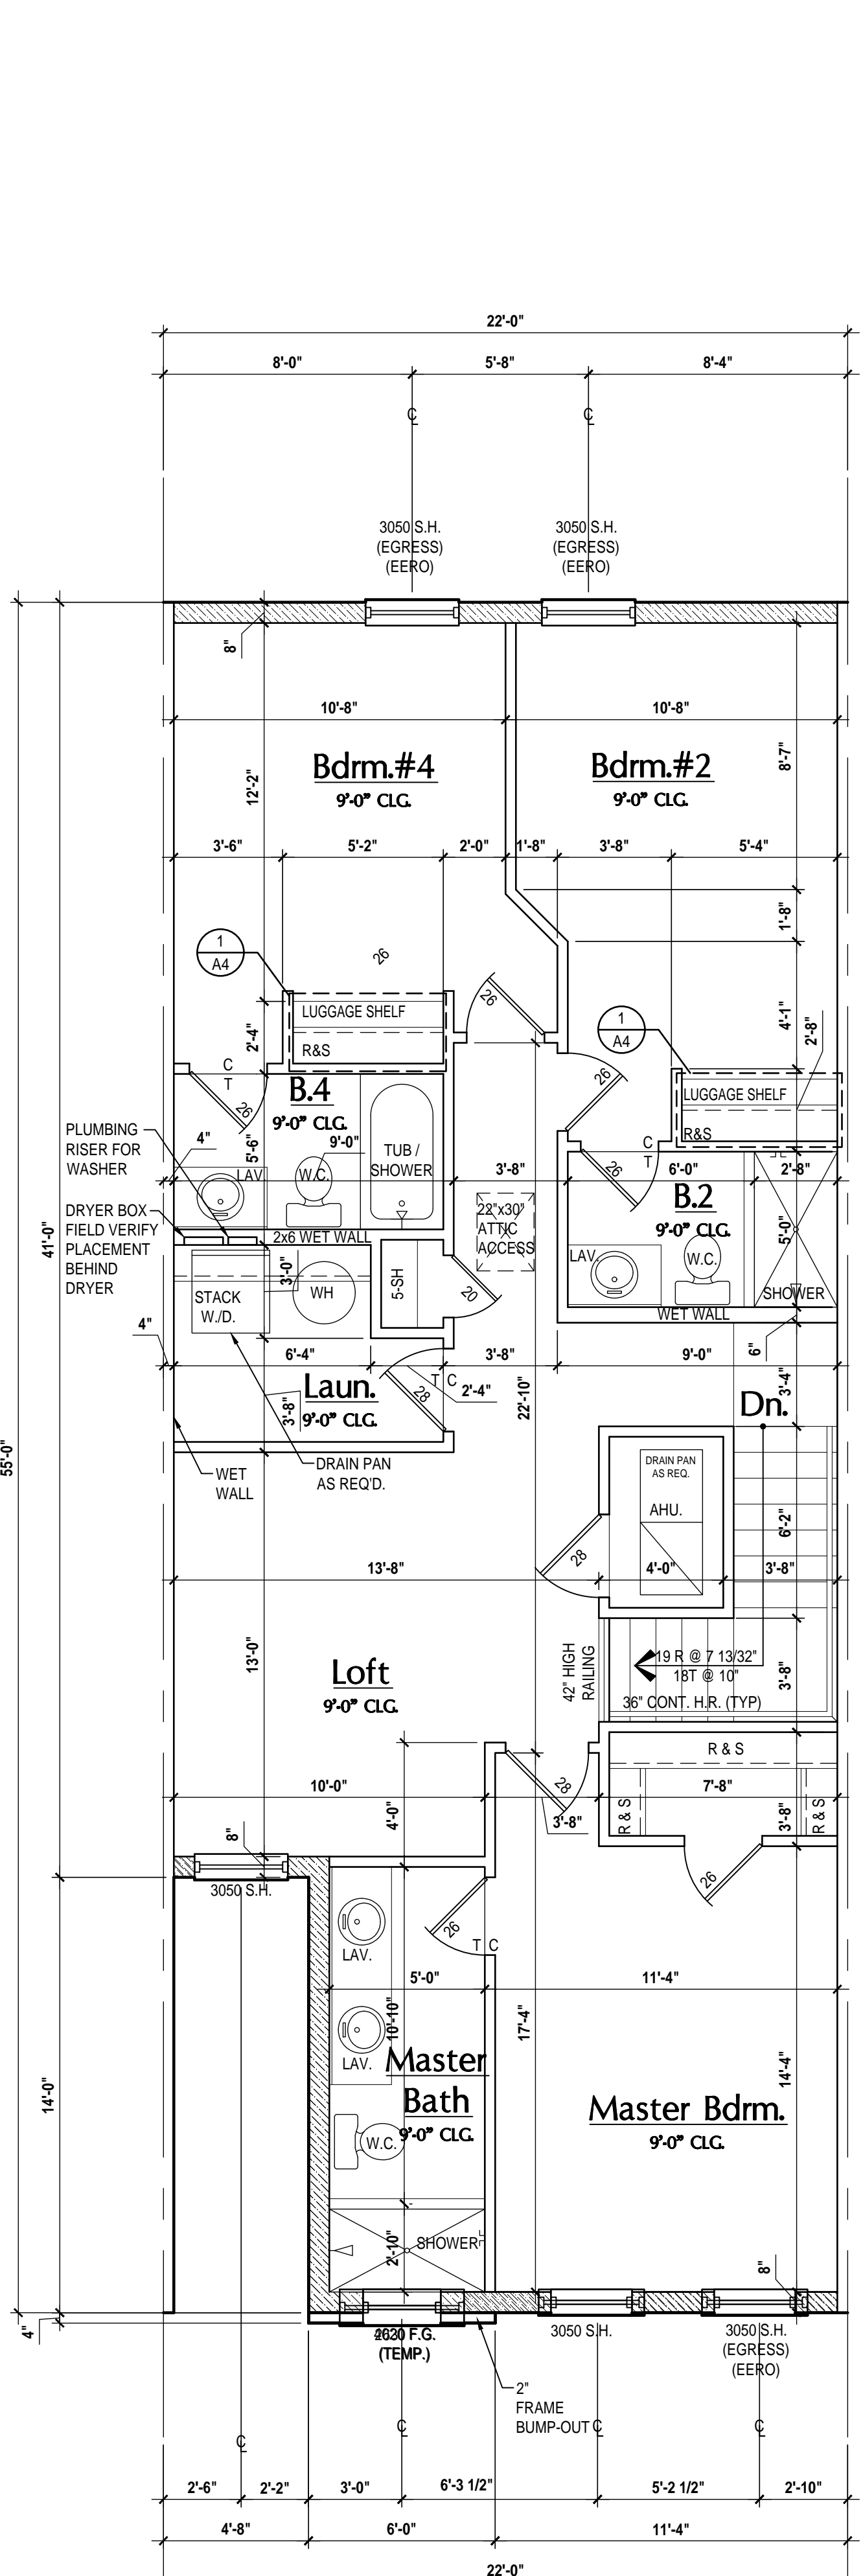

Latitude II Second Floor- "Elev. A"
SCALE: 1/4" = 1'-0"

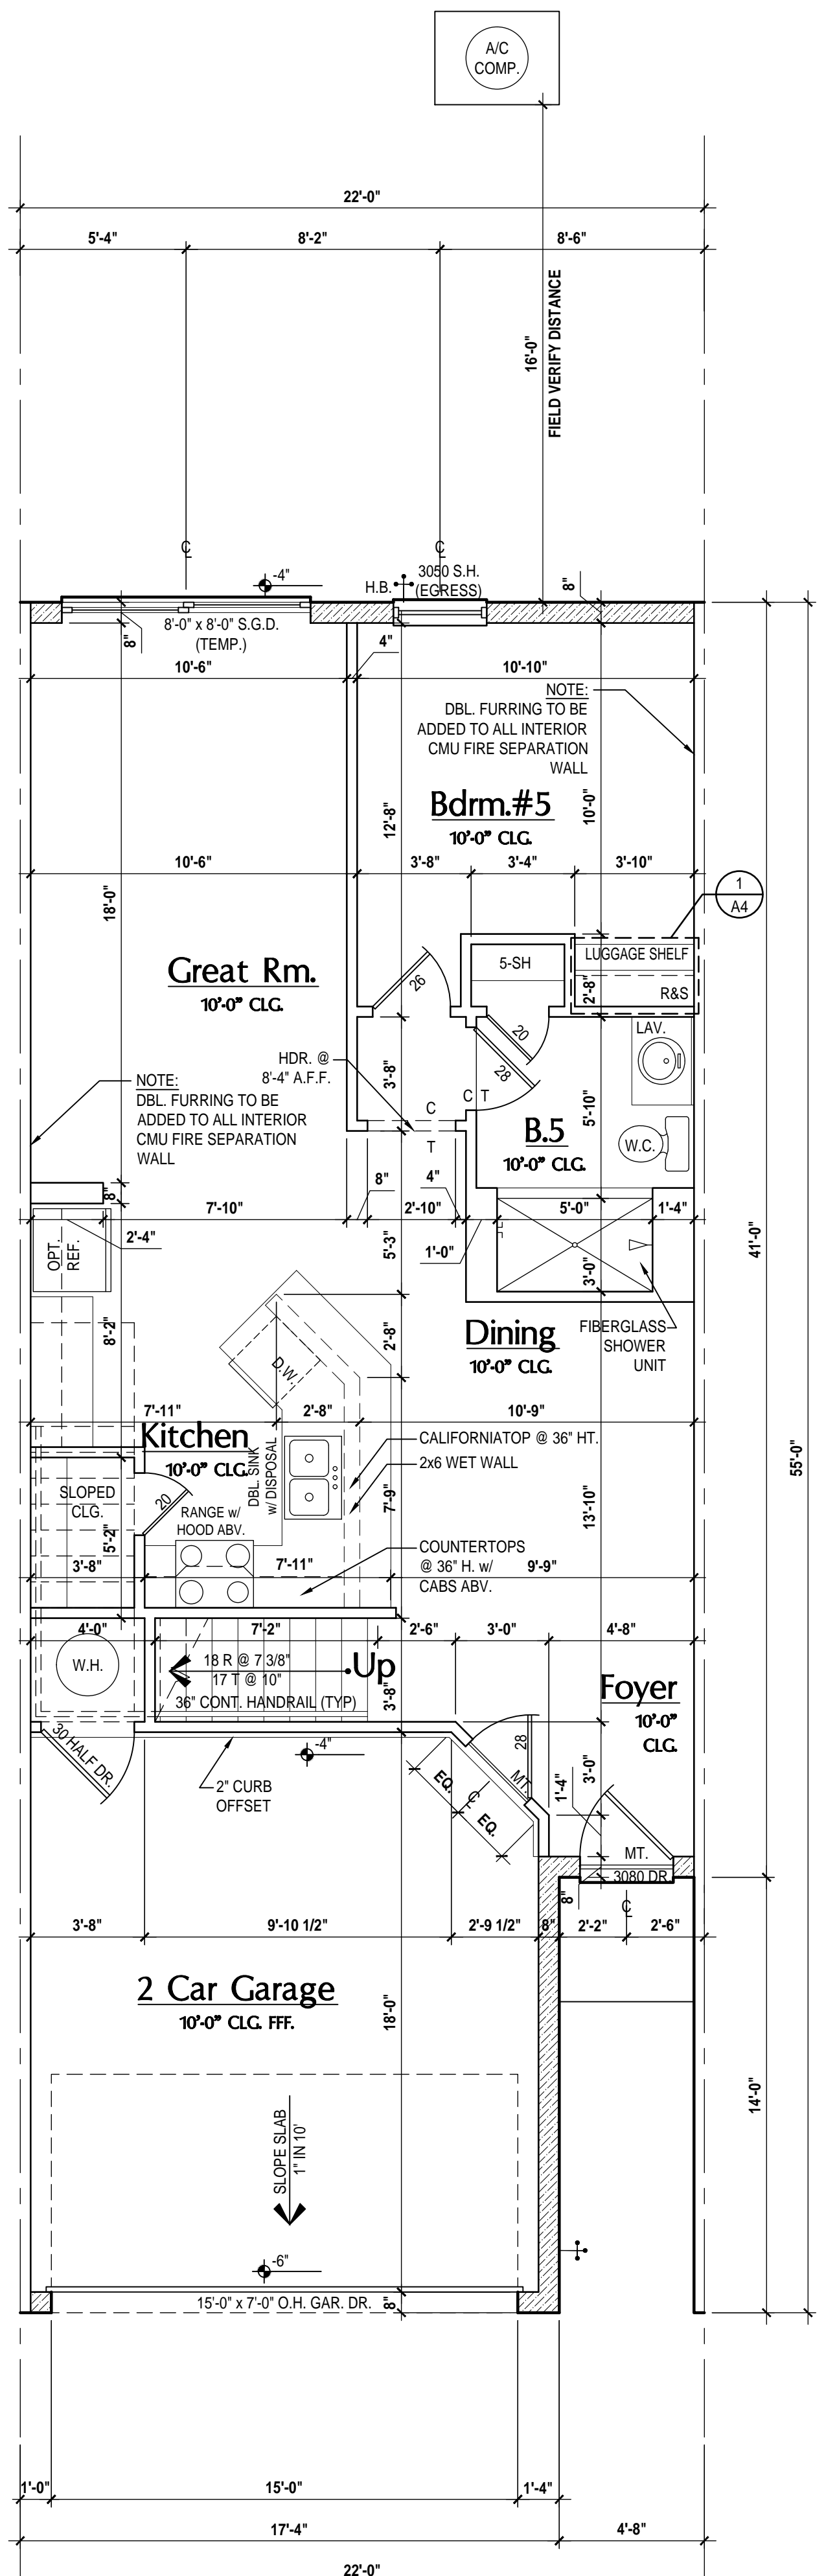

Latitude II First Floor- Rev.
SCALE: 1/4" = 1'-0"

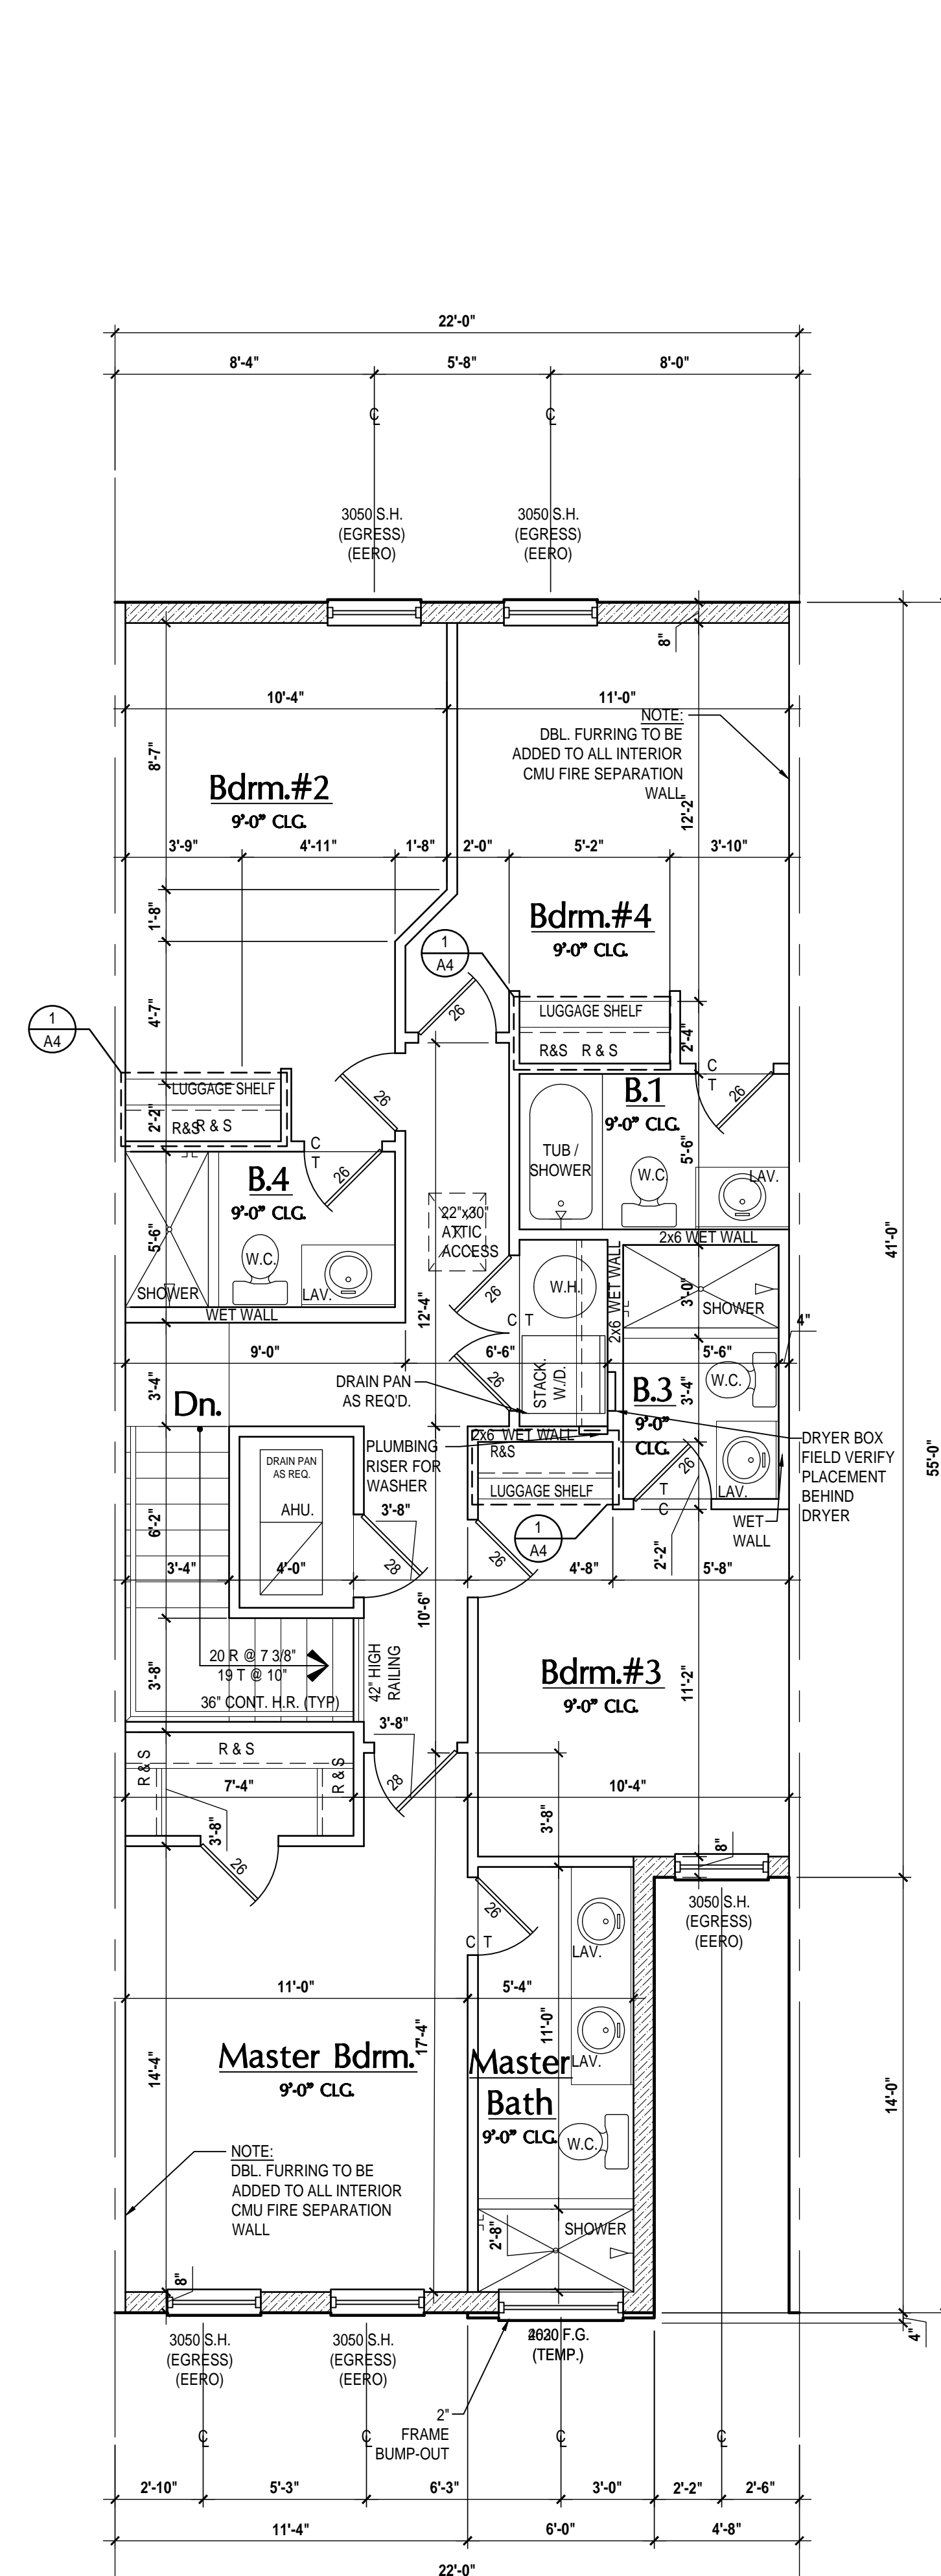

Latitude II Second Floor- Rev. - "Elev. A"
SCALE: 1/4" = 1'-0"

GENERAL NOTES KEY:

- THIS STRUCTURE HAS BEEN DESIGNED TO MEET OR EXCEED REQUIREMENTS OF THE (2023) FLORIDA BUILDING CODE (8TH EDITION)
- ABBREVIATIONS:**
- 2 - # OF DOORS
 - 2 - # OF WINDOWS
 - MT - METAL THRESHOLD
 - FR - FRENCH DOORS
 - SL - SIDE LIGHT
 - FG - FIXED GLASS
 - TR - TRANSOM
 - GB - GLASS BLOCK
 - PKT - POCKET DOOR
 - OBS - OBSCURED GLASS
 - TEMP - TEMPERED GLASS
 - SH - SINGLE HUNG
 - DH - DOUBLE HUNG
 - HR - HORIZONTAL ROLLER
 - BF - BYPASS
 - BF - BIFOLD
 - TYP - TYPICAL
- NOTES:**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
 - DO NOT SCALE PRINTED CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS. ONLY DIMENSIONS ON DRAWINGS OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 - MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMPANY AND COUNTY CODES.
 - AC CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE FC-R 1307.2 & FC-M 354.
 - PROVIDE RECESS H2O WATER W/ DRAIN & WASHER SPACE.
 - VENT DRYER THRU EXTERIOR WALL U.N.O.
 - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
 - PROVIDE RECESS H2O WATER W/ DRAIN & WASHER SPACE.
 - SAG RESISTANT DRYWALL ON ALL CEILING WITH FRAMING MEMBER AT 3" C.C. SHALL HAVE DRYWALL INSTALLED PERPENDICULAR TO FRAMING TO MINIMIZE SAGGING PER FC-R 702.3.5.
 - PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
 - REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISHES.
 - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
 - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 1/2" U.N.O.
 - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1/2" U.N.O.
 - ALL INT. FIRST FLOOR CEILING AT 8'-0" U.N.O.
 - ALL INT. SECOND FLOOR CEILING AT 8'-0" U.N.O.
 - CMU & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SVS - SHEAR WALL SEGMENTS.
 - OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FC-R302.5.1.
 - INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP).
 - GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
 - ALL TUB & SHOWER UNITS WILL HAVE ANTI-SLIP DEVICES INSTALLED.
 - ALL OPERABLE WINDOWS LOCATED MORE THAN 12" ANY SURFACE BELOW SHALL HAVE THE LOWEST POSITION OF WINDOW CLOSING A MIN. OF 2" ABOVE FINISHED FLOOR BEING SERVED PER FC-R312.3.
 - ALL EGRESS OPENINGS SHALL BE IN ACCORDANCE WITH SECTION FC-R310.
 - ALL INT. DOORS TO BE 6'-0" TALL U.N.O. OR PER BUILDER / CLIENT.
 - 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING.
 - 1/2" GYPSUM BOARD APPLIED TO THE ACCESSIBLE AREA UNDER STAIR SURFACE AND SIDES.
 - THERMAL BARRIER: FOAM PLASTIC SHALL BE SEPARATED FROM THE INTERIOR OF A BUILDING BY NOT LESS THAN 1/2" MIN. GYPSUM WALLBOARD, 2 1/2" MIN. WOOD STRUCTURAL PANEL OR A MATERIAL THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE INTERESTER FIRE TEST OF ASTM E 213.
 - ADDRESS IDENTIFICATION SHALL BE IN ACCORDANCE WITH SECTION FC-R315.
 - ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH GROUNDING PANELS (OR SIMILAR).
 - SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.
 - ATTIC ACCESS OPENING SHOULD BE WEATHERSTRIPPED AND INSULATED TO LEVEL EQUIVALENT TO INSULATION ON THE SURROUNDING AREAS PER FC-R302.4.
 - FILL VOID OF UNDERSIDE OF TUBS & SHOWERS WITH INSULATION FOR ACUSTIC DAMPENING.
 - ADD ACUSTIC OR VIBRATION ISOLATION DEVICES AT GARAGE DOOR OPENERS THAT ARE ADJACENT TO HABITABLE SPACES ABOVE.
 - WHERE WALL TILE IS INSTALLED IN TUB AND SHOWER AREAS GLASS MAT DRYBACK BACKER PANELS (ASTM C127), FIBER-REINFORCED POLYMER COMPOSITE BACKER PANELS (ASTM C127), NON-ABSORBENT FIBER-CEMENT BACKER BOARD (ASTM C127) OR NON-ABSORBENT FIBER-REINFORCED CONCRETE BACKER UNITS (ASTM C127) SHALL BE USED PER FC-R 702.4. PAPER-FACED GYPSUM BOARD SHALL NOT BE USED.

WINDOW NOTE KEY:

WINDOW SIZE CALLOUT: 24'-0" x 4'-0" 20'-0" x 2'-0" x 6'-0" 20'-0" x 2'-0" x 6'-0"	ALL WINDOW CALLOUTS ARE MEASURED IN FEET & INCHES AS PER THE EXAMPLE TABLE ABOVE.
--	---

DOOR NOTE KEY:

DOOR SIZE CALLOUT: 24'-0" x 4'-0" 24'-0" x 4'-0" 24'-0" x 4'-0" 24'-0" x 4'-0"	ALL WINDOW CALLOUTS ARE MEASURED IN FEET & INCHES AS PER THE EXAMPLE TABLE ABOVE.
--	---

BRG. HT. LEGEND

- POURED CONCRETE FILLED CELL WITHIN AN 8" CMU WALL, U.N.O. 1/2" VERT. AS REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM (MIN. OF 25' LAP ON ALL STEEL REINFORCING BARS)
- INDICATES BRG. WALL
- BRG. HT.
- INDICATES BRG. HT.
- FRAME WALL PER PLAN

Area Tabulations

	Latitude II
1st floor:	813 sf
2nd floor:	1,134 sf
Total Living:	1,947 sf
entry:	18 sf
garage:	331 sf
Total Area:	2,296 sf

Floor Plan

SCALE: 1/4" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vinedard Road Suite #6 Orlando, FL 32811
Ph: (407) 734-1750 Fax: (407) 734-1750 www.iteg.com

815 Oriole Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignersgroup.com
www.mjsdesignersgroup.com
DESIGNERS GROUP
residentialcommercialarchitecture
OF MJS, INC. ALL RIGHTS RESERVED.

MJS designers group
residentialcommercialarchitecture

AI **BD**

GOBA
GREAT ORANGE BUILDING GROUP

5-Unit: (Paradiso TH)
Models: Paradiso, Latitude
Building Plat #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square
Enterprises Inc.
5200 Vinedard Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES


ISSUE DATE: 04/13/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

LATITUDE II FLR. PLAN
A6

VERTICAL DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR DIMENSIONS AND CONDITIONS OF THE JOB AND M.S., INC. MUST BE NOTIFIED IN WRITING OF ANY CHANGES TO THE DIMENSIONS, CONDITIONS AND SPECIFICATIONS APPEARING ON THESE PLANS.


ELEVATION NOTES

1. ADDRESS NOTIFICATION SHALL BE IN ACCORDANCE w/ SECTION FBC-R319.

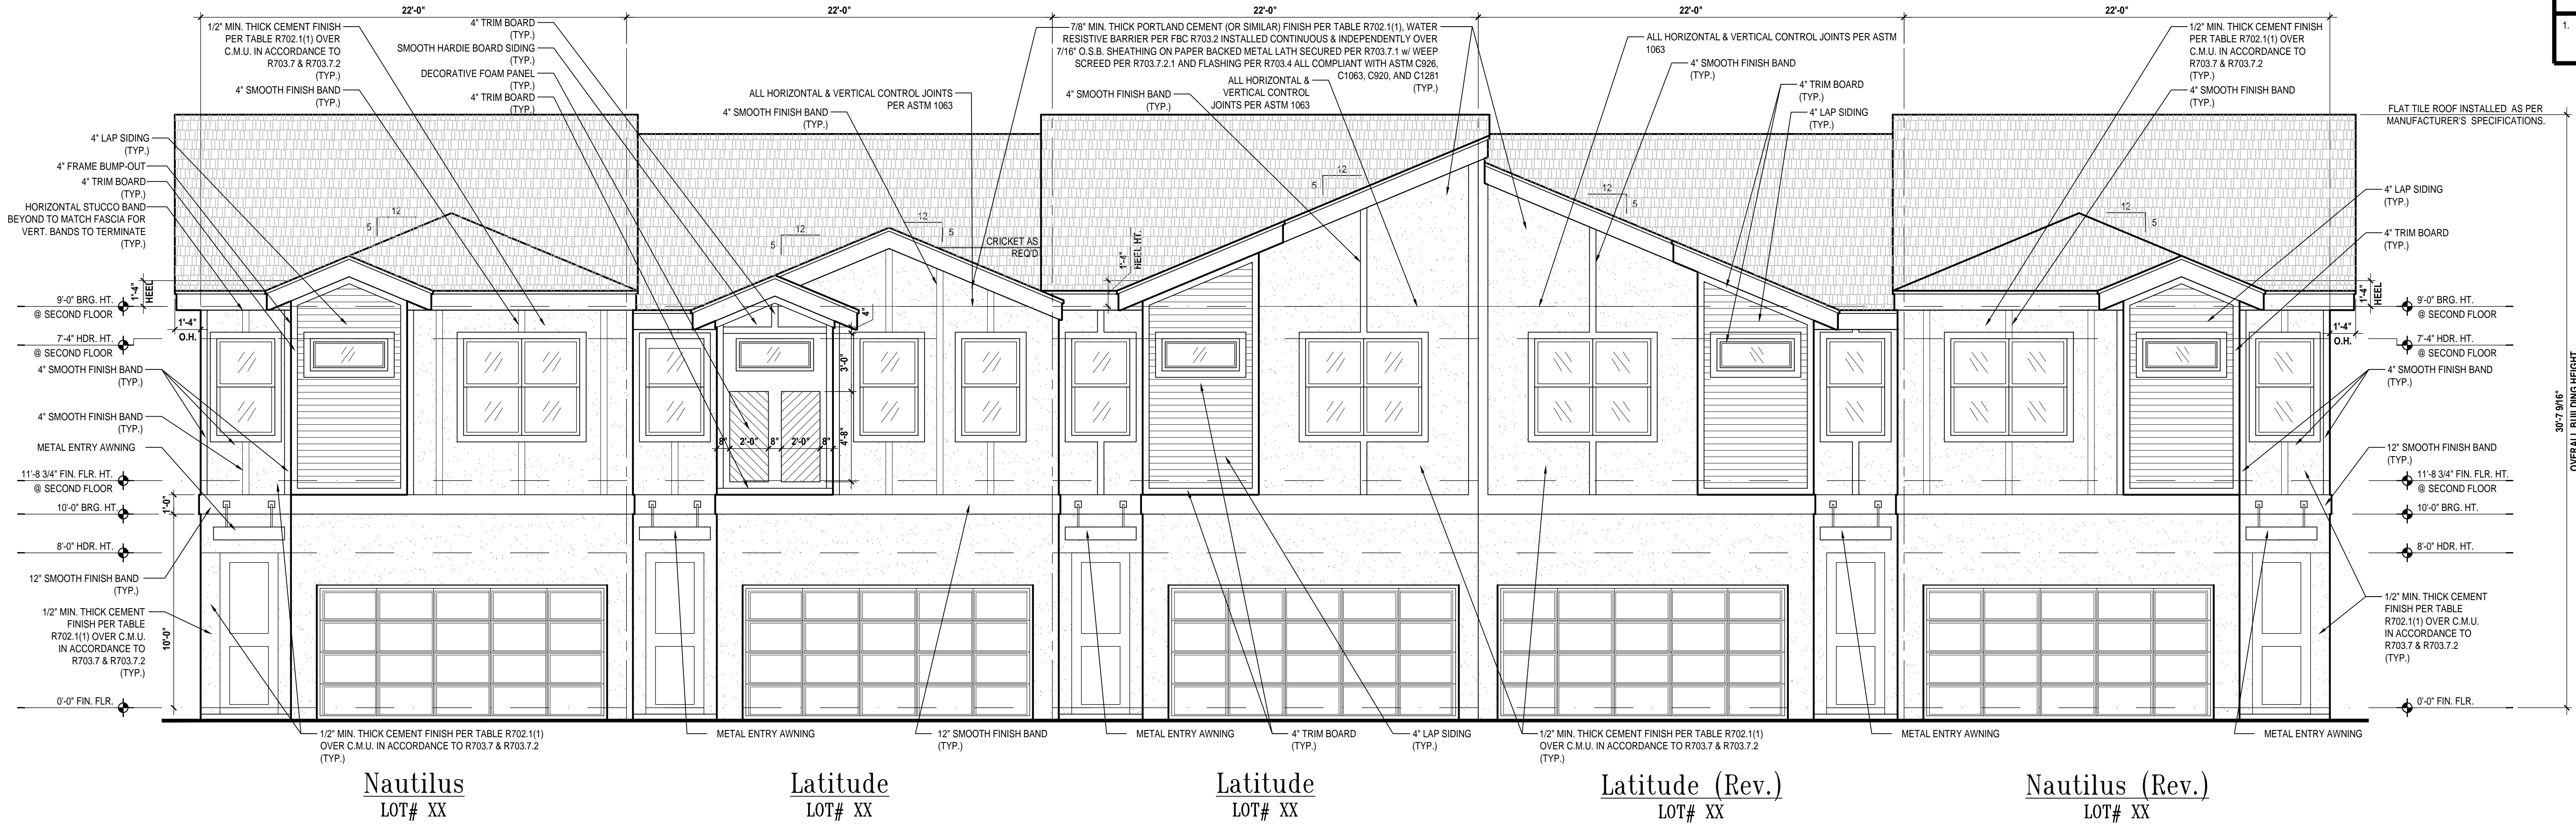


Front Elevation "A"

(Standard)
SCALE 1/4" = 1'-0"

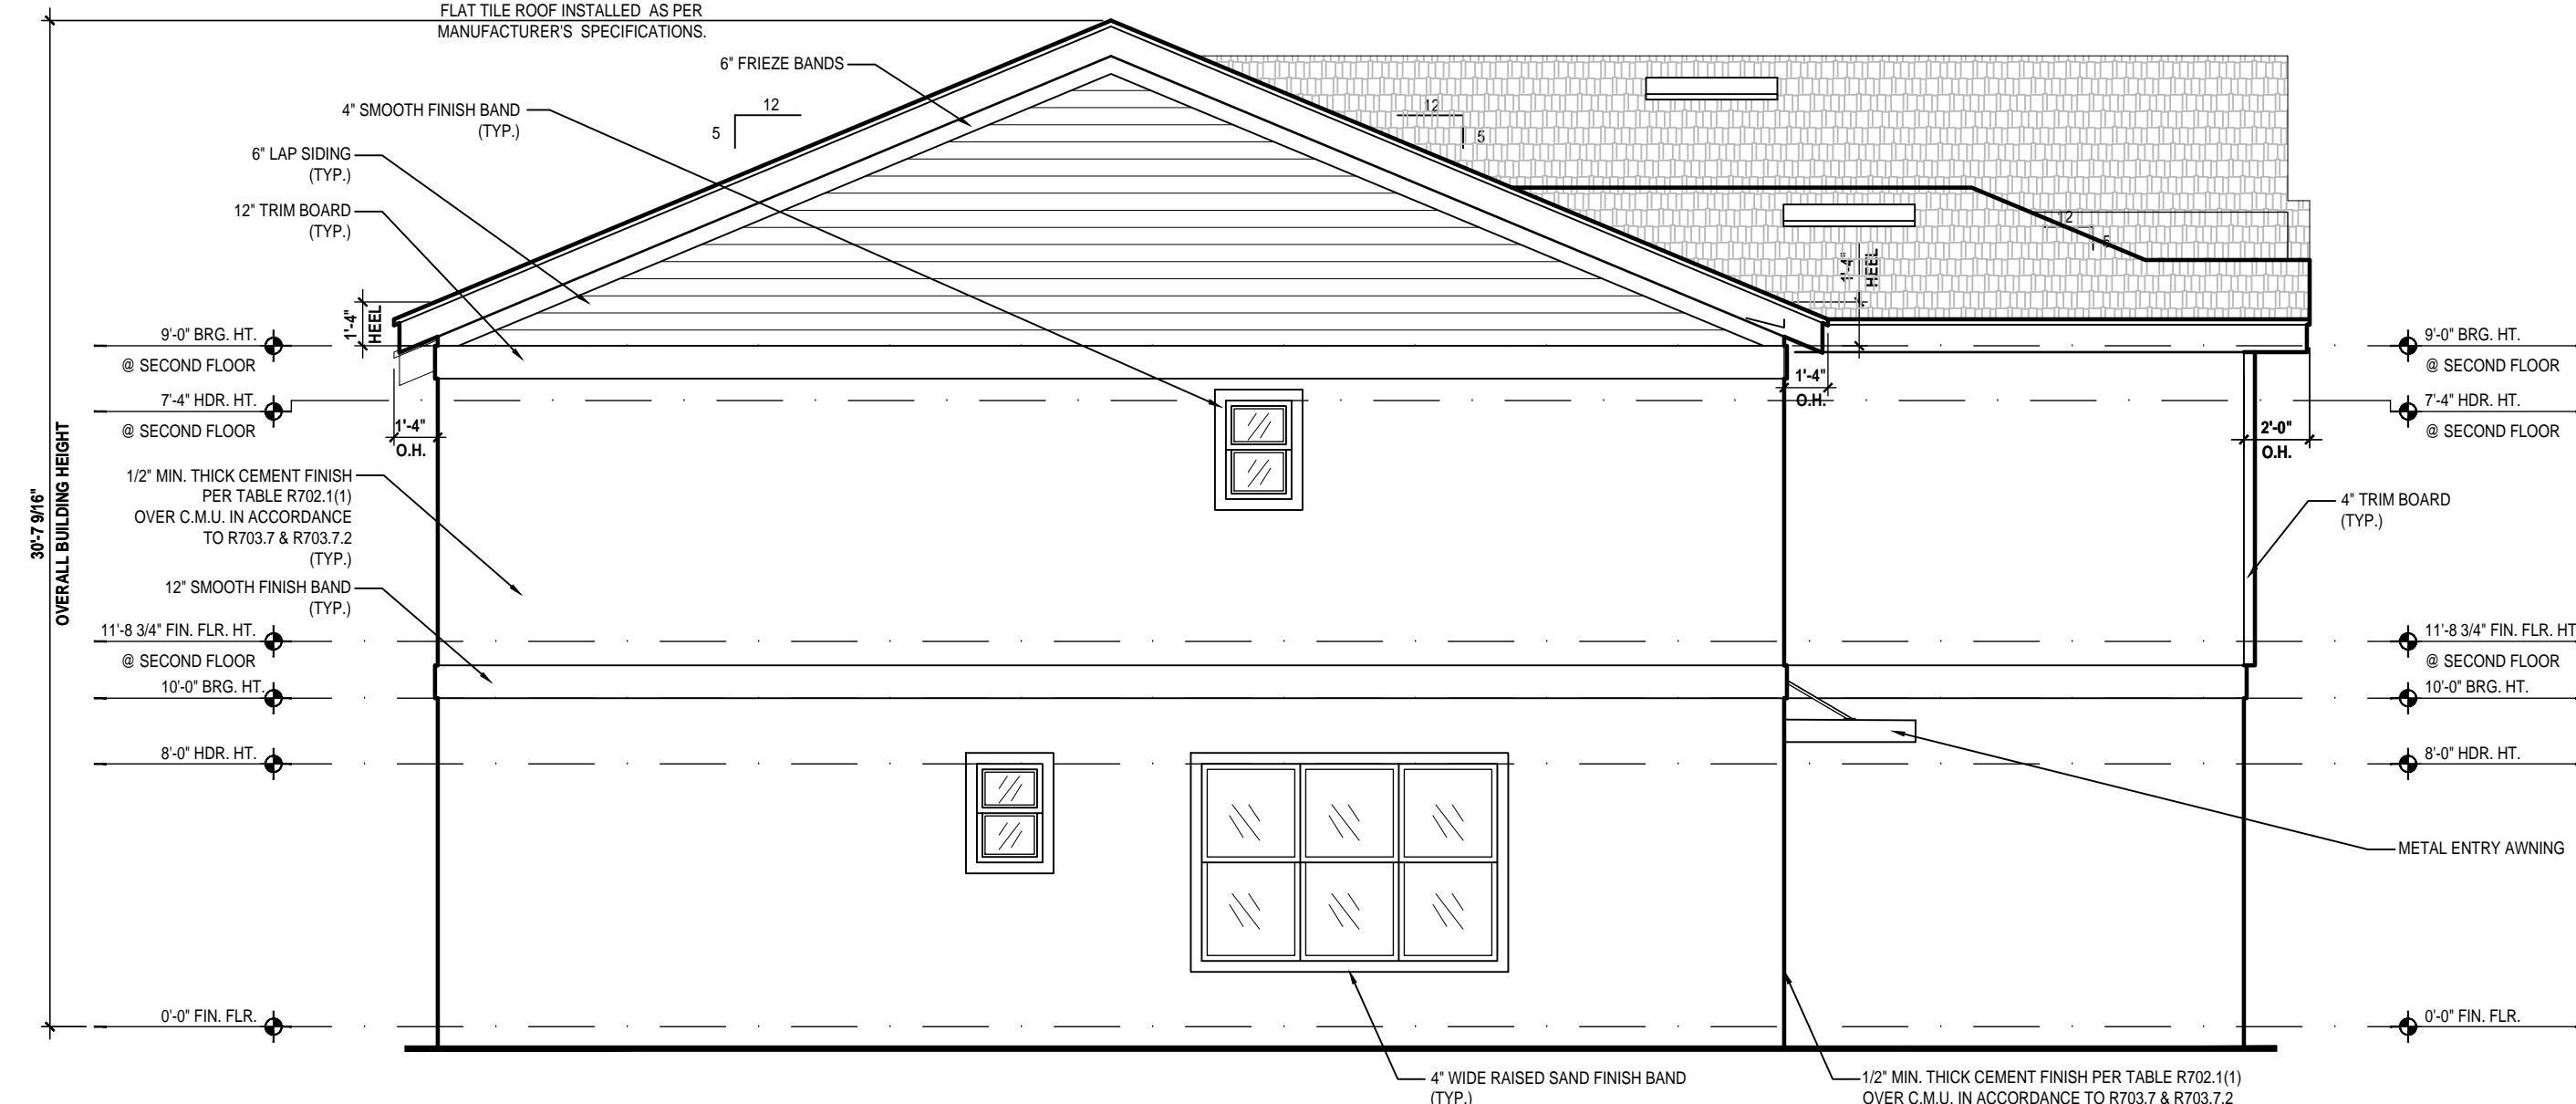


Left Elevation "A"

(Standard)
SCALE 3/16" = 1'-0"

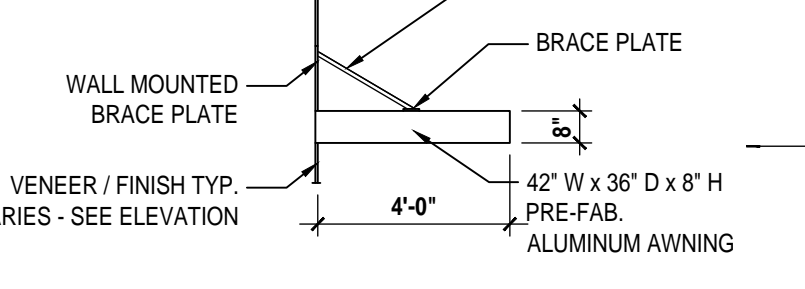

Metal Awning Detail

SCALE 1/4" = 1'-0"

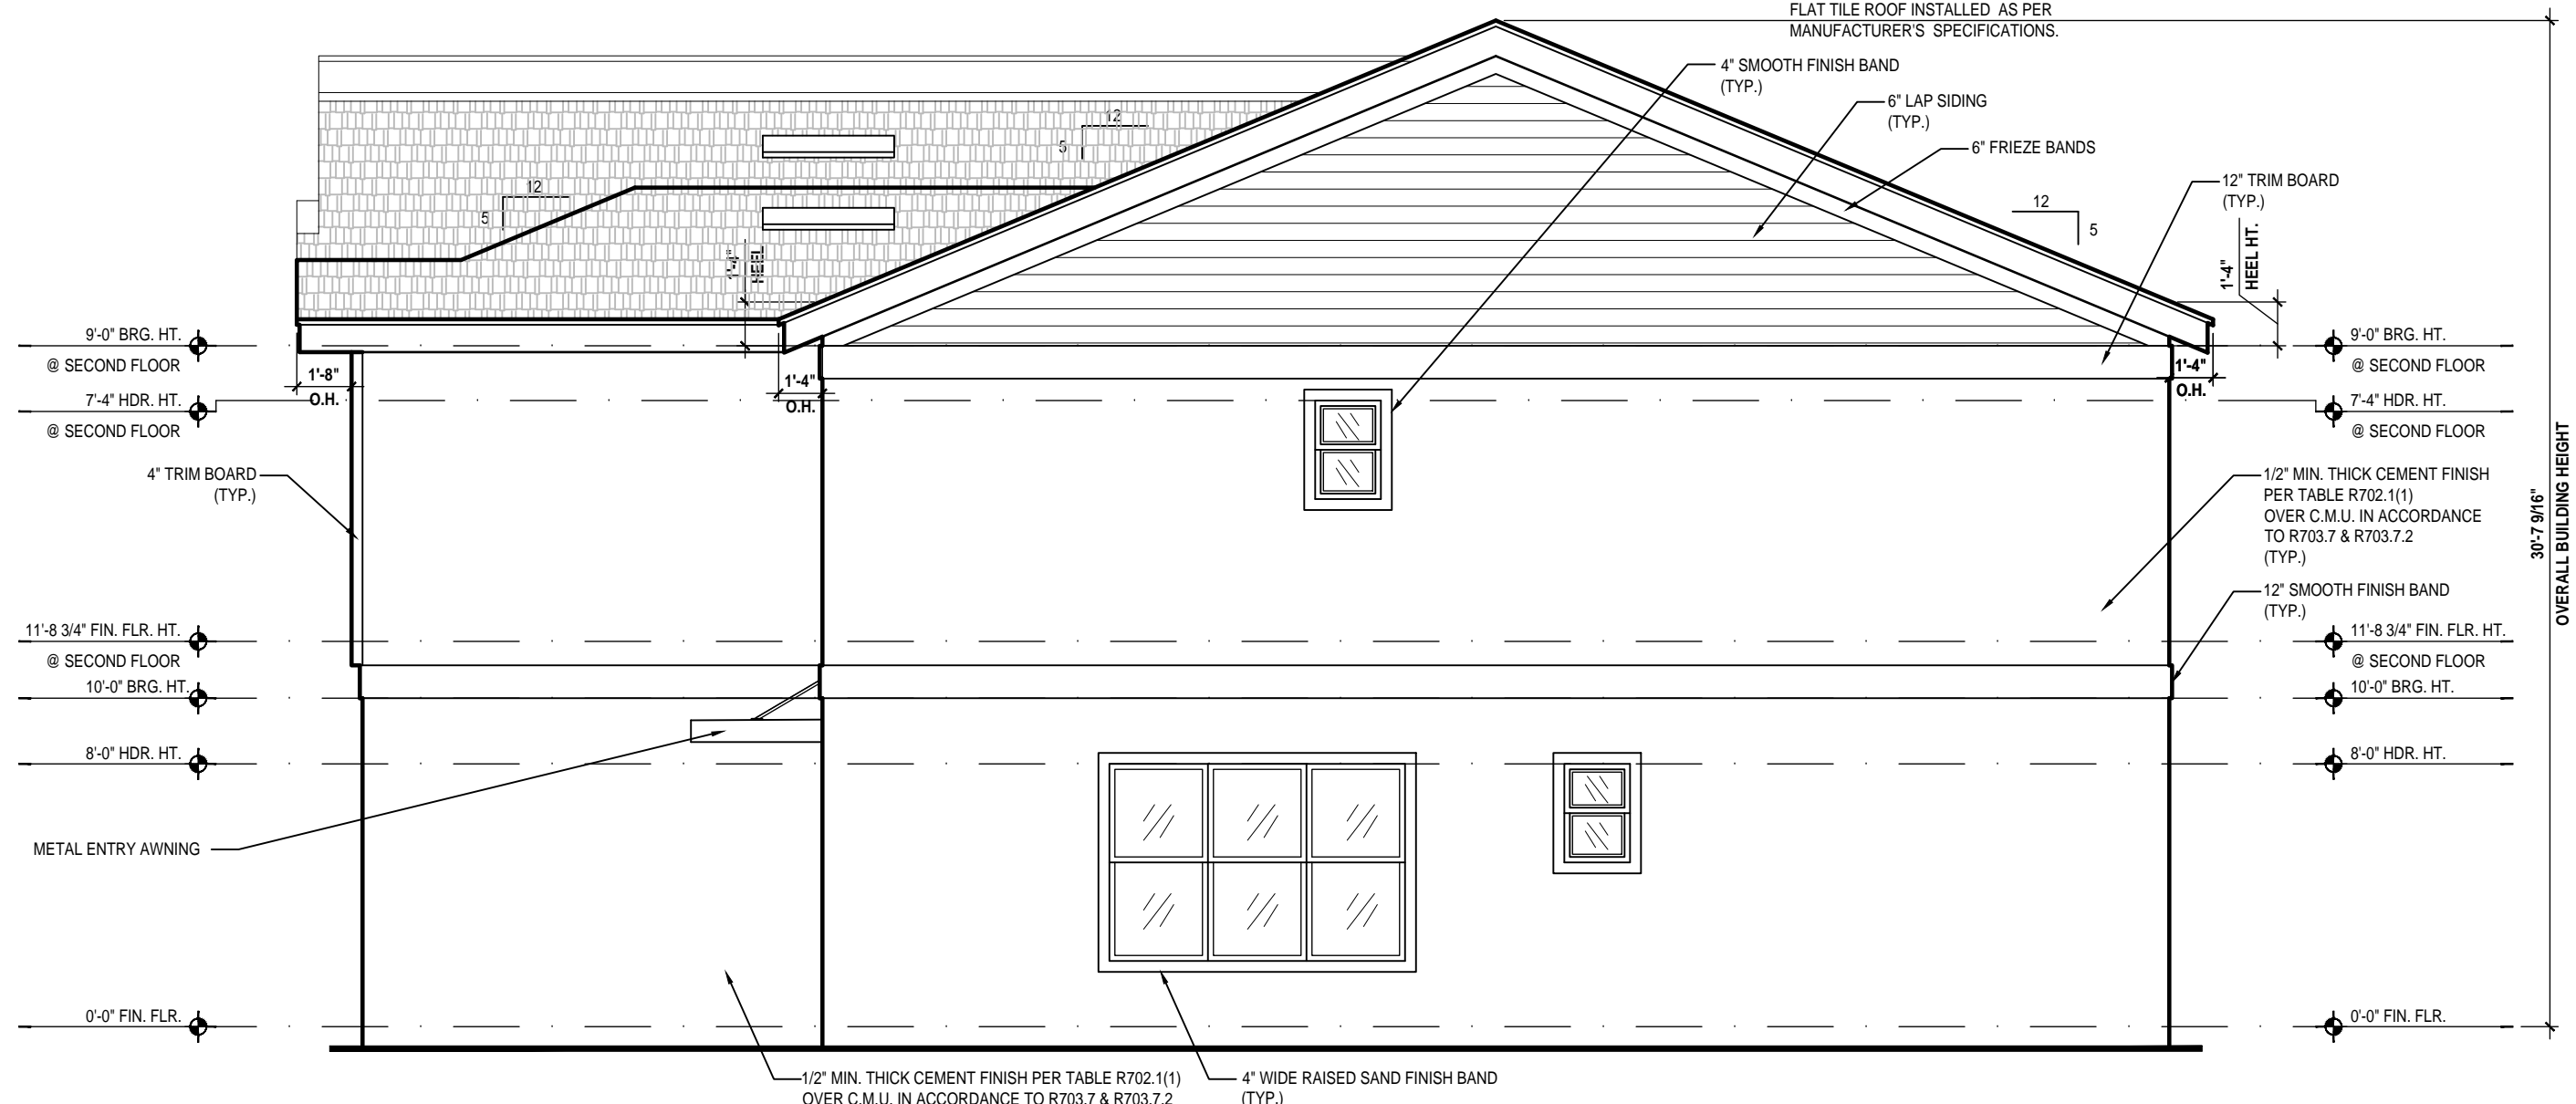

Right Elevation "A"

(Standard)
SCALE 3/16" = 1'-0"



Rear Elevation "A"

(Standard)
SCALE 3/16" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vineland Road Suite #6 Orlando, FL 32811
Tel: (407) 734-1790
Fax: (407) 734-1790
www.iteg.com

815 Orienta Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignersgroup.com
www.mjsdesignersgroup.com
DESIGNS ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

MJS
designers group
residentialcommercialarchitecture

AIBD

GOBA
GREAT ORGANIZED BUSINESS ASSISTANCE

5-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Plat #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square
Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES


ISSUE DATE	04/13/2023
REVISIONS	
PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS

ELEVATIONS
A7


All designs in this publication are protected under the copyright law. Reproduction of the illustrations or working drawings by any means is strictly prohibited unless licensed by MJS, Inc.
 MJS, Inc. reserves all rights in this document. No part of this document may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of MJS, Inc.
 MJS, Inc. shall not be held responsible for errors or omissions in the drawings. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall not be held responsible for any changes in the dimensions, conditions and specifications appearing on these plans.
 MJS, Inc. is not a contractor. It is the responsibility of the contractor to verify all dimensions and conditions of the job and MJS, Inc. shall not be held responsible for any changes in the dimensions, conditions and specifications appearing on these plans.

ELEVATION NOTES

1. ADDRESS NOTIFICATION SHALL BE IN ACCORDANCE W/ SECTION FBC-R319.

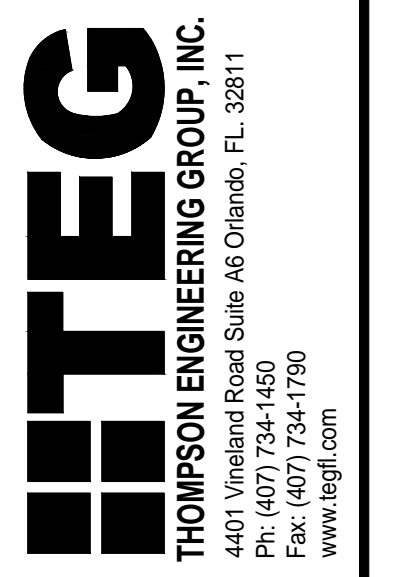

815 Oriole Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjdesignsgroup.com
www.mjdesignsgroup.com
401 Vineland Road, Suite #6 Orlando, FL 32811
Fax: (407) 734-1790
www.mjdesignsgroup.com

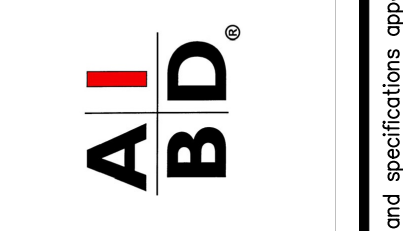


5-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Plat #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000





REVISIONS	DATE

PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

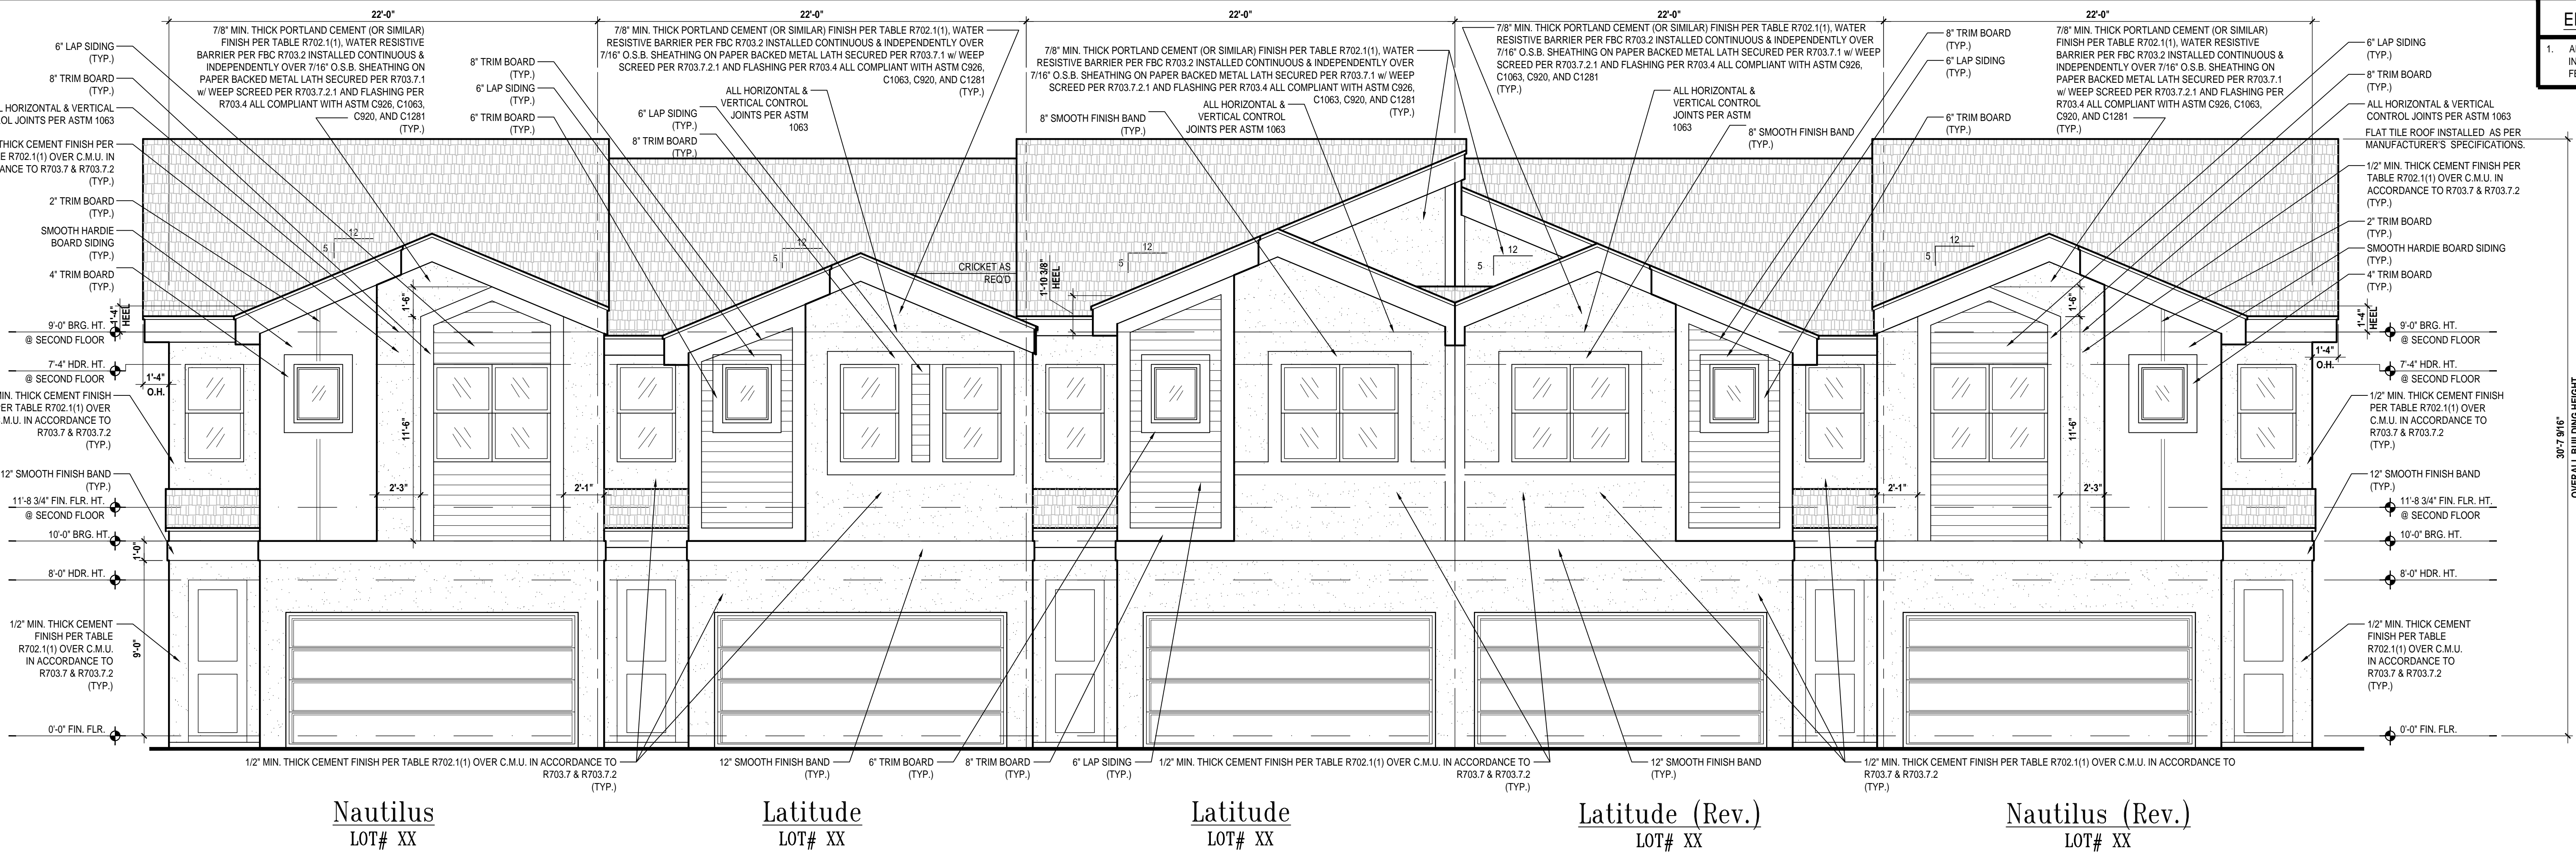

Front Elevation "B"

(Standard)
SCALE 1/4" = 1'-0"

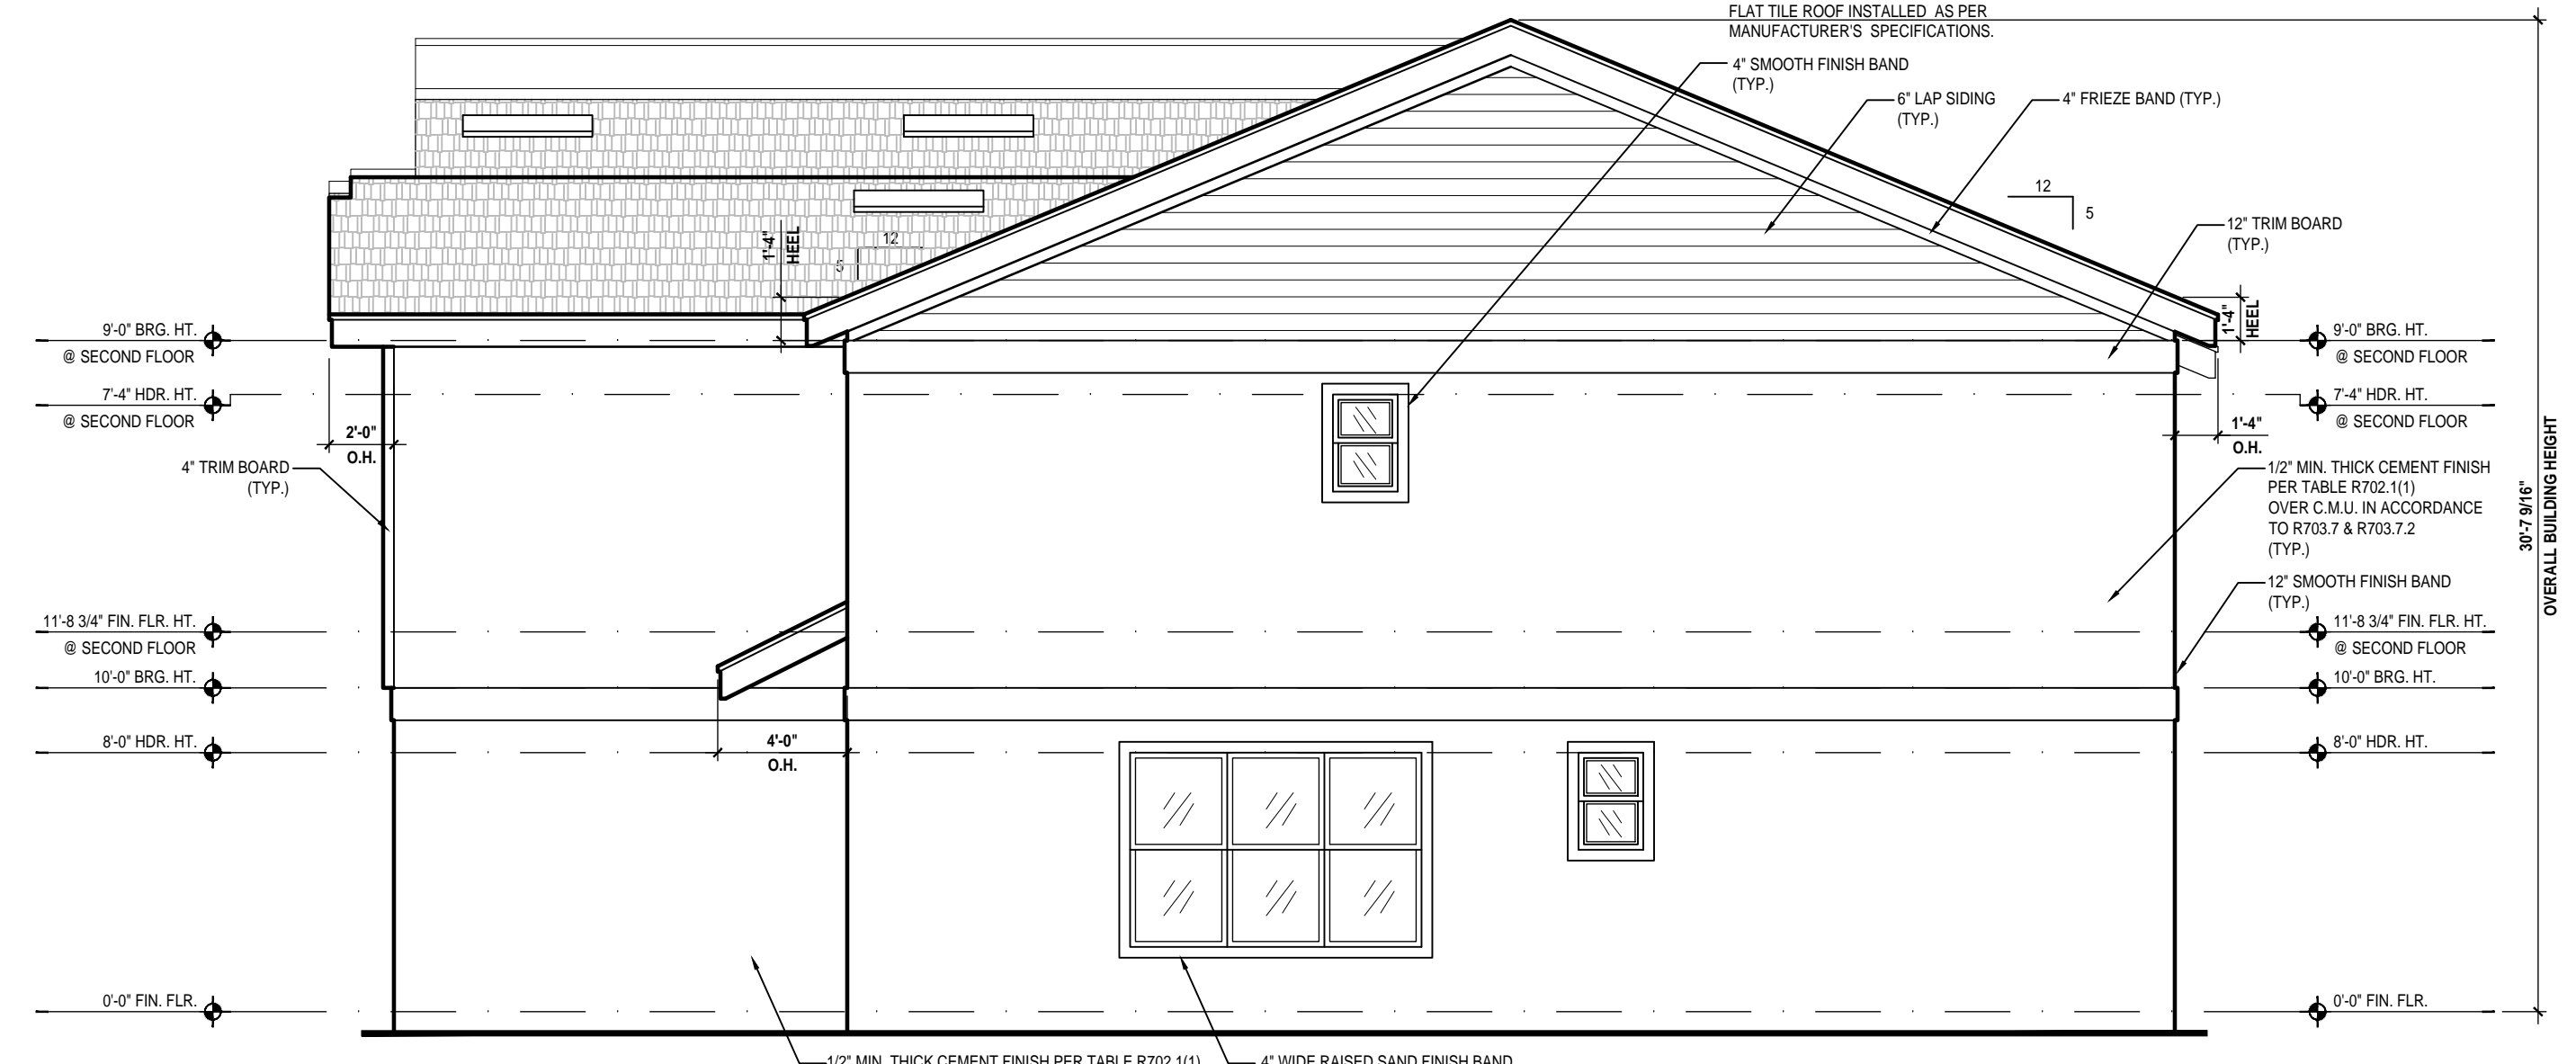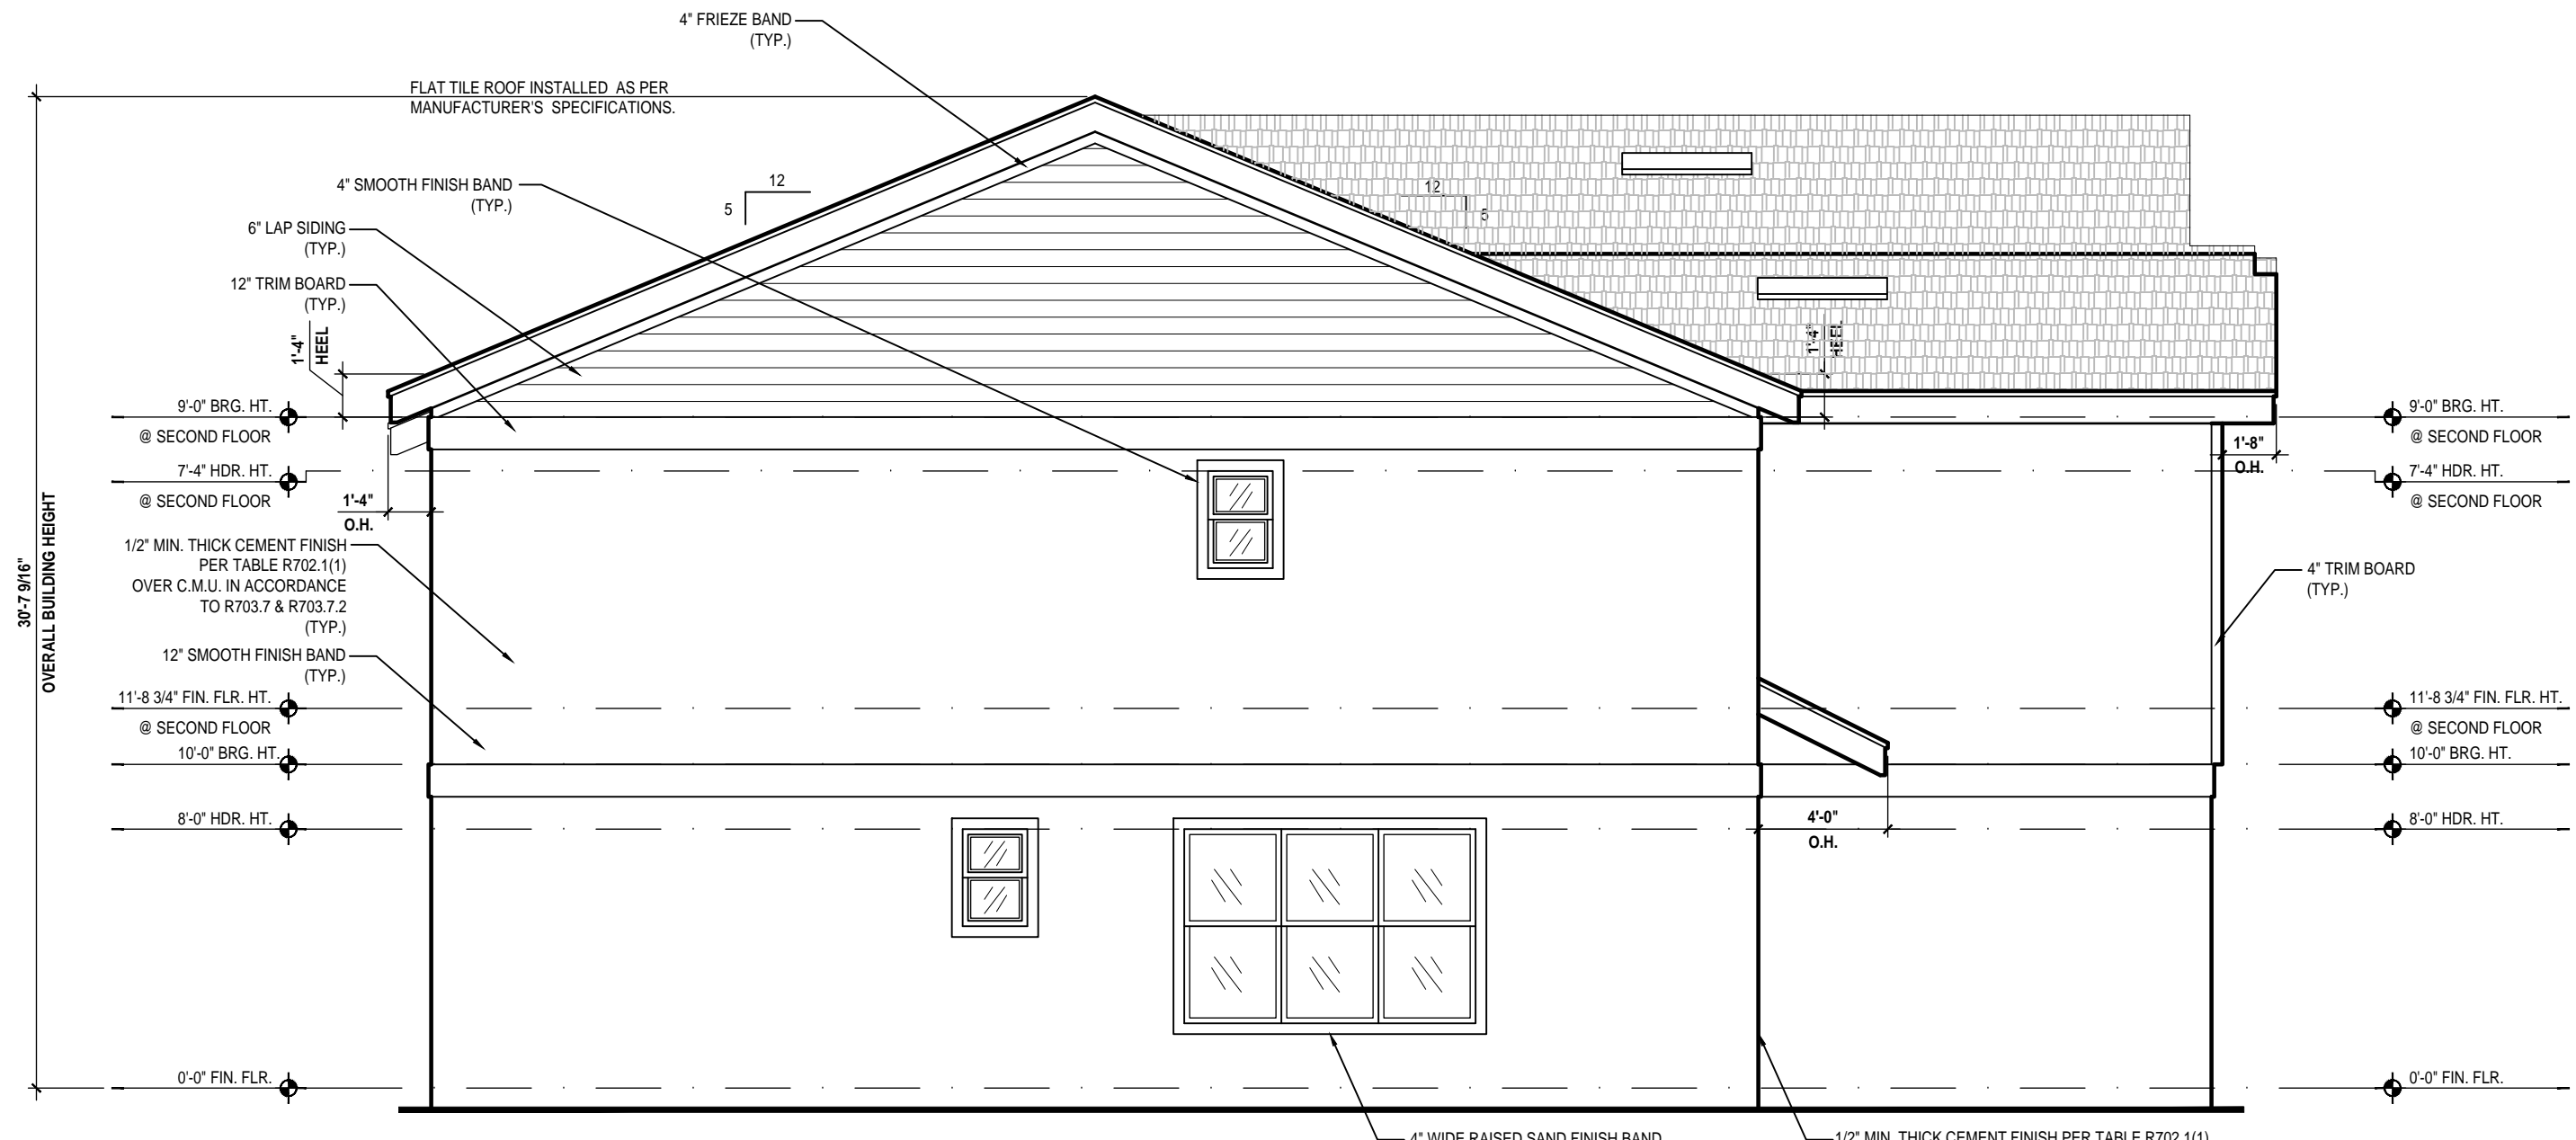

Rear Elevation "B"

(Standard)
SCALE 3/16" = 1'-0"

MJS DESIGN GROUP, INC. IS AN EQUAL OPPORTUNITY EMPLOYER. ALL RIGHTS RESERVED. ALL DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR DIMENSIONS AND CONDITIONS OF THE JOB AND MJS, INC. MUST BE NOTIFIED IN WRITING OF ANY CHANGES TO THE DIMENSIONS, CONDITIONS AND SPECIFICATIONS APPEARING ON THESE PLANS.


ATTIC VENT CALC'S:

2023 FLORIDA BUILDING CODE (BFC) SECTION 909.2.1
 MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).
 (OFF-RIDGE VENT MAXIMUM OPENING SIZES)

MINIMUM NET VENTILATION AREA SHALL BE 1/150 OF VENTED SPACE.


NAUTILUS UNIT:
 TOTAL VENTED: 1,320/300 = 4.4 SQ. FT.
 UPPER PORTION VENTILATION TOTAL w/ OFF-RIDGE VENTS (40%): 1.76 SQ. FT. / .652 = 2.69 VENTS= 3 VENTS
 LOWER PORTION VENTILATION TOTAL w/ SOFFITS @ EAVE (60%): 2.64 SQ. FT. / 80.00 LF = .033 SQ. FT. PER VENTING/ LF.

LATITUDE UNIT:
 TOTAL VENTED: 1,160/300 = 3.89 SQ. FT.
 UPPER PORTION VENTILATION TOTAL w/ OFF-RIDGE VENTS (40%): 1.55 SQ. FT. / .652 = 2.39 VENTS= 3 VENTS
 LOWER PORTION VENTILATION TOTAL w/ SOFFITS @ EAVE (60%): 2.33 SQ. FT. / 80.00 LF = .029 SQ. FT. PER VENTING/ LF.

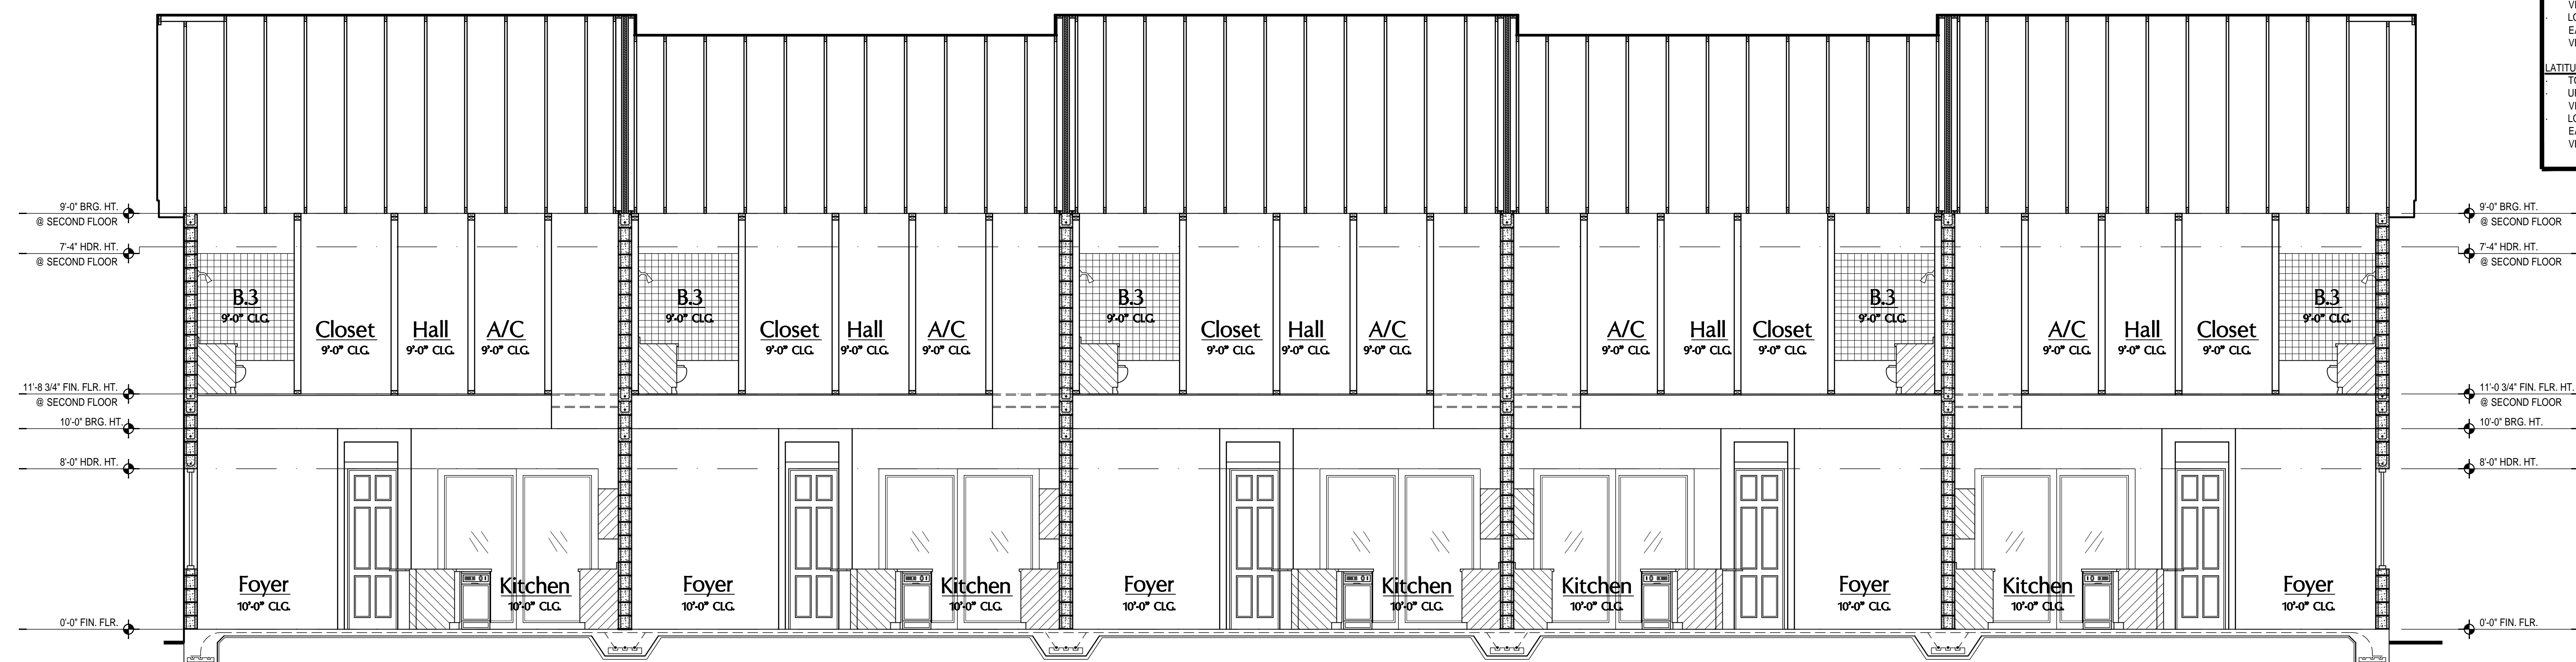

Nautilus LOT# XX Latitude LOT# XX Latitude LOT# XX Latitude (Rev.) LOT# XX Nautilus (Rev.) LOT# XX

1 Building Section "A&B"
 SCALE: 1/4" = 1'-0"

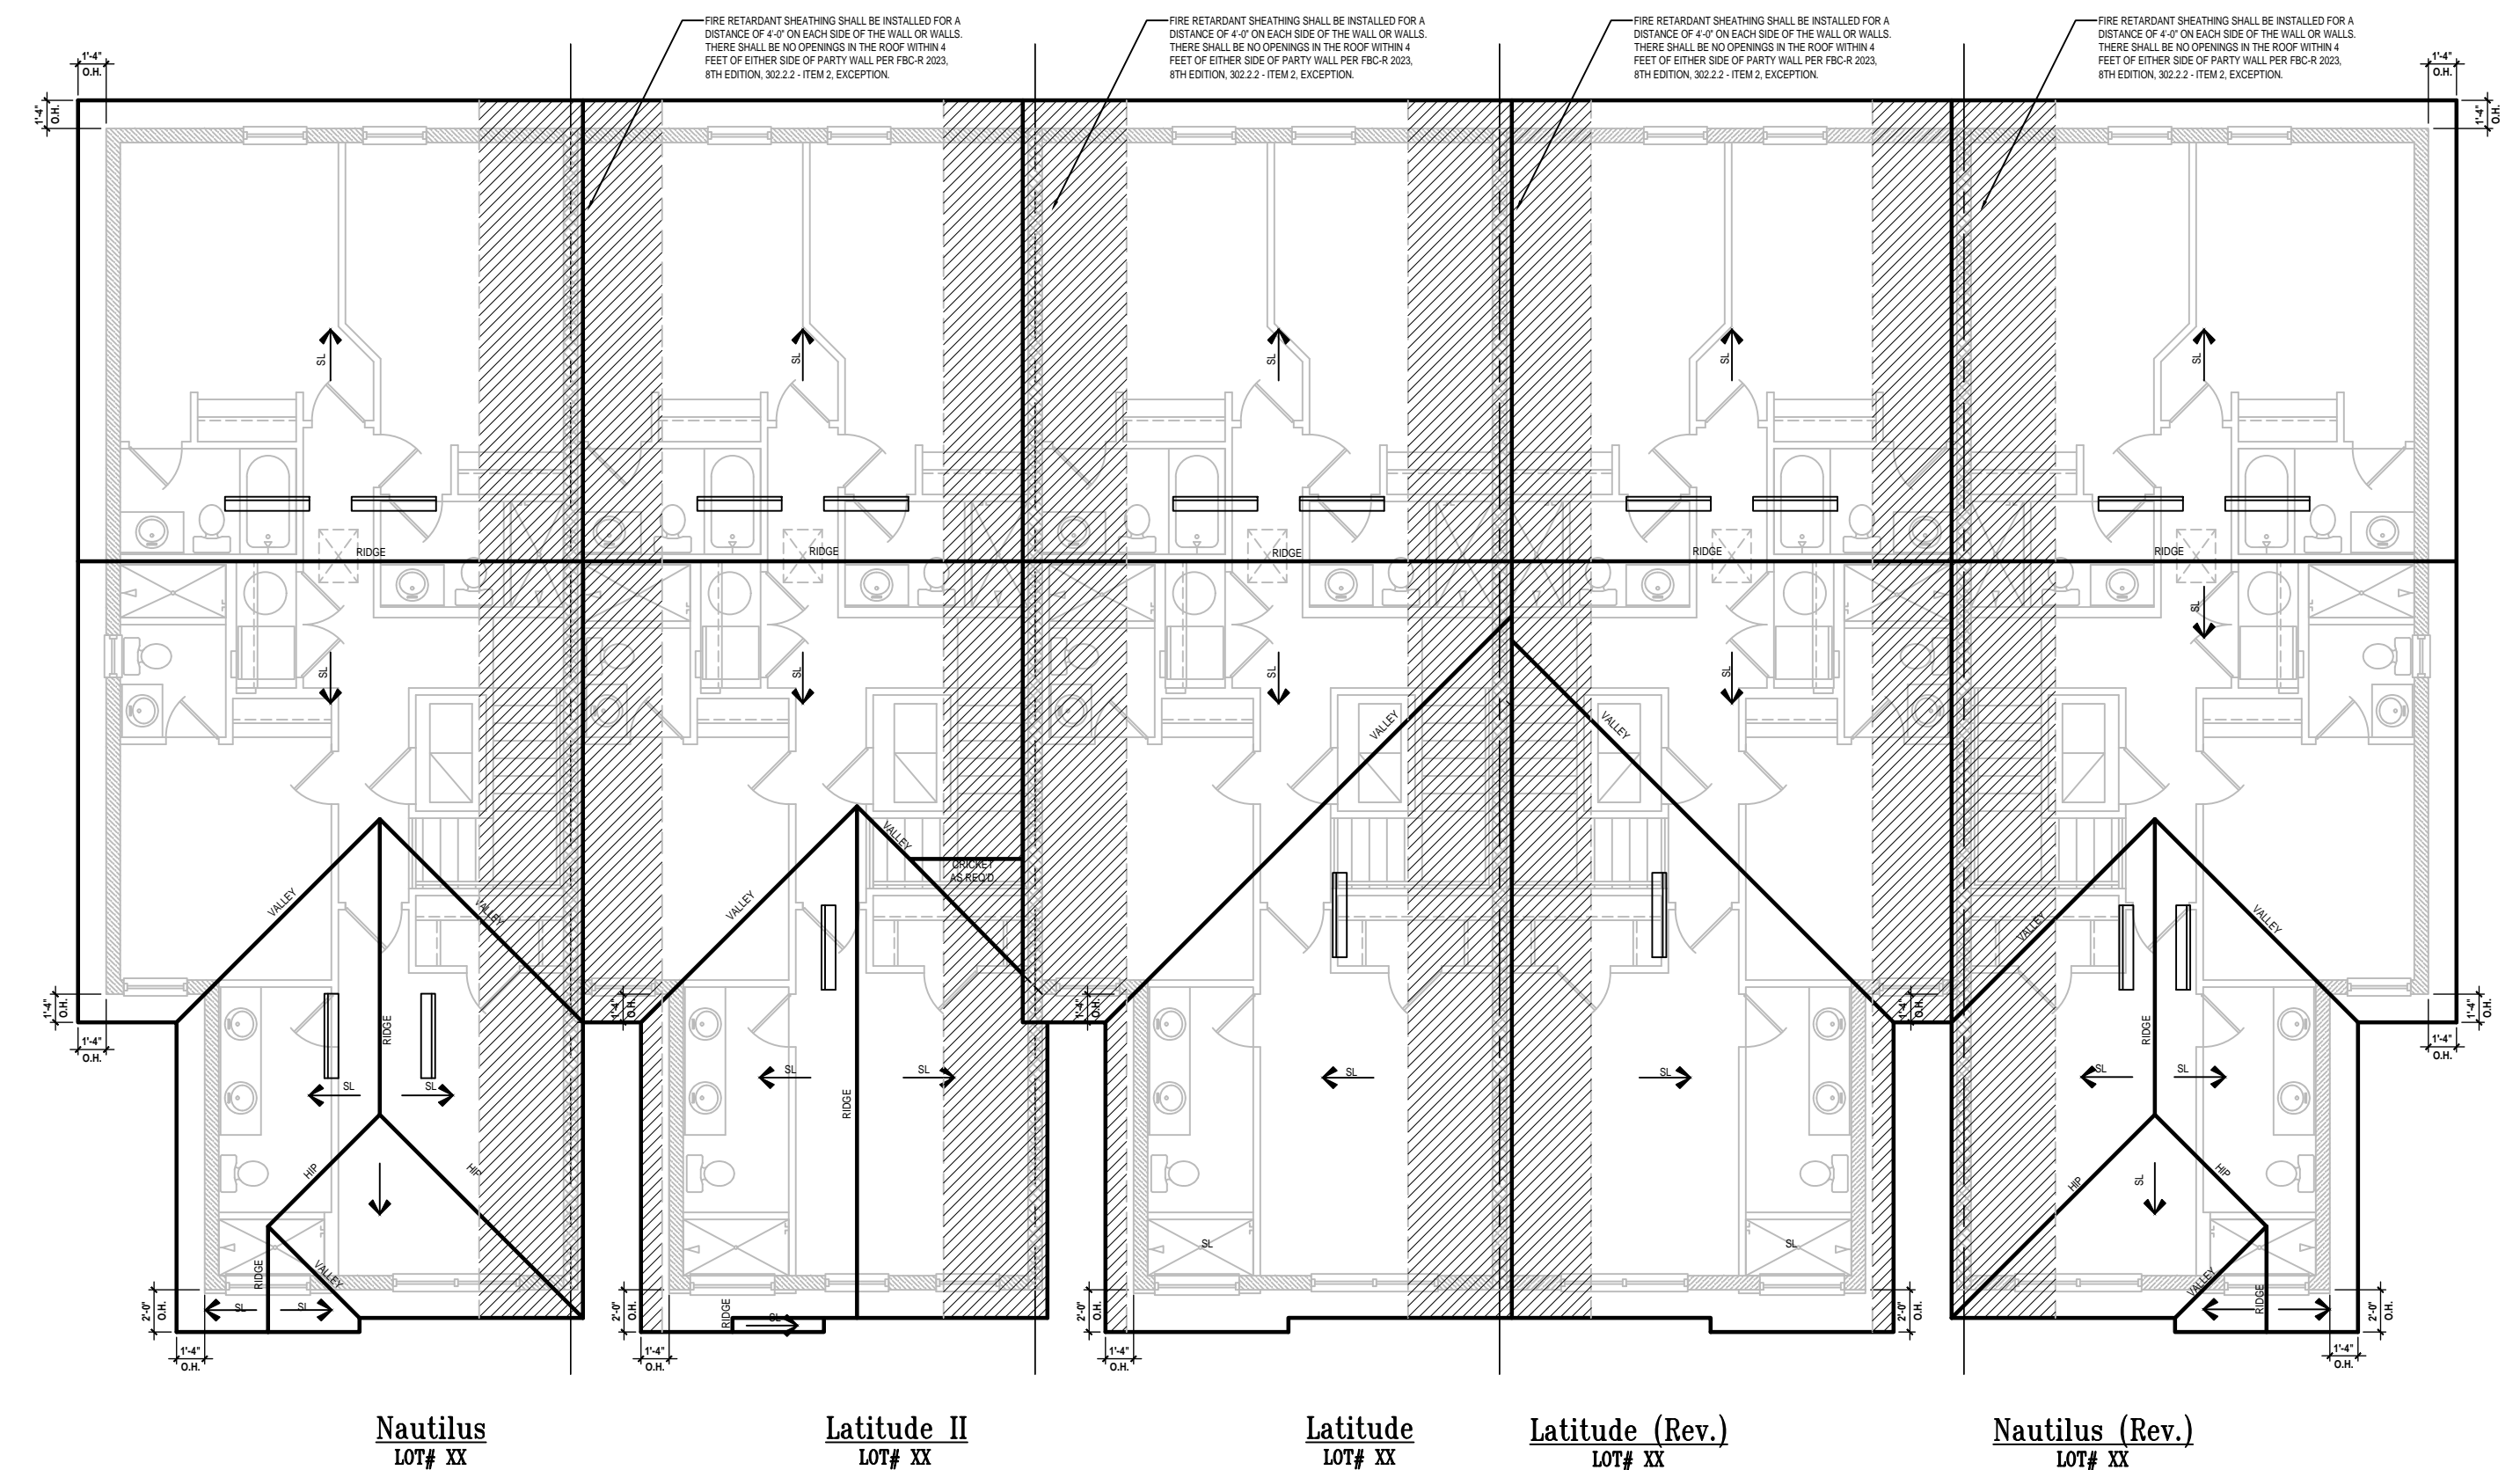

2 Roof Layout "A"
 SCALE: 1/8" = 1'-0"

ITEG
 THOMPSON ENGINEERING GROUP, INC.
 401 Vineland Road, Suite #6 Orlando, FL 32811
 Ph: (407) 734-1750 Fax: (407) 734-1750
 www.iteg.com

MJS
 designers group
 residential/commercial/architecture

A I B D

GOBA
 GROUP (WARRANTY ADMINISTRATION)

5-Unit: (Paradiso TH)
 Models: Nautilus, Latitude
 Building Plat #XX
 Lot# XX-XX, Subdivision
 Street Address
 City, State, Zip Code

A division of Park Square Enterprises Inc.
 5200 Vineland Rd, Suite #200
 Orlando, FL 32811
 Phone: (407) 529-3000

Park Square HOMES


ISSUE DATE: 04/13/2023
 REVISIONS:
 PROJECT: 22-1151
 SCALE: AS NOTED
 DRAWN BY: M.C.
 DESIGNED BY: MJS

SECTIONS
A9

Mar 03, 2025 8:35am Daniel V/Park Square Homes/STATIONHOME MODELS/Townhomes (Orlando)/1-Townhome Models/Paradiso Grande (CMP-Paradiso) 5-UNIT/AS Building Section- Elev. TAB.dwg


ALL designs/plans in this publication are protected under the copyright law. Reproduction of the illustrations or working drawings by any means is strictly prohibited unless licensed by MJS, Inc.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes in the dimensions, conditions and specifications appearing on these plans.

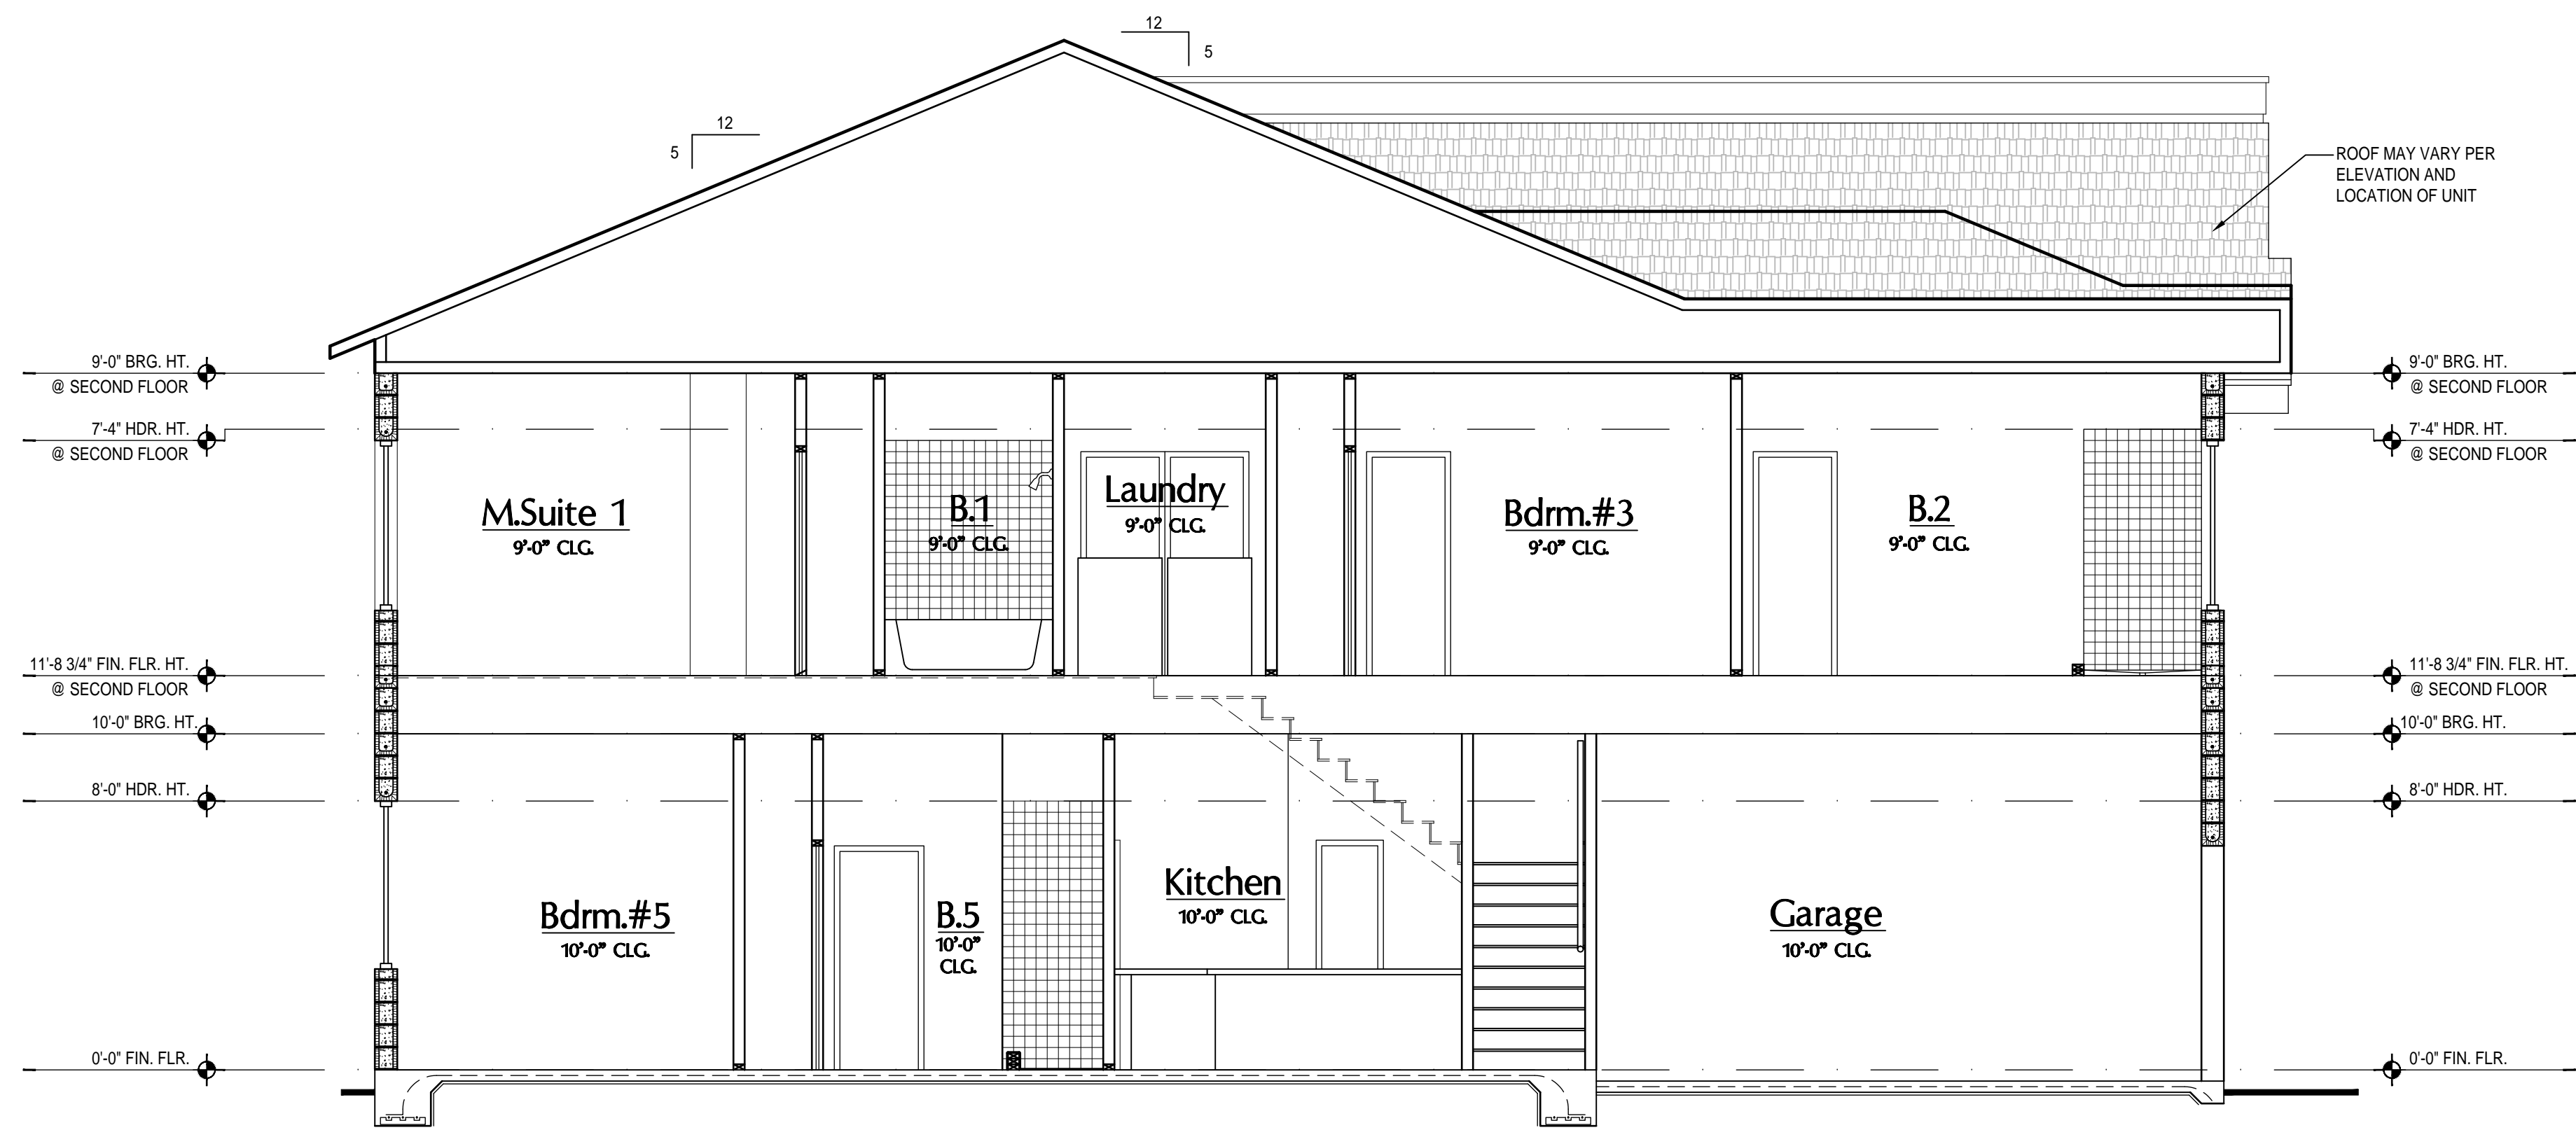


Nautilus & Latitude


1 Building Section "A"
SCALE: 1/4" = 1'-0"

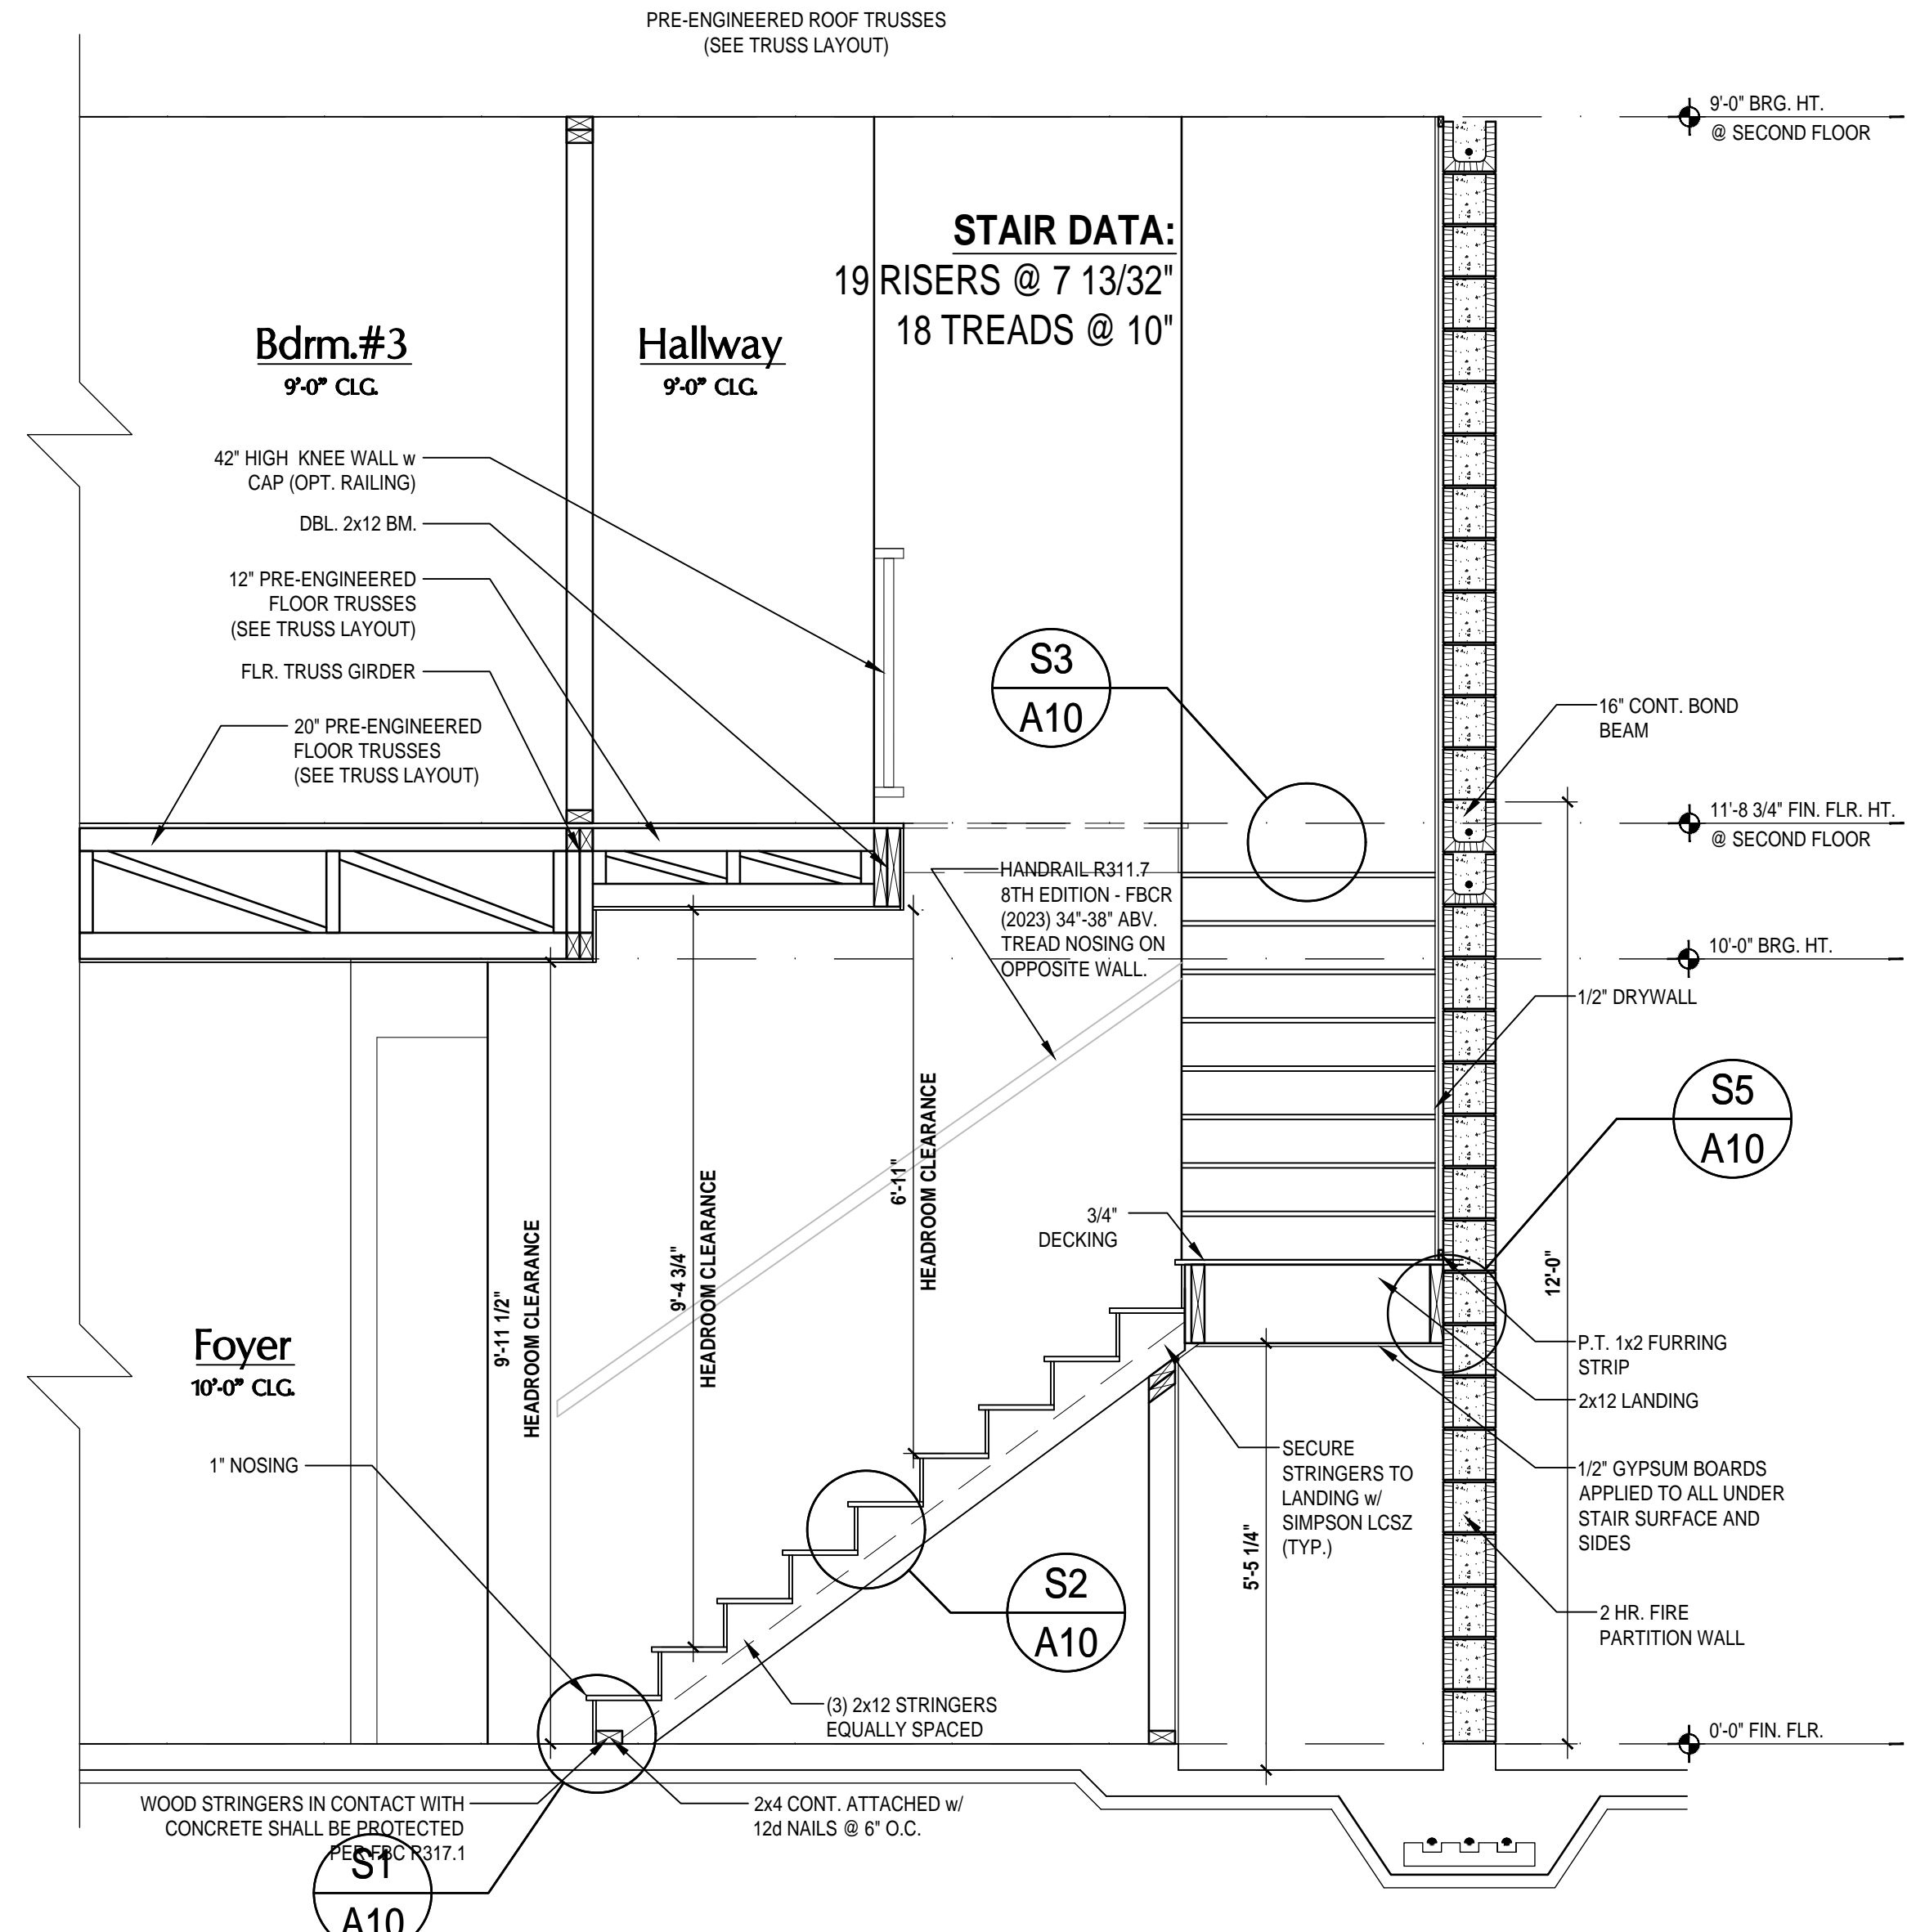


3 Stair Section
SCALE: 1/2" = 1'-0"

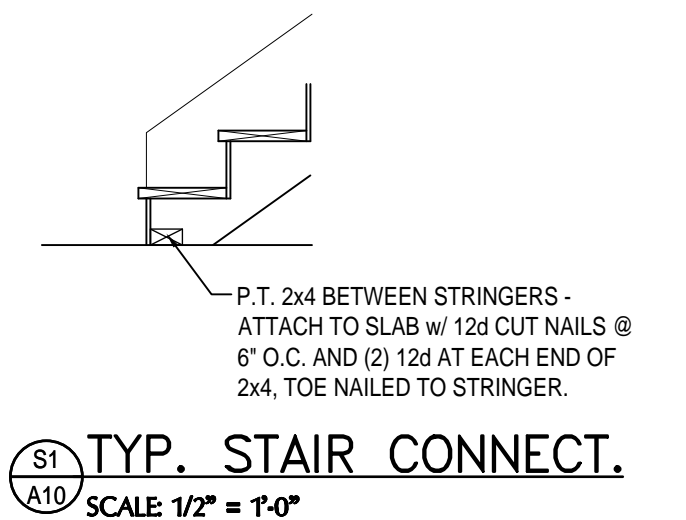


S1 TYP. STAIR CONNECT.
SCALE: 1/2" = 1'-0"

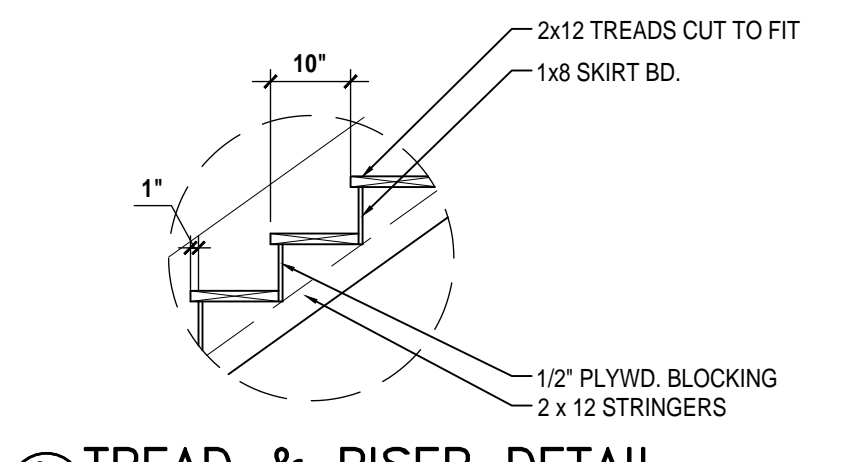


S2 TREAD & RISER DETAIL
SCALE: 1/2" = 1'-0"

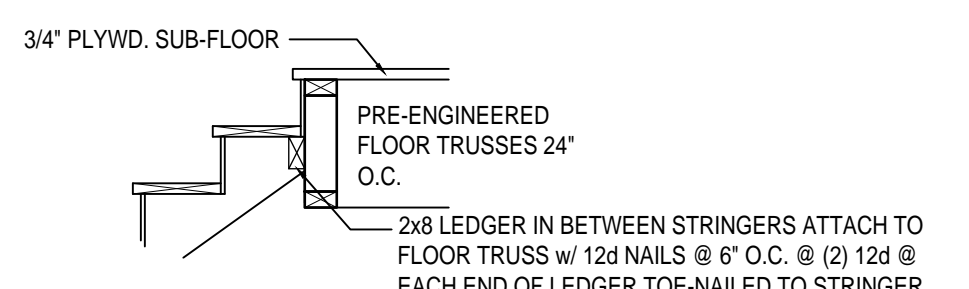

S3 STAIR CONNECT. @ FLR. TRUSS
SCALE: 1/2" = 1'-0"

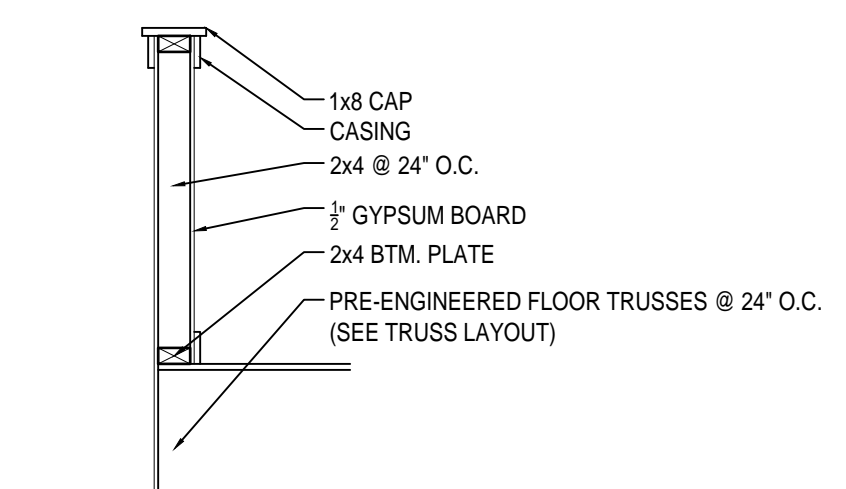

S4 KNEE WALL DETAIL
SCALE: 1/2" = 1'-0"

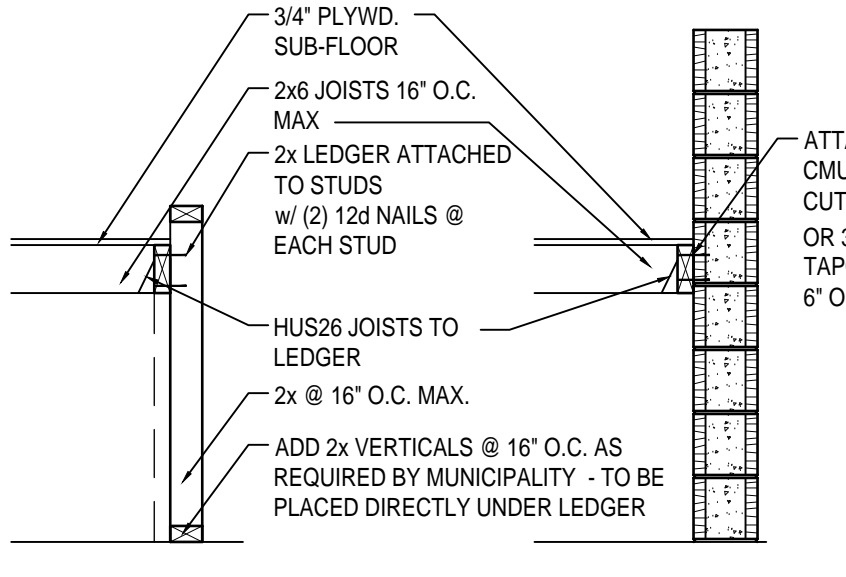

S5 LANDING CONNECTION DETAIL
SCALE: 1/2" = 1'-0"

- NOTES:**
- STAIRWAY CONSTRUCTION TO CONFORM TO FBCR 2023, 8TH EDITION SECTION R311.7
 - STAIRWAY SHALL NOT BE LESS THAN 36" MIN. IN WIDTH.
 - HEADROOM SHALL NOT BE LESS THAN 6 FEET 8 INCHES MIN. IN CLEARANCE.
 - RISERS SHALL BE AT A MAX. HGT. OF 7 3/4".
 - TREAD DEPTH SHALL NOT BE LESS THAN 10 INCHES.
 - TREAD NOSING SHALL HAVE A MAX. RADIUS CURVATURE OF 9/16" AND A PROJECTION OF 3/4" BUT NOT MORE THAN 1 1/4". NOSING PROJECTION NOT REQUIRED WHERE THE TREAD DEPTH IS NOT LESS THAN 11 INCHES.
 - 3/16" MAX VARIATION IN RISERS / TREADS ADJACENT TO EACH OTHER.
 - 3/8" MAX VARIATION IN ANY RISE / TREAD.
 - HAND RAIL CIRCULAR CROSS SECTION DIA. TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT GRASPABILITY.
 - UNDER MIN. 6" WIDE @ NARROW END.
 - HANDRAIL HGT. SHALL BE NOT LESS THAN 34" BUT NOT GREATER THAN 38".

THOMPSON ENGINEERING GROUP, INC.

 401 Vineland Road Suite 46 Orlando, FL 32811

 Ph: (407) 734-1750 Fax: (407) 734-1750 www.mteg.com

MJS DESIGNERS GROUP

 residentialcommercialarchitecture

AIBD

GOBA

5-Unit: (Paradiso TH)

 Models: Nautilus, Latitude

 Building Plat #XX

 Lot# XX-XX, Subdivision

 Street Address

 City, State, Zip Code

A division of Park Square Homes Inc.

 5200 Vineland Rd, Suite #200

 Orlando, FL 32811

 Phone: (407) 529-3000

ISSUE DATE: 04/13/2023

 REVISIONS:

PROJECT: 22-1151

 SCALE: AS NOTED

 DRAWN BY: M.C.


 DESIGNED BY: MJS

SECTIONS


A10

ALL DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes in the dimensions, conditions and specifications appearing on these plans.


All designs plans in this publication are protected under the copyright law. Reproduction of the illustrations or working drawings by any means is strictly prohibited unless licensed by MJS, Inc.

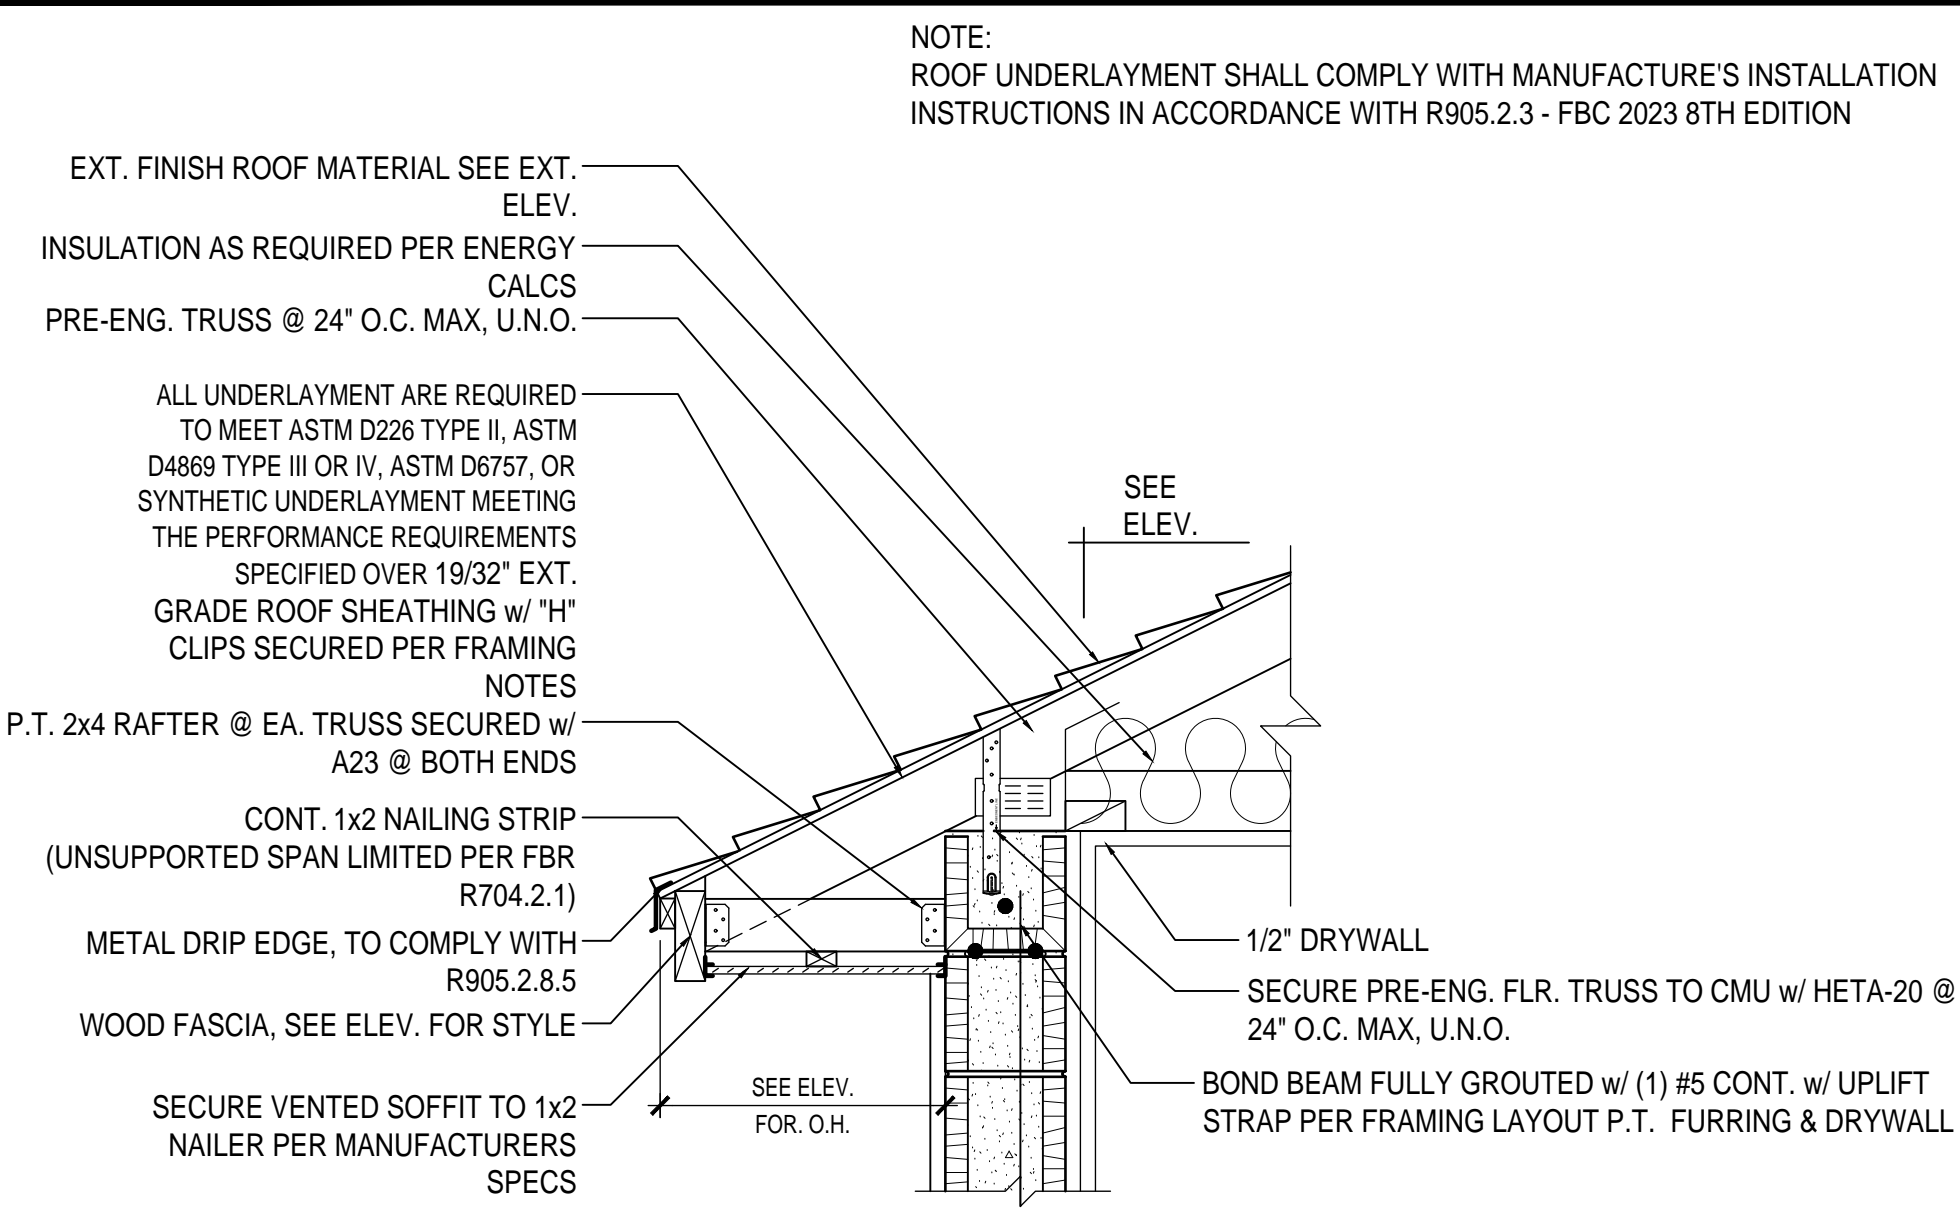

NOMINAL HEEL CONDITION

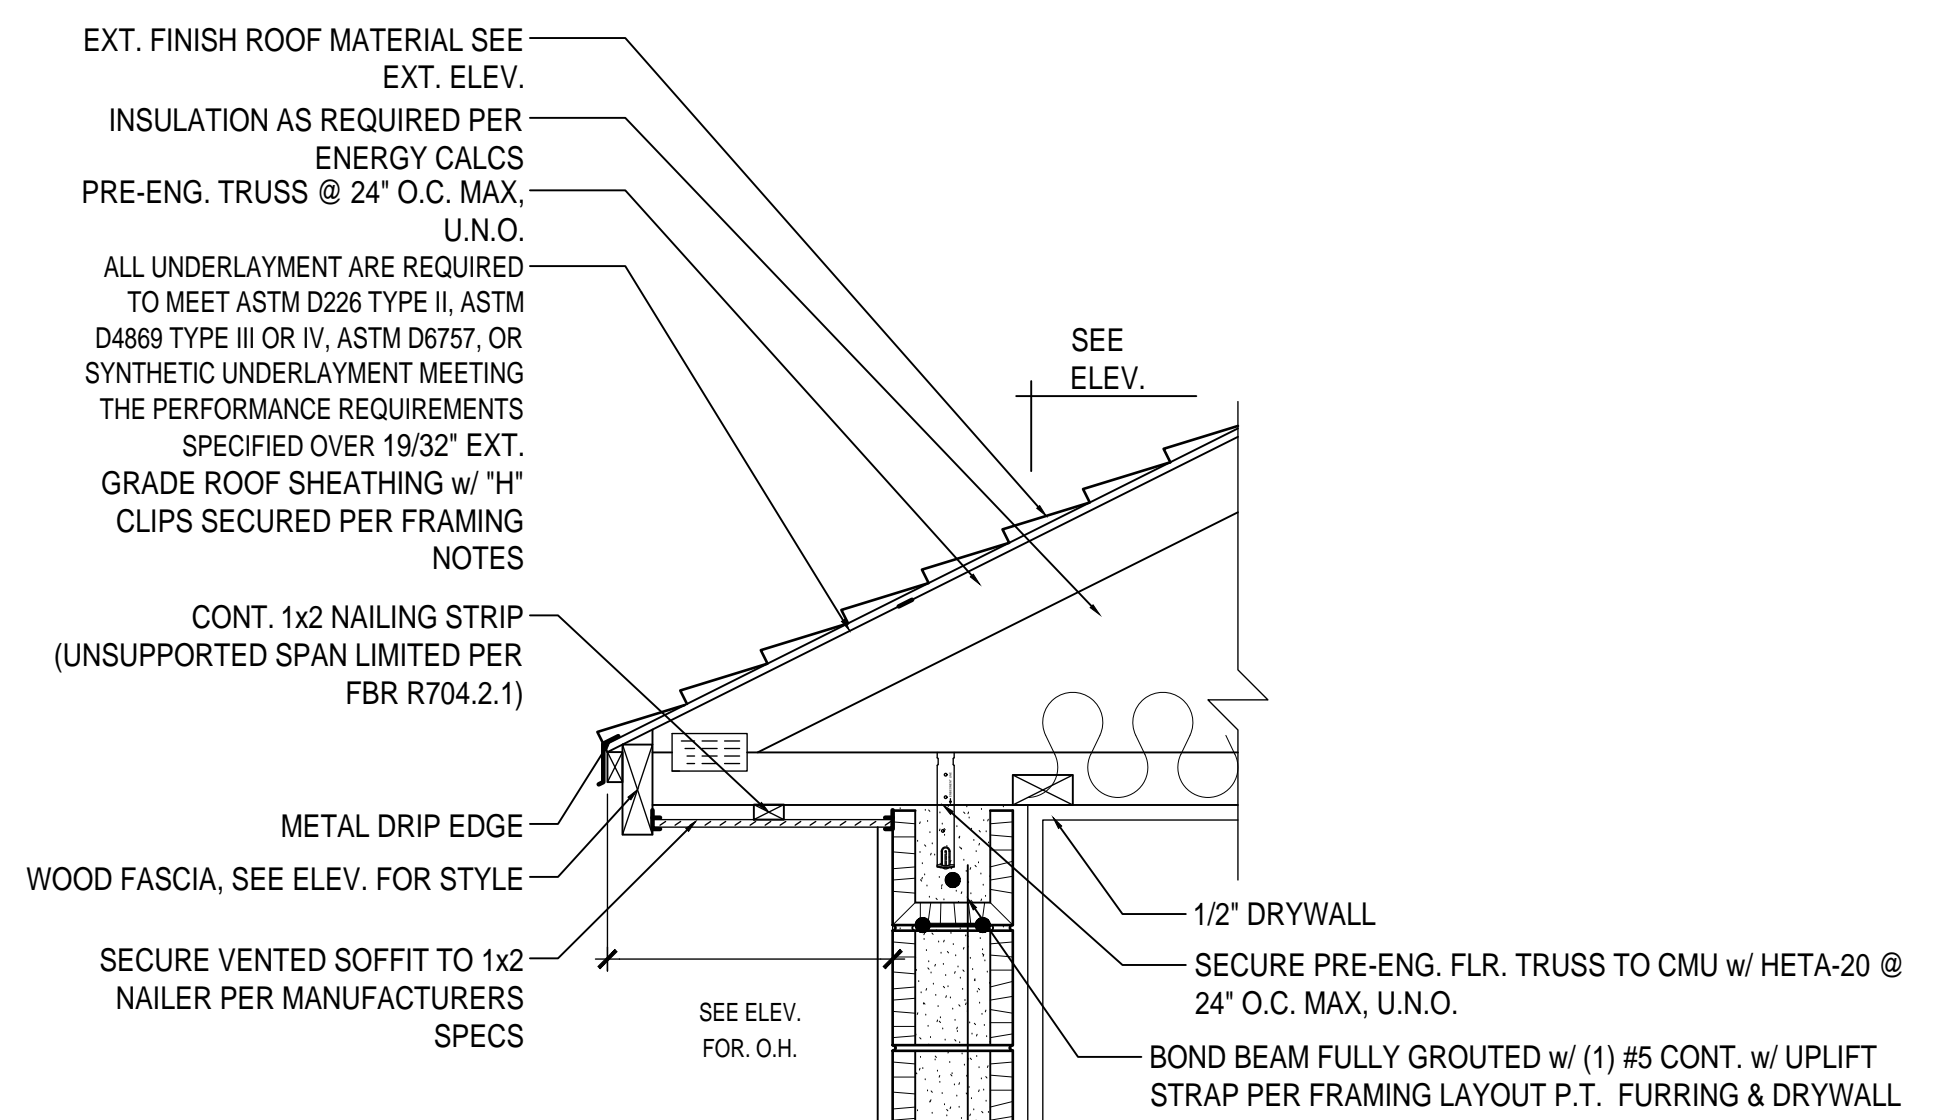


CANTILEVERED BTM. CHORD CONDITION

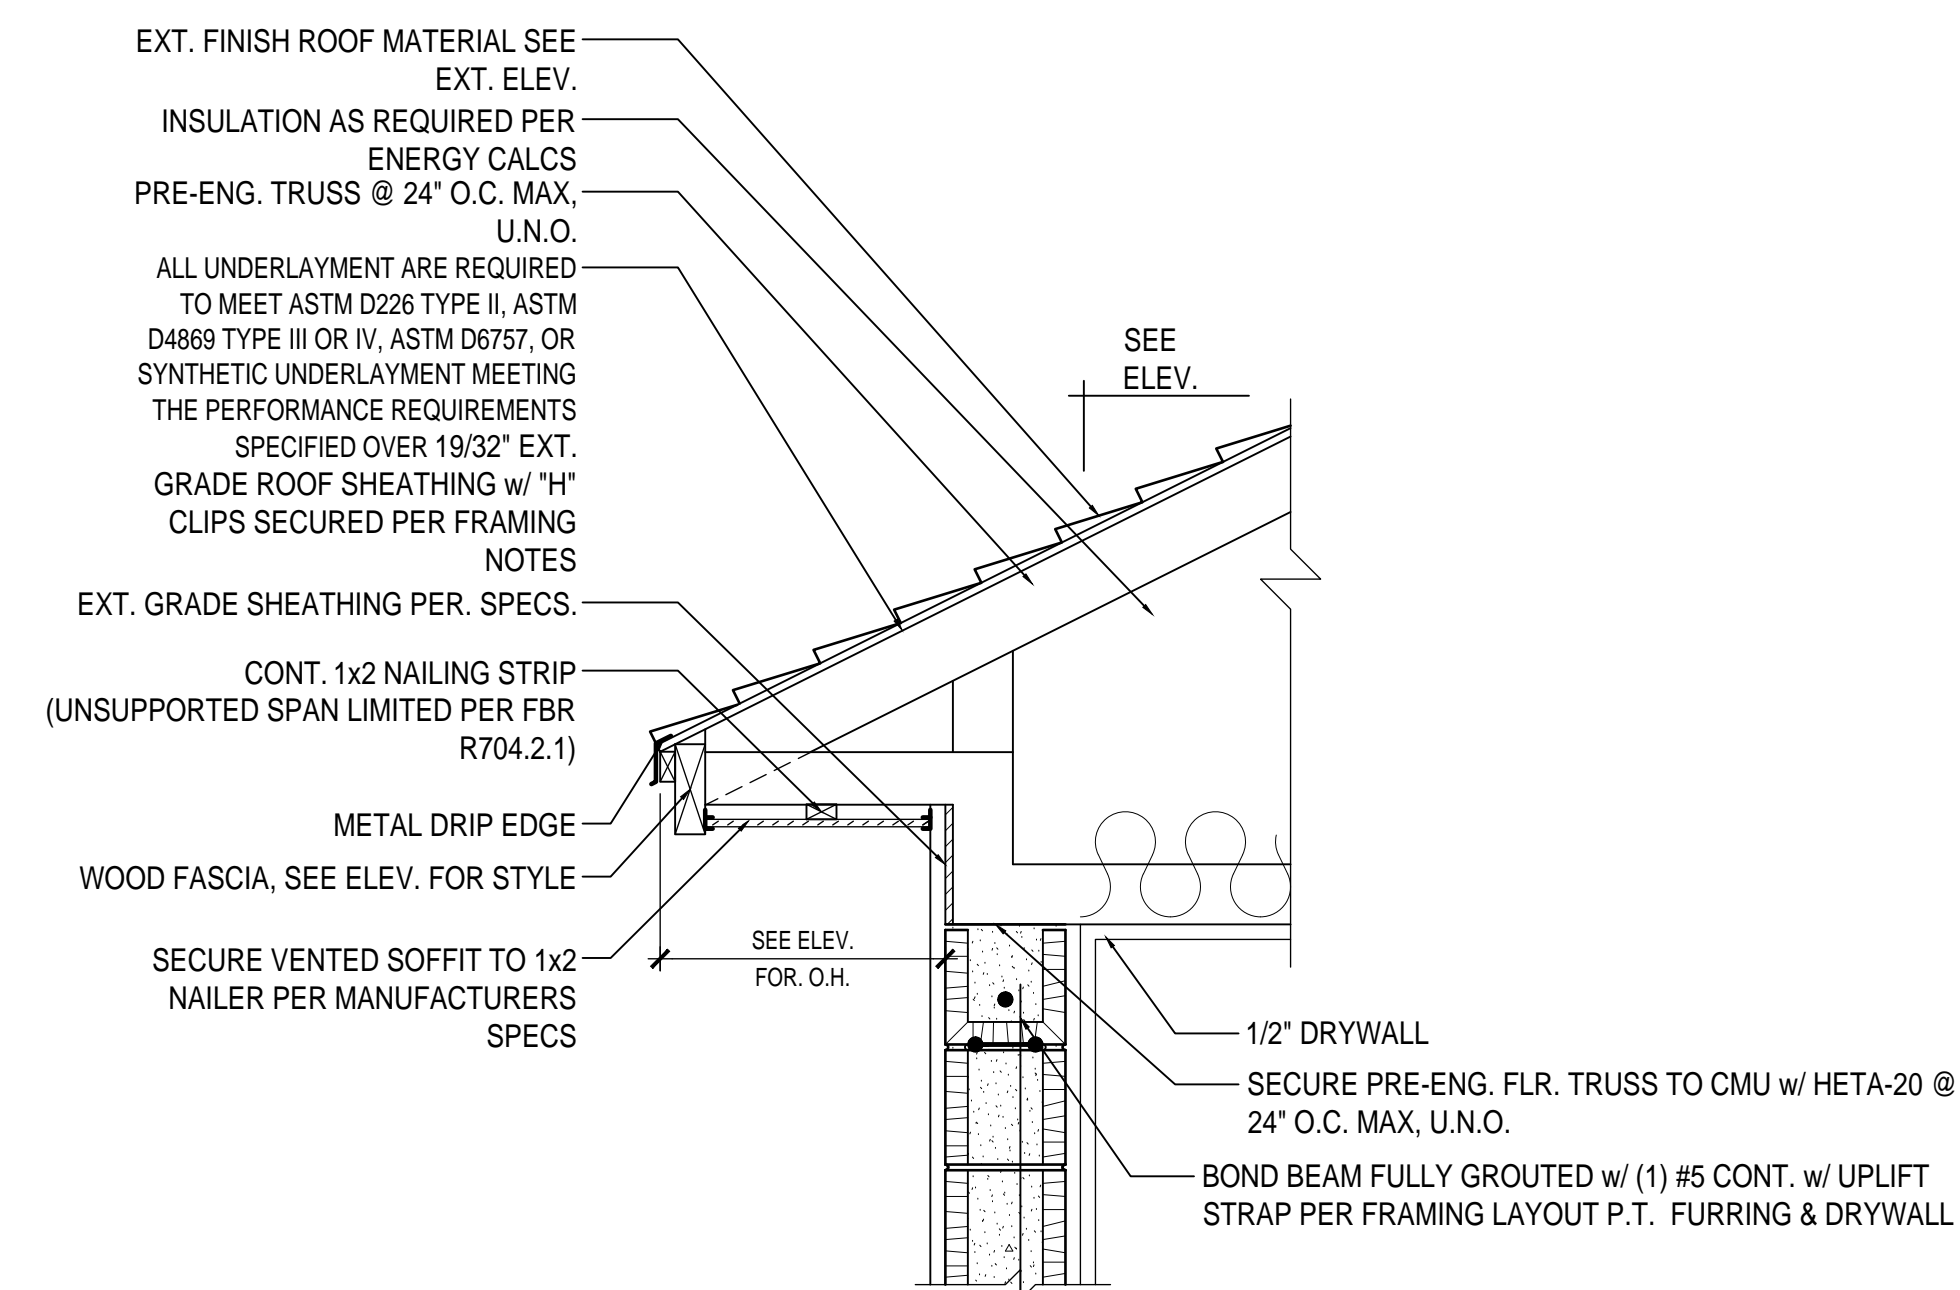


RAISED HEEL CONDITION

1 SOFFIT OVERHANG DETAIL


SCALE: N.T.S.

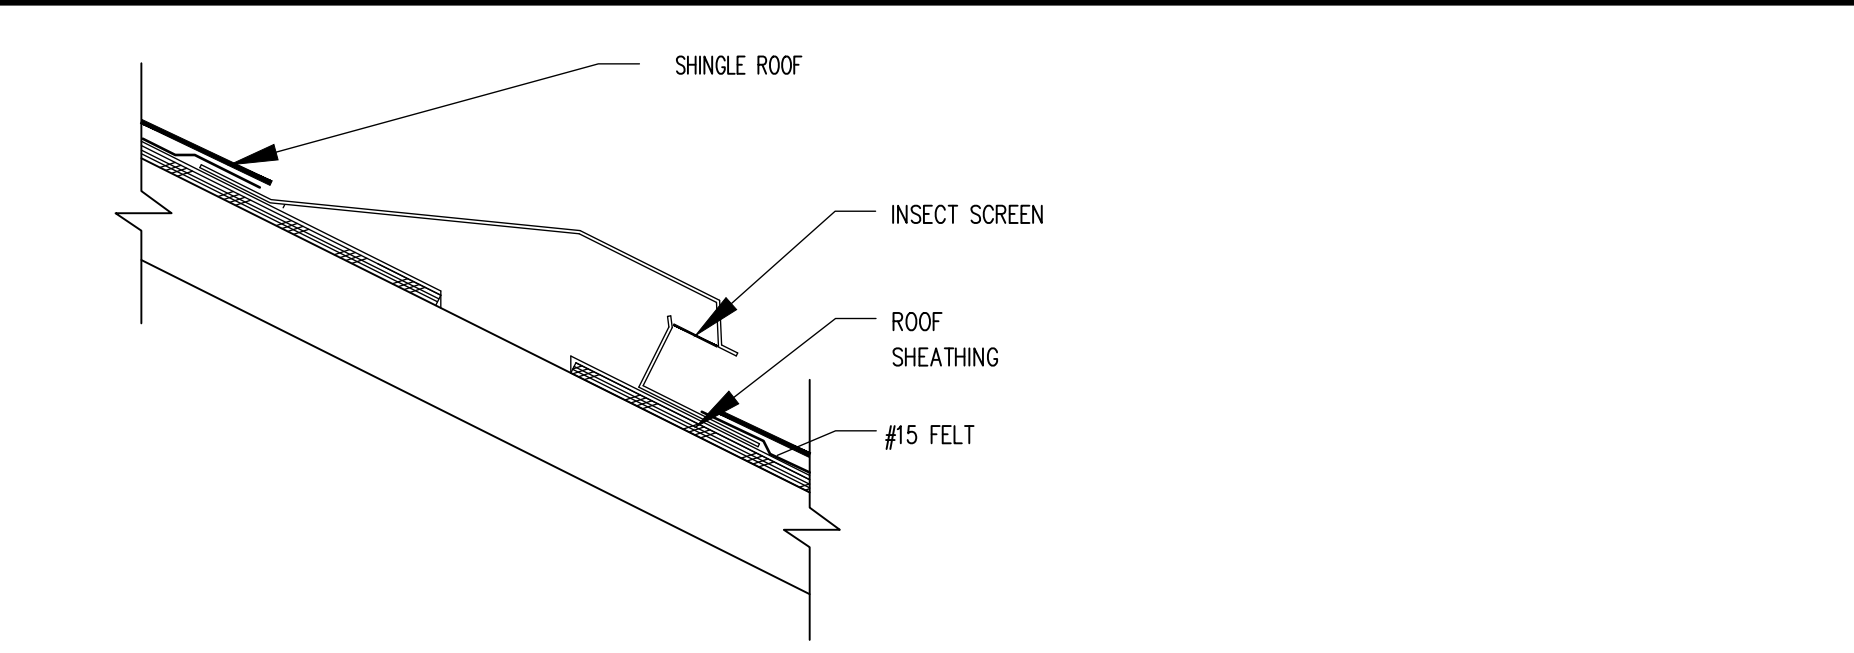

OFF-RIDGE VENT PENETRATION THRU ROOF

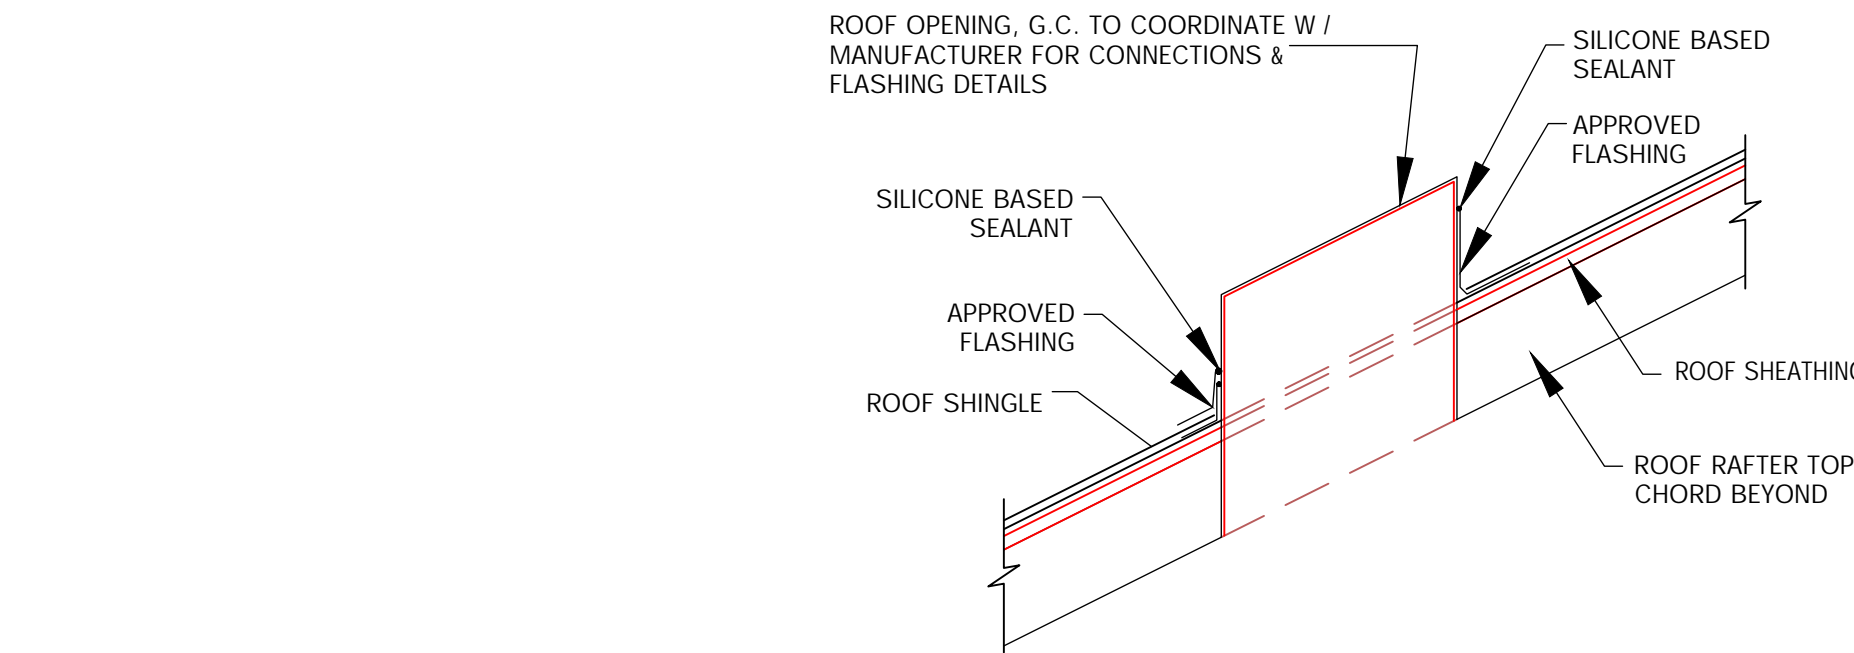

OPENING PENETRATION THRU ROOF


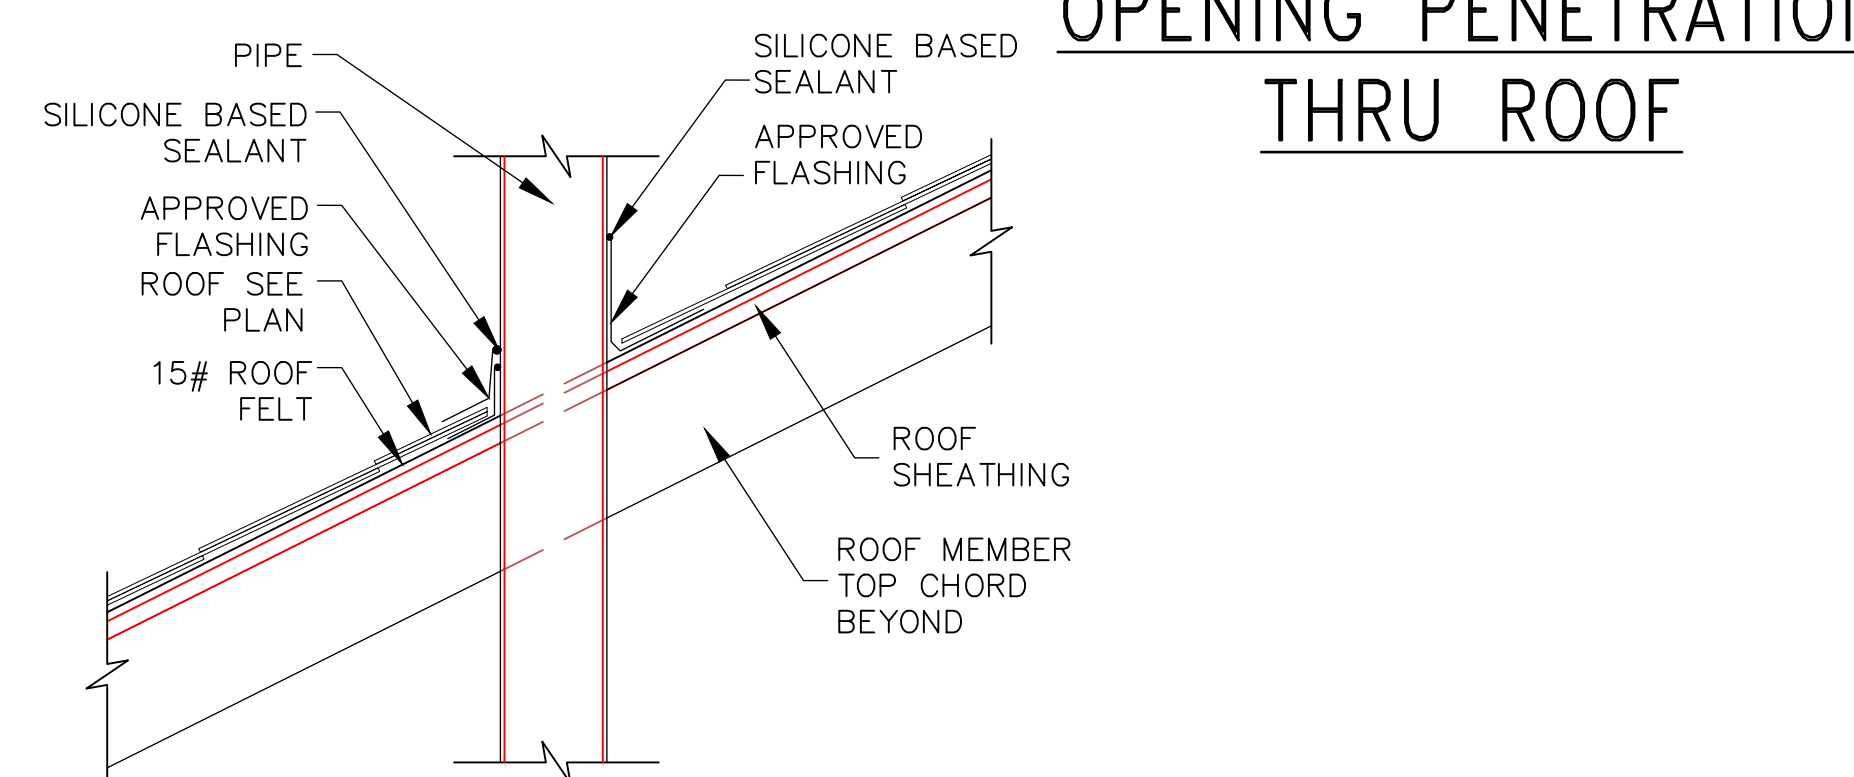


PIPE PENETRATION THRU ROOF

2 ROOF PENETRATION DETAIL


SCALE: N.T.S.

NOTE: ALL ROOF FLASHING TO COMPLY WITH R905.2.8 & ALL SUBSEQUENT SECTIONS OF THE FBC 2023 - 8TH EDITION

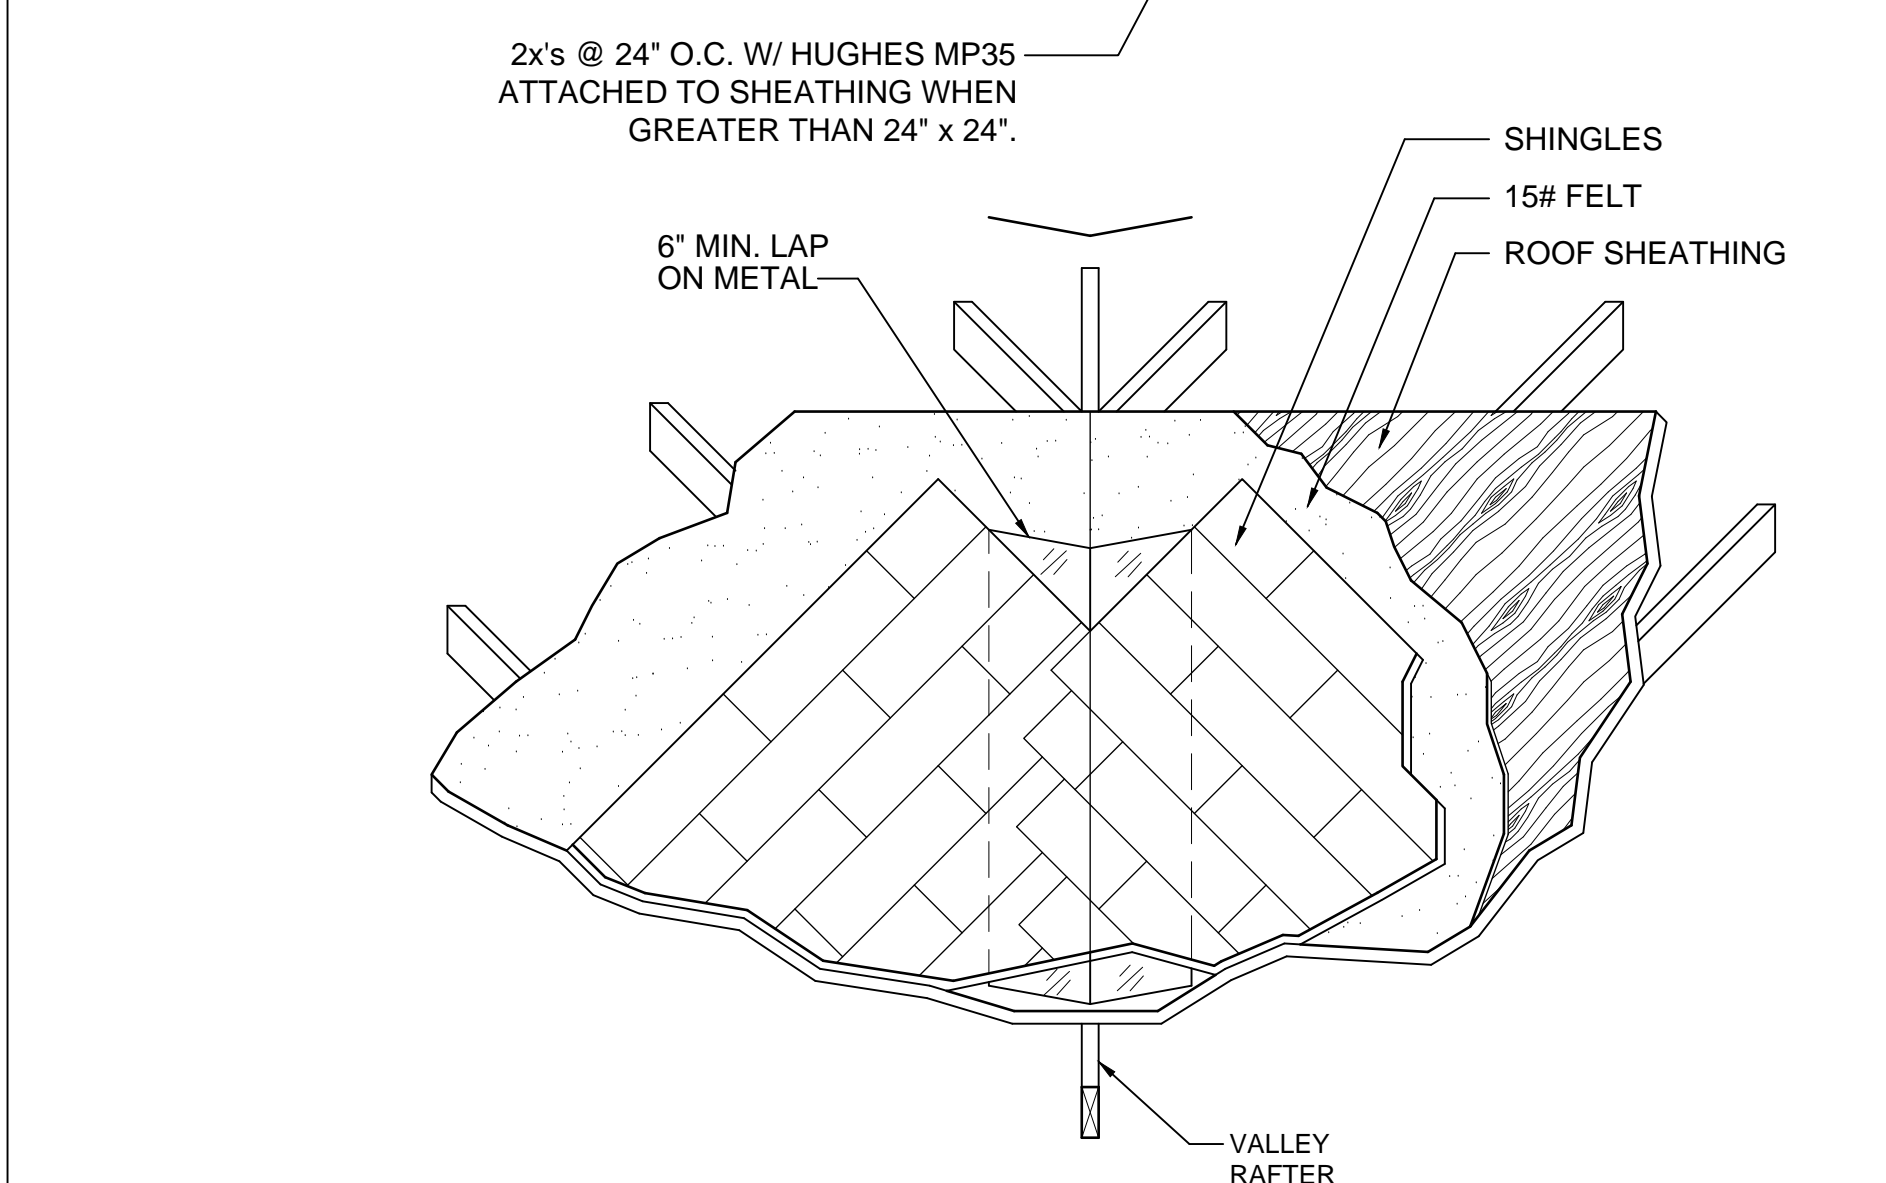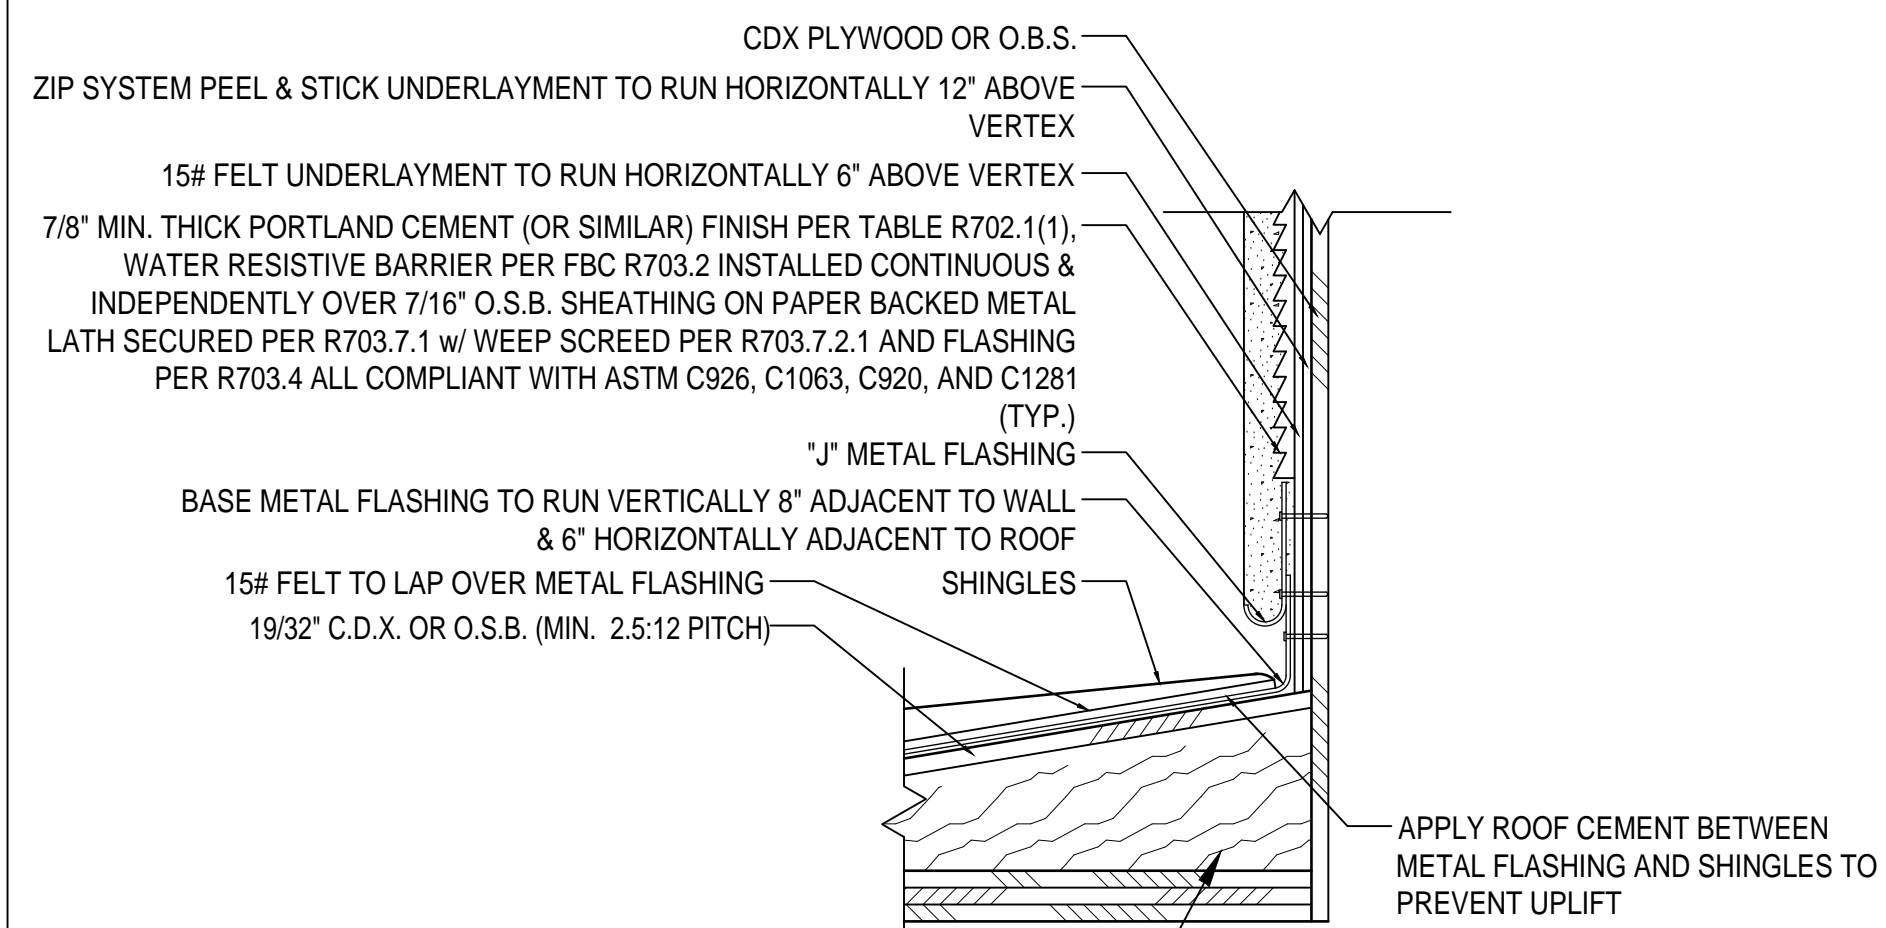

3 CRICKET/FLASHING DETAIL

SCALE: N.T.S.

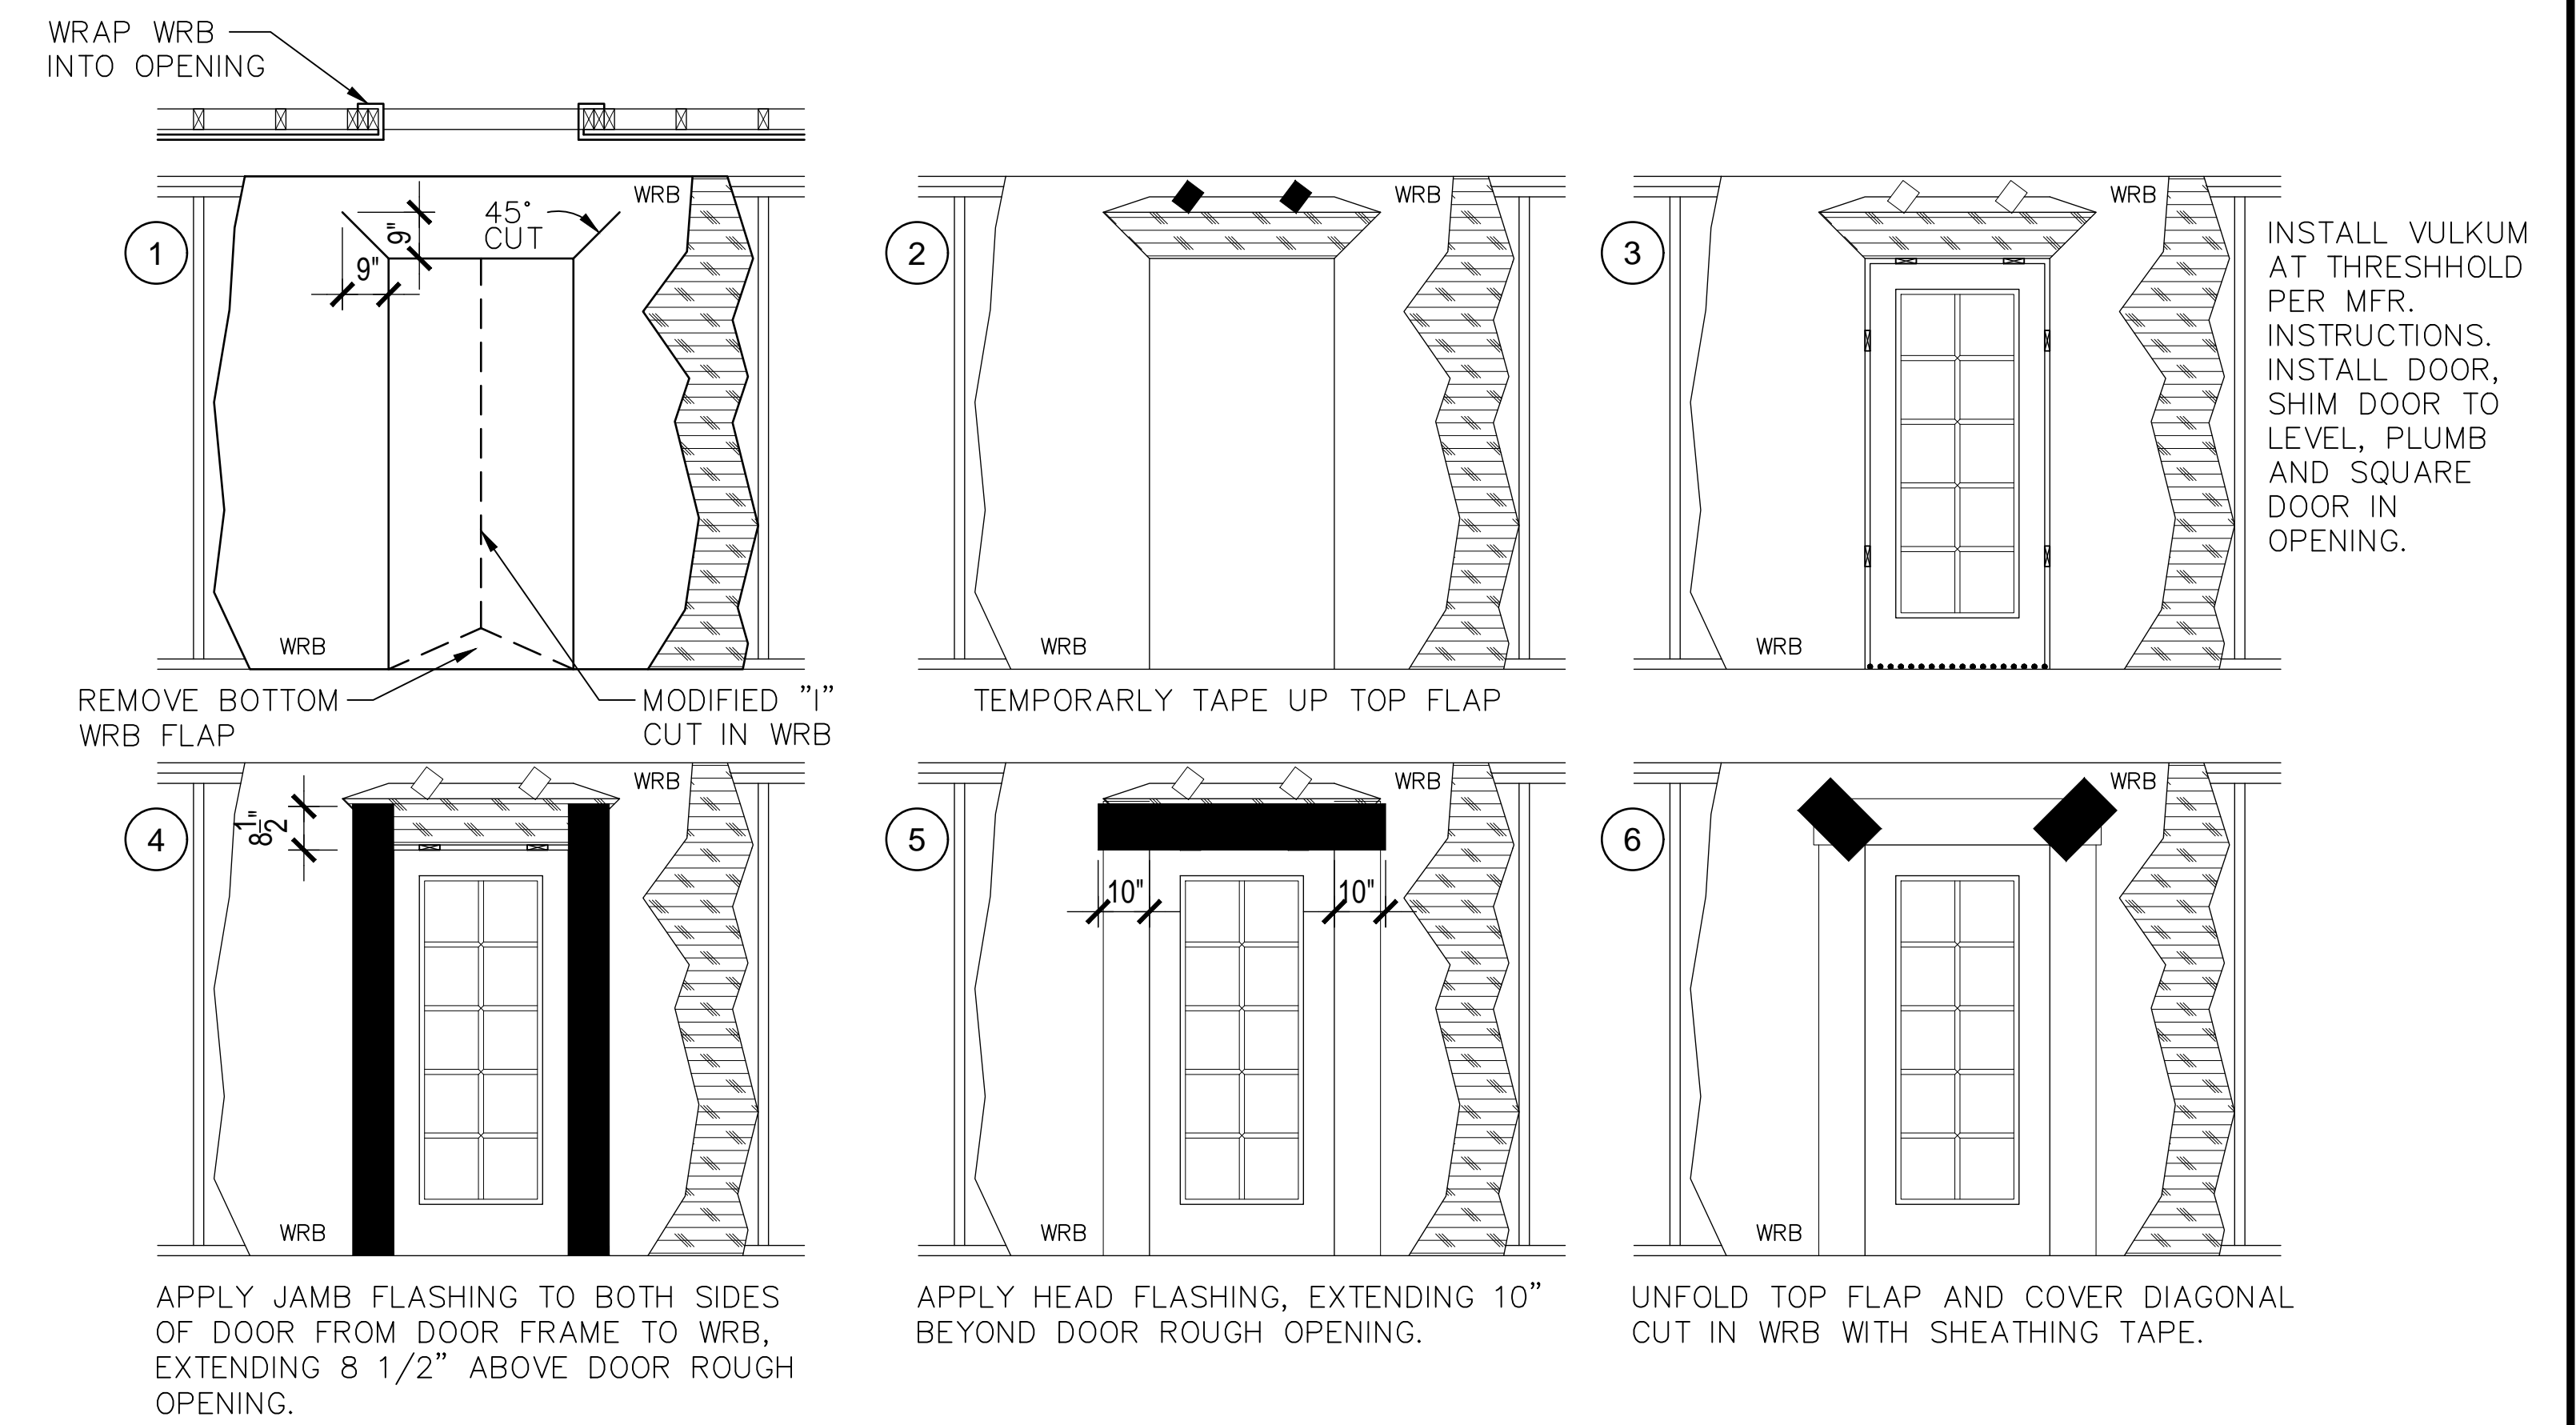


EXTERIOR DOOR FLASHING

NOTE: ALL FLASHING WILL BE SELF ADHERING AND ROLLED SMOOTH & FLAT WITH A J-ROLLER.

SCALE: N.T.S.

WINDOW INSTALLATION (METHOD A-1) (ASTM E 2112-23)

WEATHER RESISTIVE BARRIER (WRB) APPLIED PRIOR TO THE WINDOW INSTALLATION. FLASHING APPLIED OVER THE FACE OF THE MOUNTING FLANGE.

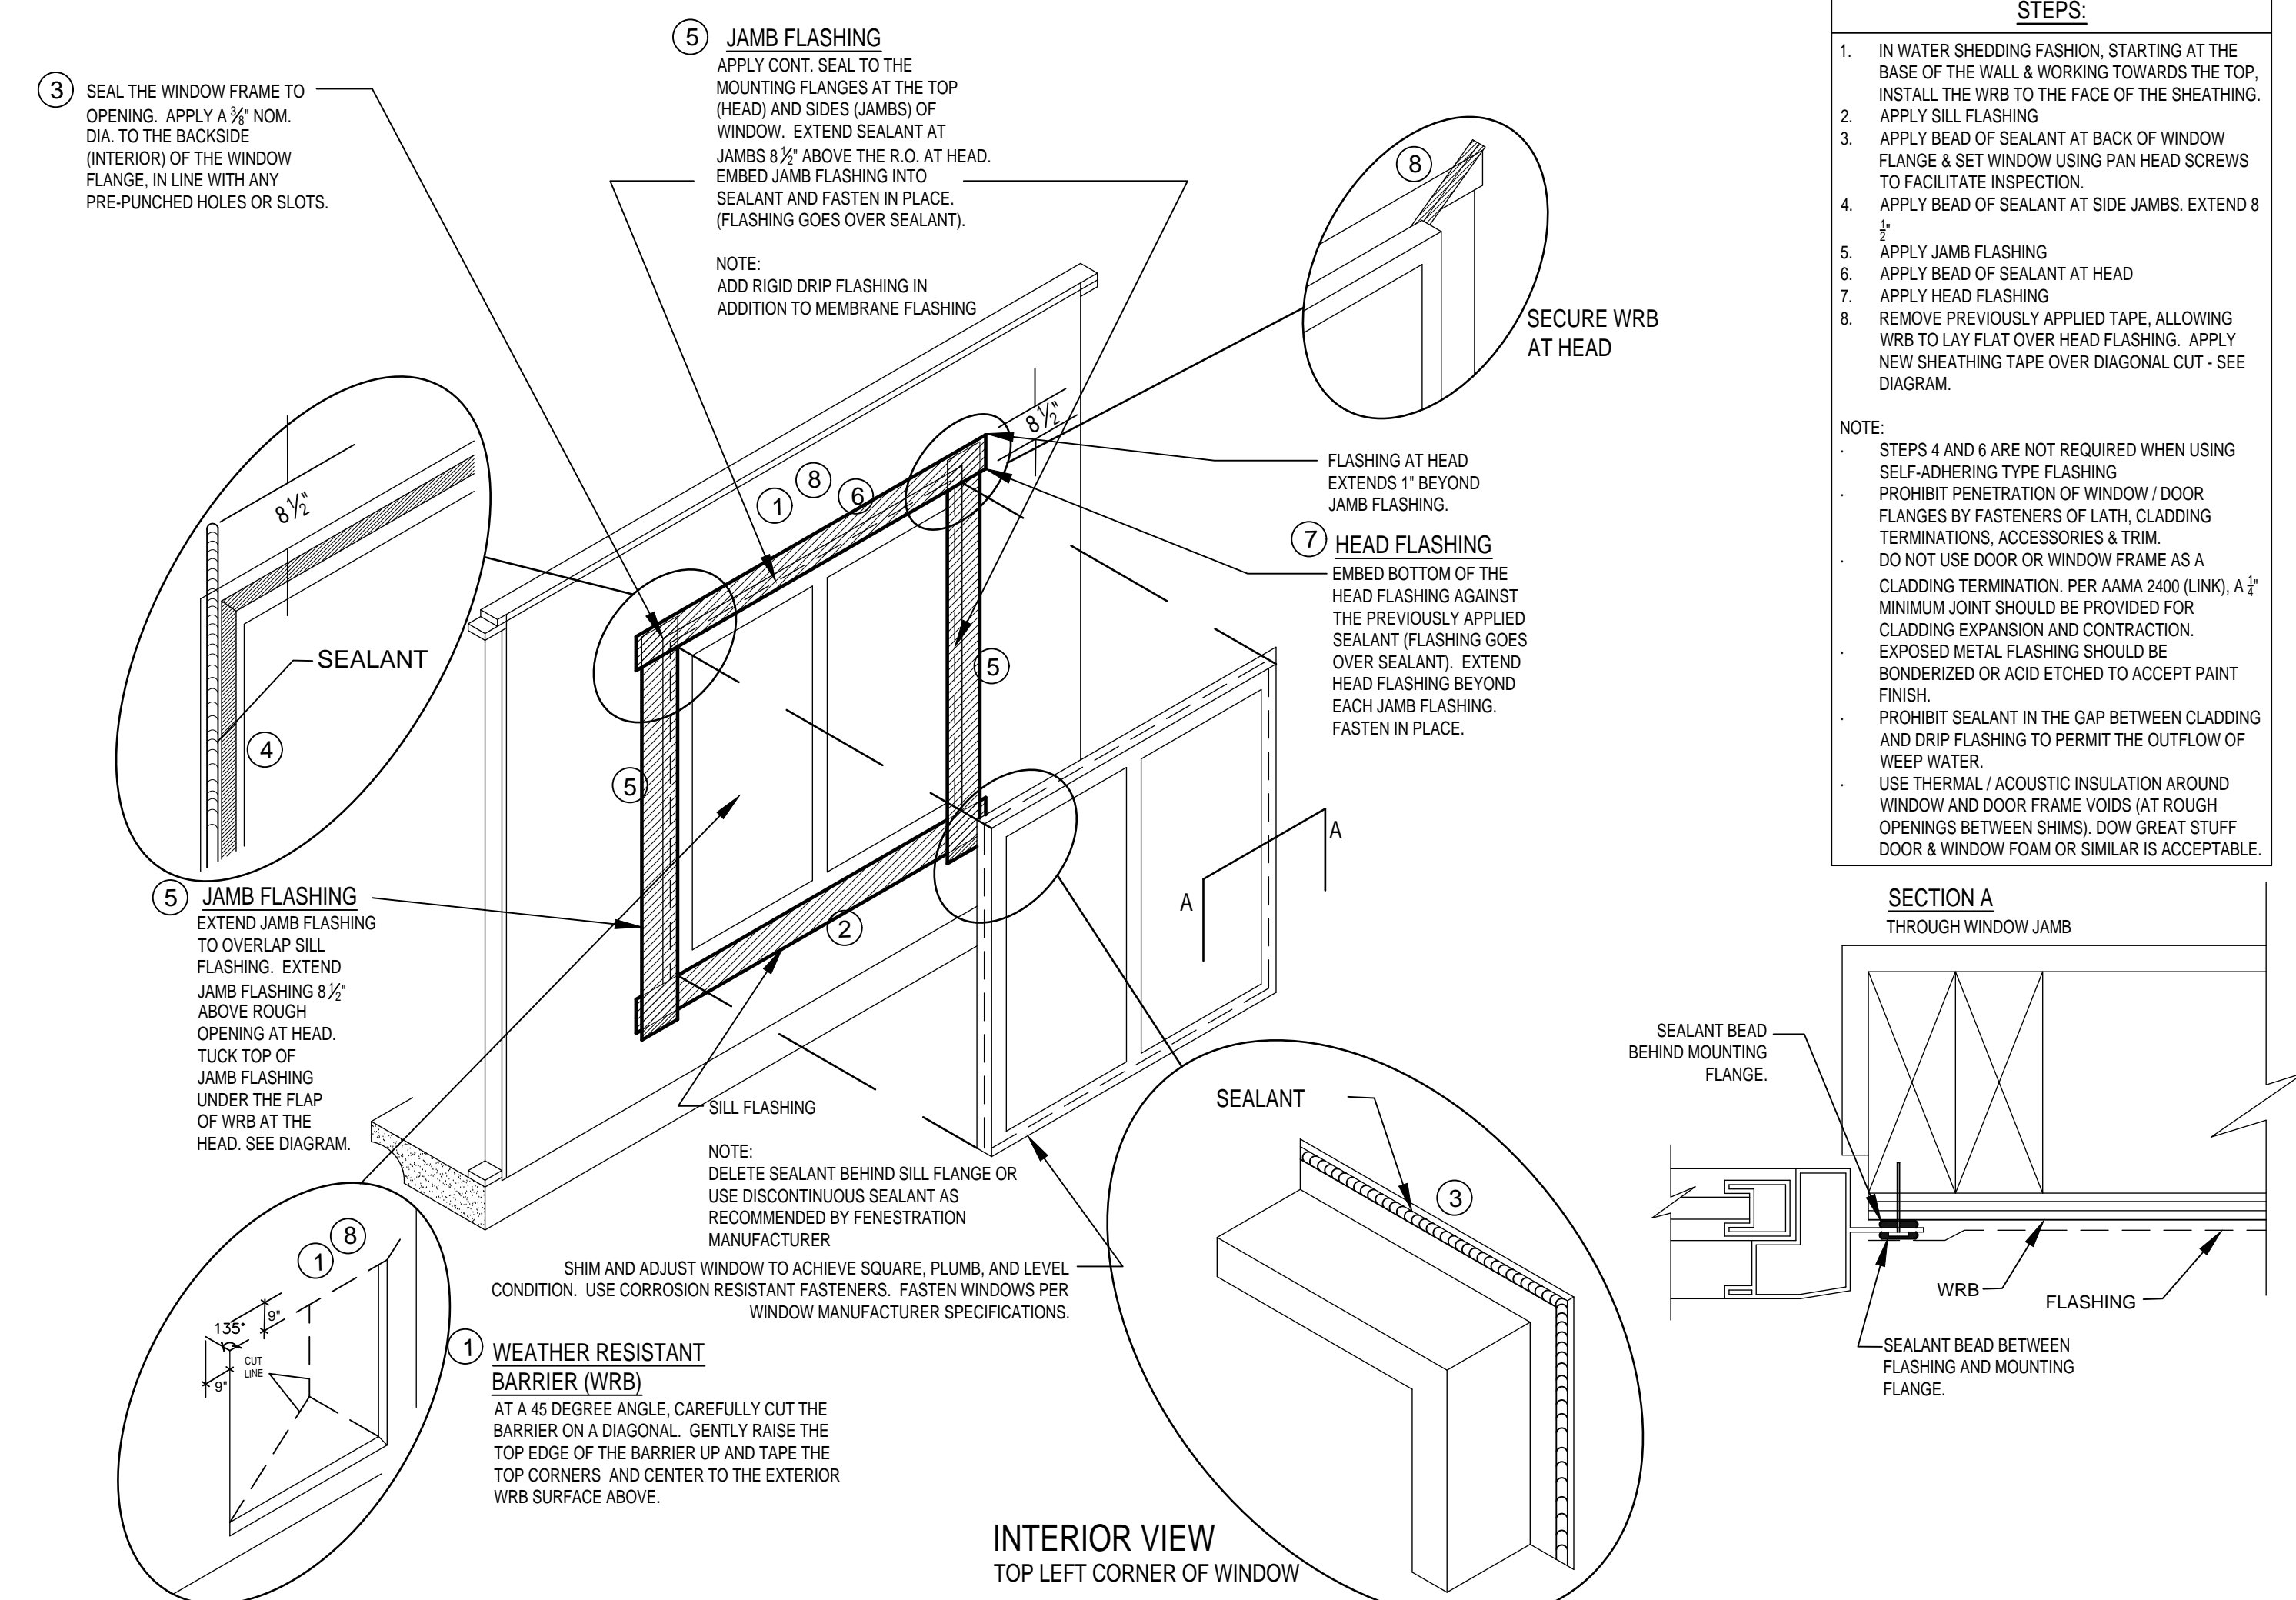


INTERIOR VIEW TOP LEFT CORNER OF WINDOW

WINDOW FLASHING "METHOD A-1"

NOTE: ALL FLASHING WILL BE SELF ADHERING AND ROLLED SMOOTH & FLAT WITH A J-ROLLER.

SCALE: N.T.S.

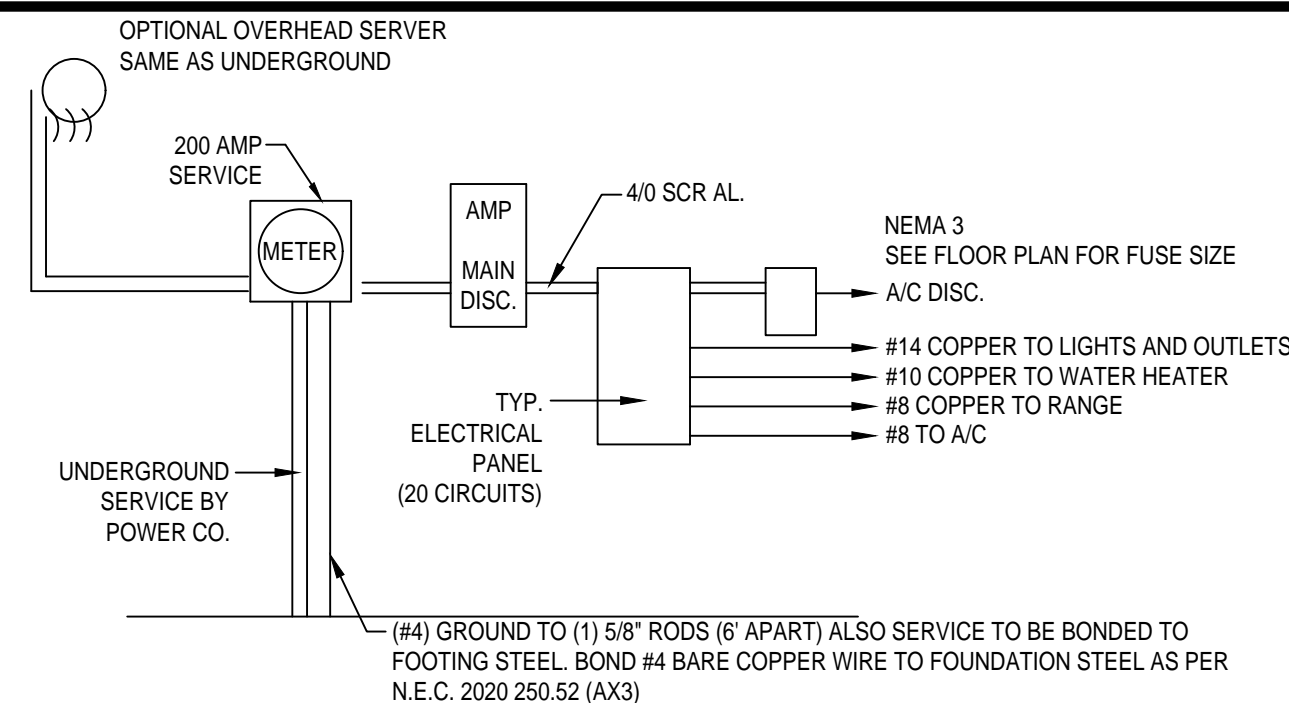

200 AMP ELECTRICAL RISER

Prestige Electric
COMPANY OF FLORIDA, LLC


Mark Young
State License #EC0000000

Electrical Contracting
Licensed • Bonded • Insured

Park Square
Paradiso Town Home

2702022
270 2nd Service

General Lighting @ 3 watts/sq.	1900	5700
Small appliance @1000 watt	1200	3600
Laundry	1500	1500
Range	8000	8000
Pool	4000	4000
Dishwasher	1200	1200
Disposal	1000	1000
Dryer	8000	8000
Pool Heater	8000	8000
Sub Total	34800	
Final 10 KVA @ 100%		4400
Recessed @ 40 %		10600
Air Conditioner Load @ 100%	5200	5200
Heat Pump @ 85%	8000	5200
VA 240 Vols + Service Amps		29440
		100 (20000)

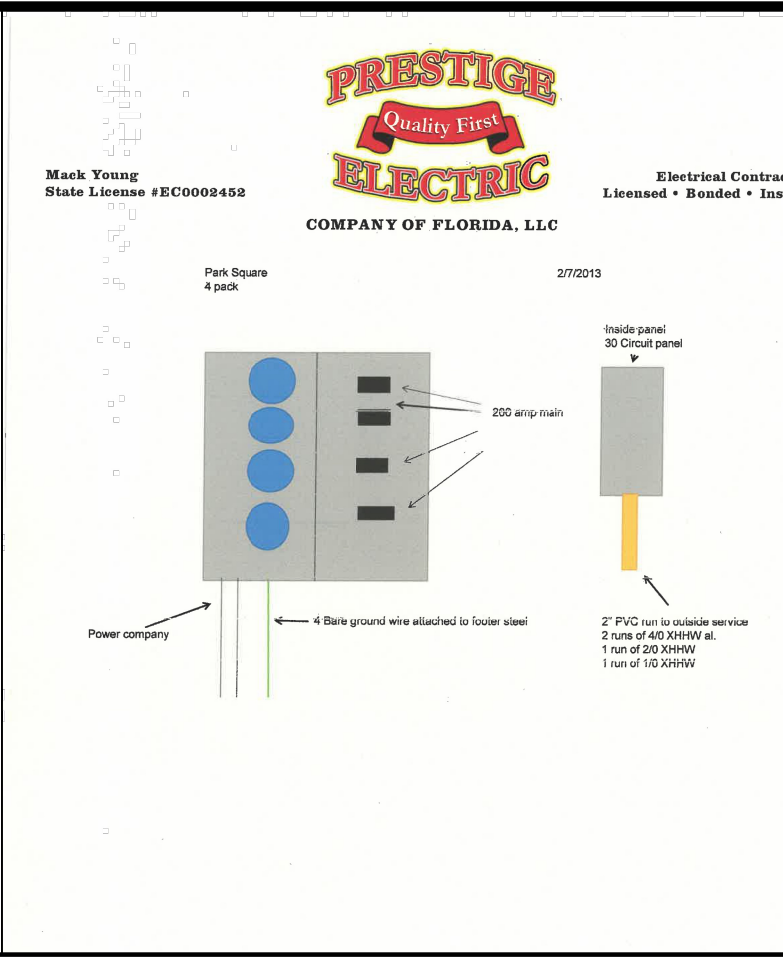


GENERAL NOTES KEY:

- BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
 - ALL OUTLETS ARE TO BE AFCI PROTECTED.
 - ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
 - ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
 - ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
 - ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
 - DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
 - EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
 - OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
 - OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
 - ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (J.N.O.).
 - ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
 - 6'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
 - ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH QUICKFLASH PANELS (OR SIMILAR).
 - RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENVELOPE ARE SUBJECT TO THE PROVISIONS OF FBCEC R402.4.5. FIXTURES SHALL BE IC-RATED (FOR ZERO CLEARANCE INSULATION CONTACT) AND SEALED AIR TIGHT. ALSO SEE FBCEC 410.116.
- NOTES:**
THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REINING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 8TH EDITION (2023) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.
ELECTRICAL BOXES IN FIRE-RATED WALLS SHALL BE STEEL OR LISTED FIRE-RATED EQUI. AND THE ANNULAR SPACE BETWEEN THE MEMBRANE AND THE BOX SHALL NOT EXCEED 1/8" PER FBC-R 302.4.2. IF THE ANNULAR SPACE EXCEEDS 1/8" FIRE-RATED SEALANT MAY BE USED TO FILL THE GAP.
- SMOKE DETECTOR REQUIREMENTS:**
ALL SMOKE/CARBON DETECTOR LOCATIONS MUST BE A MINIMUM OF 3' FROM ANY BATHROOM PER FBC-R314.3 (4). THEY MUST ALSO BE LOCATED NO MORE THAN 10' FROM ANY BEDROOM DOOR OPENING PER FBC-R315.1.


ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vineland Road Suite #6 Orlando, FL 32811
Ph: (407) 734-1790
Fax: (407) 734-1790
www.iteg.com

MJS
designers group
residential/commercial/architecture


815 Orienta Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignersgroup.com
MJS DESIGNERS GROUP, INC. IS AN EQUAL OPPORTUNITY EMPLOYER AND IDEAS ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

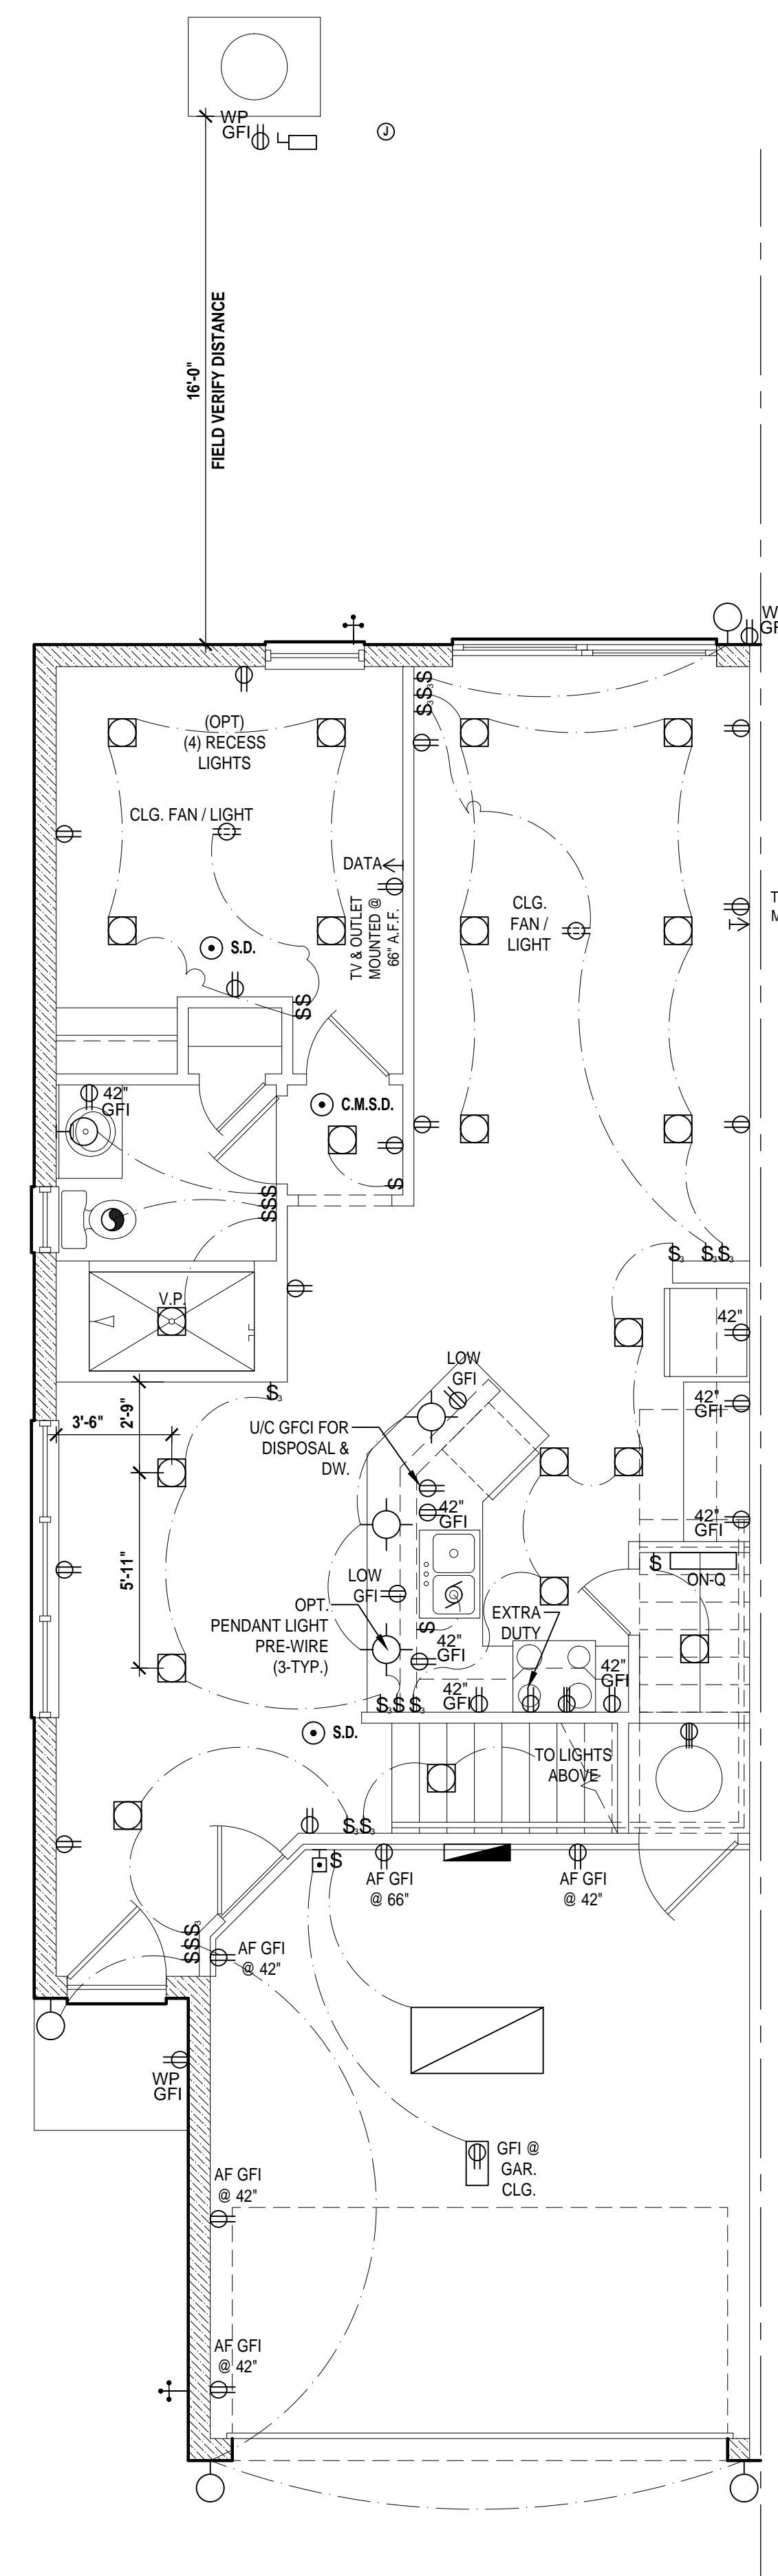


Nautilus First Floor
SCALE 1/4" = 1'-0"

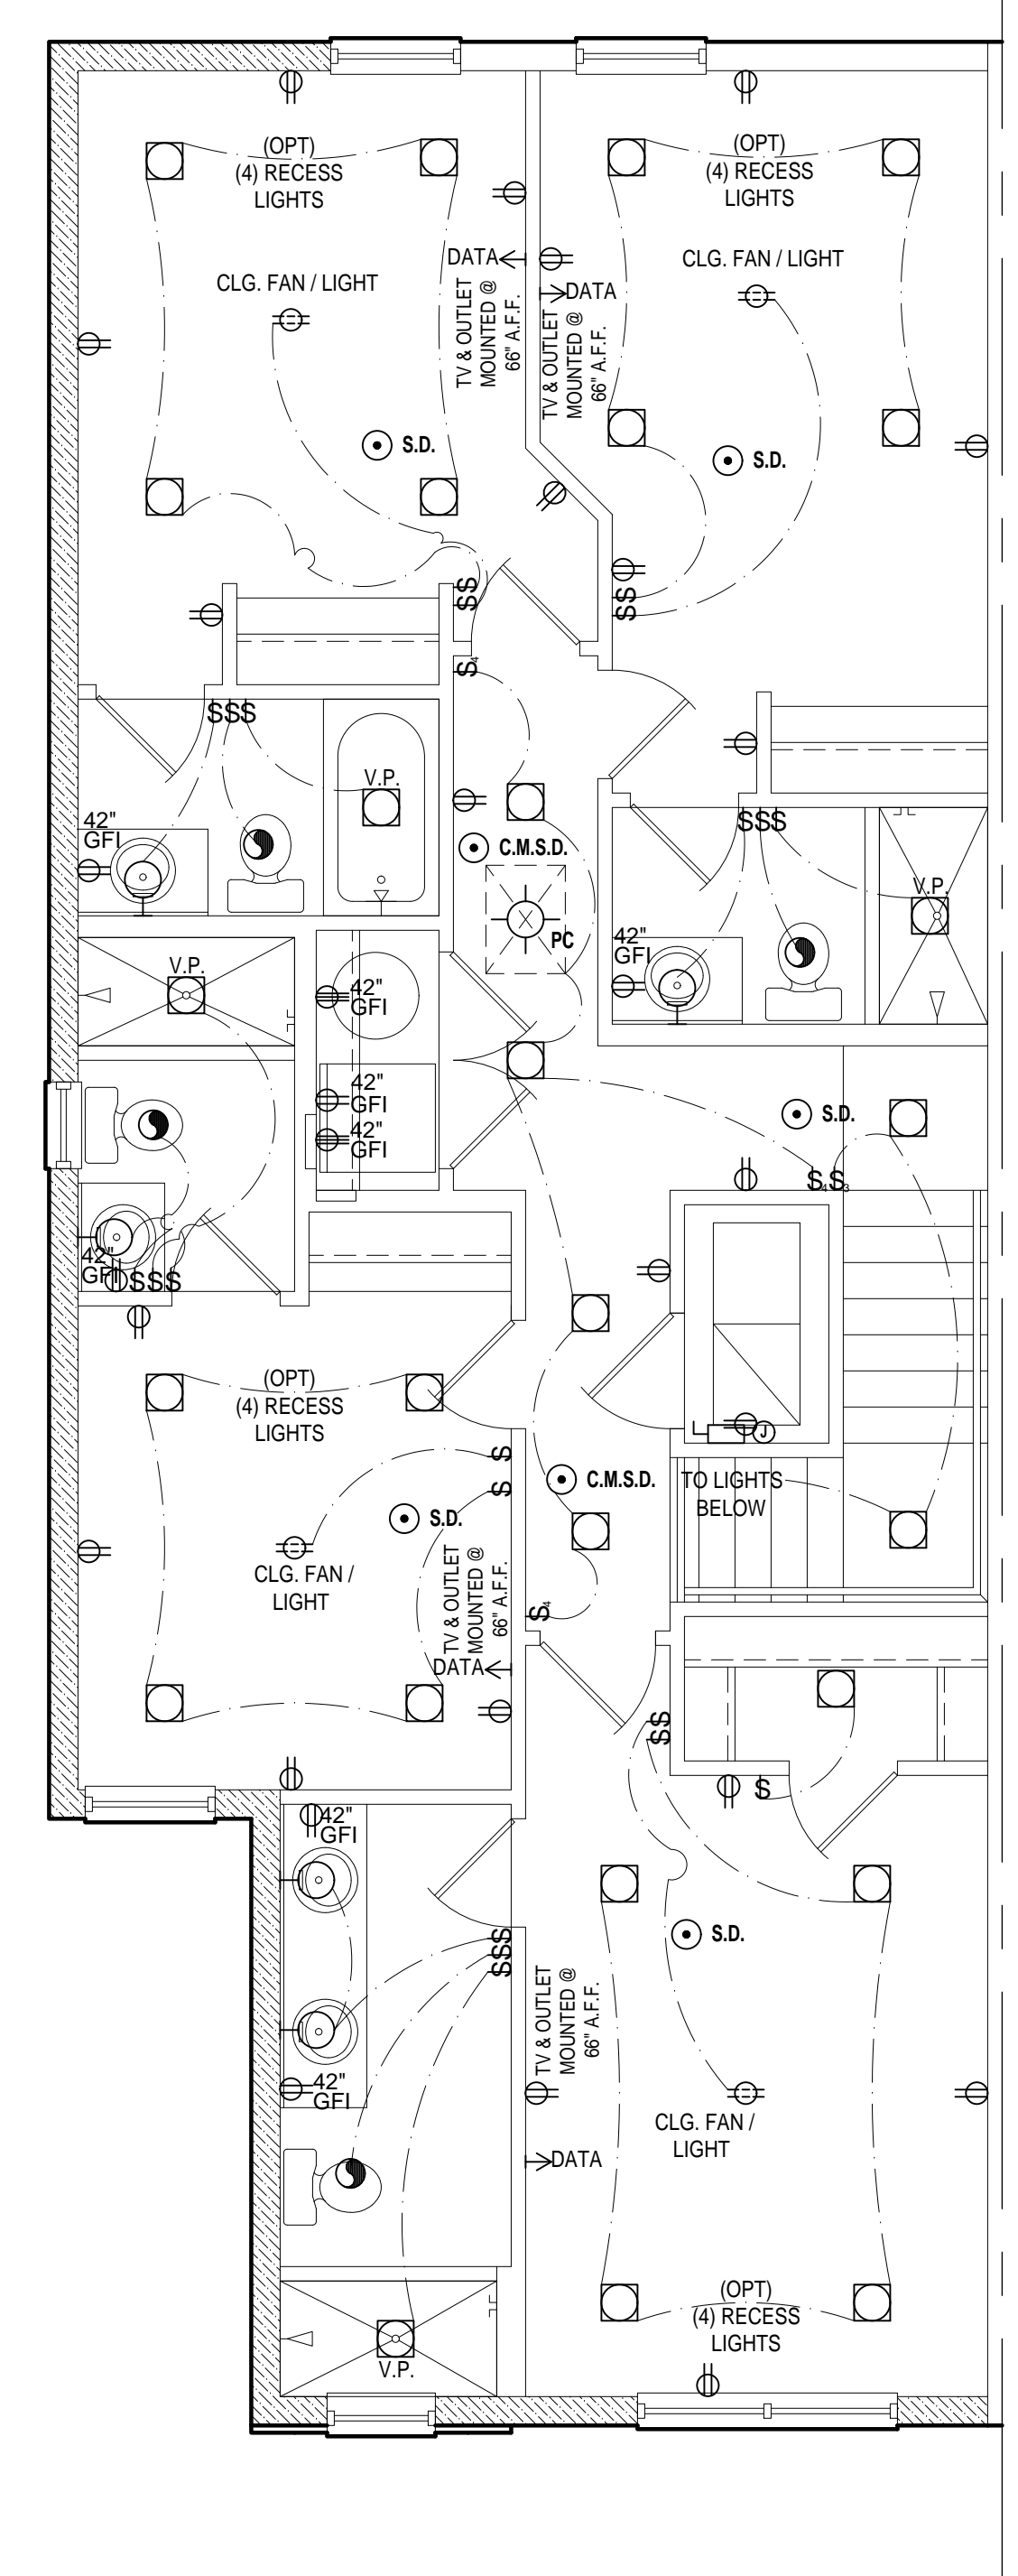

**Nautilus Second Floor
"Elev. A&B" (Elev. "A" shown)**
SCALE 1/4" = 1'-0"

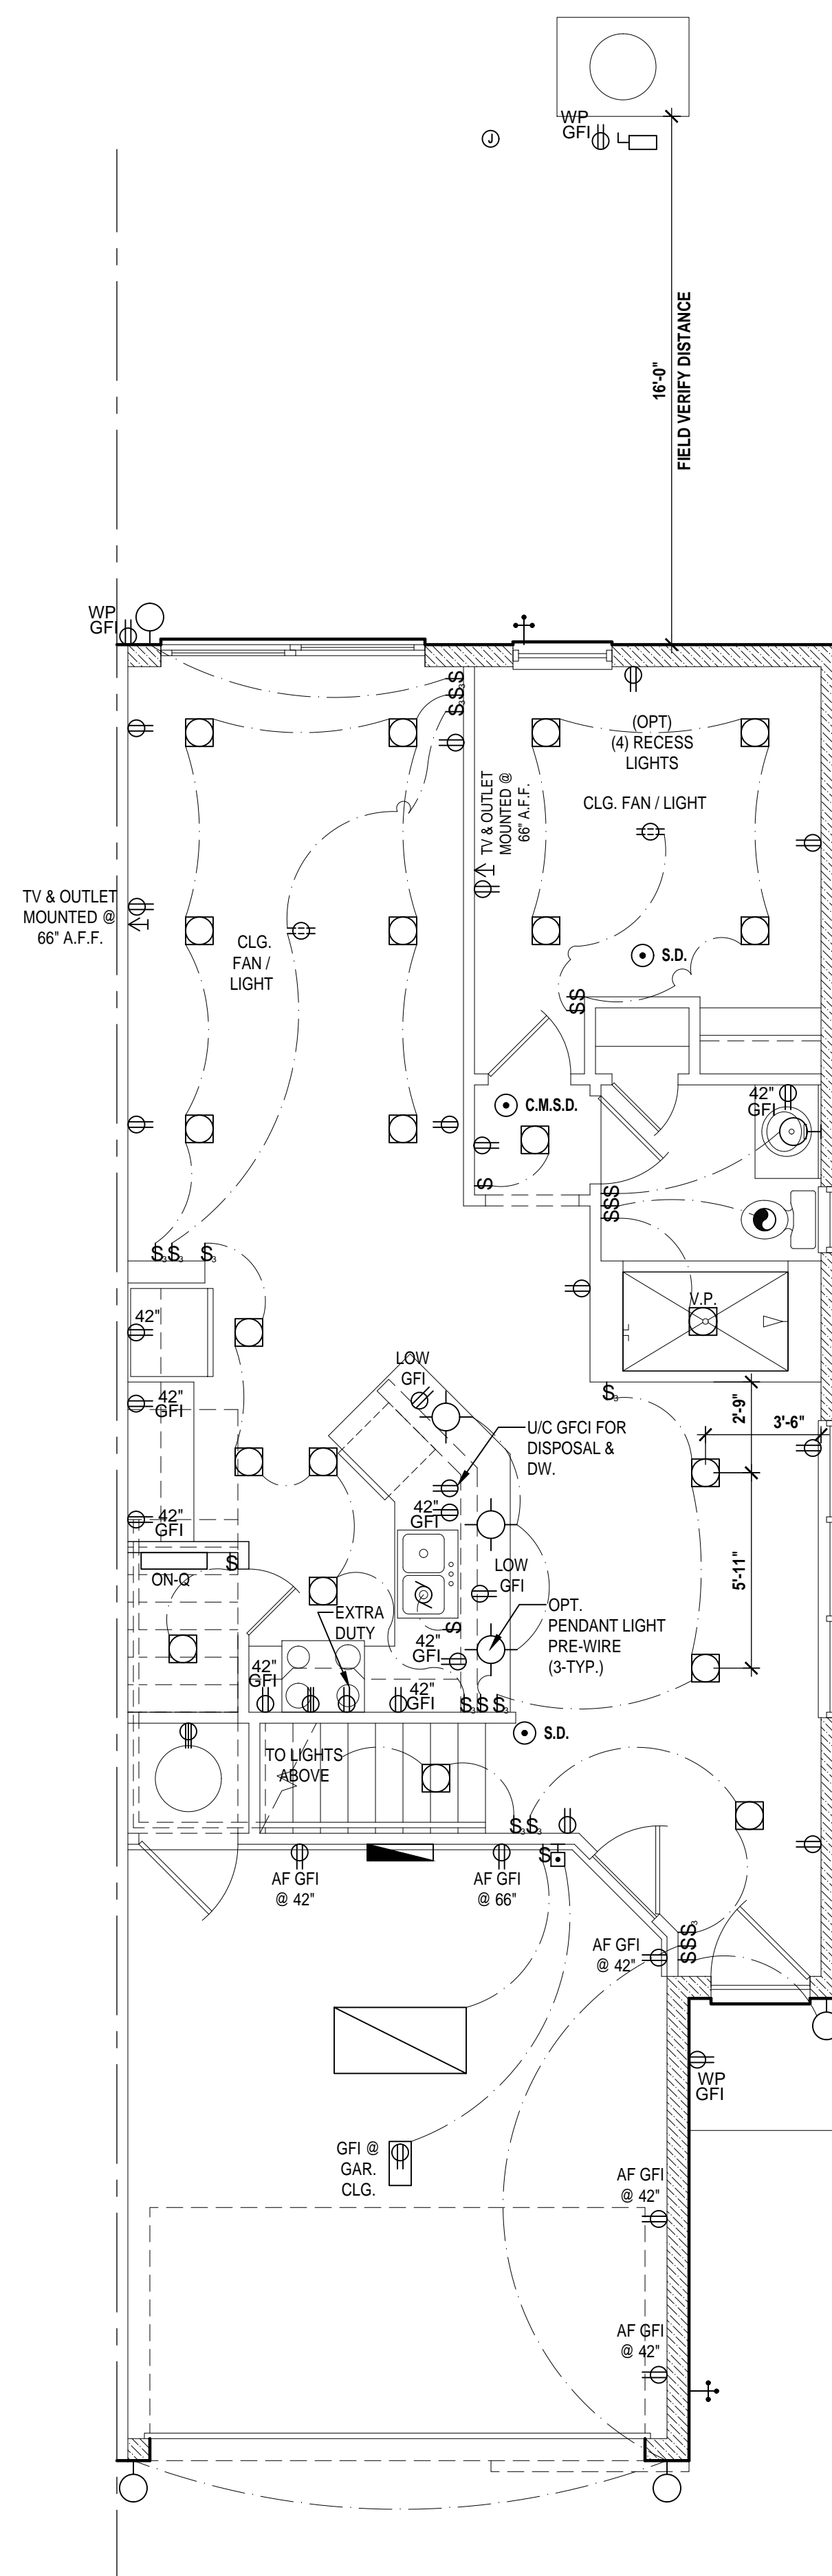

**Nautilus First Floor - (Rev.)
"Elev. A&B" (Elev. "A" shown)**
SCALE 1/4" = 1'-0"

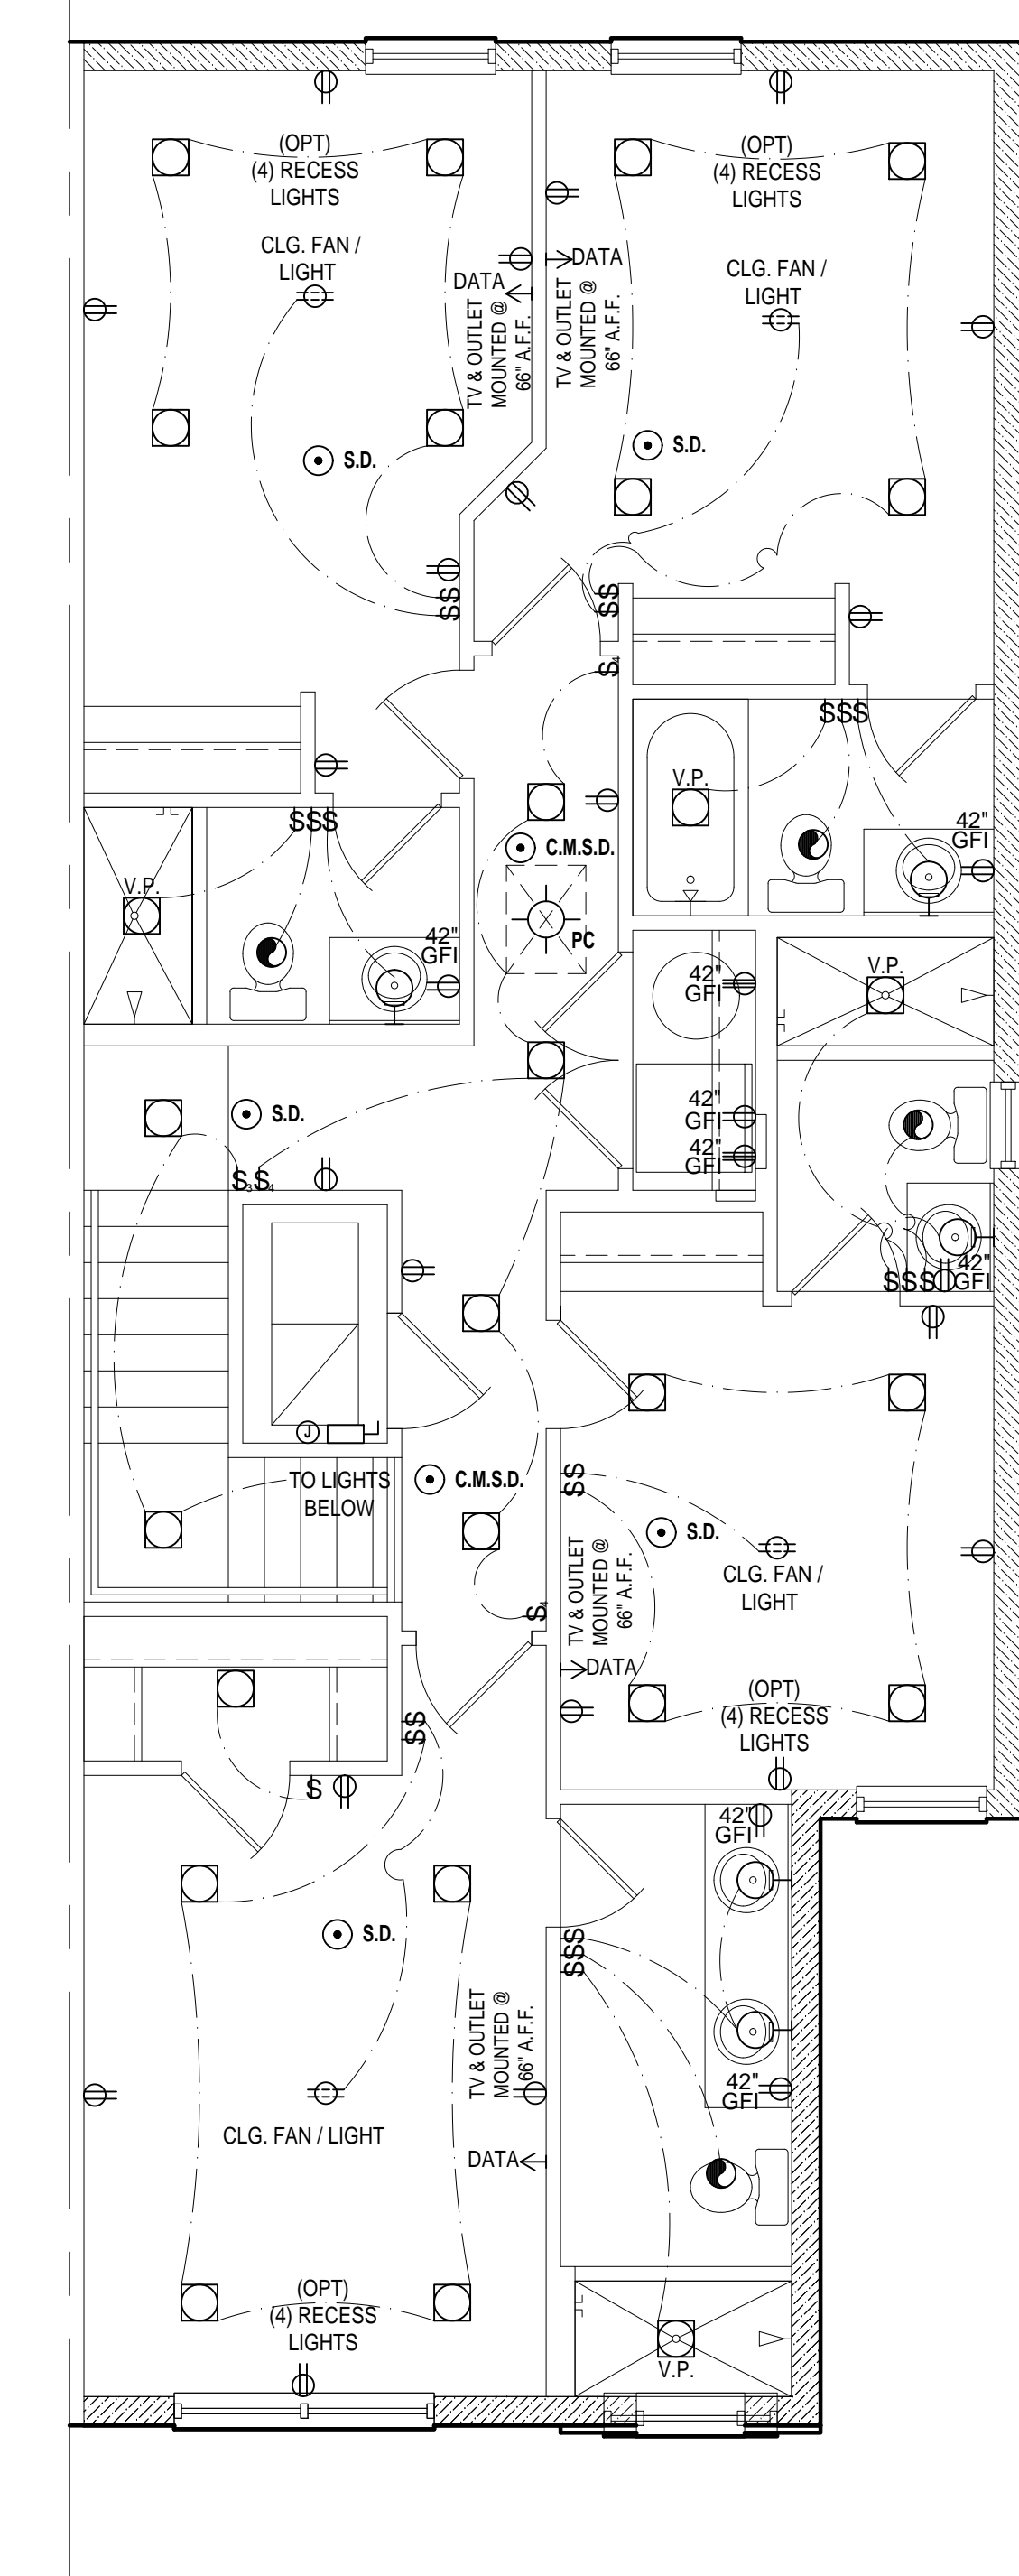

**Nautilus Second Floor - (Rev.)
"Elev. A&B" (Elev. "A" shown)**
SCALE 1/4" = 1'-0"

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT
	PULL CHAIN LIGHT
	FLUSH-MOUNT LED
	WALL MOUNTED LIGHT
	WALL WASH RECESSED
	DUPLEX RECEPTACLE
	220 V RECEPTACLE
	1/2 HOT, 1/2 SWITCHED
	WATER PROOF RECEPTACLE
	FLOOR RECEPTACLE
	PRE-WIRE FOR CLG. FAN
	GROUND FAULT INTERRUPT
	WALL SWITCH
	3-WAY SWITCH
	DIMMER SWITCH
	TELEPHONE JACK
	CABLE JACK
	PRE-WIRE GARAGE DOOR OPENER
	FLUORESCENT LIGHT
	ELECTRICAL PANEL
	CHIME
	DOOR BELL / GARAGE DOOR SWITCH
	DISCONNECT SWITCH
	ELECTRICAL METER
	S.D. SMOKE DETECTOR
	C.M.S.D. CARBON MONOXIDE / SMOKE DETECTOR
	CEILING FAN
	WALL SCONCE
	CHANDELIER
	SPOT LIGHT
	FLUSH MOUNT FLUORESCENT LIGHT
	FAN / LIGHT COMBINATION
	GARBAGE DISPOSAL MOTOR
	SPEAKER
	JUNCTION BOX
	LOW VOLTAGE
	VAPOR PROOF
	ARC FAULT PROTECTION
	INTERCOM

Electrical Plan

SCALE 1/4" = 1'-0"

5-Unit: (Paradiso TH)
Models: Nautilus, Latitude


A division of Park Square
Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE: 04/13/2023
REVISIONS:

PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

Electrical Layout
E1


WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR DIMENSIONS AND CONDITIONS OF THE JOB AND MJS, INC. MUST BE NOTIFIED IN WRITING OF ANY CHANGES TO THE DIMENSIONS, CONDITIONS AND SPECIFICATIONS APPEARING ON THESE PLANS.

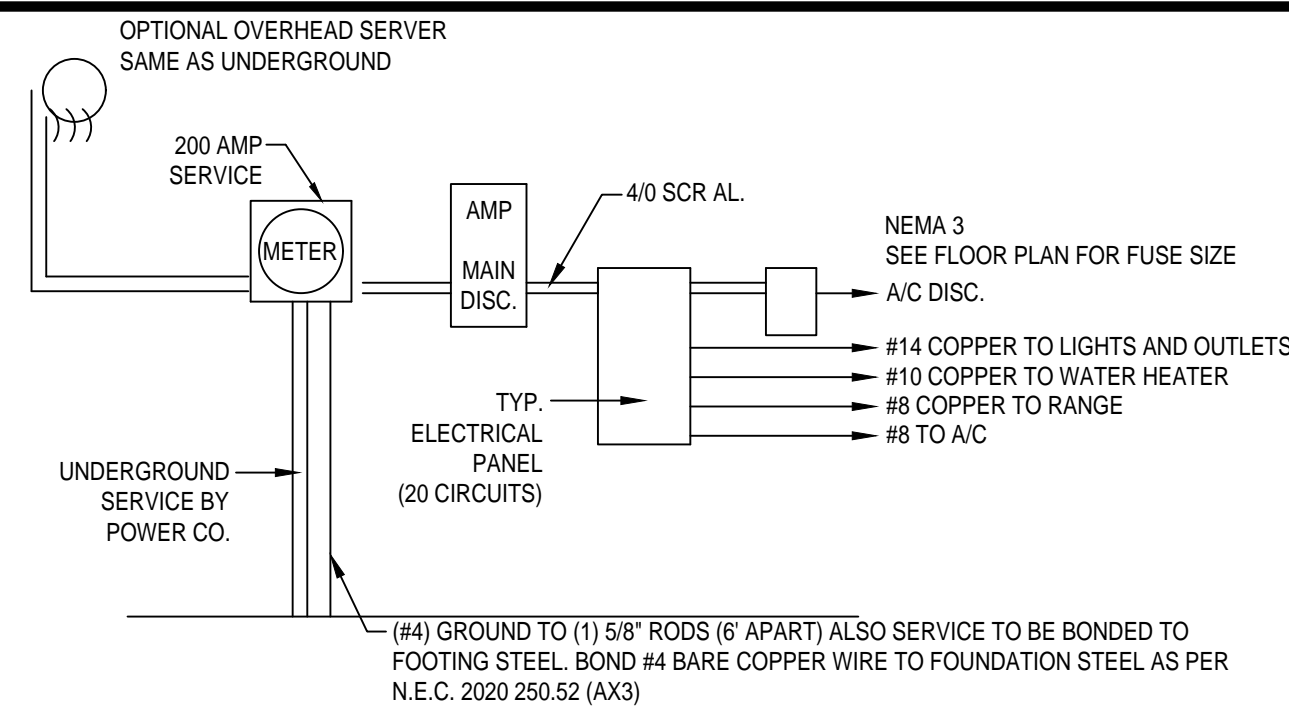

200 AMP ELECTRICAL RISER

Park Square
2702022
200 amp Service

General Lighting @ 3 watts/sq.	1900	5700
Small appliance @ 1500 watt	1200	3600
Laundry	1500	1500
Range	8000	8000
Pool	4000	4000
Dishwasher	1200	1200
Disposal	1000	1000
Dryer	8000	8000
Pool Heater	8000	8000
Sub Total	34800	
Final 10 KVA @ 100%		8400
Reameter @ 40 %		10600
Air Conditioner Load @ 100%	5200	5200
Heat Pump @ 85%	8000	5200
VA 240 Vols + Service Size Amps		29400
		100 (20000)

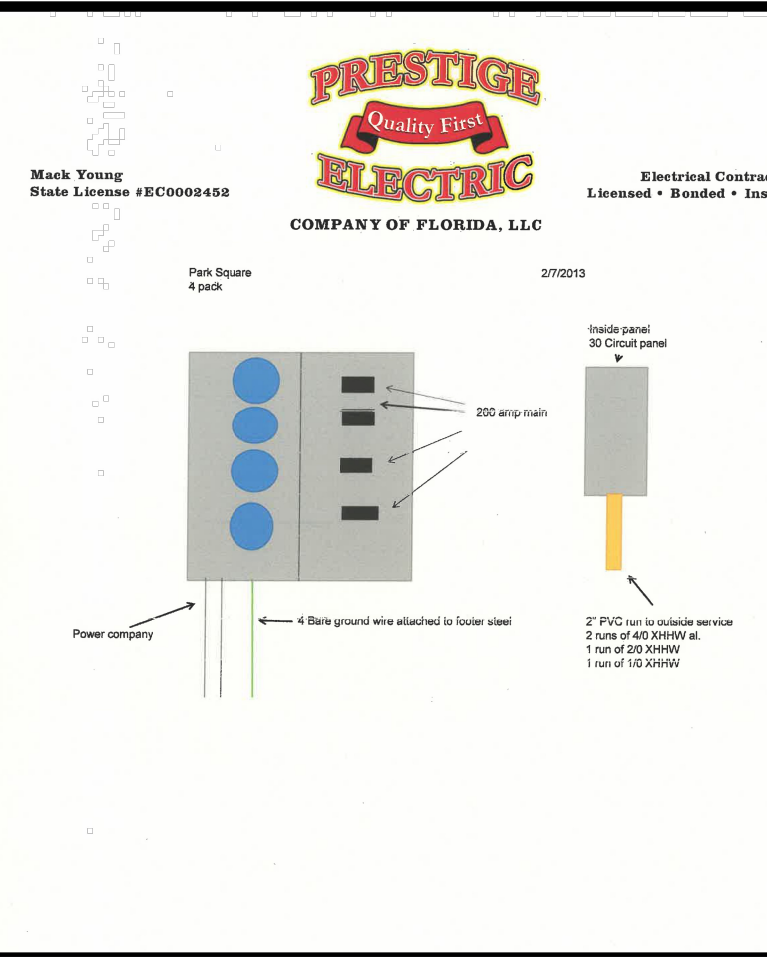

GENERAL NOTES KEY:

- BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
- ALL OUTLETS ARE TO BE AFCI PROTECTED.
- ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
- ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
- ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
- ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
- DW. AND GARAGE DISPOSAL ARE TO BE GFCI PROTECTED.
- EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
- OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
- OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
- ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (J.N.O.).
- ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
- 6'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
- ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH QUICKFLASH PANELS (OR SIMILAR).
- RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENVELOPE ARE SUBJECT TO THE PROVISIONS OF FBCE R402.4.5. FIXTURES SHALL BE IC-RATED (FOR ZERO CLEARANCE INSULATION CONTACT) AND SEALED AIR TIGHT. ALSO SEE FBCE 410.116.

NOTES:
THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REINING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
LOCATION OF FIXTURES AND/OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD. ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 8TH EDITION (2023) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.
ELECTRICAL BOXES IN FIRE-RATED WALLS SHALL BE STEEL OR LISTED FIRE-RATED EQUAL AND THE ANNULAR SPACE BETWEEN THE MEMBRANE AND THE BOX SHALL NOT EXCEED 1/8" PER FBC-R 302.4.2. IF THE ANNULAR SPACE EXCEEDS 1/8" FIRE-RATED SEALANT MAY BE USED TO FILL THE GAP.

SMOKE DETECTOR REQUIREMENTS:
ALL SMOKE/CARBON DETECTOR LOCATIONS MUST BE A MINIMUM OF 3' FROM ANY BATHROOM PER FBC-R314.3 (4). THEY MUST ALSO BE LOCATED NO MORE THAN 10' FROM ANY BEDROOM DOOR OPENING PER FBC-R315.1.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT
	PULL CHAIN LIGHT
	FLUSH-MOUNT LED
	WALL MOUNTED LIGHT
	WALL WASH RECESSED
	DUPLEX RECEPTACLE
	220 V RECEPTACLE
	1/2 HOT, 1/2 SWITCHED
	WATER PROOF RECEPTACLE
	FLOOR RECEPTACLE
	PRE-WIRE FOR CLG. FAN
	GROUND FAULT INTERRUPT
	WALL SWITCH
	3-WAY SWITCH
	DIMMER SWITCH
	TELEPHONE JACK
	CABLE JACK
	PRE-WIRE GARAGE DOOR OPENER
	FLUORESCENT LIGHT
	ELECTRICAL PANEL
	CHIME
	DOOR BELL / GARAGE DOOR SWITCH
	DISCONNECT SWITCH
	ELECTRICAL METER
	S.M.O.K.E. D.E.T.E.C.T.O.R.
	C.A.R.B.O.N M.O.N.O.X.I.D.E. / S.M.O.K.E D.E.T.E.C.T.O.R.
	CEILING FAN
	WALL SCONCE
	CHANDELIER
	SPOT LIGHT
	FLUSH MOUNT FLUORESCENT LIGHT
	FAN / LIGHT COMBINATION
	GARBAGE DISPOSAL MOTOR
	SPEAKER
	JUNCTION BOX
	LOW VOLTAGE
	VAPOR PROOF
	A.R.C. F.A.U.L.T. P.R.O.T.E.C.T.I.O.N.
	I.N.T.E.R.C.O.M.


5-Unit: (Paradiso TH)
Models: Nimbus, Latitude
Building Plat #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000


ISSUE DATE: 04/13/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

Electrical Plan
SCALE: 1/4" = 1'-0"


E2

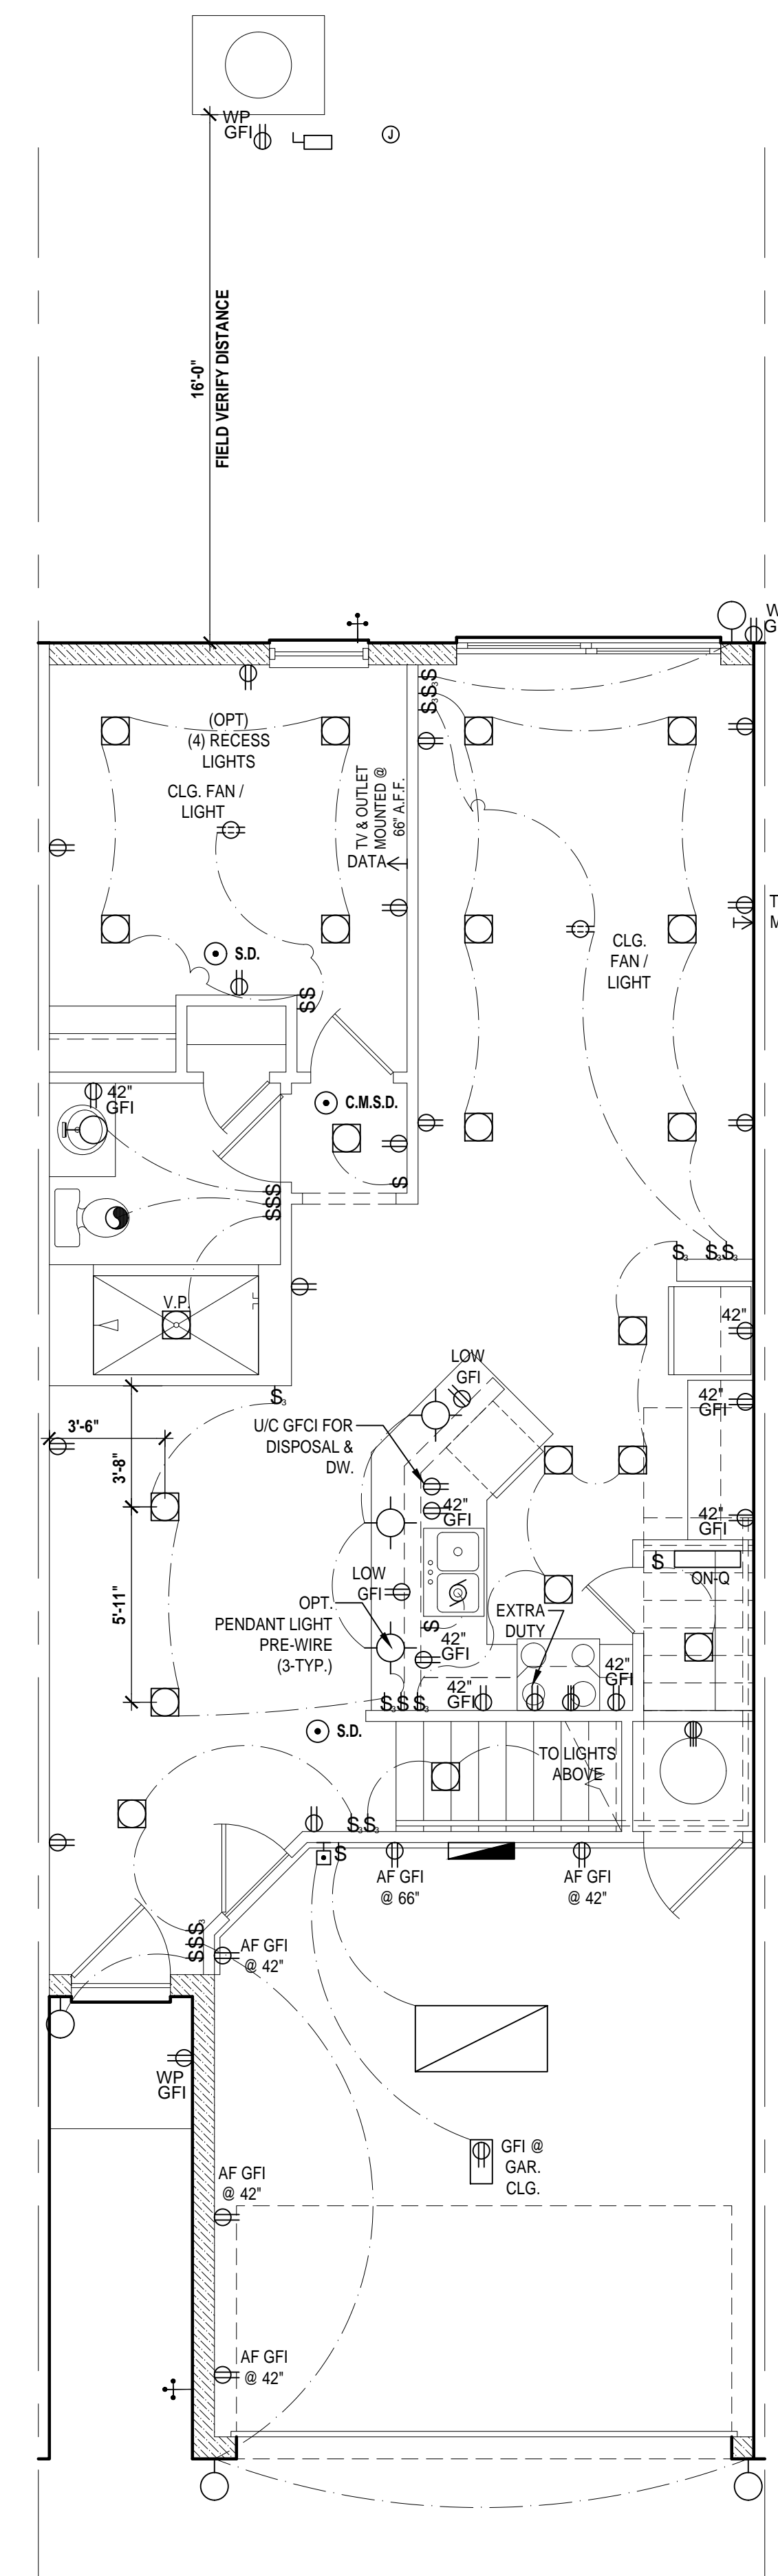


Latitude First Floor
SCALE: 1/4" = 1'-0"

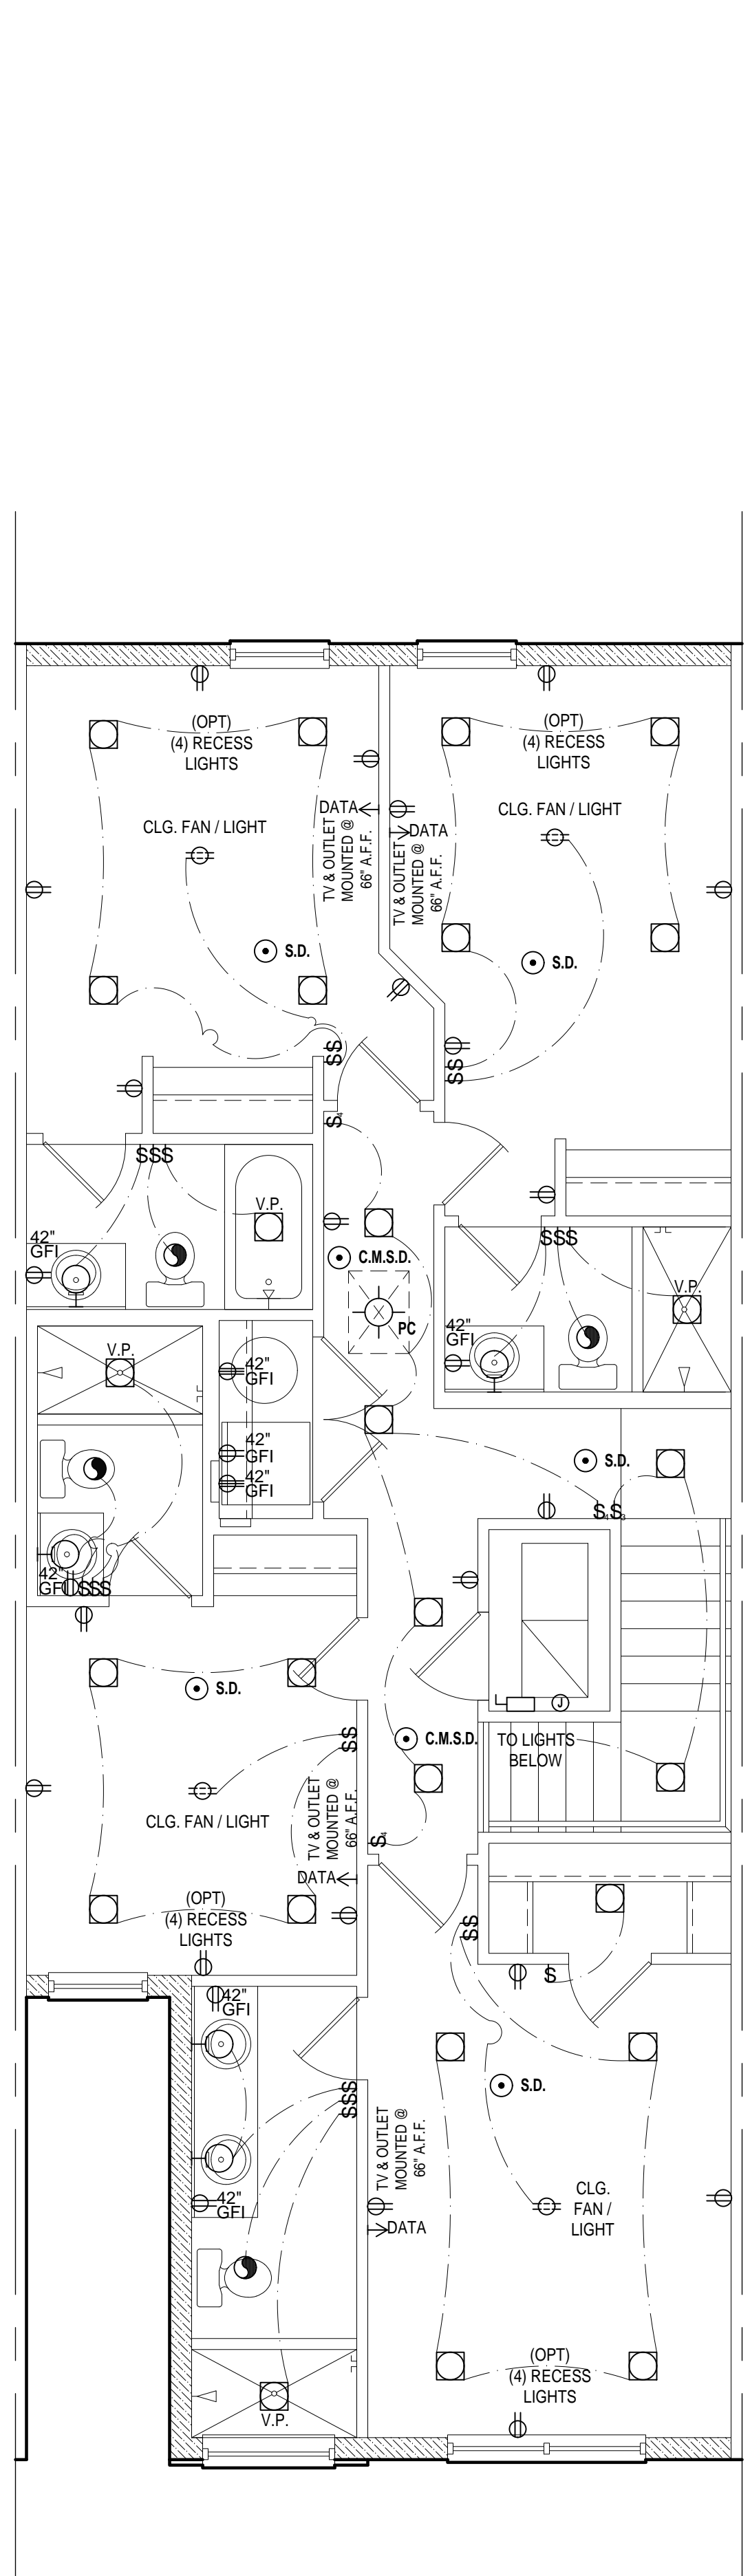

Latitude Second Floor "Elev. A&B" (Elev. "A" shown)
SCALE: 1/4" = 1'-0"

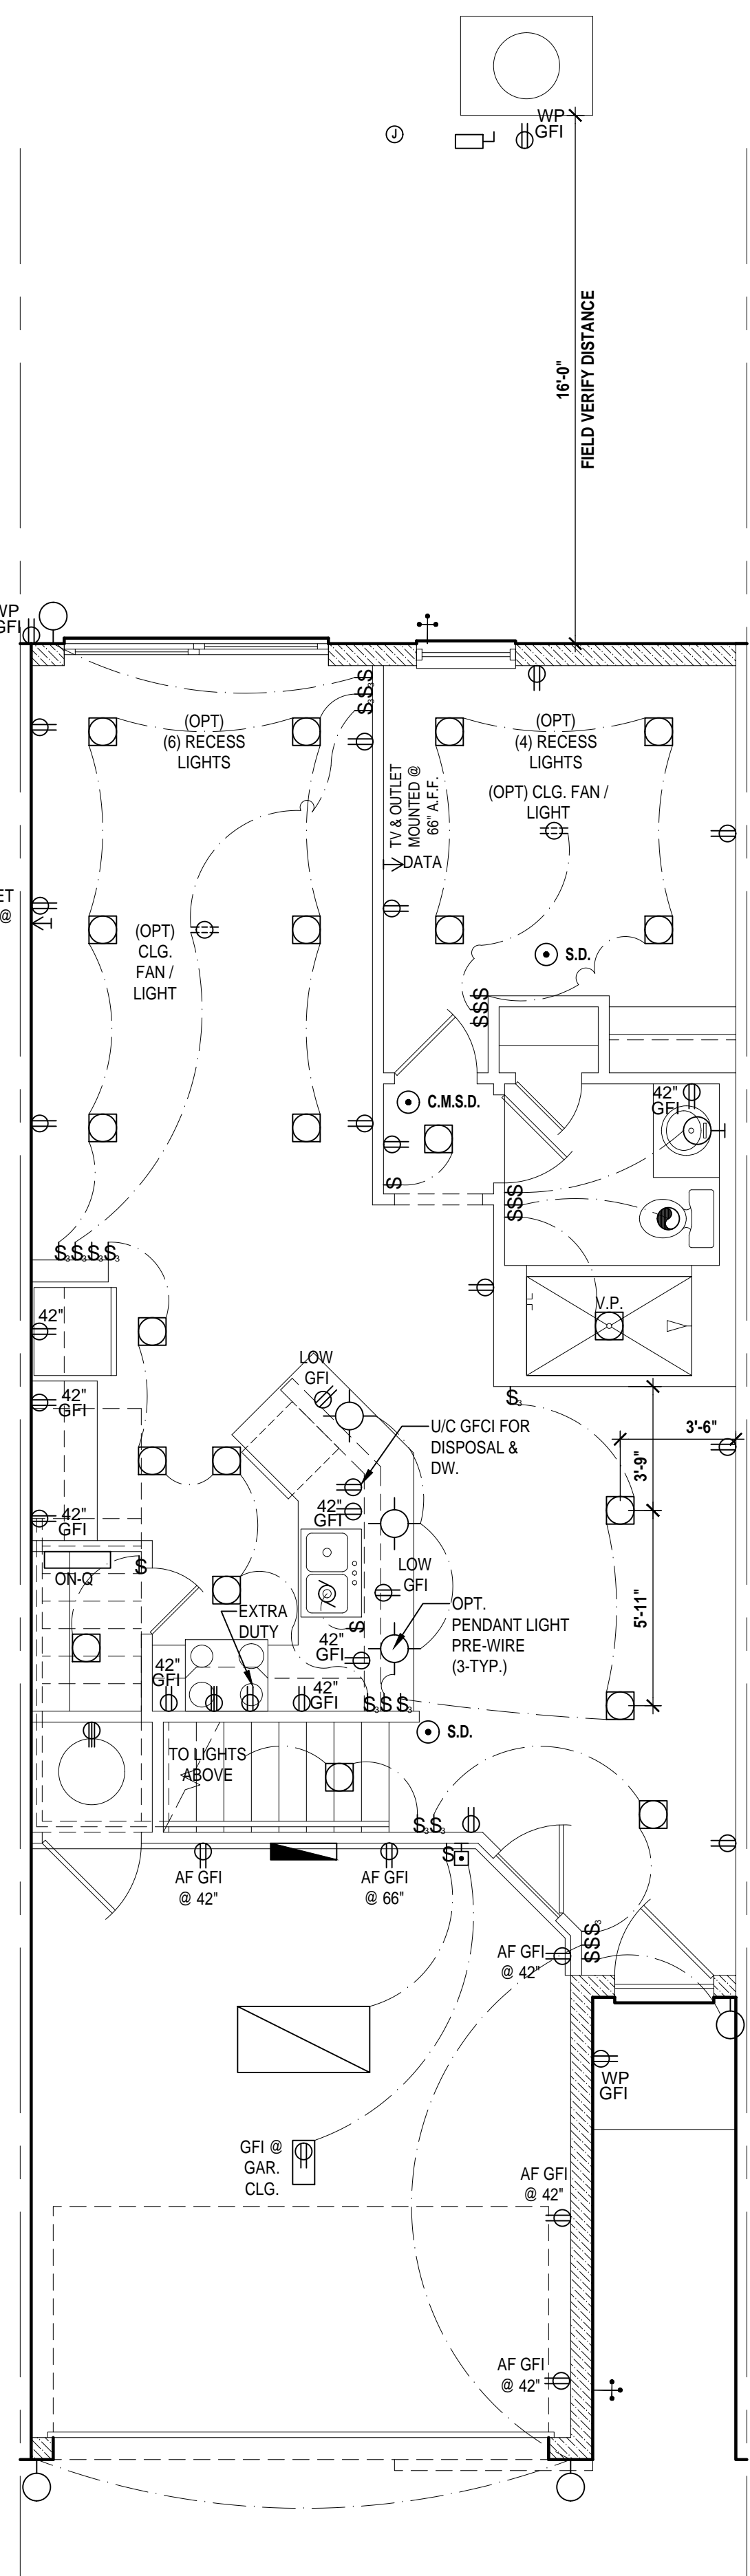

Latitude First Floor - (Rev.)
SCALE: 1/4" = 1'-0"

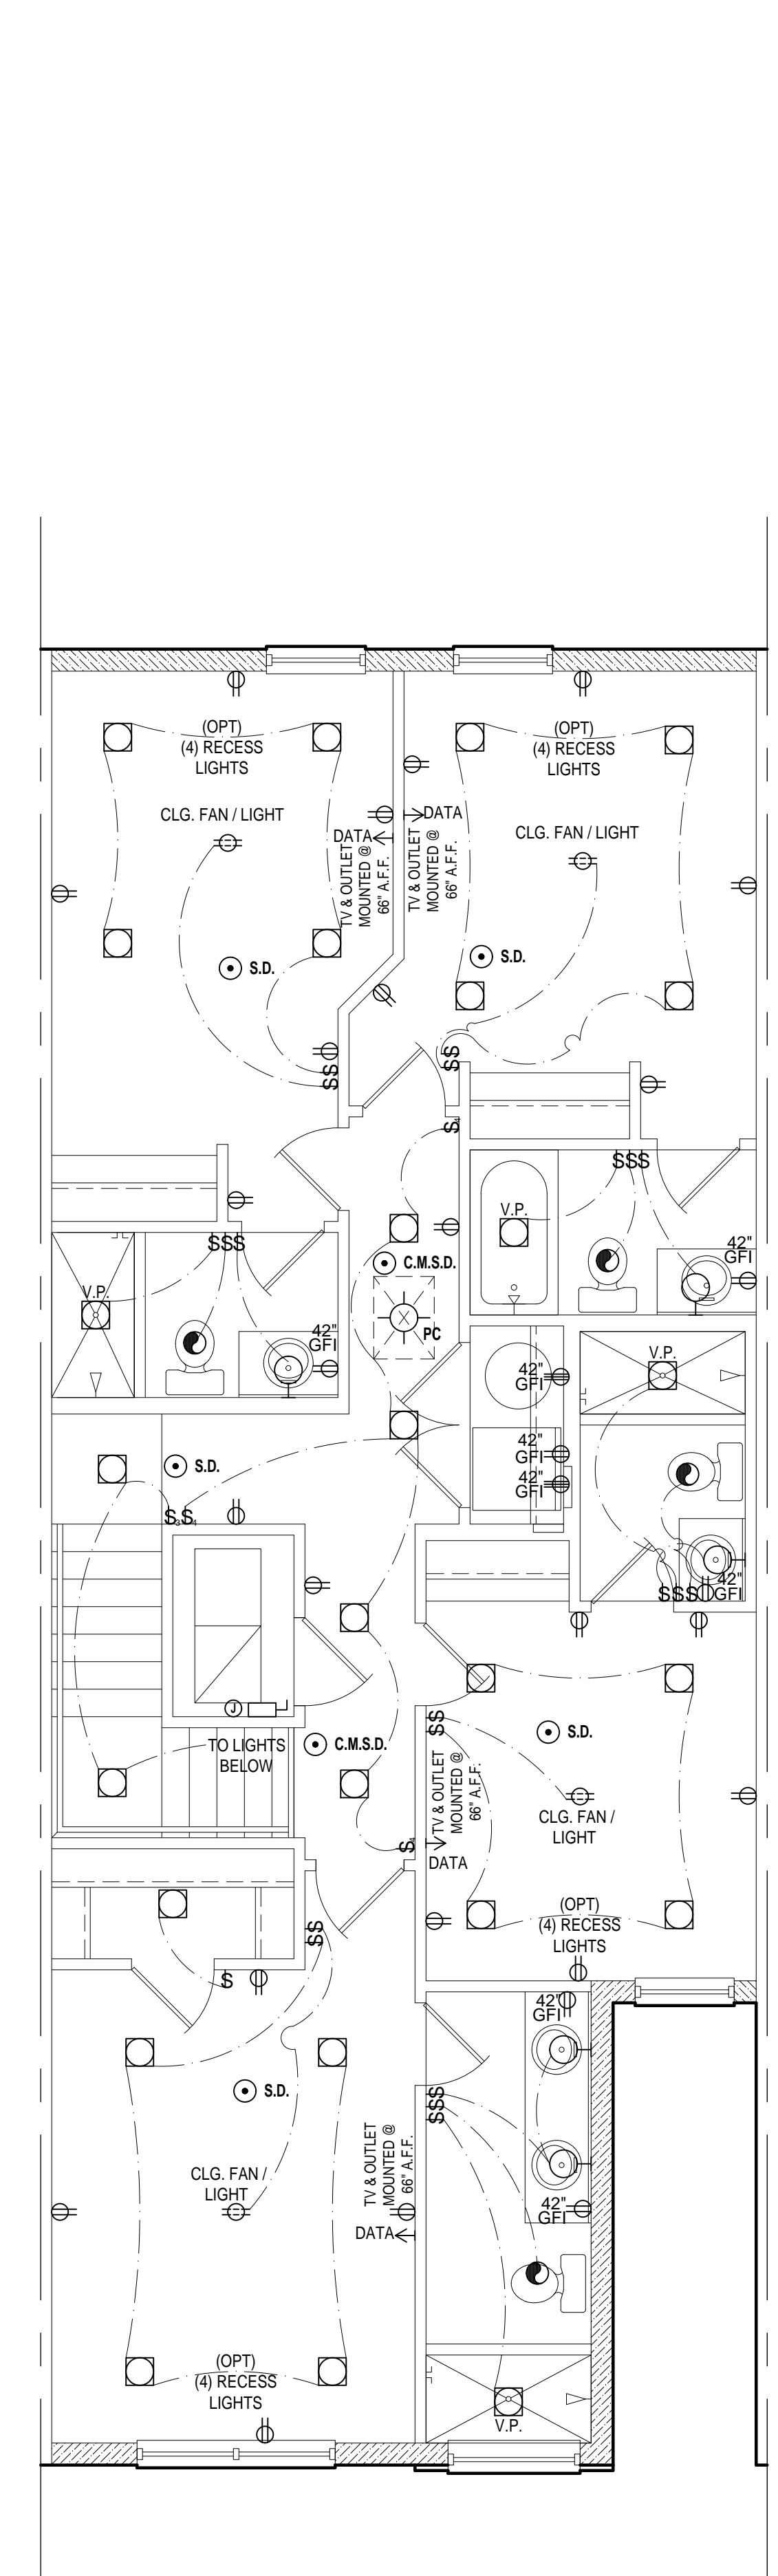

Latitude Second Floor-(Rev.) "Elev. A&B" (Elev. "A" shown)
SCALE: 1/4" = 1'-0"

MJS designs group
residential/commercial/architecture

AI BID
GOBA
GREAT BRANDS BELIEVED

5-Unit: (Paradiso TH)
Models: Nimbus, Latitude
Building Plat #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code


A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE: 04/13/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

Electrical Plan
SCALE: 1/4" = 1'-0"


E2

REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PERMISSION IN WRITING, IS STRICTLY PROHIBITED UNLESS OTHERWISE SPECIFIED.

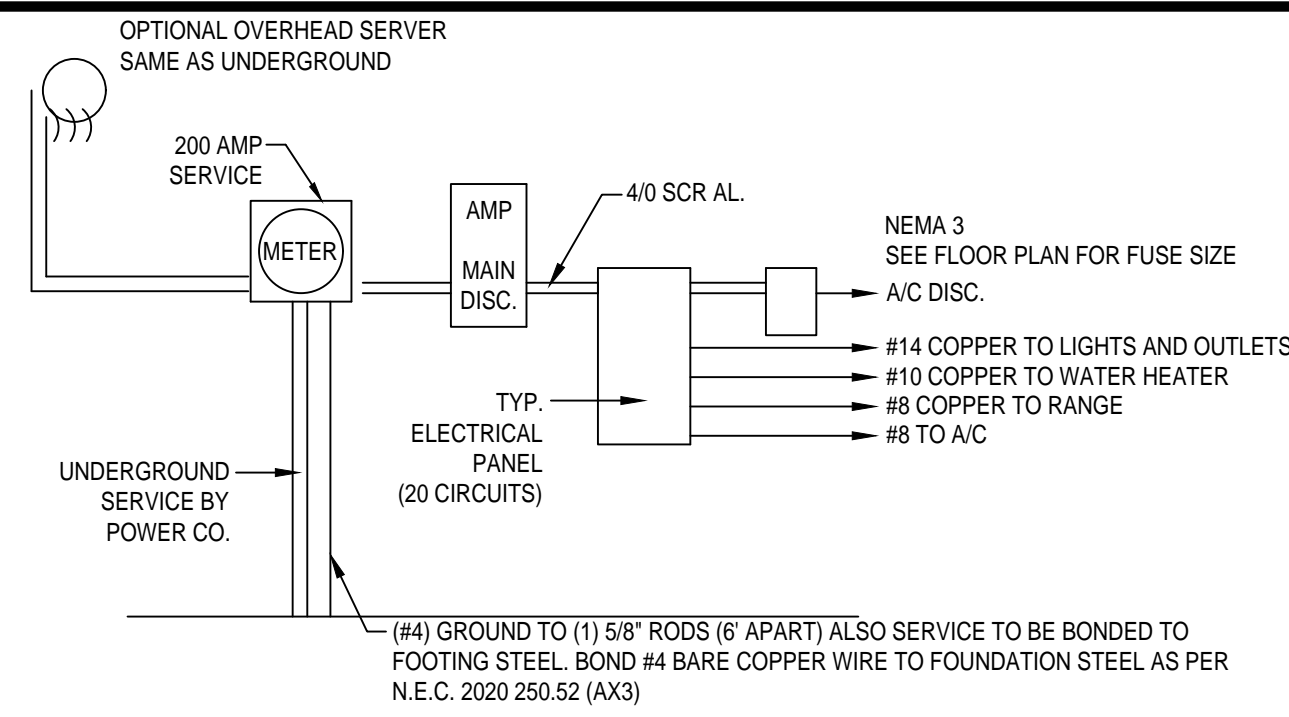

200 AMP ELECTRICAL RISER

Marking	Make/Model	Quantity	Unit Price	Total
2	General Lighting @ 3 watts/sq ft	1900	5700	
2	Small appliance @ 1500 watt	1200	3600	
1	Laundry	1500	1500	
1	Range	8000	8000	
1	Pool	4000	4000	
1	Dishwasher	1200	1200	
1	Disposal	1000	1000	
1	Dryer	8000	8000	
1	Pool Heater	8000	8000	
Sub Total			34800	
Fees 10.00% @ 100%			3480	
Remainder @ 40%			10960	
Air Conditioner Load @ 100%			5280	
Heat Pump @ 85%			5280	
VA 240 Vols + Service Size Amps			29440	
			100 (30000)	

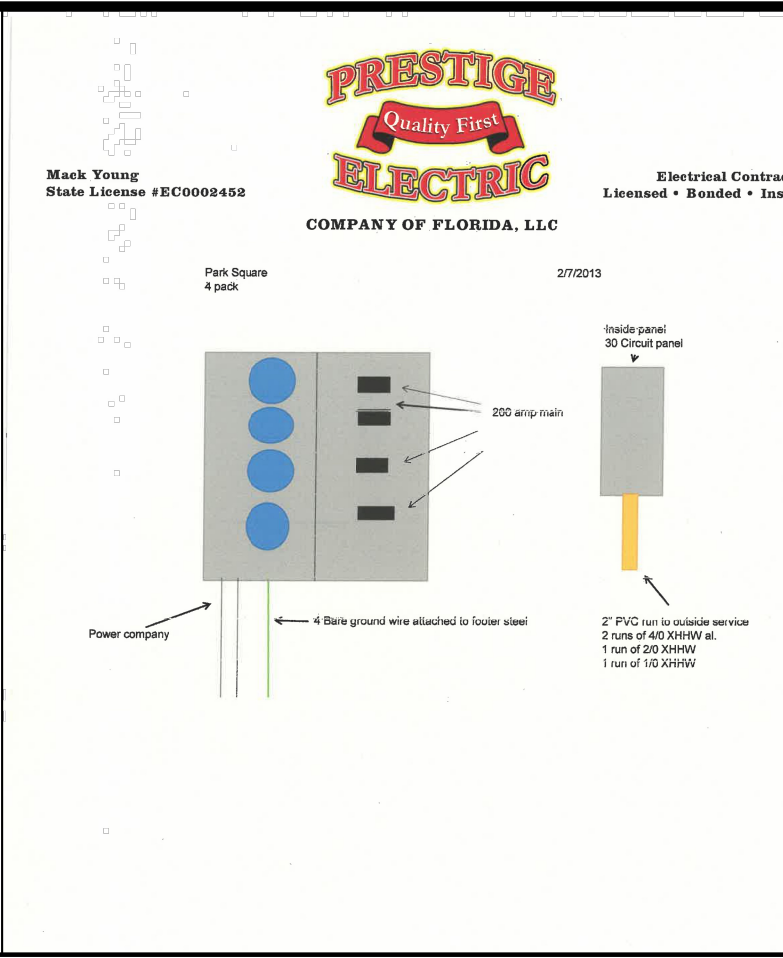

GENERAL NOTES KEY:


- BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
- ALL OUTLETS ARE TO BE AFCI PROTECTED.
- ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
- ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
- ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
- ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
- DW. AND GARAGE DISPOSAL ARE TO BE GFCI PROTECTED.
- EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
- OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
- OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
- ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (J.N.O.).
- ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
- 6'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
- ANY EXTERIOR WALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATIONS SHOULD BE FITTED WITH QUICKFLASH PANELS (OR SIMILAR).
- RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENVELOPE ARE SUBJECT TO THE PROVISIONS OF FBC 402.4.5. FIXTURES SHALL BE IC-RATED (FOR ZERO CLEARANCE INSULATION CONTACT) AND SEALED AIR TIGHT. ALSO SEE FBC 410.116.

NOTES:
THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REINING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
LOCATION OF FIXTURES AND/OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD. ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 8TH EDITION (2023) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.
ELECTRICAL BOXES IN FIRE-RATED WALLS SHALL BE STEEL OR LISTED FIRE-RATED EQUAL AND THE ANNULAR SPACE BETWEEN THE MEMBRANE AND THE BOX SHALL NOT EXCEED 1/8" PER FBC R-302.2. IF THE ANNULAR SPACE EXCEEDS 1/8" FIRE-RATED SEALANT MAY BE USED TO FILL THE GAP.

SMOKE DETECTOR REQUIREMENTS:
ALL SMOKE/CARBON DETECTOR LOCATIONS MUST BE A MINIMUM OF 3' FROM ANY BATHROOM PER FBC-R314.3 (4). THEY MUST ALSO BE LOCATED NO MORE THAN 10' FROM ANY BEDROOM DOOR OPENING PER FBC-R315.1.


ELECTRICAL KEY:

	CEILING MOUNTED LIGHT
	PULL CHAIN LIGHT
	FLUSH-MOUNT LED
	WALL MOUNTED LIGHT
	WALL WASH RECESSED
	DUPLEX RECEPTACLE
	220 V RECEPTACLE
	1/2 HOT, 1/2 SWITCHED
	WATER PROOF RECEPTACLE
	FLOOR RECEPTACLE
	PRE-WIRE FOR CLG. FAN
	GROUND FAULT INTERRUPT
	WALL SWITCH
	3-WAY SWITCH
	DIMMER SWITCH
	TELEPHONE JACK
	CABLE JACK
	PRE-WIRE GARAGE DOOR OPENER
	FLUORESCENT LIGHT
	ELECTRICAL PANEL
	CHIME
	DOOR BELL / GARAGE DOOR SWITCH
	DISCONNECT SWITCH
	ELECTRICAL METER
	S.M.O.K.E. DETECTOR
	C.A.R.B.O.N M.O.N.O.X.I.D.E. / S.M.O.K.E. DETECTOR
	CEILING FAN
	WALL SCONCE
	CHANDELIER
	SPOT LIGHT
	FLUSH MOUNT FLUORESCENT LIGHT
	FAN / LIGHT COMBINATION
	GARBAGE DISPOSAL MOTOR
	SPEAKER
	JUNCTION BOX
	LOW VOLTAGE
	VAPOR PROOF
	ARC FAULT PROTECTION
	INTERCOM

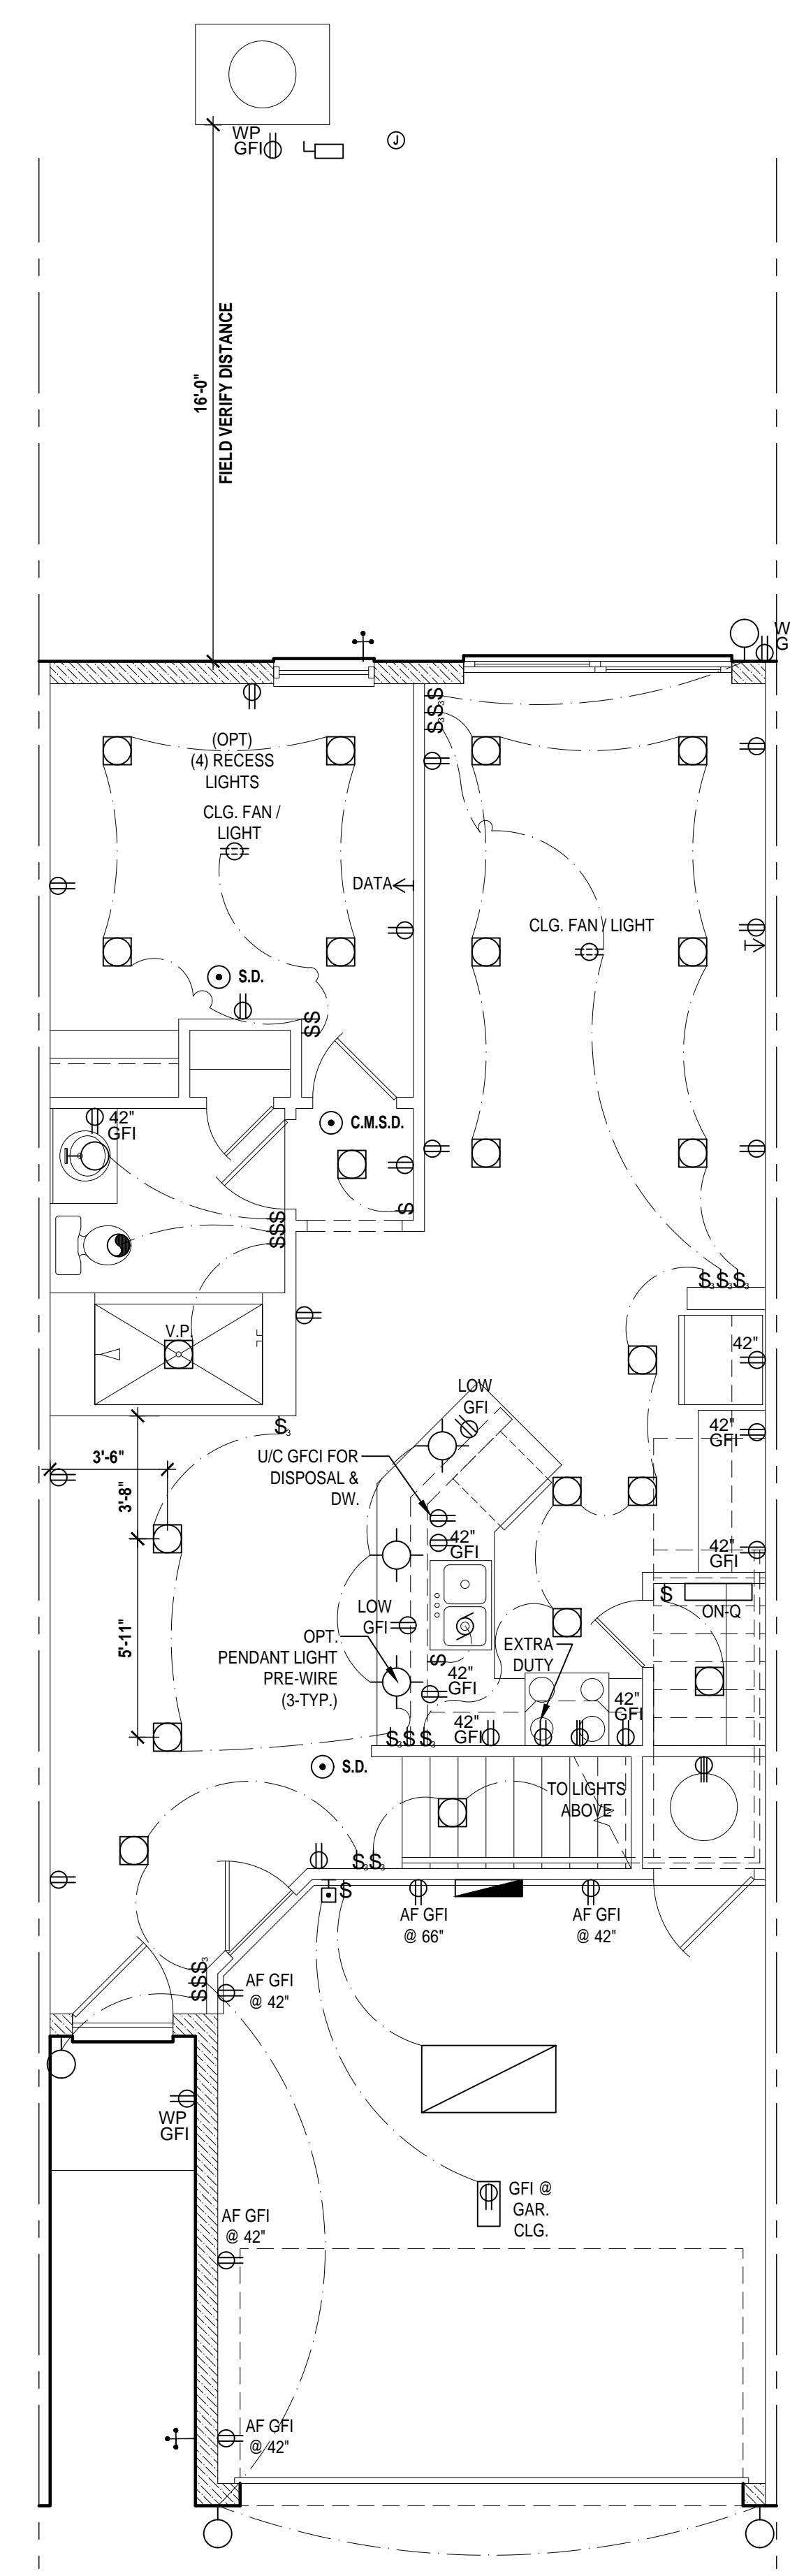


Latitude II First Floor

SCALE: 1/4" = 1'-0"

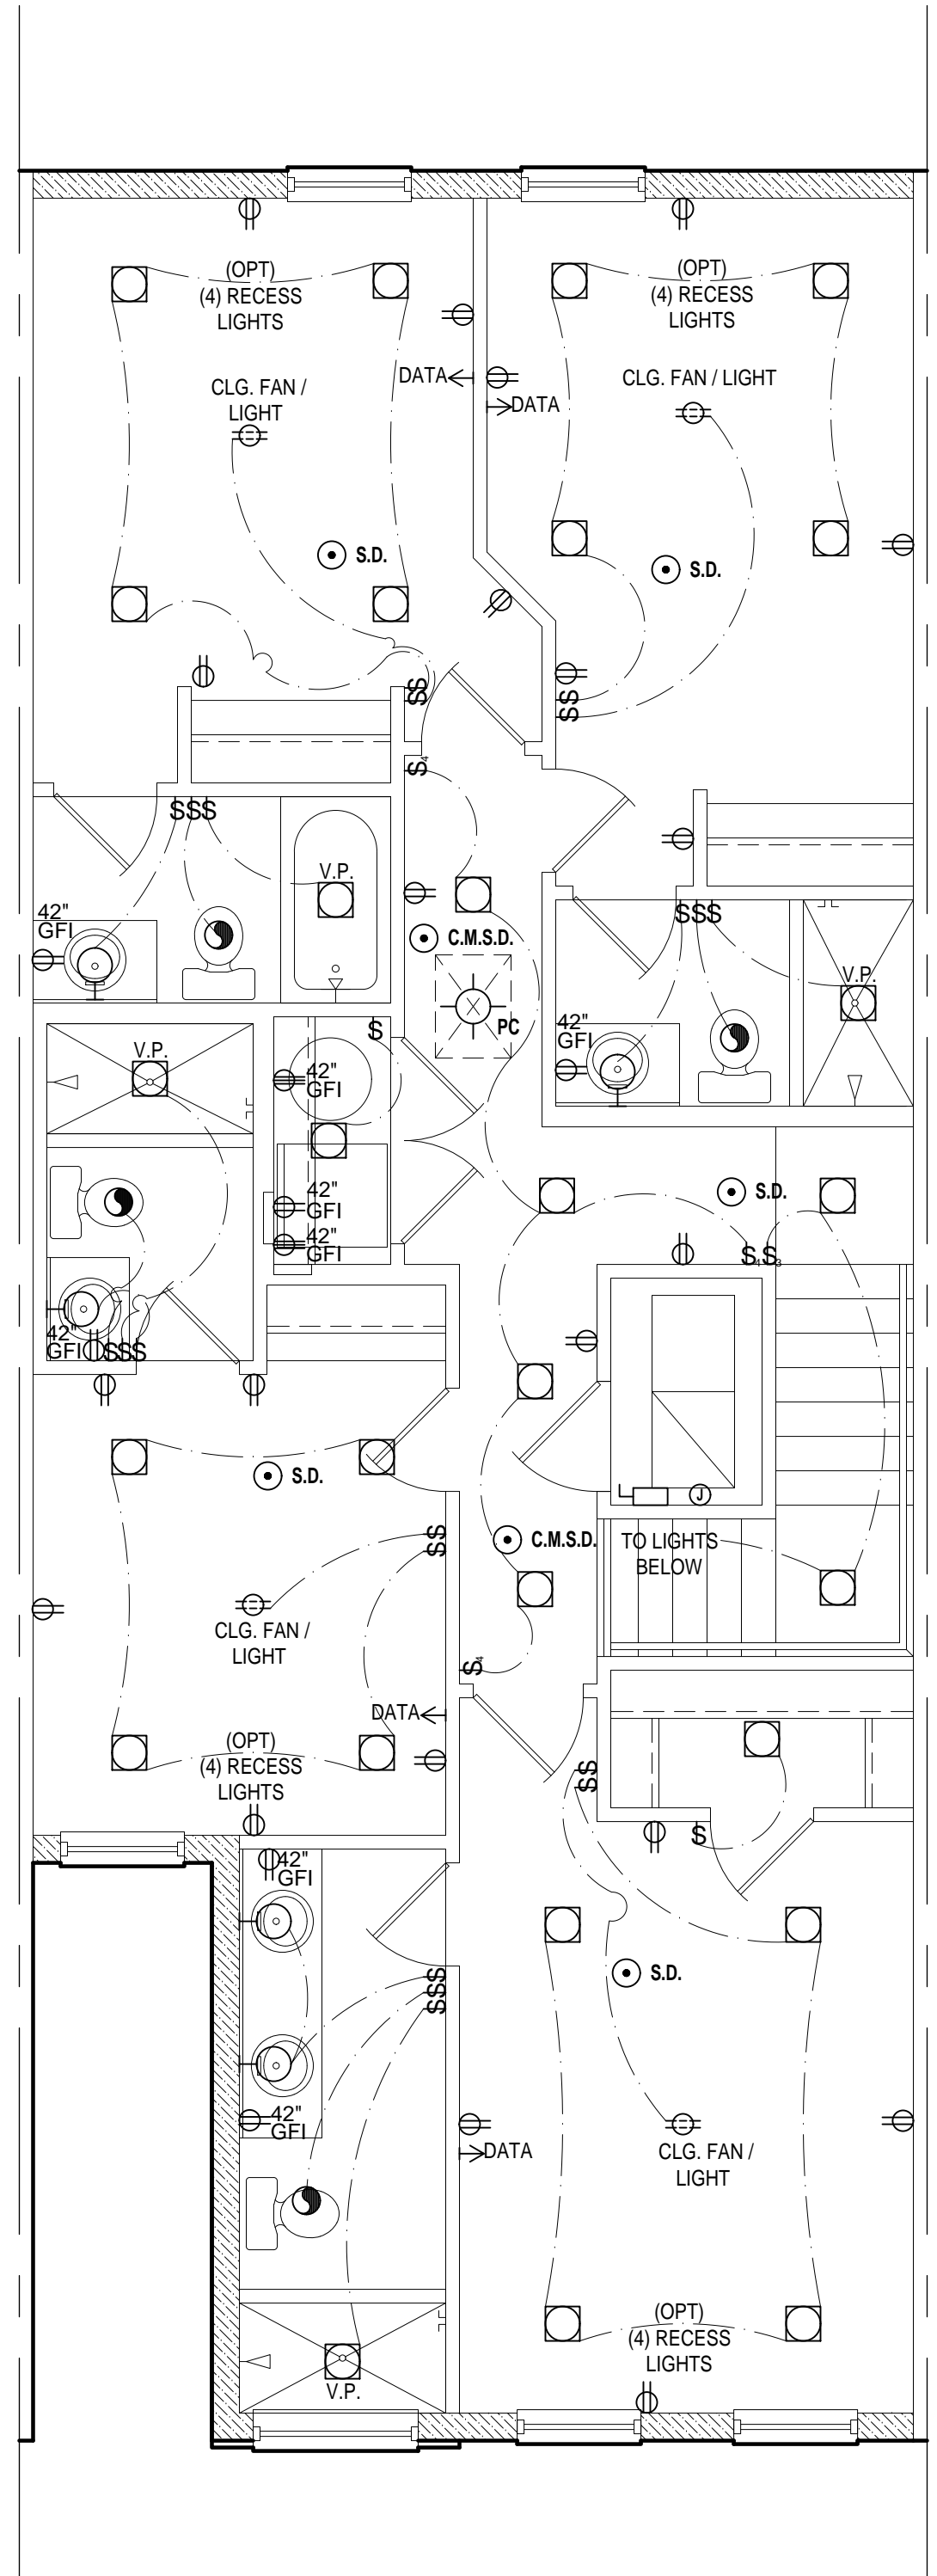


Latitude II Second Floor "Elev. A&B" (Elev. "A" shown)

SCALE: 1/4" = 1'-0"

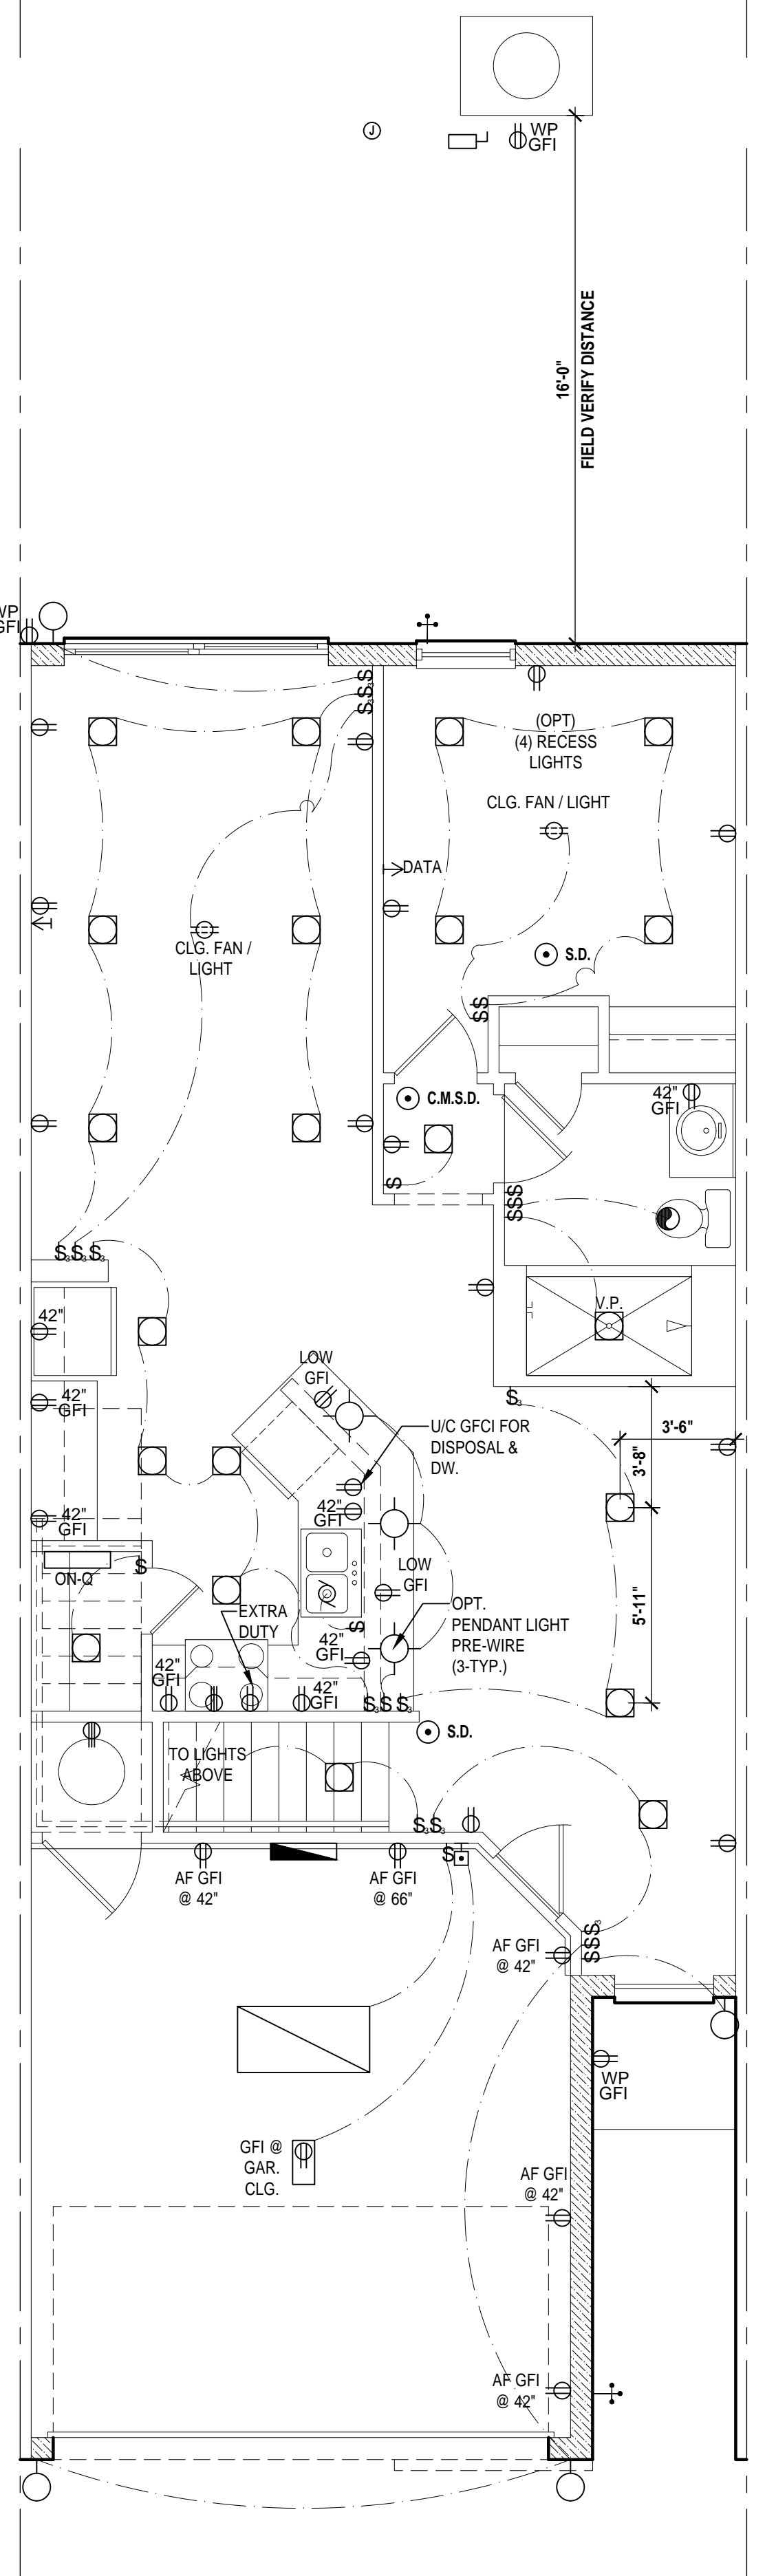

Latitude II First Floor - (Rev.)

SCALE: 1/4" = 1'-0"

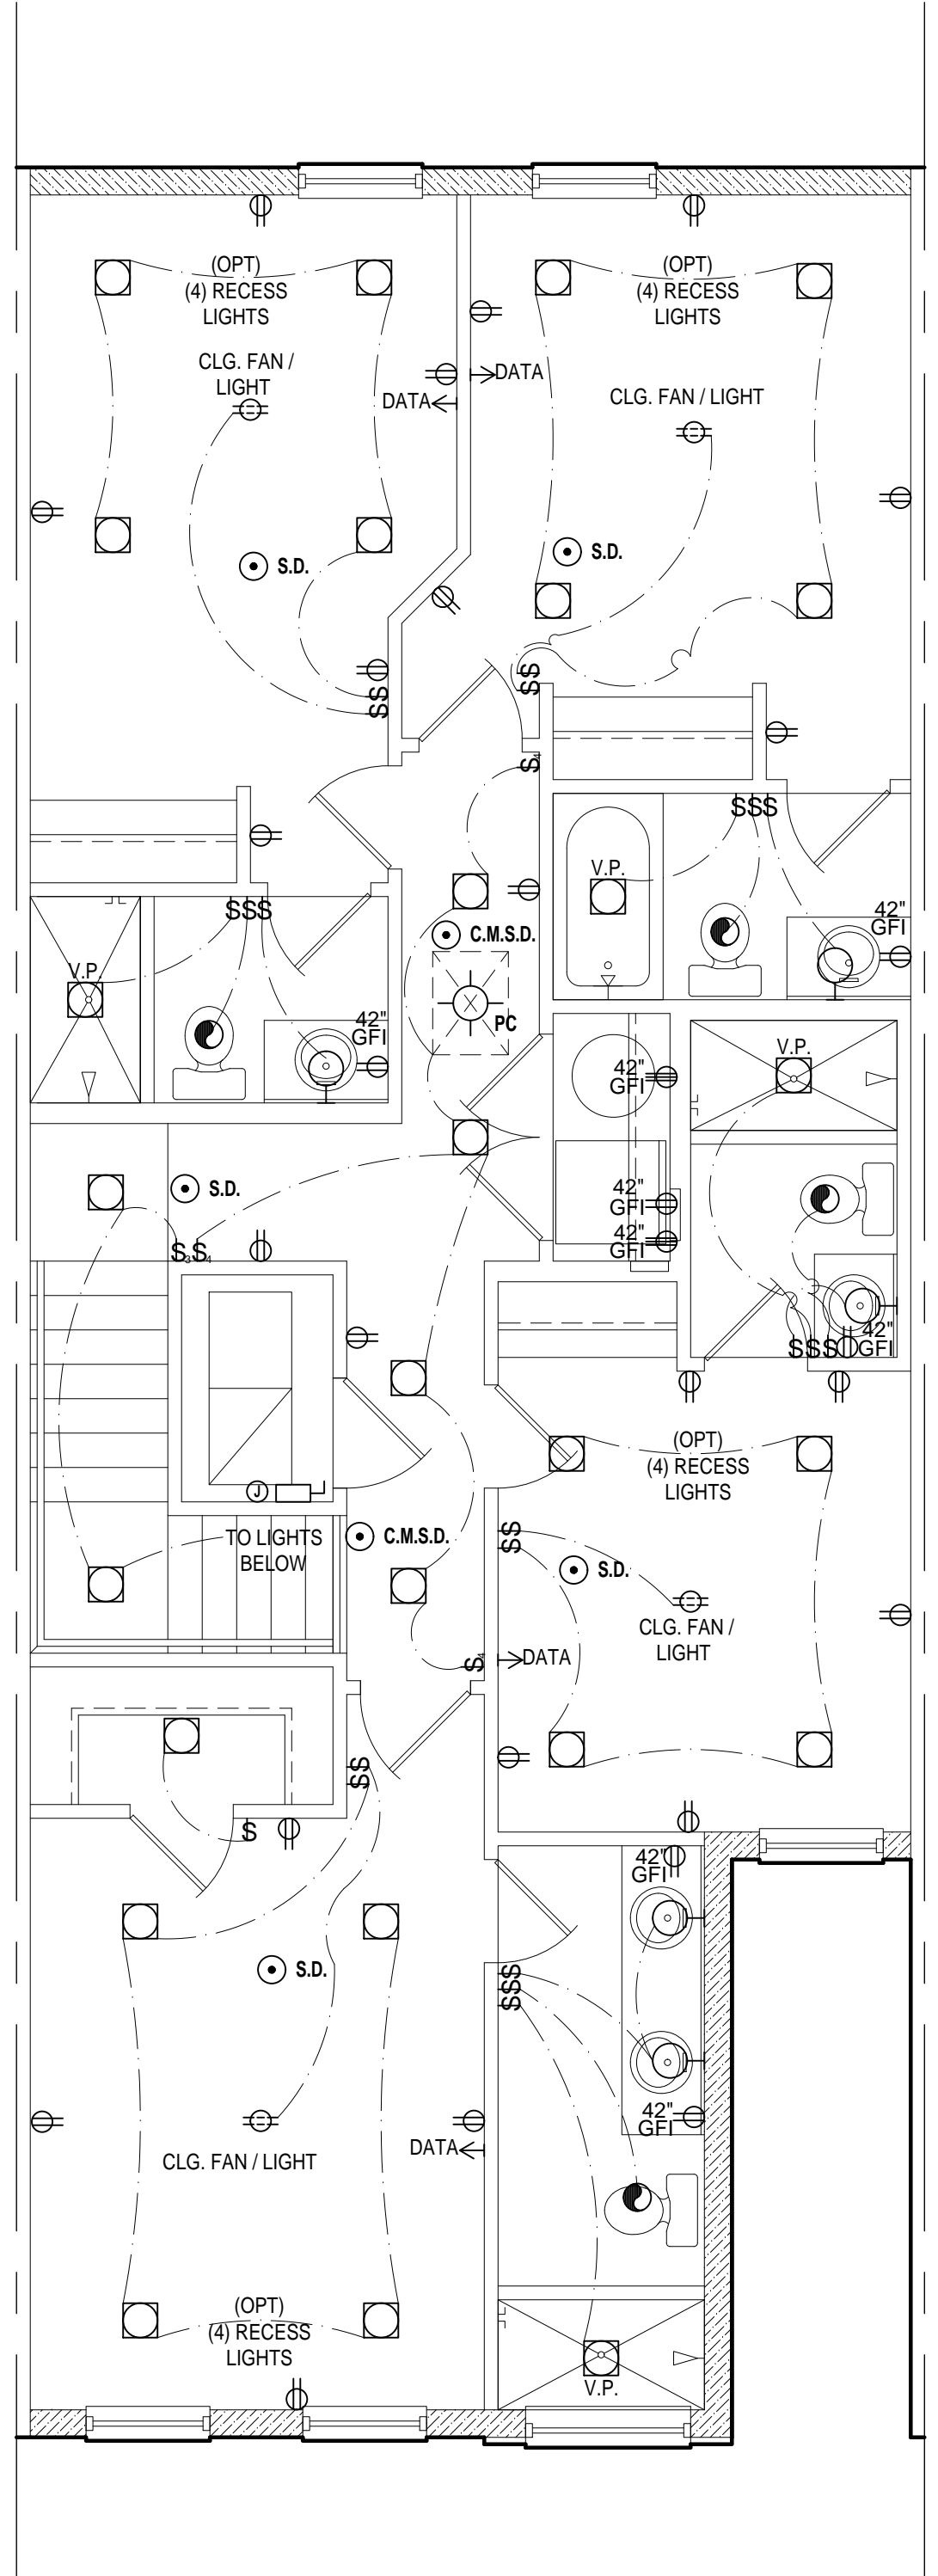

Latitude II Second Floor - (Rev.) "Elev. A&B" (Elev. "A" shown)

SCALE: 1/4" = 1'-0"

THOMPSON ENGINEERING GROUP, INC.
401 Vineland Road Suite #6 Orlando, FL 32811
Ph: (407) 629-6711
Fax: (407) 734-1750
www.thompsoneng.com

MJS design group
residential/commercial/architecture

AIBD

GOBA
GREAT BRANDS BELIEVED

5-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Plat #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000


Park Square HOMES

ISSUE DATE: 04/13/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

Electrical Plan
SCALE: 1/4" = 1'-0"

E3

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR DIMENSIONS AND CONDITIONS OF THE JOB AND MJS, INC. MUST BE NOTIFIED IN WRITING OF ANY CHANGES TO THE DIMENSIONS, CONDITIONS AND SPECIFICATIONS APPEARING ON THESE PLANS.

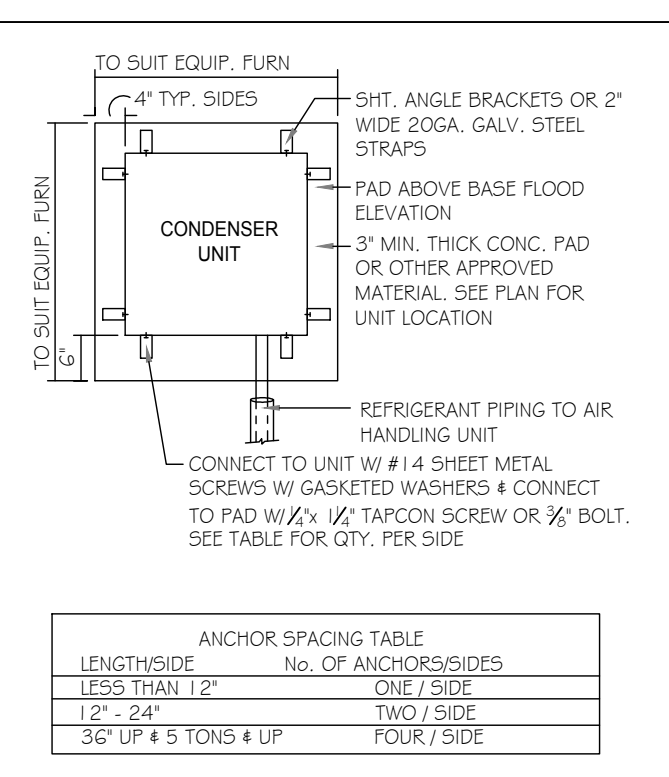

1 COND. ANCHOR DETAIL
N.T.S.

FOUNDATION NOTES


- CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
- ① DENOTES FILL CELL REIN. W/ CONC. W/ (1) #5 REBAR, GRADE 60. 5/8\"/>
- ② DENOTES FILL CELL REIN. W/ CONC. W/ (2) #5 REBAR, GRADE 60. ELEVATION
- ③ DENOTES FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4\"/>
- DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
- WATER HEATER TWP RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR. WATER HEATER AT OR ABOVE FLOOR LEVEL. G1 FALL IN R/A FAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE APPROVED THERMAL EXPANSION DEVICE.
- PAVERS MAY BE USED ILO CONCRETE SLABS IN PATIO, PORCH, DRIVE AND WALKWAY AREAS. DELETE SLAB IN AREAS PAVERS ARE USED.
- MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
- IN LIEU OF TREATING THE SOIL, AN ALTERNATIVE TO TREATMENT SOIL CAN BE PROVIDED 75 MP TERRAZZO.
- SOMA-CARE TO BE APPLIED ON INTERIOR WALLS W/ MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS, PURSUANT FLORIDA BUILDING CODE LATEST EDITION.
- WOOD STAIRS STRINGERS IN CONTACT WITH CONCRETE SHALL BE PROTECTED BY AN IMPERVIOUS MOISTURE BARRIER OR SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD PER IRC K3.1.1.

FIELD REPAIR NOTES

- MISSED FOOTING DOWELS MAY BE SUBSTITUTED W/ A STRAIGHT #5 REBAR SET IN A 3/4\"/>
- BLOCK WALL OVERHANGING SLAB CONDITION: UP TO 7/8\"/>
- PENETRATION OF PLUMBING PIPES OR VENTS THRU PLATES OF A LOAD BEARING WALL MAY OCCUR PROVIDED DBL. STUDS ARE ADDED ON EITHER SIDE OF PENETRATION WITHIN 3\"/>

VERIFICATION OF FIELD CONDITIONS:

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS RELATIVE TO SAME. WHERE THERE ARE CONFLICTS BETWEEN ACTUAL FIELD CONDITIONS AND DATA PRESENTED IN THE DRAWINGS, SUCH CONDITIONS SHALL BE CALLED TO THE ARCHITECTS AND OR TO THE ENGINEER OF RECORDS (EOR) ATTENTION AND NECESSARY ADJUSTMENTS MADE PER THEIR INSTRUCTIONS.

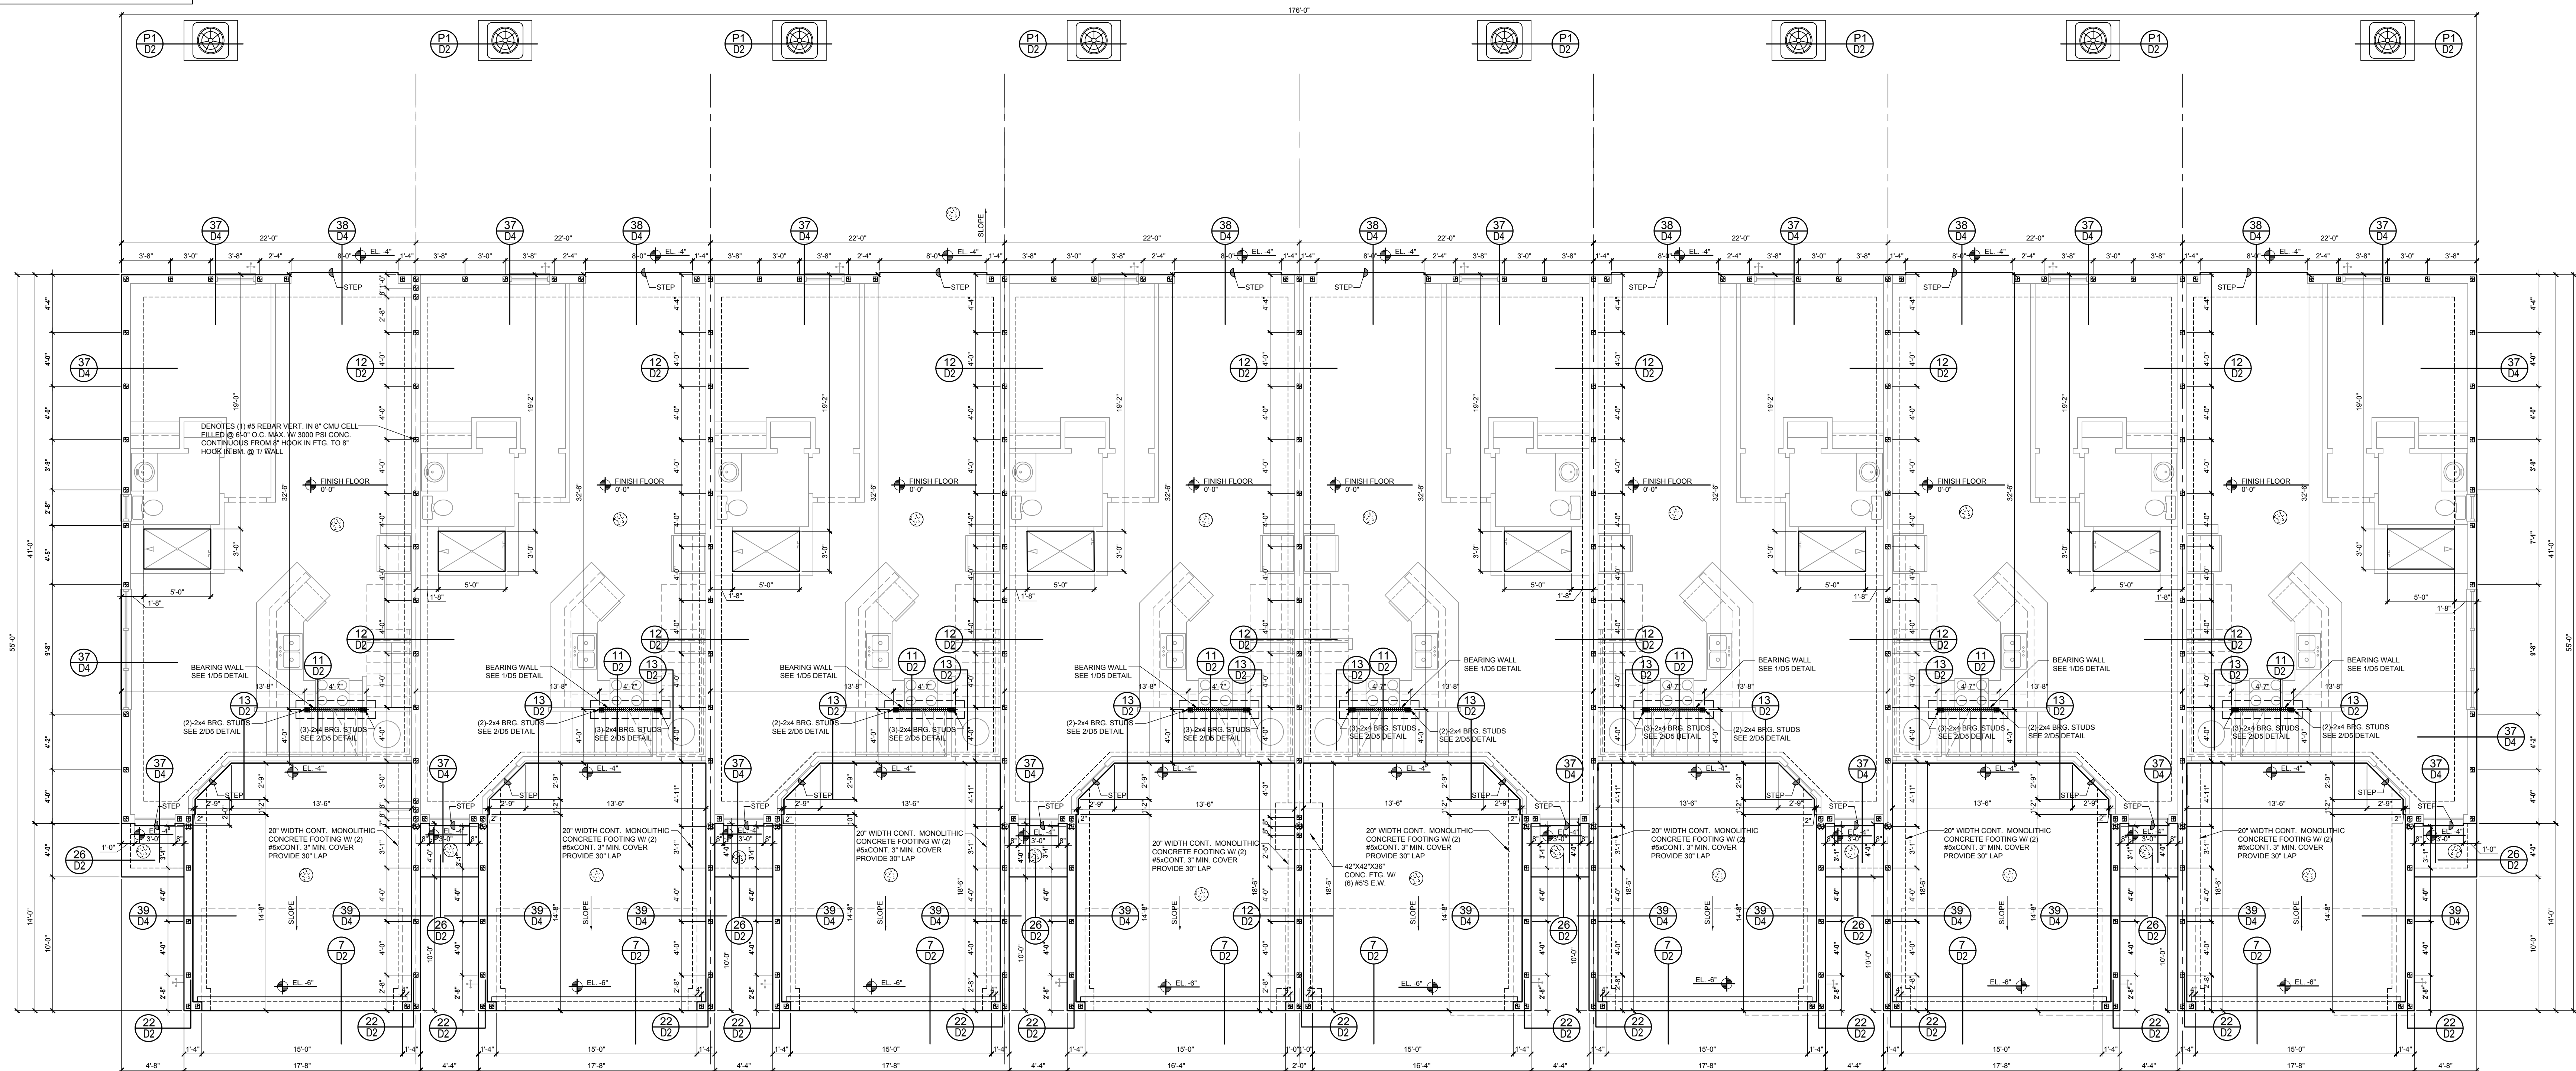

Nautilus LOT# XX Latitude II LOT# XX Latitude II LOT# XX Latitude LOT# XX Latitude (Rev.) LOT# XX Latitude II (Rev.) LOT# XX Latitude II (Rev.) LOT# XX Nautilus (Rev.) LOT# XX

Foundation Plan
SCALE 3/16" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vineland Road Suite A6 Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1150
www.iteg.com

MJS
designers group
residential-commercial-architecture

AIBD

GOBA
GROUP OF ARCHITECTS ASSOCIATES

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pad # XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES
ISSUE DATE: 03/06/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS
FOUNDATION PLAN
S1

FOUNDATION NOTES

- CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
- DENOTES HELICAL ANCHORS.
- PROVIDE HELICAL ANCHORS AS SPECIFIED TO MEET A MINIMUM CAPACITY OF 35 KIPS ALLOWABLE COMPRESSION PER HELICAL ANCHOR.
- FLOOR SLAB 4 GRADE BEAM OF PLANT MIX CONCRETE 3000 P.S.I.
- DO NOT SCALE PRINTS CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
- COORDINATE STRUCTURAL AND OTHER DRAWINGS THAT ARE PART OF THE CONTRACT DOCUMENTS FOR ANCHORED, EMBEDDED, OR SUPPORTED ITEMS WHICH AFFECT THE STRUCTURAL DRAWINGS.
- NO STRUCTURAL MEMBER SHALL BE CUT, NOTCHED OR OTHERWISE REDUCED IN SIZE OR STRENGTH WITHOUT PRIOR APPROVAL IN WRITING FROM STRUCTURAL ENGINEER.

NOTE:

THE DEVELOPER TO RETAIN GEOTECHNICAL ENGINEER TO PROVIDE INSPECTION SERVICES DURING THE SIDE PREPARATION PROCEDURES FOR CONFIRMATIONS OF THE ADEQUACY OF THE EARTHWORK OPERATIONS. FIELD TESTS AND OBSERVATIONS INCLUDE VERIFICATION OF FOUNDATION SUBGRADE BY MONITORING EARTHWORK OPERATIONS AND PERFORMING QUALITY ASSURANCE TESTS OF THE PLACEMENT OF COMPACTED STRUCTURAL FILL COURSES.


IN-PLACE DENSITY TESTS SHALL BE PERFORMED WITHIN TWO FEET OF THE BOTTOM OF ALL FOUNDATIONS AND IN EACH LIFT OF STRUCTURAL FILL TO VERIFY PROPER COMPACTION OF THE SUBGRADE SOILS.

THE MINIMUM ALLOWABLE NET SOIL BEARING PRESSURE SHALL BE 1,500 PSF.

VERIFICATION OF FIELD CONDITIONS:

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS RELATIVE TO SAME. WHERE THERE ARE CONFLICTS BETWEEN ACTUAL FIELD CONDITIONS AND DATA PRESENTED IN THE DRAWINGS, SUCH CONDITIONS SHALL BE CALLED TO THE ARCHITECTS AND OR TO THE ENGINEER OF RECORDS SOON AFTER ATTENTION AND NECESSARY ADJUSTMENTS MADE PER THEIR INSTRUCTIONS.

HELICAL PILE TOWNHOMES --- 214
 HELICAL PILE POOLS ----- 82
 TOTAL HELICAL PILES ----- 296

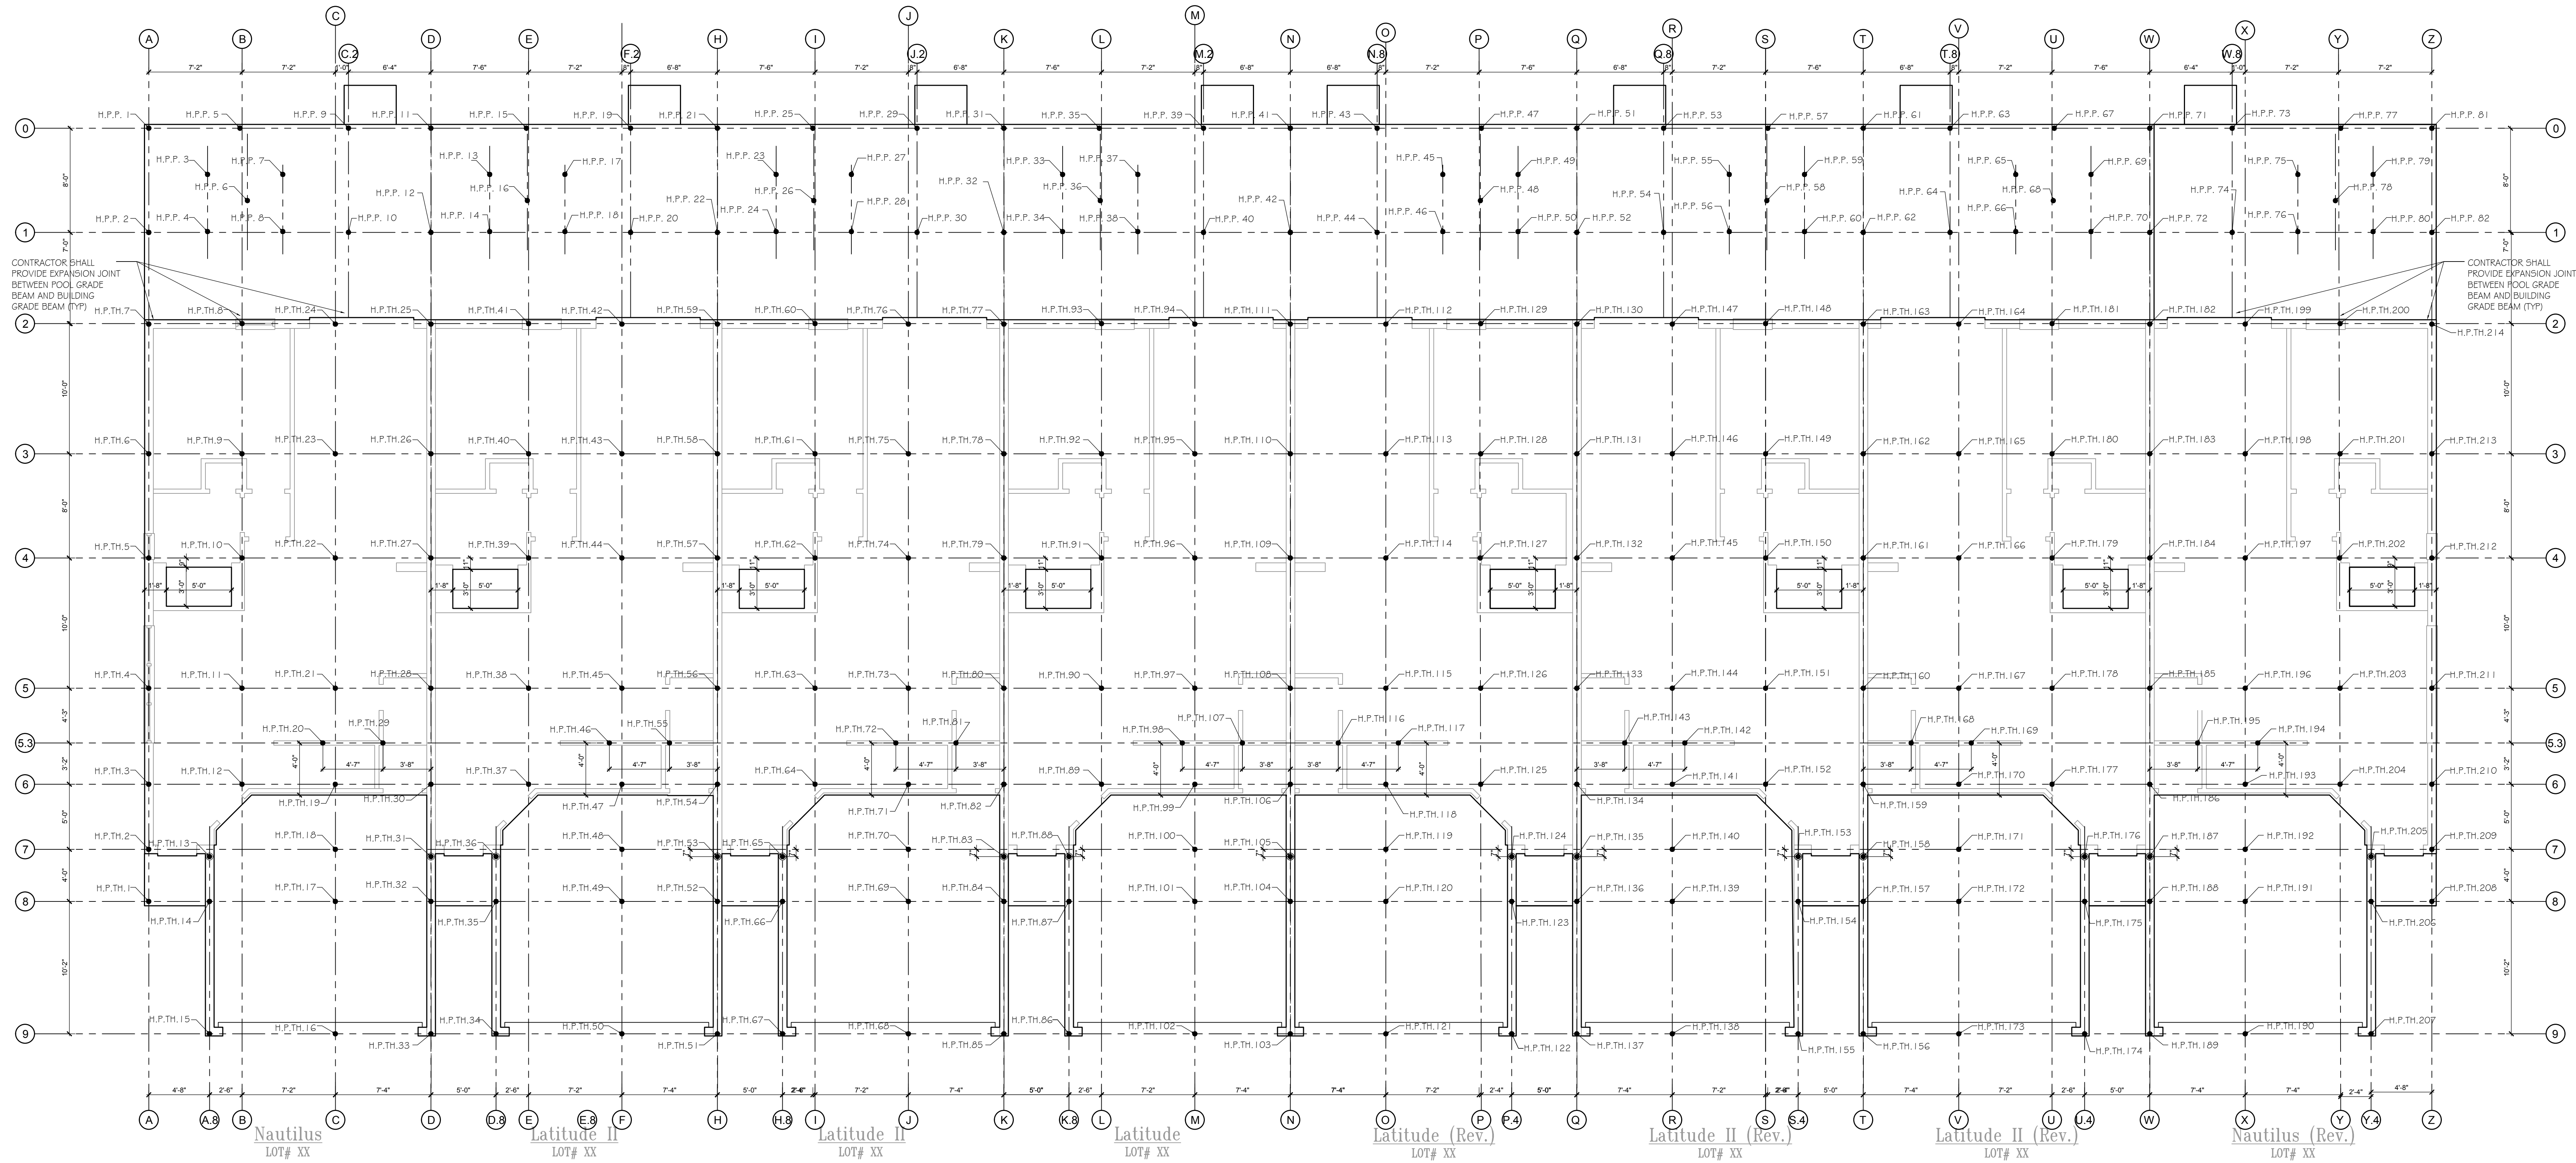


Pile Number Location

SCALE 1/4" = 1'-0"

NOTE:
 WORK THIS SHEET WITH FOUNDATION PLAN (GRADE BEAM)



815 Oriente Ave., Suite #1040
 Altamonte Springs, FL 32701
 Ph: (407) 629-6711
 Fax: (407) 629-6776
 www.mjsdesignsgroup.com

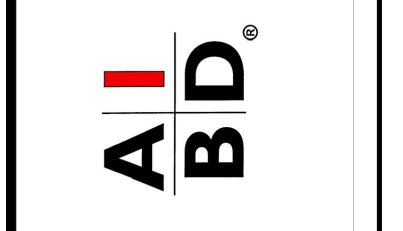

8-Unit: (Paradiso TH)
 Models: Nautilus, Latitude
 Building Pad #XX
 Lot# XX-XX, Subdivision
 Street Address
 City, State, Zip Code


A division of Park Square Enterprises Inc.
 5200 Vineland Rd., Suite #200
 Orlando, FL 32811
 Phone: (407) 529-3000



ISSUE DATE	03/06/2023
REVISIONS	

PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS

FOUNDATION PLAN
S1.0

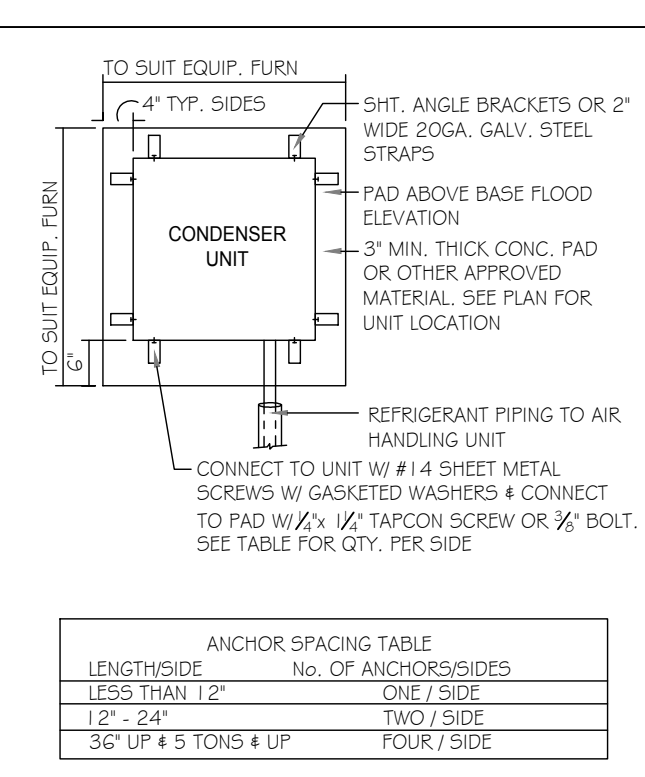

- FOUNDATION NOTES**
- CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
 - DENOTES HELICAL ANCHORS.
 - PROVIDE HELICAL ANCHORS AS SPECIFIED TO MEET A MINIMUM CAPACITY OF 35 KIPS ALLOWABLE COMPRESSION PER HELICAL ANCHOR.
 - FLOOR SLAB & GRADE BEAM OF PLANT MIX CONCRETE 3000 P.S.I.
 - DO NOT SCALE PRINTS CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 - COORDINATE STRUCTURAL AND OTHER DRAWINGS THAT ARE PART OF THE CONTRACT DOCUMENTS FOR ANCHORS, EMBEDDED OR SUPPORTED ITEMS WHICH AFFECT THE STRUCTURAL DRAWINGS.
 - NO STRUCTURAL MEMBER SHALL BE CUT, NOTCHED OR OTHERWISE REDUCED IN SIZE OR STRENGTH WITHOUT PRIOR APPROVAL IN WRITING FROM STRUCTURAL ENGINEER.

VERIFICATION OF FIELD CONDITIONS:


CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS RELATIVE TO SAME. WHERE THERE ARE CONFLICTS BETWEEN ACTUAL FIELD CONDITIONS AND DATA PRESENTED IN THE DRAWINGS, SUCH CONDITIONS SHALL BE CALLED TO THE ARCHITECT'S AND/OR TO THE ENGINEER OF RECORD'S BEST ATTENTION AND NECESSARY ADJUSTMENTS MADE PER THEIR INSTRUCTIONS.

- 1 COND. ANCHOR DETAIL**
N.T.S.
- FIELD REPAIR NOTES**
- MISSED FOOTING DOWELS MAY BE SUBSTITUTED W/ A STRAIGHT #3 REBAR SET IN A 3/4" DIA. x 4" DEEP HOLE FILLED W/ UNITE PROXY 300 OR SIMILAR SET OR CIP CONCRETE.
 - BLOCK WALL OVERHANGING SLAB CONDITION UP TO 7/8" - NO REPAIR NECESSARY 7/8" TO 1 1/4" - ADD FILLED CELL (NO VERTICAL STEEL) MIDPOINT OF WALL BETWEEN EXISTING FILLED CELLS WITH STEEL IN AREAS AFFECTED. 1 1/4" - REQUIRE SPECIAL ENGINEERING LETTER.
 - PENETRATION OF PLUMBING PIPES/DRIVER VENTS THRU PLATES OF A LOAD BEARING WALL MAY OCCUR PROVIDED DBL STUDS ARE ADDED ON EITHER SIDE OF PENETRATION WITHIN 3' AND TRUSS/FLOOR TRUSS IS NO CLOSER THAN 3' FROM PENETRATION. ADD 1" W/ 1/2" @ TOP AND BOTTOM PLATE.

NOTE:
THE DEVELOPER TO RETAIN GEOTECHNICAL ENGINEER TO PROVIDE INSPECTION SERVICES DURING THE SOIL PREPARATION PROCEDURES FOR CONFIRMATIONS OF THE ADEQUACY OF THE EARTHWORK OPERATIONS. FIELD TESTS AND OBSERVATIONS INCLUDE VERIFICATION OF FOUNDATION SUBGRADE BY MONITORING EARTHWORK OPERATIONS AND PERFORMING QUALITY ASSURANCE TESTS OF THE PLACEMENT OF COMPACTED STRUCTURAL FILL COURSES.

IN-PLACE DENSITY TESTS SHALL BE PERFORMED WITHIN TWO FEET OF THE BOTTOM OF ALL FOUNDATIONS AND IN EACH LIFT OF STRUCTURAL FILL TO VERIFY PROPER COMPACTION OF THE SUBGRADE SOILS.

THE MINIMUM ALLOWABLE NET SOIL BEARING PRESSURE SHALL BE 1,500 PSF.

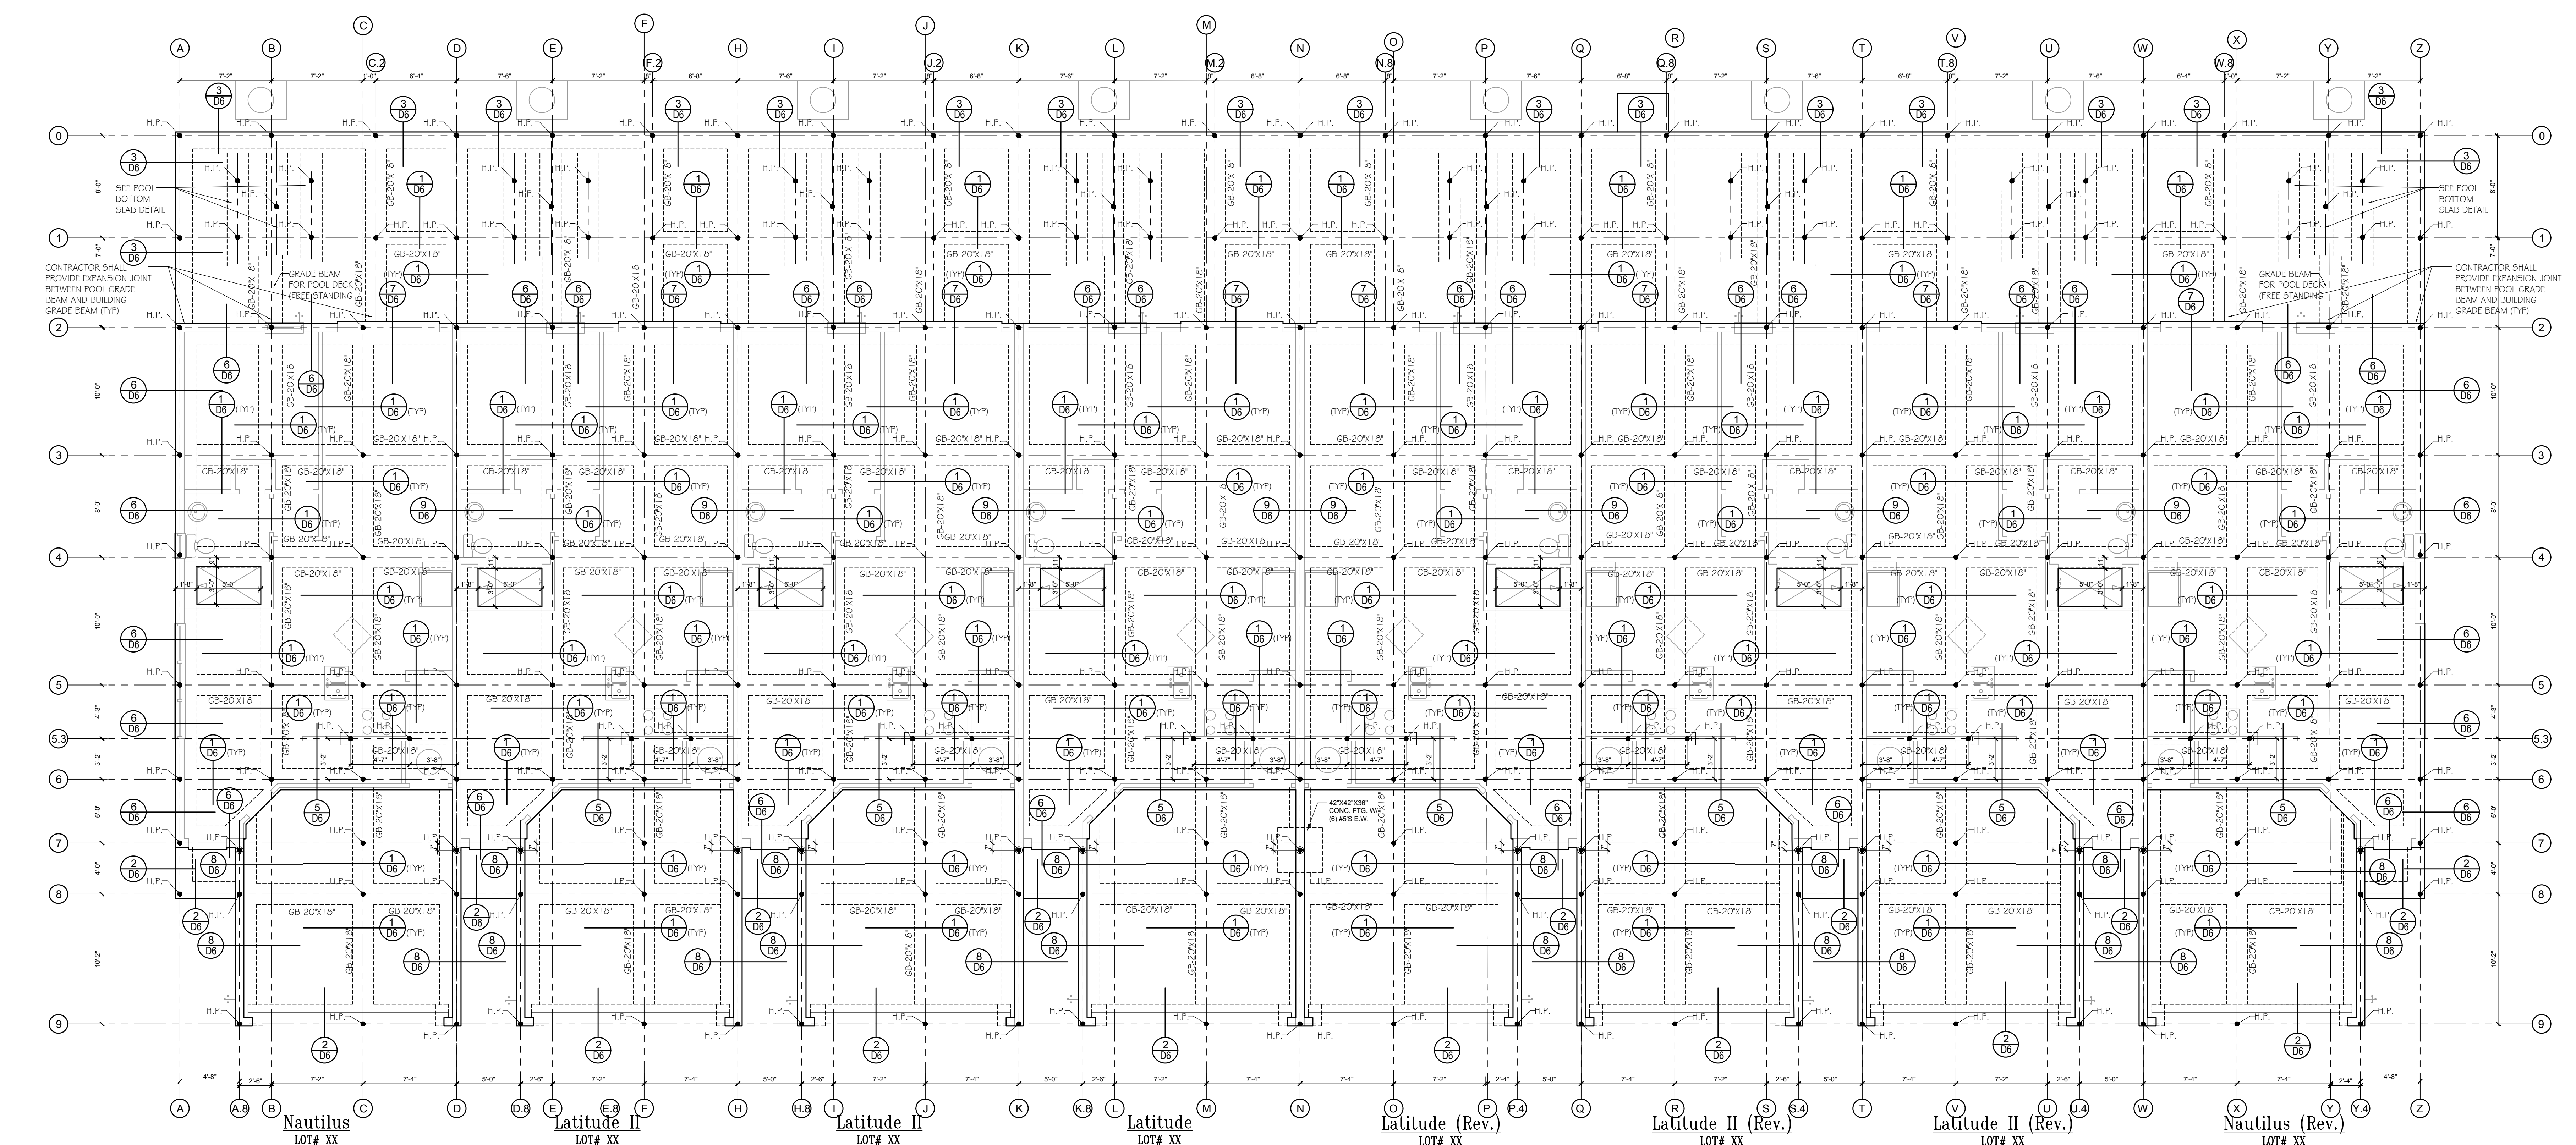

NOTE:
WORK THIS SHEET WITH FOUNDATION PLAN (DOWEL PLAN)

Foundation Plan
SCALE 3/16" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
400 Vineland Road Suite A4 Orlando, FL 32811
Ph: (407) 704-1450
Fax: (407) 704-1150
www.iteg.com

815 Oriens Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignsgroup.com
COPYRIGHT NOTICE: THESE PLANS, DESIGNS, AND SPECIFICATIONS ARE THE SOLE AND EXCLUSIVE PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

MJS
designers group
residential-commercial-architecture

AIBD


GOBA
GENERAL CONTRACTOR ASSOCIATION

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pad #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE	03/06/2023
REVISIONS	
PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS
FOUNDATION PLAN	
S1.1	

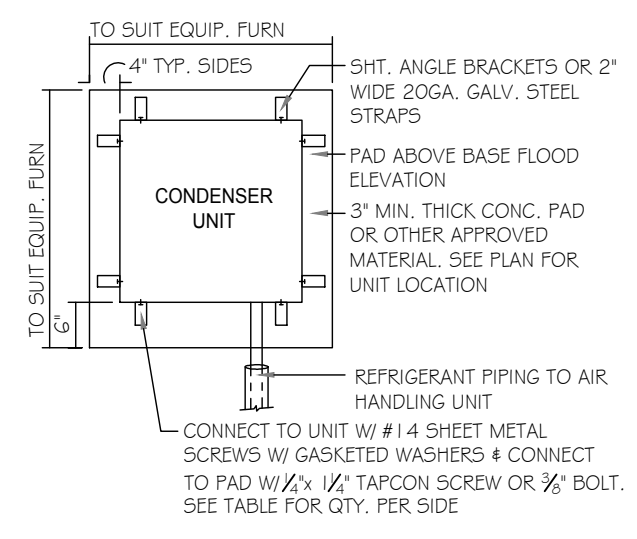

- FOUNDATION NOTES**
- CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
 - REINOTES FILL CELL REIN. W/ CONC. W/ (1) #5 REBAR, GRADE GO
 - REINOTES FILL CELL REIN. W/ CONC. W/ (2) #5 REBAR, GRADE GO
 - 3\"/>
 - DO NOT SCALE PRINTS; CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 - WATER HEATER 1/2\"/>
 - PAVERS MAY BE USED I/O CONCRETE SLABS IN PATIO, PORCH, DRIVE AND WALKWAY AREAS. DELETE SLAB IN AREAS PAVERS ARE USED.
 - MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
 - IN LIEU OF TREATING THE SOIL, AN ALTERNATIVE TO TREATMENT TREATED SOIL CAN BE PREMISE 75 W/ TERMICIDE.
 - DORA - CARE TO BE APPLIED ON INTERIOR WALLS W/ MANUFACTURER'S INSTRUCTIONS AND SPECIFICATIONS, PURSUANT FLORIDA BUILDING CODE LATEST EDITION.
 - WOOD STAIRS STRINGERS IN CONTACT WITH CONCRETE SHALL BE PROTECTED BY AN IMPERVIOUS MOISTURE BARRIER OR SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD PER FBC 83.17.1

ANCHOR SPACING TABLE

LENGTH/SPAN	NO. OF ANCHORS/SIDES
LESS THAN 12"	ONE / SIDE
12" - 24"	TWO / SIDE
24" - 36"	THREE / SIDE
36" - 48"	FOUR / SIDE


1 COND. ANCHOR DETAIL
N.T.S.

FIELD REPAIR NOTES

- MISSING FOOTING DOWNLS MAY BE SUBSTITUTED W/ A STRAIGHT #5 REBAR SET IN A 3/4\"/>
- BLOCK WALL OVERHANGING SLAB CONDITION: UP TO 7/8\"/>
- PENETRATION OF PLUMBING PIPES OR VENTS THRU PLATES OF A LOAD BEARING WALL MAY OCCUR PROVIDED DBL. STUDS ARE ADDED ON EITHER SIDE OF PENETRATION WITHIN 3\"/>

VERIFICATION OF FIELD CONDITIONS:

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS RELATIVE TO SAME. WHERE THERE ARE CONFLICTS BETWEEN ACTUAL FIELD CONDITIONS AND DATA PRESENTED IN THE DRAWINGS, SUCH CONDITIONS SHALL BE CALLED TO THE ARCHITECTS AND OR TO THE ENGINEER OF RECORDS (EOR) ATTENTION AND NECESSARY ADJUSTMENTS MADE PER THEIR INSTRUCTIONS.

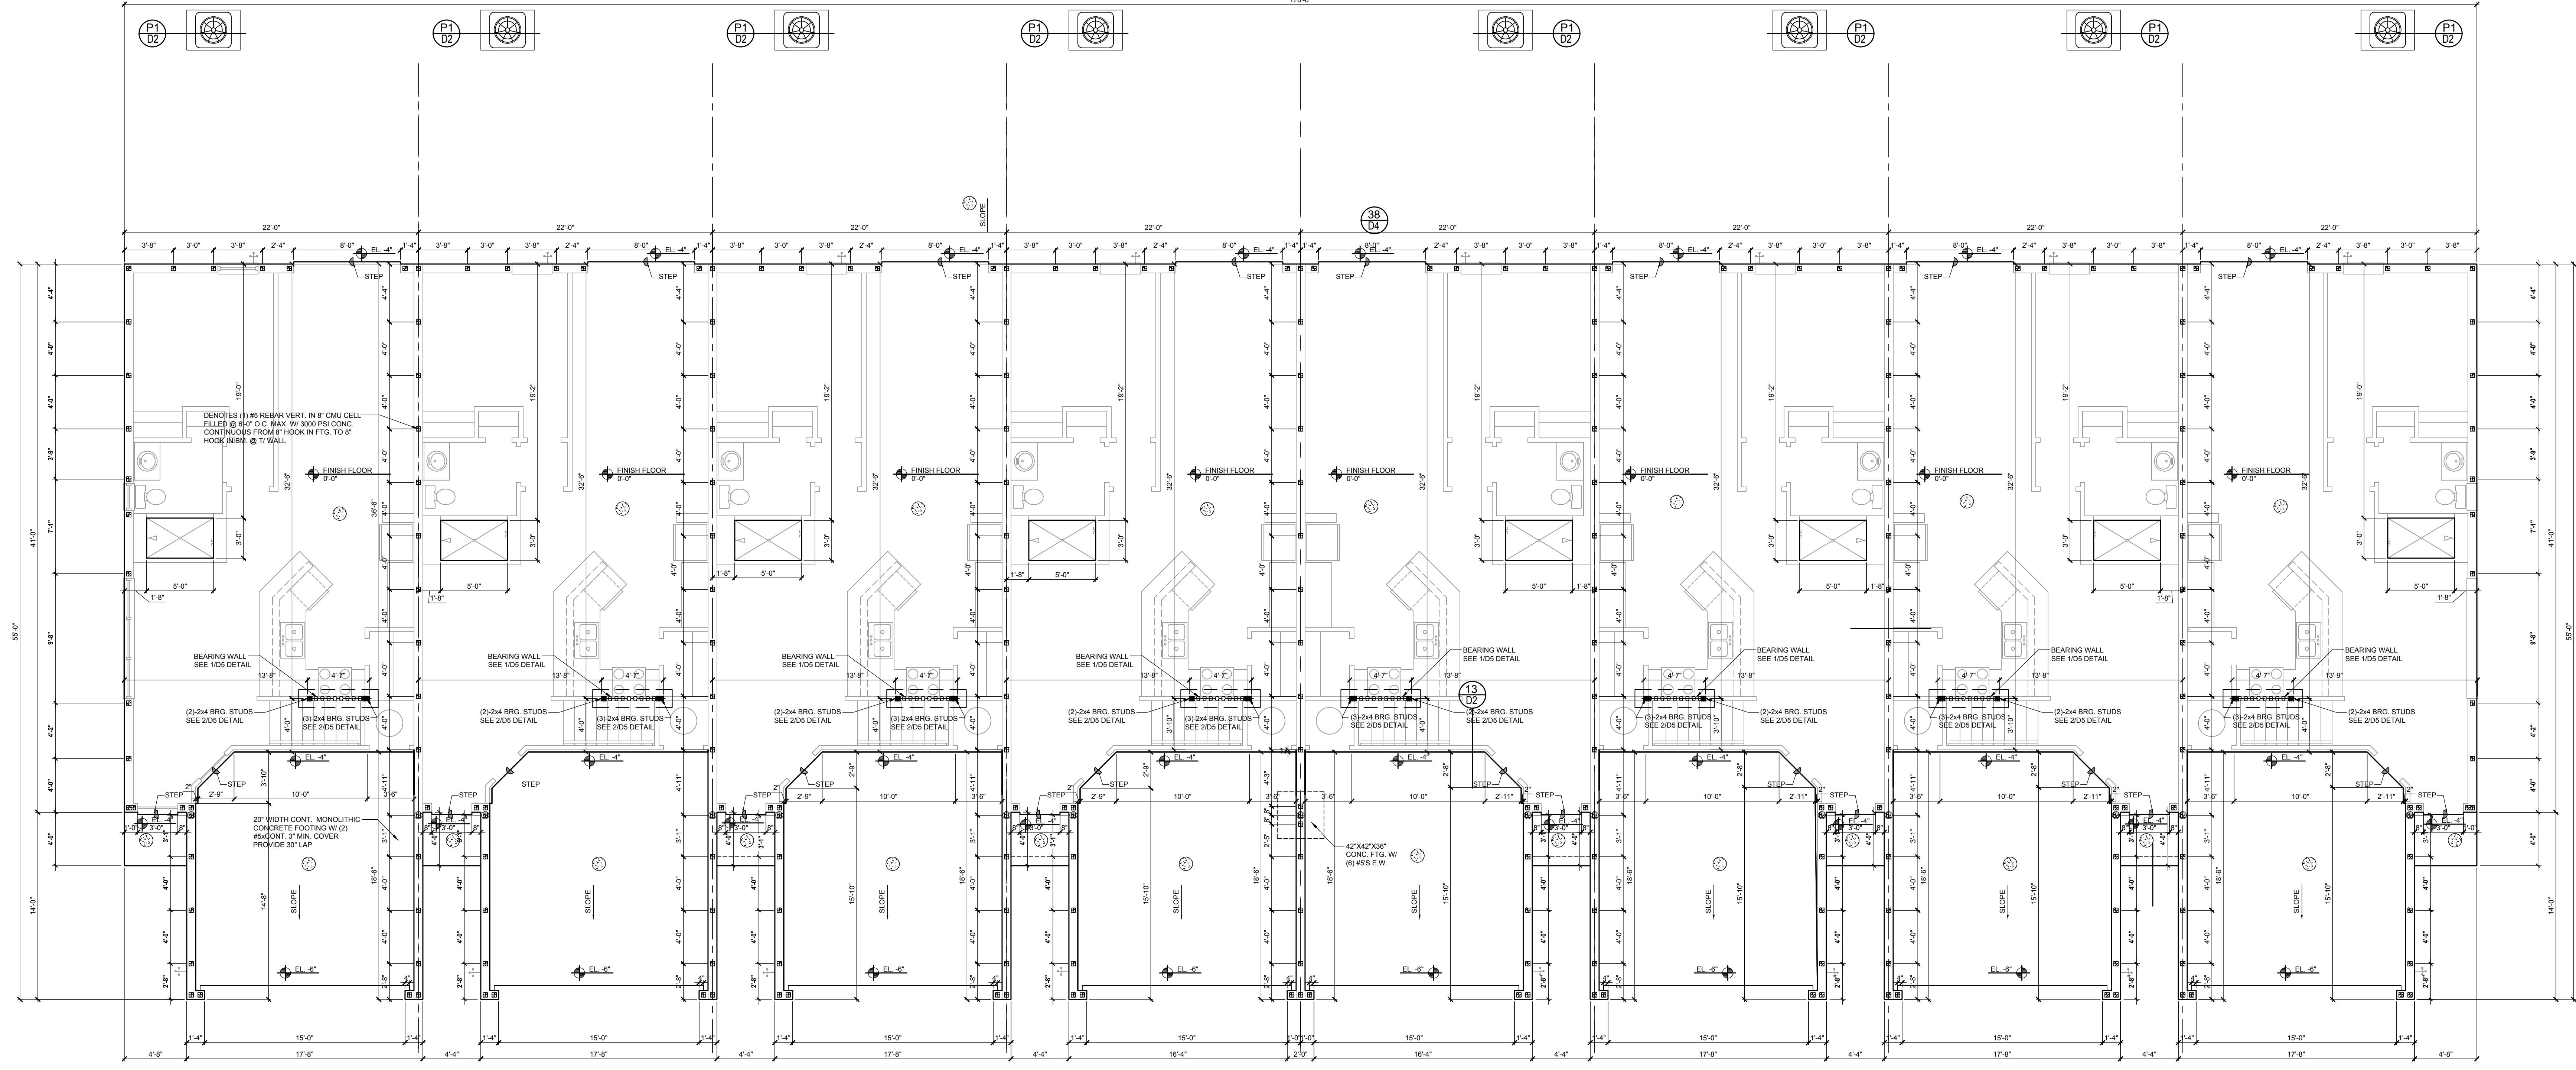

Nautilus LOT# XX Latitude II LOT# XX Latitude II LOT# XX Latitude (Rev.) LOT# XX Latitude II (Rev.) LOT# XX Latitude II (Rev.) LOT# XX Nautilus (Rev.) LOT# XX

Foundation Plan

SCALE 3/16" = 1'-0"

NOTE:
WORK THIS SHEET WITH FOUNDATION PLAN (GRADE BEAM)

ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vineland Road, Suite A6, Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1150
www.iteg.com

815 Oriole Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignsgroup.com
COPYRIGHT NOTICE: THESE PLANS, DESIGNS, AND DRAWINGS ARE THE EXCLUSIVE PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

MJS
designers group
residential-commercial-architecture

AI
BD

GOBA
DESIGN FOR PROGRESS ASSOCIATE

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pad #XXX
Lot# XX-XX Subdivision
Street Address
City, State, Zip Code

A division of Park Square Enterprises Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE: 03/06/2023

REVISIONS

PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS

FIELD REPAIR NOTES


1. MISSED FOOTING DOWELS MAY BE SUBSTITUTED W/ A STRAIGHT #5 REBAR SET IN A 3/4" DIA. X 6" DEEP HOLE FILLED W/ UNITEC PROPOXY 300 OR SIMPSON SET OR E/F ADHESIVES.
2. BLOCK WALL OVERHANGING SLAB CONDITION: UP TO 7/8" - NO REPAIR NECESSARY 7/8" TO 1 1/4" - ADD FILLED CELL (NO VERTICAL STEEL) MIDPOINT OF WALL BETWEEN EXISTING FILLED CELLS (WITH STEEL) IN AREAS AFFECTED. 1 1/4" + - REQUIRE SPECIAL ENGINEERING LETTERS.
3. PENETRATION OF PLUMBING PIPES/VEHICLE VENTS THRU PLATES OF A LOAD BEARING WALL MAY OCCUR PROVIDED DBL. STUDS ARE ADDED ON EITHER SIDE OF PENETRATION WITHIN 3" AND TRUSS/FLOOR TRUSS IS NO CLOSER THAN 3" FROM PENETRATION. ADD (1) MTS12 @ TOP AND BOTTOM PLATE.

VERIFICATION OF FIELD CONDITIONS:

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS RELATIVE TO SAME. WHERE THERE ARE CONFLICTS BETWEEN ACTUAL FIELD CONDITIONS AND DATA PRESENTED IN THE DRAWINGS, SUCH CONDITIONS SHALL BE CALLED TO THE ARCHITECTS AND/OR TO THE ENGINEER OF RECORDS (BOQ) ATTENTION AND NECESSARY ADJUSTMENTS MADE PER THEIR INSTRUCTIONS.

FOUNDATION NOTES

1. CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
2. DENOTES FILL CELL REPAIR, W/ CONC. W/ 1-#5 REBAR, GRADE GO.
3. DENOTES FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S. I. 4" THICK WITH 6X6 (O) 10 GAUGE REINFORCING MAT. W/ MIN. 1" COVER TREATED SOIL WITH 0.008mm (60mil) POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. W/PT SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. THESE MESH REINFORCEMENT MAY BE USED AS ALTERNATIVE TO WIRE.
4. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
5. WATER HEATER TAP RELIEF VALVE SHALL E FULL SIZE TO EXTERIOR. WATER HEATER SET OR ABOVE FLOOR LEVEL G1. FILL IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE APPROVED THERMAL EXPANSION DEVICE.
6. PAVERS MAY BE USED I/D CONCRETE SLABS IN PATIO, PORCH, DRIVE AND WALKWAY AREAS. COLETE SLAB IN AREAS PAVERS ARE USED.
7. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
8. IN LIEU OF TREATING THE SOIL, AN ALTERNATIVE TO TERMIT TREATED SOIL, CA BE PROVIDED TO WE TERNACIO.
9. SOKA CARE TO BE APPLIED ON INTERIOR WALLS W/ MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS, PURSUANT FLORIDA BUILDING CODE LATEST EDITION.

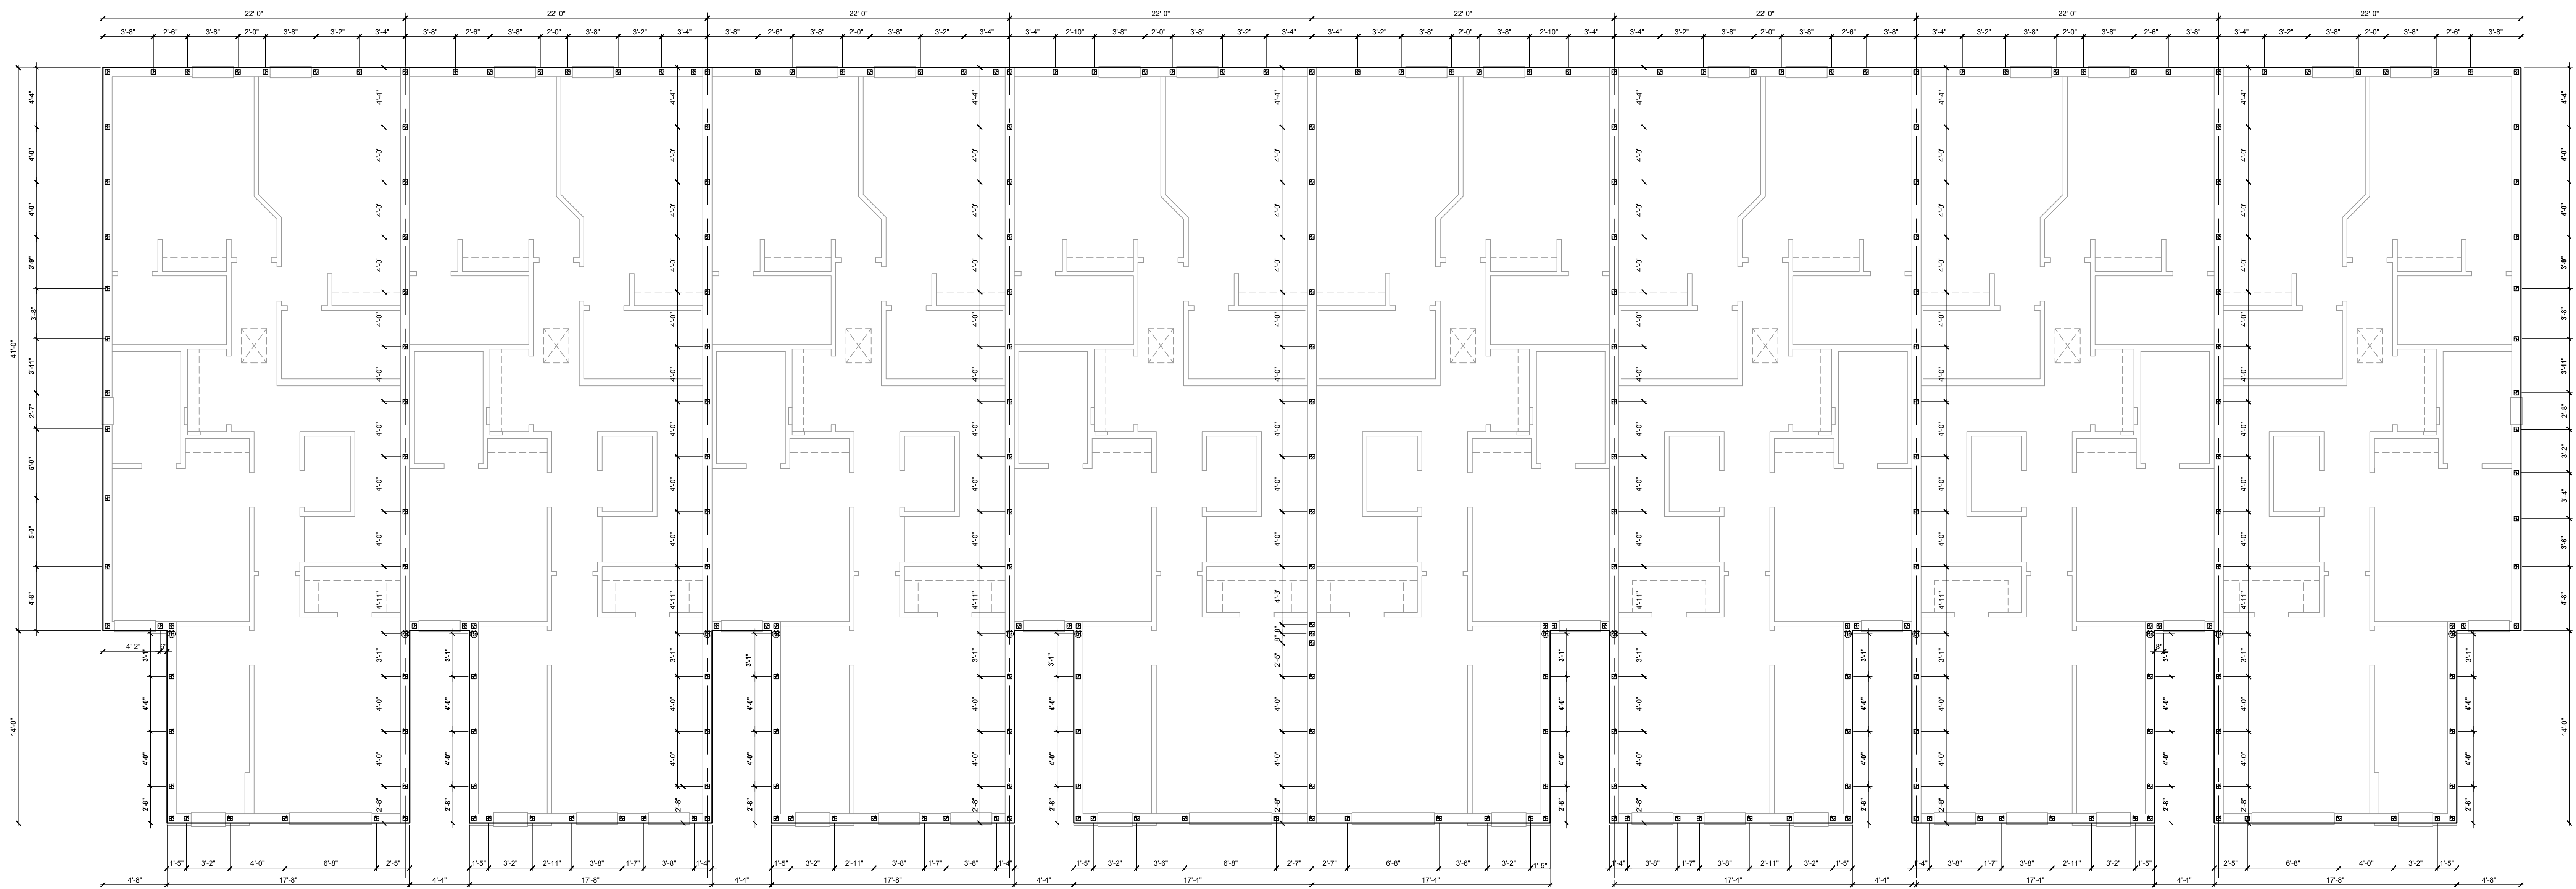

Nautilus
LOT# XX

Latitude II
LOT# XX

Latitude II
LOT# XX

Latitude
LOT# XX

Latitude (Rev.)
LOT# XX

Latitude II (Rev.)
LOT# XX

Latitude II (Rev.)
LOT# XX

Nautilus (Rev.)
LOT# XX


Second Floor dowel plan

"Elev. B"

SCALE: 3/16" = 1'-0"



815 Oriole Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignsgroup.com

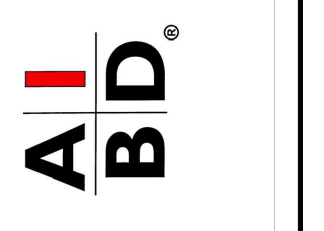

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pad #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A division of Park Square
Enterprises Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000



ISSUE DATE	03/06/2023
REVISIONS	

PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS

ROOF PLAN ELEV. A
S1.2

A:\proj\1151\8-Arched\Naiad\OneDrive - Thompson Engineering Group\Desktop\Paradiso Grande (CMU-Raised floor)\8-UNIT\8-UNIT.dwg File:S1.2 2nd Floor dowel plan ELEV.B.dwg

FIELD REPAIR NOTES


1. MISSED FOOTING DOWELS MAY BE SUBSTITUTED W/ A STRAIGHT #5 REBAR SET IN A 3/4" DIA. X 6" DEEP HOLE FILLED W/ UNITEX PROPOXY 300 OR SIMPSON SET OR E/F ADHESIVES.
2. BLOCK WALL OVERHANGING SLAB CONDITION: UP TO 7/8" - NO REPAIR NECESSARY 7/8" TO 1 1/4" - ADD FILLED CELL (NO VERTICAL STEEL) MIDPOINT OF WALL BETWEEN EXISTING FILLED CELLS (WITH STEEL) IN AREAS AFFECTED. 1 1/4" + - REQUIRE SPECIAL ENGINEERING LETTERS.
3. PENETRATION OF PLUMBING PIPES/VEH VENTS THRU PLATES OF A LOAD BEARING WALL MAY OCCUR PROVIDED DBL. STUDS ARE ADDED ON EITHER SIDE OF PENETRATION WITHIN 3" AND TRUSS/FLOOR TRUSS IS NO CLOSER THAN 3" FROM PENETRATION. ADD (1) MTS12 @ TOP AND BOTTOM PLATE.

VERIFICATION OF FIELD CONDITIONS:

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS RELATIVE TO SAME. WHERE THERE ARE CONFLICTS BETWEEN ACTUAL FIELD CONDITIONS AND DATA PRESENTED IN THE DRAWINGS, SUCH CONDITIONS SHALL BE CALLED TO THE ARCHITECTS AND OR TO THE ENGINEER OF RECORDS (EOR) ATTENTION AND NECESSARY ADJUSTMENTS MADE PER THEIR INSTRUCTIONS.

FOUNDATION NOTES

1. CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
2. DENOTES FILL CELL REINF. W/ CONC. W/ 1-#5 REBAR, GRADE 60. DENOTES FILL CELL REINF. W/ CONC. W/ 2-#5 REBAR, GRADE 60.
3. DENOTES FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I., 4" THICK WITH 6/16 (10) 10 GAUGE REINFORCING MAT. W/ MIN. 1" COVER TREATED SOIL WITH 0.008mm (60mil) POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. W/PT SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. TRUSS MESH REINFORCEMENT MAY BE USED AS ALTERNATIVE TO WIRE.
4. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
5. WATER HEATER TAP RELIEF VALVE SHALL E FULL SIZE TO EXTERIOR. WATER HEATER SET OR ABOVE FLOOR LEVEL 61" FILL L IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE APPROVED THERMAL EXPANSION DEVICE.
6. PAVERS MAY BE USED I/D CONCRETE SLABS IN PATIO, "PORCH", DRIVE AND WALKWAY AREAS. COLETE SLAB IN AREAS PAVERS ARE USED.
7. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
8. IN LIEU OF TREATING THE SOIL, AN ALTERNATIVE TO TERMIT TREATED SOIL, CA BE PROVIDED TO WE TERMITEC.
9. SOKA CARE TO BE APPLIED ON INTERIOR WALLS W/ MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS, PURSUANT FLORIDA BUILDING CODE LATEST EDITION.

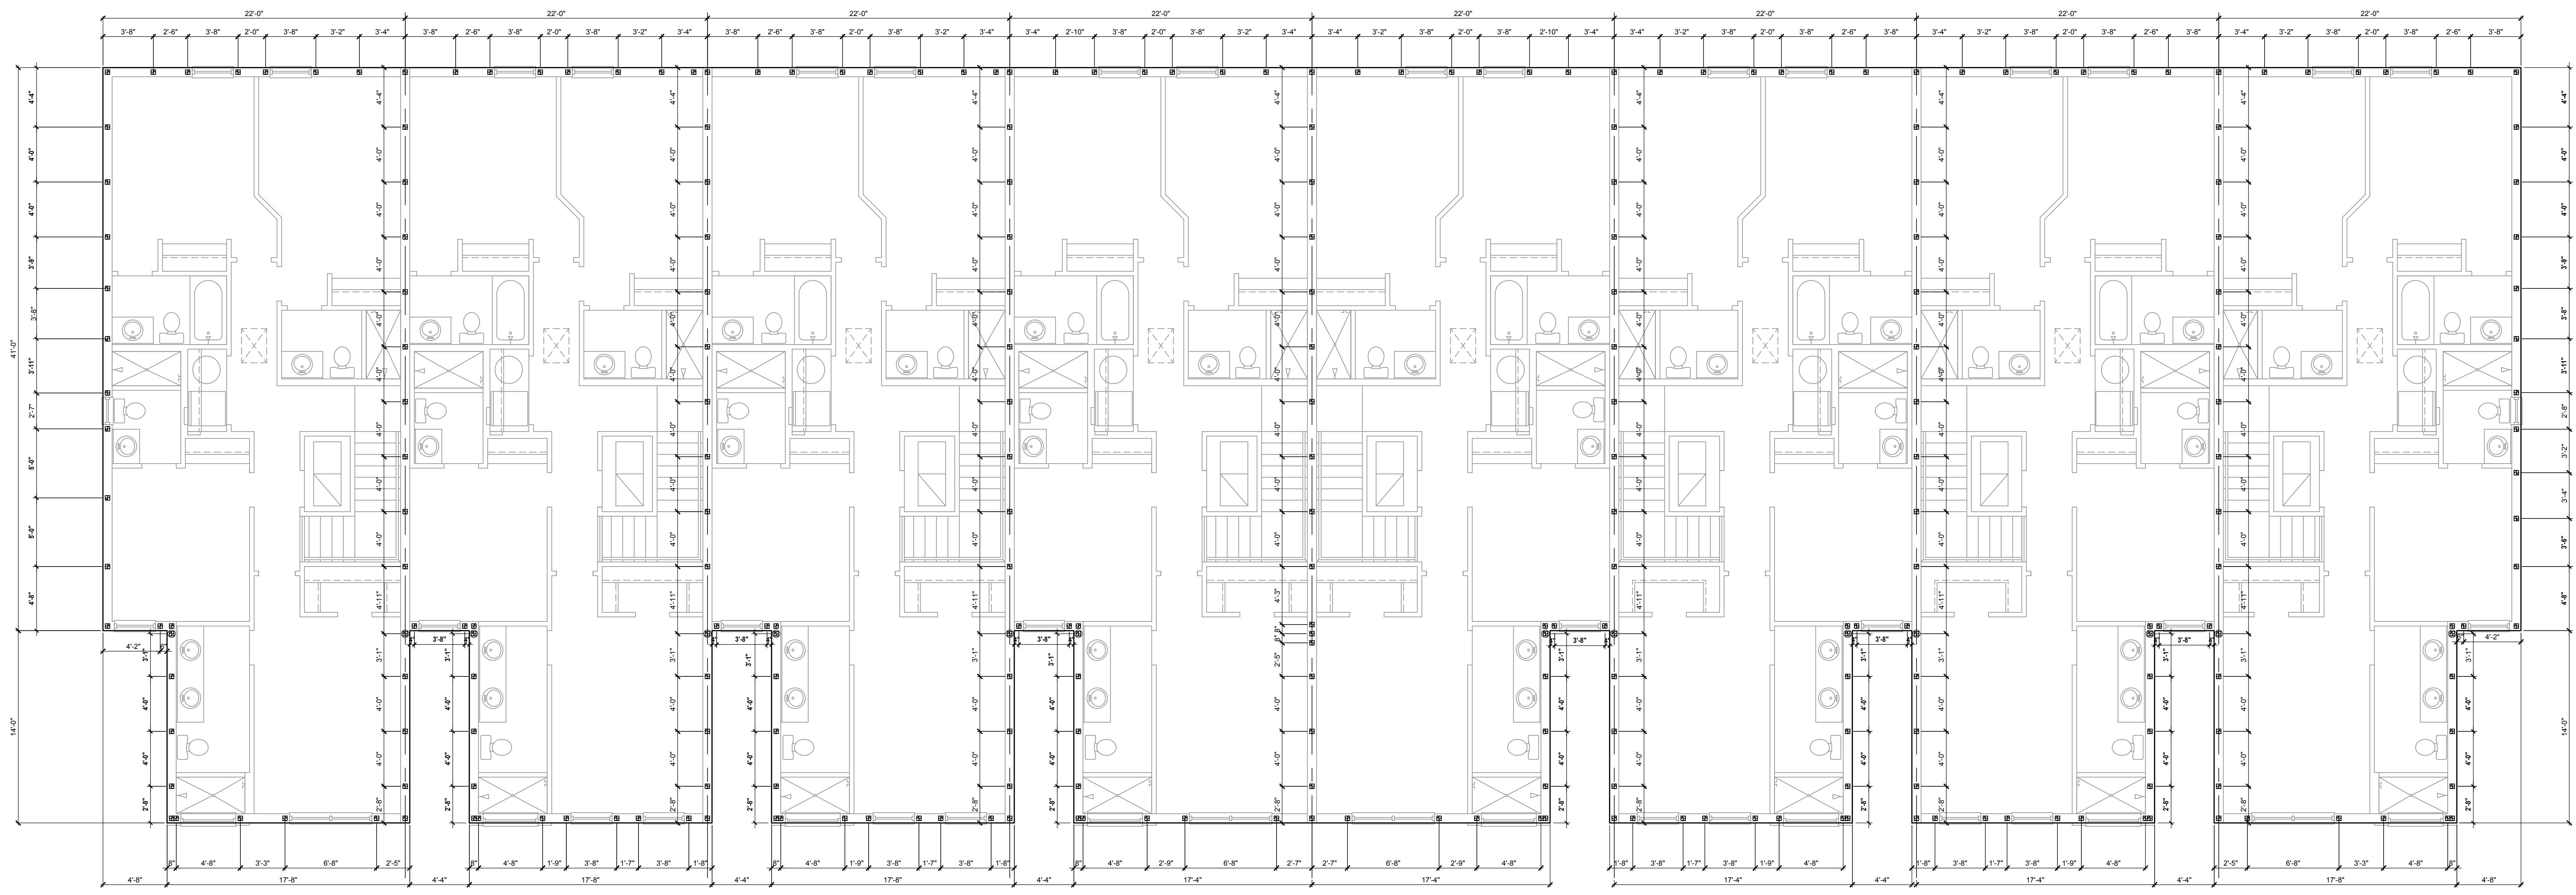


Nautilus LOT# XX Latitude II LOT# XX Latitude II LOT# XX Latitude LOT# XX Latitude (Rev.) LOT# XX Latitude II (Rev.) LOT# XX Latitude II (Rev.) LOT# XX Nautilus (Rev.) LOT# XX

Second Floor dowel plan
"Elev. A"
 SCALE: 3/16" = 1'-0"



815 Oriole Ave., Suite #1040
 Altamonte Springs, FL 32701
 Ph: (407) 629-6711
 Fax: (407) 629-6776
 www.mjsdesignsgroup.com
 COPYRIGHT NOTICE: THESE PLANS, DESIGNS, AND DRAWINGS ARE THE EXCLUSIVE PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

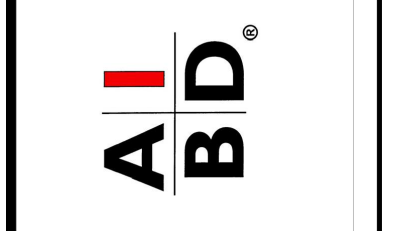

8-Unit: (Paradiso TH)
 Models: Nautilus, Latitude
 Building Pad #XXX
 Lot# XX-XX, Subdivision
 Street Address
 City, State, Zip Code

A division of Park Square Enterprises Inc.
 5200 Vineland Rd., Suite #200
 Orlando, FL 32811
 Phone: (407) 529-3000



ISSUE DATE: 03/06/2023
 REVISIONS:

PROJECT: 22-1151
 SCALE: AS NOTED
 DRAWN BY: M.C.
 DESIGNED BY: MJS

ROOF PLAN ELEV. A
S1.2

SAFE LOAD TABLES
FOR GRAVITY, UPLIFT & LATERAL LOADS


8" PRECAST & PRESTRESSED U-LINTELS
GRAVITY
TABLE with columns for LENGTH, TYPE, and various load values (RUB, RFL, etc.)

8" PRECAST W/ 2" RECESS DOOR U-LINTELS
GRAVITY
TABLE with columns for LENGTH, TYPE, and various load values

8" PRECAST & PRESTRESSED U-LINTELS

UPLIFT & LATERAL
TABLE with columns for LENGTH, TYPE, and various load values

8" PRECAST W/ 2" RECESS DOOR U-LINTELS
UPLIFT & LATERAL
TABLE with columns for LENGTH, TYPE, and various load values

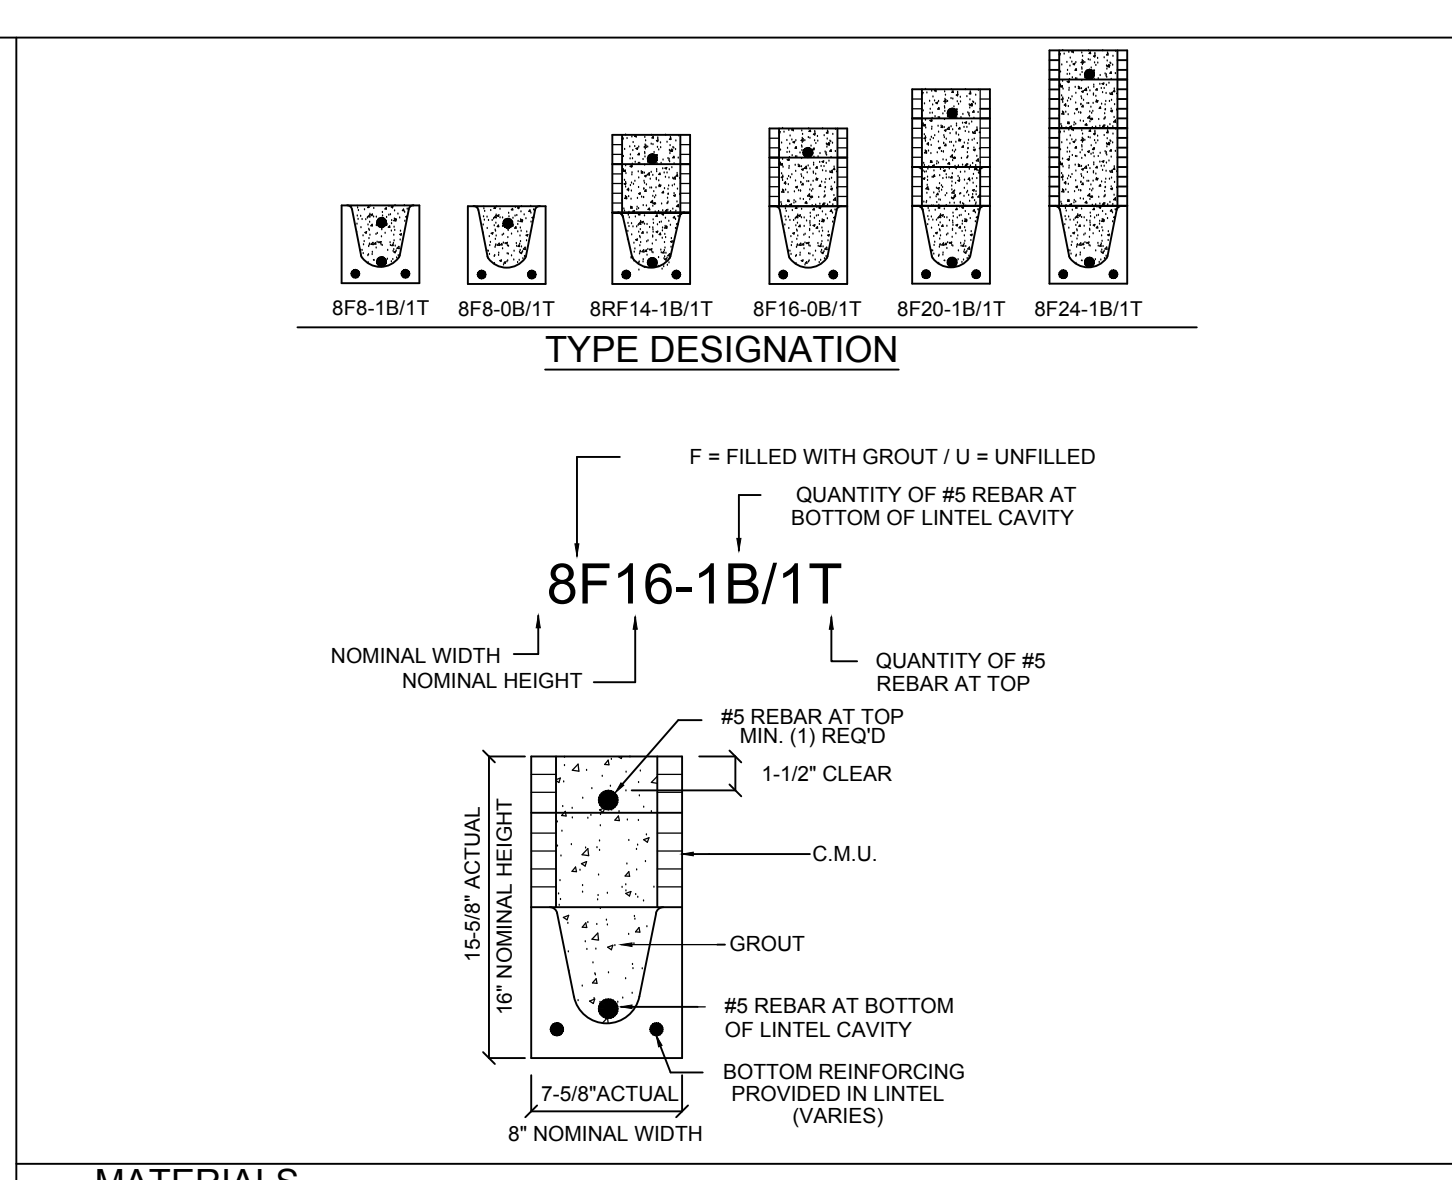


MATERIALS
1. Fc precast lintels = 3500 psi.
2. Fc prestressed lintels = 6000 psi.
3. Fc grout = 3000 psi w/ maximum 3/8" aggregate.
4. Concrete masonry units (CMU) per ASTM C90 w/ minimum net area compressive strength = 1900 psi.
5. Rebar provided in precast lintel per ASTM A615 G500. Field rebar per ASTM A415 G40 or G60.
6. Prestressing strand per ASTM A416 grade 270 low relaxation.
7. #2 wire per ASTM A10.
8. Mortar per ASTM C270 type M or S.

GENERAL NOTES
1. Provide full mortar head and bed joints.
2. Shore field lintels as required.
3. Installation of lintel must comply with the architectural and/or structural drawings.
4. Lintels are manufactured with 5-1/2" long notches at the ends to accommodate vertical cell reinforcing and grouting.
5. All lintels meet or exceed L/260 vertical deflection, except lintels 17'-4" and longer with a nominal height of 8" meet or exceed L/80.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load ratings based on rational design analysis per ACI 318 and ACI 530.

SAFE LOAD TABLE NOTES
1. All values based on minimum 4" bearing. Exception: Safe loads for unlifted lintels must be reduced by 20% if bearing length is less than 6-1/2". Safe loads for all recessed lintels based on 8" nominal bearing.
2. N.R. = Not Rated.
3. Safe loads are total superimposed allowable load on the section specified.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. Additional lateral load capacity can be obtained by the designer by providing additional reinforced masonry above the precast lintel.
6. One #7 rebar may be substituted for two #5 rebars in 8" lintels only.
7. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-way from the face of support.
8. For composite lintel heights not shown, use safe load from next lower height.
9. All safe loads in units of pounds per linear foot.

CAST CRETE / LOTS / WEKIWA / FLORIDA ROCK
PRECAST LINTEL SCHEDULE
TABLE with columns for LINTEL NO., LENGTH, TYPE, and COMMENTS

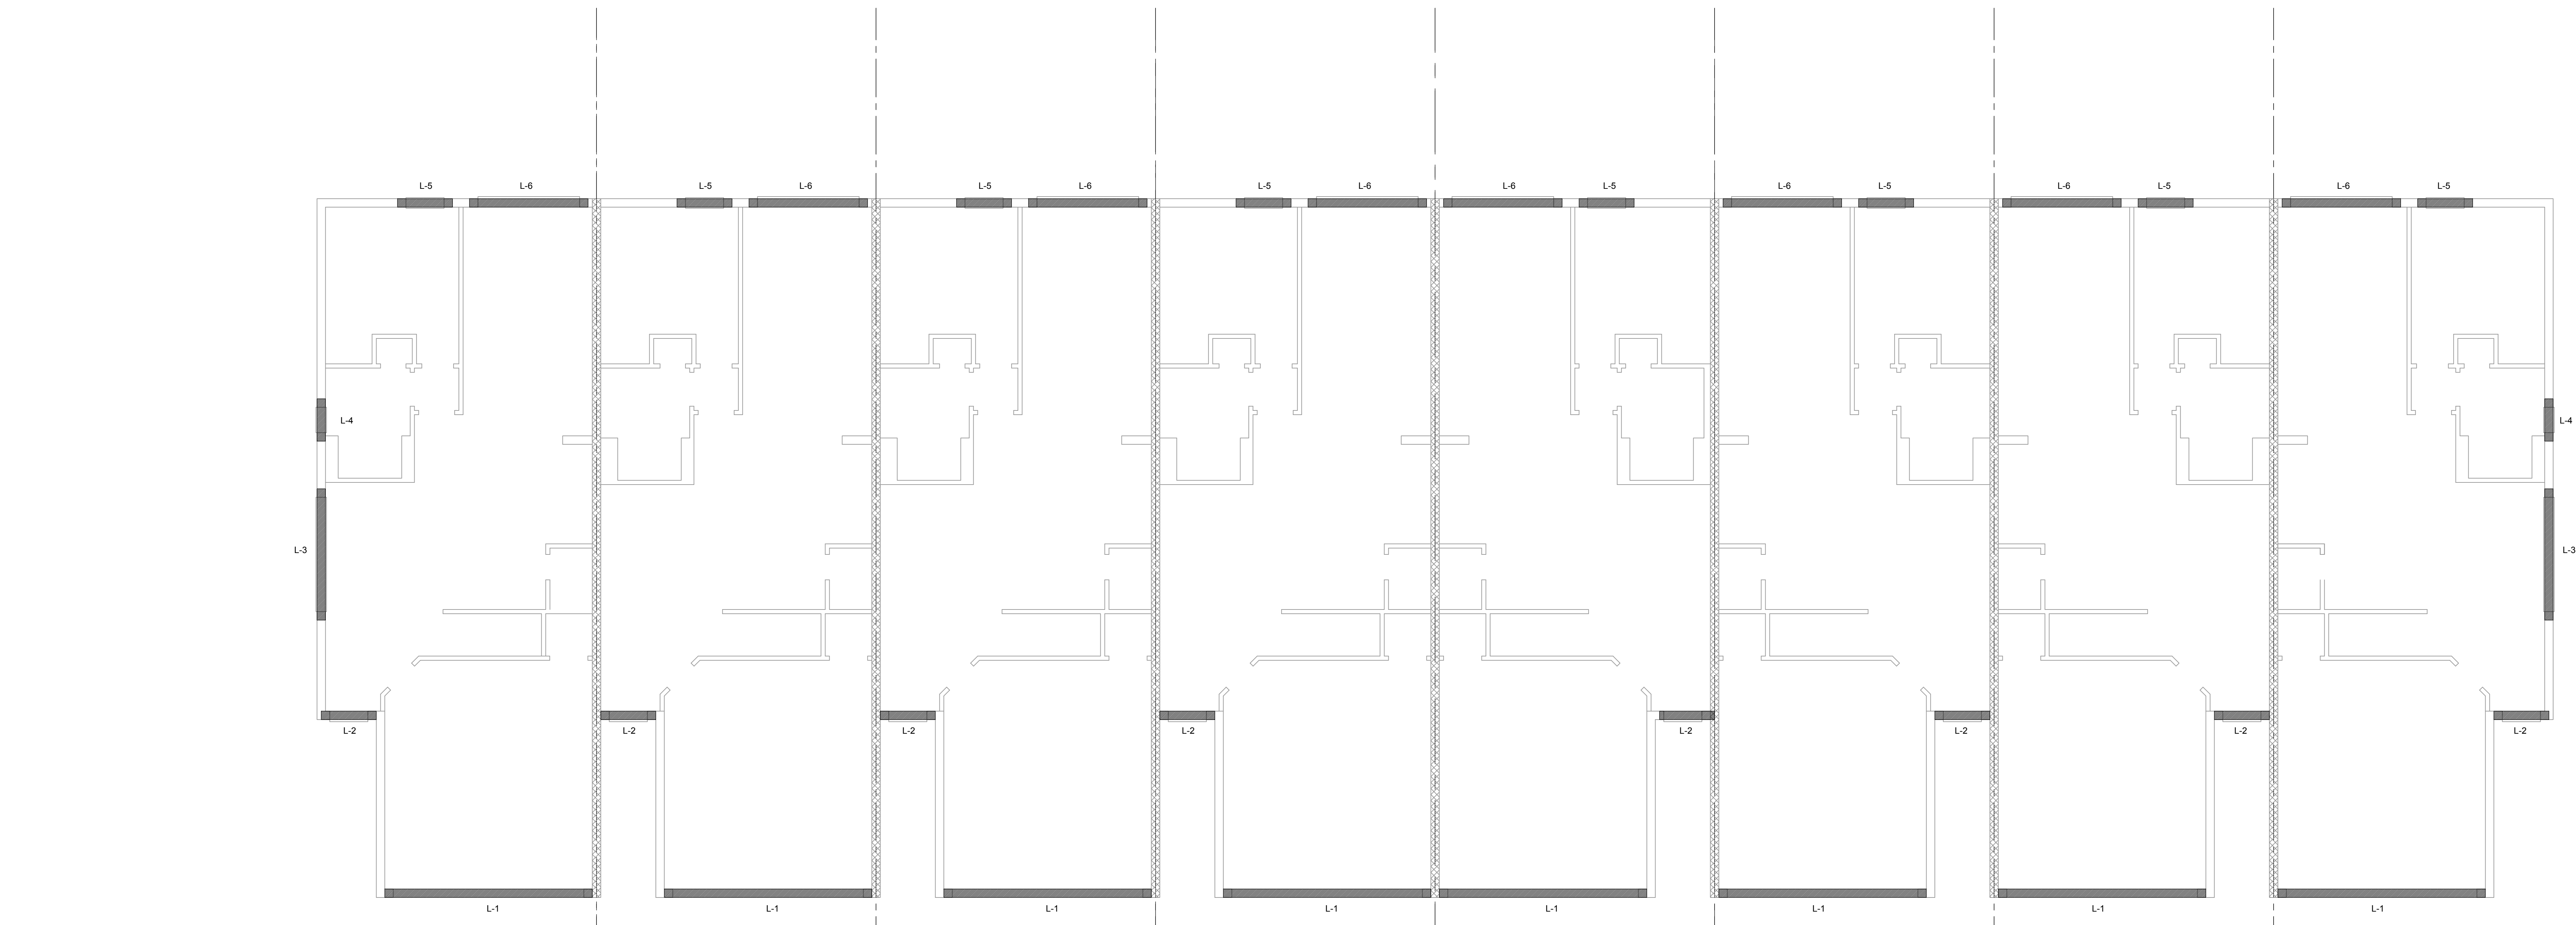

815 Oriens Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjdesignsgroup.com
All rights reserved.
©2024 MJS INC. ALL RIGHTS RESERVED.
www.mjsg.com

MJS designers group residential-commercial-architecture

AI BD

GOBA GROUP OF COMPANIES

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pad #XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS
ISSUE DATE: 03/06/2023
REVISIONS:
LINTEL PLAN S2

SAFE LOAD TABLES FOR GRAVITY, UPLIFT & LATERAL LOADS FOR PRECAST & PRESTRESSED U-INTELS

GRAVITY

LENGTH	TYPE	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T
--------	------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

GRAVITY



LENGTH	TYPE	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T
--------	------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

UPLIFT

LENGTH	TYPE	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	LATERAL
--------	------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	---------


LATERAL

LENGTH	TYPE	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	8F16-1B/1T	LATERAL
--------	------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	---------

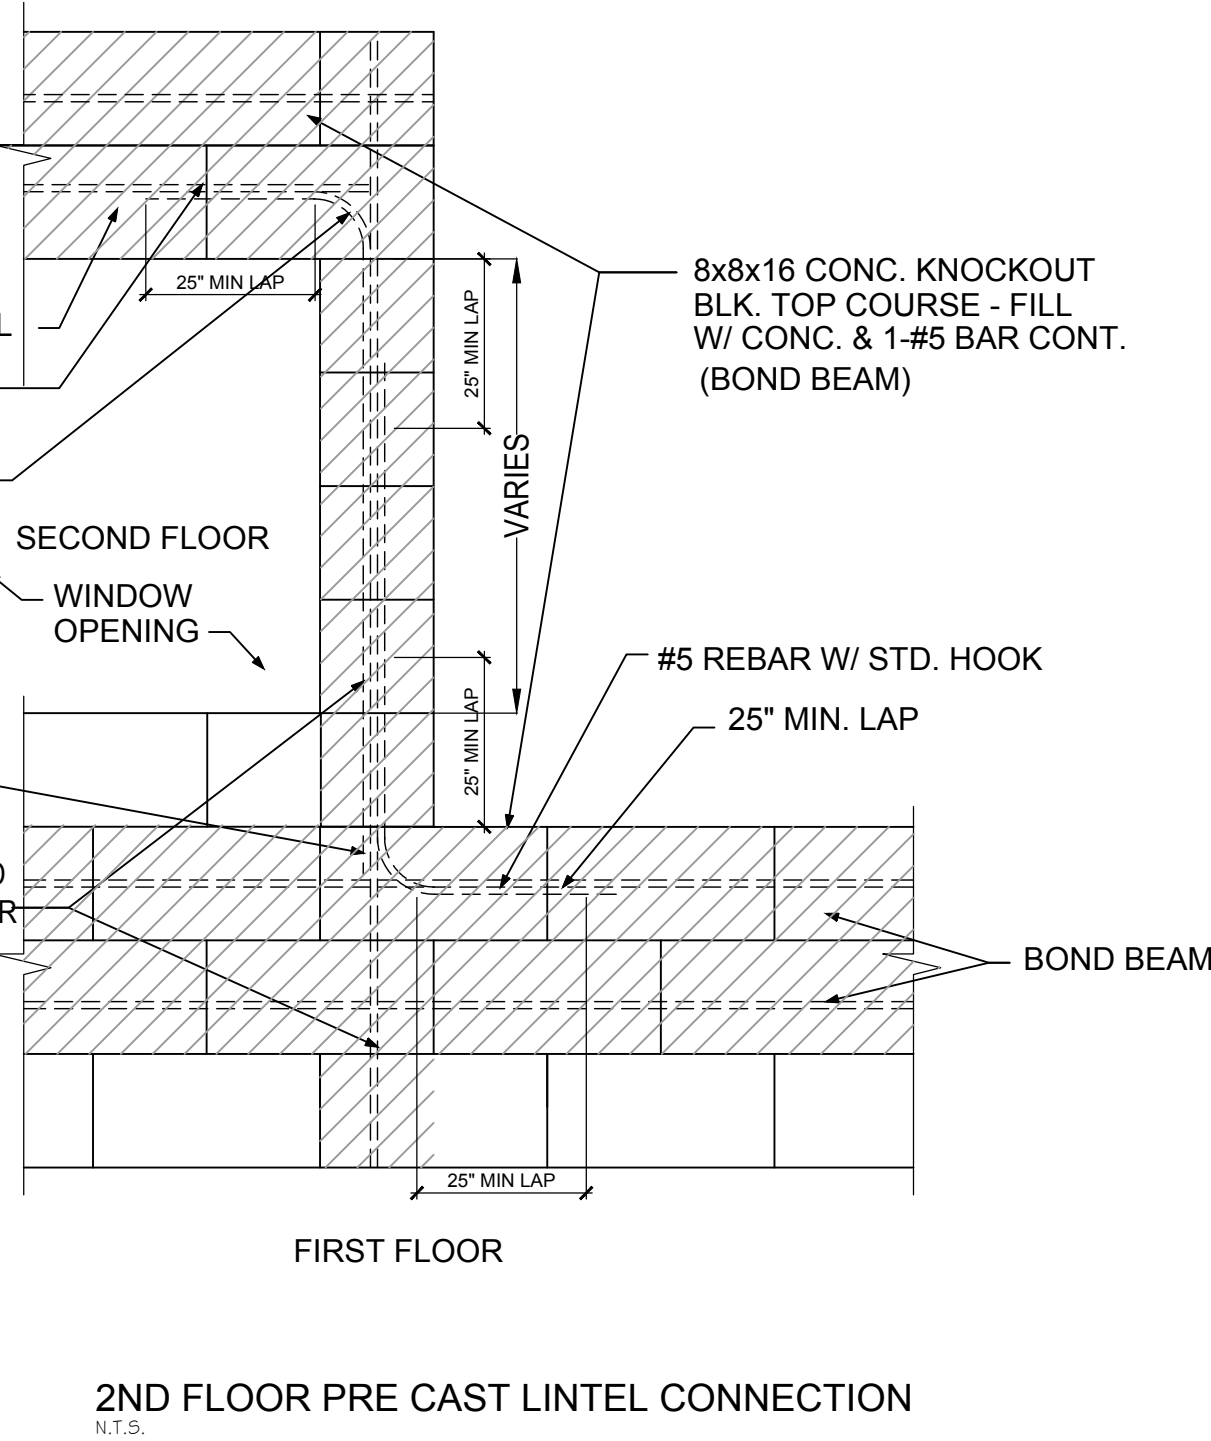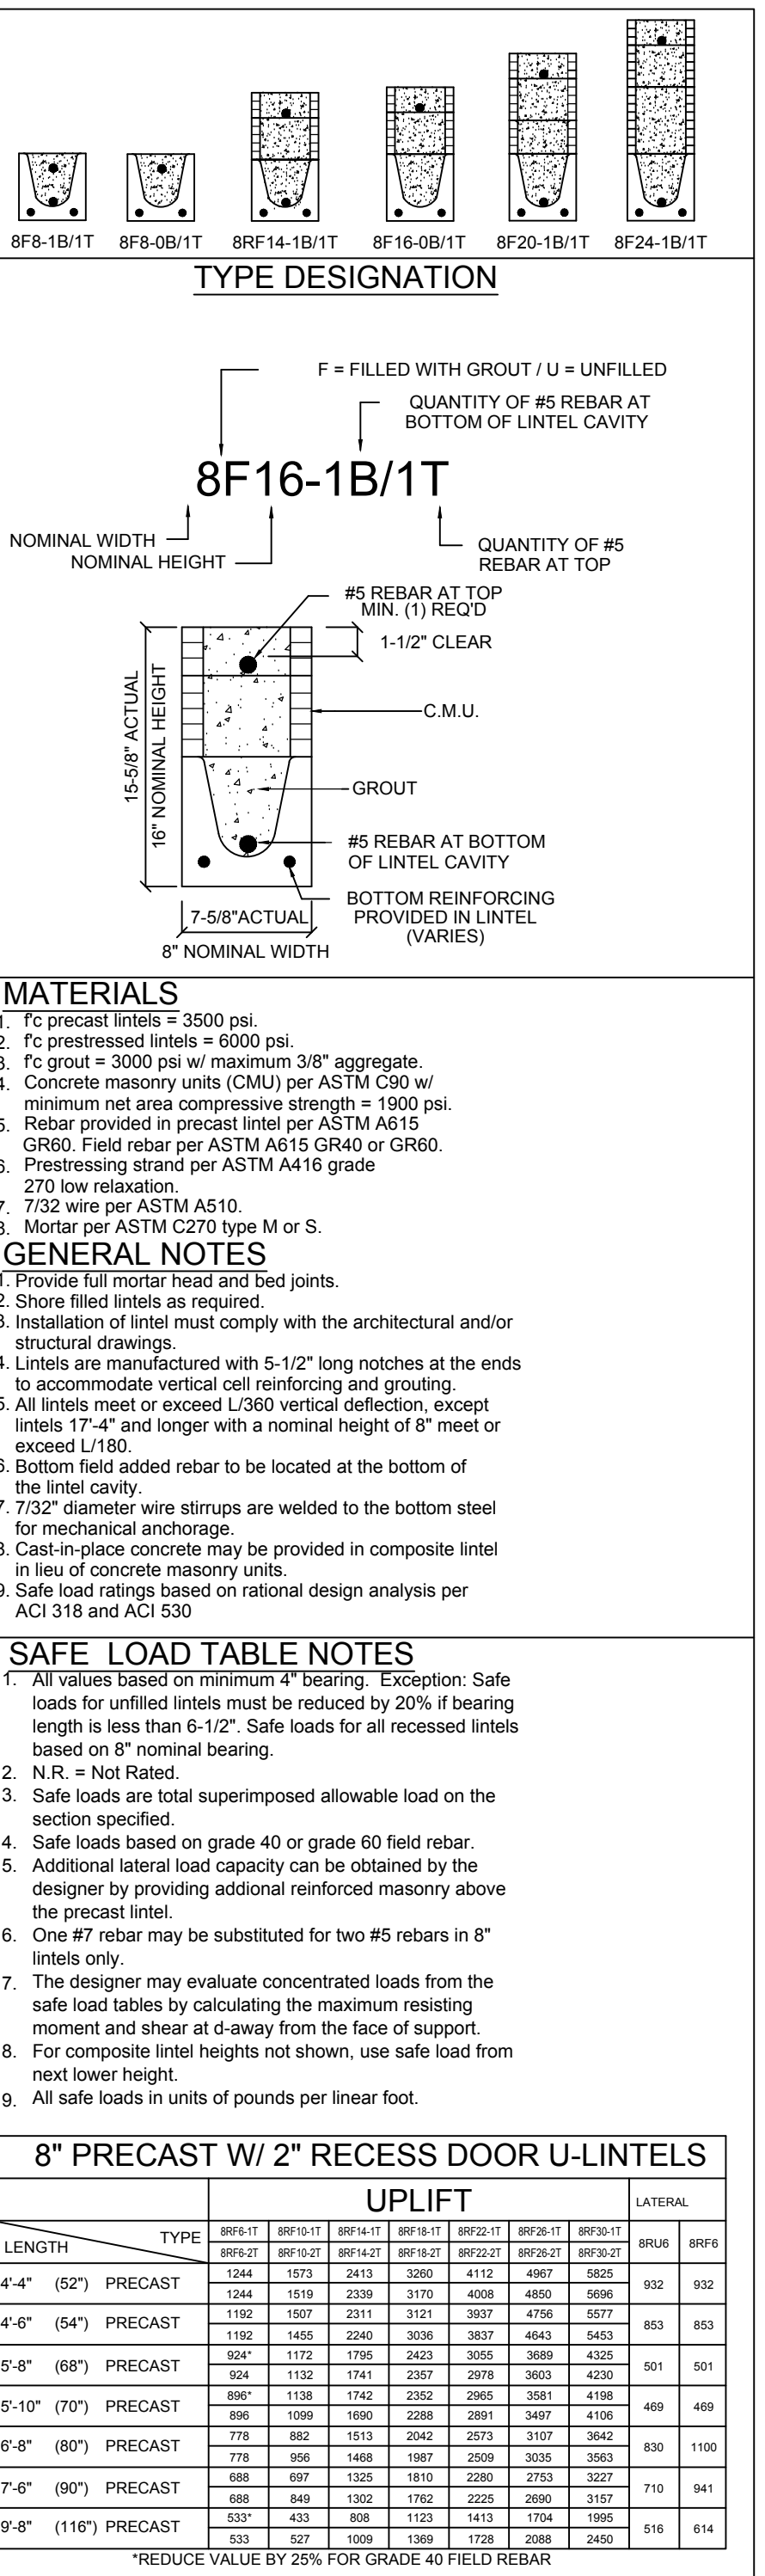

CAST CRETE / LOTT'S / WEKIWA / FLORIDA ROCK PRECAST LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L-1	17'-4"	8F40-1B/1T	GARAGE DOOR
L-2	4'-6"	8F22-1B/1T	FRONT DOOR
L-3	10'-6"	8F24-1B/1T	(3) 3060 S.H.
L-4	3'-6"	8F24-1B/1T	2030 S.H.
L-5	4'-6"	8F24-1B/1T	3050 S.H.
L-6	9'-4"	8F24-1B/1T	8'-0" X 8'-0" S.G.D.
L-7	7'-6"	8F24-1B/1T	(2) 3050 S.H.
L-8	4'-0"	8F24-1B/1T	FIX GLASS

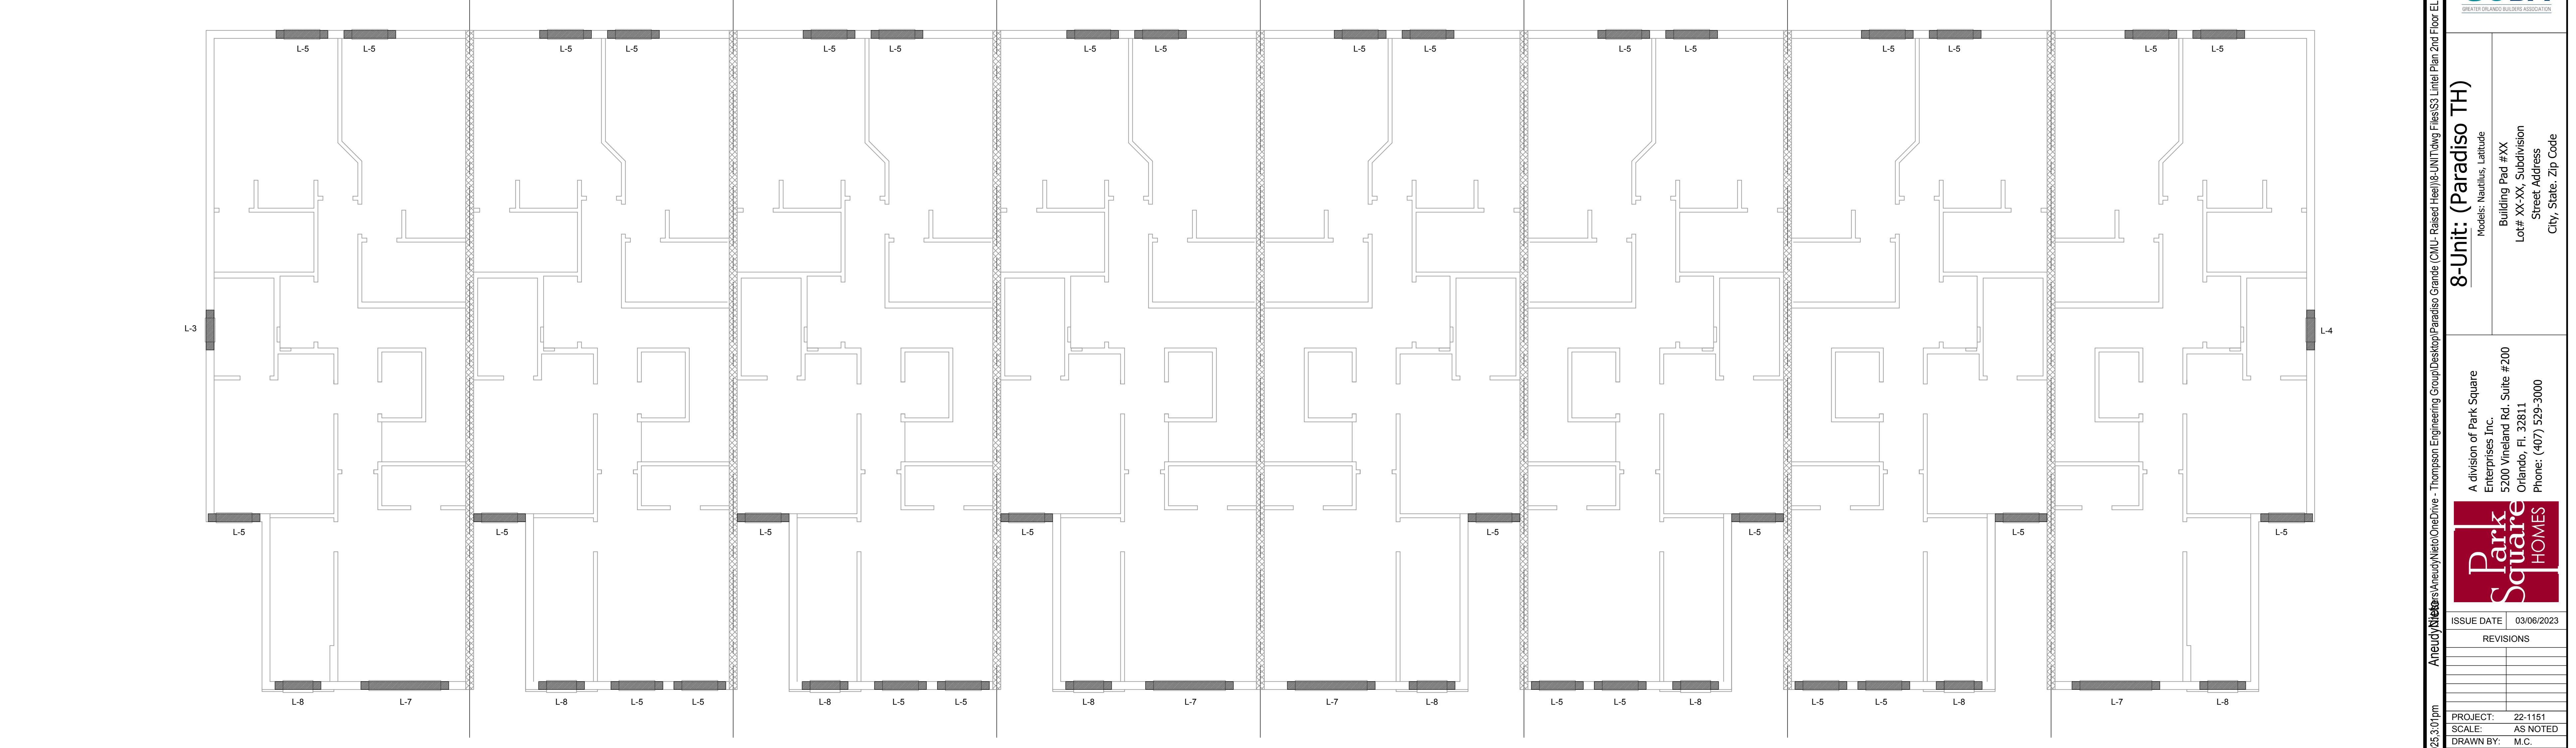

CONNECTOR SCHEDULE

CONNECTOR TYPE	SIMPSON DESCRIPTION	FASTENERS PER CONNECTOR	MAX. UPLIFT	LAT. LDS. F1 / F2
4	HETA20	14-10d x 1 1/2"	1,810	65 / 960
5	DETA20	18-10d x 1 1/2"	2,480	2000 / 1370
20	H3	RFT: 4-8d / PLT: 4-8d	455	125 / 160
21	H1	RFT: 6-8d x 1 1/2" / PLT: 4-8d	475	485 / 165
22	H10A OR MTS12	RFT: 8-8d x 1 1/2" / PLT: 8-8d x 1 1/2"	1010	660 / 550
23	LUS26	HDR: 4-10d/JST: 4-10d	935	N/A
24	H7	RFT / TRS: 4-8d / PLT / STD: 10-8d	885	400 / N/A
26	H2.5	RFT: 5-8d / PLT: 5-8d	415	150 / 150
34	A34	H: 4-8d x 1 1/2" / P: 4-8d x 1 1/2"	365	280 / 303
35	A35F	H: 4-8d x 1 1/2" / P: 4-8d x 1 1/2"	440	440 / N/A
37	MTS12	14-10d	990	N/A
38	MTS16	14-10d	990	N/A
39	MTS30	14-10d	990	N/A
43	LSTA12	10-10d	905	N/A
45	ST18	14-16d	1,200	N/A
47	LSTA24	18-10d	1,295	N/A
71	MSTA36	26-10d	2,135	N/A
72	MSTC66	84-16d SINKERS	5,495	N/A
79	SP1	STD: 6-10d / PLT: 4-10d	535	560 / 260
80	SP2	STD: 6-10d / PLT: 6-10d	605	560 / 260
81	SPH4.6.8	12-10d x 1 1/2"	885	N/A
90	ABU66	12-16d	2,240	N/A
89	CB66	(2) 7/8" BOLTS	2,300	985
92	ABU44	12-16d	2,200	N/A
93	AC6 (MAX)	28-16d	1,815	1,070
94	AC4 (MAX)	28-16d	1,815	1,070
95	HTS20	20-10d	1,450	N/A
96	HD8A	SILL: 7/8" BOLT	7,910	N/A
97	MTSM16	BLOCK: 4-1/2" x 2-1/2" TC JOIST: 7-10d	860	N/A
98	HTT4	SILL: 5/8" BOLT	4,235	N/A
99	A35	H: 4-8d x 1 1/2" / P: 4-8d x 1 1/2"	440	440 / N/A
102	HTT5	5/8" BOLT / 26-10d	4,275	N/A
103	VGTR/L	32-SDS 1/2" x 3/4" (2) 7/8" BLT	3,990	N/A
104	HDUS-SDS2.5	7/8" BLT / 20-SDS 1/2" x 2 1/2"	5,020	N/A
110	HCP2	12-10d x 1 1/2"	520	260 / N/A
167	HU546	H: 14-16d / J: 8-16d	1,550	N/A
168	L46	H: 8-10d / J: 4-10d	710	N/A
181	HUS26	20-16d	1,550	N/A
184	HUC28-2	H: 14-16d / J: 4-10d	1,085	N/A
186	HUCQ210-2-SDS	H: 12-14" x 2-1/2" SDS J: 6-14" x 2-1/2" TITEN T.*	2,345	N/A
190	HU210-2	CMU: 8-14" x 2-1/2" TITEN T.* J: 10-0-148x3"	1,800 U 5,095 D.	N/A
191	HU28	CMU: 8-14" x 2-1/2" TITEN T.* J: 10-0-148x1 1/2"	545 U 1,700 D.	N/A
214	HUC212-3TF	HD: 16-3/16" x 1 1/2" TAPCON BM: 8-16d	1,135	N/A
215	HGUS210-2	HDR: 46-16d / JST: 10-16d	2,720	N/A
216	HUS412	BLOCK: 10-1/2" x 1 1/2" TC JOIST: 10-16d	3,240	N/A
217	HUS212-2	BLOCK: 10-1/2" x 1 1/2" TC JOIST: 10-16d	2,830	N/A
219	MBH412	H: 1-ATR34X8 TOP&FACE JOIST: 18-10d	3,145	N/A
226	MBH44.75/12	HDR: (2) 3/4" φ x 8" JOIST: 18-10d	2,160	N/A

NOTES:

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH 8TH EDITION 2023 FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZE BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPWV10CA BCB 1.
- REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- ROOF UNDERLAYMENT TO BE USED IS 30 LBS. SYNTHETIC FELT.
- TILE ROOF UNDERLAYMENT TO BE INSTALLED IN ACCORDANCE WITH 8TH EDITION R605.1.1.1 UNDERLAYMENT MATERIALS REQUIRED TO COMPLY WITH ASTM D226, D1970, D4889 AND D4957 SHALL BEAR A LABEL INDICATING COMPLIANCE TO THE STANDARD DESIGNATION AND, IF APPLICABLE, TYPE CLASSIFICATION INDICATED IN TABLE R605.1.1.1 UNDERLAYMENT SHALL BE APPLIED AND ATTACHED IN ACCORDANCE WITH TABLE R605.1.1.1.
- OFF ROOF VENTS MAXIMUM OPENING SIZES: REFER TO MANUFACTURE SPECIFICATIONS.


FIELD REPAIR NOTES

- MISSED HOISTING POINTS MAY BE SUBSTITUTED BY A STRAIGHT REBAR SET IN A 30" DIA. 4" DEEP HOLE FILLED W/ EPOXY PROPORT 300 OR SIMPSON SET OR ETT ADHESIVE.
- BLOCK WALL OVERHANGING SLAB CONDITION UP TO 78" - NO REBAR NECESSARY 78" TO 100" - ADD FILLED CELL AND VERTICAL STEEL REINFORCEMENT OF WALL BETWEEN EXISTING FILLED CELLS WITH STEEL IN AREAS AFFECTED 100" - REQUIRE SPECIAL ENGINEERING LETTERS.
- PENETRATION OF PLUMBING PIPES/DRYER VENTS THRU PLATES OF A LOAD BEARING WALL MAY OCCUR PROVIDED DR. STUDS ARE ADDED ON EITHER SIDE OF PENETRATION WITHIN 2" AND TRUSS/ROOF TRUSSES IS NO CLOSER THAN 2" FROM PENETRATION. ADD (1) MTS12 @ TOP AND BOTTOM PLATE.

COMPONENT & CLADDING DESIGN WIND PRESSURES

SEE PLAN DESIGN WIND PRESSURE

+0.00 ULTIMATE DESIGN POSITIVE PRESSURE
-0.00 ULTIMATE DESIGN NEGATIVE PRESSURE
 NOTE: DESIGN PRESSURES BASED ULTIMATE WIND SPEED TO OBTAIN NOMINAL "ASD" WIND PRESSURES MULTIPLY VALUES SHOWN BY A FACTOR OF 0.8

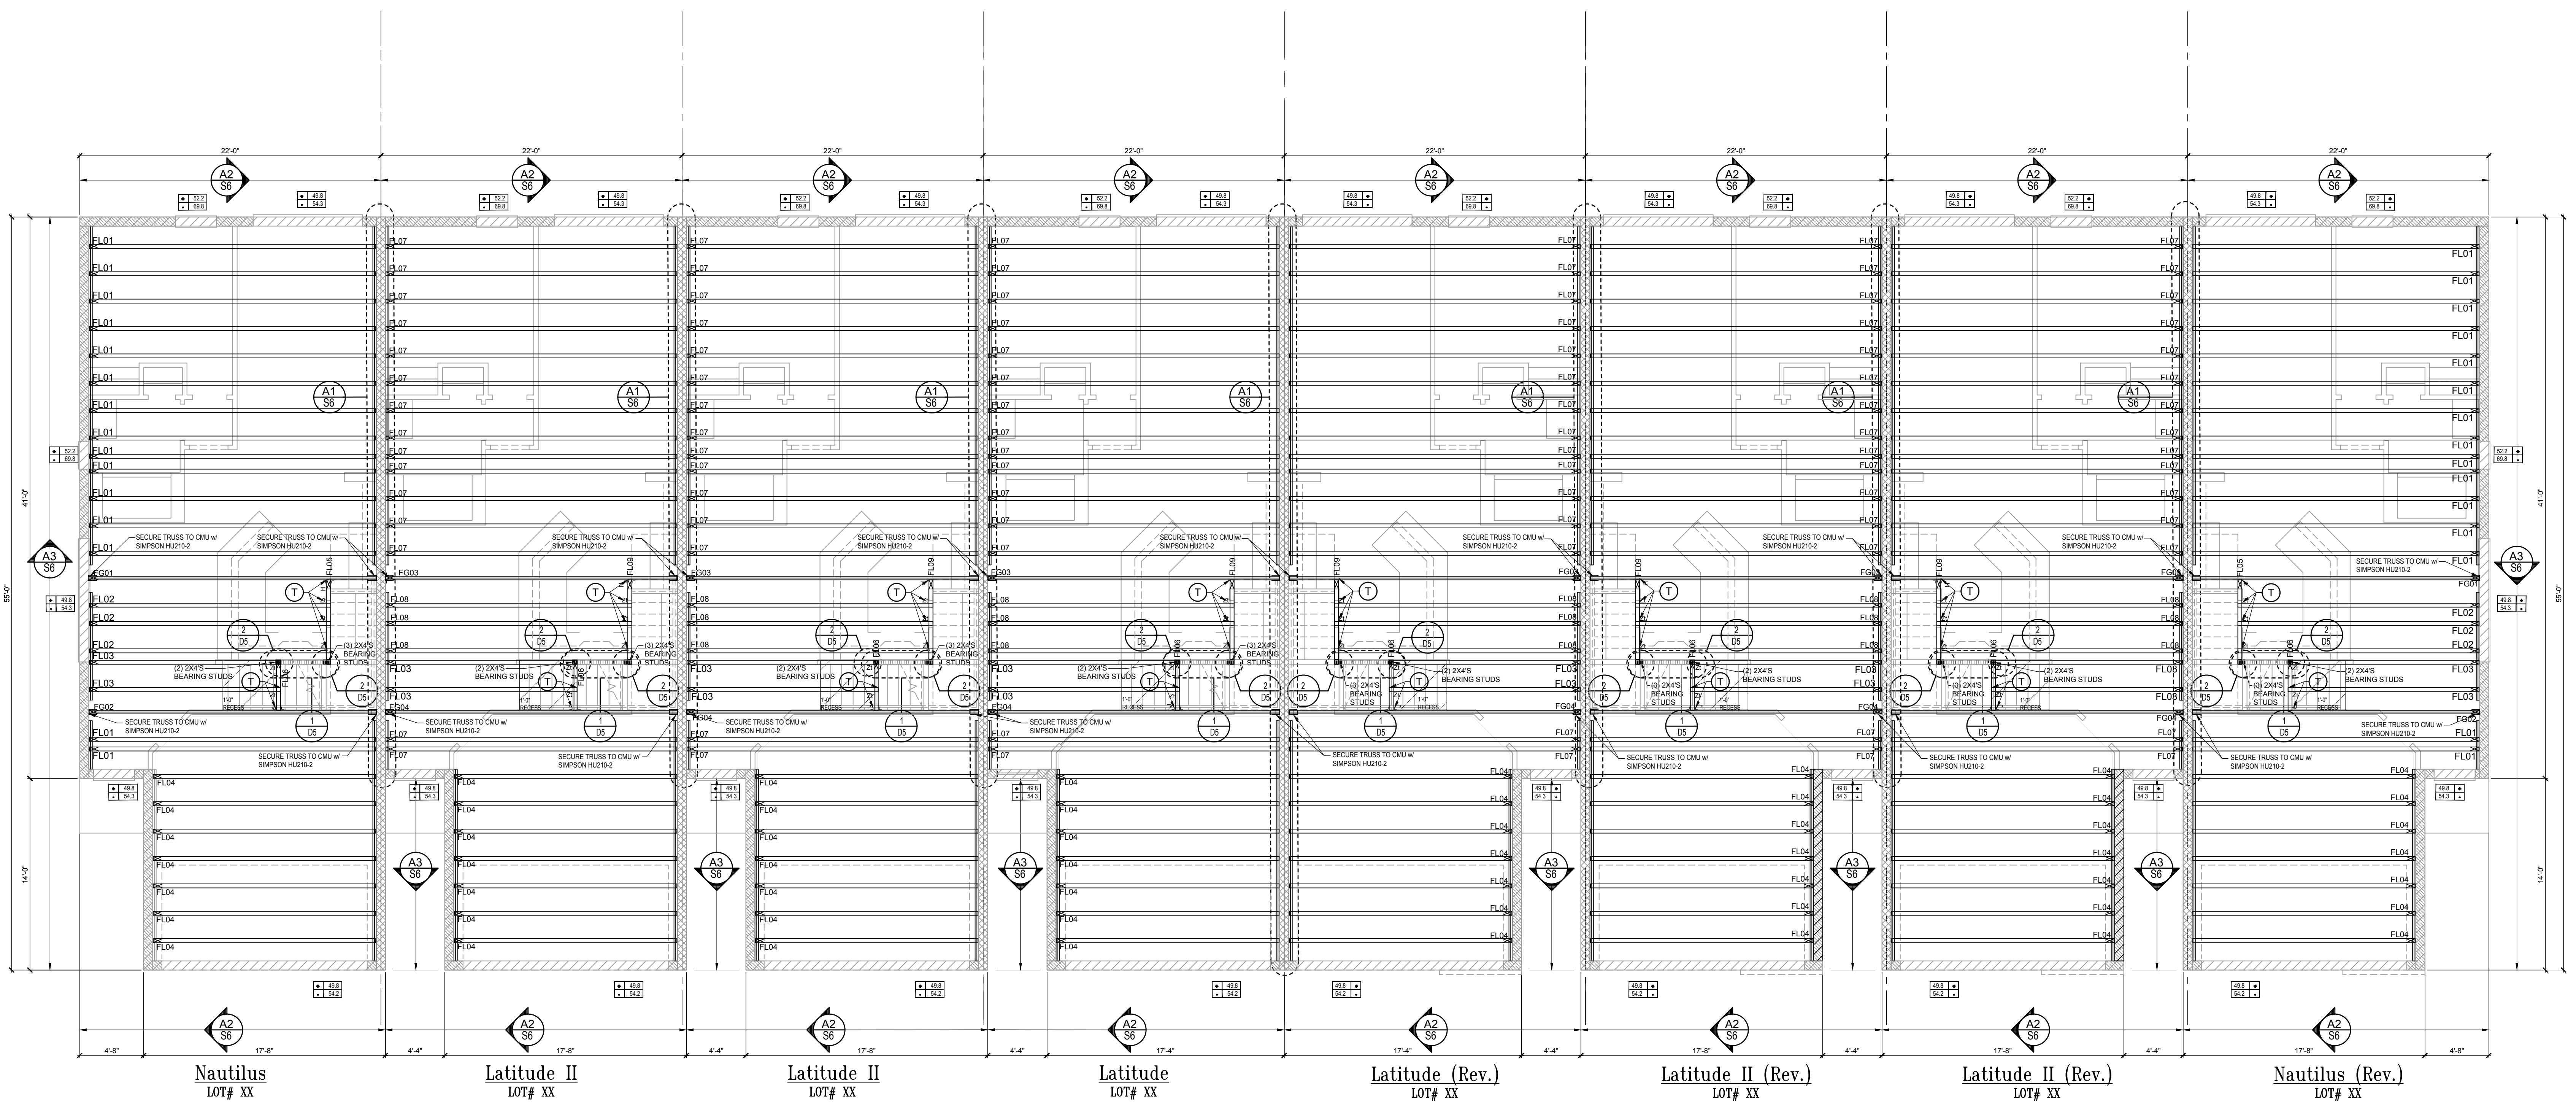

Floor Framing Plan
SCALE: 3/16" = 1'-0"

HTEG
THOMPSON ENGINEERING GROUP, INC.
4401 Vineland Road, Suite A8, Orlando, FL 32811
Ph: (407) 241-1150
www.hteg.com

815 Orienta Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignersgroup.com
COPYRIGHT NOTICE: THESE PLANS, DESIGNS, AND DRAWINGS ARE THE SOLE PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

MJS
designers group
residential-commercial-architecture

A | B | D

GOBA
GROUP OF BUILDERS ASSOCIATION

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pac # XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A Division of Park Square
Enterprises Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE	03/06/2023
REVISIONS	
PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS
FLOOR PLAN LEVEL:	A 8 UNIT
S4	

CONNECTOR SCHEDULE

CONNECTOR TYPE	SIMPSON DESCRIPTION	FASTENERS PER CONNECTOR	MAX. UPLIFT	LAT. LDS. F1/F2
4	HETA20	14-10d x 1 1/2"	1,810	65 / 960
5	DETA20	18-10d x 1 1/2"	2,480	2000 / 1370
20	H3	RFT: 4-8d / PLT: 4-8d	455	125 / 160
21	H1	RFT: 6-8d x 1 1/2" / PLT: 4-8d	475	485 / 195
22	H10A OR MTS12	RFT: 8-8d x 1 1/2" / PLT: 8-8d x 1 1/2"	1010	680 / 550
23	LUS26	HDR: 4-10d JST: 4-10d / RFT: TRS: 4-8d / PLT: STD: 10-8d	935	N/A
24	H7	RFT: 8-8d x 1 1/2"	985	400 / N/A
26	H2.5	RFT: 5-8d / PLT: 5-8d	415	150 / 150
34	A34	H: 4-8d x 1 1/2" / P: 4-8d x 1 1/2"	365	280 / 303
35	A35F	H: 4-8d x 1 1/2" / P: 4-8d x 1 1/2"	440	440 / N/A
37	MTS12	14-10d	990	N/A
38	MTS16	14-10d	990	N/A
39	MTS30	14-10d	990	N/A
43	LSTA12	10-10d	905	N/A
45	ST18	14-16d	1,200	N/A
47	LSTA24	18-10d	1,295	N/A
71	MSTA36	26-10d	2,135	N/A
72	MSTC66	64-16d SINKERS	5,495	N/A
78	SP1	STD: 6-10d / PLT: 6-10d	535	560 / 260
80	SP2	STD: 6-10d / PLT: 6-10d	605	560 / 260
81	SPH4.6.8	12-10d x 1 1/2"	885	N/A
90	ABU66	12-16d	2,240	N/A
89	CB66	(2) 7/8" BOLTS	2,300	985
92	ABU44	12-16d	2,200	N/A
93	AC6 (MAX)	28-16d	1,815	1,070

94	AC4 (MAX)	28-16d	1,815	1,070
95	HTS20	20-10d	1,450	N/A
96	HDBA	SILL: 7/8" BOLT / STUD: (3) 7/8"x5 1/2" BOLTS	7,910	N/A
97	MTSM16	BLOCK: 4-1/2"x2 1/4" TC JOIST: 7-10d	860	N/A
98	HTT4	SILL: 5/8" BOLT / STRAP: 18-16d	4,235	N/A
99	A35	H: 4-8d x 1 1/2" / P: 4-8d x 1 1/2"	440	440 / N/A
102	HTT5	5/8" BOLT: 28-10d	4,275	N/A
103	VGTR1L	32-SDS: 1/2"x3(2) 7/8" BLT	3,990	N/A
104	HDB8-SDS2.5	7/8" BLT: 20-SDS 1/2"x2 1/2"	5,020	N/A
110	HCP2	12-10d x 1 1/2"	520	260 / N/A
167	HHUS46	H: 14-16d J: 8-16d	1,550	N/A
168	L46	H: 8-10d J: 4-10d	710	N/A
181	HUS26	20-16d	1,550	N/A
184	HUC28-2	H: 14-16d J: 4-10d	1,085	N/A
186	HUCQ210-2-SDS	H: 12-14"x2-1/2" SDS* / J: 6-14"x2-1/2" SDS*	2,345	N/A
190	HU210-2	CMU: 18-14"x2-1/2" TITEN T.* / J: 10-0.148x3"	1,800 U / 5,095 D	N/A
191	HU28	CMU: 6-14"x2-1/2" TITEN T.* / J: 10-0.148x1 1/2"	545 U / 1,700 D	N/A
214	HUC212-3TF	HD: 16-3/16"x1 1/2" TAPCON / BM: 8-16d	1,135	N/A
215	HGUS210-2	HDR: 46-16d JST: 10-16d	2,720	N/A
216	HUS412	BLOCK: 10-1/2"x1 1/2" TC JOIST: 10-16d	3,240	N/A
217	HUS212-2	BLOCK: 10-1/2"x1 1/2" TC JOIST: 10-16d	2,630	N/A
219	MBHA412	H: 1-ATRS: 4x8 TOP: 8" FACE / JOIST: 18-10d	3,145	N/A
226	MBHA4.75/12	HDR: (2) 3/4" x 8" JOIST: 18-10d	2,160	N/A

FIELD REPAIR NOTES

1. MISSED FOOTING DOWNLAYS MAY BE SUBSTITUTED BY A STRAIGHT AS BEAR SET IN A 3/4" DIA. 4" DEEP HOLE FILLED WITH EPOXY PROPOR 300 OR EMPION SET OR EPO ADHESIVES.
2. BLOCK WALL OVERHANGING SLAB CONDITION UP TO 26". NO REPAIR NECESSARY PER TO 10". ADD TILLO CELL AND VERTICAL STEEL MIDPOINT OF WALL BETWEEN EXISTING FILLED CELLS WITH STEEL IN AREAS AFFECTED. 13 - REQUIRE SPECIAL ENGINEERING LETTER.
3. PENETRATION OF PLUMBING PIPES OVER VENTS THROUGH SLAB OR ALCOHOL BEARING WALL MAY OCCUR PROVIDED DSB. STUDS ARE ADDED ON EITHER SIDE OF PENETRATOR WITH 3" AND TRUSSES/ROOF TRUSSES NO CLOSER THAN 3" FROM PENETRATOR. ADD (1) MTS12 @ TOP AND BOTTOM FLATE.

COMPONENT & CLADDING DESIGN WIND PRESSURES


SEE PLAN DESIGN WIND PRESSURE

XXX ULTIMATE DESIGNED POSITIVE PRESSURE
XXX ULTIMATE DESIGNED NEGATIVE PRESSURE

NOTE: DESIGN PRESSURES BASED ULTIMATE WIND SPEED TO OBTAIN NOMINAL WIND PRESSURES MULTIPLY VALUES SHOWN BY A FACTOR OF 0.6

NOTES

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZE BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH PW1717(CA) BCS-1.
6. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TRUSS CONNECTIONS.
7. ROOF UNDERLAYMENT TO BE USED IS 30 LBS. SYNTHETIC FELT.
8. TILE ROOF UNDERLAYMENT TO BE INSTALLED IN ACCORDANCE WITH ASTM F2258, 8TH EDITION R05.1.1.1. UNDERLAYMENT MATERIALS REQUIRED TO COMPLY WITH ASTM D226, D1970, D4889 AND D9757 SHALL BEAR A LABEL INDICATING COMPLIANCE TO THE STANDARD DESIGNATION AND, IF APPLICABLE, TYPE CLASSIFICATION INDICATED IN TABLE R05.1.1.1. UNDERLAYMENT SHALL BE APPLIED AND ATTACHED IN ACCORDANCE WITH TABLE R05.1.1.1.
9. OFF RIDGE VENTS MAXIMUM OPENING SIZES: REFER TO MANUFACTURE SPECIFICATIONS.

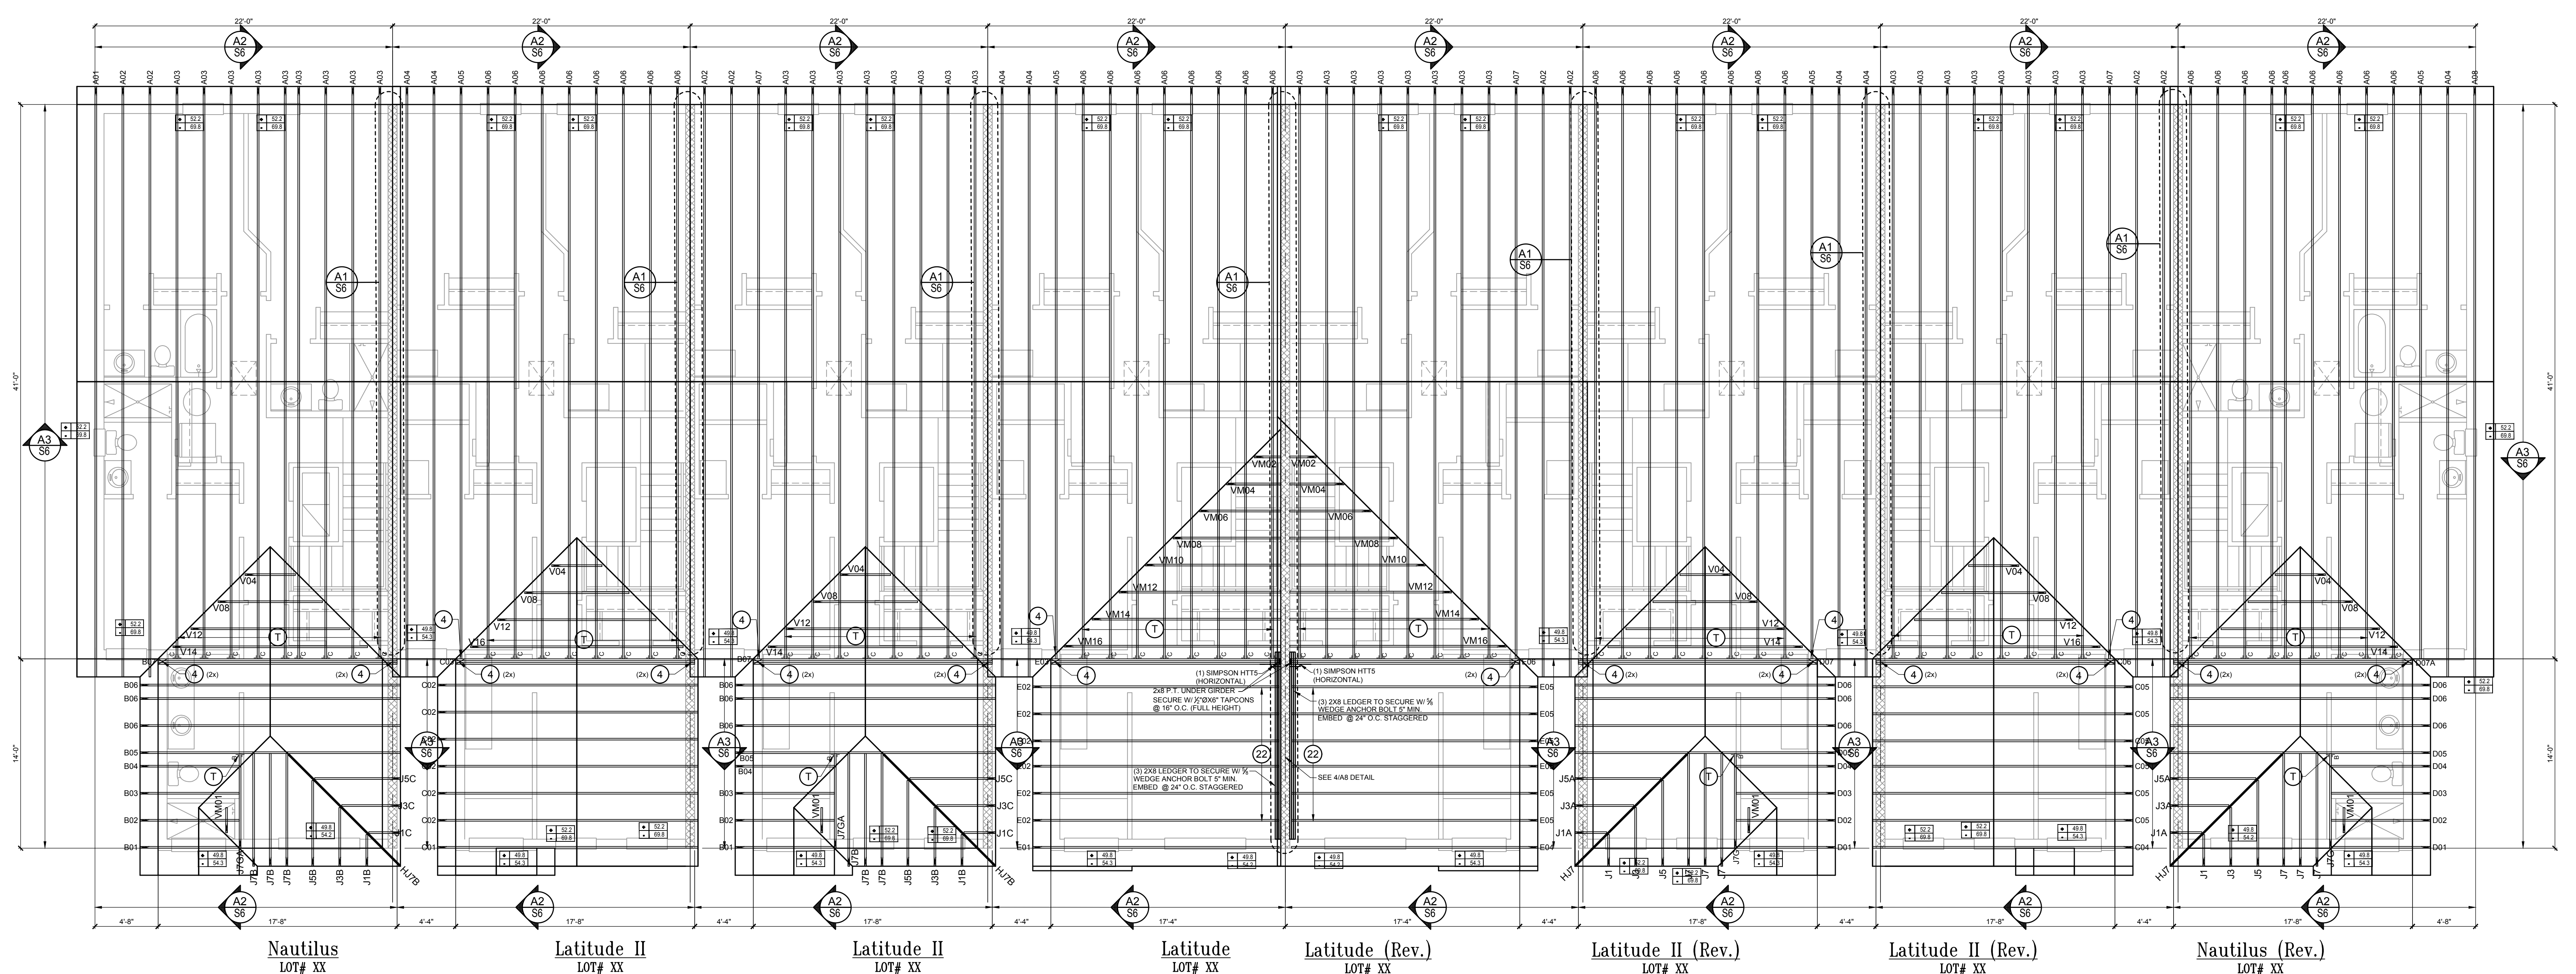

Roof Framing Plan "Elev. A"
SCALE: 3/16" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
401 Vineyard Road, Suite 46, Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1150
www.iteg.com

815 Oriole Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
www.mjsdesignersgroup.com
www.mjsdesignersgroup.com
COPYRIGHT NOTICE: THESE PLANS, DESIGNS, AND SPECIFICATIONS ARE THE SOLE PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

MJS
designers group
residential-commercial-architecture

AIBD

GOBA
DESIGN PROFESSIONAL ASSOCIATE

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pad #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A Division of Park Square Enterprises, Inc.
5200 Vineyard Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE: 03/06/2023
REVISIONS:

PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

ROOF PLAN ELEV. A
S5

CONNECTOR SCHEDULE

CONNECT. TYPE	SIMPSON DESCRIPTION	FASTENERS PER CONNECTOR	MAX. UPLIFT	LAT. LDS. F1 / F2
4	HETA20	14-10d x 1 1/2"	1,810	65 / 960
5	DETA20	18-10d x 1 1/2"	2,480	2000 / 1370
20	H3	RFT: 4-8d / PLT: 4-8d	455	125 / 160
21	H1	RFT: 6-8d x 1 1/2" / PLT: 4-8d	475	485 / 195
22	H10A OR MTS12	RFT: 8-8d x 1 1/2" / PLT: 8-8d x 1 1/2"	1010	680 / 550
23	LUS26	HDR: 4-10d JST: 4-10d	935	N/A
24	H7	RFT / TRS: 4-8d / PLT / STD: 10-8d	985	400 / N/A
26	H2.5	RFT: 5-8d / PLT: 5-8d	415	150 / 150
34	A34	H:4-8d x 1 1/2" / P:4-8d x 1 1/2"	365	280 / 303
35	A35F	H:4-8d x 1 1/2" / P:4-8d x 1 1/2"	440	440 / N/A
37	MTS12	14-10d	990	N/A
38	MTS16	14-10d	990	N/A
39	MTS30	14-10d	990	N/A
43	LSTA12	10-10d	905	N/A
45	ST18	14-16d	1,200	N/A
47	LSTA24	18-10d	1,295	N/A
71	MSTA36	26-10d	2,135	N/A
72	MSTC66	64-16d SINKERS	5,495	N/A
78	SP1	STD: 6-10d / PLT: 4-10d	535	560 / 260
80	SP2	STD: 6-10d / PLT: 6-10d	605	560 / 260
81	SPH4.6.8	12-10d x 1 1/2"	885	N/A
90	ABU66	12-16d	2,240	N/A
89	CB66	(2) 7/8" BOLTS	2,300	985
92	ABU44	12-16d	2,200	N/A
93	AC6 (MAX)	28-16d	1,815	1,070
94	AC4 (MAX)	28-16d	1,815	1,070
95	HTS20	20-10d	1,450	N/A
96	HD8A	SILL: 7/8" BOLT	7,910	N/A
97	MTSM16	STUD: (3) 7/8"x5 1/2" BOLTS	860	N/A
98	HTT4	BLOCK: 4-1/2"x2 1/2" TC JOIST: 7-10d	4,235	N/A
99	A35	SILL: 5/8" BOLT	440	440 / N/A
102	HTT5	STRAP: 18-16d	4,275	N/A
103	VGTR1L	H:4-8d x 1 1/2" / P:4-8d x 1 1/2"	3,990	N/A
104	HDU8-SDS2.5	5/8" BOLT: 28-10d	5,020	N/A
110	HCP2	32-SDS1/2"x3/2"(2) 7/8" BLT	520	260 / N/A
167	HHUS46	7/8" BLT: 20-SDS 1/2"x2 1/2"	1,550	N/A
168	L46	12-10d x 1 1/2"	710	N/A
181	HUS26	H:14-16d J:4-10d	1,550	N/A
184	HUC28-2	H:14-16d J:4-10d	1,085	N/A
186	HUC210-2-SDS	H:12-14"x2-1/2" SDS* J:6-14"x2-1/2" SDS*	2,345	N/A
190	HU210-2	CMU: 18-14"x2-1/2" TITEN T.* J:10-0.148x3"	1,800 U, 5,095 D	N/A
191	HU28	CMU: 6-14"x2-1/2" TITEN T.* J:10-0.148x1 1/2"	545 U, 1,700 D	N/A
214	HUC212-3TF	HD: 16-3/16"x1 1/2" TAPCON BM: 8-16d	1,135	N/A
215	HGUS210-2	HDR: 46-16d JST: 10-16d	2,720	N/A
216	HUS412	BLOCK: 10-1/2"x1 1/2" TC JOIST: 10-16d	3,240	N/A
217	HUS212-2	BLOCK: 10-1/2"x1 1/2" TC JOIST: 10-16d	2,630	N/A
219	MBHA412	H:1-ATRS4X8 TOP/FACE JOIST: 18-10d	3,145	N/A
226	MBHA4.75/12	HDR: (2) 3/4" x 8" JOIST: 18-10d	2,160	N/A

FIELD REPAIR NOTES

1. UNSEEN FOOTING DOWNLAYS MAY BE SUBSTITUTED BY A STRAIGHT AS BEAR SET IN A 3/4" DIA. 4" DEEP HOLE FILLED WITH EPOXY PROPOX 300 OR SIMPSON SET OR EPOX ADHESIVES.
2. BLOCK WALL OVERHANGING SLAB CONDITION UP TO 26". NO REPAIRS NECESSARY PER TO 10". ADD FILL TO CELL AND VERTICAL STEEL MIDPOINT OF WALL BETWEEN EXISTING FILLED CELLS WITH STEEL IN AREAS AFFECTED. 13" - REQUIRE SPECIAL ENGINEERING LETTER.
3. PENETRATION OF PLUMBING PIPES/OVER VENTS THROUGH SLAB OR BLOCK BEARING WALL MAY OCCUR. PROVIDE DSB. STUDS ARE ADDED ON EITHER SIDE OF PENETRATOR WITHIN 2" AND TRUSS/ROOF TRUSSES NO CLOSER THAN 3" FROM PENETRATOR. ADD (1) MTS12 @ TOP AND BOTTOM PLATE.


COMPONENT & CLADDING DESIGN WIND PRESSURES

SEE PLAN DESIGN WIND PRESSURE

XXX ULTIMATE DESIGNED POSITIVE PRESSURE
-XXX ULTIMATE DESIGNED NEGATIVE PRESSURE

NOTE: DESIGN PRESSURES BASED ULTIMATE WIND SPEED TO OBTAIN NOMINAL WIND PRESSURES MULTIPLY VALUES SHOWN BY A FACTOR OF 0.6

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
 2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
 3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH 8TH EDITION 2023 FLORIDA RESIDENTIAL CODE.
 4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZE BY TRUSS MANUFACTURER OR FL. REG. ENG.
 5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPW17V1CA R051.
 6. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
 7. ROOF UNDERLAYMENT TO BE USED IS 30 LBS. SYNTHETIC FELT.
 8. TILE ROOF UNDERLAYMENT TO BE INSTALLED IN ACCORDANCE WITH TABLE R05.1.1.1 UNDERLAYMENT MATERIALS REQUIRED TO COMPLY WITH ASTM D226, D1970, D4889 AND D9757 SHALL BEAR A LABEL INDICATING COMPLIANCE TO THE STANDARD DESIGNATION AND, IF APPLICABLE, TYPE CLASSIFICATION INDICATED IN TABLE R05.1.1.1. UNDERLAYMENT SHALL BE APPLIED AND ATTACHED IN ACCORDANCE WITH TABLE R05.1.1.1.
 9. OFF RIDGE VENTS MAXIMUM OPENING SIZES: REFER TO MANUFACTURE SPECIFICATIONS.

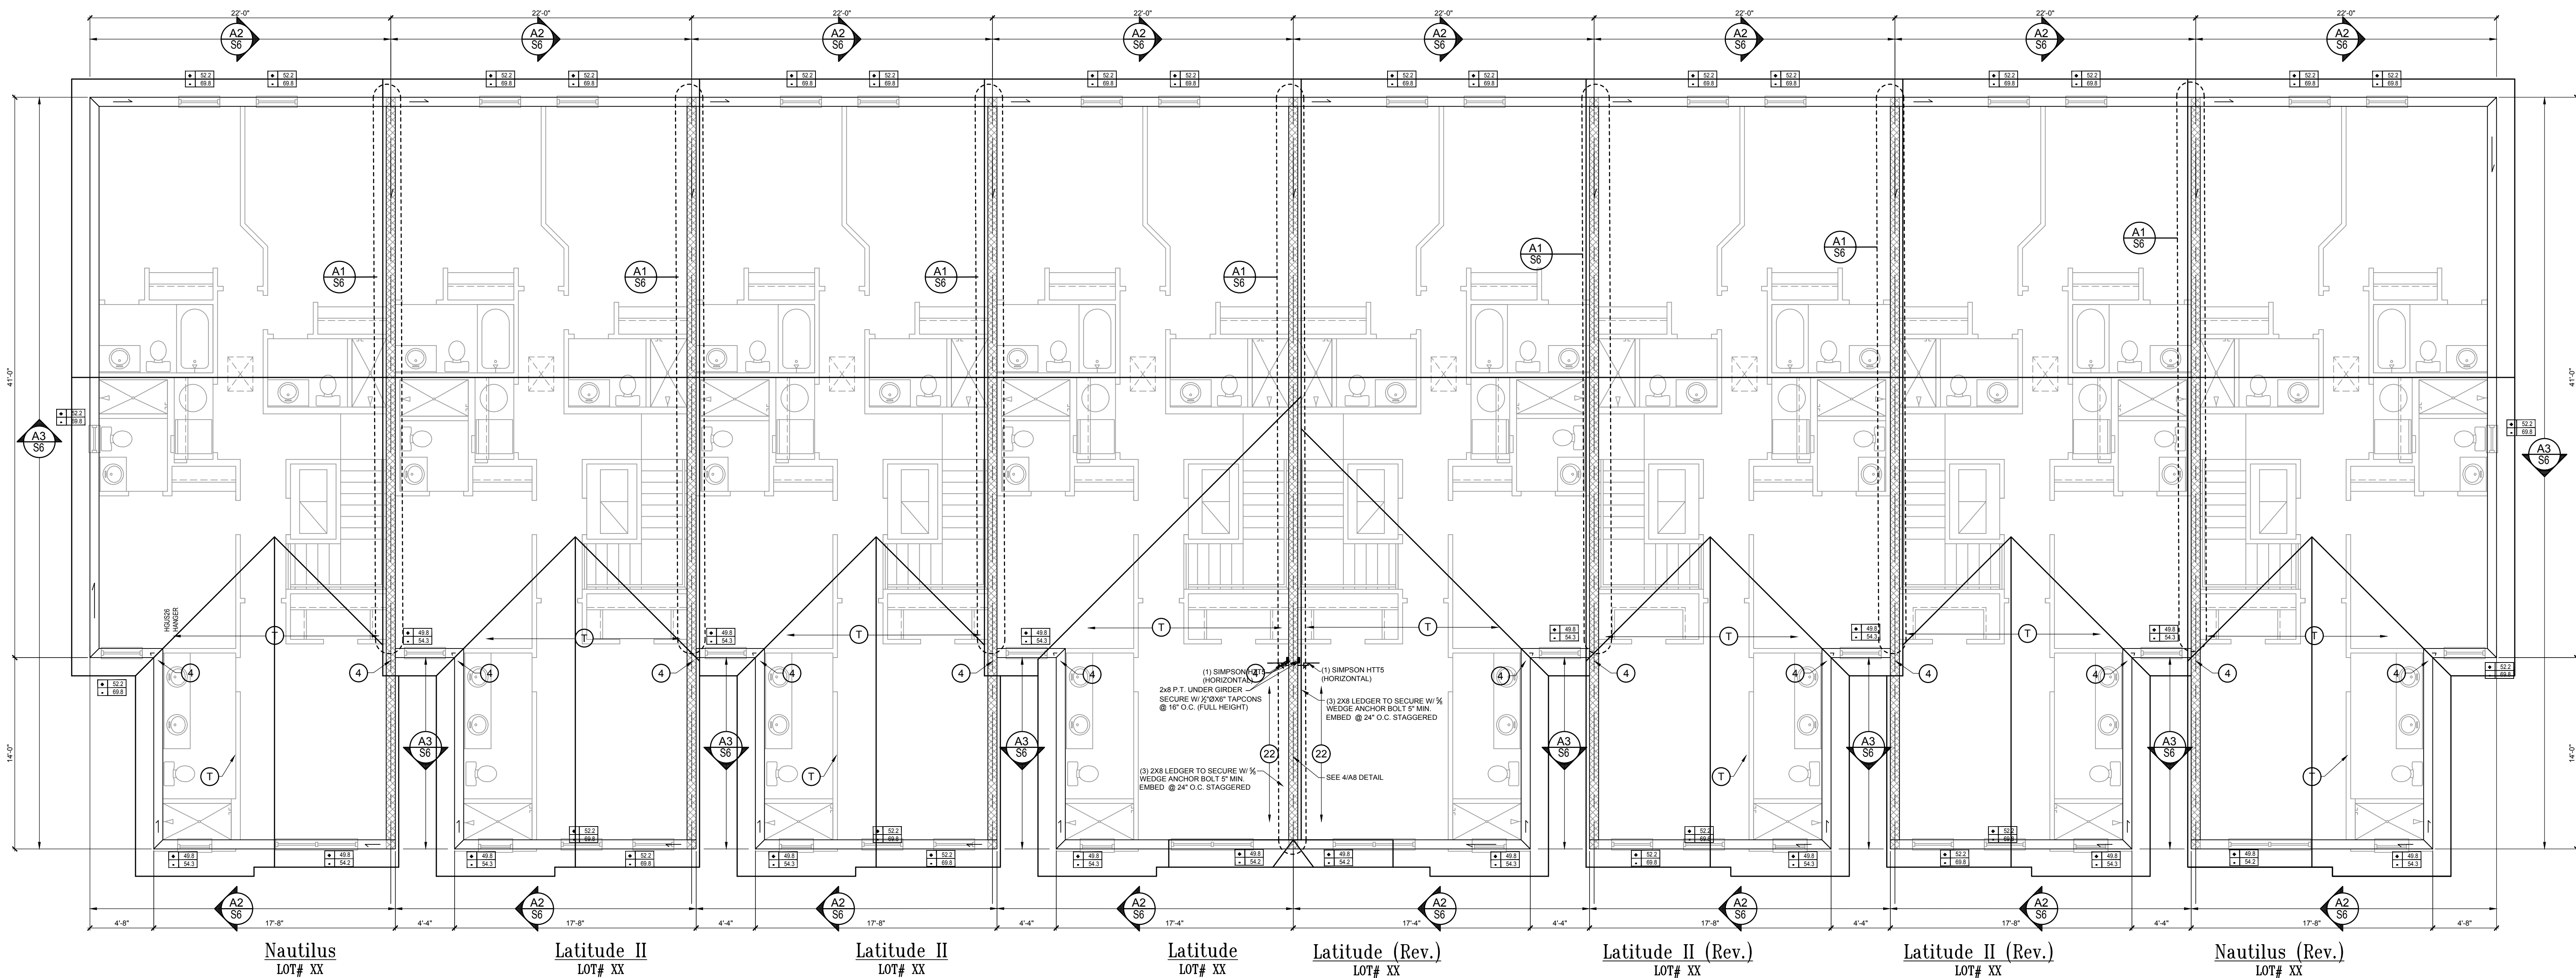

Roof Framing Plan "Elev. B"
SCALE: 3/16" = 1'-0"

ITEG
THOMPSON ENGINEERING GROUP, INC.
400 Vineland Road Suite 46 Orlando, FL 32811
Ph: (407) 334-1450
Fax: (407) 704-1150
www.iteg.com

815 Oriole Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignersgroup.com
COPYRIGHT NOTICE: THESE PLANS, DESIGNS, AND DRAWINGS ARE THE SOLE AND EXCLUSIVE PROPERTY OF MJS, INC. ALL RIGHTS RESERVED.

MJS
designers group
residential-commercial-architecture

AIBD

GOBA
GROUP OF BUILDING PROFESSIONALS ASSOCIATE

8-Unit: (Paradiso TH)
Models: Nautilus, Latitude
Building Pad #XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code


A division of Park Square Enterprises Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES


ISSUE DATE: 03/06/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

Mar 04, 2025, 3:01pm
Roof Plan Elev. B
S5

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGN ARE NOT TO BE COPIED OR MODIFIED IN ANY MANNER OR FOR WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

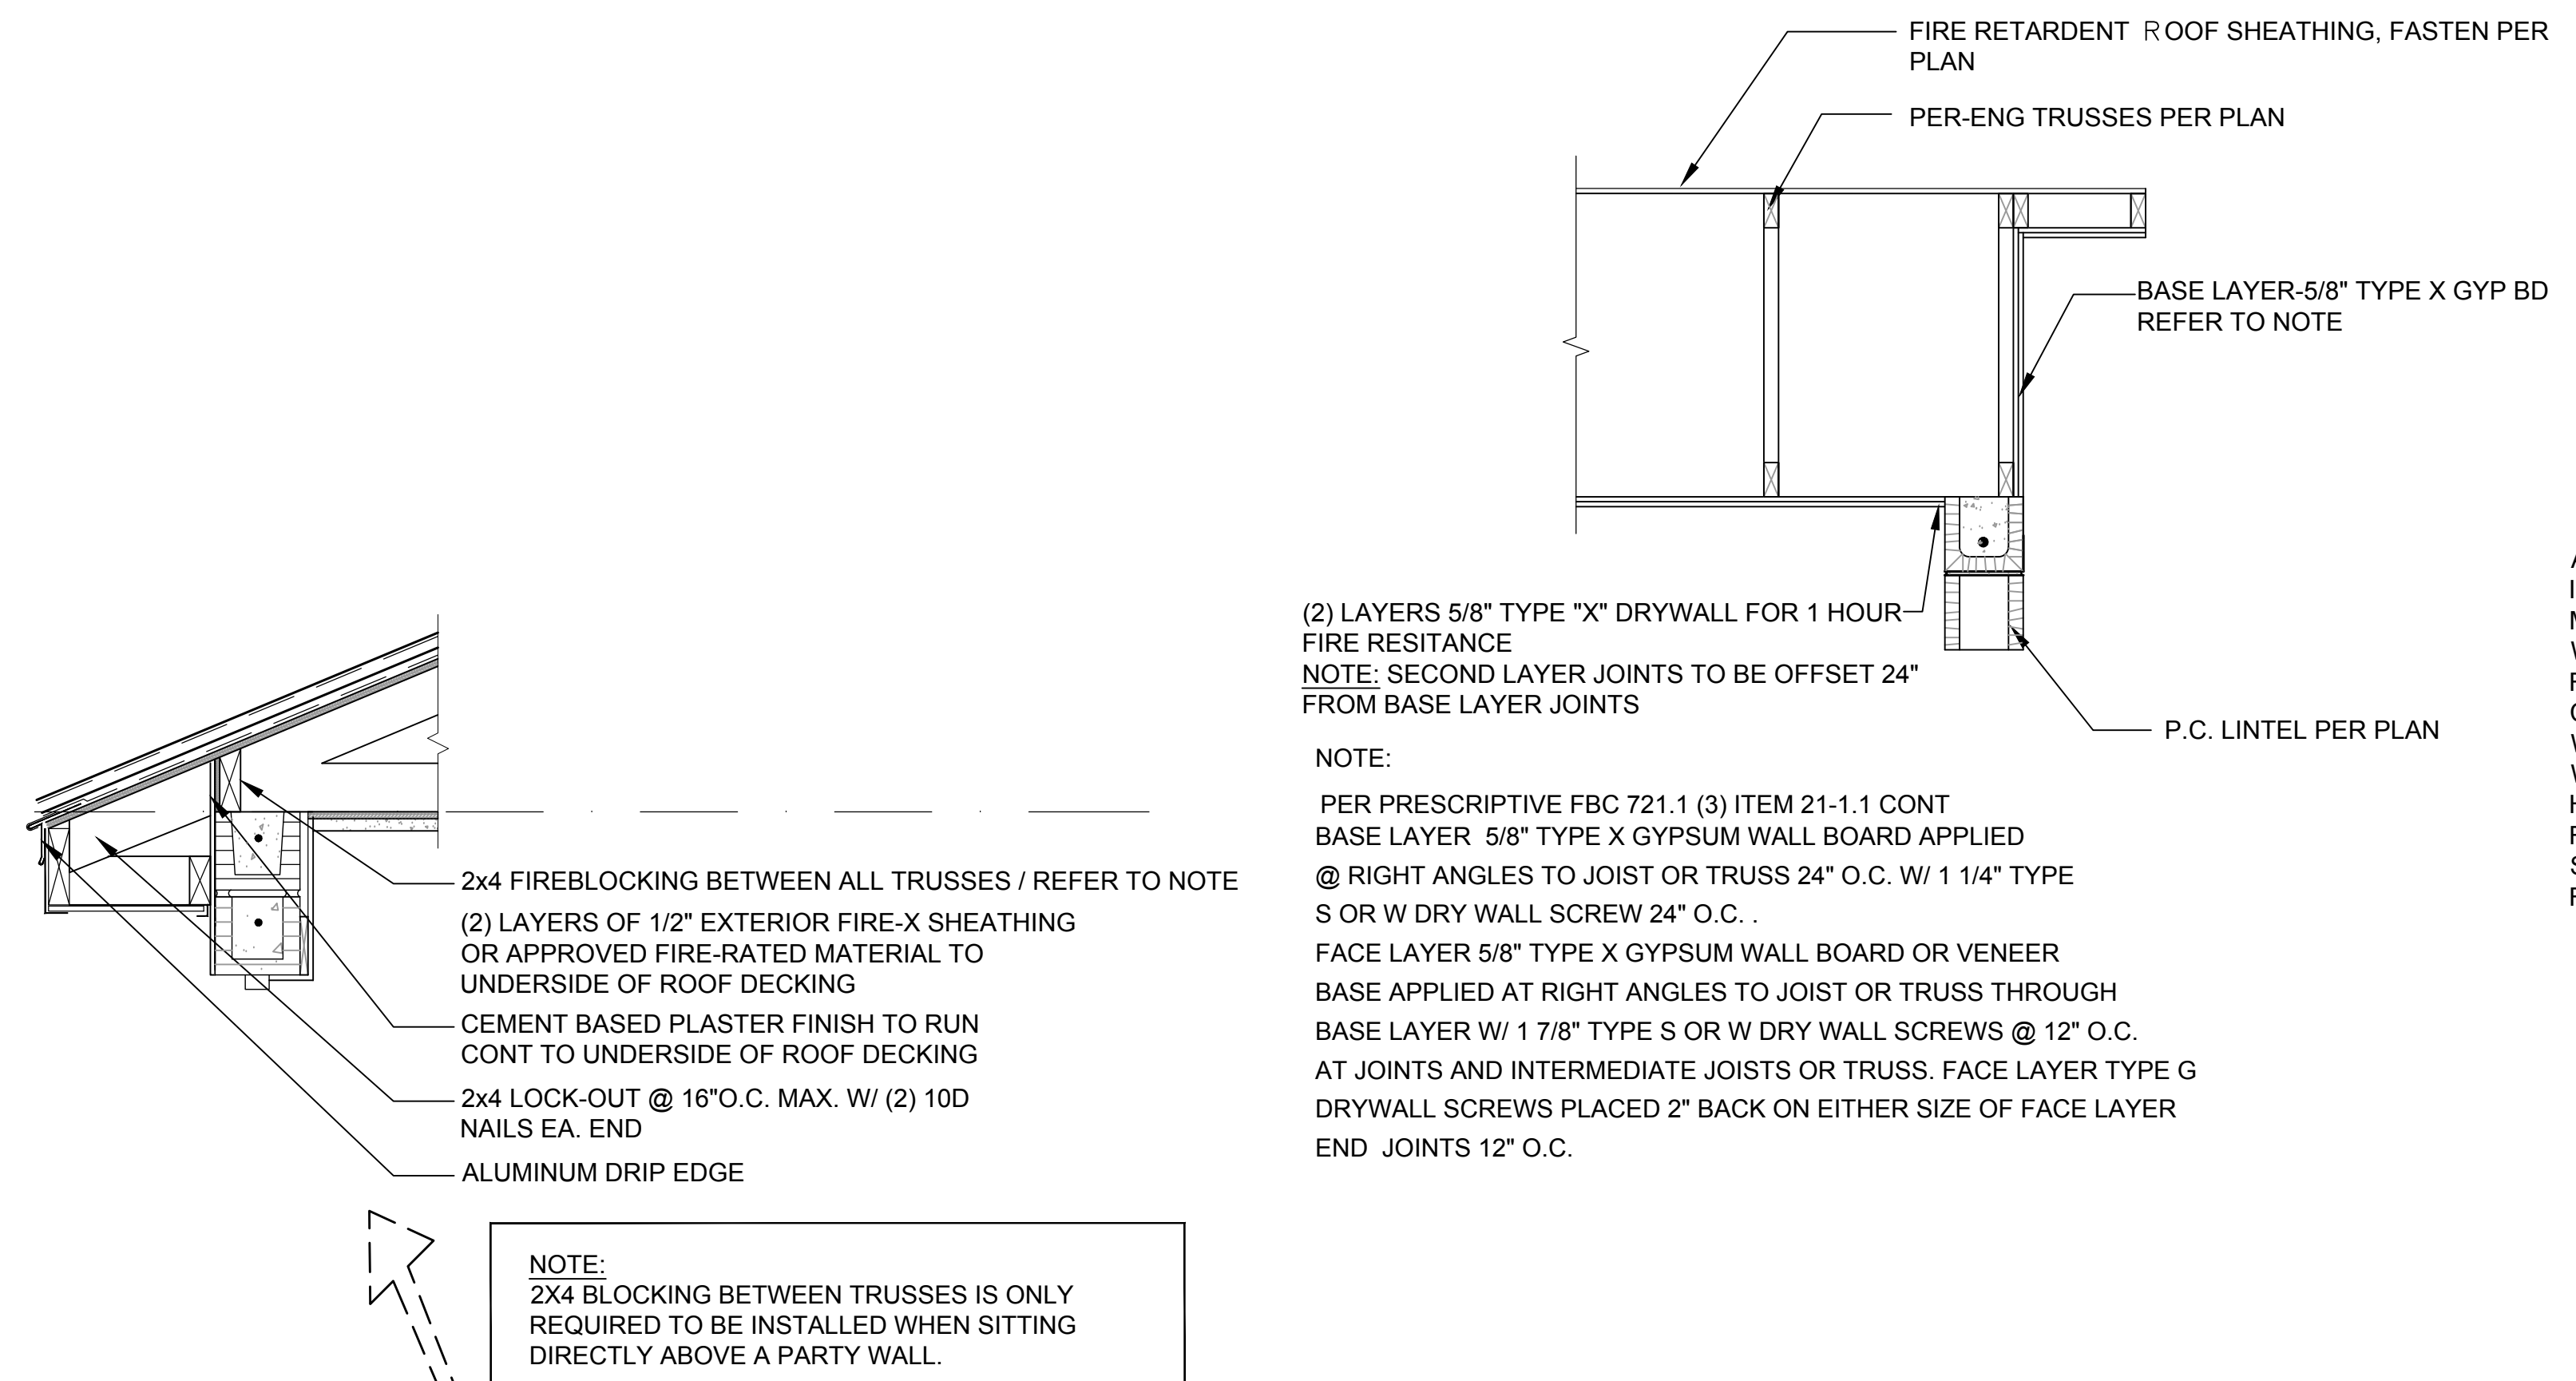


A4
S6
1-HR FIRE RATED @ GABLE
N.T.S.

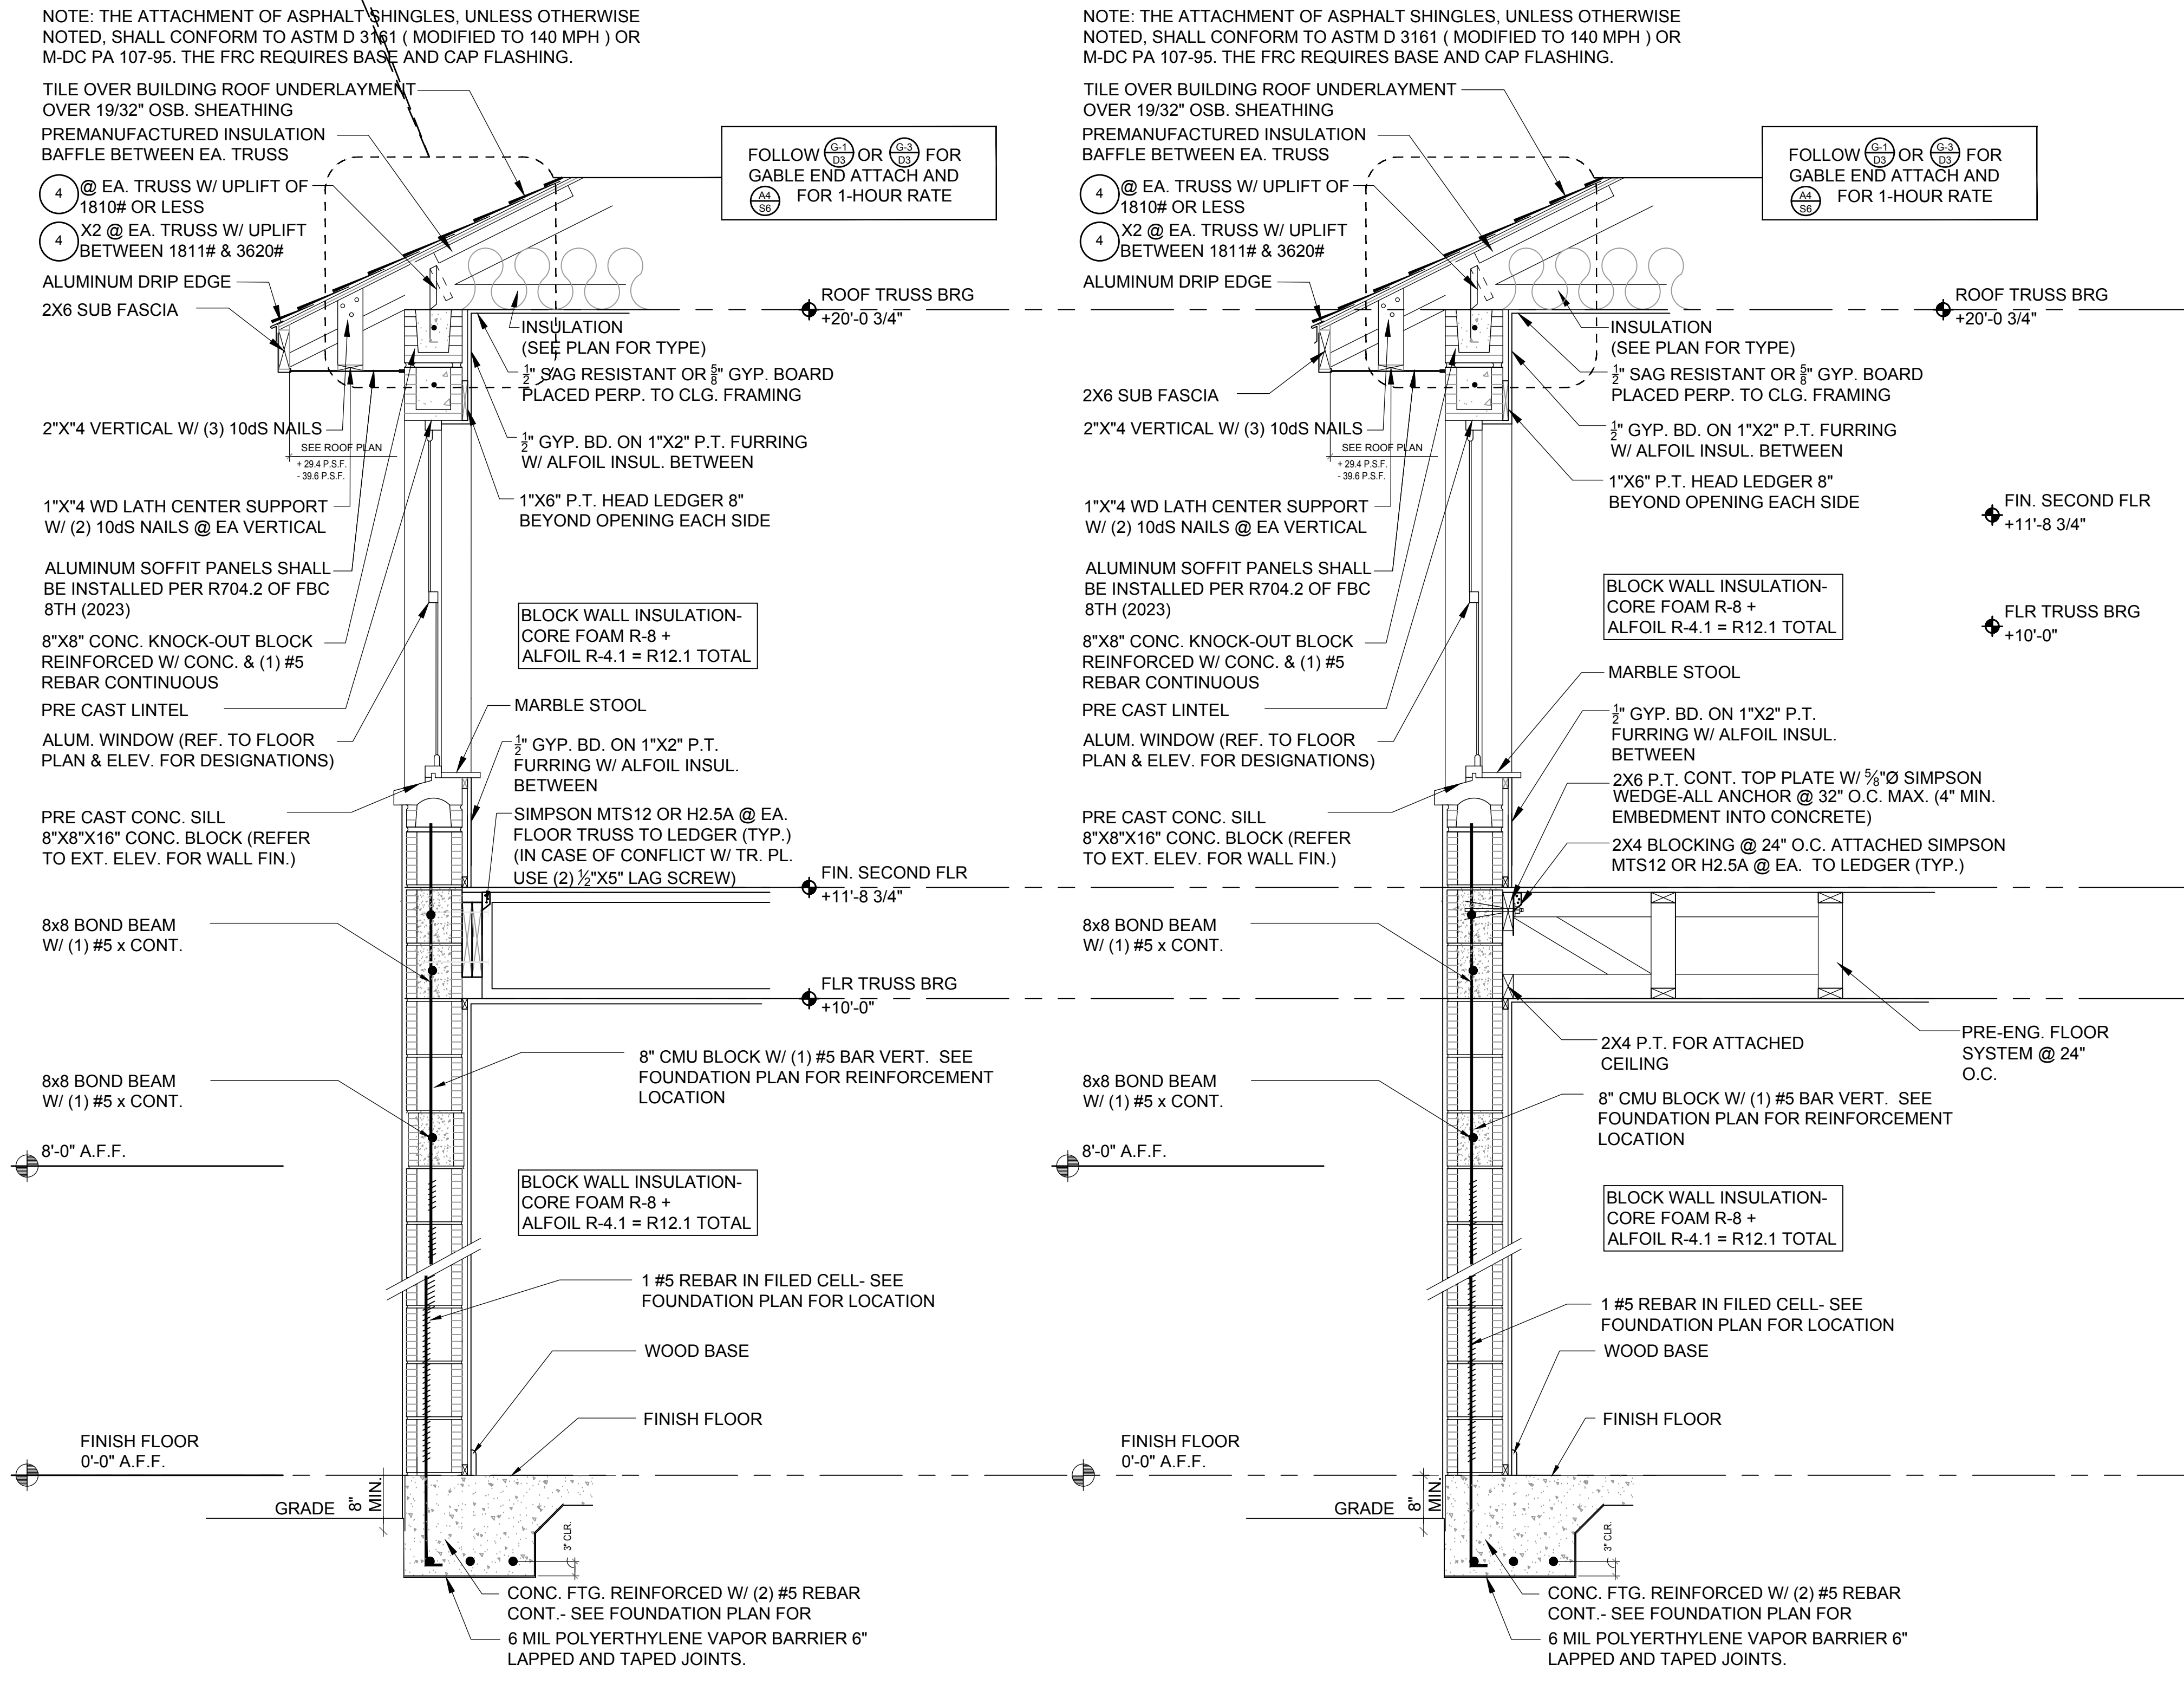


A3
S6
EXTERIOR WALL SECTION
N.T.S.

A2
S6
EXTERIOR WALL SECTION
N.T.S.

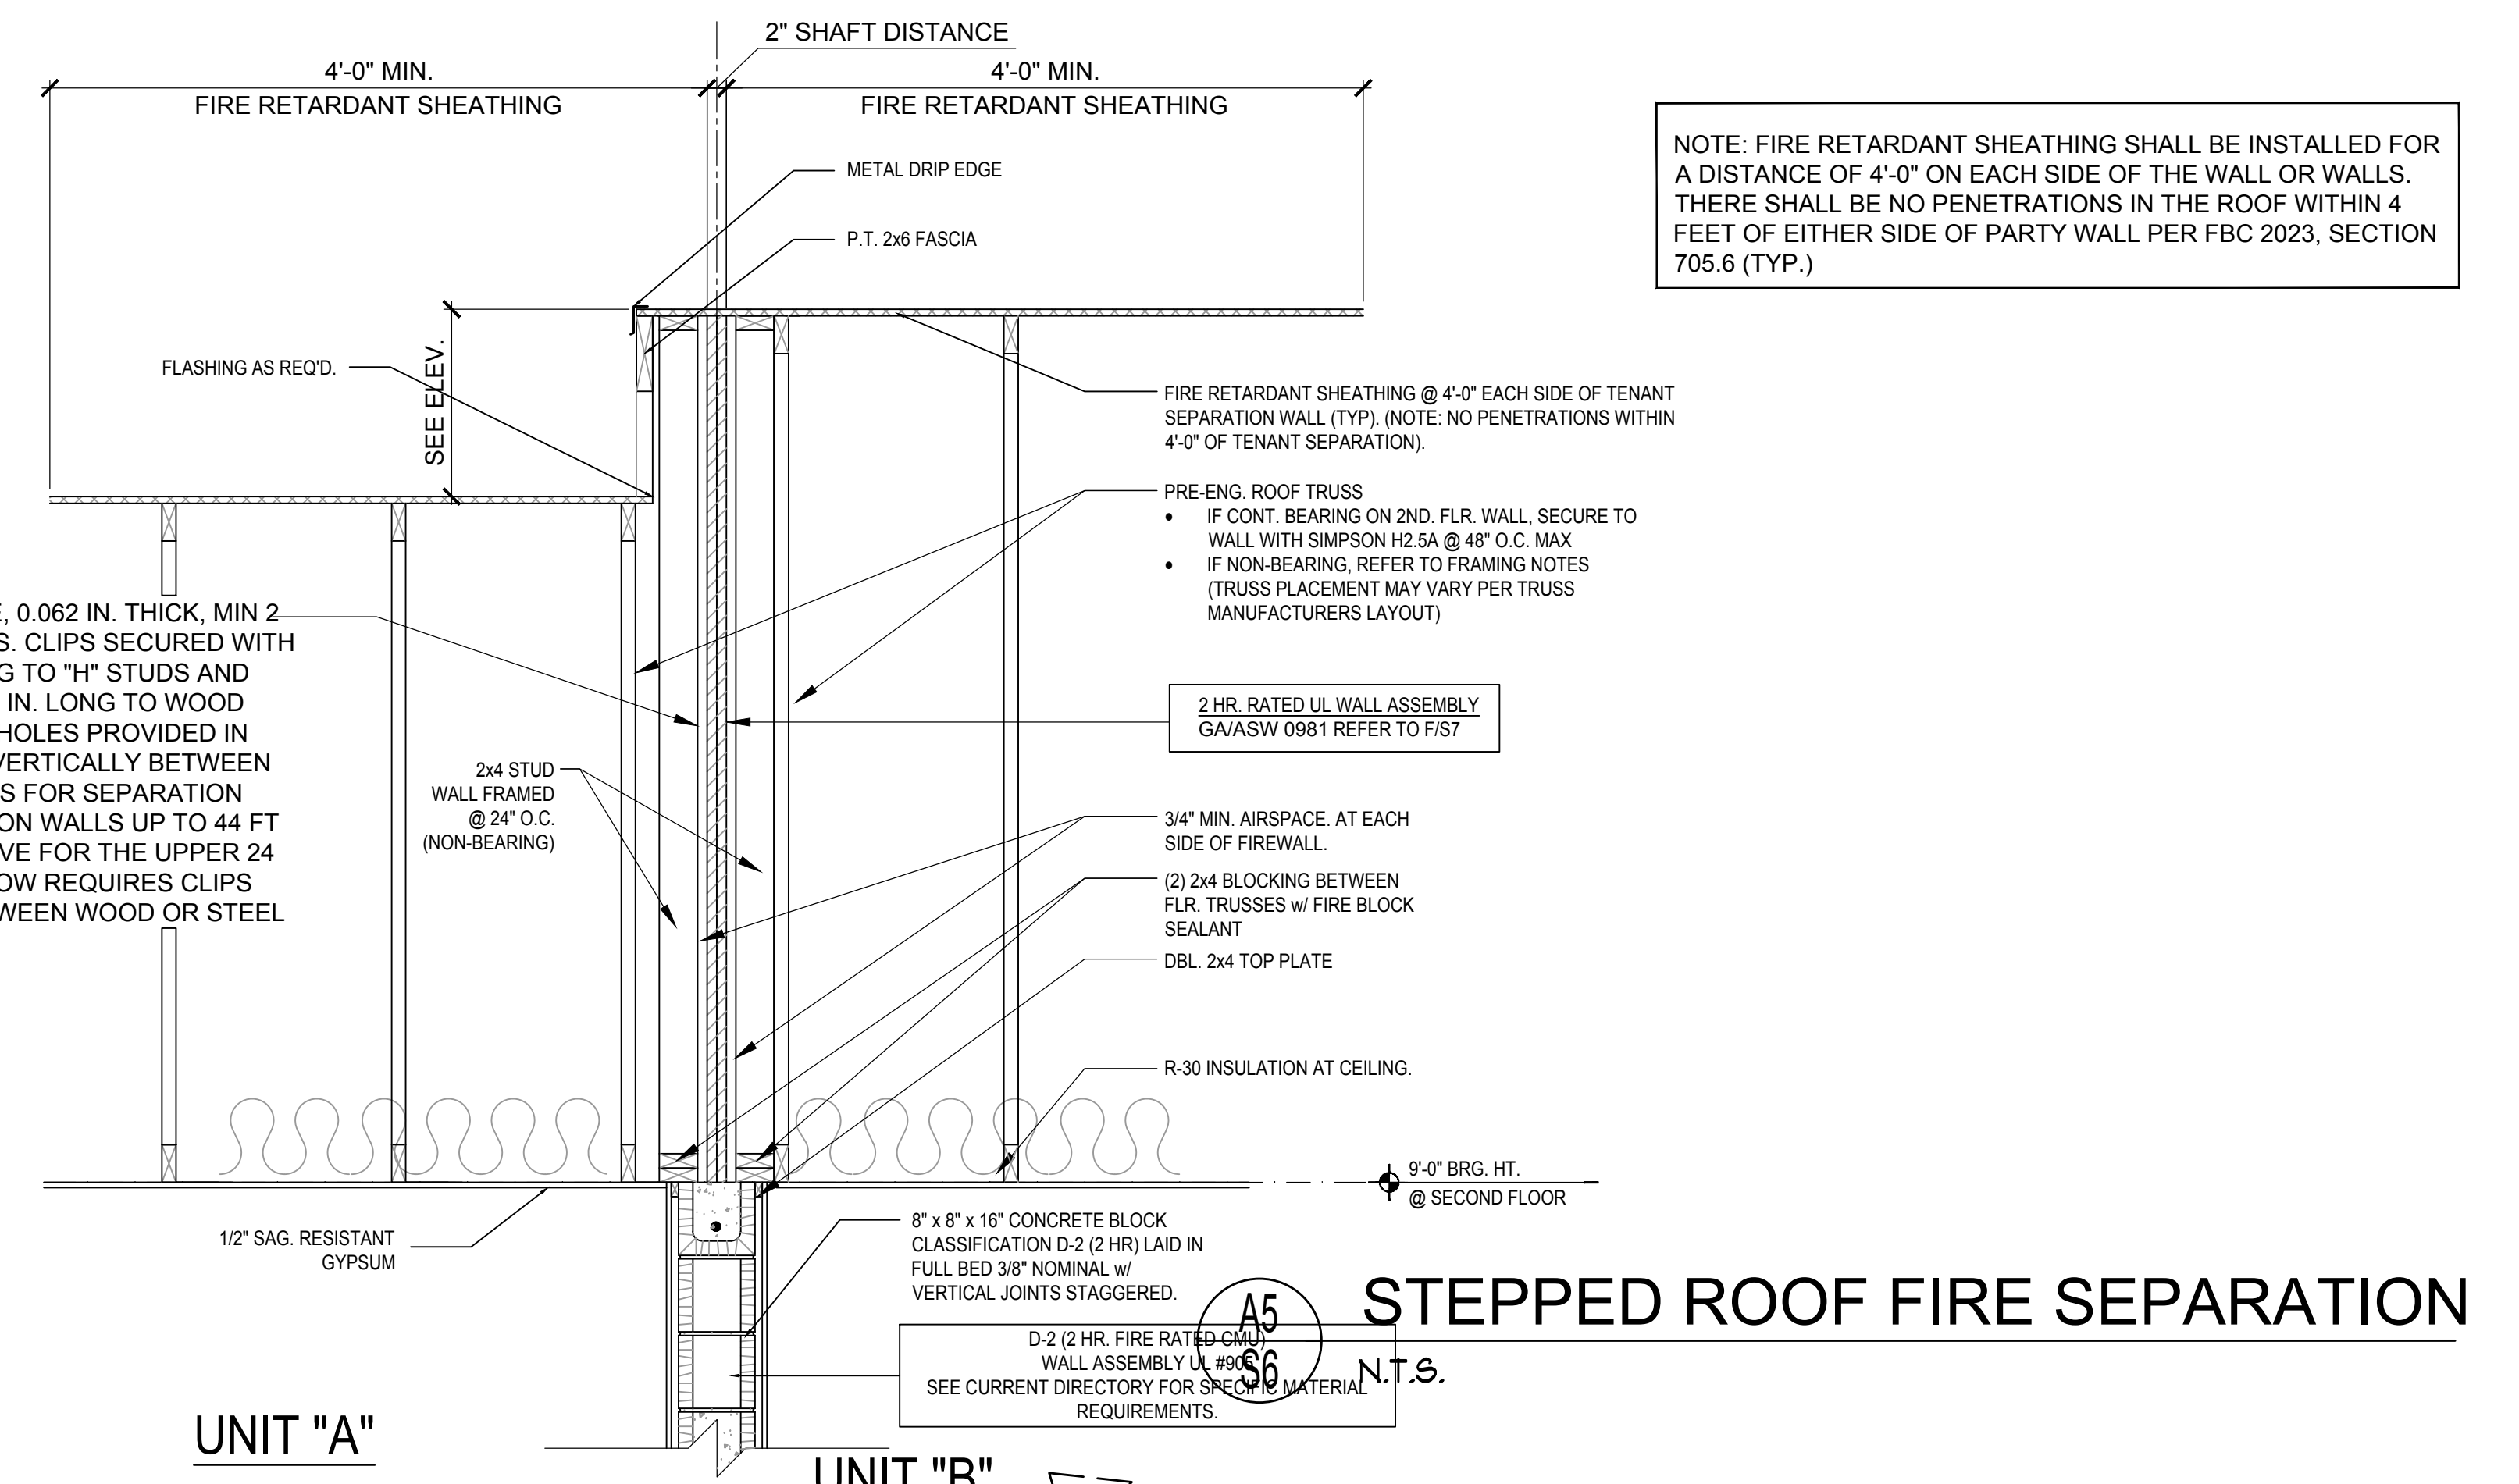

UNIT "A"
UNIT "B"
STEPPED ROOF FIRE SEPARATION
N.T.S.

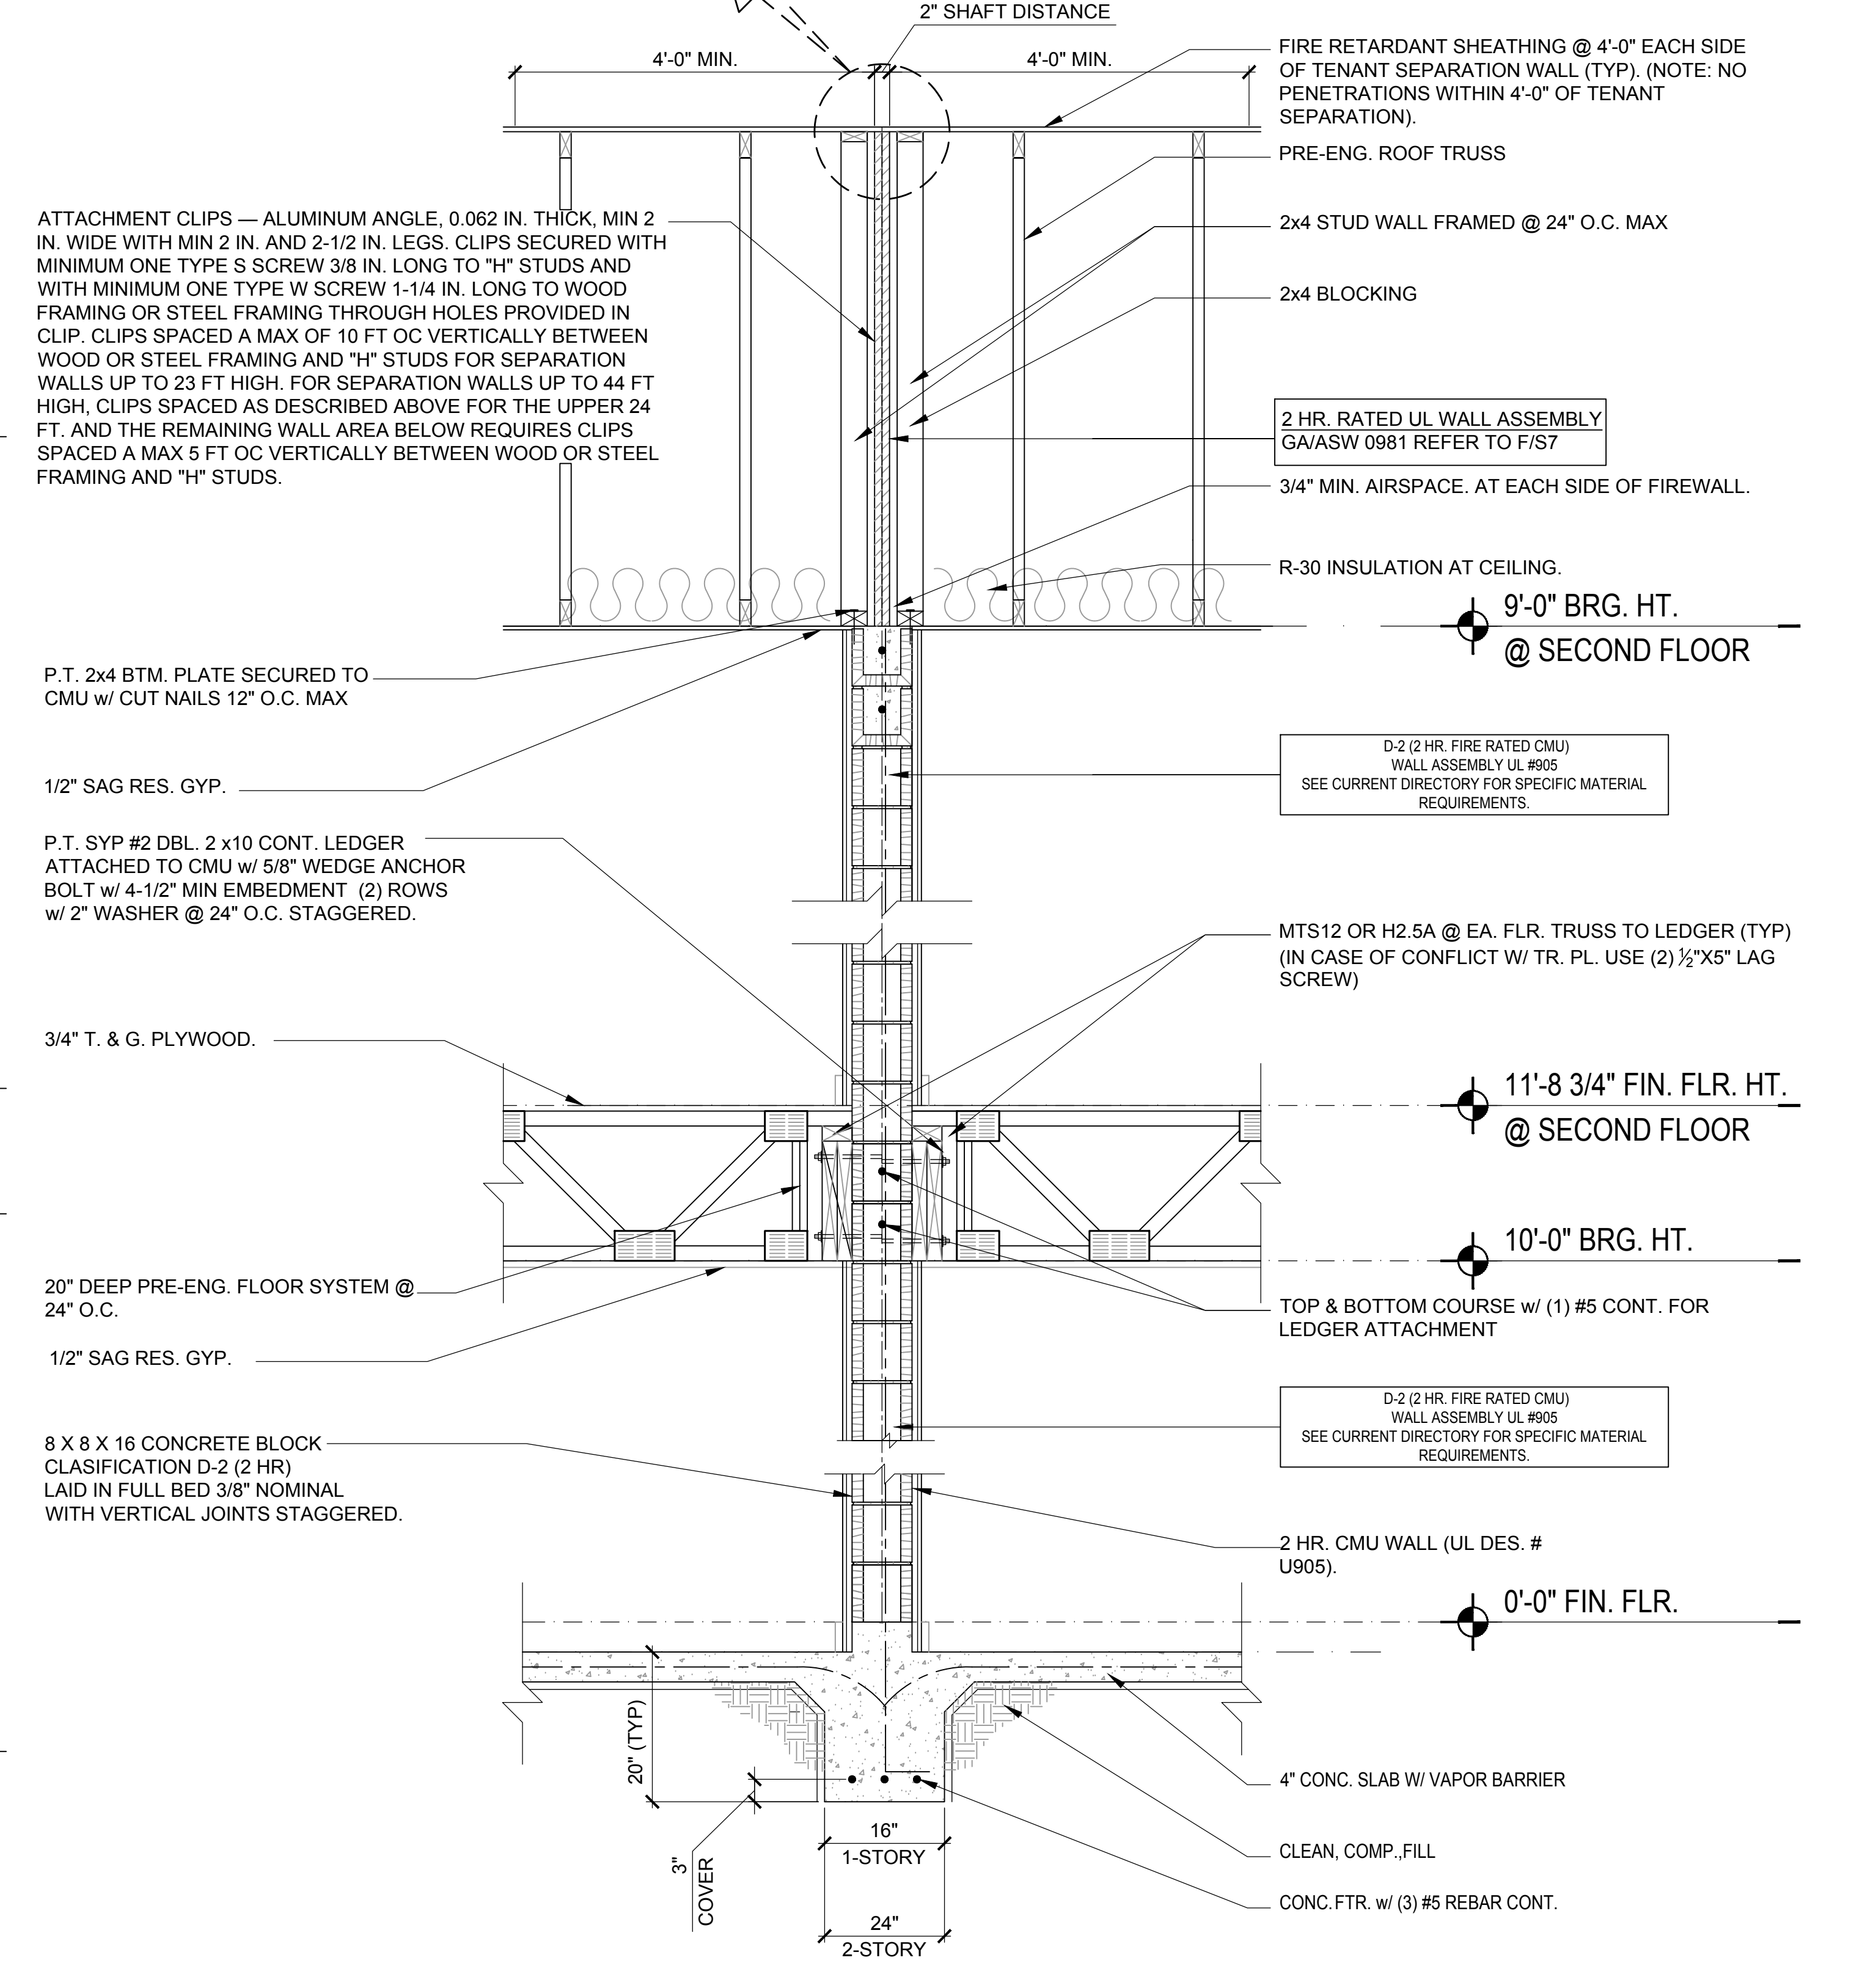

A1
S6
2-STORY FIRE WALL SECTION
N.T.S.

NOTE: FIRE RETARDANT SHEATHING SHALL BE INSTALLED FOR A DISTANCE OF 4'-0" ON EACH SIDE OF THE WALL OR WALLS. THERE SHALL BE NO PENETRATIONS IN THE ROOF WITHIN 4 FEET OF EITHER SIDE OF PARTY WALL PER FBC 2023, SECTION 705.6 (TYP.)

ITEG
THOMPSON ENGINEERING GROUP, INC.
4401 Vineland Road, Suite #6 Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1750
www.iteg.com

815 Oriole Ave., Suite # 1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignsgroup.com
COPYPRIGHT NOTICE: THESE PLANS, DESIGNS AND SPECIFICATIONS ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF MJS DESIGN GROUP AND ARE NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF MJS DESIGN GROUP.

MJS
designers group
residential-commercial-architecture

AI
BD

GOBA
GROUP ORGANIZED BUILDING ASSOCIATION

8-Unit: (Paradiso TH)
Models: Paradiso, Latitude
Building Part # XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A Division of Park Square Enterprises Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES
ISSUE DATE: 03/06/2023
REVISIONS:
PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS
DETAILS
S6

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGN ARE NOT TO BE COPIED OR MODIFIED IN ANY MANNER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

GA FILE NO. ASW 0981	PROPRIETARY*	2 HOUR FIRE	60 to 64 STC SOUND
----------------------	--------------	-------------	--------------------

GYPSUM WALLBOARD, STEEL H STUDS

Fire Design:
Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. A 3/4" minimum air space must be maintained between steel components and adjacent framing (indicated by dashed lines in sketch). As an alternate, the steel components may be covered with 6" wide battens or full sheets of 1/2" type X gypsum wallboard.
Height limitation 66 feet. (NLB)
Refer to the manufacturer for the thermal protection of the framing.

Sound Design:
Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of assembly and 3-1/2" glass fiber in stud space on both sides.

PROPRIETARY GYPSUM PANEL PRODUCTS

National Gypsum Company.....1" Gold Bond® Brand eXP® FIRE SHIELD® Shaftliner

Thickness:	3-1/2" (Fire) 11-3/4" (Sound)
Approx. Weight:	9 psf (Fire and Sound)
Fire Test:	UL R3501, 92NK28896, 6-7-93, UL Design U347, WHI 694-200.6, 10-21 & 24-85
Sound Test:	RAL TL05-199, 11-17-05

Gold Bond® eXP® Shaftliner

TECHNICAL DATA

Physical Properties	eXP Shaftliner
Thickness ¹ , Nominal	1" (25.4 mm)
Width ¹ , Nominal	2' (610 mm)
Length ^{1, 4} , Standard	8' - 12' (2,438 mm - 3,658 mm)
Weight, Nominal	3.75 lbs./sq. ft. (18.31 k/m ²)
Edges ¹	Double Beveled
Flexural Strength ¹ , Perpendicular	≥ 230 lbf. (1,023 N)
Flexural Strength ¹ , Parallel	≥ 80 lbf. (356 N)
Humidified Deflection ¹	N/A
Nail Pull Resistance ¹	≥ 80 lbf. (356 N)
Hardness ¹ - Core, Edges and Ends	≥ 15 lbf. (67 N)
Thermal Resistance ²	R = .65
Water Absorption ³ (% of Weight)	≤ 5%
Linear Expansion with Change Moisture	6.25 x 10 ⁻⁴ in./in./%RH
Coefficient of Thermal Expansion	9.26 x 10 ⁻⁴ in./in./°F
Mold Resistance ⁴ , ASTM D3273	Score of 10
Product Standard Compliance	ASTM C1658

Fire-Resistance Characteristics	
Core Type	Type X
UL Type Designation	FSW-7
Combustibility ²	Non-combustible Core
Surface Burning Characteristics ³	Class A
Flame Spread ³	0
Smoke Development ³	0

- Applicable Standards and References**
- ASTM C473 Standard Test Methods for Physical Testing of Gypsum Panel Products
 - ASTM C518 Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus
 - ASTM C840 Standard Specification for Application and Finishing of Gypsum Board
 - ASTM C1658 Standard Specification for Glass Mat Gypsum Panels
 - ASTM D3273 Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber
 - ASTM E84 Standard Test Method for Surface Burning Characteristics of Building Materials
 - ASTM E96 Standard Test Methods for Water Vapor Transmission of Materials
 - ASTM E119 Standard Test Methods for Fire Tests of Building Construction and Materials
 - ASTM E136 Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C
 - Gypsum Association, GA-216, Application and Finishing of Gypsum Panel Products
 - Gypsum Association, GA-238, Guidelines for Prevention of Mold Growth on Gypsum Board
 - Gold Bond Building Products, LLC Manufacturer Standards, NGC Construction Guide

- ASTM C1658, tested in accordance with ASTM C473.
- Tested in accordance with ASTM E136.
- Tested in accordance with ASTM E84.
- Please contact your local sales representative for all non-standard lengths and widths. Minimum order requirements may apply.
- Tested in accordance with ASTM C518.
- Tested in accordance with ASTM D3273 and rated in accordance with ASTM D3274.

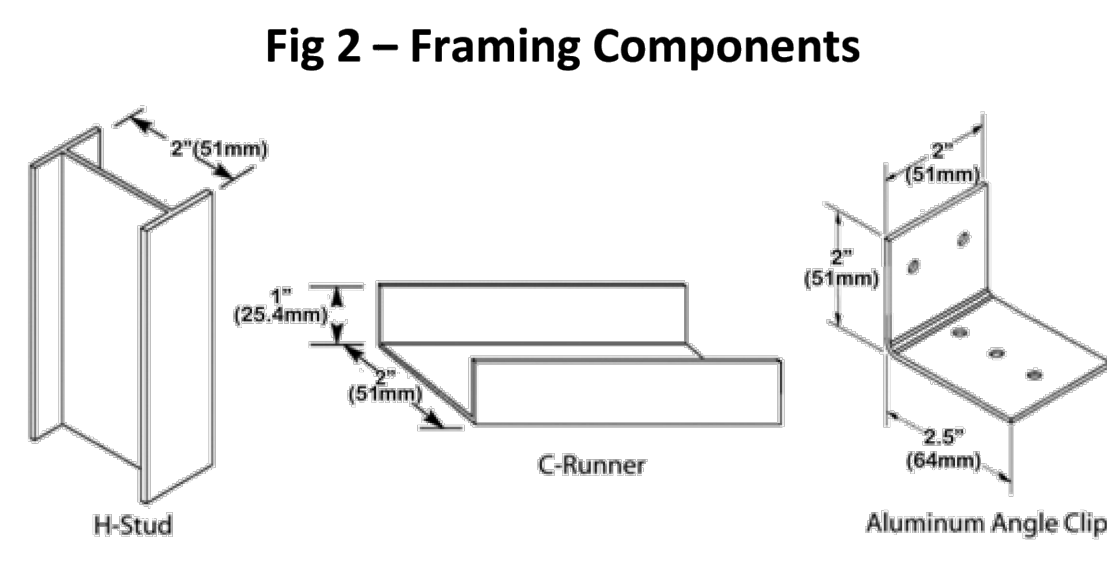


Fig 3 – Primary Components of Gypsum Area Separation Firewall (Aluminum Clips Not Shown)



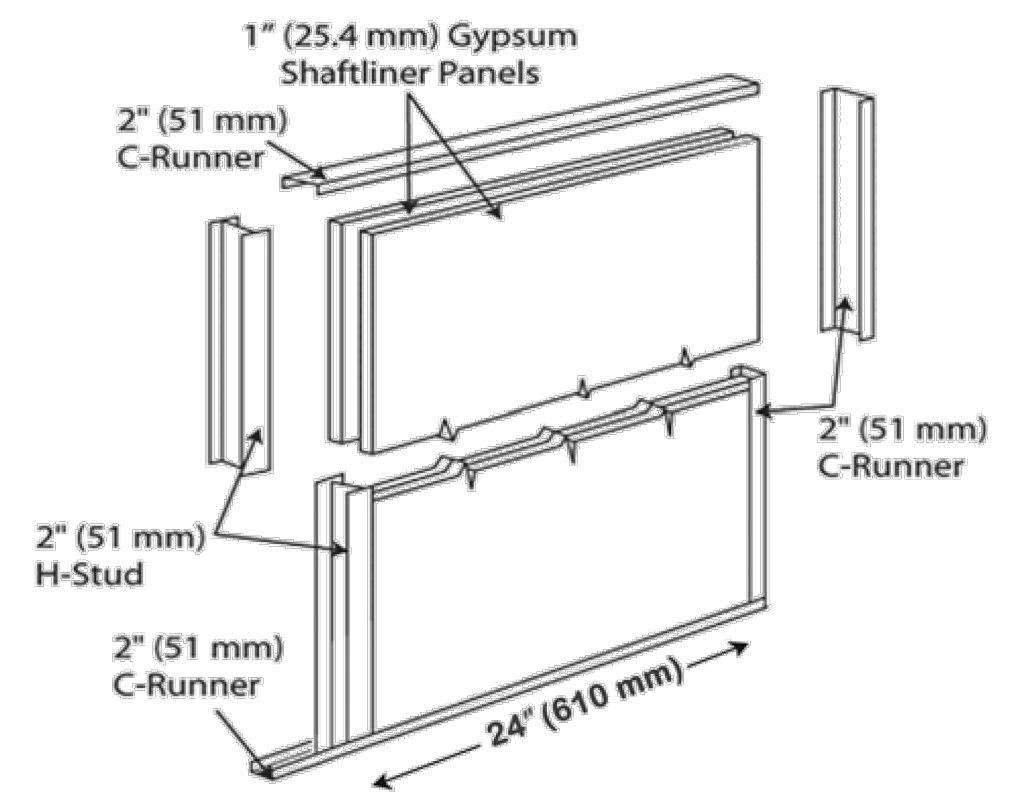


Fig 5 – Typical Floor/Ceiling Juncture

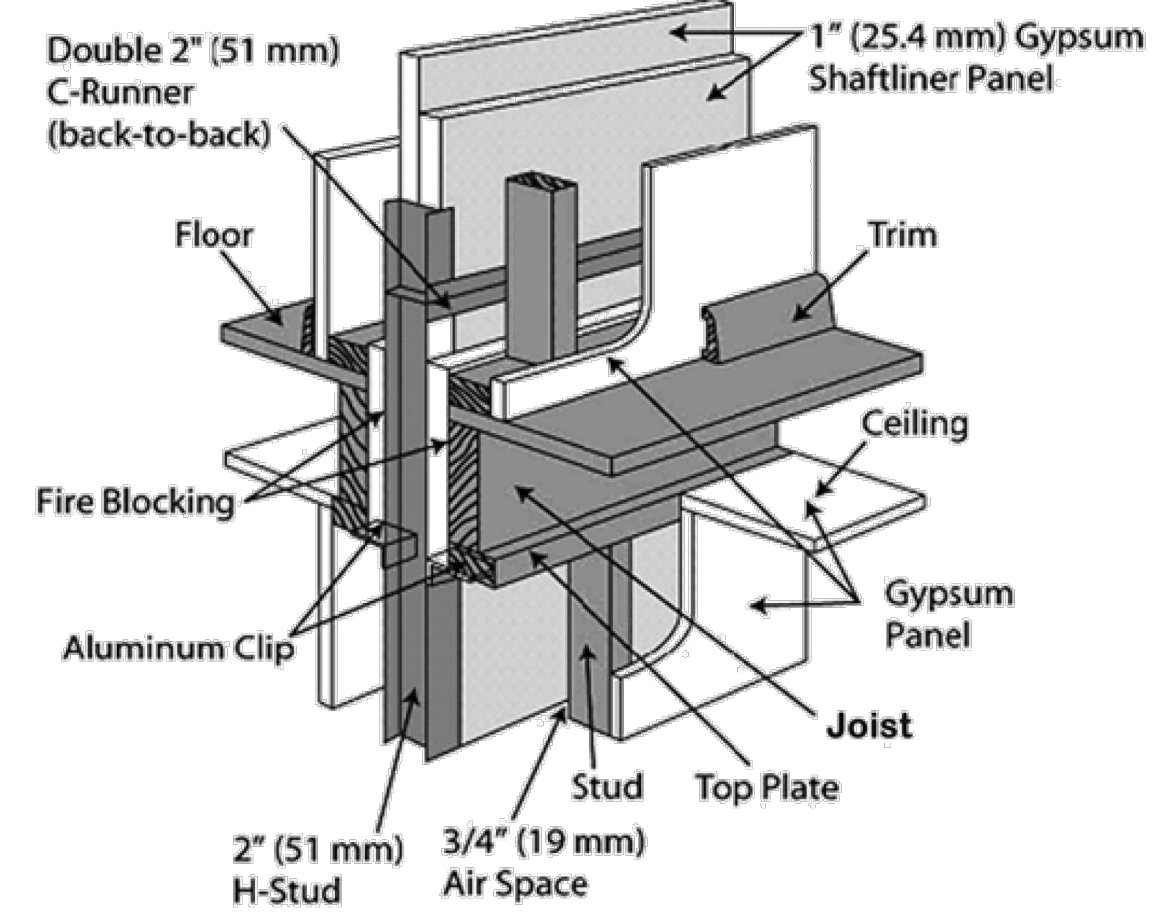

- Attach the 2" (51 mm) C-runner to the foundation floor or to the top of the footing with power-driven fasteners spaced 24" (610 mm) o.c. and apply acoustical sealant along edges of C-runner to seal the juncture between the C-runner and foundation or footing.
- Install a vertical C-runner to the wall at one end of the Gypsum Area Separation Firewall where the wall abuts either a foundation wall or an exterior wall.

Fig 9 – Intermediate Floor Intersection

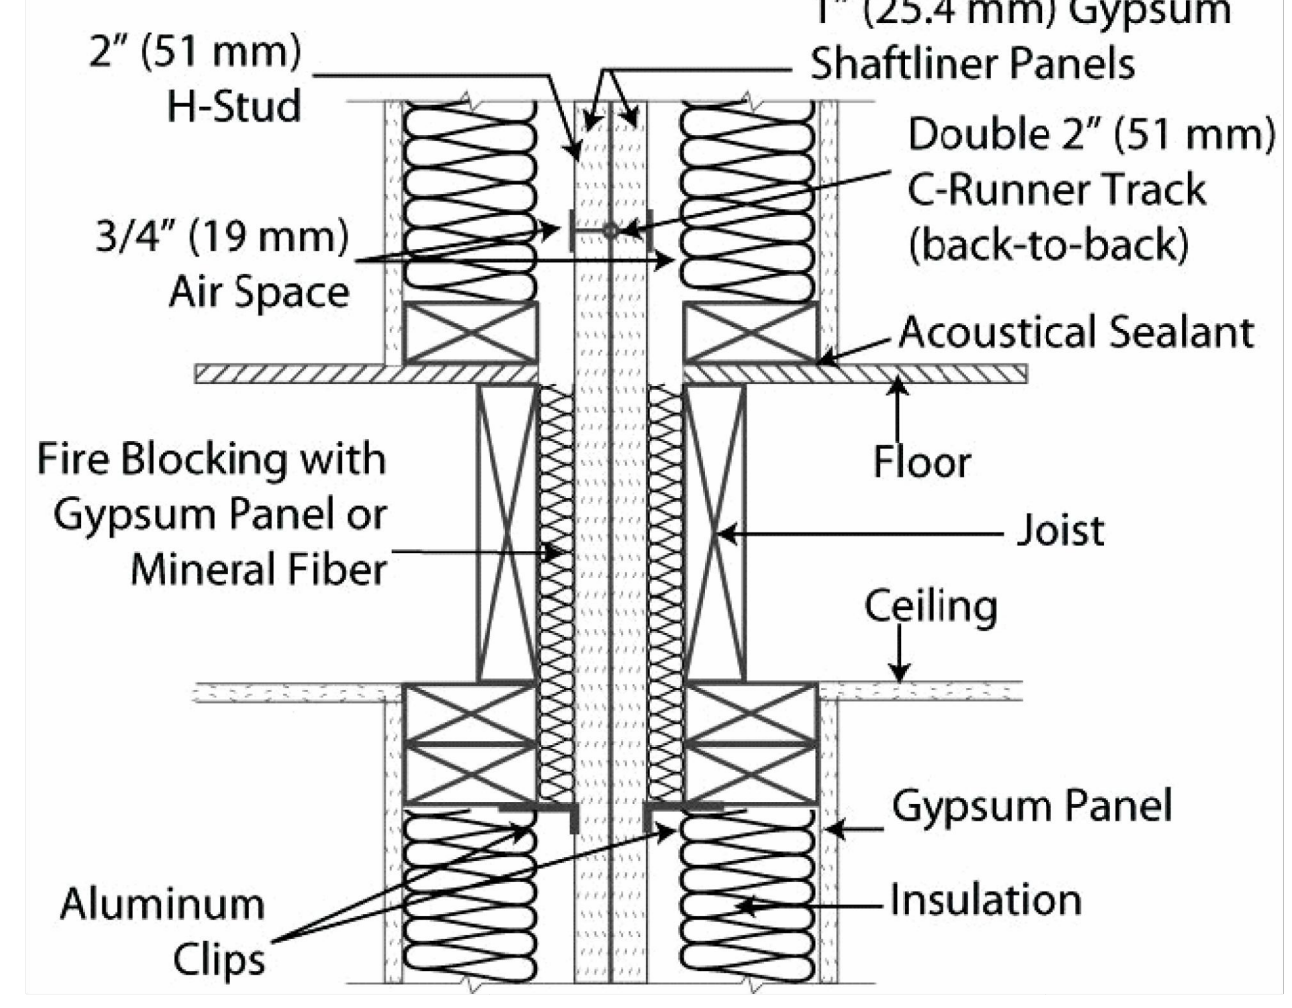

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

BXUV - Fire Resistance Ratings - ANSI/UL 263 Certified for United States
BXUV7 - Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada

See General Information for Fire-resistance Ratings - ANSI/UL 263 Certified for United States Design Criteria and Allowable Variances

See General Information for Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada Design Criteria and Allowable Variances


Design No. **U905**

April 14, 2023

Bearing Wall Rating — 2 HR.
Nonbearing Wall Rating — 2 HR

This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide BXUV or BXUV7

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

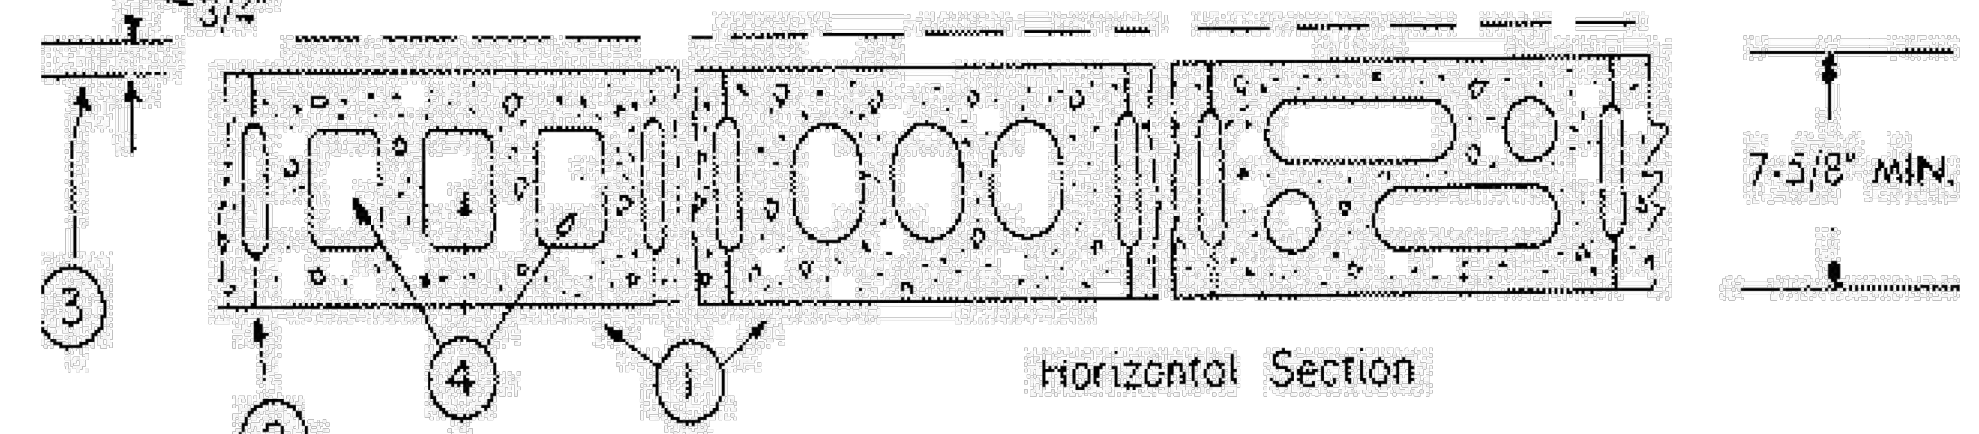

- Concrete Blocks*** — Various designs. Classification D-2 (2 hr). See Concrete Blocks category for list of eligible manufacturers.
 - Mortar** — Blocks laid in full bed of mortar, nom. 3/8 in. thick, of not less than 2-1/4 and not more than 3-1/2 parts of clean sharp sand to 1 part Portland cement (proportioned by volume) and not more than 50 percent hydrated lime (by cement volume). Vertical joints staggered.
 - Portland Cement Stucco or Gypsum Plaster** — Add 1/2 hr to classification if used. Where combustible members are framed in wall,
 - Loose Masonry Fill** — If all core spaces are filled with loose dry expanded slag, expanded clay or shale (Rotary Kiln Process), water repellent vermiculite masonry fill insulation, or silicone treated perlite loose fill insulation add 2 hr to classification.
 - Foamed Plastic*** — (Optional-Not Shown) — 1-1/2 in. thick max, 4 ft wide sheathing attached to concrete blocks (Item 1), **ATLAS ROOFING CORP** — EnergyShield Pro Wall Insulation, EnergyShield Pro 2 Wall Insulation, EnergyShield CGF Pro, EnergyShield Ply Pro, EnergyShield® CGF, EnergyShield® PanelCast, EnergyShield® and EnergyShield® XR
- DUPONT DE NEMOURS, INC.** — Types Thermax Sheathing, Thermax Light Duty Insulation, Thermax Heavy Duty Insulation, Thermax Metal Building Board, Thermax White Finish Insulation, Thermax ci Exterior Insulation, Thermax XARMOR ci Exterior Insulation, Thermax IH Insulation, Thermax Plus Liner Panel, Thermax Heavy Duty Plus (HDP), TUFF-R™ ci Insulation, Thermax Butler Stylwall Insulation Board and Thermax Morton Heavy Duty Insulation Board

- FIRESTONE BUILDING PRODUCTS CO L L C** — "Enverge™ CI Foil Exterior Wall Insulation" and "Enverge™ CI Glass Exterior Wall Insulation"
- HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — Types "Xci-Class A", "Xci Foil (Class A)", "Xci 286"
- RMAX, A BUSINESS UNIT OF SIKA CORPORATION** — Types "TSX-8500", "ECOMAXci FR", "TSX-8510", "ECOMAX xi FR White", "ECOMAXci", "ECOMAXci FR Air Barrier", "Thermasheath-XP", "Thermasheath", "Durasheath"
- JOHNS MANVILLE** — Type "AP Foil-Faced Foam Sheathing"
- 5A. **Building Units*** — As an alternate to Items 5, min. 1-in thick polyisocyanurate composite foamed plastic insulation boards, nom. 48 by 48 or 96 in.
- ATLAS ROOFING CORP** — EnergyShield® Ply
- HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — "Xci NB", "Xci Ply"
- RMAX, A BUSINESS UNIT OF SIKA CORPORATION** — "Thermasheath-SI", "ECOBASeci", "ThermaBase-CI", "ECOMAXci FR Ply", "ECOMAXci Ply".

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Last Updated on 2023-04-14

F 2HR. EXT. FIREWALL ASSEMBLY GA/ASW 0981-22ND ED. GA-600-2018

ANSI/UL 263 DESIGN U905

ITEG
THOMPSON ENGINEERING GROUP, INC.
4401 Vineland Road, Suite 46, Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1790
www.iteg.com

815 Orienta Ave., Suite # 040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignsgroup.com
COPYRIGHT NOTICE: THESE PLANS, DESIGNS AND SPECIFICATIONS ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF MJS DESIGN GROUP, INC. ALL RIGHTS RESERVED.

MJS
designers group
residential-commercial-architecture

A I B D

GOBA
Gypsum Board Association

8-Unit: (Paradiso TH)
Models: Paradiso, Latitude
Building Pair # XXX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code

A Division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE: 03/06/2023
REVISIONS:

PROJECT: 22-1151
SCALE: AS NOTED
DRAWN BY: M.C.
DESIGNED BY: MJS

FIRE SEPARATION
S7

STRUCTURAL NOTES

- THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH THE 8TH EDITION, FBCR 2023 (WIND LOAD @ 140 MPH.)
LIVE LOAD ROOF: 20 PSF.
FLOOR: 40 PSF, BALCONIES & STAIRS: 40 PSF
OCCUPANCY= 1.0
BUILDING CATEGORY R3, WIND EXPOSURE C
INTERNAL PRESSURE COEFFICIENTS = +0.18 AND -0.18
- WINDOWS, DOORS, AND GARAGE DOORS TO BE DESIGNED TO MEET FBCR SECTION R301
- ALL FLOOR SLABS TO BE OF 2500 PSI CONC. PLANT MIX MIN. 5" THICK WITH 6x6 10/10 WIRE MESH 6 MIL. POLY. VAPOR-BARRIER OVER TERMITE TREATED COMPACTED CLEAN FILL.
- CONCRETE MASONRY UNITS SHALL MEET: CH. 1-3 OF ACI 530-02/ ASCE 5-02/TMS 402-02 OR BIA BUILDING CODE REQUIREMENTS.
- MORTAR TO BE TYPE "M" OR "S", GROUT - 2500 PSI @ 28 DAYS.
- MASONRY CLEAN OUTS REQUIRED @ GROUT GREATER THAN FIVE (5) FEET IN HEIGHT AND ALL VERTICALS.
- REBAR TO BE # 5'S GRADE 60, W/ MIN. LAP OF 25". USE "L" BARS @ CORNERS AND USE STANDARD HOOKS @ CHANGE IN DIRECTION WITH MIN. LAP 12"
- GYP. BD. CEILING SHALL BE INSTALLED PERP. TO FRAMING & NAILED @ 7" O.C. WITH 5d NAILS. GYP. BD. WALLS SHALL BE NAILED @ 8" O.C. WITH 5d NAILS
- UPLIFT CONNECTOR'S TO PROVIDE CONTINUITY FROM ROOF TRUSSES THRU PLATES TO SLAB AND FOUNDATION PER ENCLOSED DETAILS.
- EPOXY ANCHOR ALTERNATIVE:
THREADED ANCHOR ROD MAY BE USED IN LIEU OF ANCHOR BOLTS FOR USE AS PLATE ANCHORS OR HURRICANE ANCHORS.
THE FOLLOWING CRITERIA MUST BE MET:

ANCHOR SIZE	CONC. HOLE SIZE	MIN. HOLE DEPTH
1/2"	-3/4"	7"
-5/8"	-7/8"	7"
-3/4"	1"	8"
-7/8"	1-1/8"	9"

AFTER HOLE IS DRILLED, ALL CONCRETE DUST MUST BE REMOVED PRIOR TO EPOXY INSTALLATION. THREADED ROD TO BE MIN. A36 STEEL AND FREE OF DIRT OR GREASE. LOAD ON ROD CANNOT BE APPLIED UNTIL 12 HOURS AFTER INSTALLATION. 2 COMPONENT EPOXY RESIN MATERIAL TO BE MIXED PER MFG. DIRECTIONS.

- SOIL BEARING CAPACITY 2000 PSF MINIMUM



WOOD STRUCTURAL NOTES

- ALL WOOD TO BE SPECIES, GROUP, AND GRADE AS NOTED BELOW. DAMAGED WOOD NOT TO BE USED.
- ALL STRUCTURAL LUMBER SHALL BE SPF (SPRUCE-PINE-FIR) #2 OR BETTER UNLESS OTHERWISE NOTED. (PRE ENG. TRUSSES EXCLUDED)
- END JOINT IN STRUCTURAL DOUBLE TOP PLATE TO BE OFFSET AT LEAST 4". STRUCTURAL DOUBLE PLATES TO BE NAILED @ 6" O.C..
- PLYWOOD OR OSB. WALL SHEATHING NAIL PATTERN TO BE 10d @ 6" O.C.. UNLESS OTHERWISE NOTED.
- NUMBER OF HEADER STUDS AND ADJACENT FULL LENGTH STUDS PER WALL AND HEADER STUD REQUIREMENT SCHEDULE.
- MAX. 1" HOLE DRILLED INTO EXTERIOR STRUCTURAL STUDS.
- DBL. STUDS @ EA. END OF SHEAR WALL.
- WHEN ANCHORING MULTIPLE WD. ITEMS TOGETHER, THE LENGTH OF HURRICANE STRAP MUST BE CENTERED.
- NAIL PATTERN
 -DOUBLE PLATE 12" O.C.. OUTSIDE SPLICE ZONE (SEE NOTE 4)
 -DOUBLE STUDS @ 12" O.C..
 -DOUBLE OR TRIPLE HEADER @ 6" O.C.. @ EDGE @ 12" O.C.. INTERMEDIATE.
 -HEADER TO STUD @ 4" O.C.. EA. HEADER MEMBER.
 -STUD TO TOP OR BOTTOM PLATE : (2) 16d THRU PLT. OR (2) 16d EA. SIDE TOE NAILED TO PLT.
- ROOF SHEATHING FOR SHINGLE ROOF TO BE MIN. 19/32 OSB, NAILED TO ROOF TRUSSES SPACED @ 24" O.C. (MAX) WITHOUT BLOCKING.
 -ROOF SHEATHING FOR TILE ROOF TO BE MIN. 19/32" OSB, 1/2" CDX PLYWOOD OR 1/2" ADVANTECH. NAILED TO ROOF TRUSS SPACED @ 24" O.C. (MAX) WITHOUT BLOCKING.
- FLOOR SHEATHING TO BE MIN. 23/32" PLYWOOD NAILED @ 6" O.C. W/ #8 RING SHANK NAILS AND LIQUID NAIL ADHESIVE.
- ALL FLOOR TRUSSES TO BE END BLOCKED @ BEARING LOCATIONS
- TRUSS BRACING PER TRUSS MANUFACTURE'S DRAWINGS.
- ALL NAILING SPECIFIED TO BE APPLIED BY NAIL GUN OR MANUALLY


- ALL WOOD IN DIRECT CONTACT WITH MASONRY SHALL BE PRESSURE TREATED.
- 2000 PSF MINIMUM SOIL BEARING CAPACITY

FIELD REPAIR NOTES

- MISSED LINTEL STRAPS FOR MASONRY CONSTRUCTION MAY BE SUBSTITUTED W/ (1) USP MTW16 OR HC10 OR SIMPSON MTSM16 W/ (4) -1/4" X 2-1/4" TAPCONS TO BOND BEAM AND (7) 10d NAILS TO TRUSS FOR UPLIFTS LESS THAN 860 LBS (USE (2) MTSM16 FOR UPLIFTS LESS THAN 1720#). NO MORE THAN 10 STRAPS MAY BE SUBSTITUTED OR NO MORE THAN 3 IN A ROW. IF GIRGER TRUSS CONNECTIONS ARE MISSED CONTACT ENGINEER FOR SUBSTITUTION
- MISSED J-BOLTS FOR FRAMED EXTERIOR/ BEARING WALLS MAY BE SUBSTITUTED W/ 1/2" DIA. X 7" LONG WEDGE ANCHORS (REDHEADS).
- MISSED FOOTING DOWELS MAY BE SUBSTITUTED W/ A STRAIGHT #5 REBAR SET IN A 3/4" DIA. X 6" DEEP HOLE FILLED W/ UNITEX PROPOXY 300 OR SIMPSON SET OR ETF ADHESIVES.
- BLOCK WALL OVERHANGING SLAB CONDITION:
UP TO -7/8" - NO REPAIR NECESSARY
-7/8" TO 1-1/4" - ADD FILLED CELL (NO VERTICAL STEEL) MIDPOINT OF WALL BETWEEN EXISTING FILLED CELLS (WITH STEEL) IN AREAS AFFECTED
1-1/4" - REQUIRE SPECIAL ENGINEERING LETTER
- PENETRATION OF PLUMBING PIPES/DRYER VENTS THRU PLATES OF A LOAD BEARING WALL MAY OCCUR PROVIDED DBL. STUDS ARE ADDED ON EITHER SIDE OF PENETRATION WITHIN 3" AND TRUSS/ FLOOR TRUSS IS NO CLOSER THAN 3" FROM PENETRATION.
ADD (1) MTS12 @ TOP AND BOTTOM PLATE

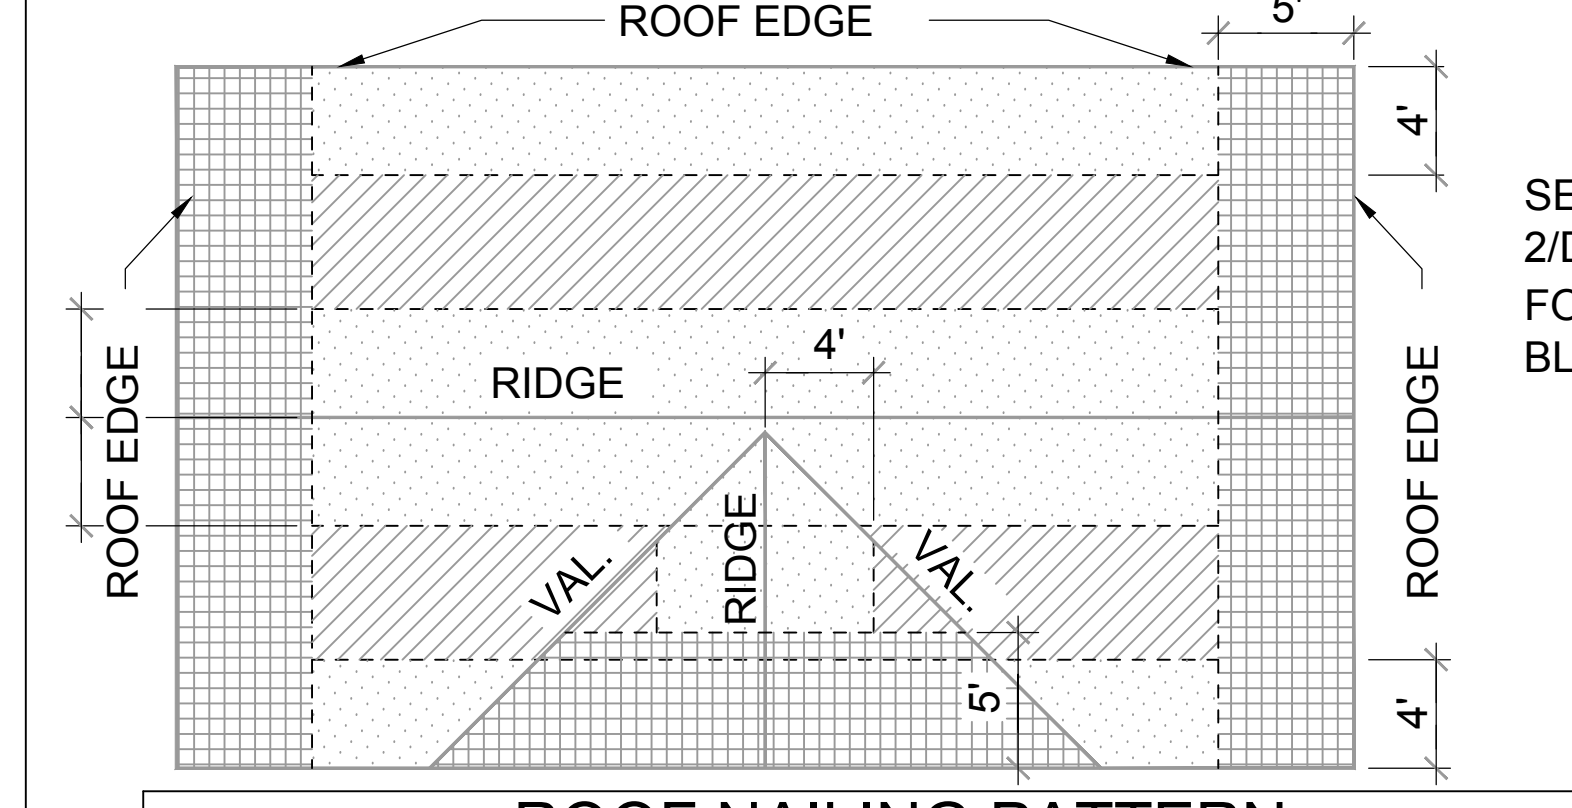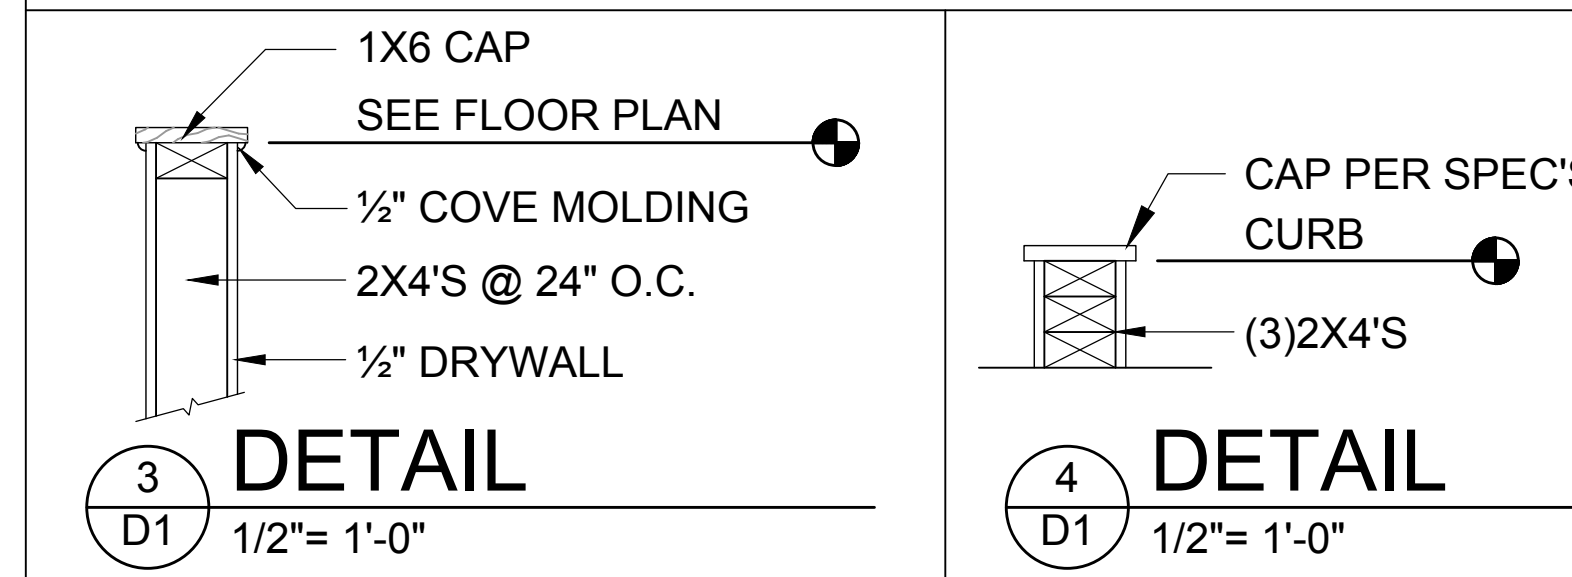


ZONE:	10d RING SHANK NAILS @ 6" O.C. EDGES AND 12" O.C. FIELD
ZONE:	10d RING SHANK NAILS @ 6" O.C. EDGES AND 12" O.C. FIELD
ZONE:	10d RING SHANK NAILS @ 4" O.C. EDGES AND 6" O.C. FIELD

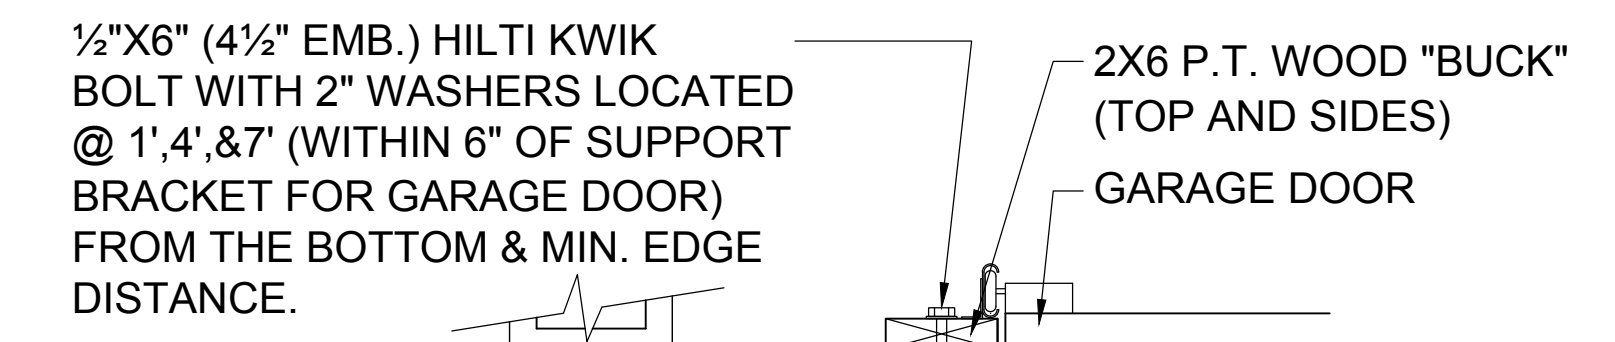


- DETAIL TO SATISFY 150 MPH WIND LOAD
- MASONRY FRAME SHALL BE MIN 8X16 ASTM C-9D
- GROUT FILLED CELL W/ 1/2" ASTM 2 #5 REBAR (GRADE 60) @ EA. SIDE OF GARAGE DOOR OPENING
- MAX. DISTANCE TO CORNER OF C.B.S. WALL REINF. 48"
- REINF. TO BE CONT. FROM FTG. TO TIE BEAM W/ ALL "ACI" DETAILS & DEVELOPMENT LENGTHS ADHERED TO
- GARAGE DOOR MANUF. TO PROVIDE ATTACHMENT TO "BUCK"

- THE GARAGE DOOR ASSEMBLY SHALL BE DESIGNED FOR POSITIVE AND NEGATIVE WIND PRESSURES OF 25 PSF IN ACCORDANCE WITH SECTION R301 OF THE FLORIDA RESIDENTIAL CODE CERTIFICATION SHALL BE SUBMITTED FROM THE GARAGE DOOR MANUFACTURER TO THE BUILDING DEPARTMENT FOR THE FOLLOWING ITEMS:
 - THE DESIGN OF THE DOOR CAN WITHSTAND POSITIVE AND NEGATIVE WIND PRESSURES OF 25 PSF.
 - THE DESIGN OF THE DOOR COMPLIES WITH THE CRITERIA SPECIFIED IN SECTION R609 OF THE 2023 FLORIDA BUILDING CODE RESIDENTIAL, 8TH EDITION
 - DOOR SIZE, TYPE AND GLAZING
 - TRACK SIZE AND FASTENER DETAILS.
 - TRACK BRACKET QUANTITY, SPACING AND FASTENER DETAILS.
 - REINFORCING MEMBER QUANTITY, LOCATION, SIZE, TYPE AND FASTENER DETAILS. (IF REQUIRED)

GARAGE BUCK DETAIL

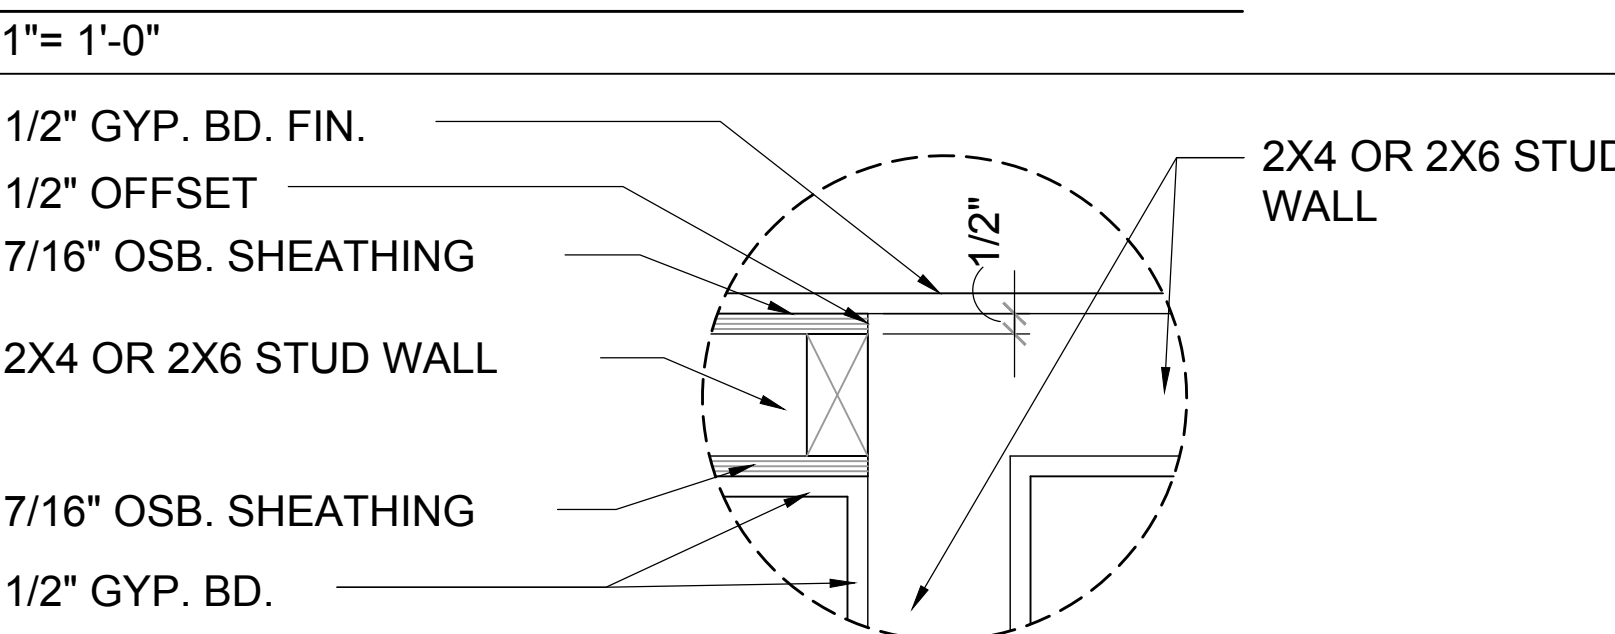

DETAIL @ CONN. TO REG. WALL


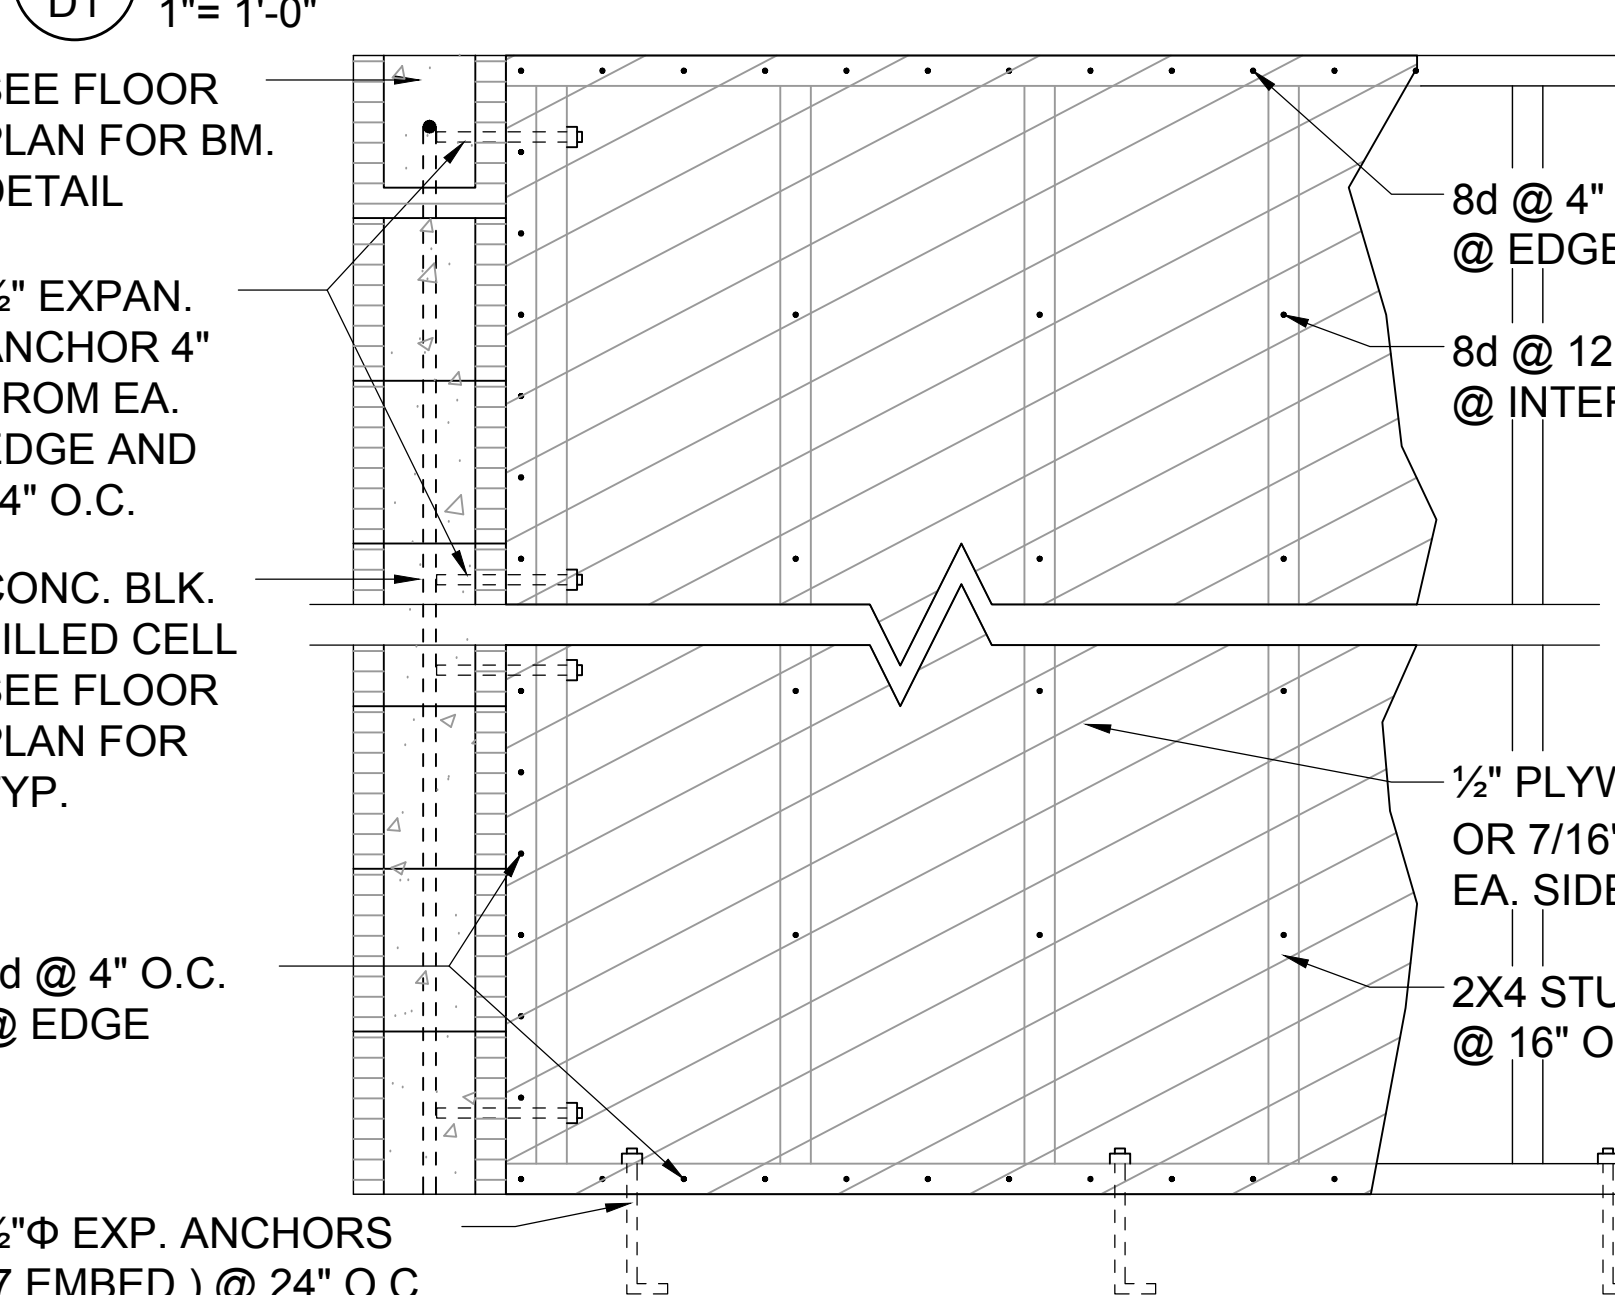


SHEAR WALL DETAIL




MIN. WALL AND HEADER REQUIREMENTS


UNSUPPORTED WALL HEIGHT	STUD SPACING	MAXIMUM HEADER SPAN (ft.)					
		3'	6'	9'	12'	15'	18'
		NUMBER OF HEADER STUDS SUPPORTING END OF HEADER					
10' OR LESS	2	2	3	3	3	3	
		NUMBER OF FULL-LENGTH STUDS @ EACH END OF HEADER					
GREATER THAN 10'	2	2	3	4	5	5	

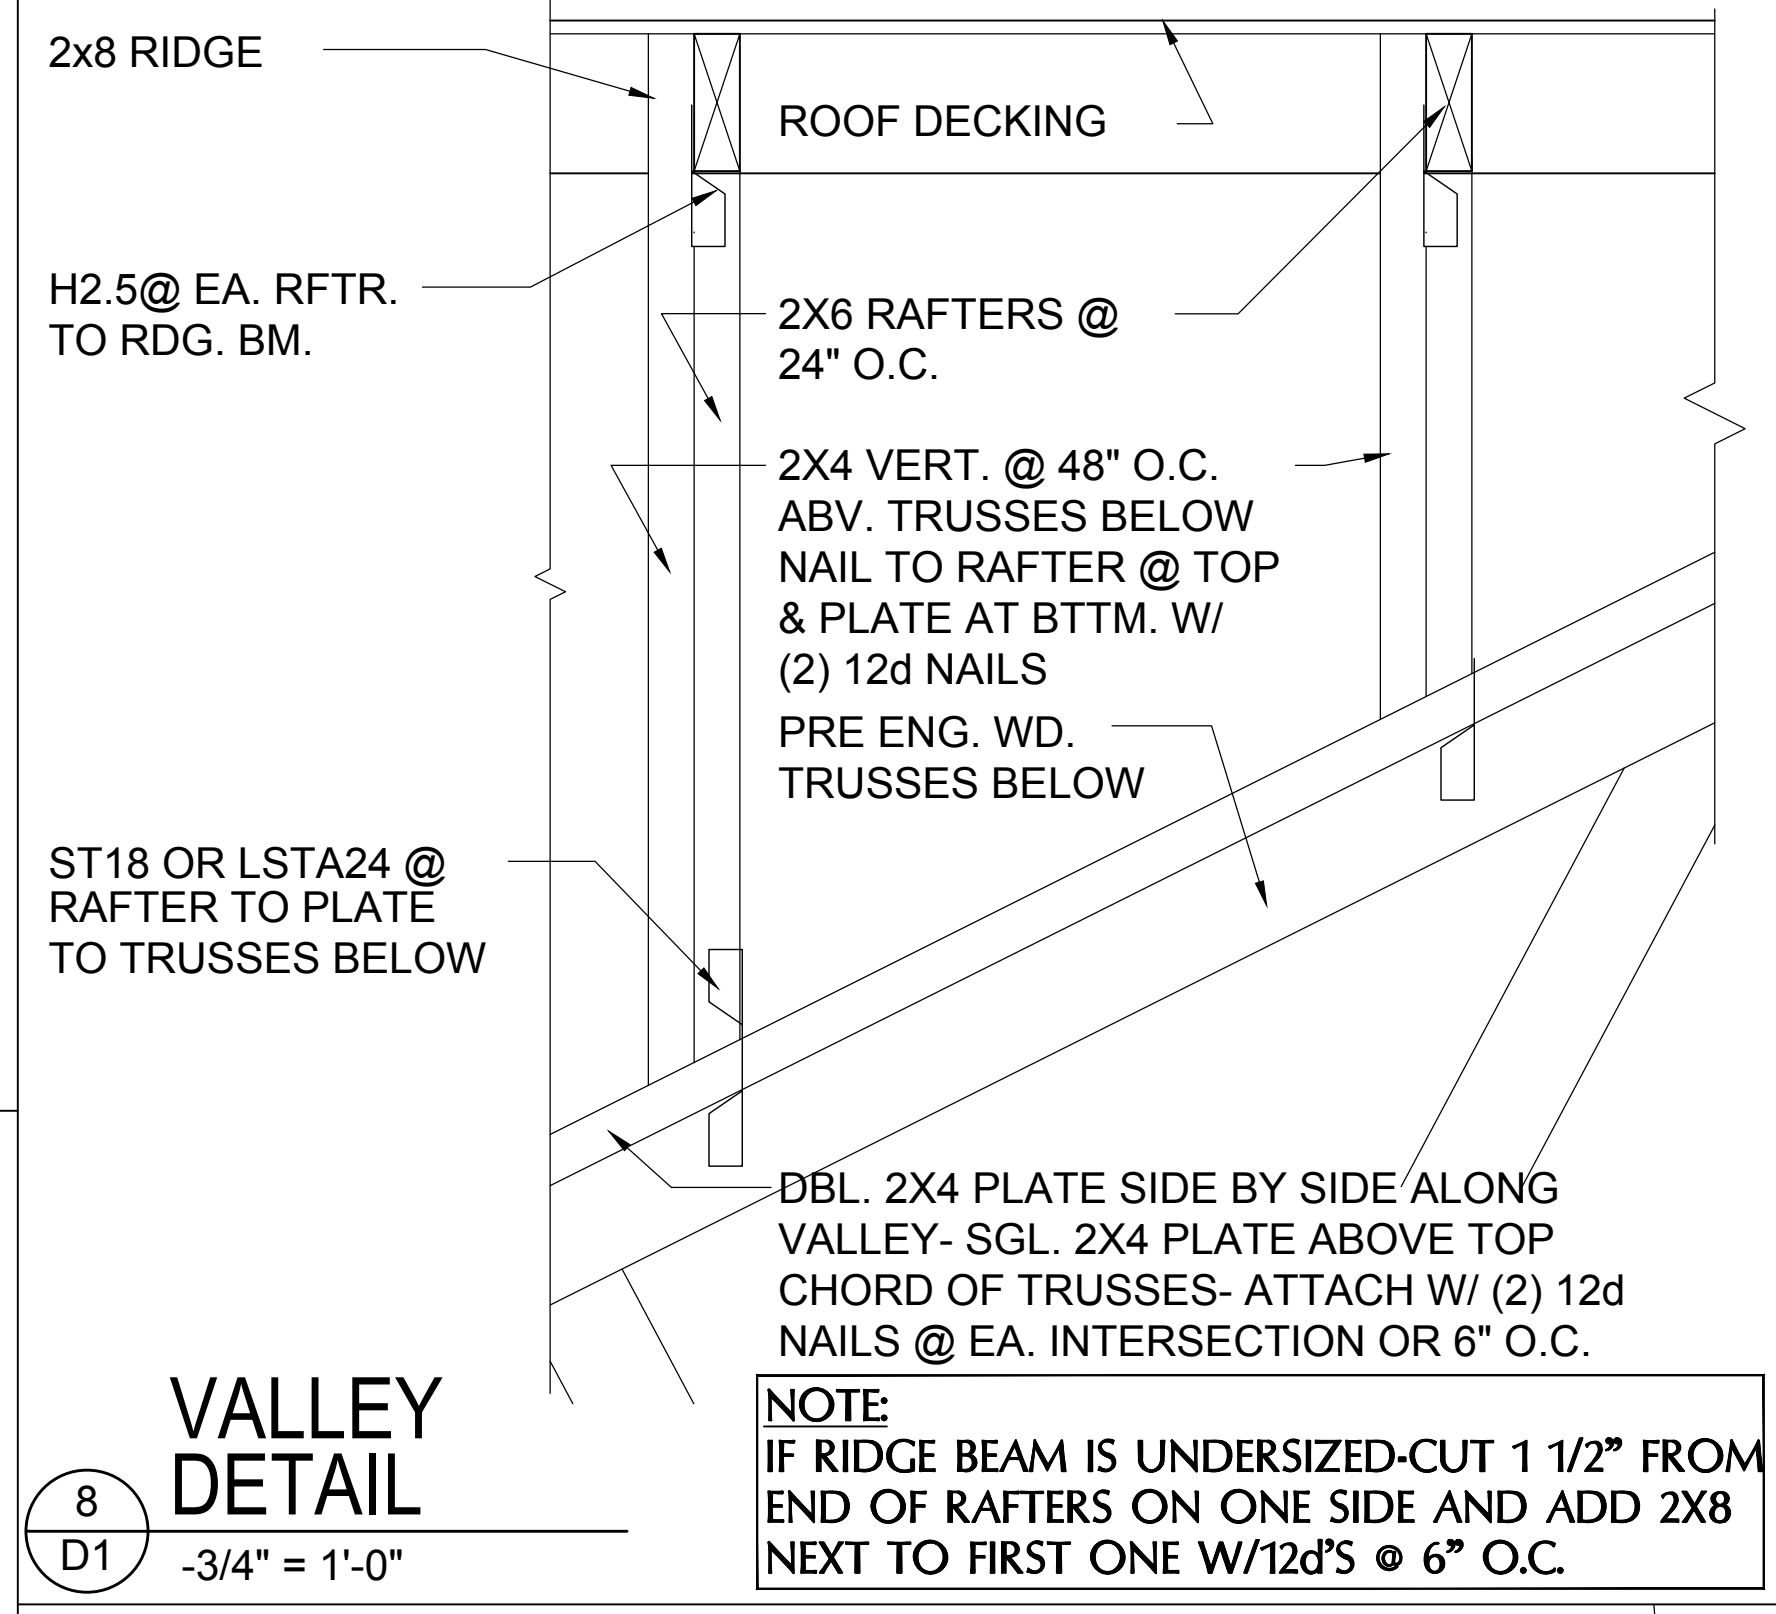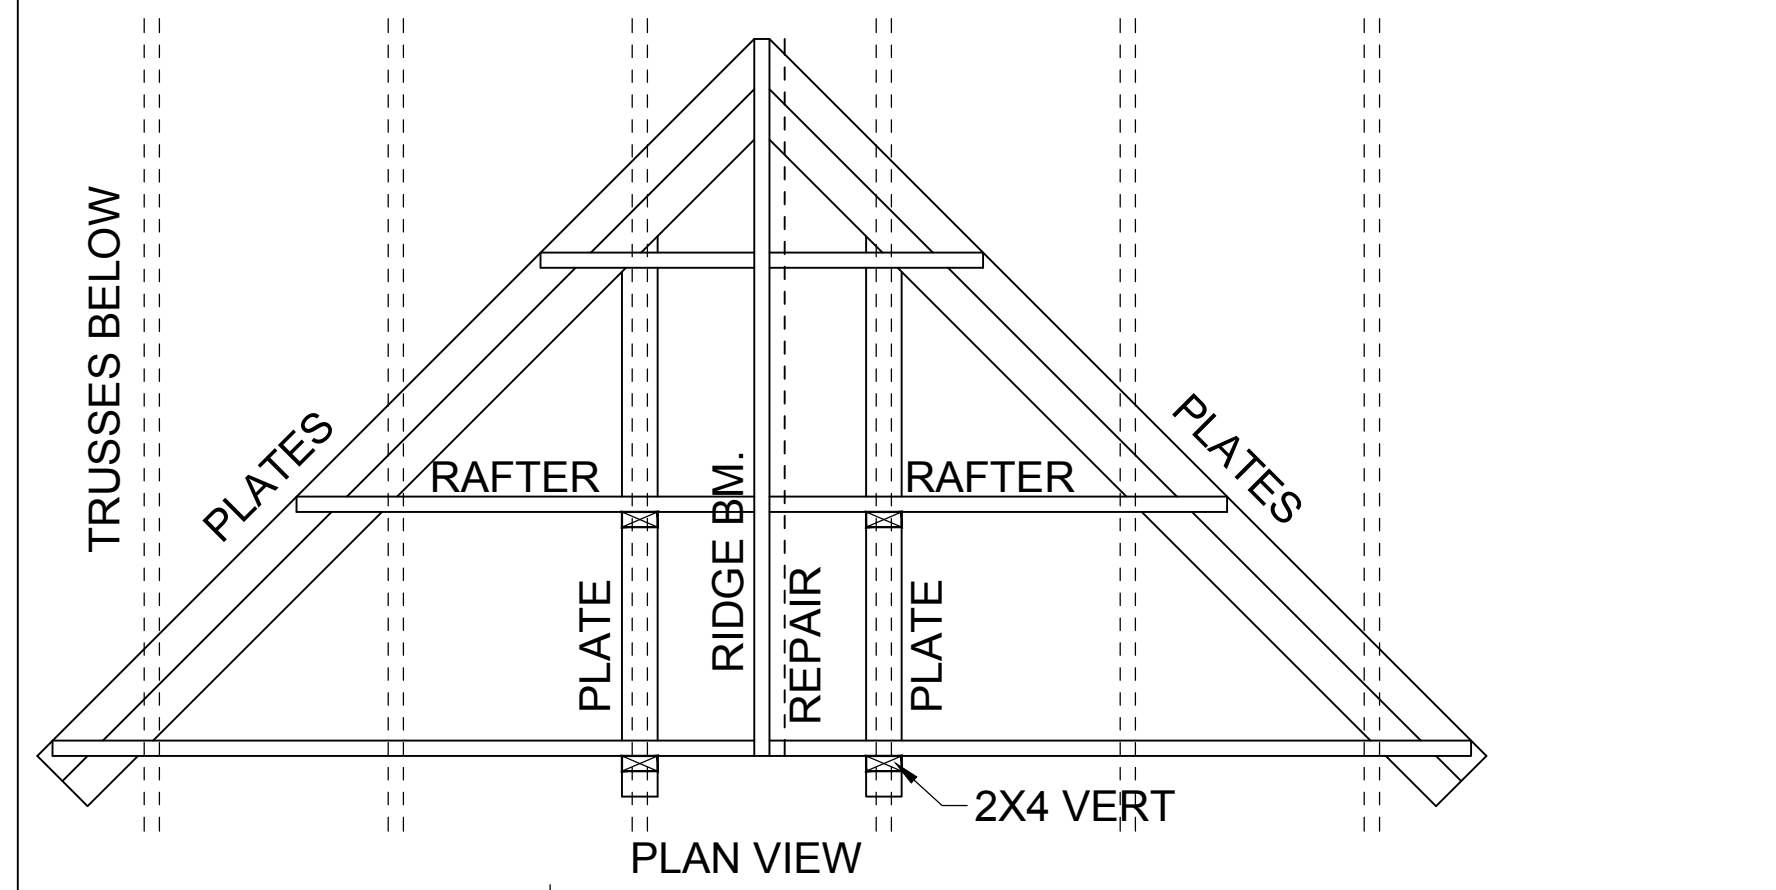

PANEL ANCHOR CONSTRUCTION





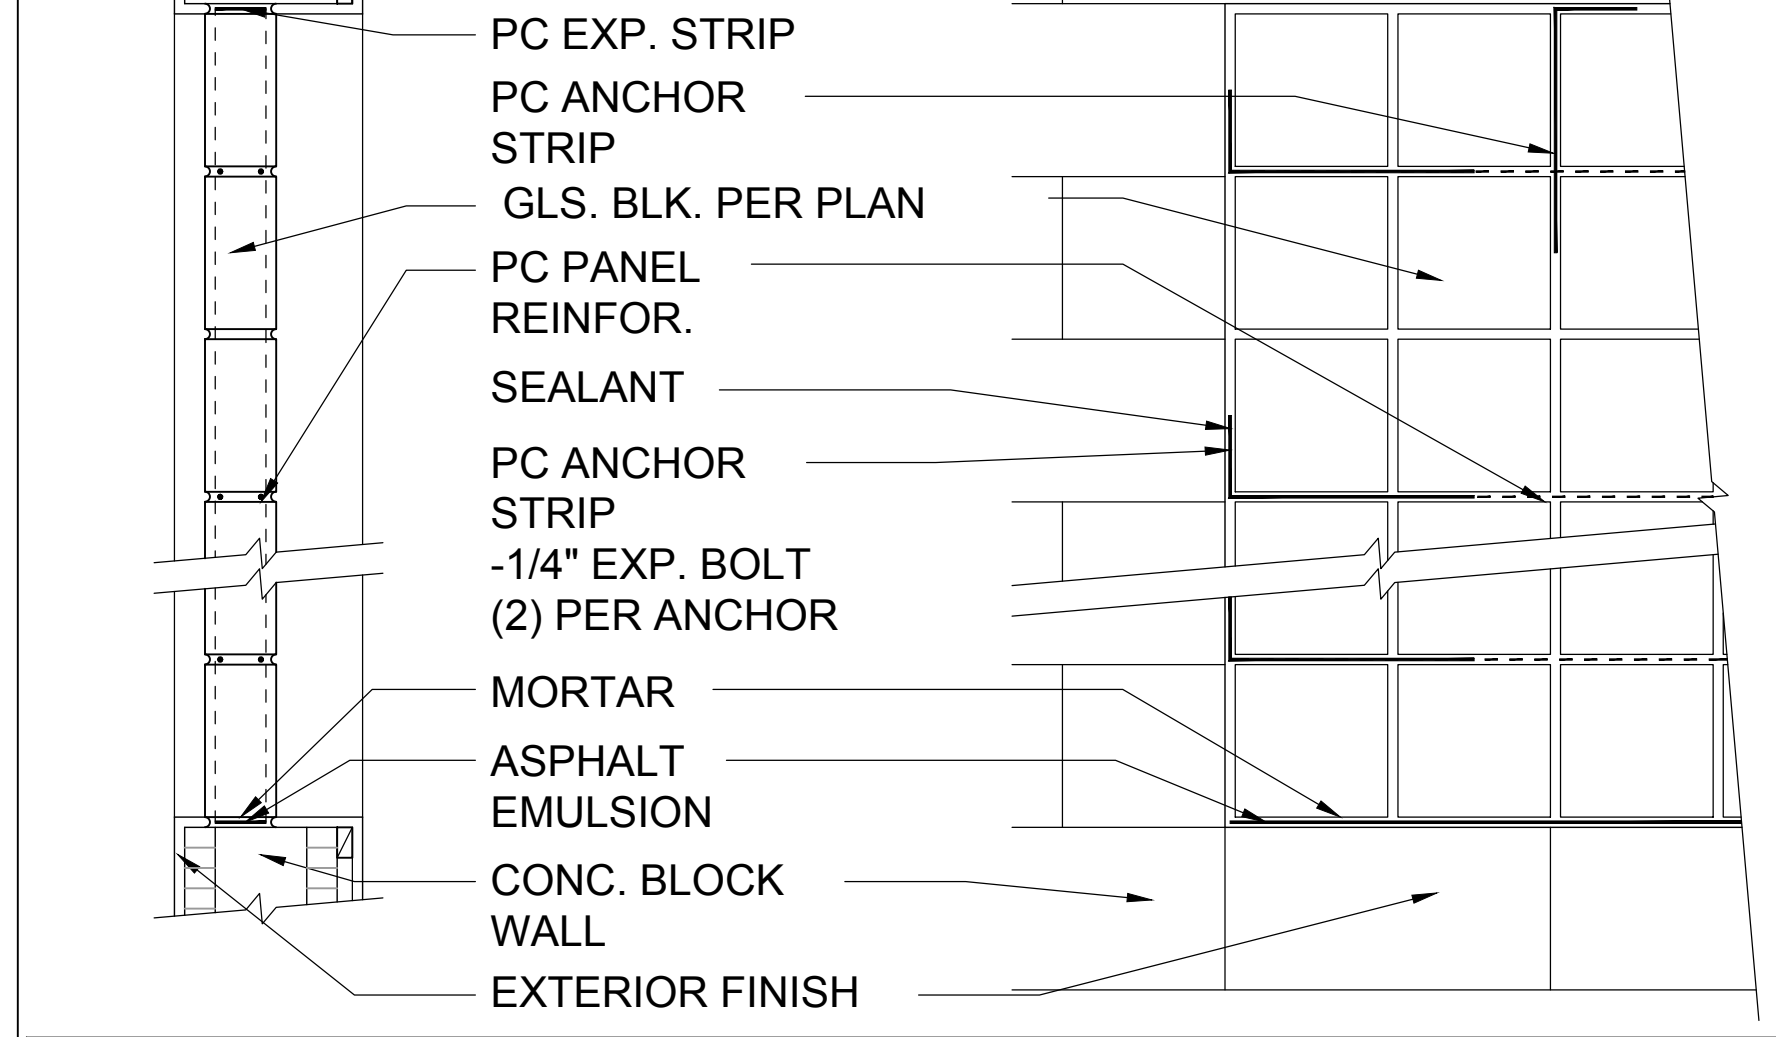


GLASS BLOCK DETAIL

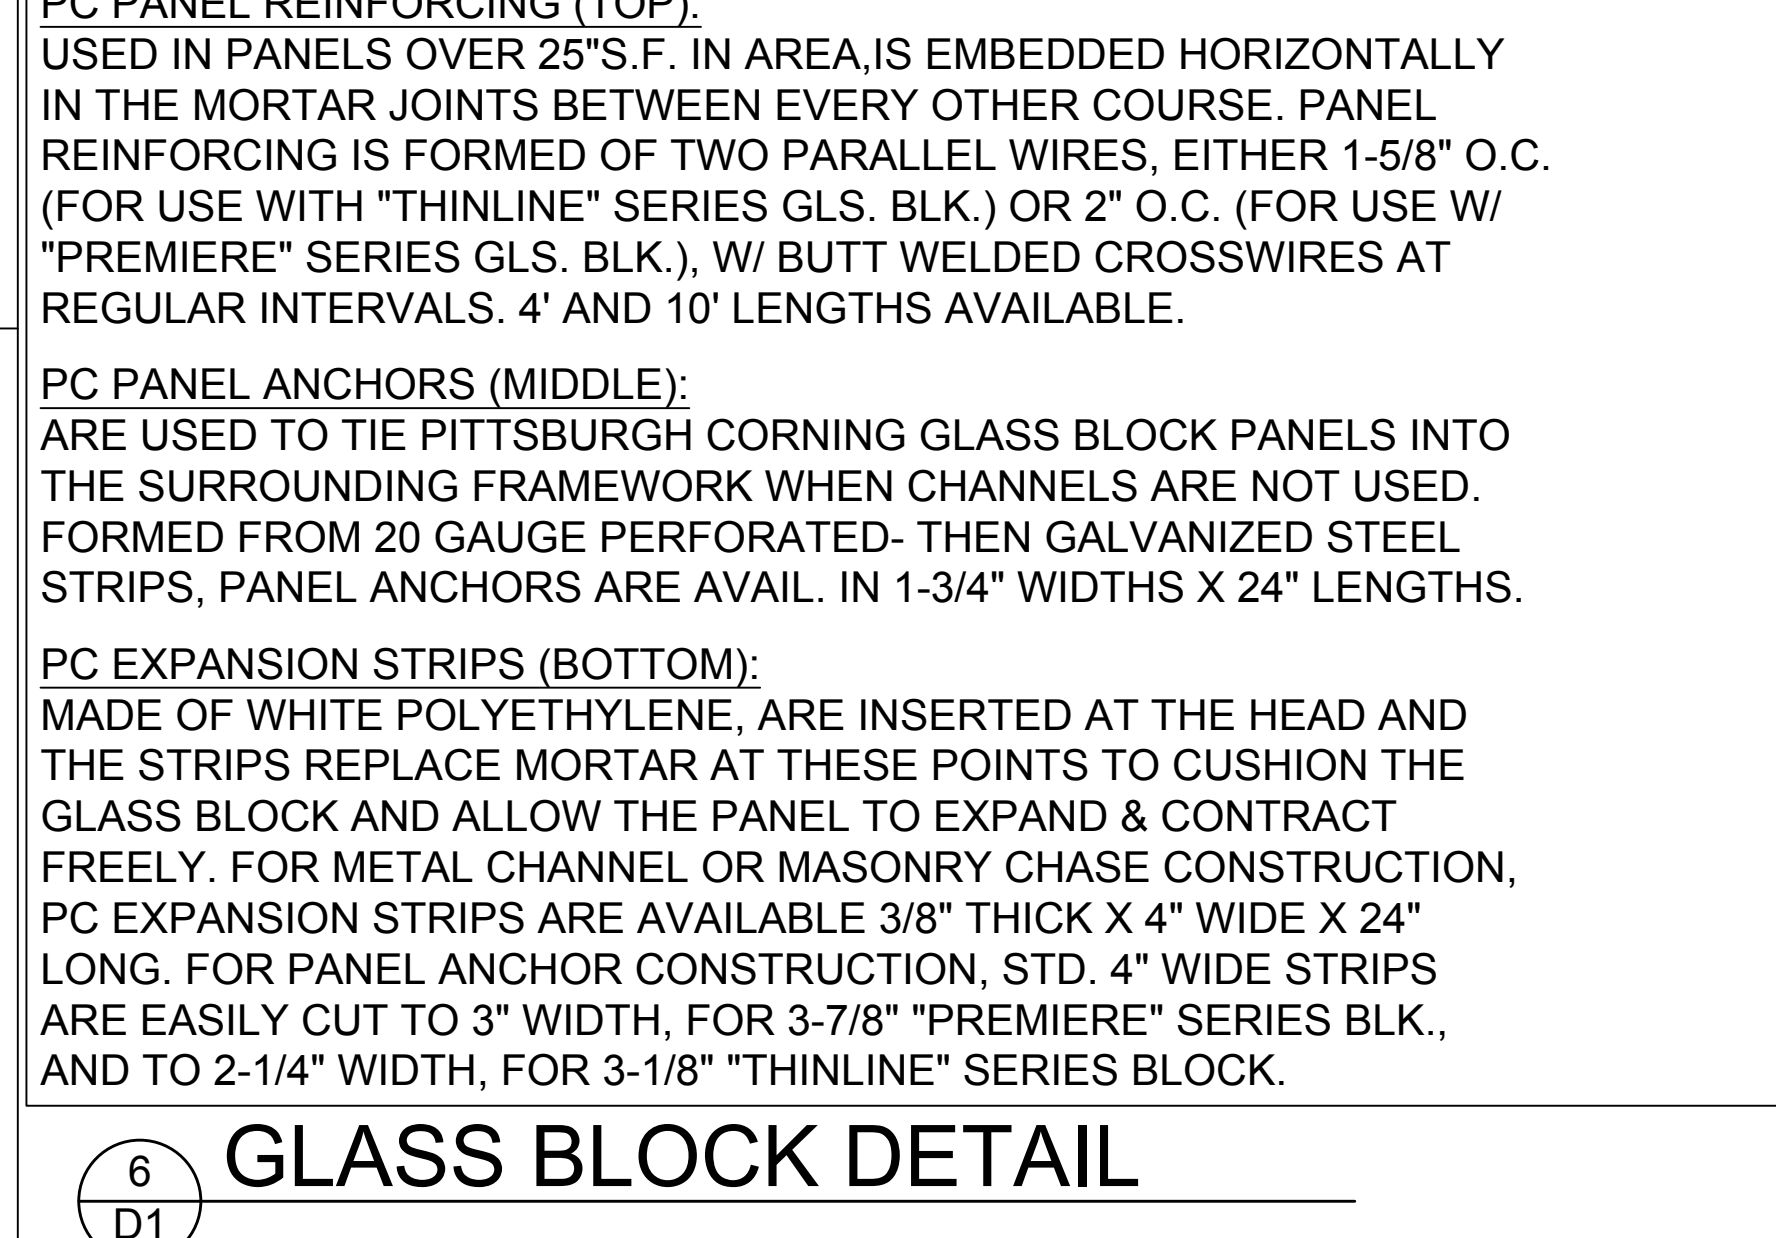




PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGN ARE NOT TO BE COPIED OR MODIFIED IN ANY MANNER OR FORM WHATSOEVER NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES. © COPYRIGHT 2016

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGN ARE NOT TO BE COPIED OR MODIFIED IN ANY MANNER OR FROM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

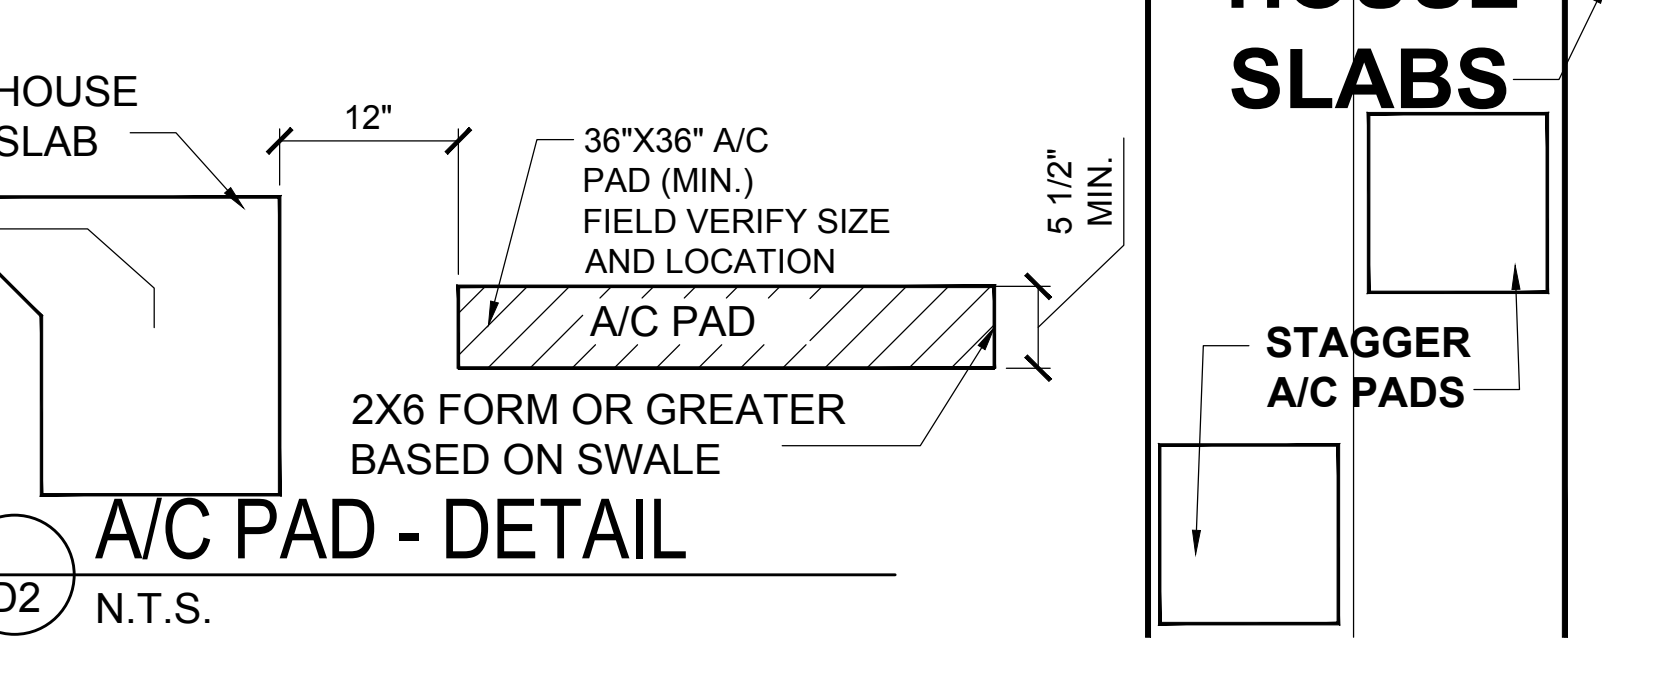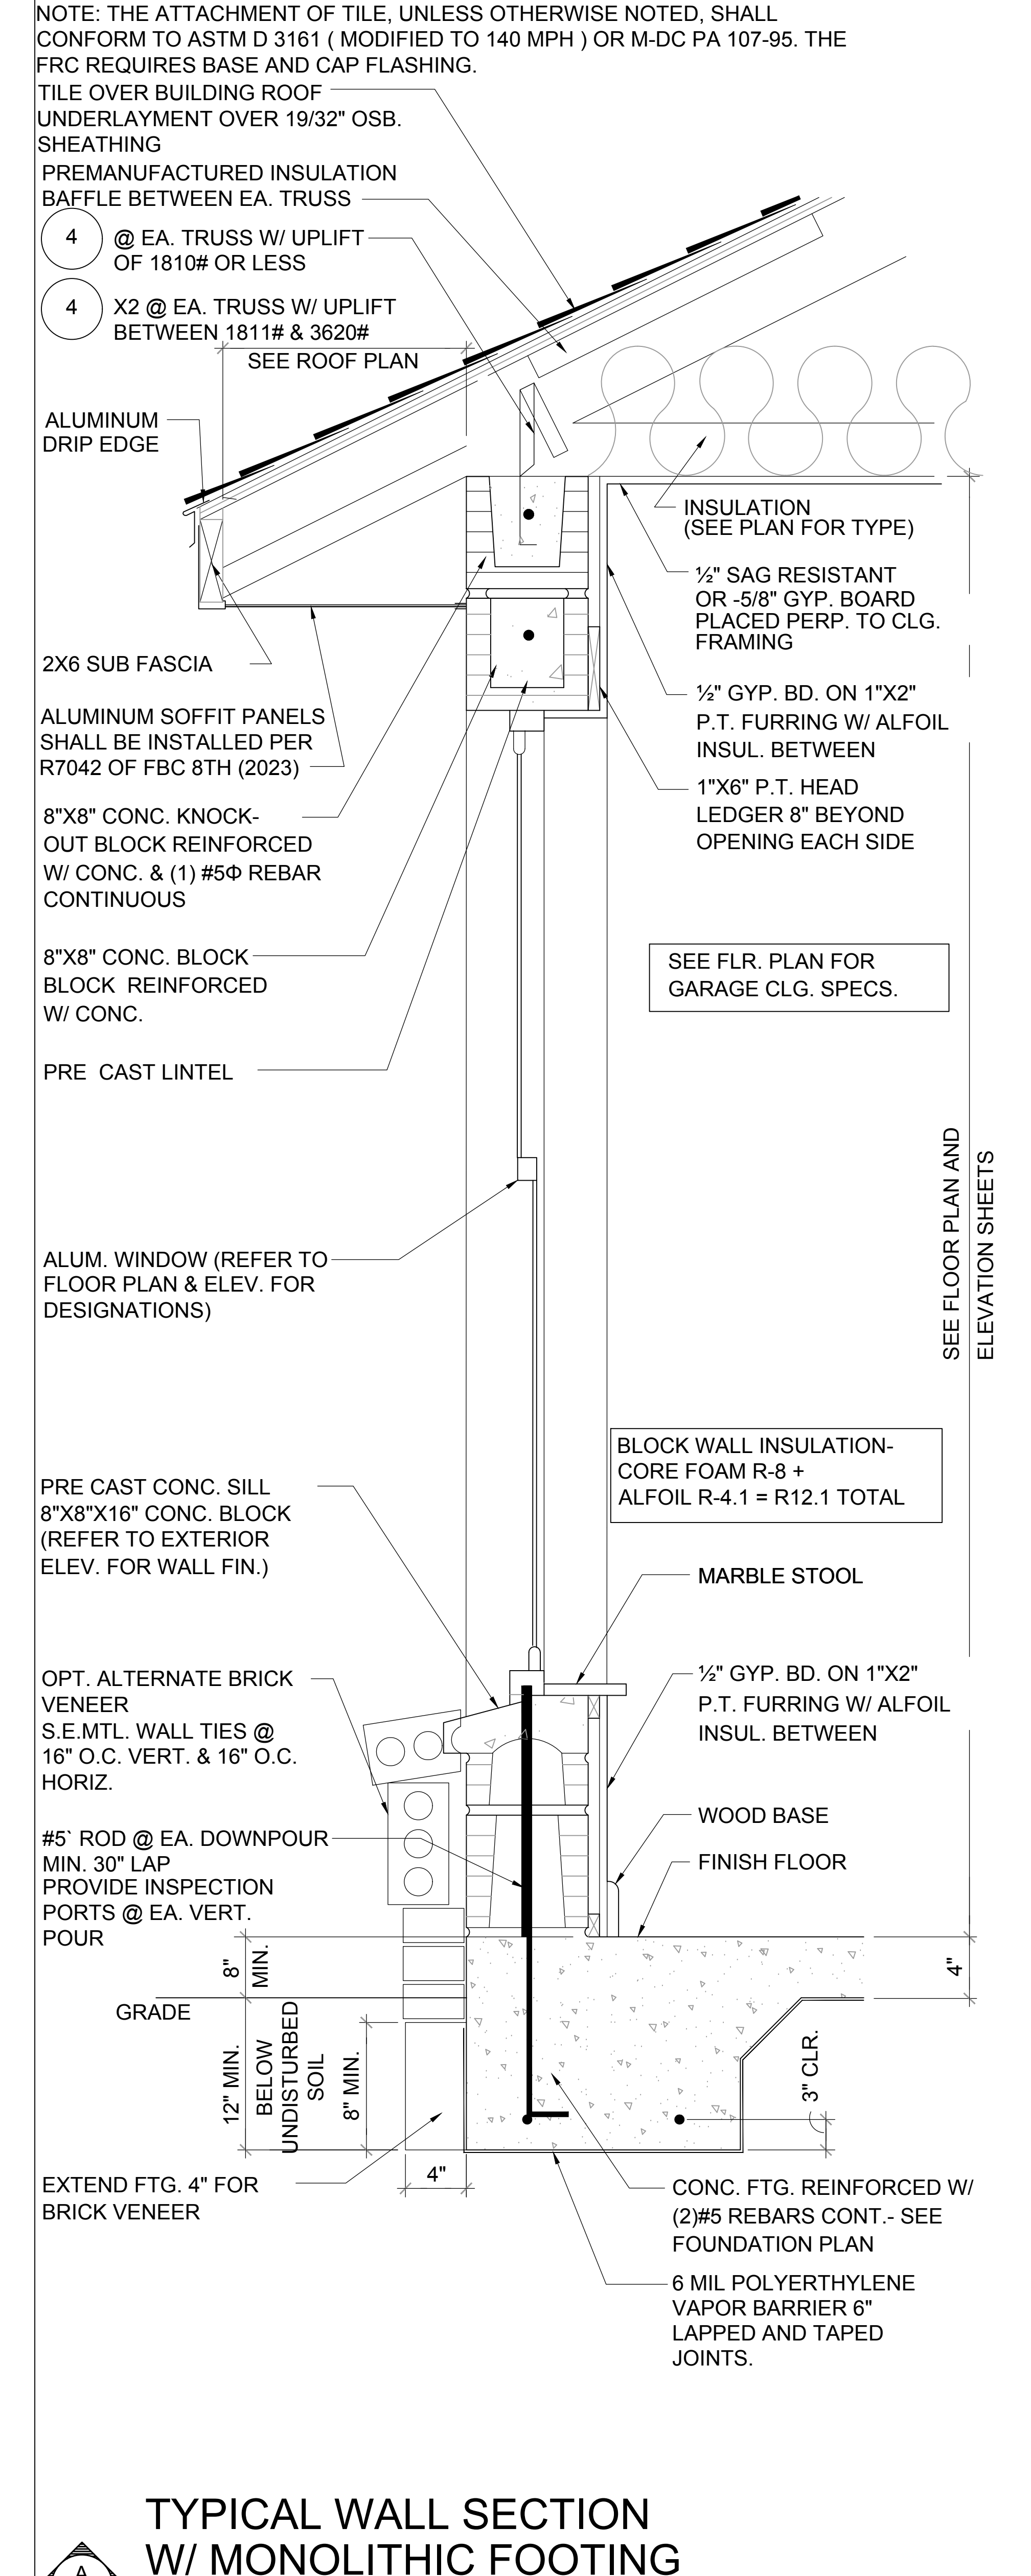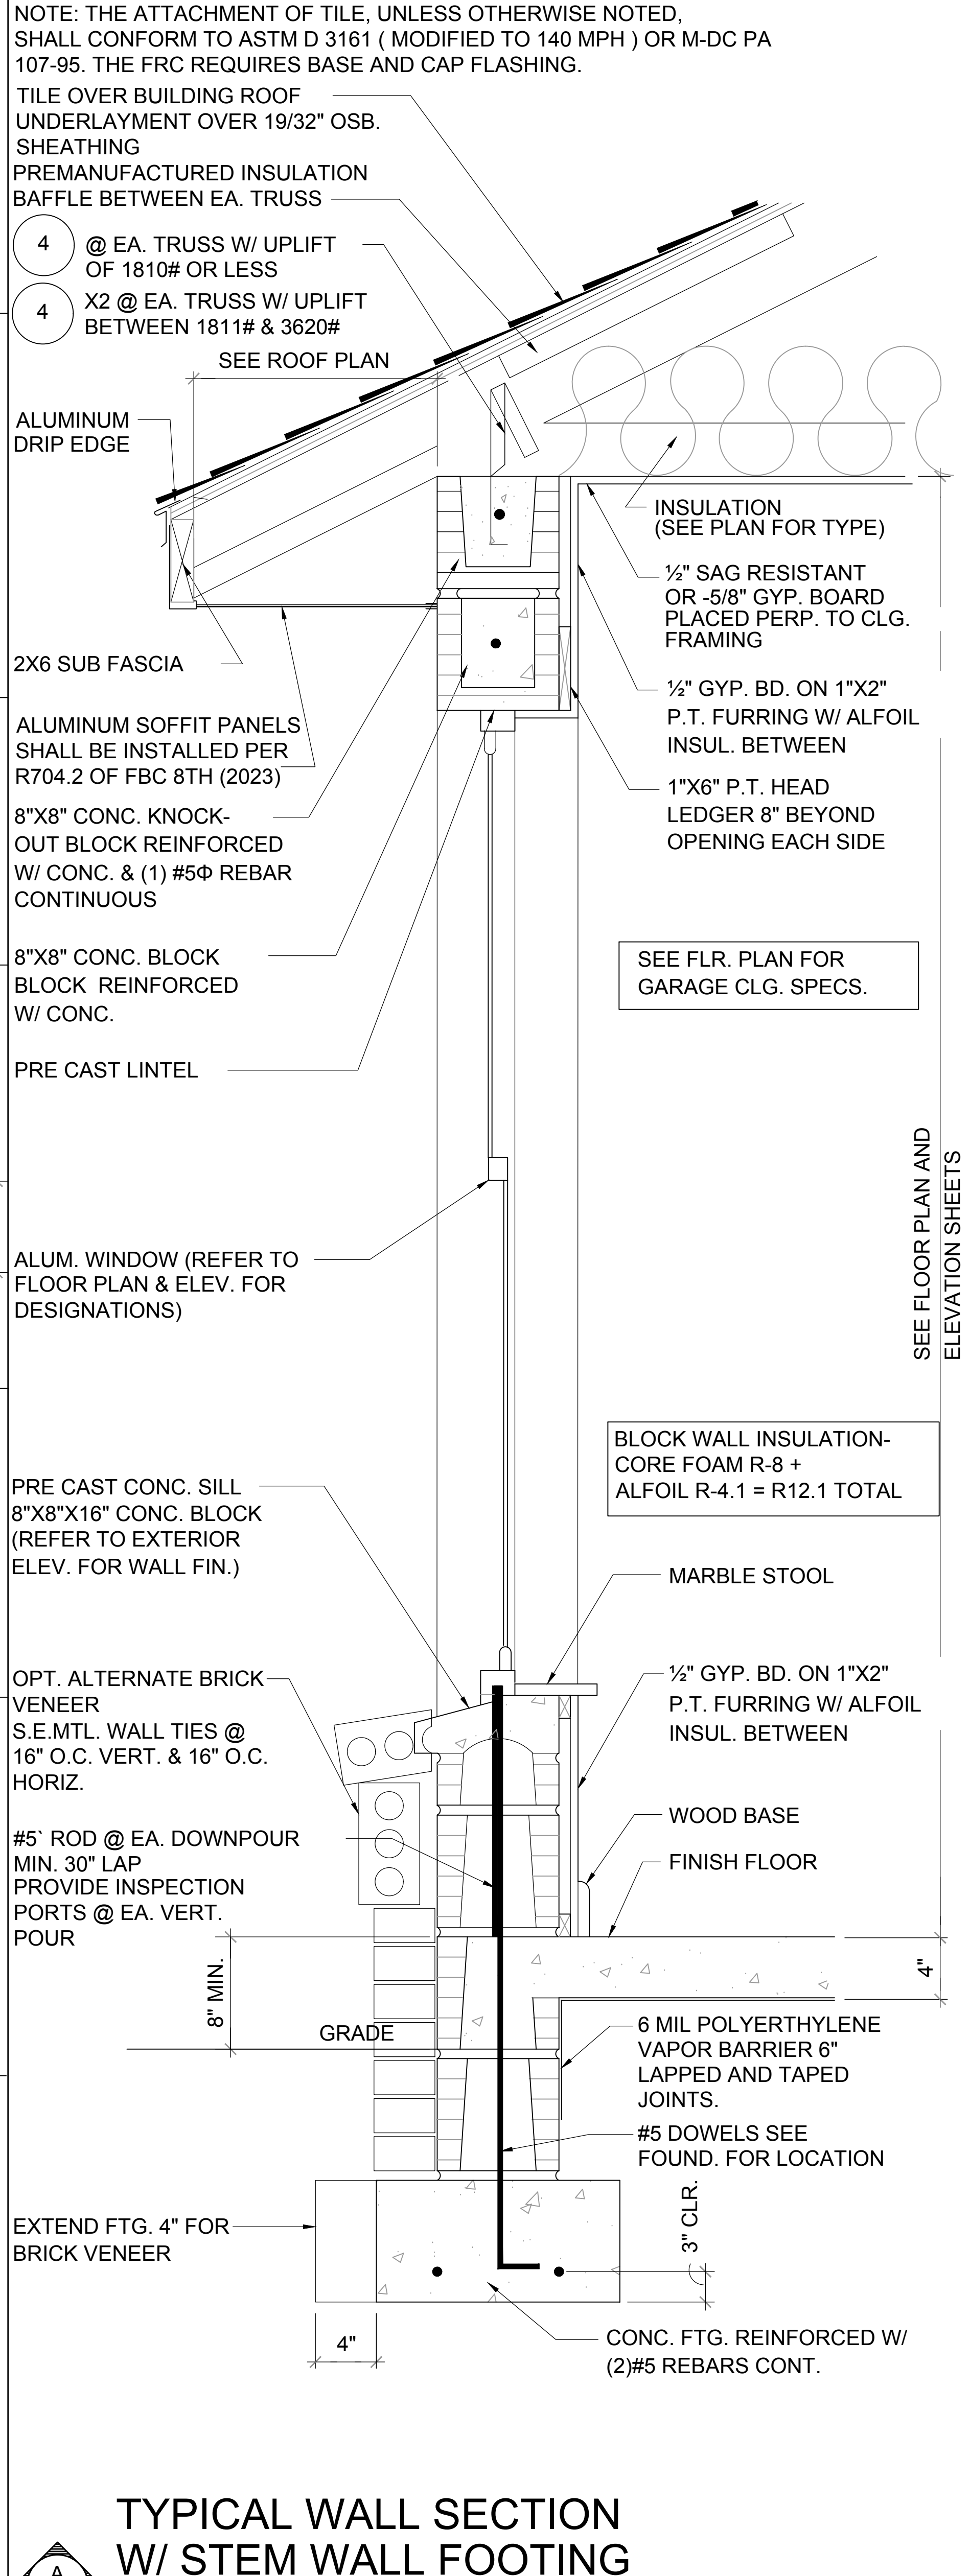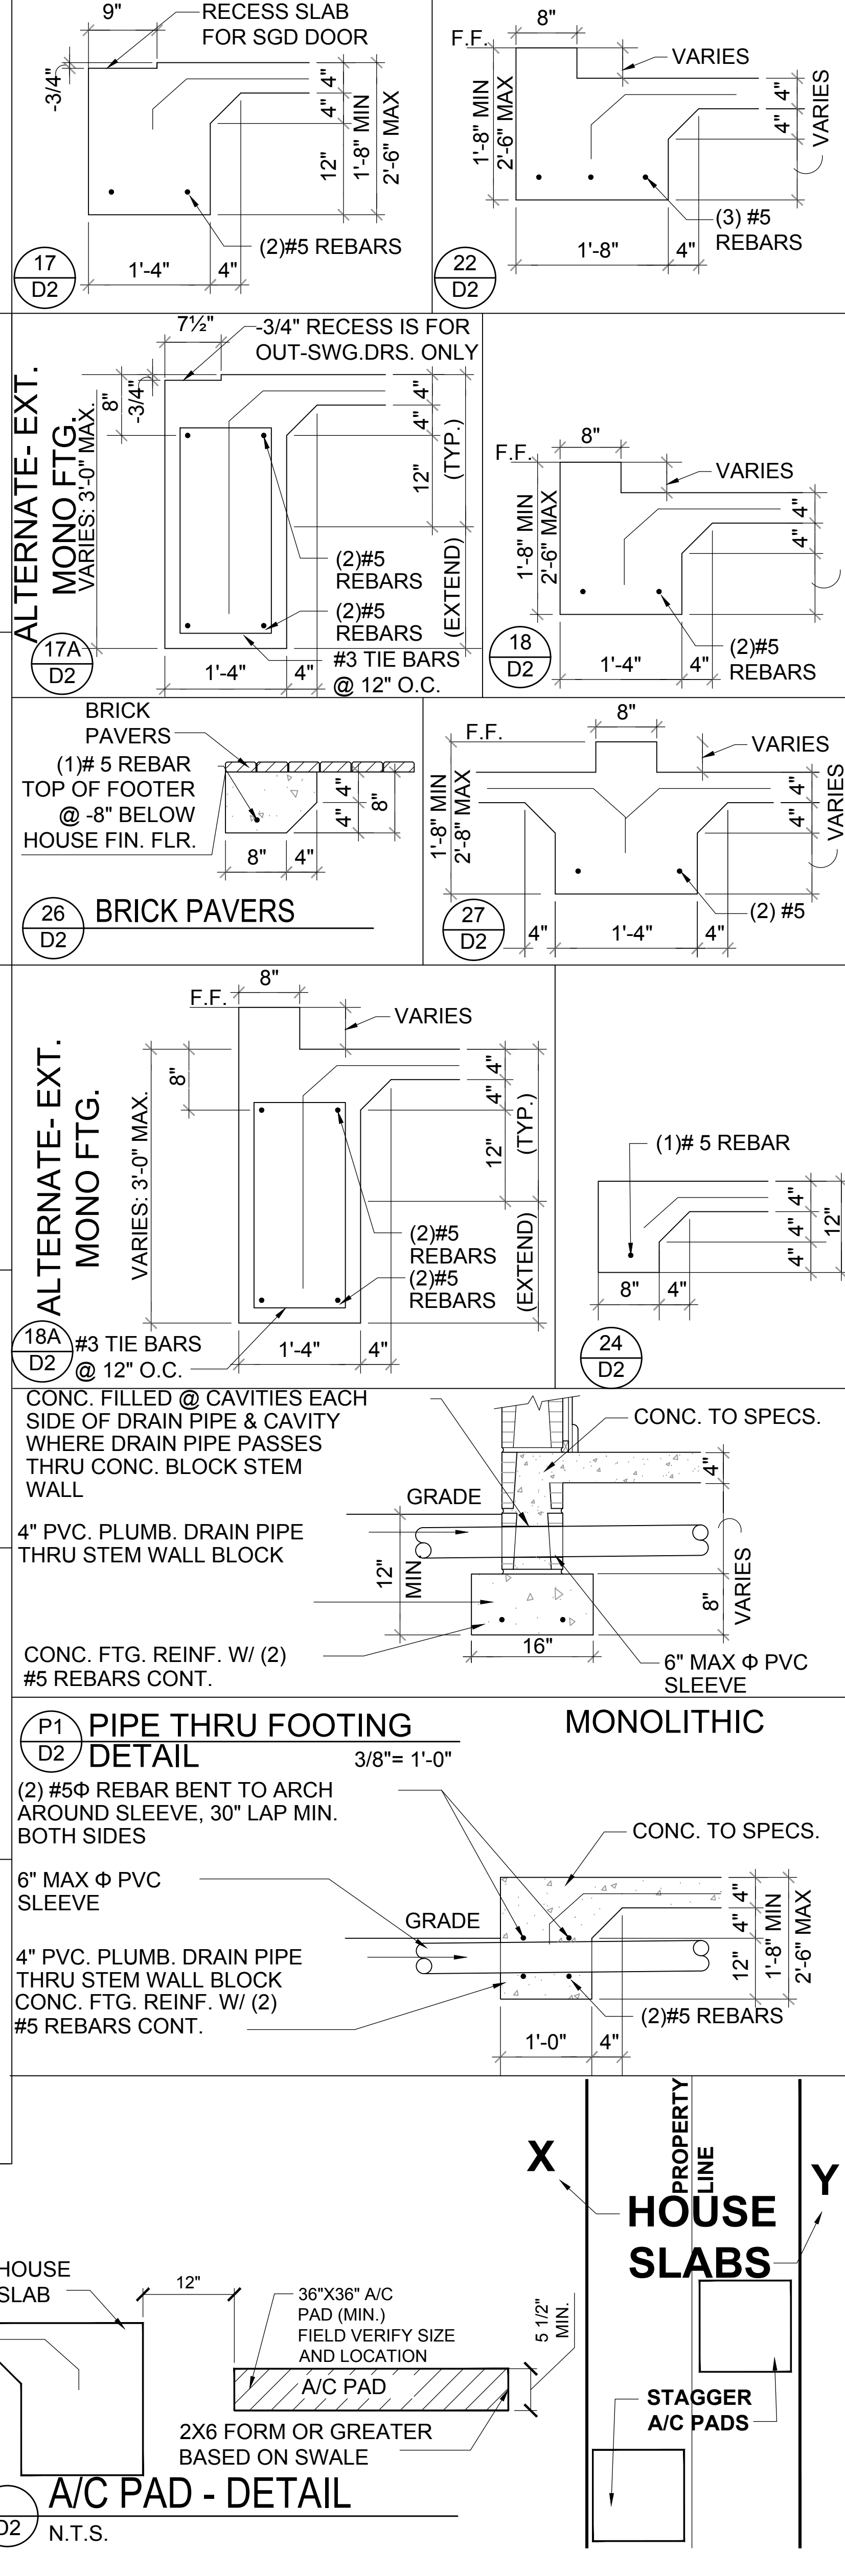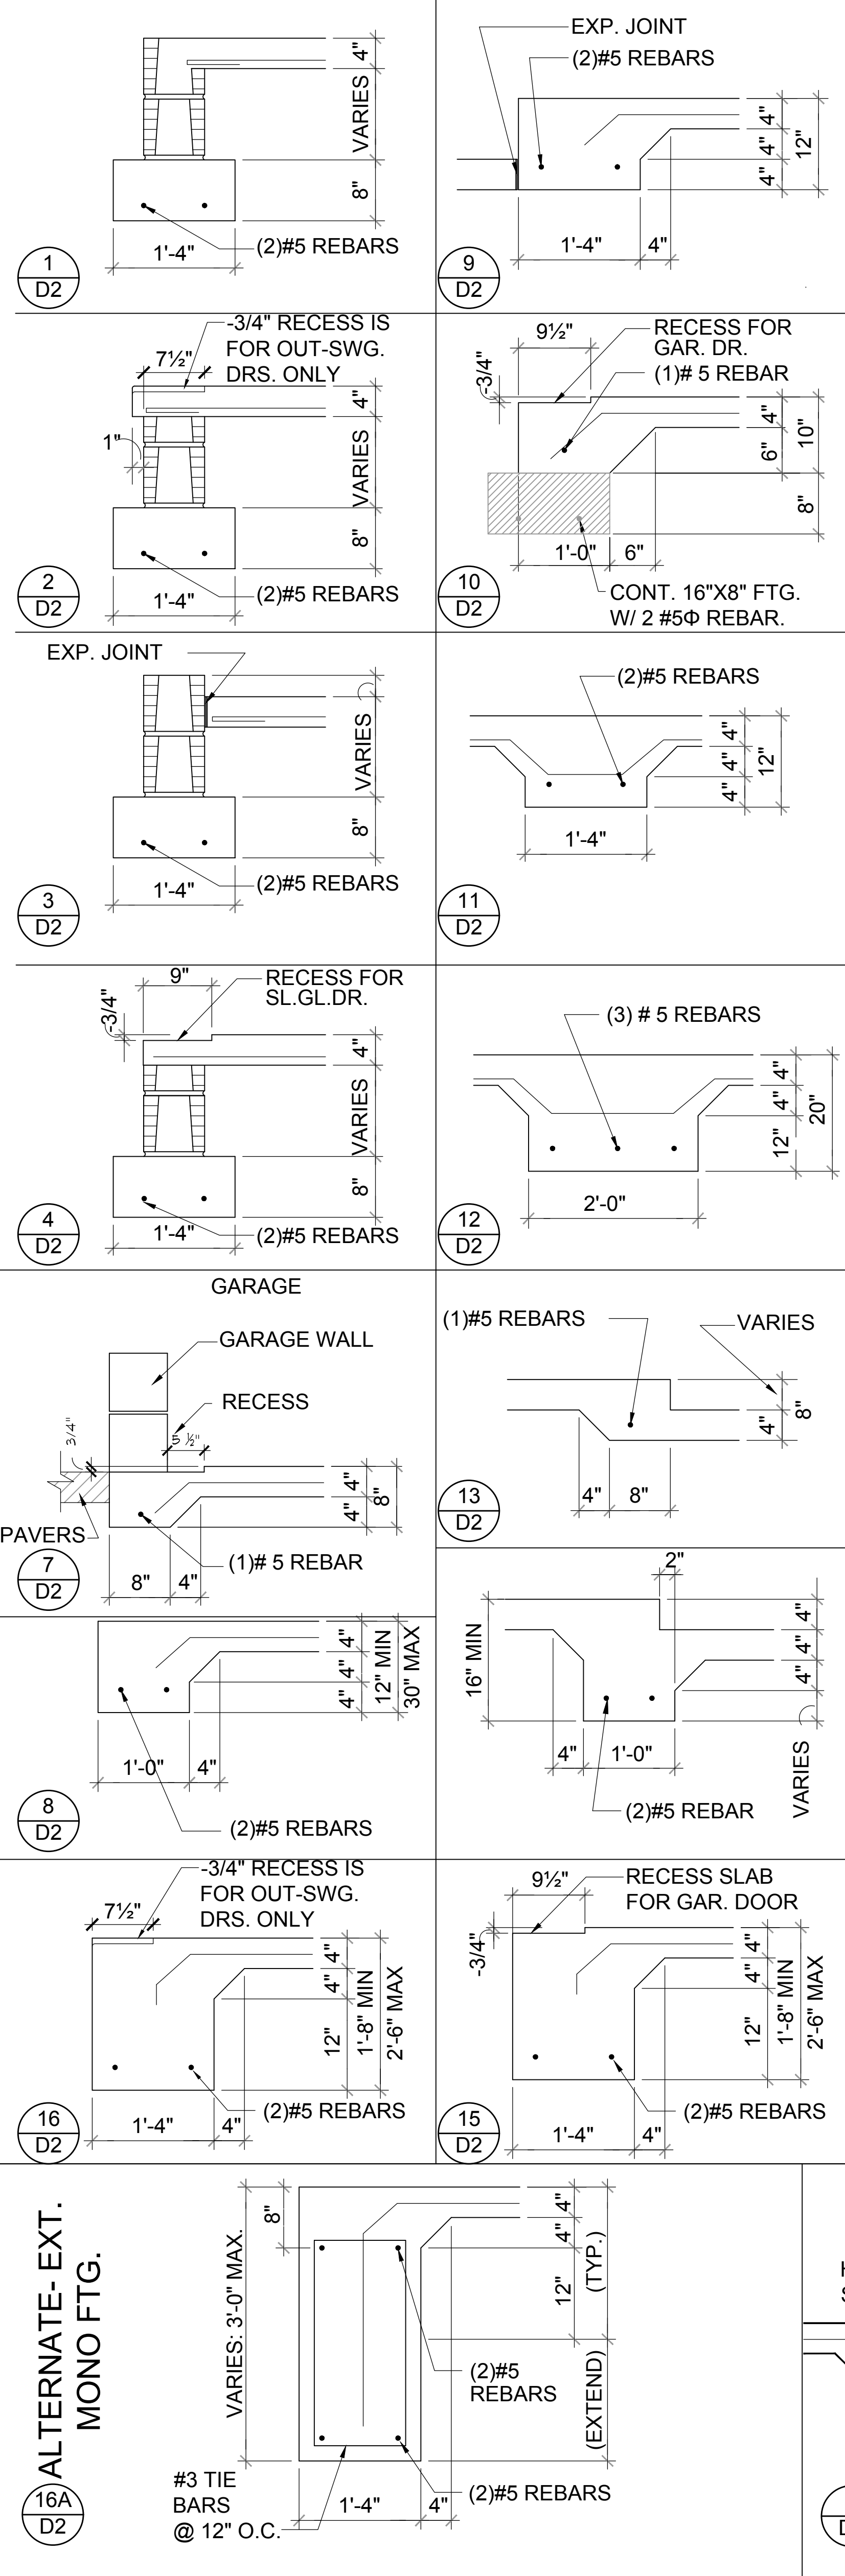



TYPICAL WALL SECTION W/ STEM WALL FOOTING
3/4" = 1'-0"

TYPICAL WALL SECTION W/ MONOLITHIC FOOTING
3/4" = 1'-0"

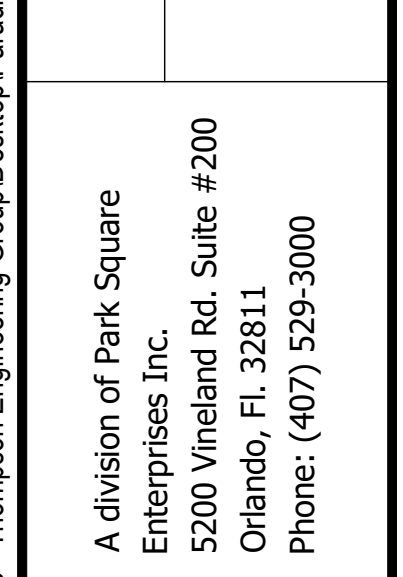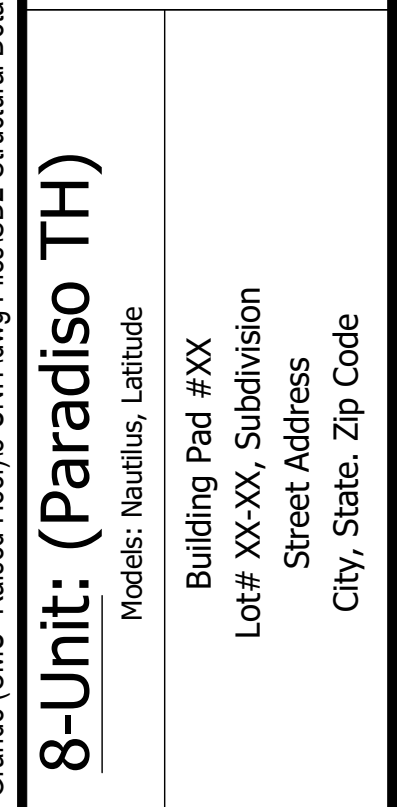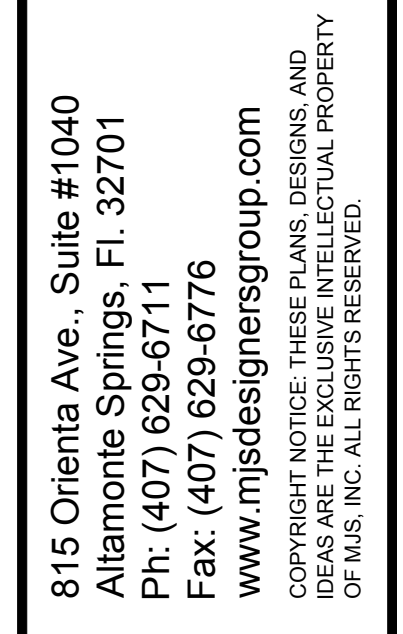

PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS
ISSUE DATE:	03/06/2023
REVISIONS:	
STRUCTURAL DETAILS:	D2

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGNS. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MANNER OR FORM WHATSOEVER NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

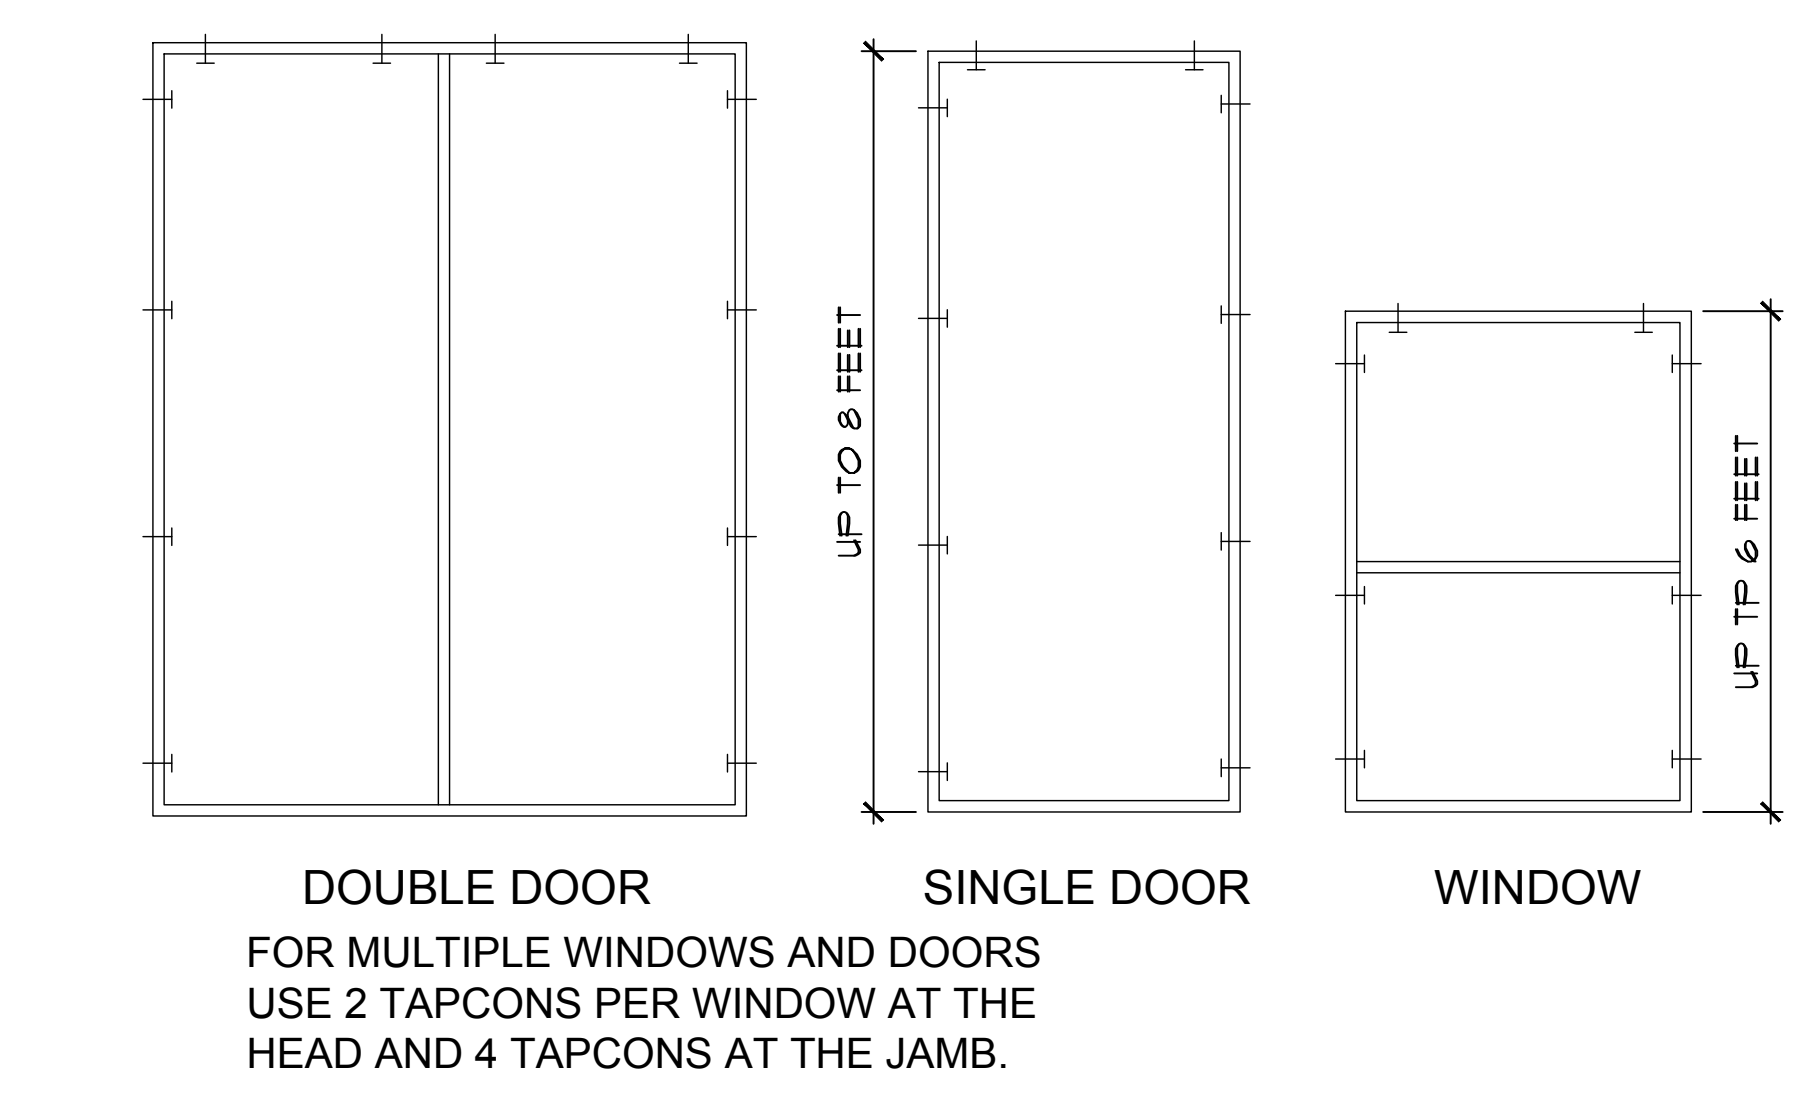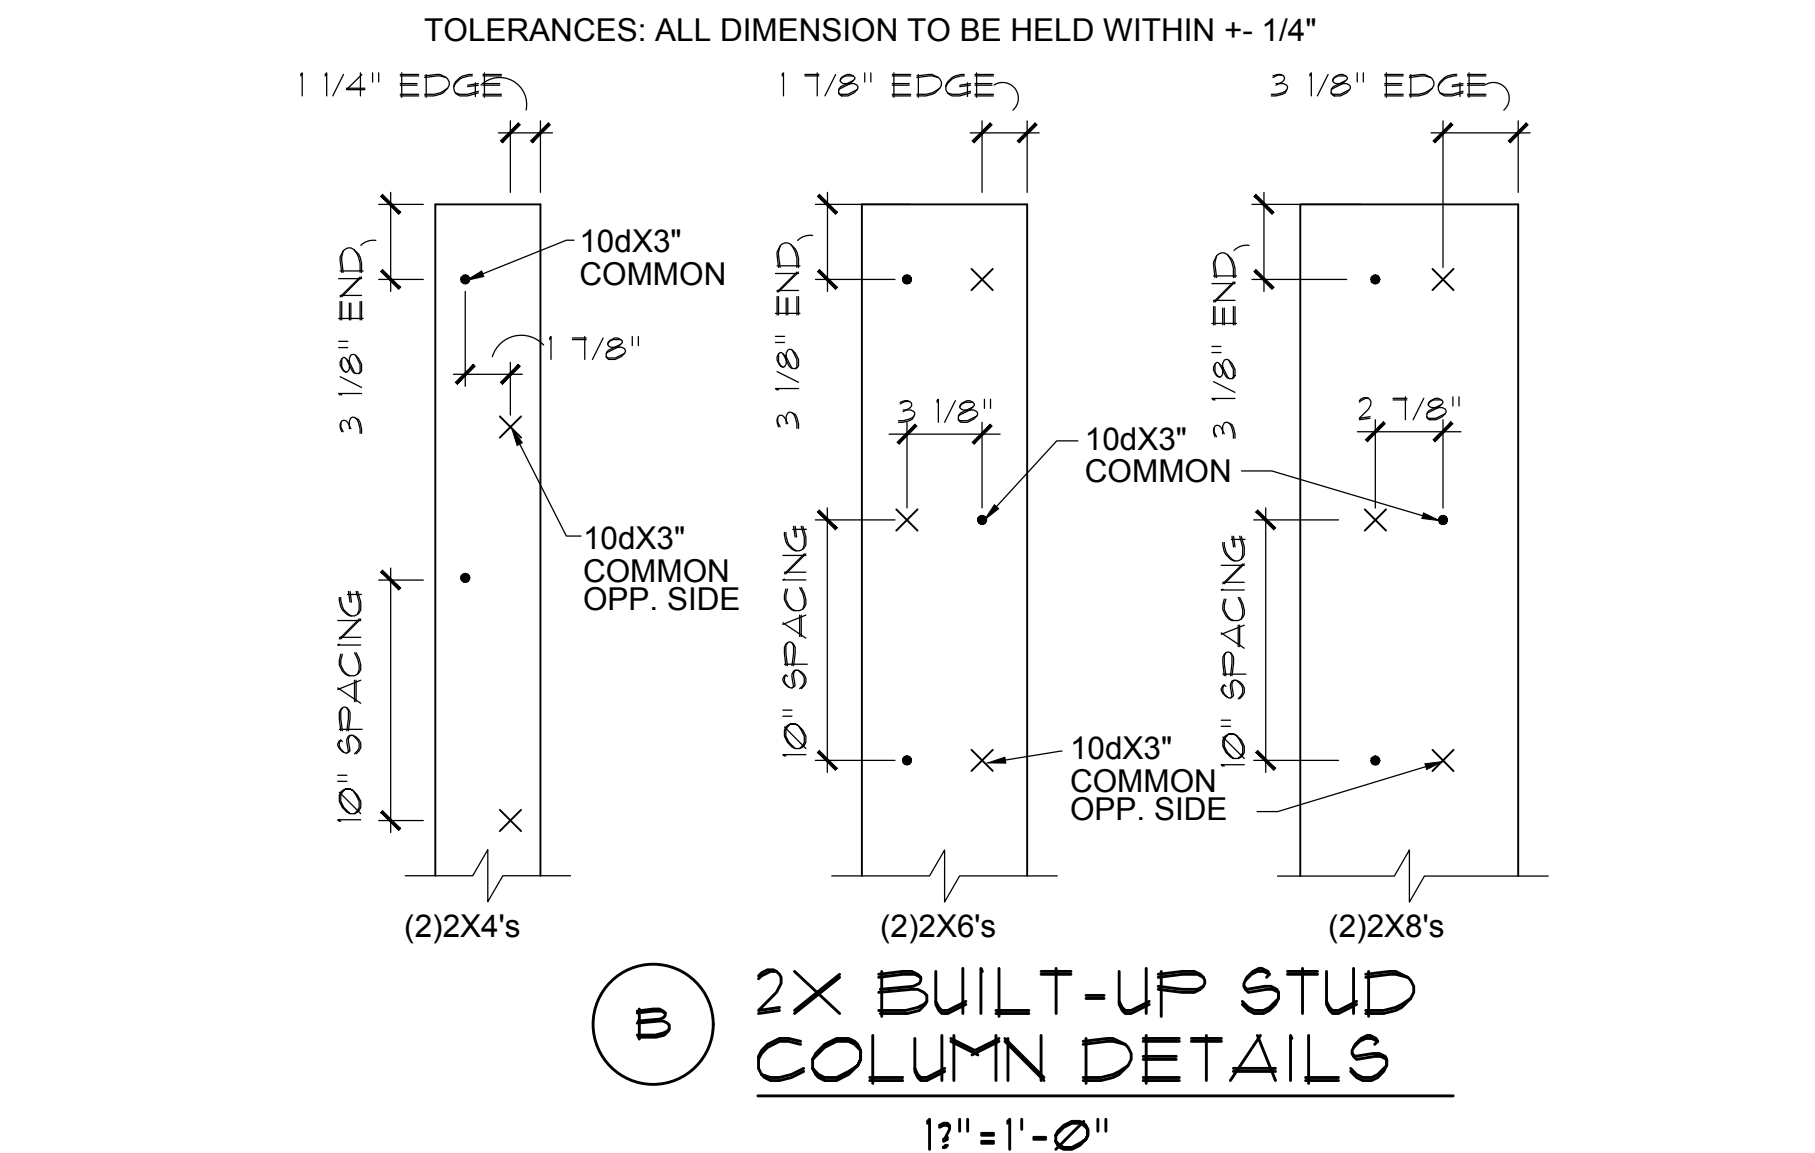











BUCK ATTACHMENT DATA

BUCKS SHALL BE 1x4 OR 2x8 PT AT WINDOWS OR 2x8 PT AT DOORS IN PINE OR SPRUCE. AT WINDOWS ATTACH BUCKS TO BLOCK WITH COMMON T-NAILS AND PLACEMENT SIMILAR TO TAPCONS SHOWN. AT DOORS OR FIN WINDOWS IN BLOCK, ATTACH BUCKS w/ 2 T-NAILS TOP AND BOTTOM AND 8" O.C. STAGGERED IN THE FIELD.

USE MIN. 2-1/4" T-NAILS w/ 1x BUCK. USE MIN. -1/4" x 3" TAPCONS w/ 2x BUCK. START ALL END TAPCONS WITHIN 6" OF CORNERS AND 30" ON CENTER MAXIMUM.

NOTE

IN CASE OF BLOCK OPENINGS LARGER THAN DOOR FRAMING: ATTACH ADDITIONAL 2X FRAMING TO THE BLOCK WALL USING 1/4" x 4" TAPCONS AT 3" FROM END AND 12" O.C. IN THE CENTER. ATTACH TOP FRAMING TO HEADER USING 1/4"x1-3/4" TAPCONS W/ (1) 6" FROM END TO END AND 12" O.C. IN THE CENTER.

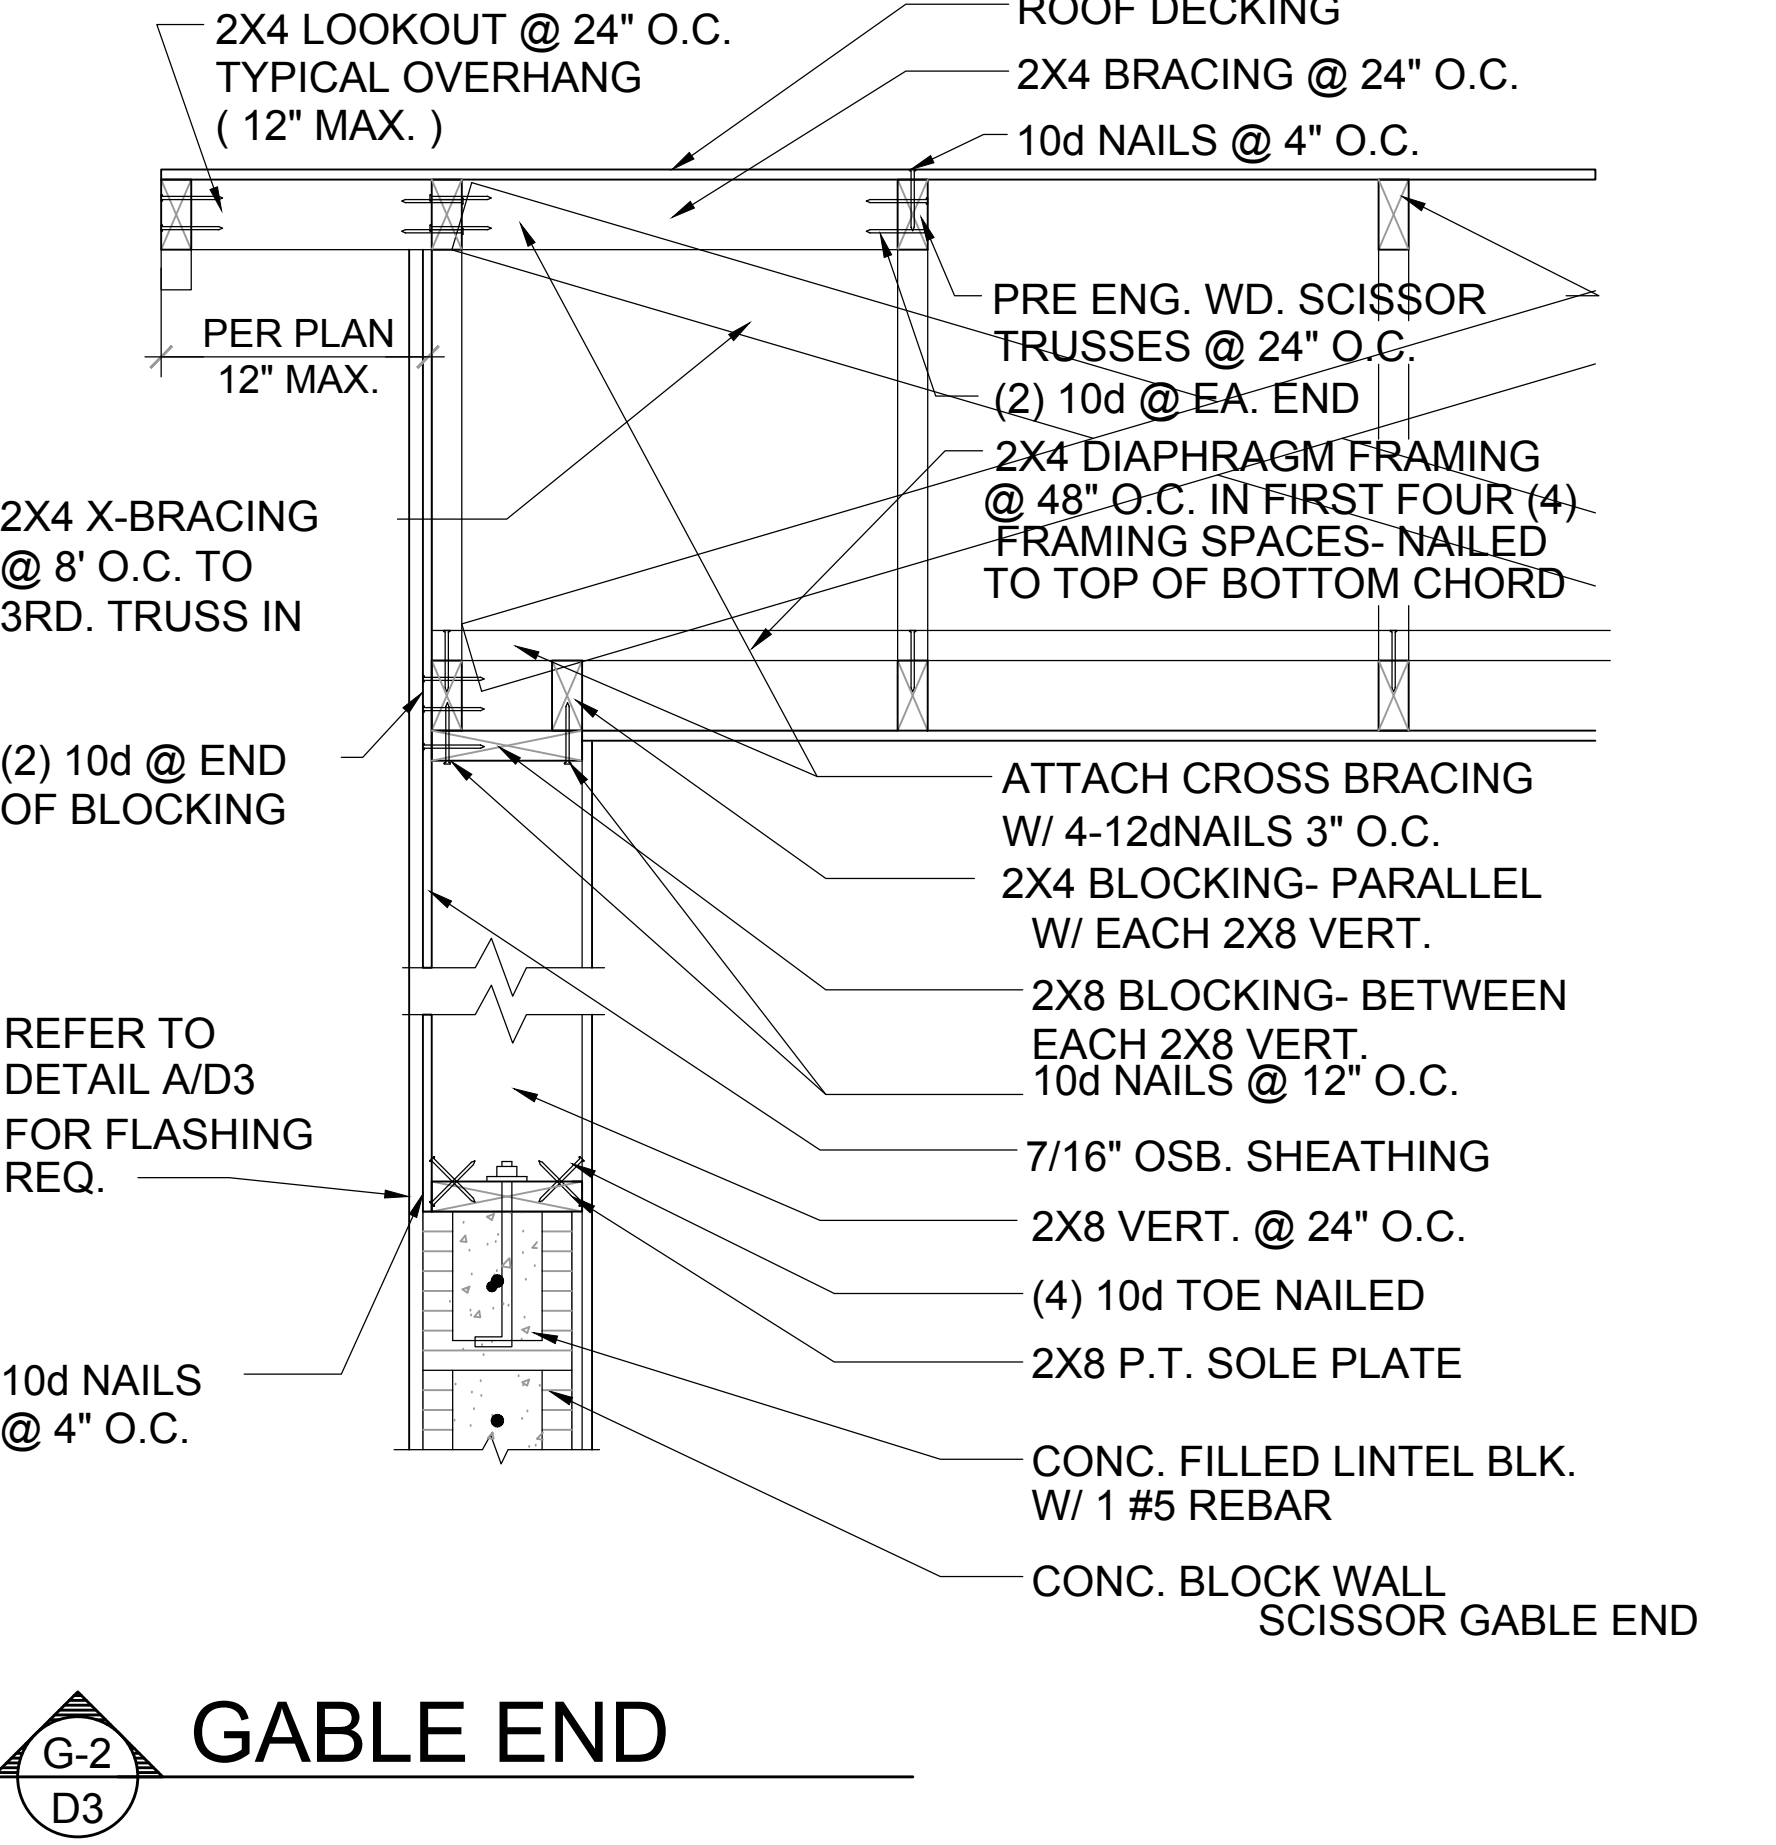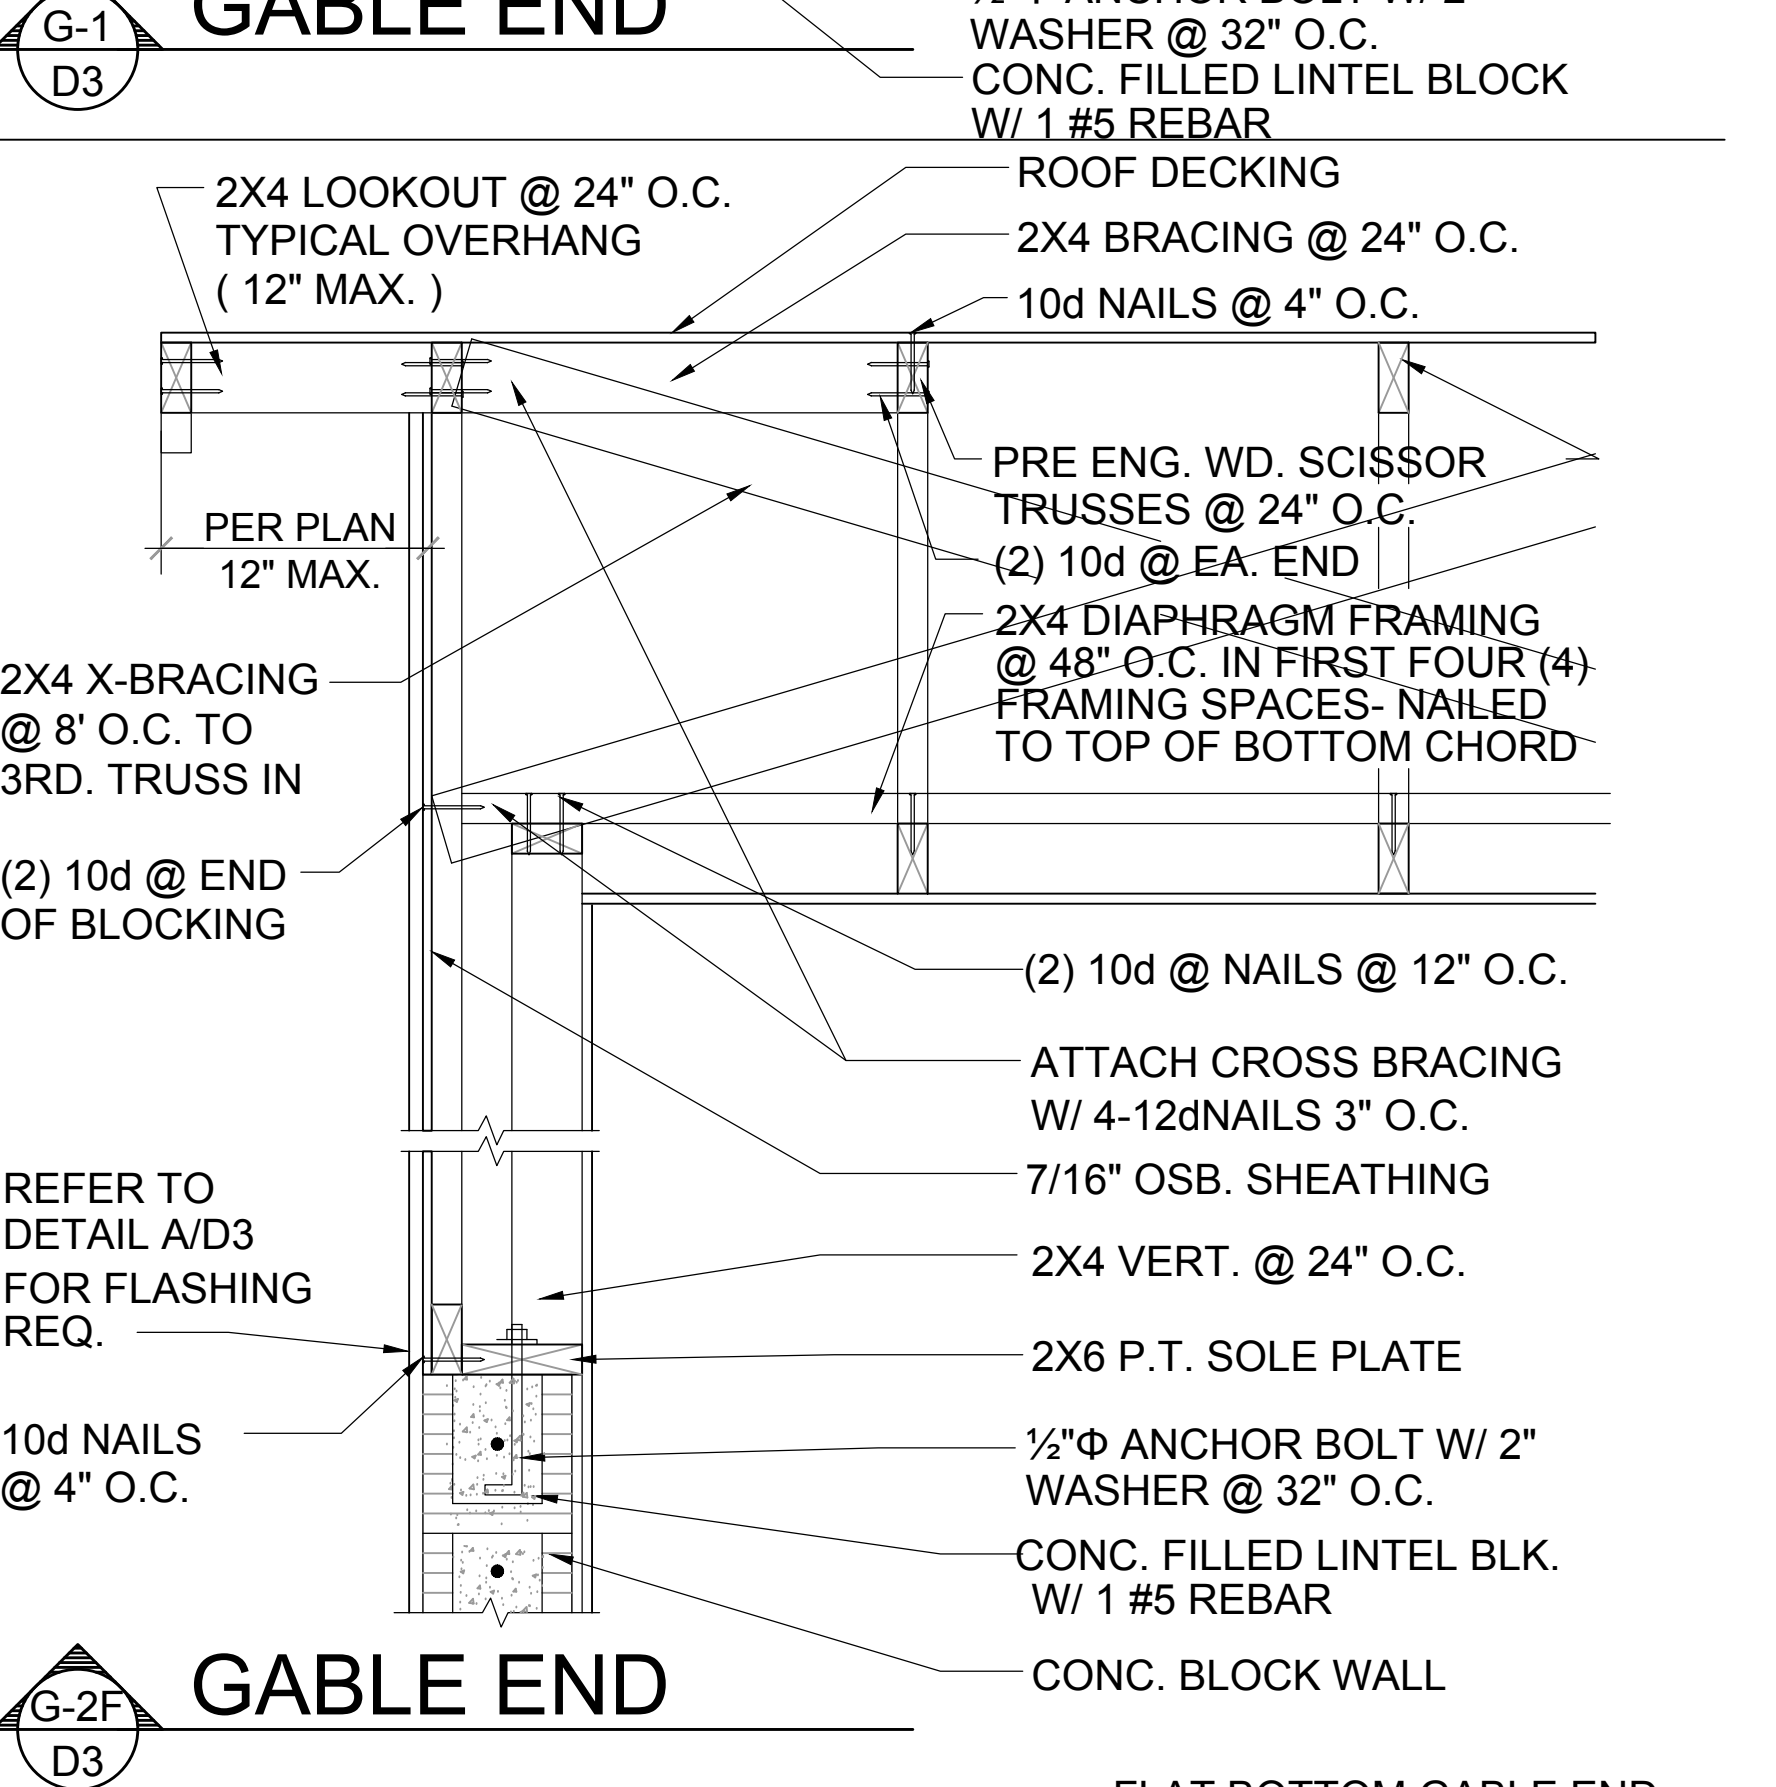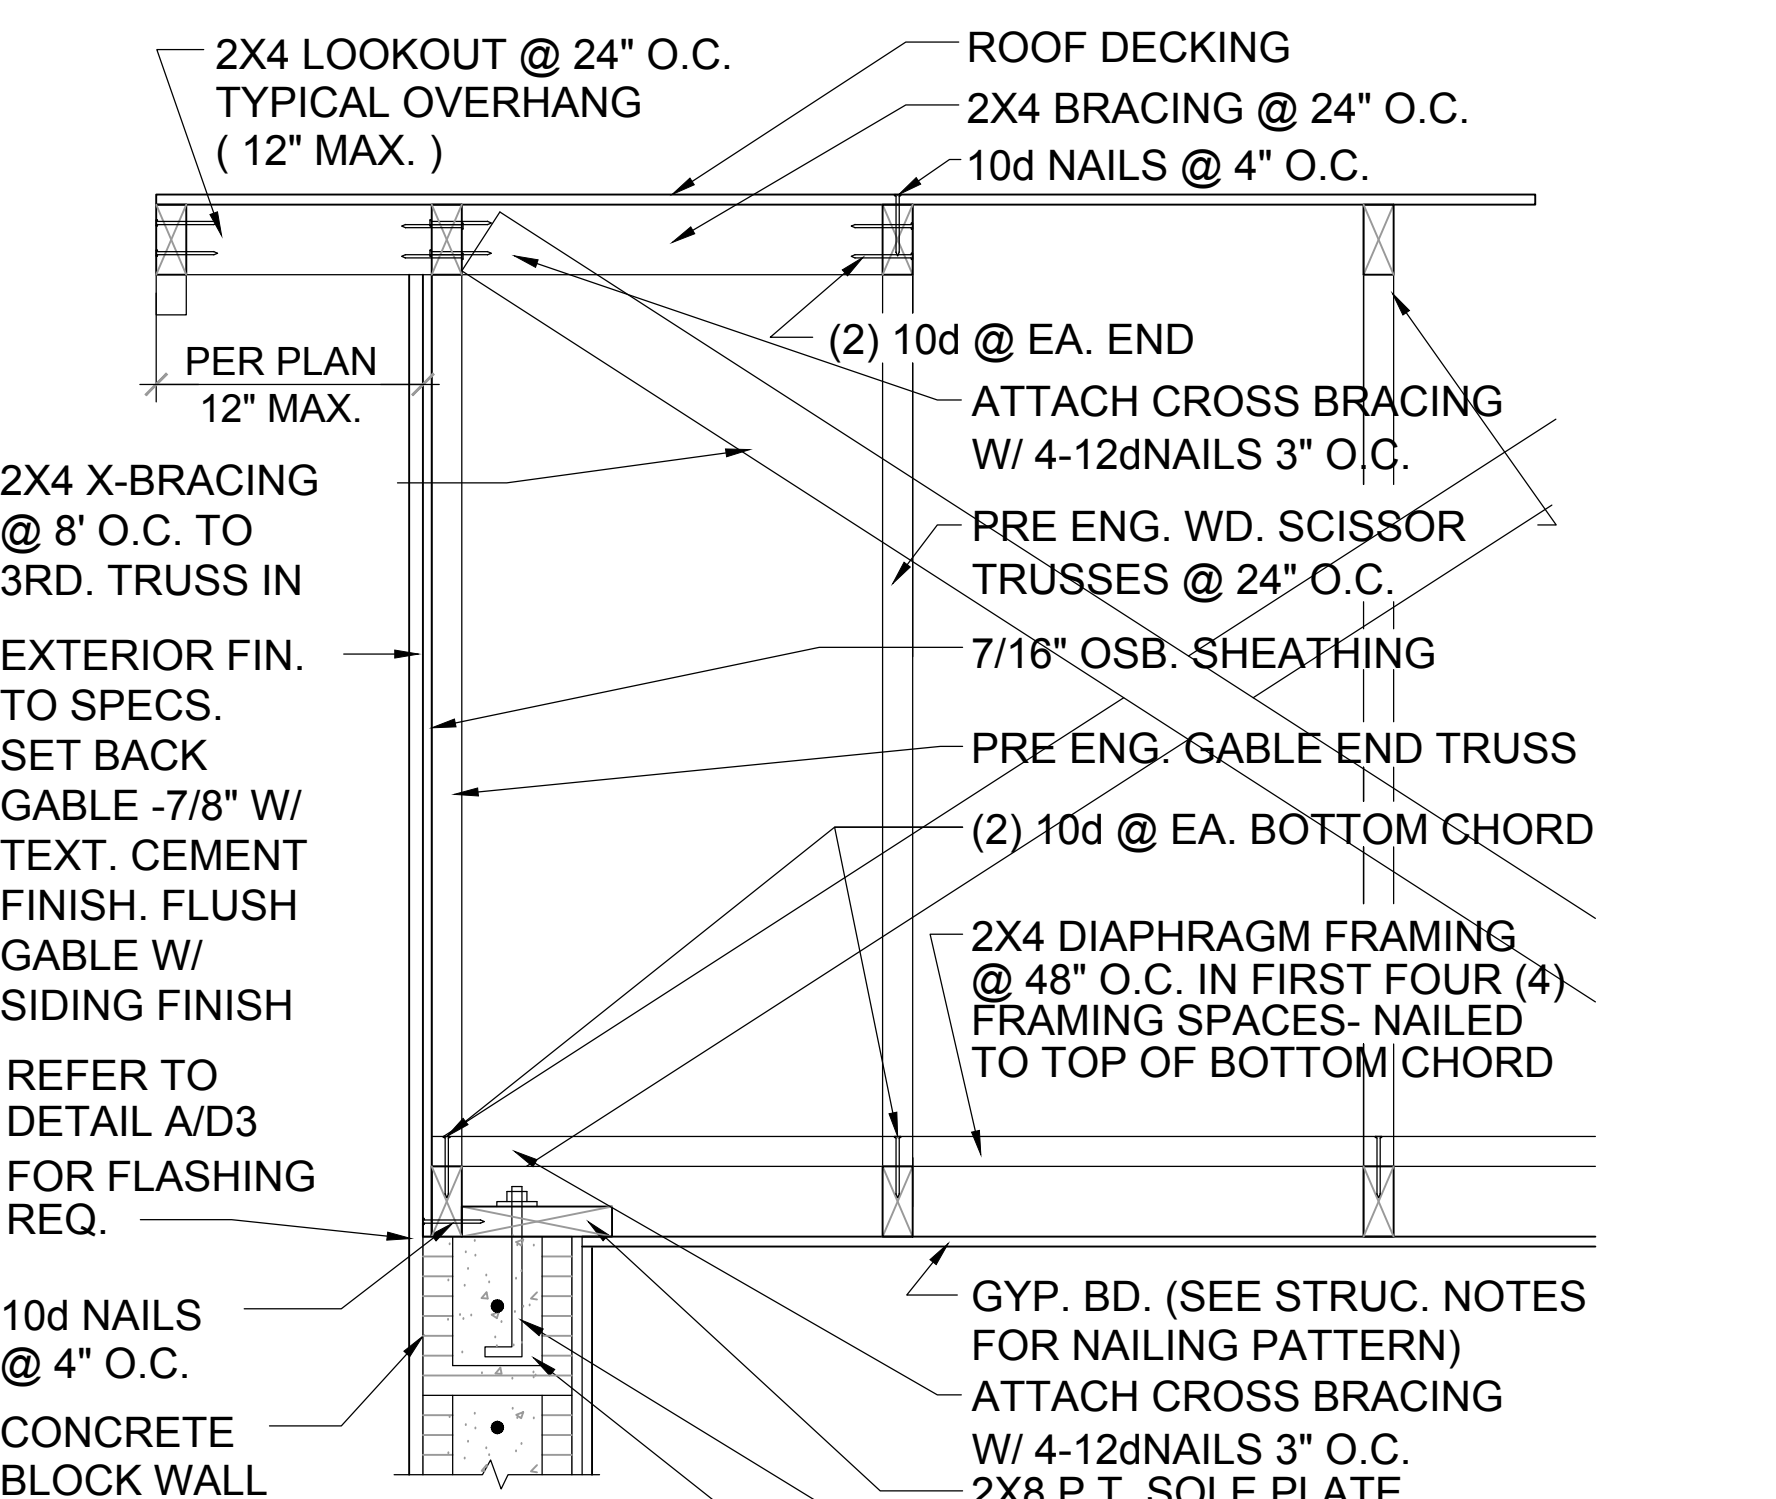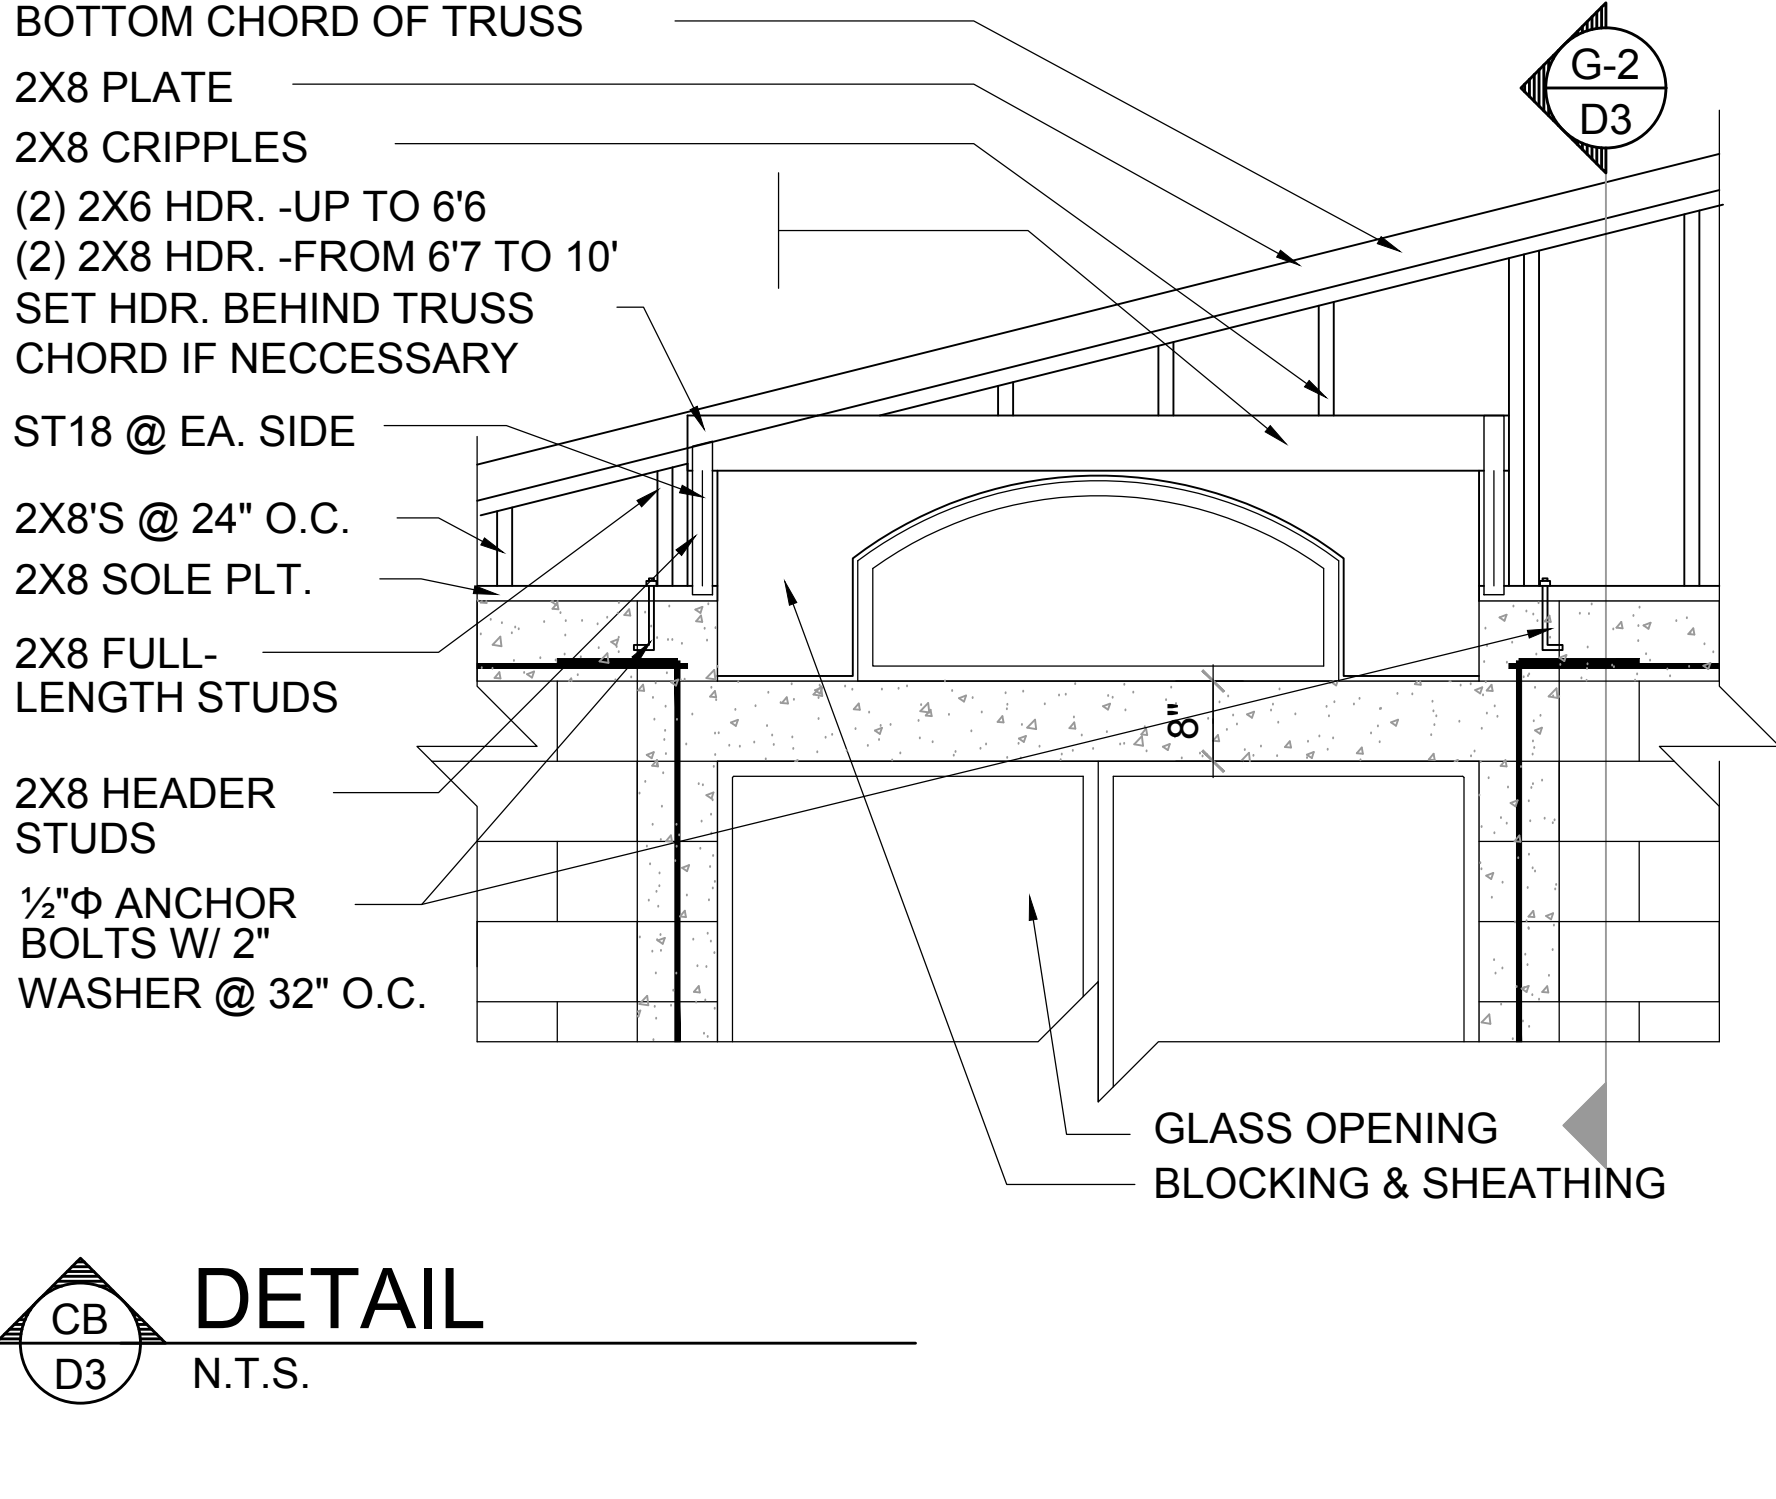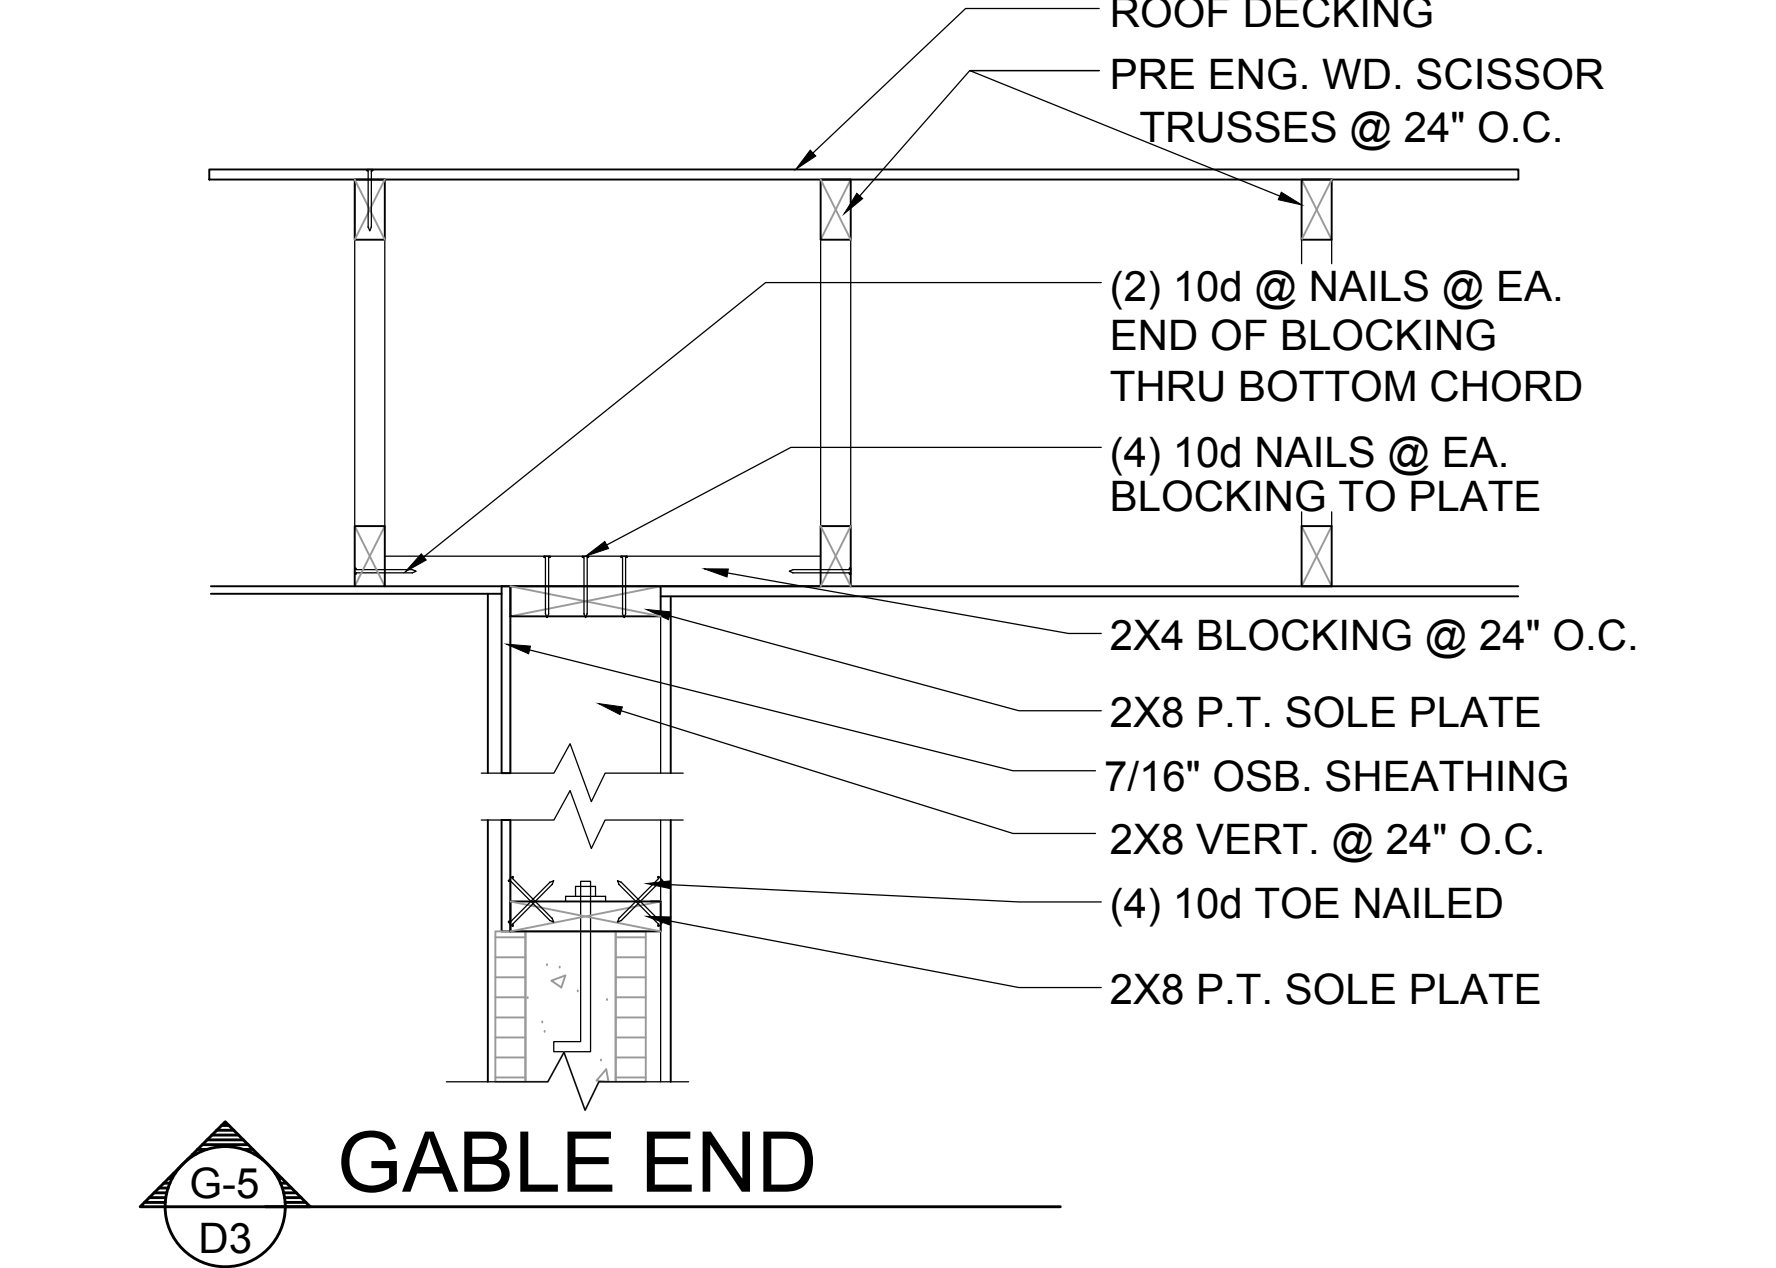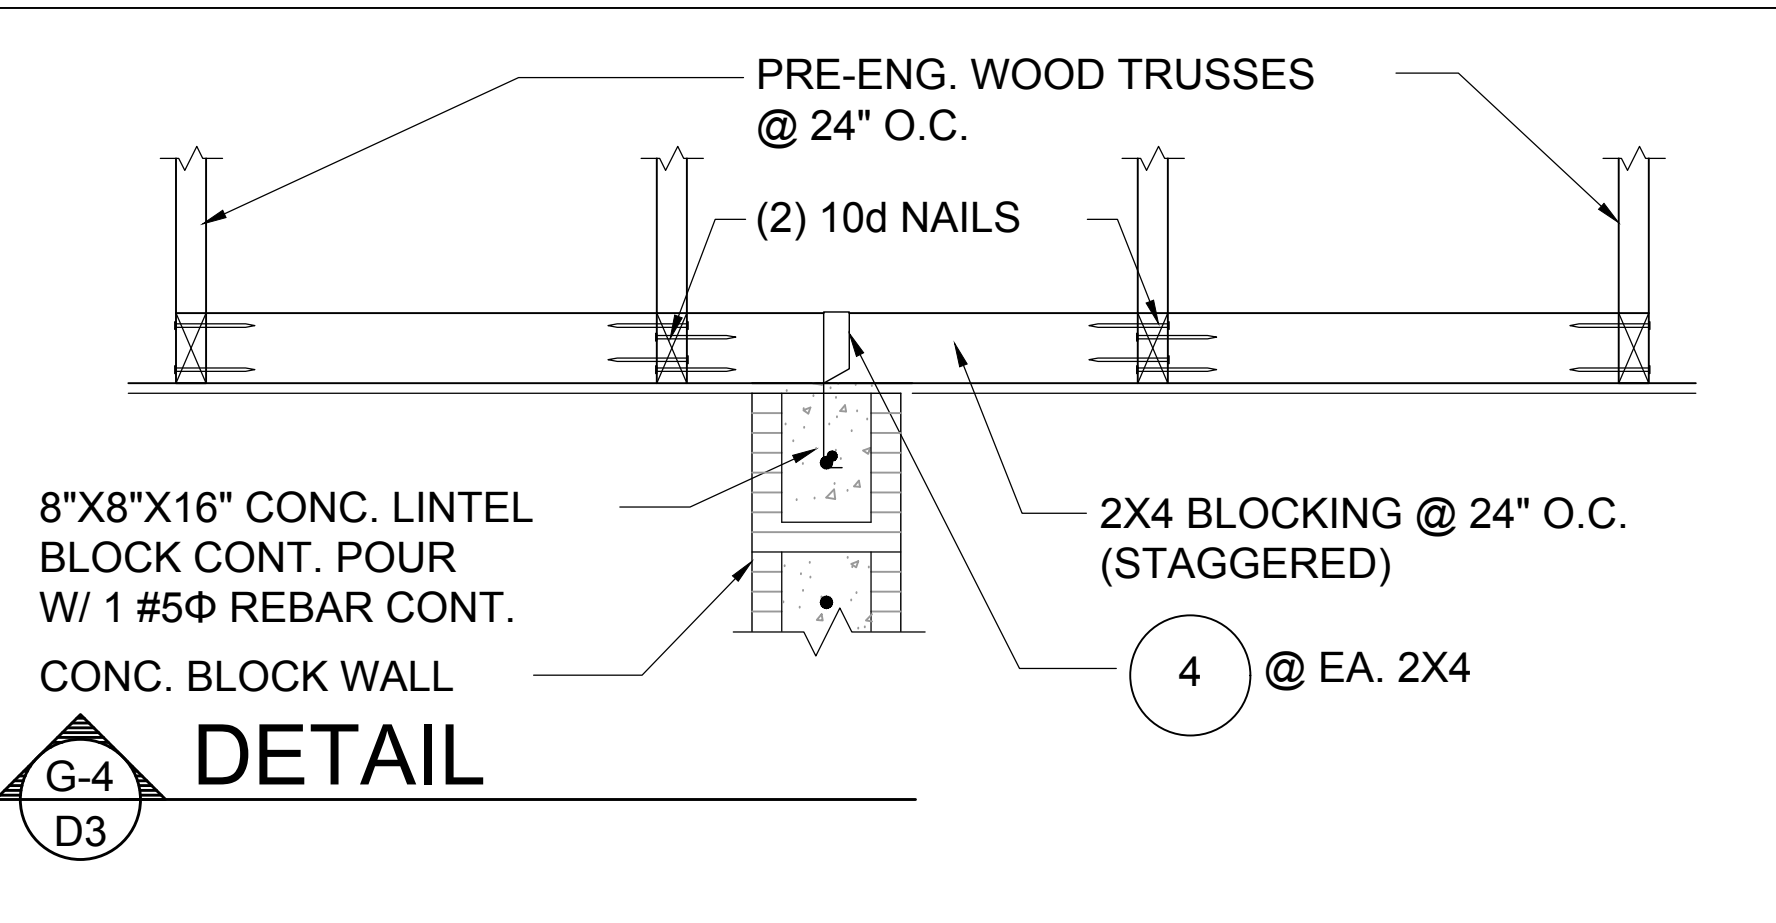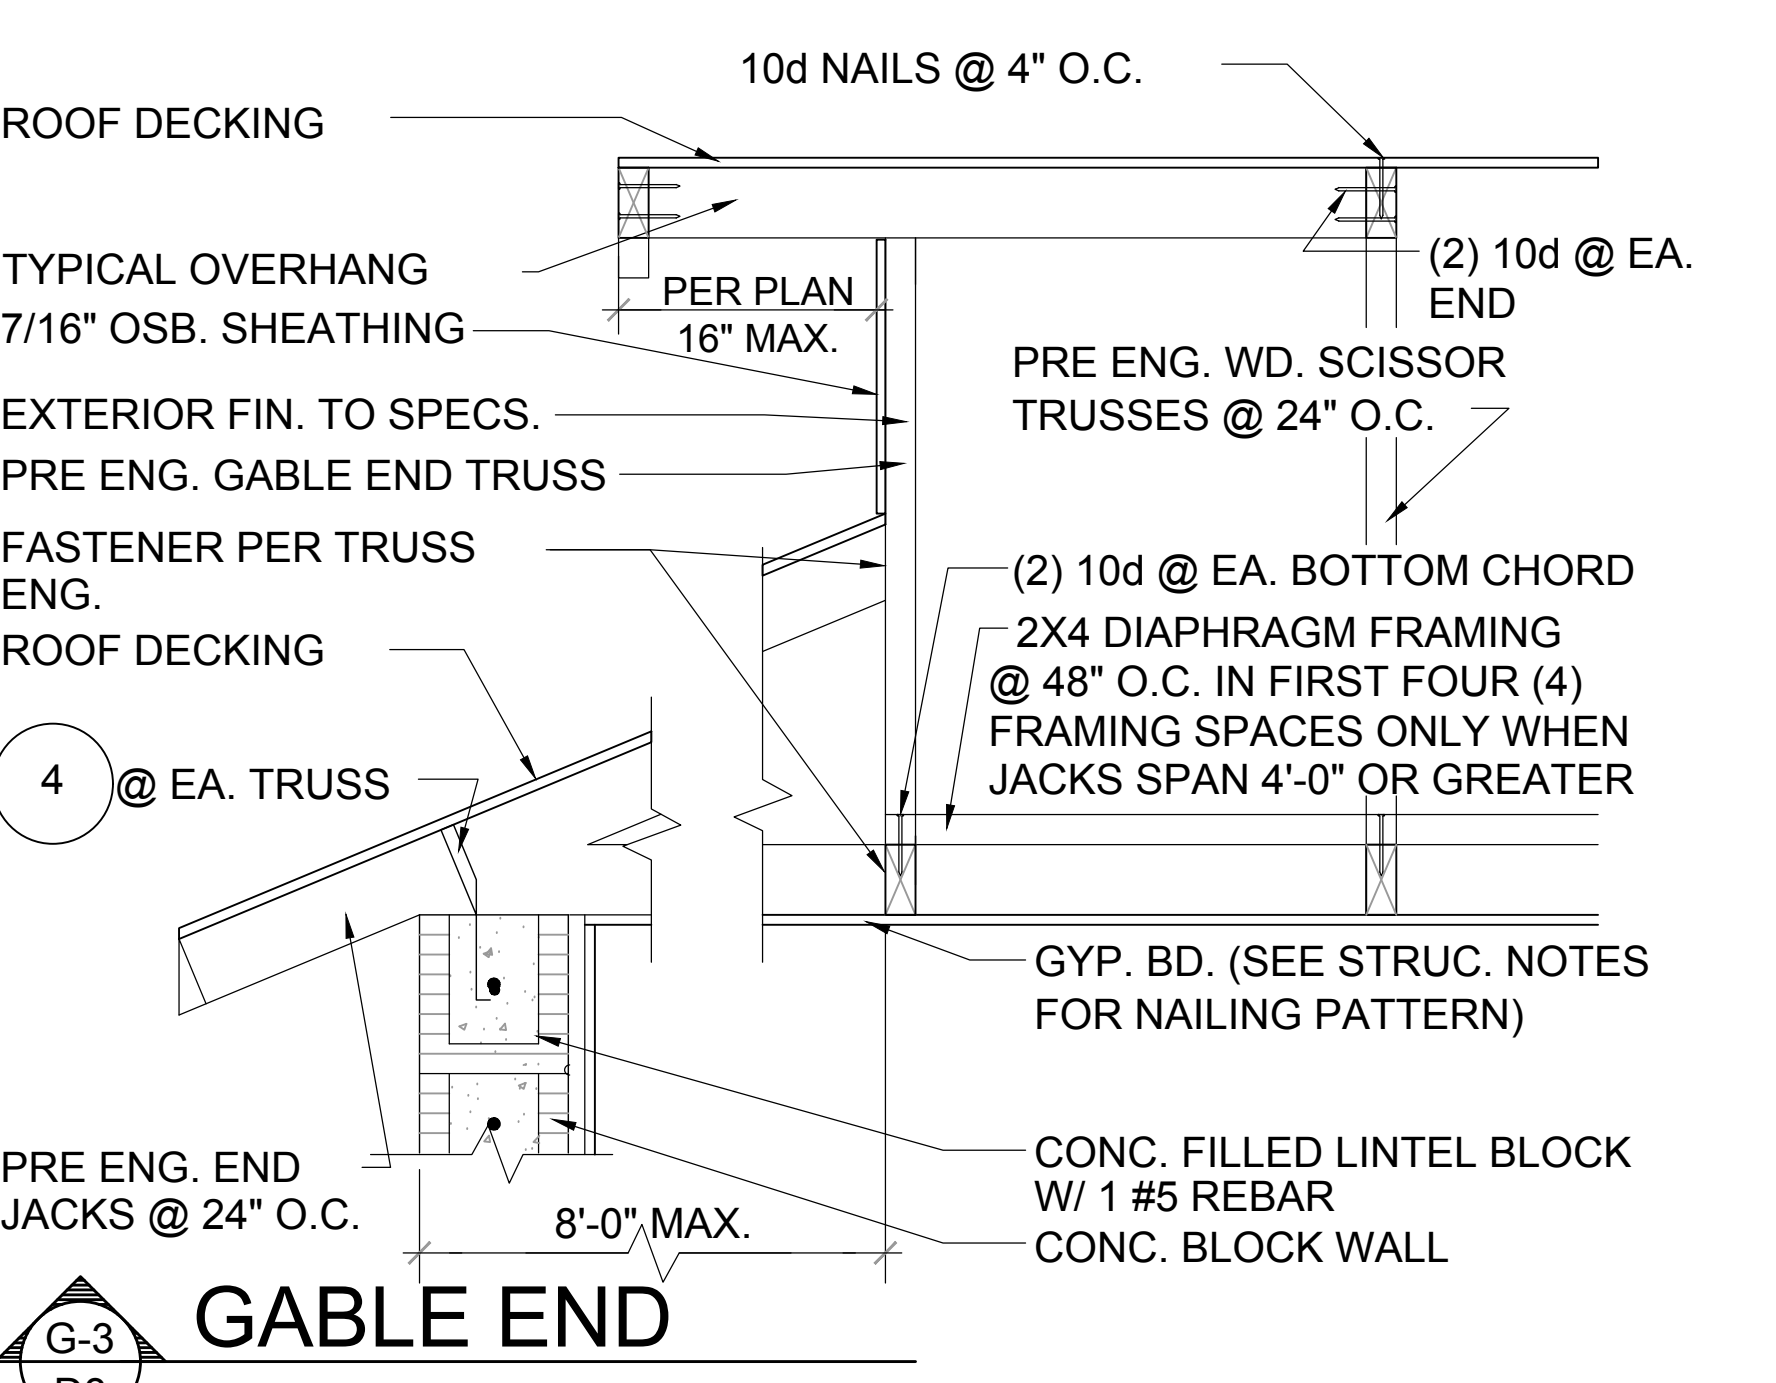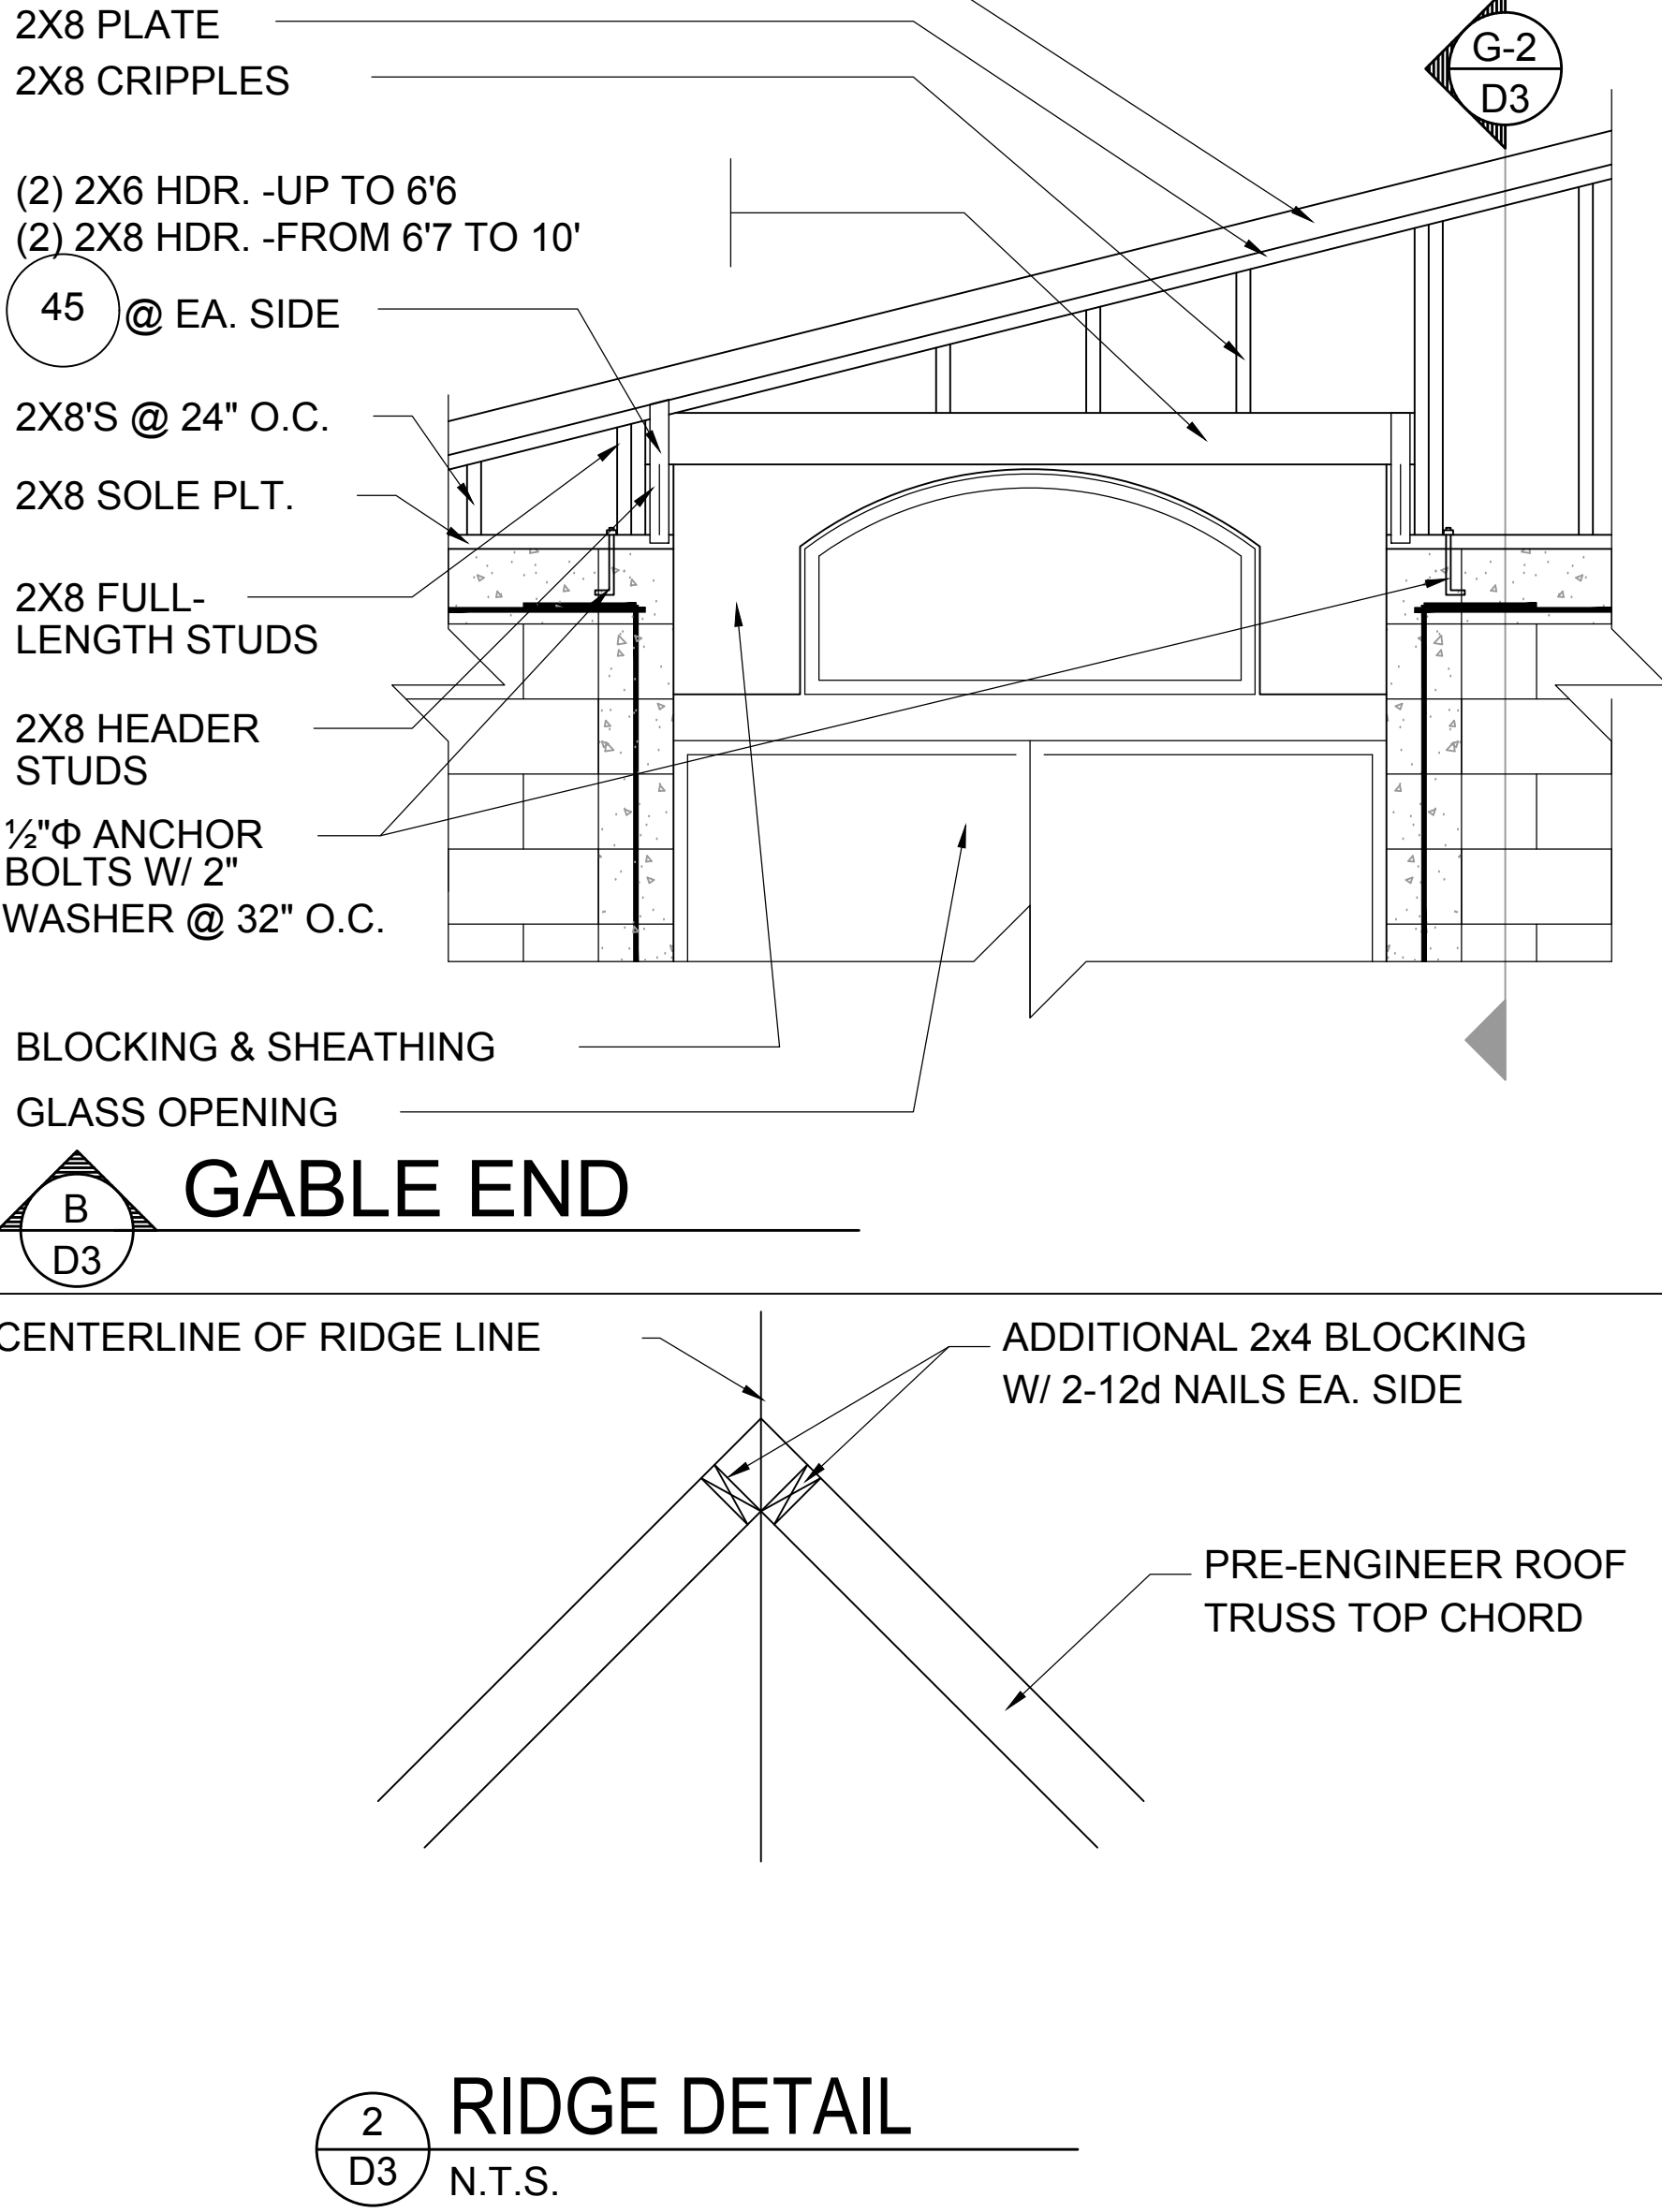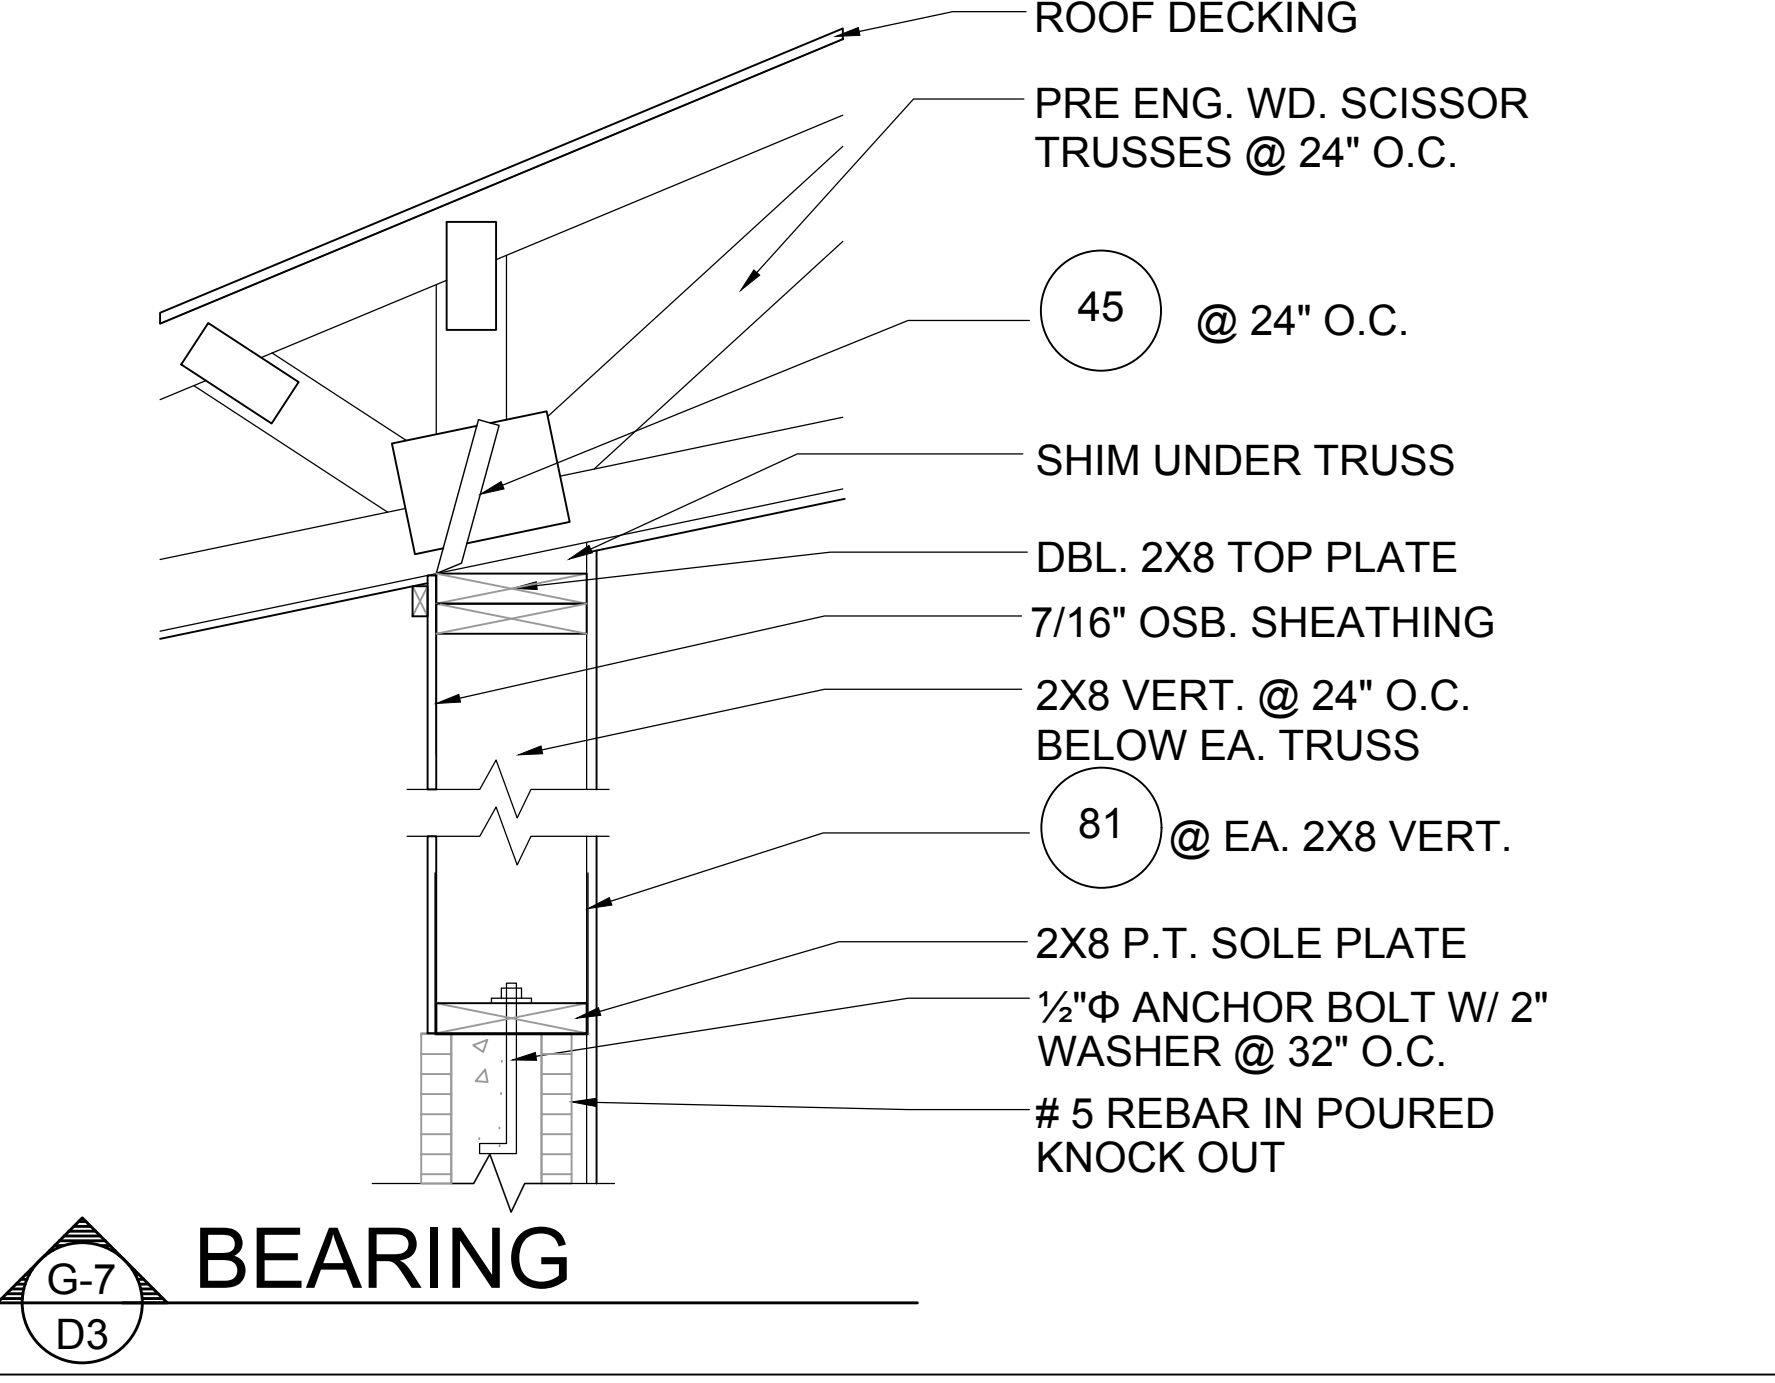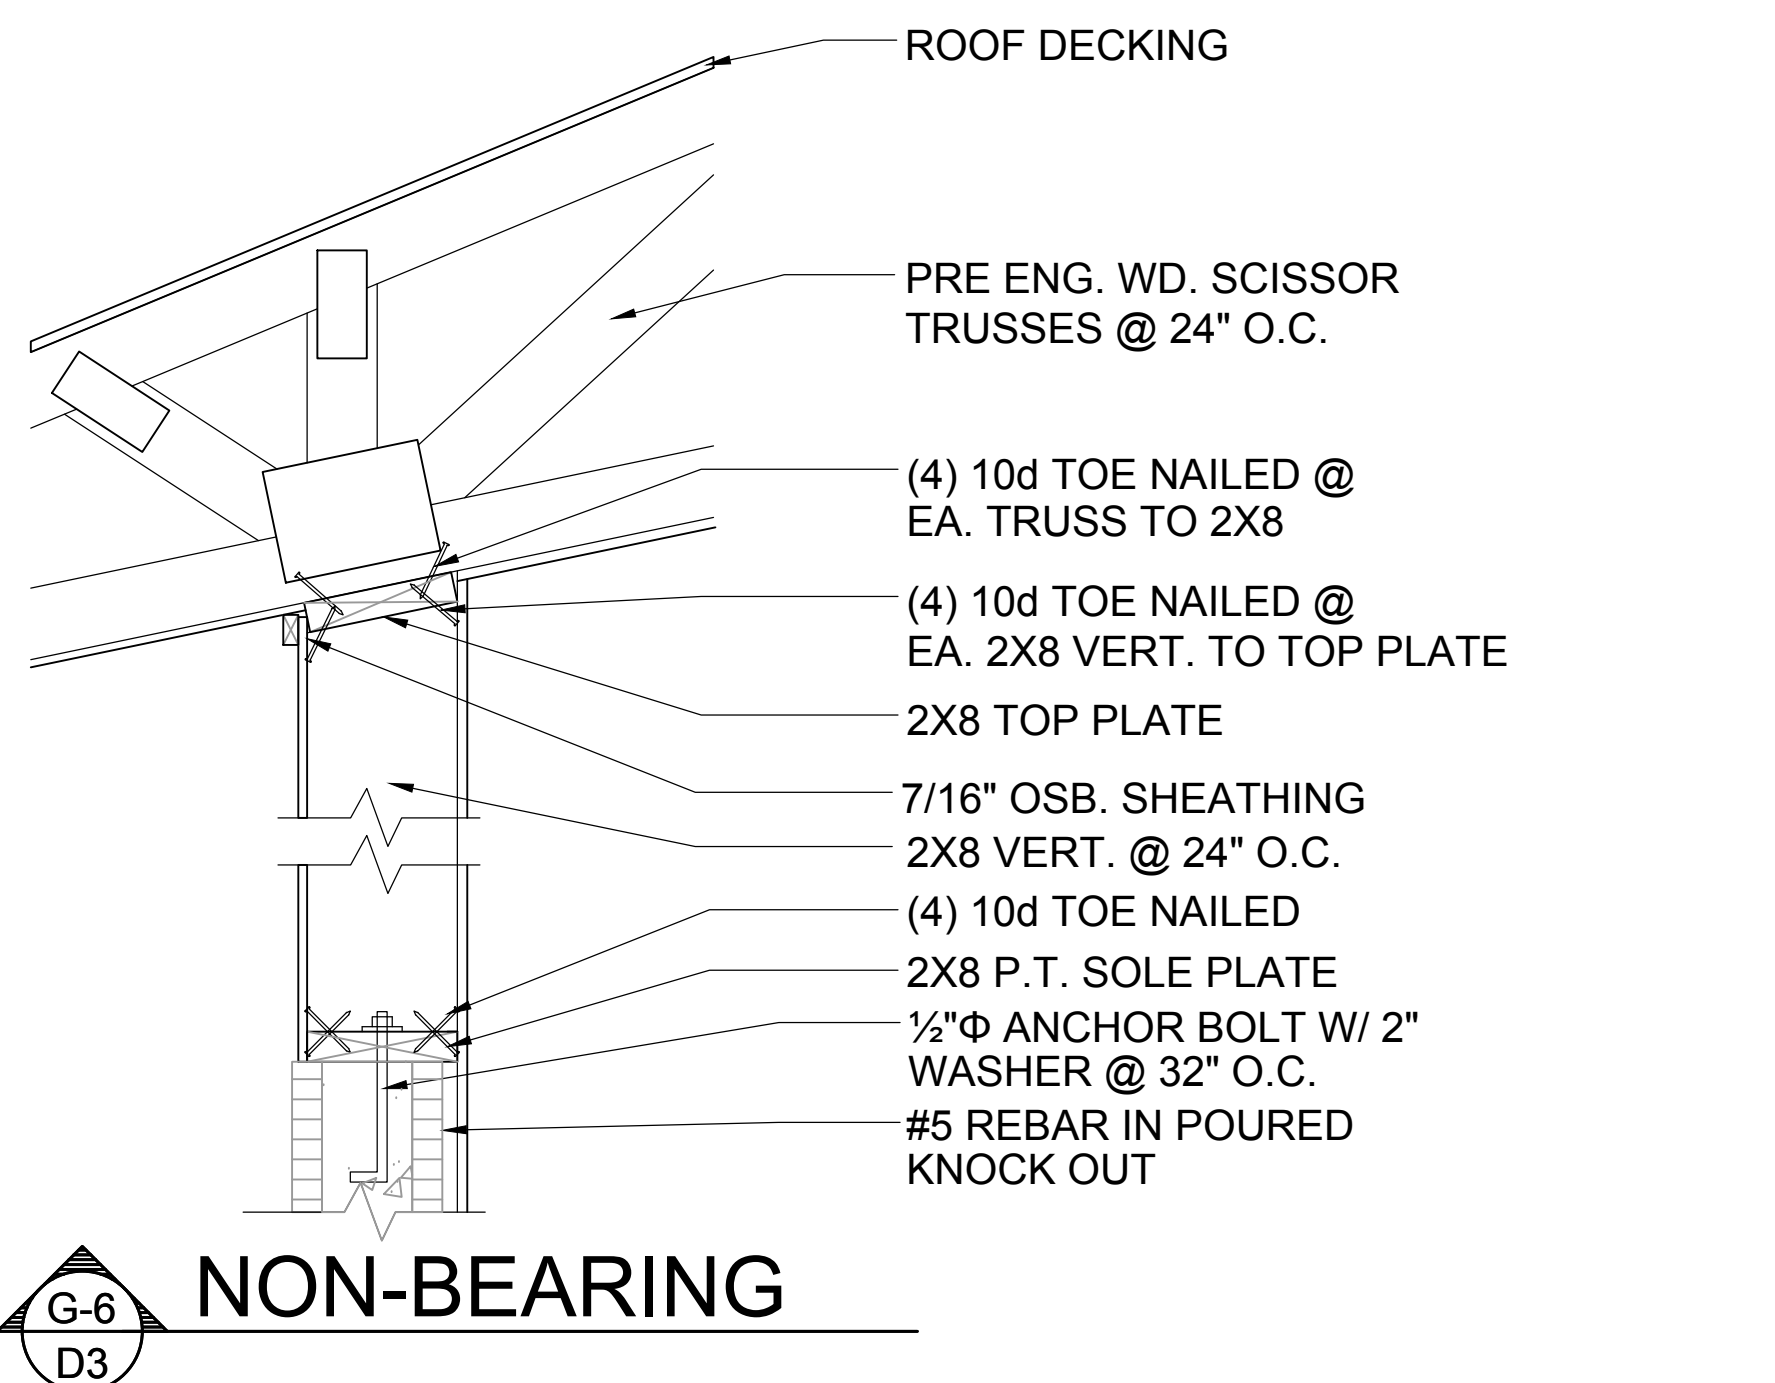

ITEG
THOMPSON ENGINEERING GROUP, INC.
4401 Woodloch Road, Suite 400, Orlando, FL 32811
Ph: (407) 734-1467
Fax: (407) 734-1790
www.iteg.com

815 Orienta Ave., Suite #1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjsdesignersgroup.com

MJS
designers group
residential-commercial-architecture

AIBD

GOBA
GROUP OF ASSOCIATES

8-Unit: (Paradiso TH)
Models: Neutral, Latitude
Building Pad #XX
Lot# XX-XX, Subdivision
Street Address
City, State, Zip Code









A Division of Park Square Enterprises, Inc.
5200 Vineland Rd., Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE	03/06/2023
REVISIONS	
PROJECT:	22-1151
SCALE:	AS NOTED
DRAWN BY:	M.C.
DESIGNED BY:	MJS





STRUCTURAL DETAILS
D3

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGN ARE NOT TO BE COPIED OR MODIFIED IN ANY MANNER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

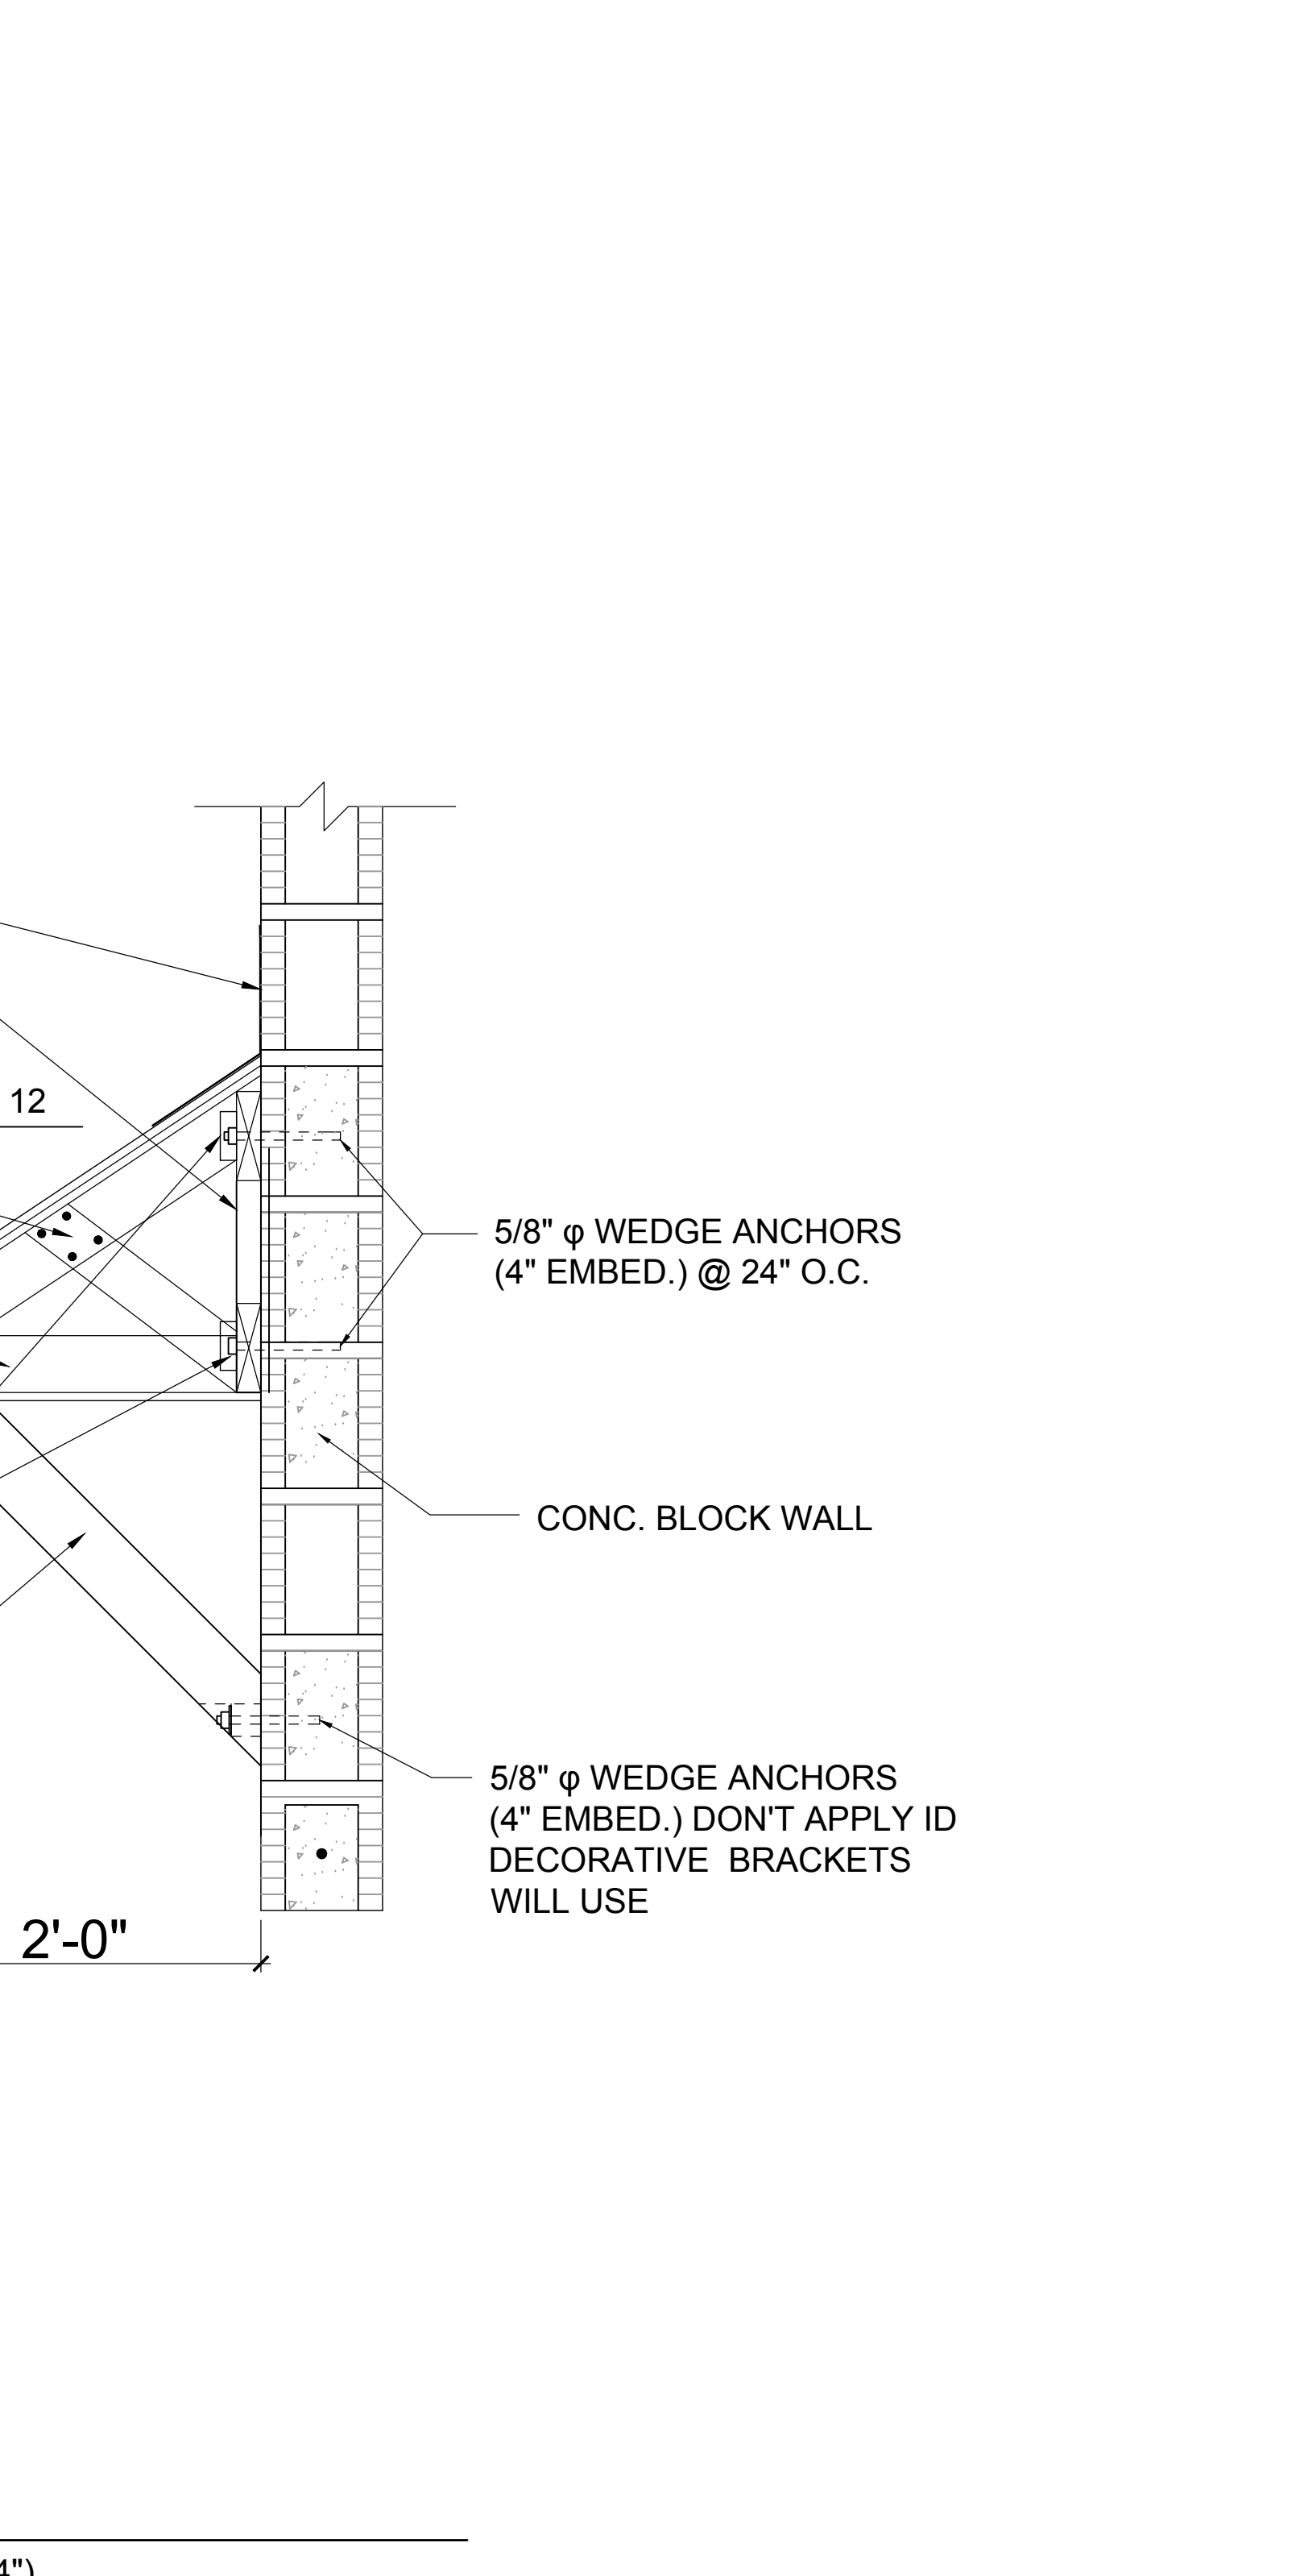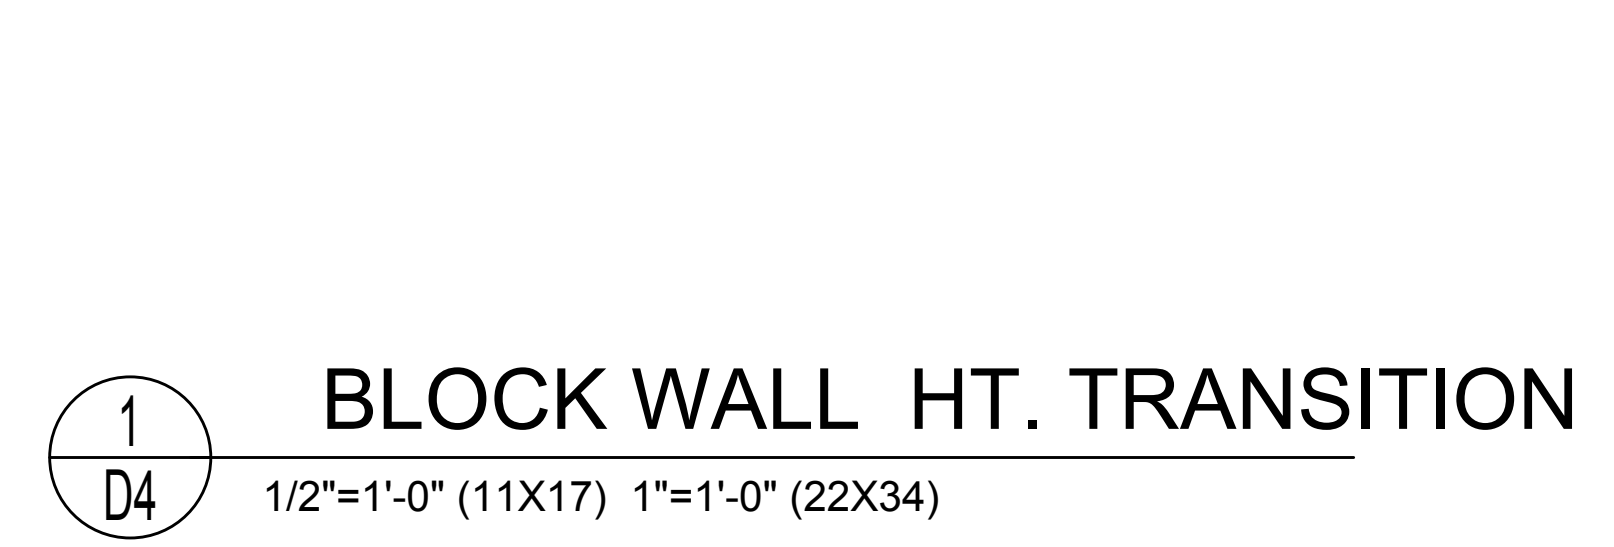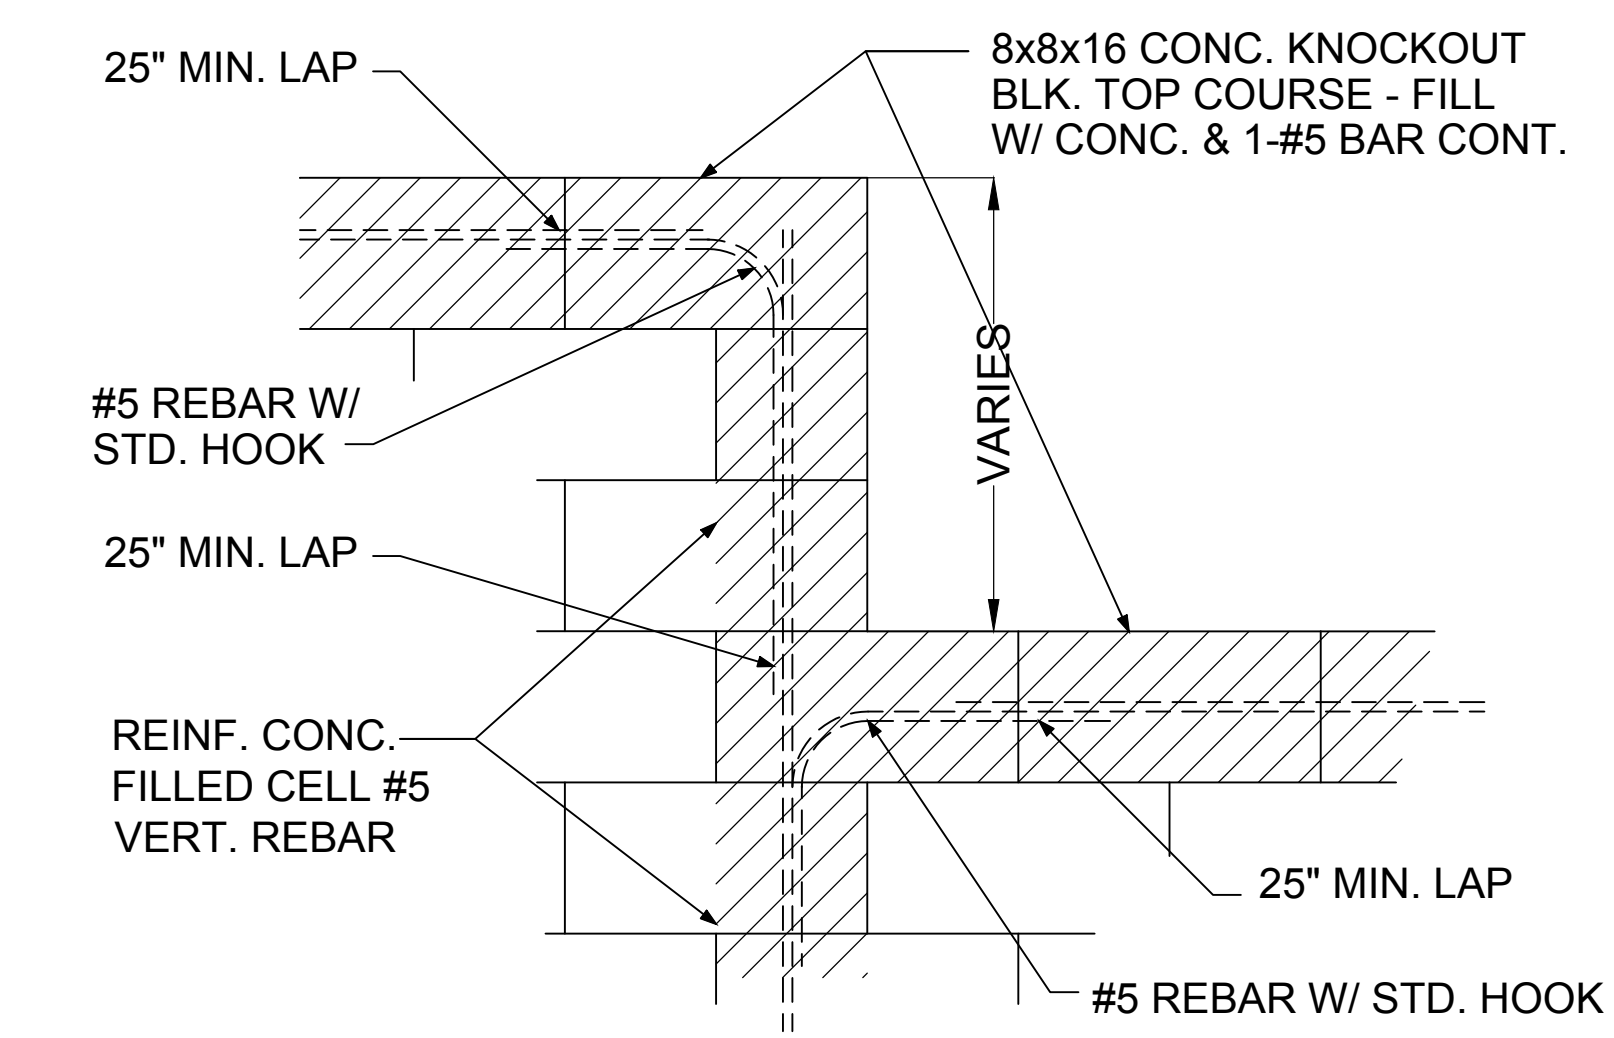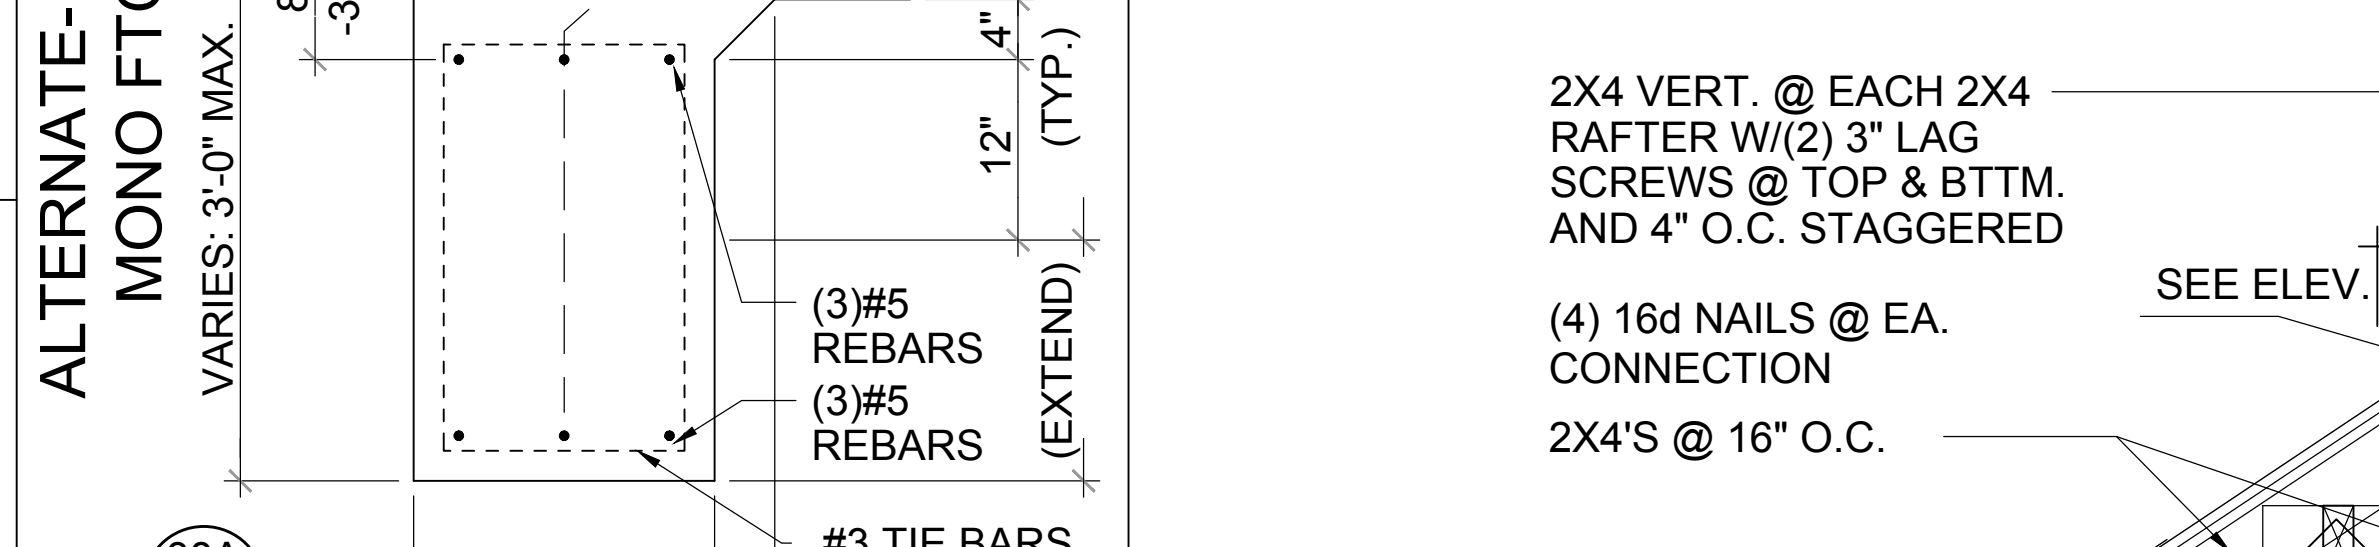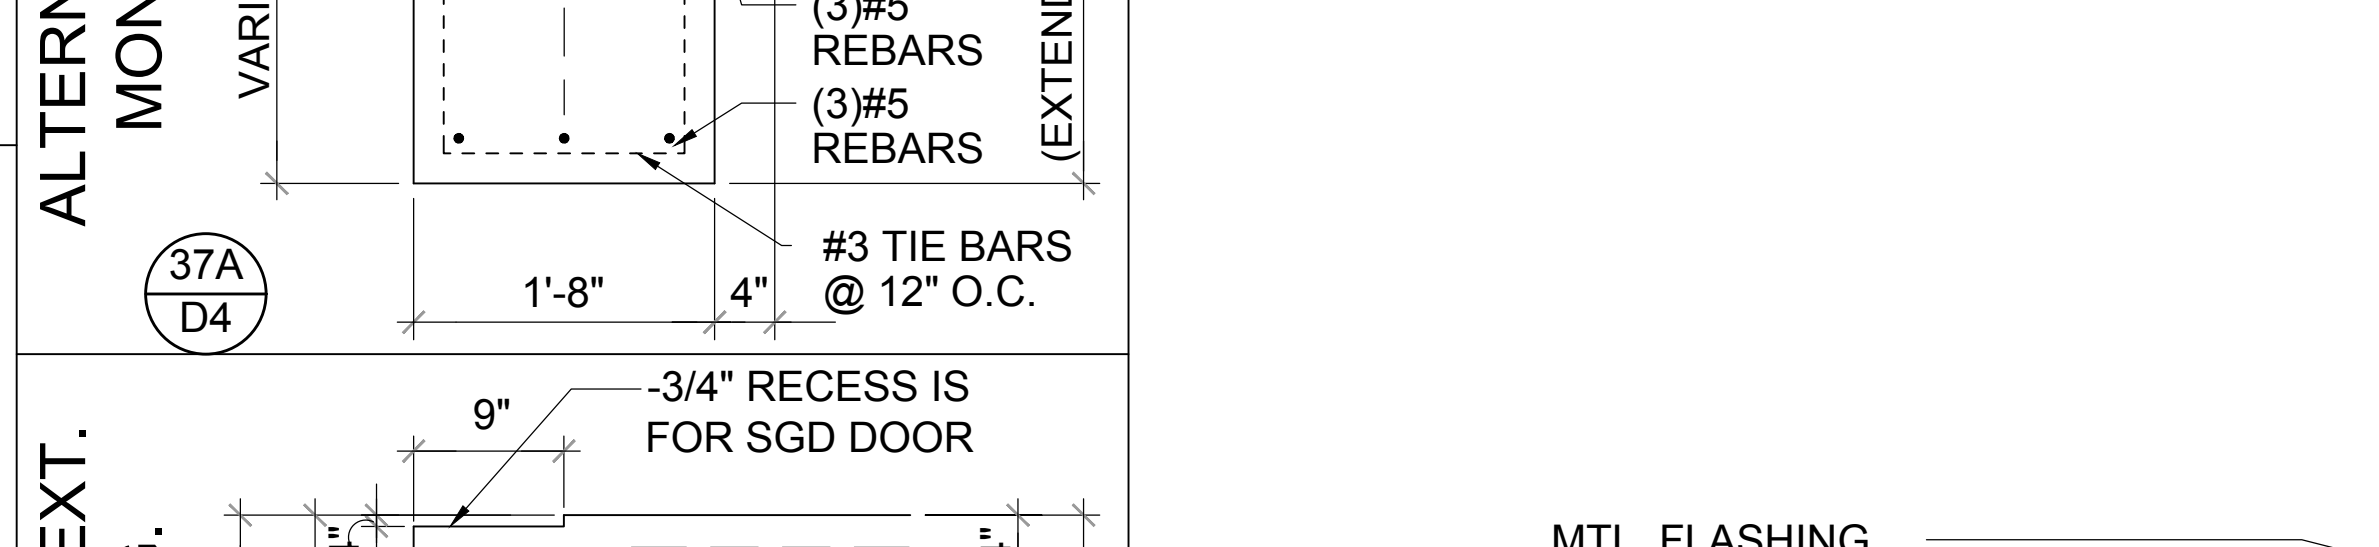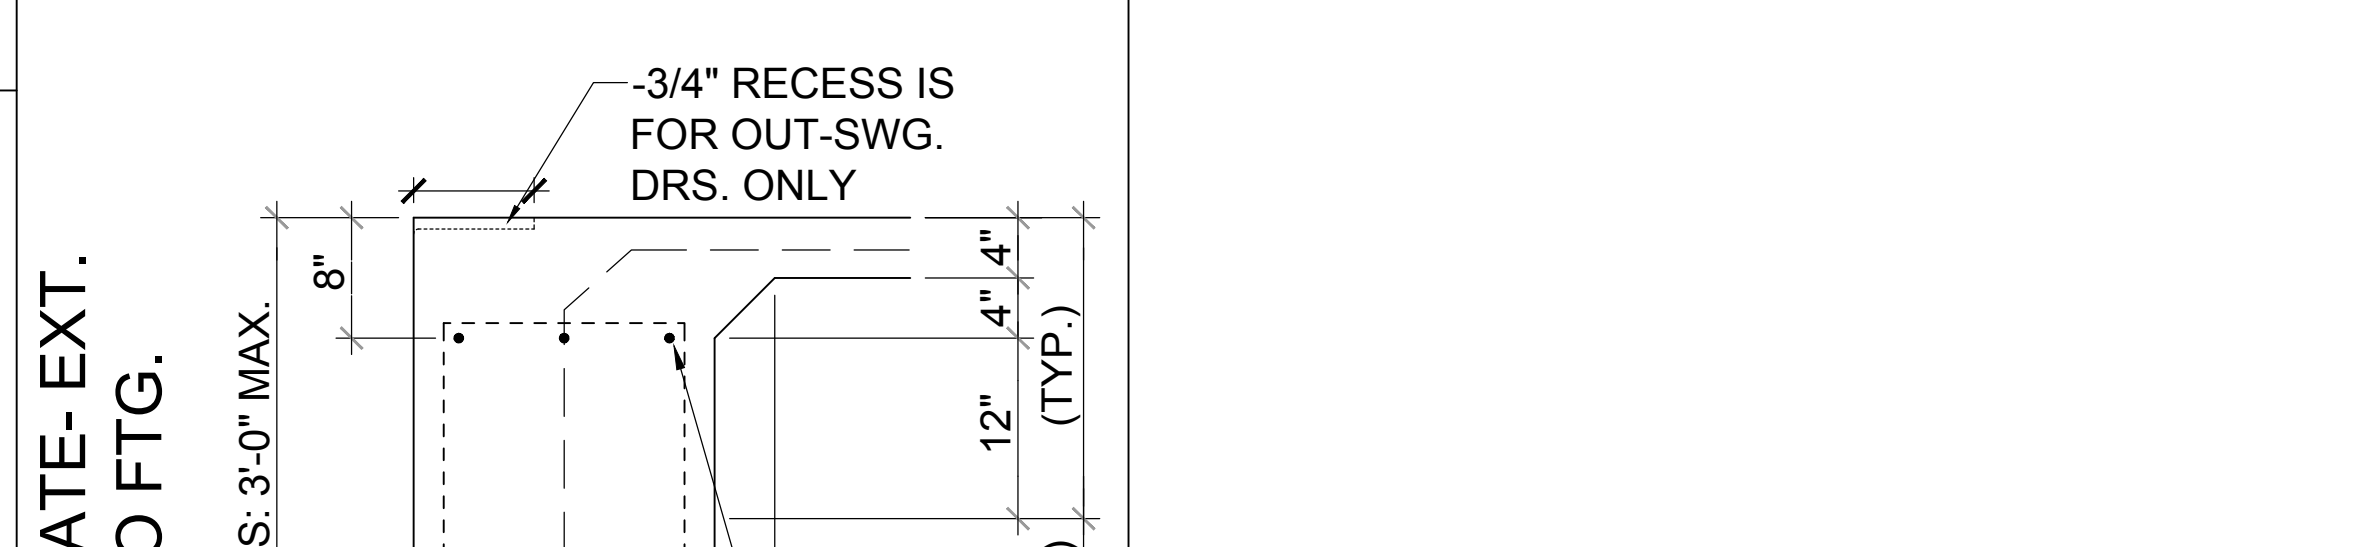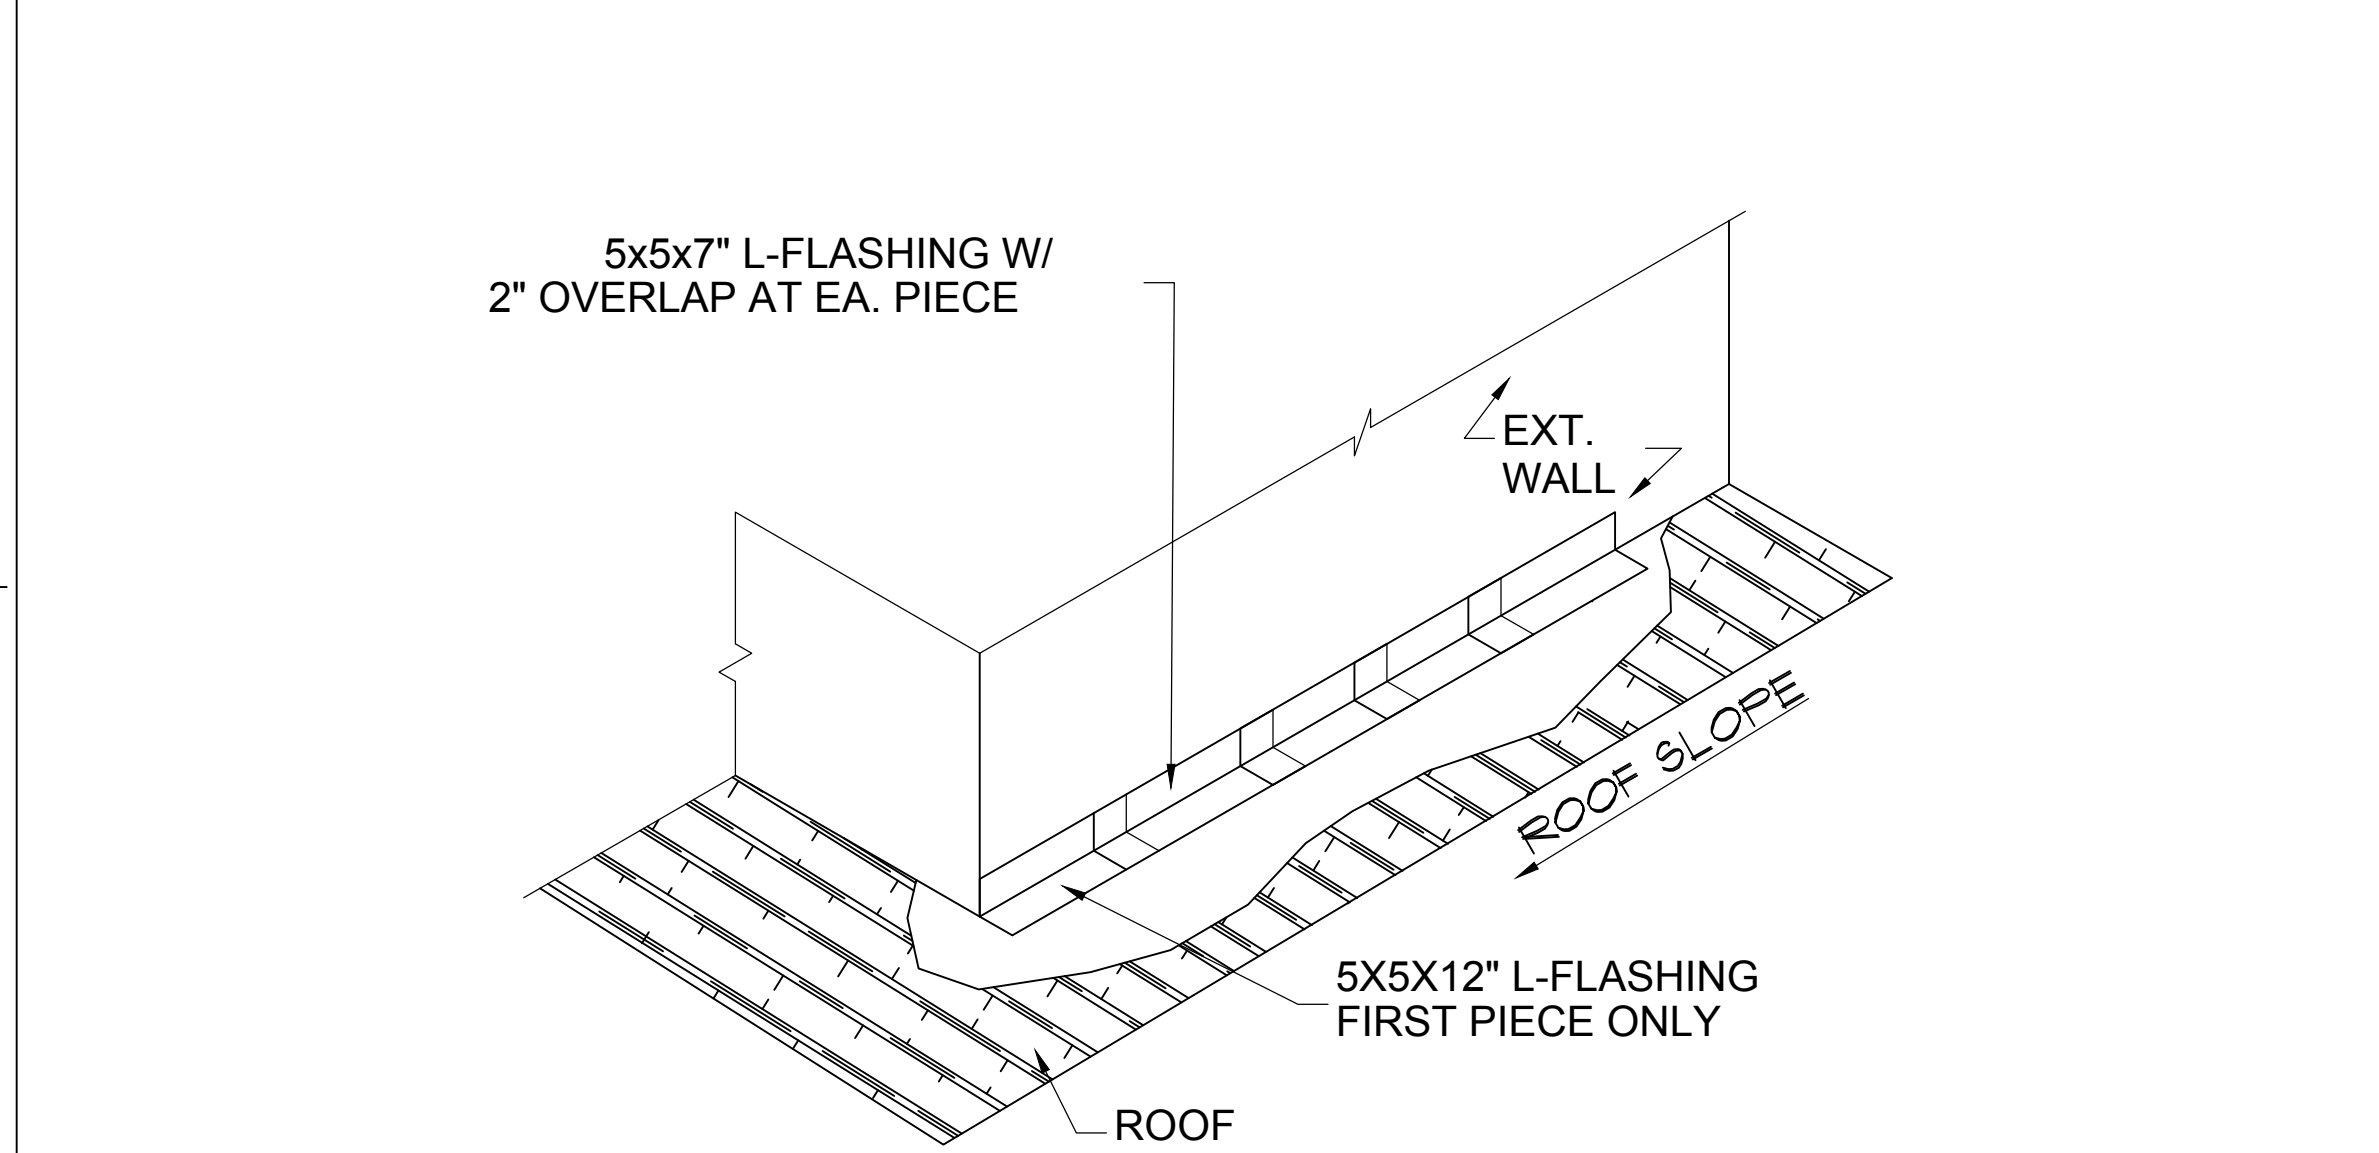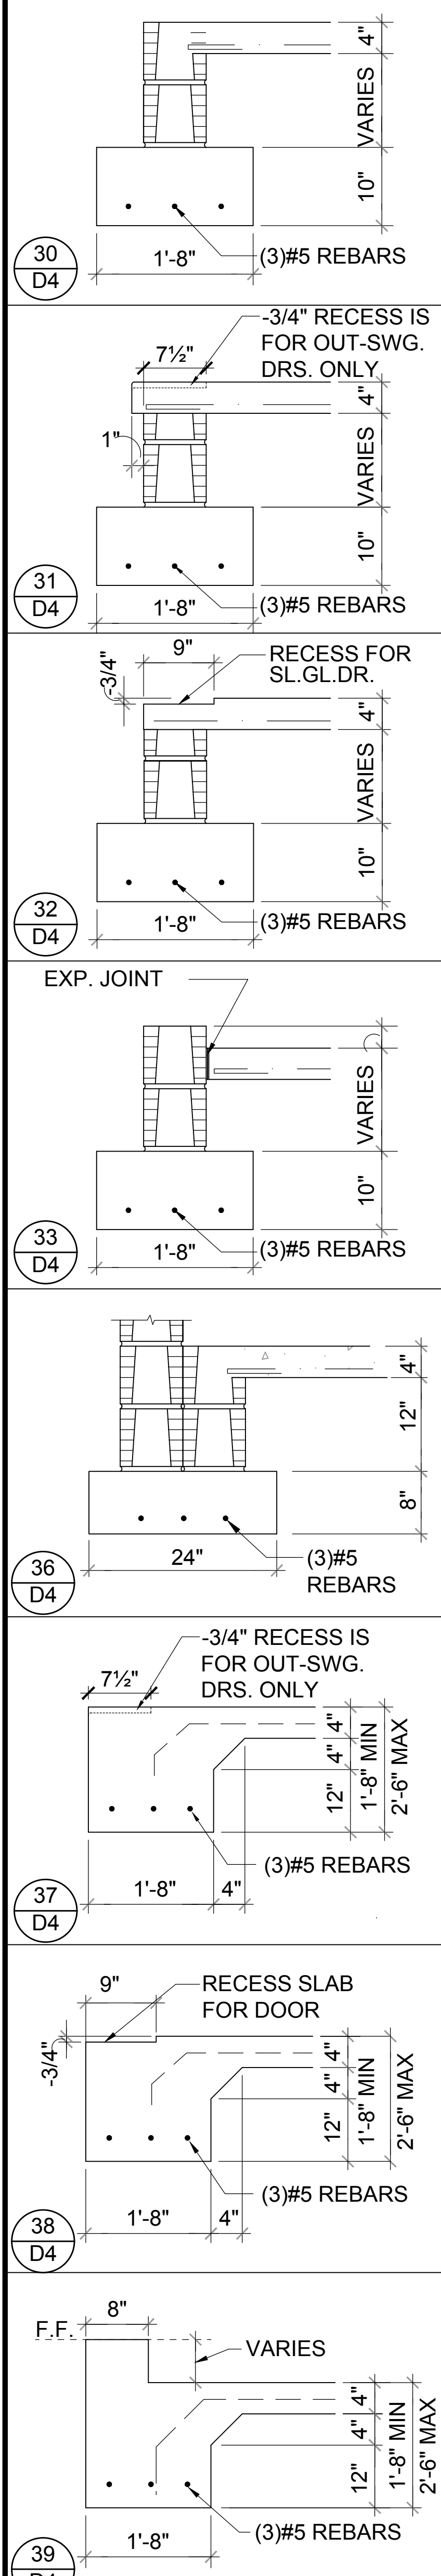

NOTE:
1/2" PLYWOOD OR 7/16" O.S.B. TO BE USED AS UPLIFT RESISTANCE NO OTHER FASTENERS REQ'D. EXCEPT AS NOTED ON PLANS IN TWO STORY FRAME APPLICATIONS, SHEATHING SHALL EXTEND MIN. 1'-0" W/O BREAK ABV. 2nd FLOOR BOTTOM PLT. TO T.O.M.

NAILING SCHEDULE:
(2) ROWS @ 3" O.C. AT TOP AND (1) ROW AT BOTTOM OF WALL, 6" O.C. ALL OTHER EDGES AND 12" IN FIELD. BLOCKING SHALL BE PLACED AT ALL SHEATHING JOINTS.

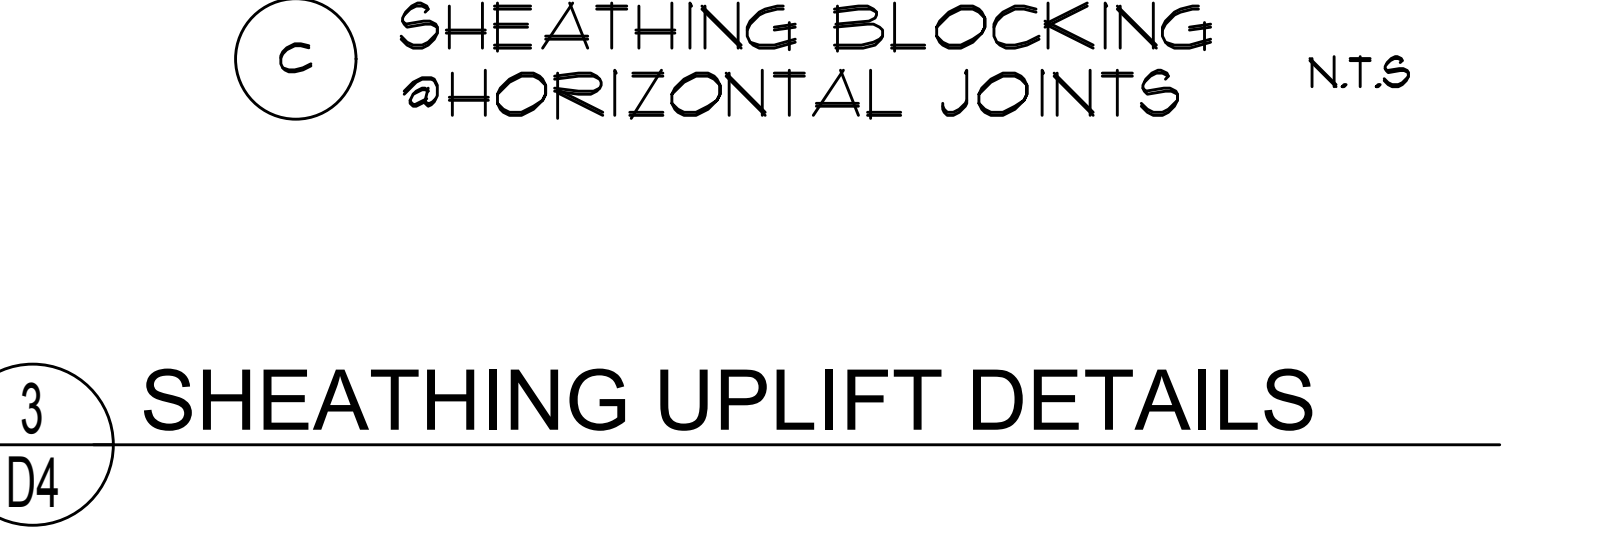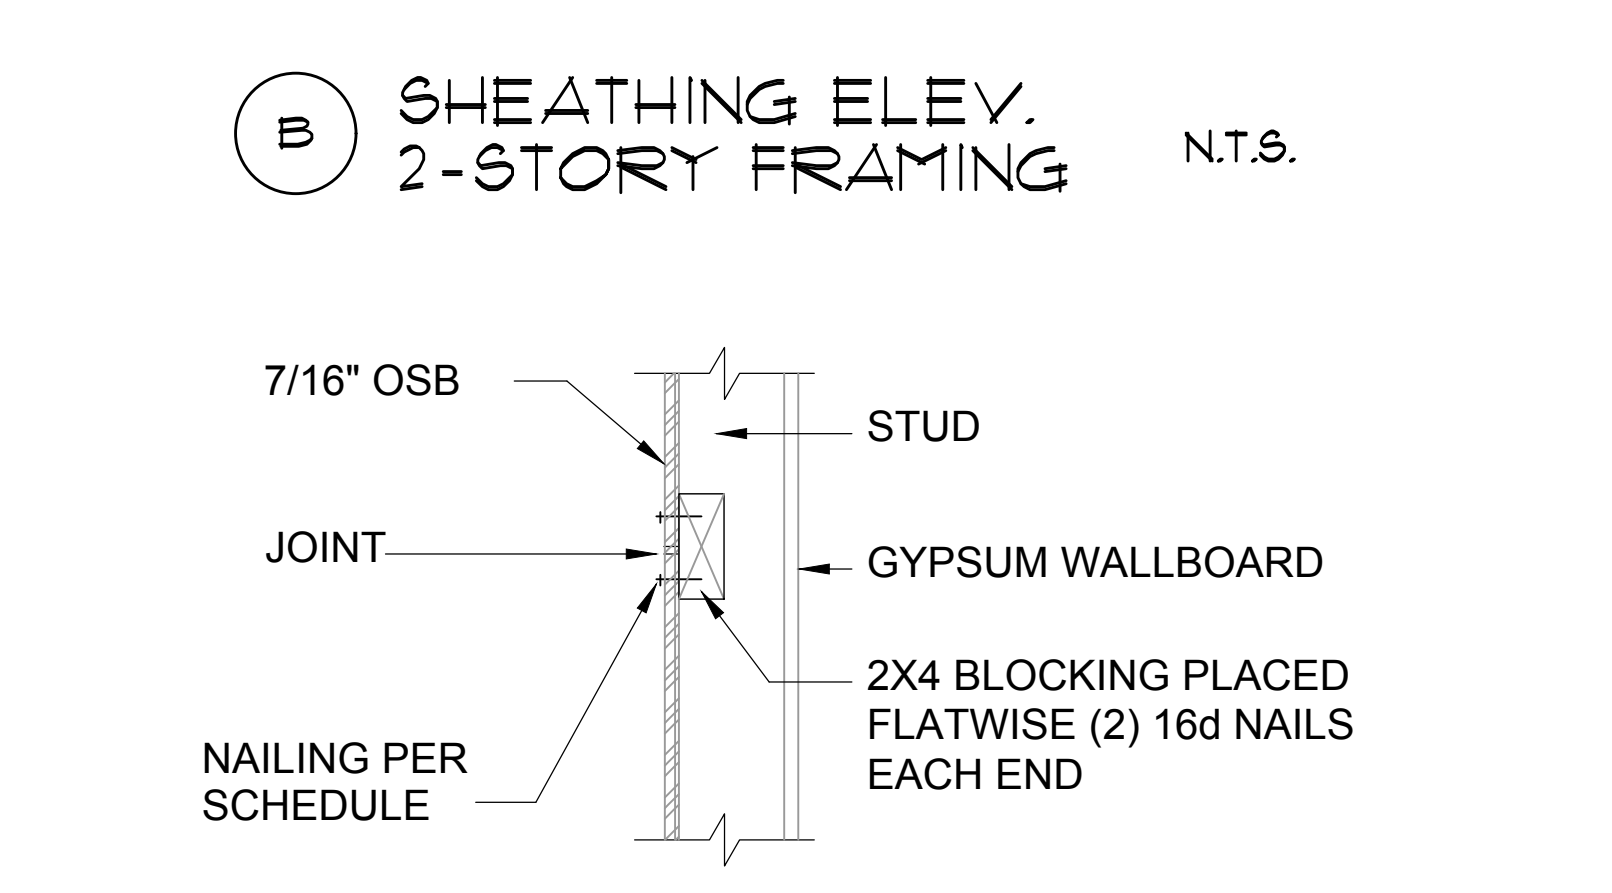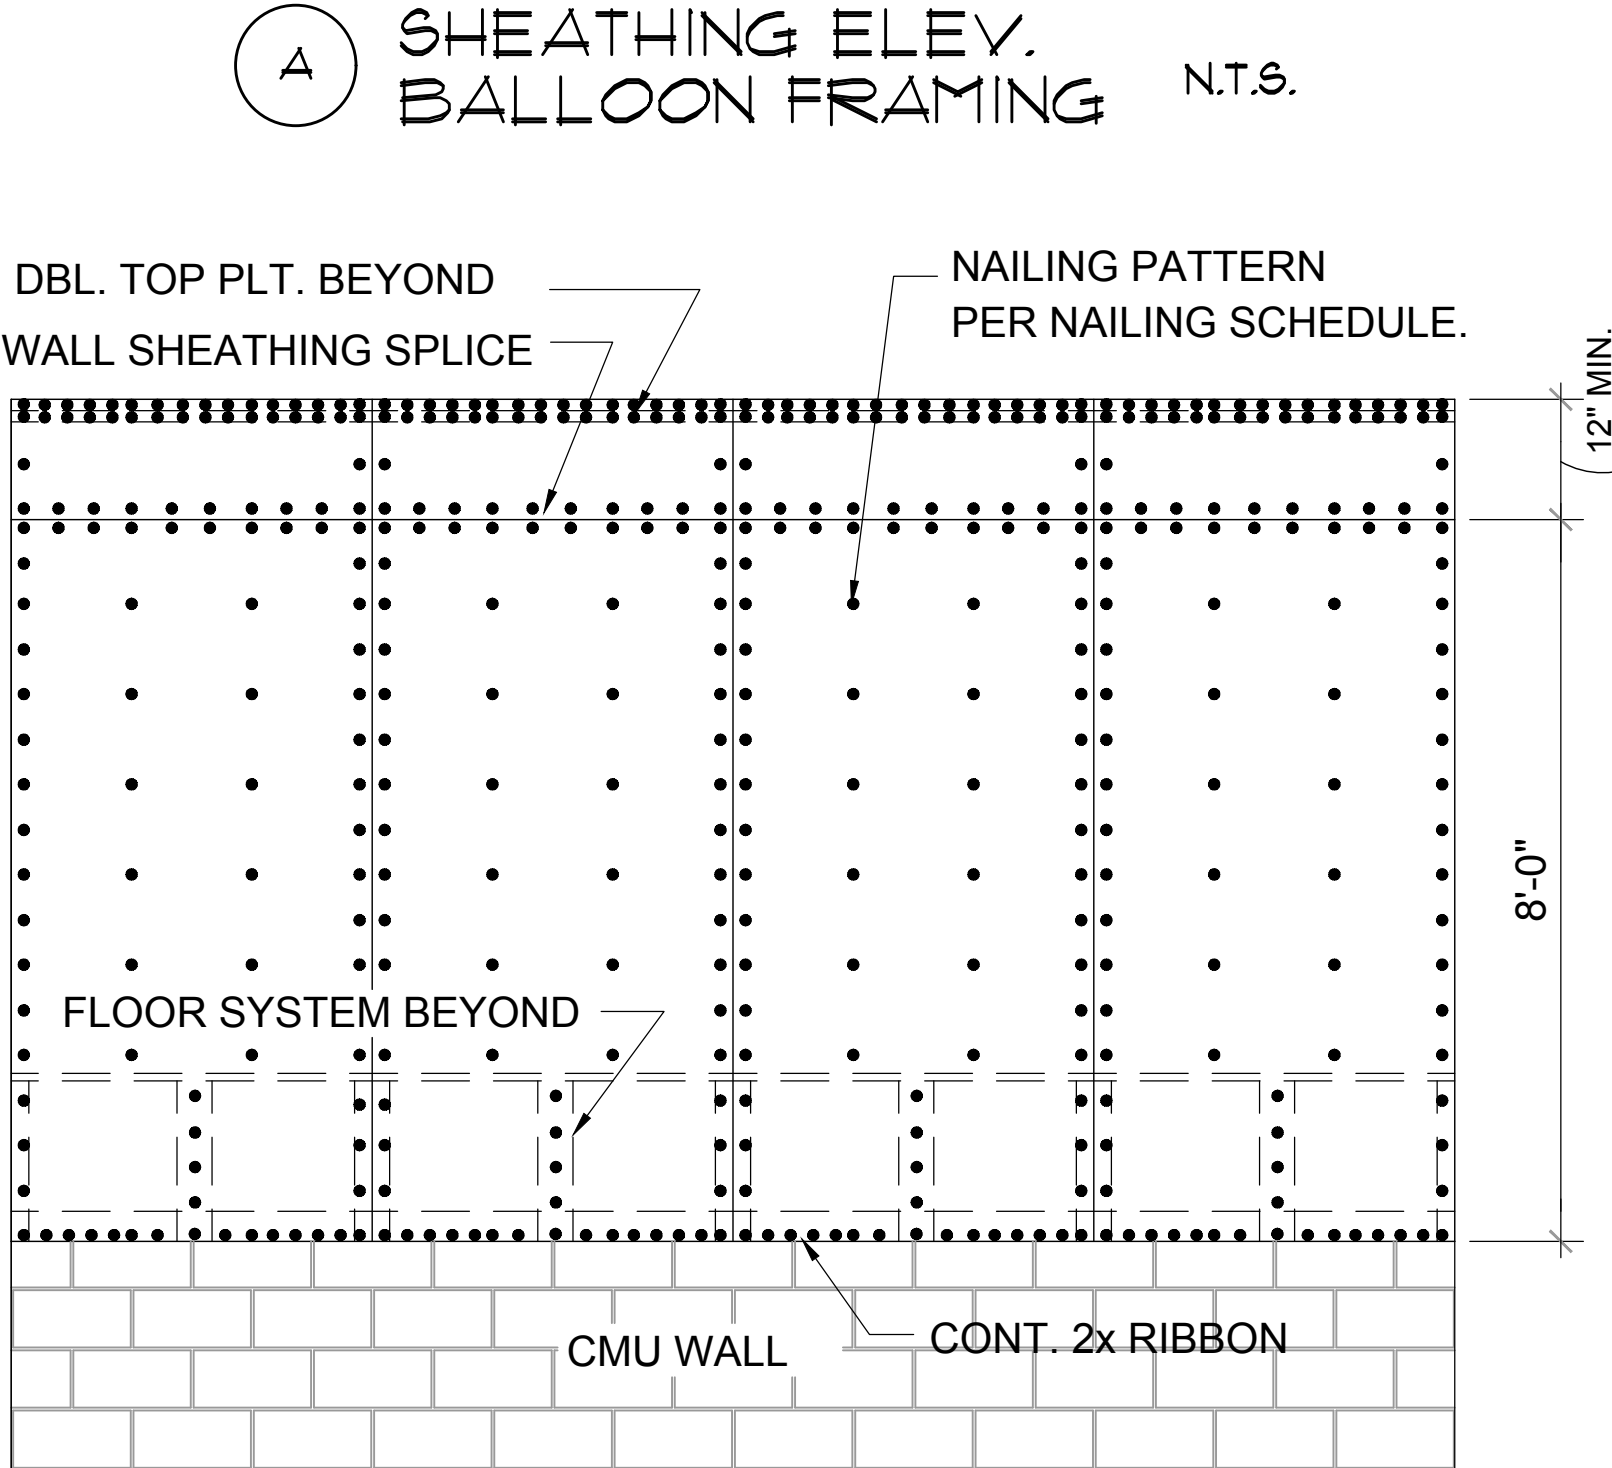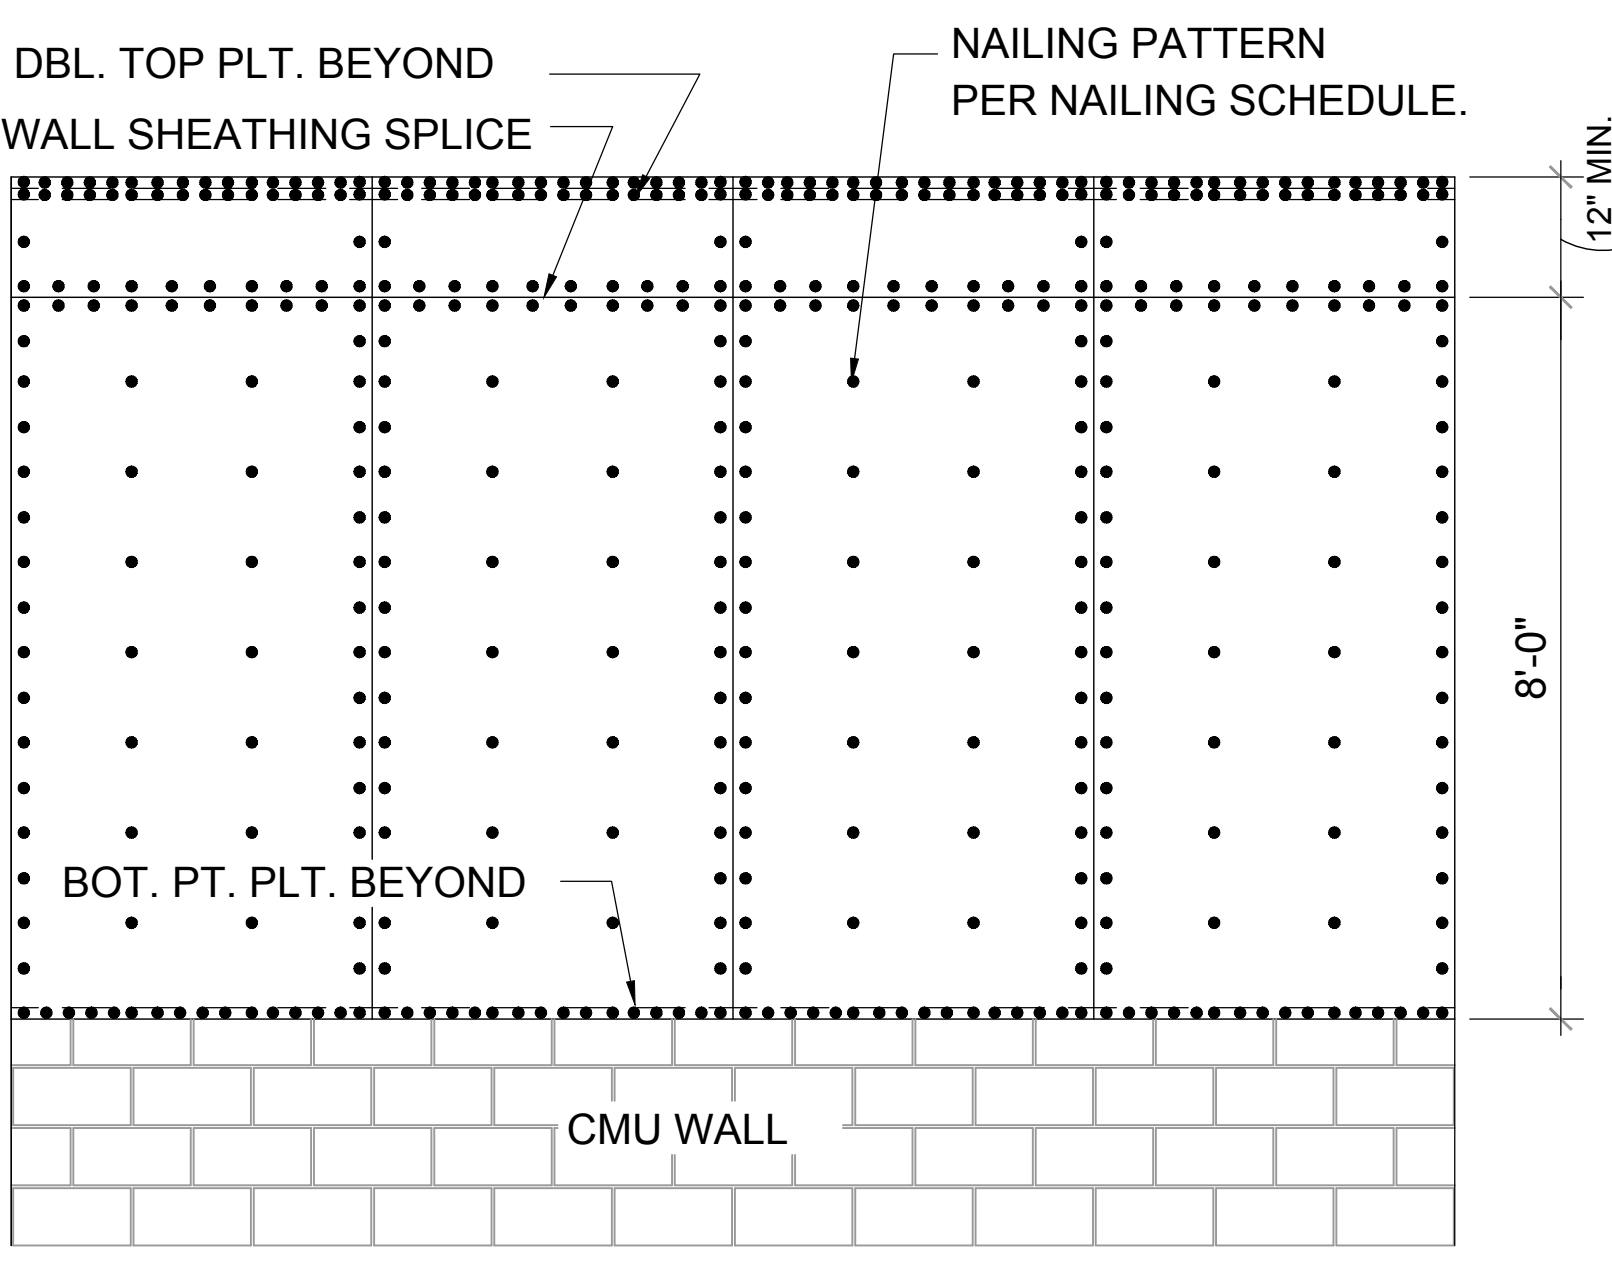

STRUCTURAL ALUMINUM:


1. Conform to latest edition of Aluminum Association of Florida standard practice for aluminum design.
2. All aluminum shall be 6061-T6 (E= 10,000 ksi; Fy = 35 ksi)

STRUCTURAL STEEL:


1. Conform to latest edition of AISC "Specification for structural steel building" and AISC "Code of standard practice for steel buildings and bridges".
2. All structural steel shall be ASTM A36, (E= 29,000 ksi; Fy = 36 ksi)
3. Splicing prohibited without prior approval as to location and type.
4. Burning of holes in steel members is prohibited. Any member with burned holes must be replaced.

WELDING:

1. Conformed to "Code for welding in building construction" by the American Welding Society, latest edition.
2. Steel Weld IAW AWS D1.1 (latest edition) -E70XX electrodes
3. Aluminum Weld IAW AWS D1.2 (latest edition)-Filler Alloy 5356 or equal.
4. Connection welds to be sized for forces and reactions indicated.
5. All steel welds shall be E70XX low hydrogen, 250 degrees min. oven temp.
6. Welds shall be full penetration welds at all points of contact (1/16" min. unless otherwise noted).

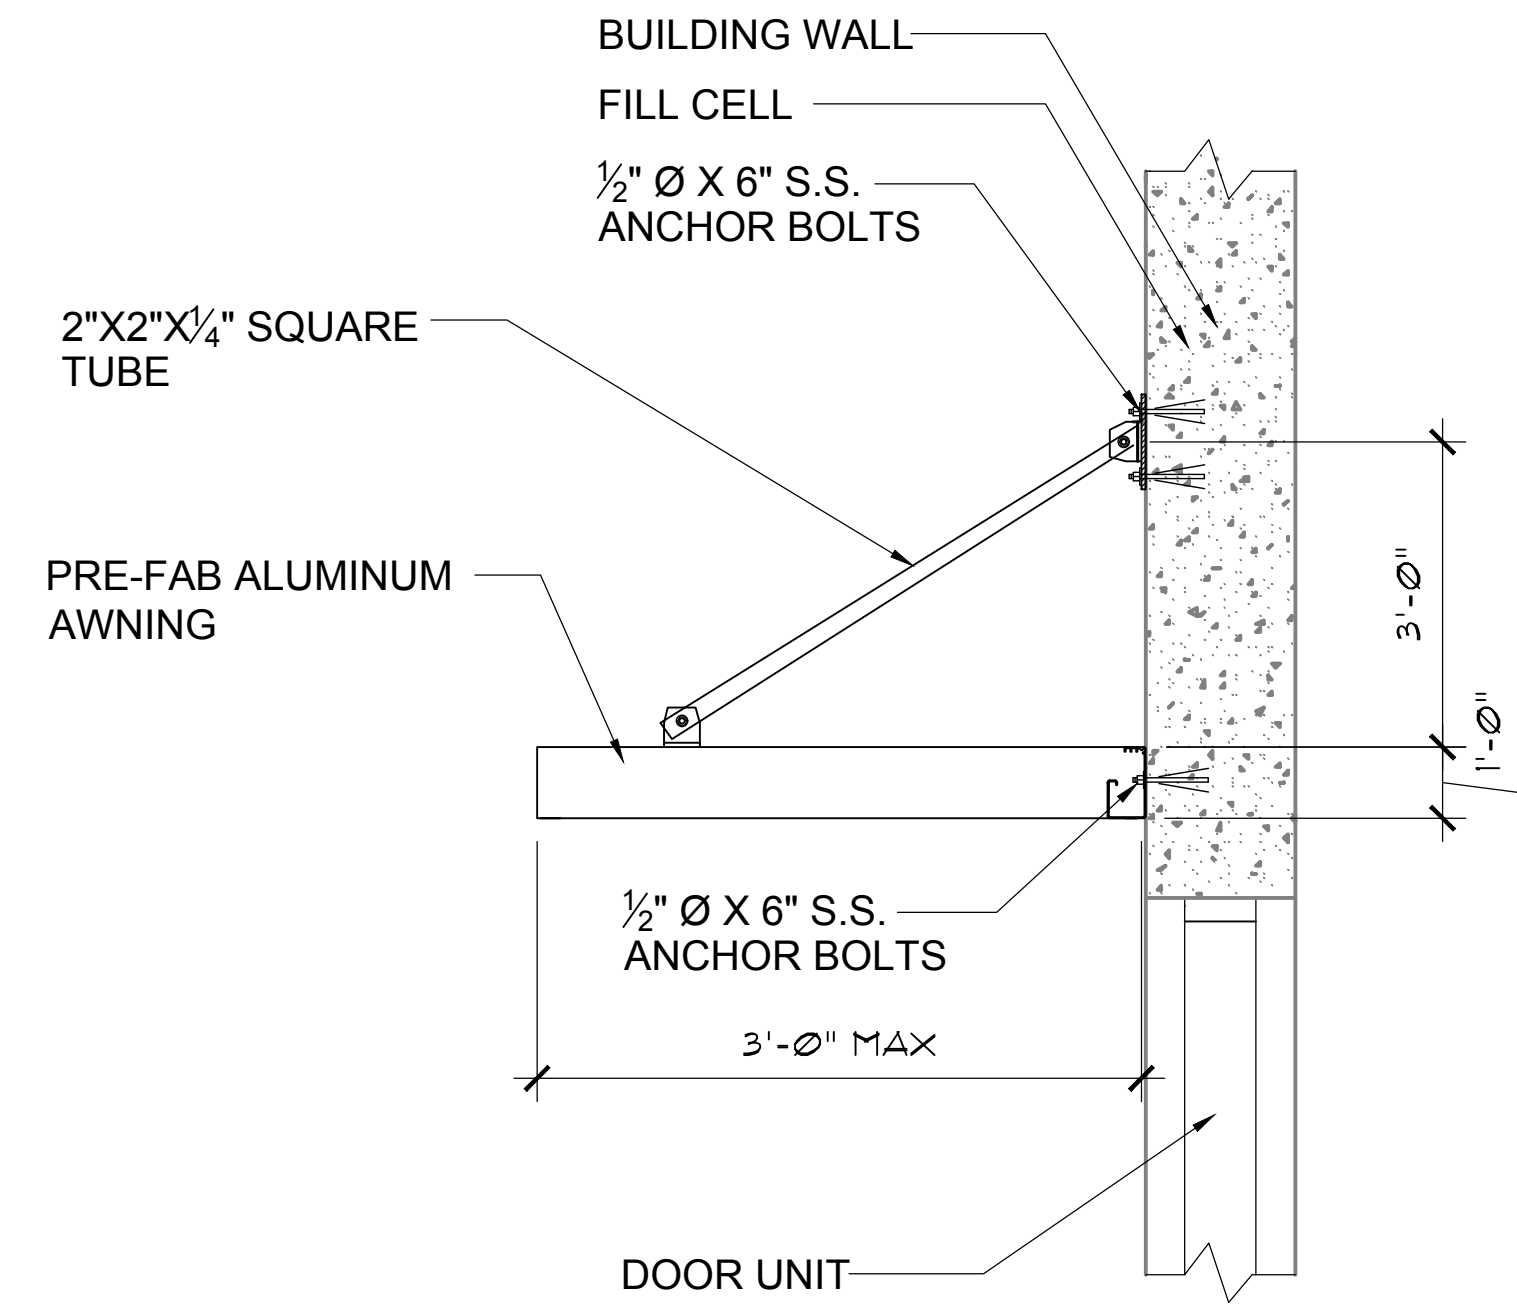


4 AWNING DETAIL
D5 N.T.S.

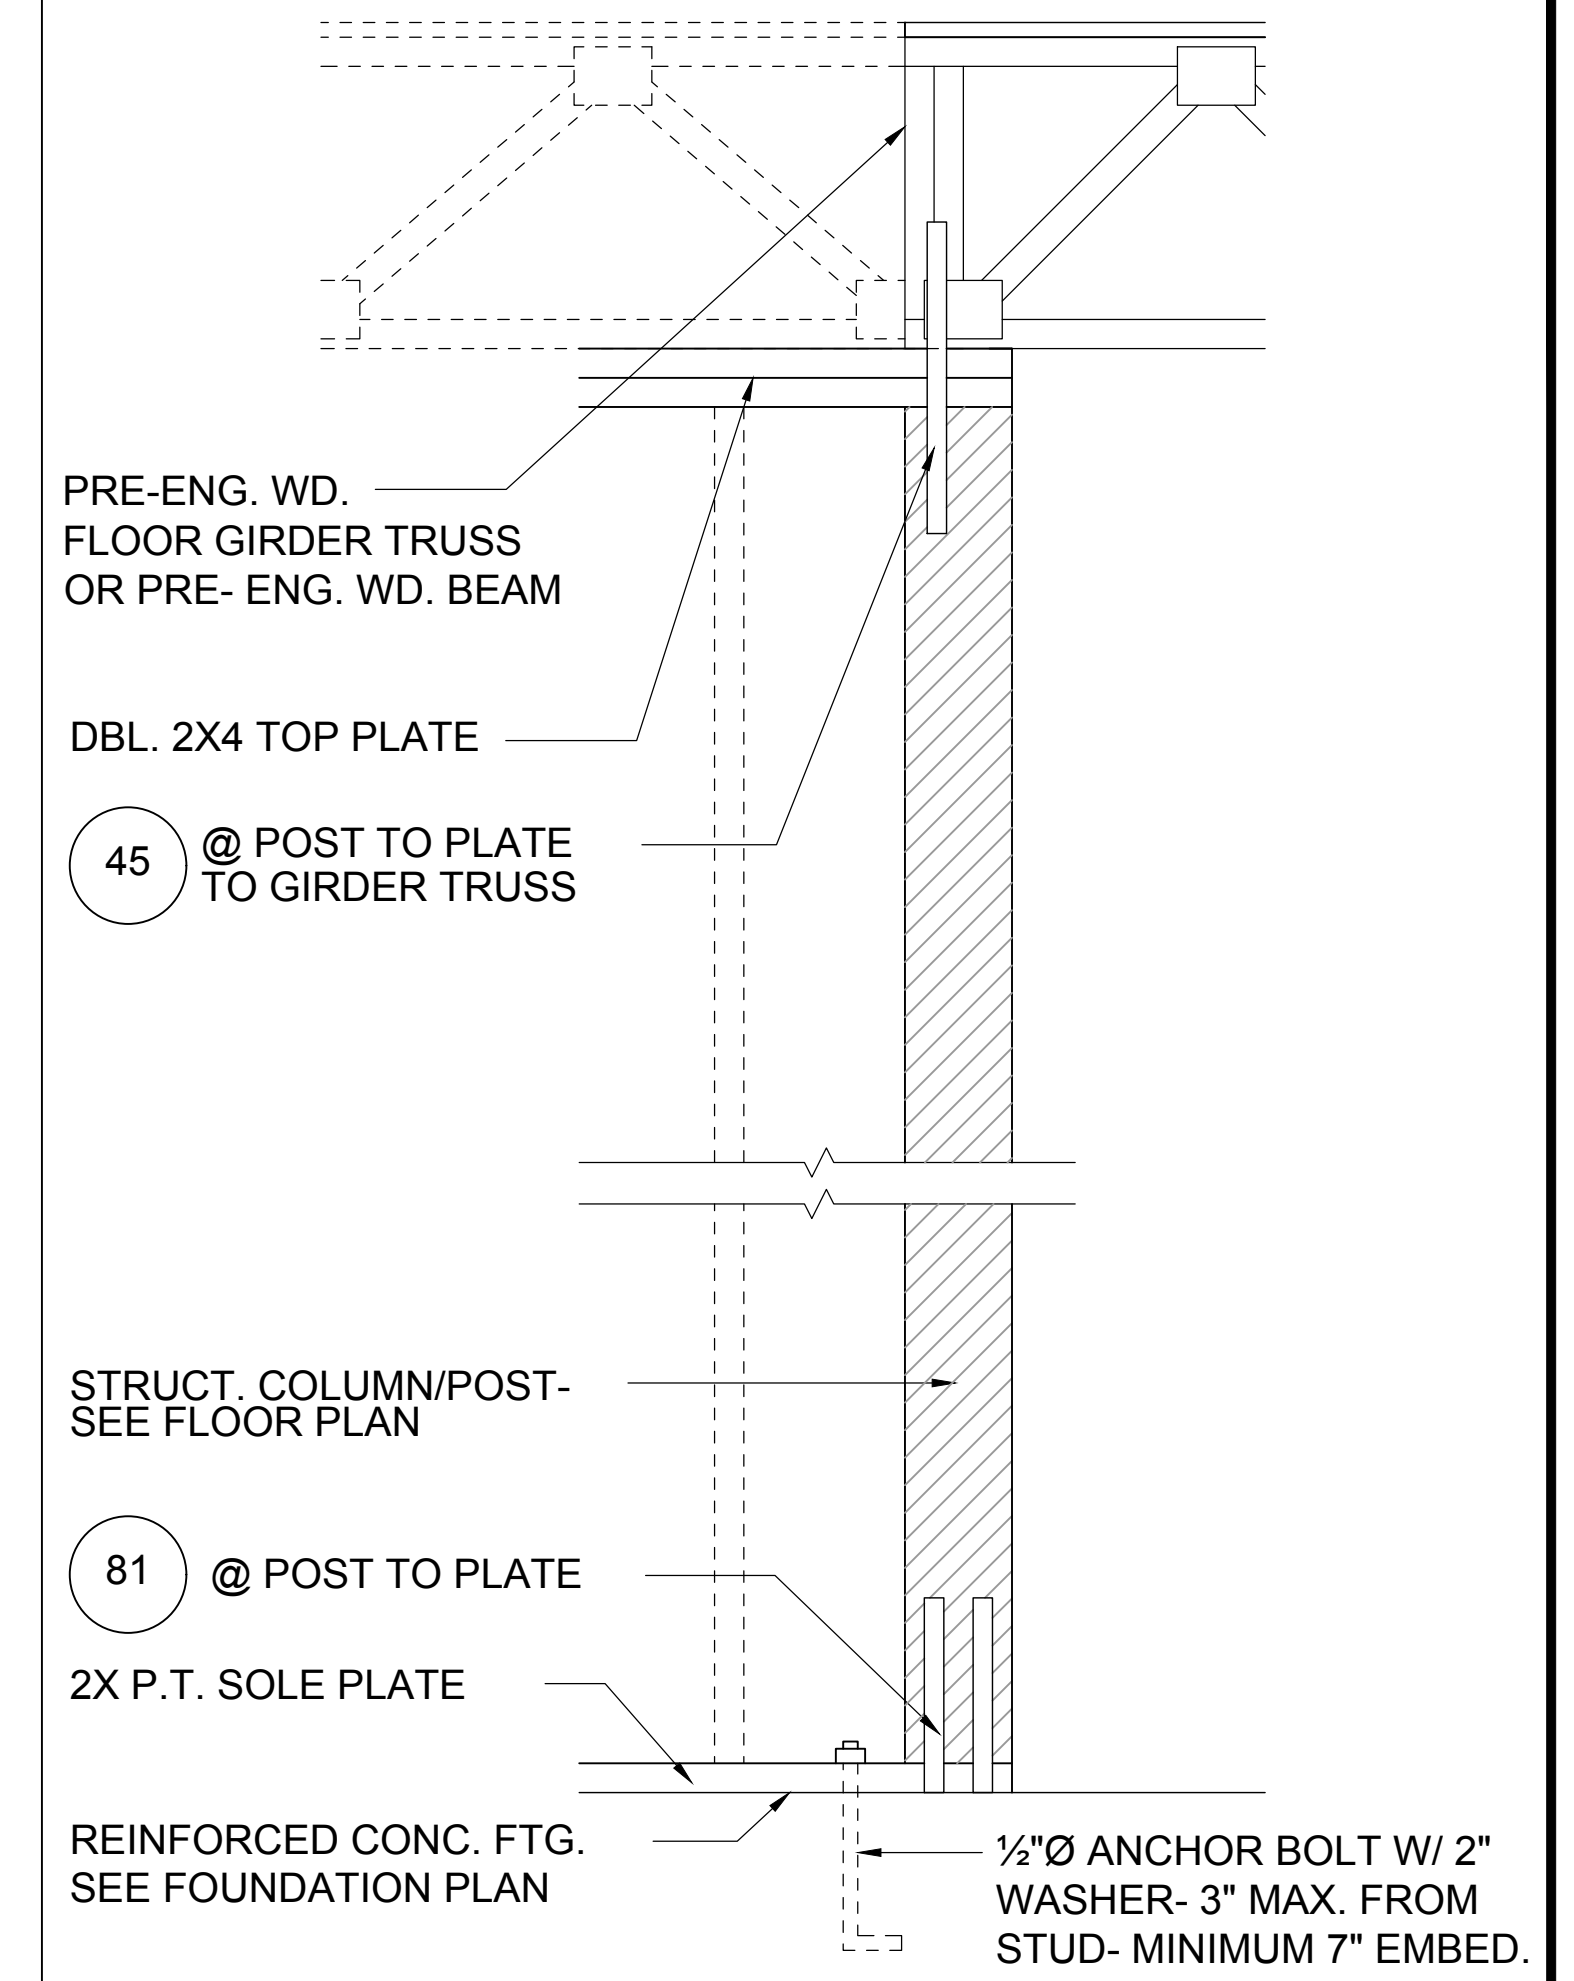


2 DETAIL
D5


1/2"=1'-0" (11X17) 1"=1'-0" (22"X34")

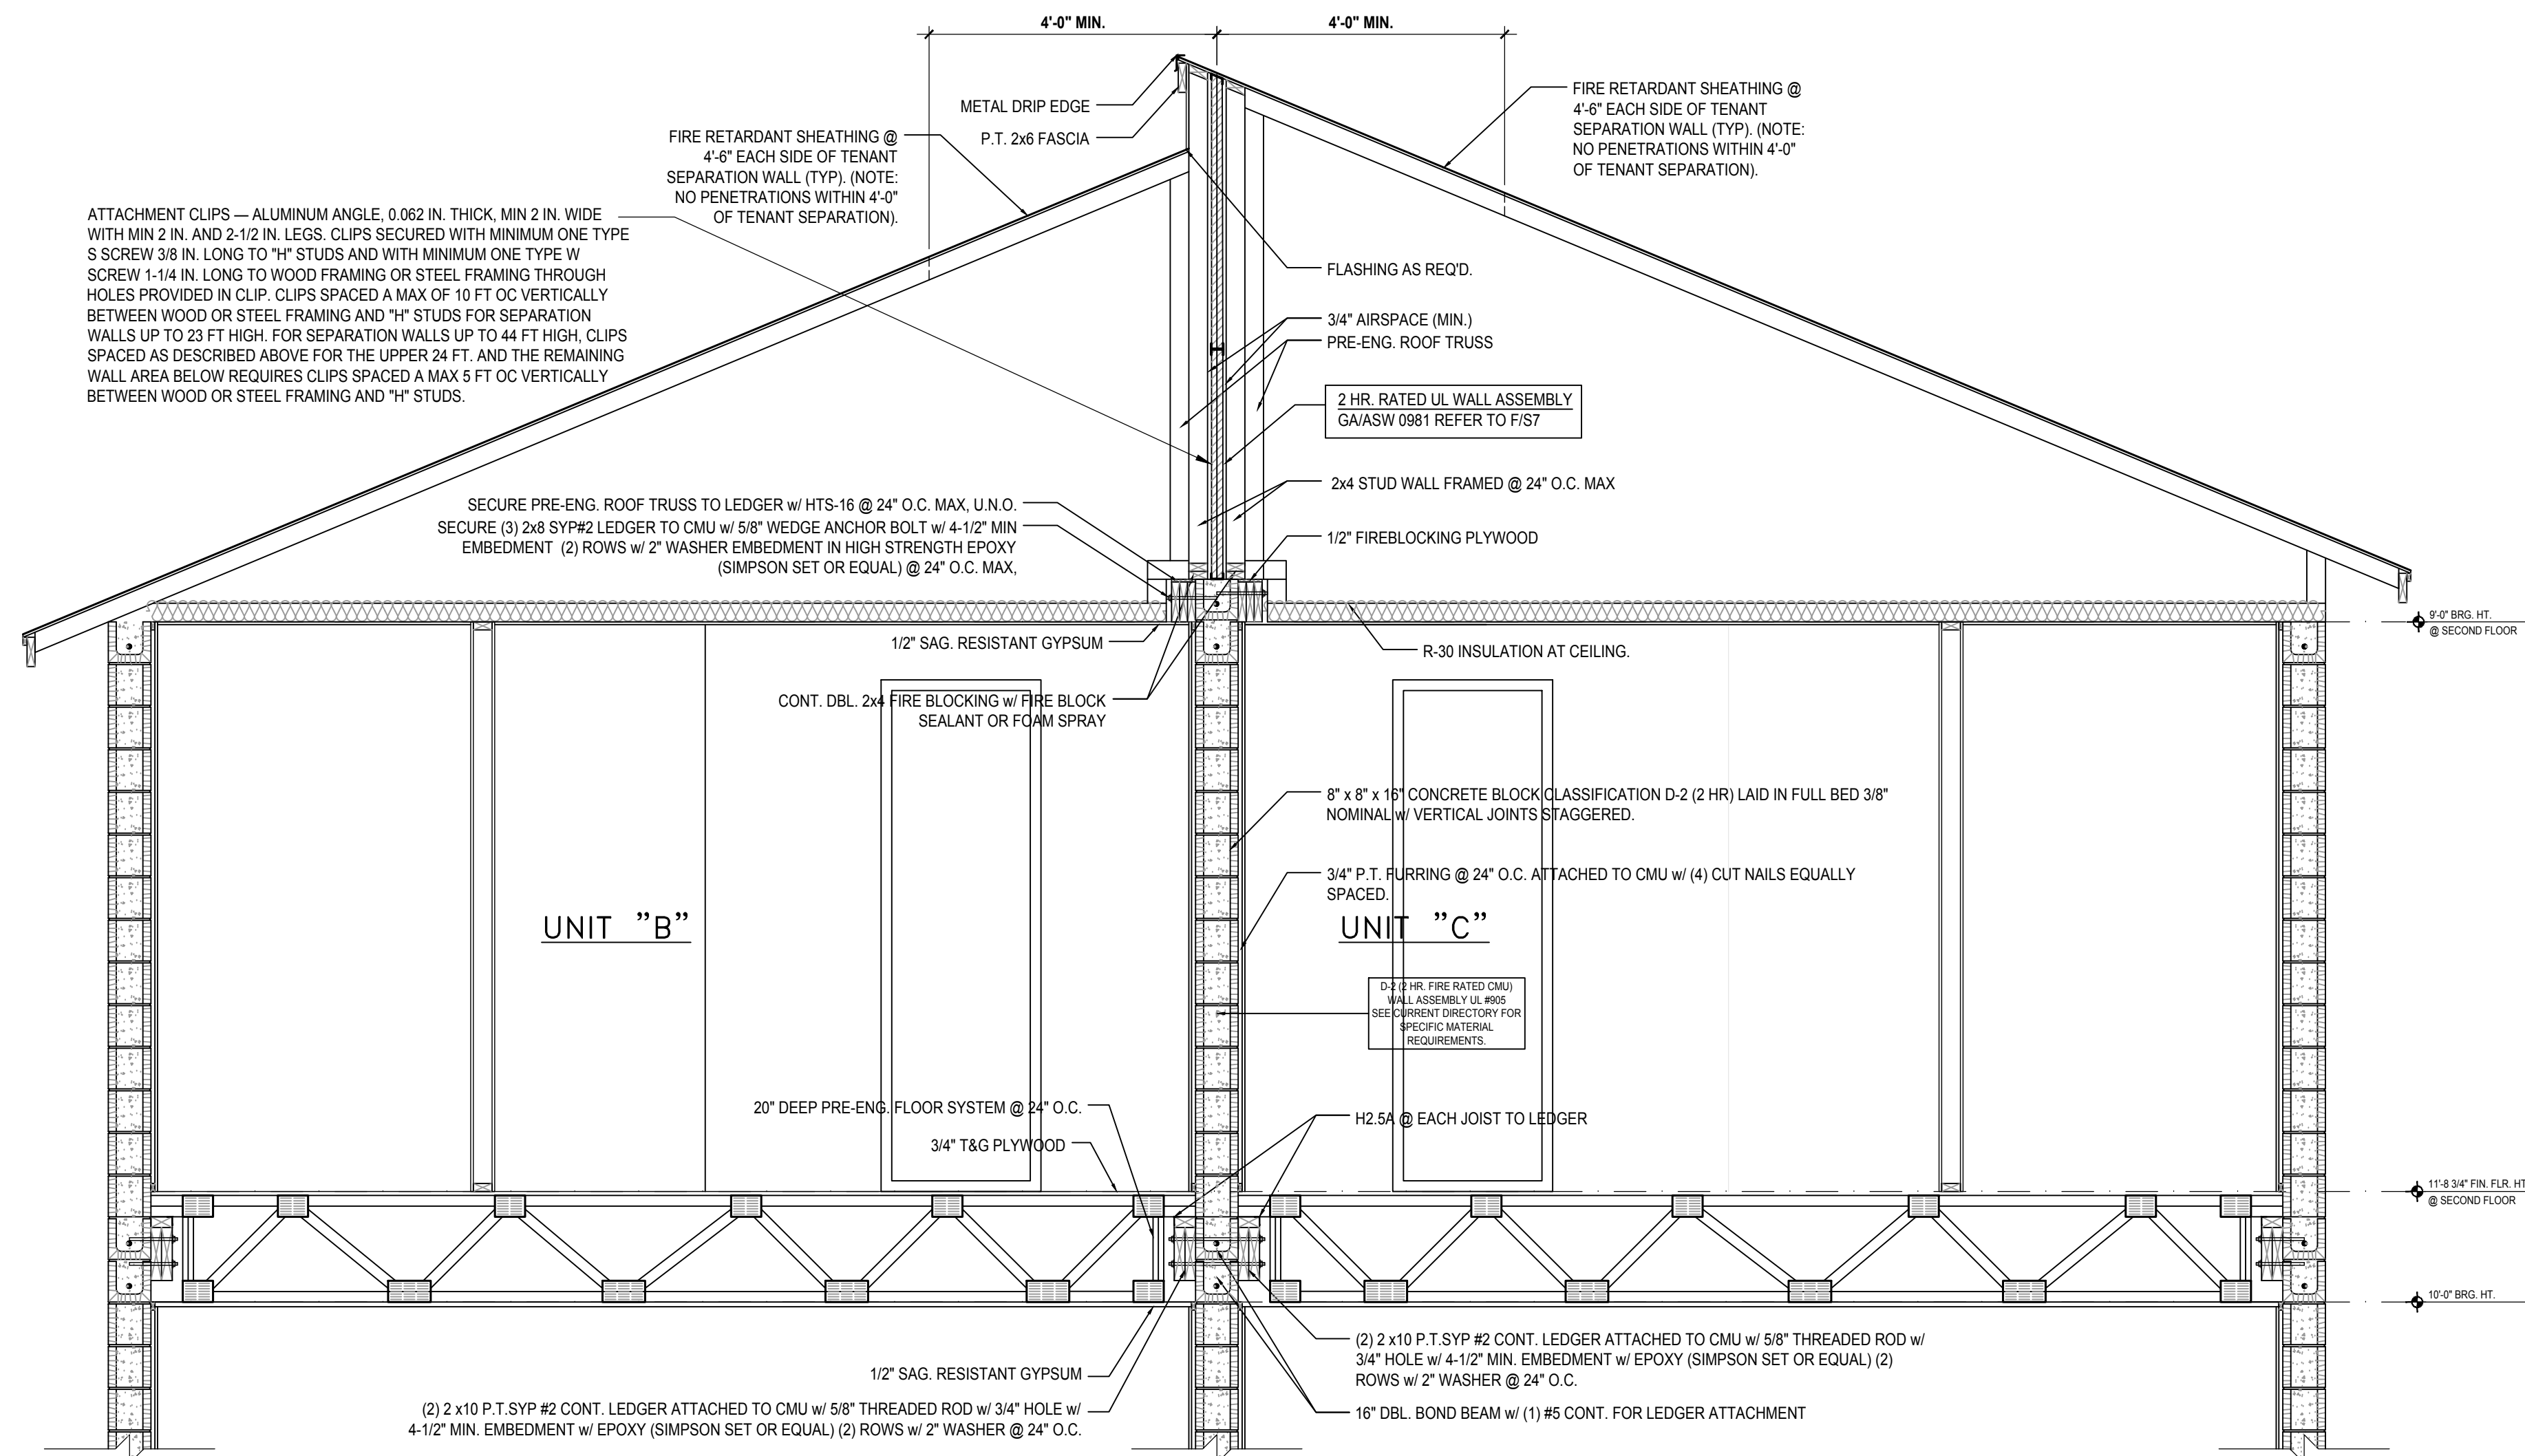

A BUILDING SECTION
D5 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

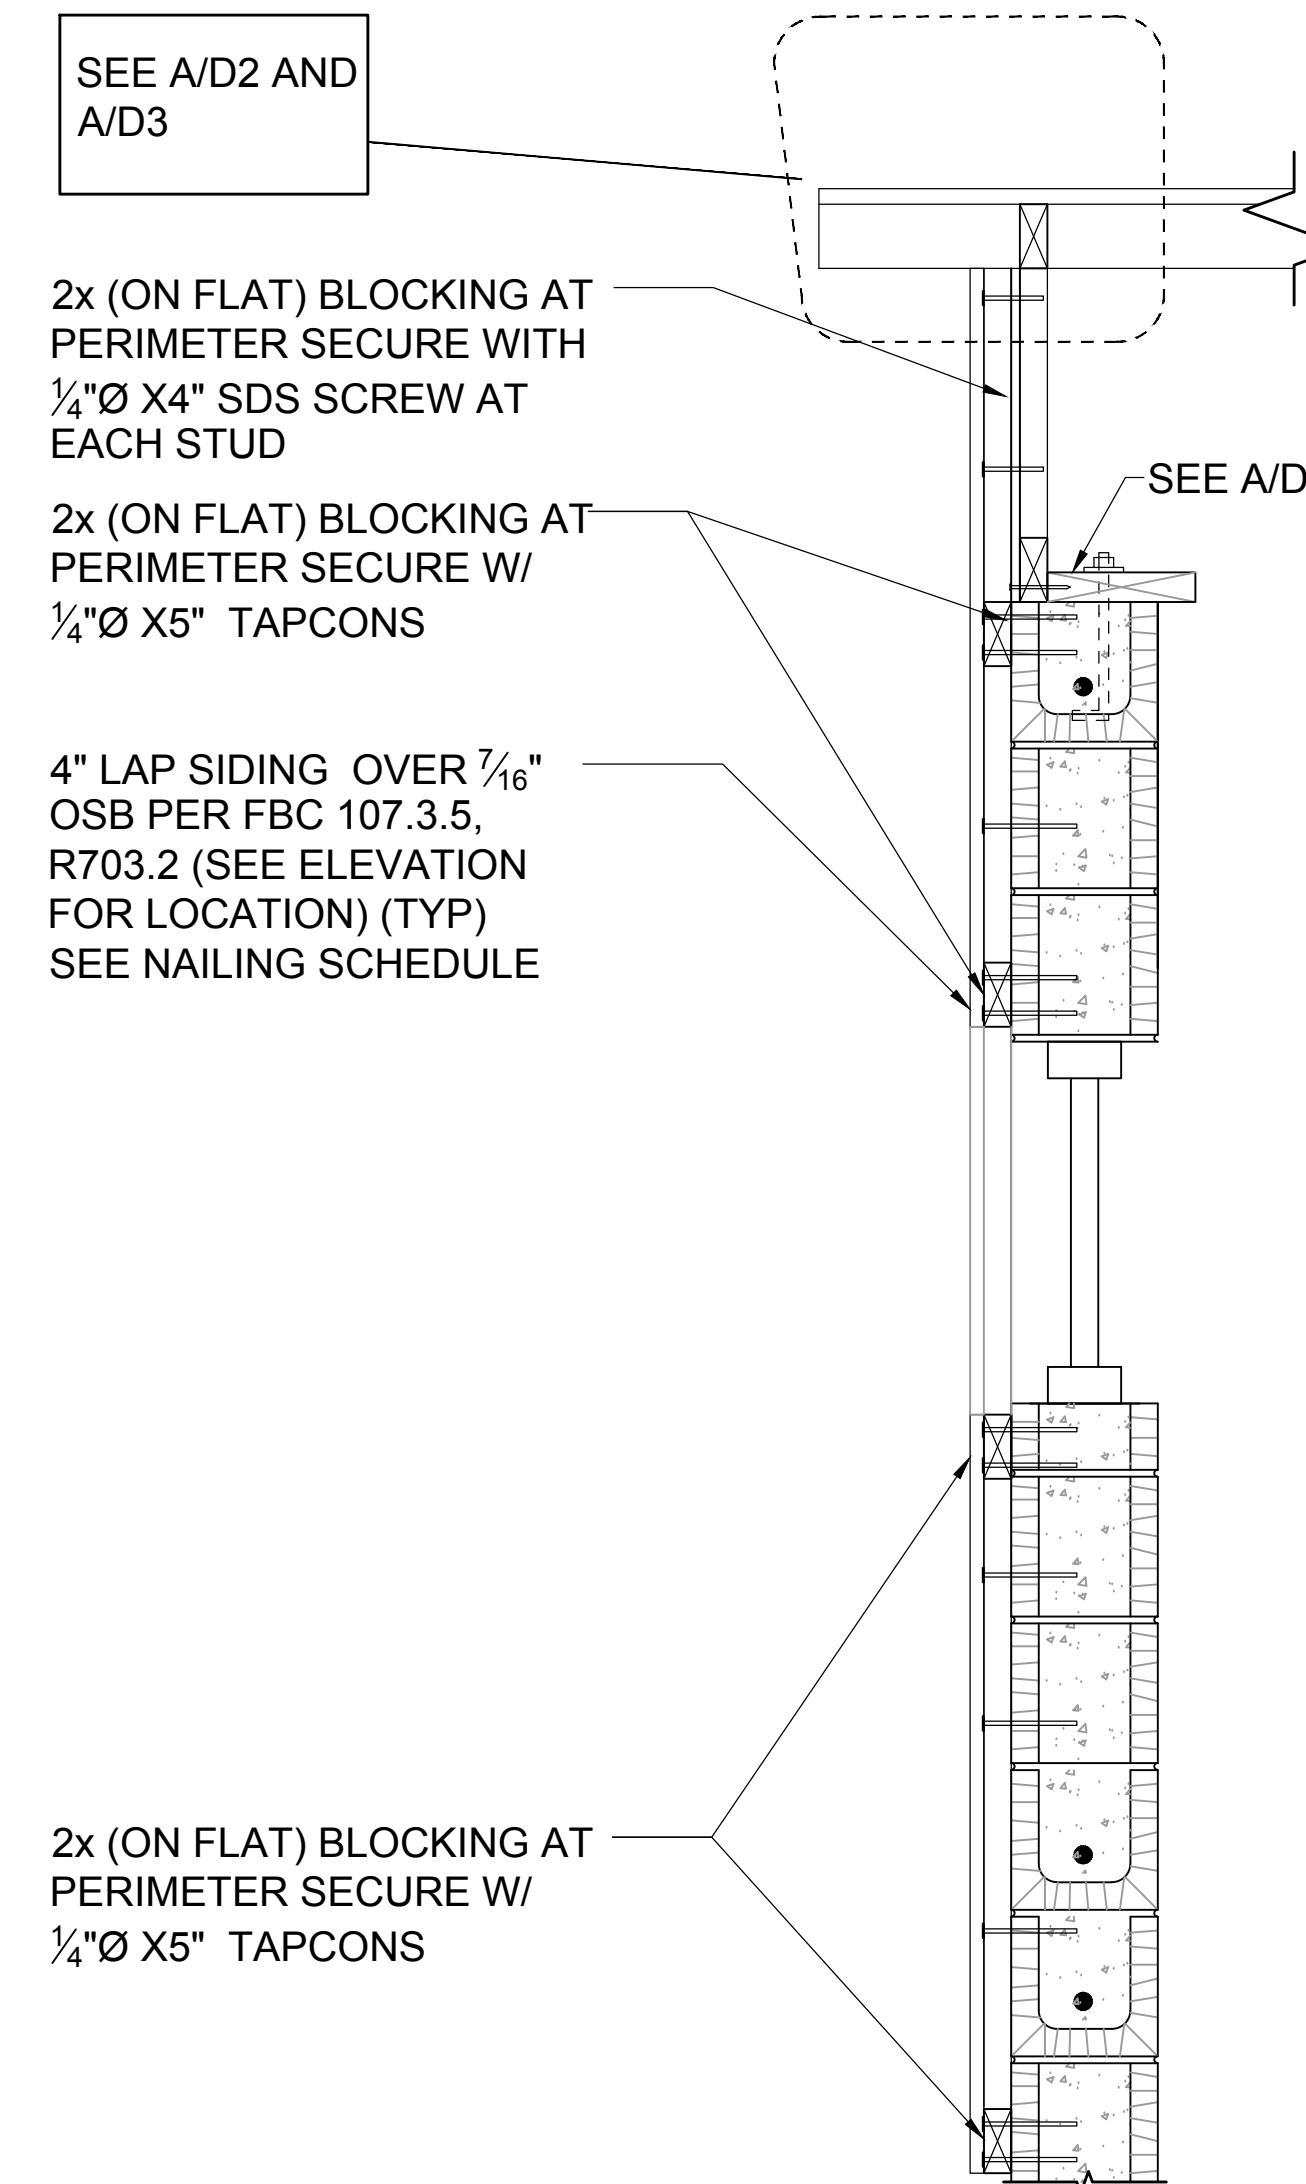


3 FRAME BUMP OUT DETAIL
D5 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

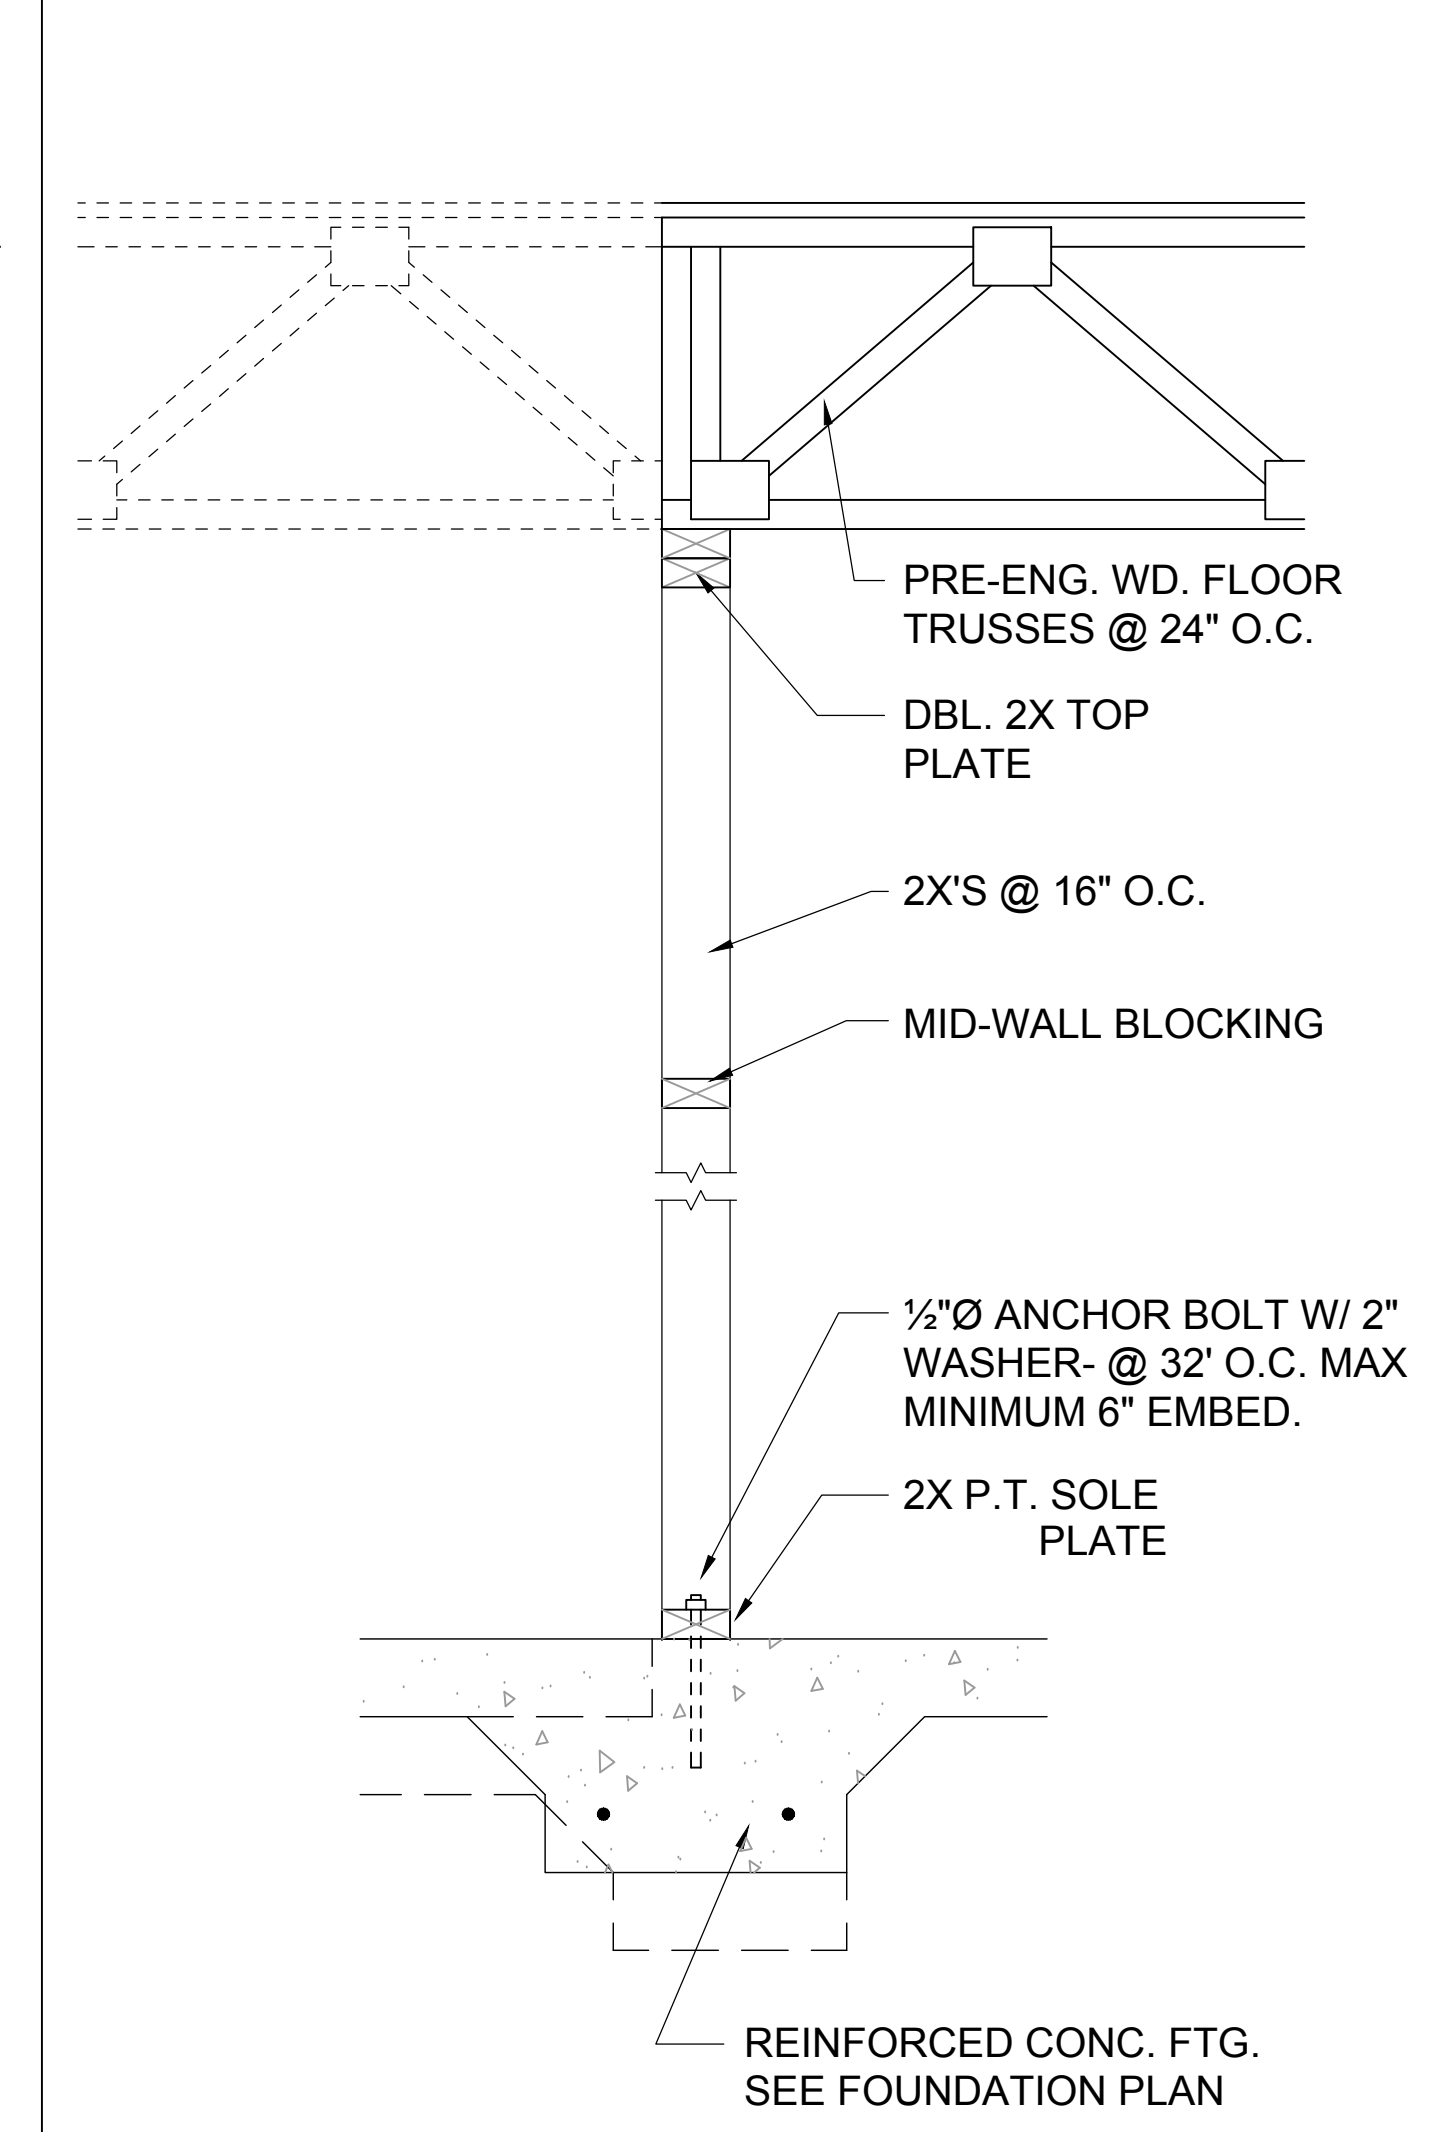


1 DETAIL
D5 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGN ARE NOT TO BE COPIED OR MODIFIED IN ANY MANNER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.


Mar 01, 2025 3:02pm A:\eplan\Nilesh\New\NewOneDrive - Thompson Engineering Group\Desktop\Paradiso Grande (CMU)-Revised\Detail\UNIT\Temp Files\SDS Structural Details.dwg

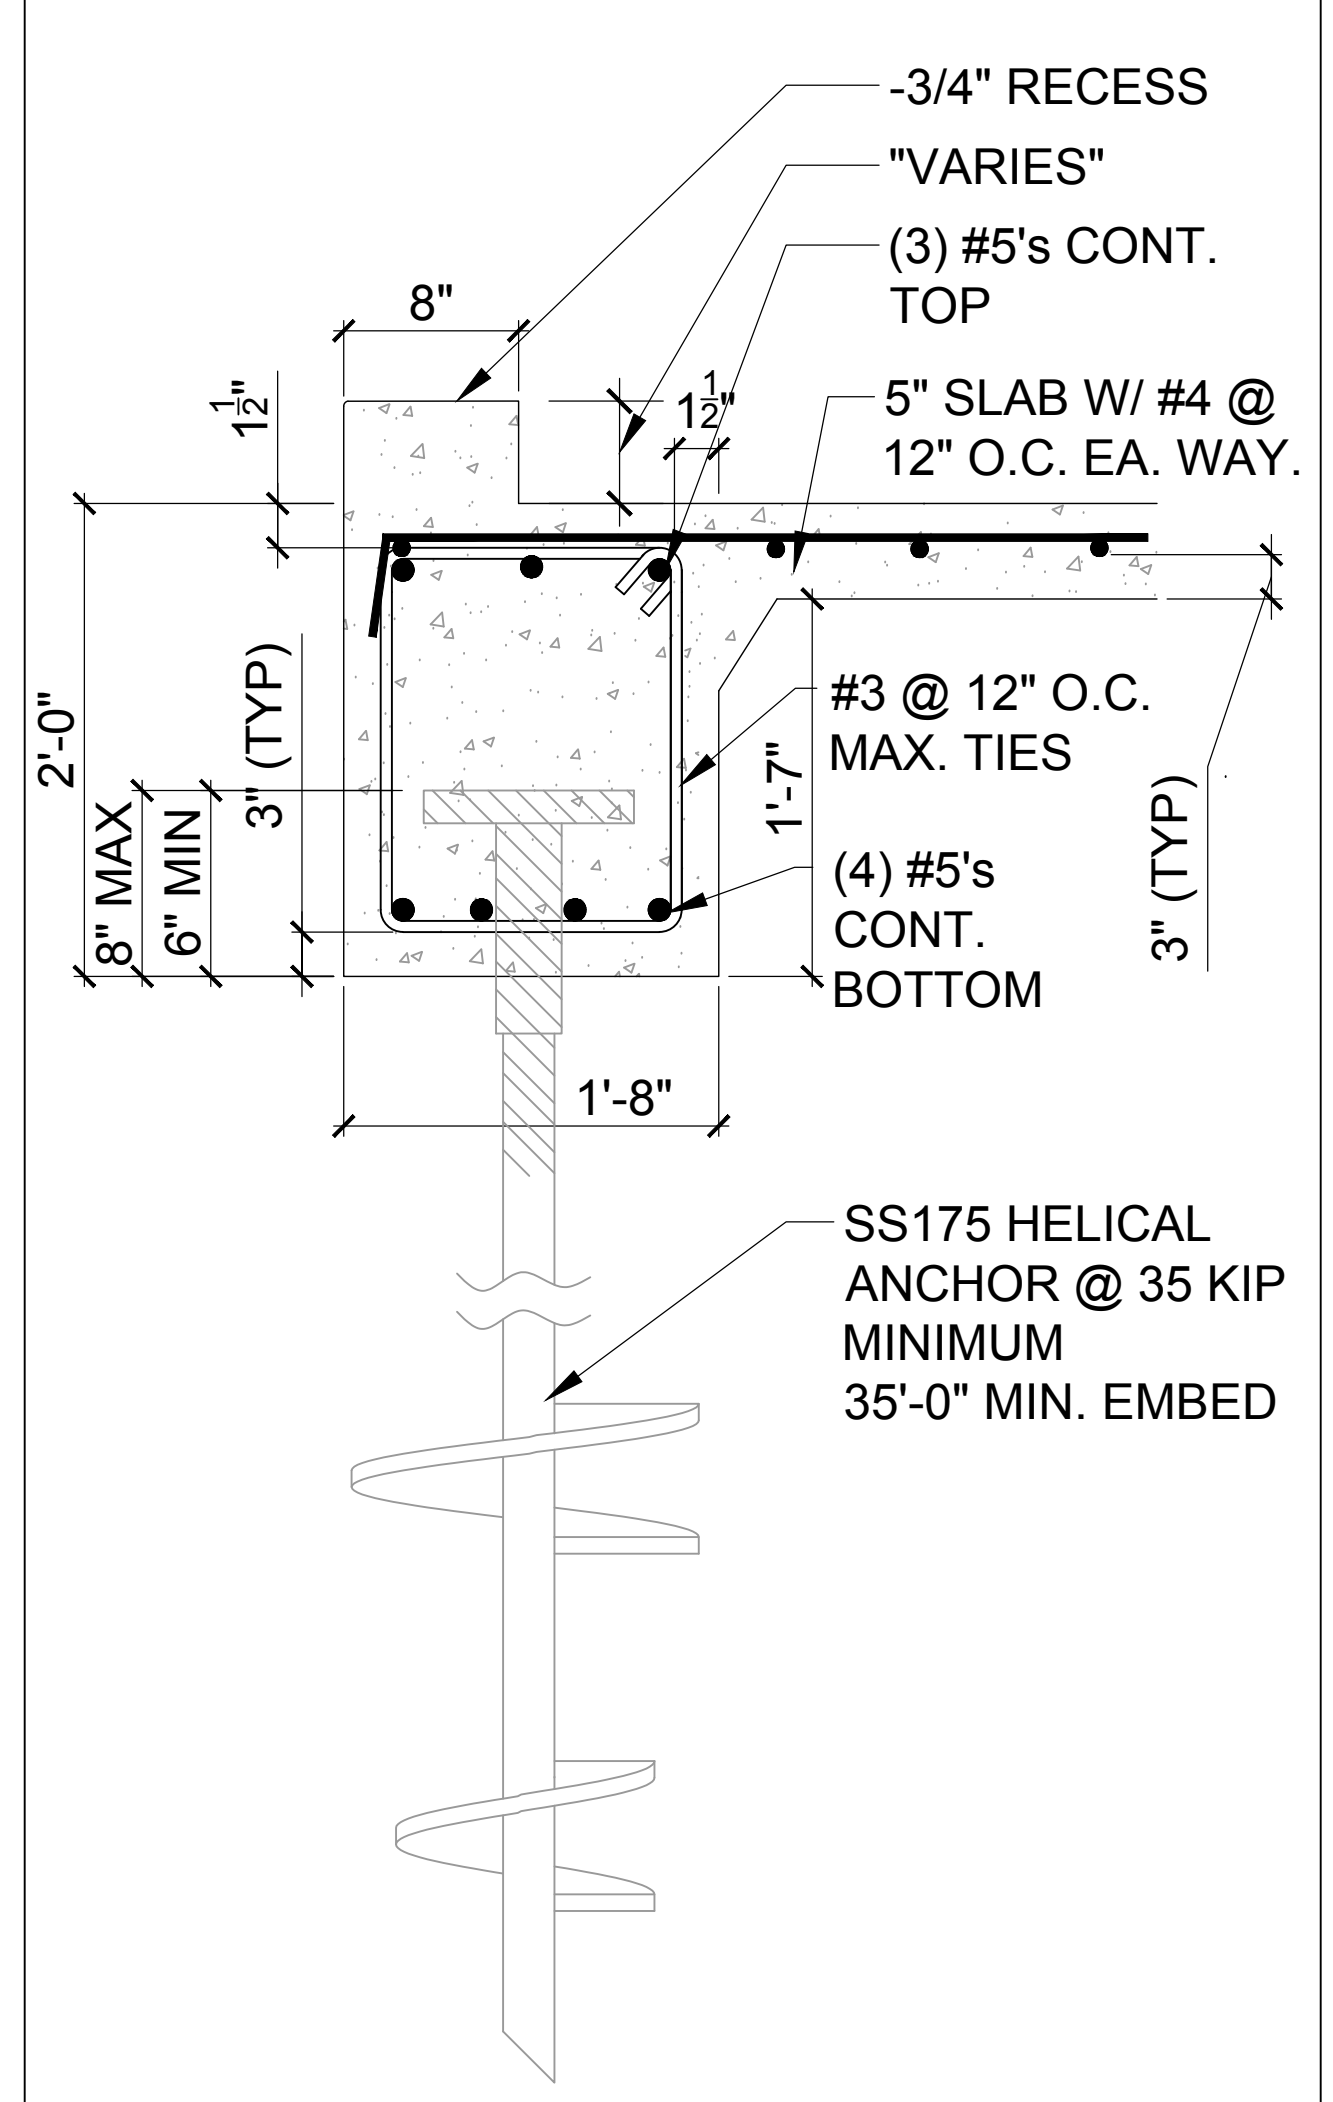


BEARING FOOTER @ CONCRETE CURB SECTION TWO-STORY
 8
 D6 N.T.S.

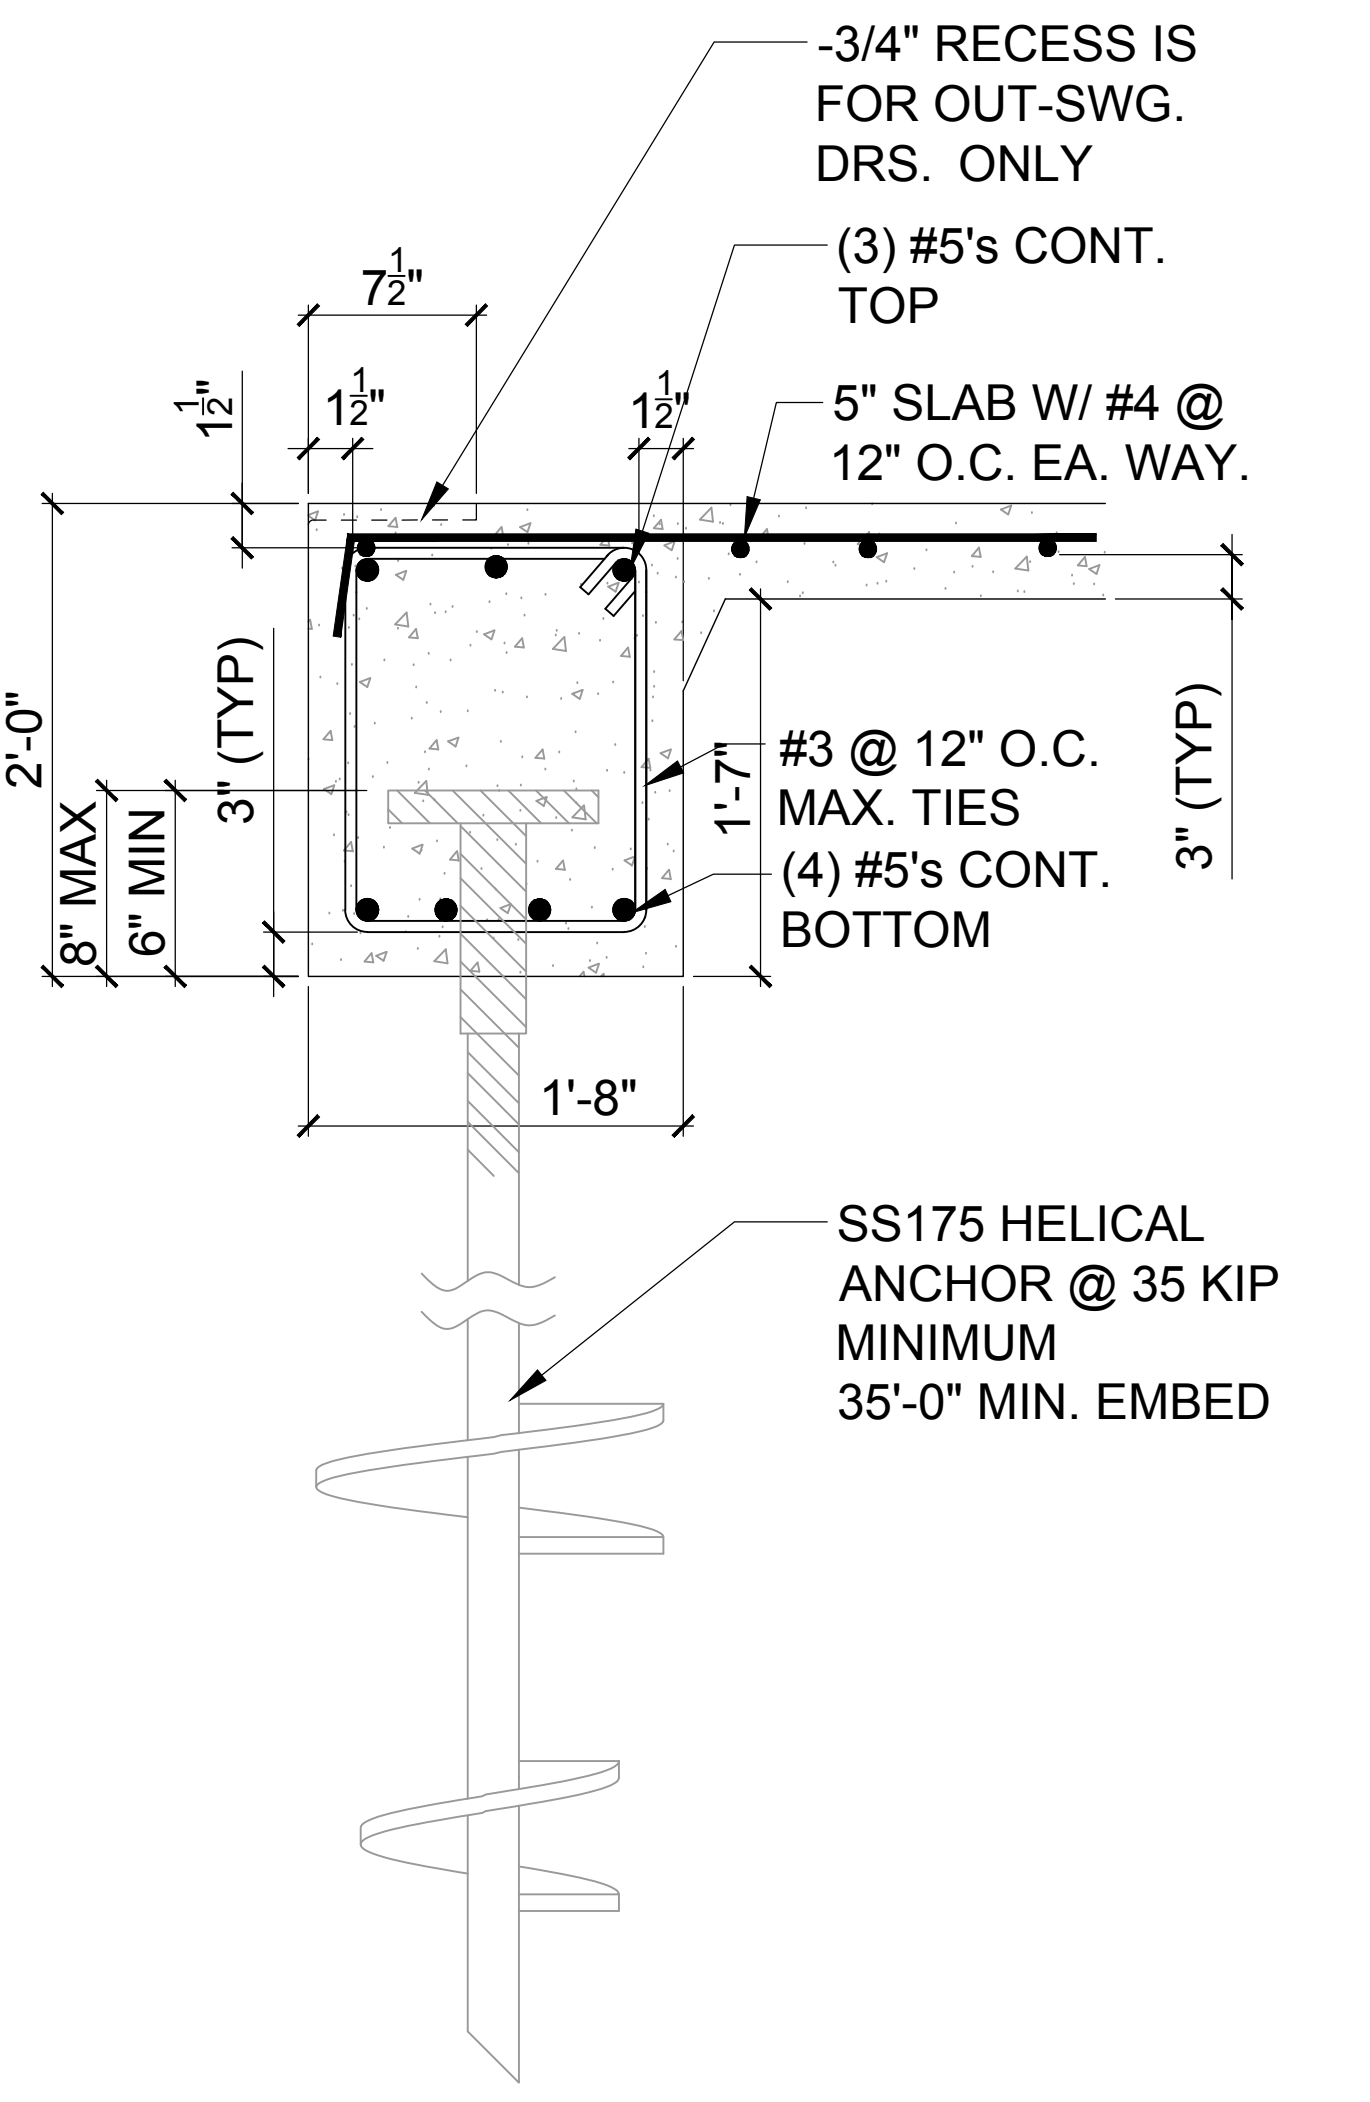


CONT. BEARING FOOTER TWO-STORY DETAIL
 6
 D6 N.T.S.

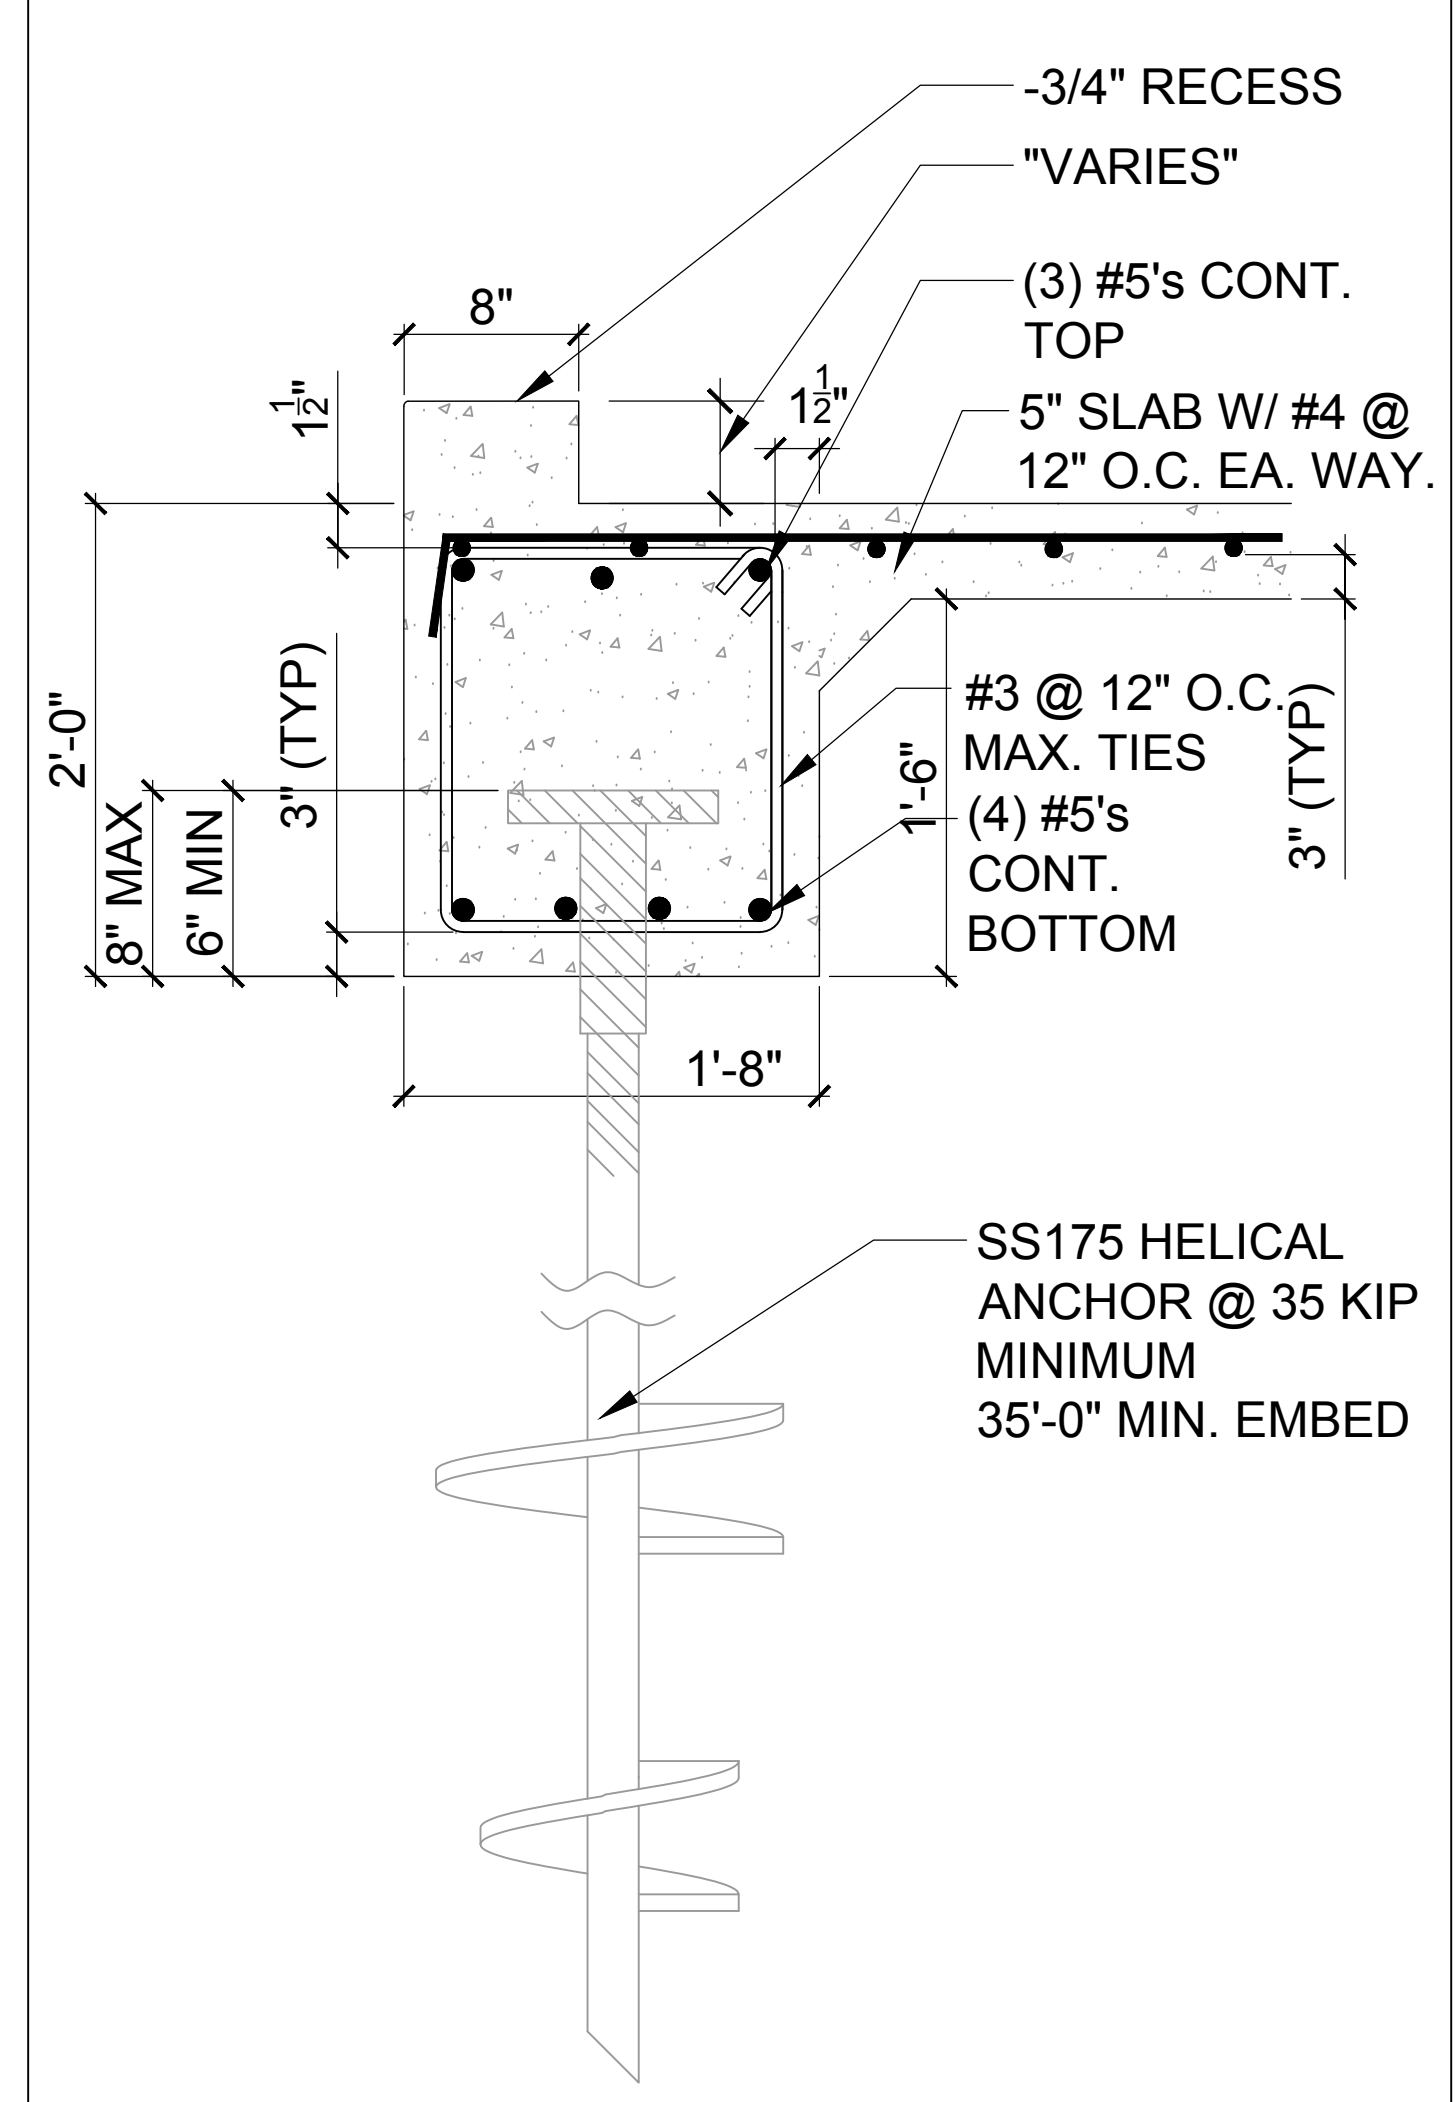


BEARING FOOTER @ CONCRETE CURB SECTION ONE-STORY
 4
 D6 N.T.S.

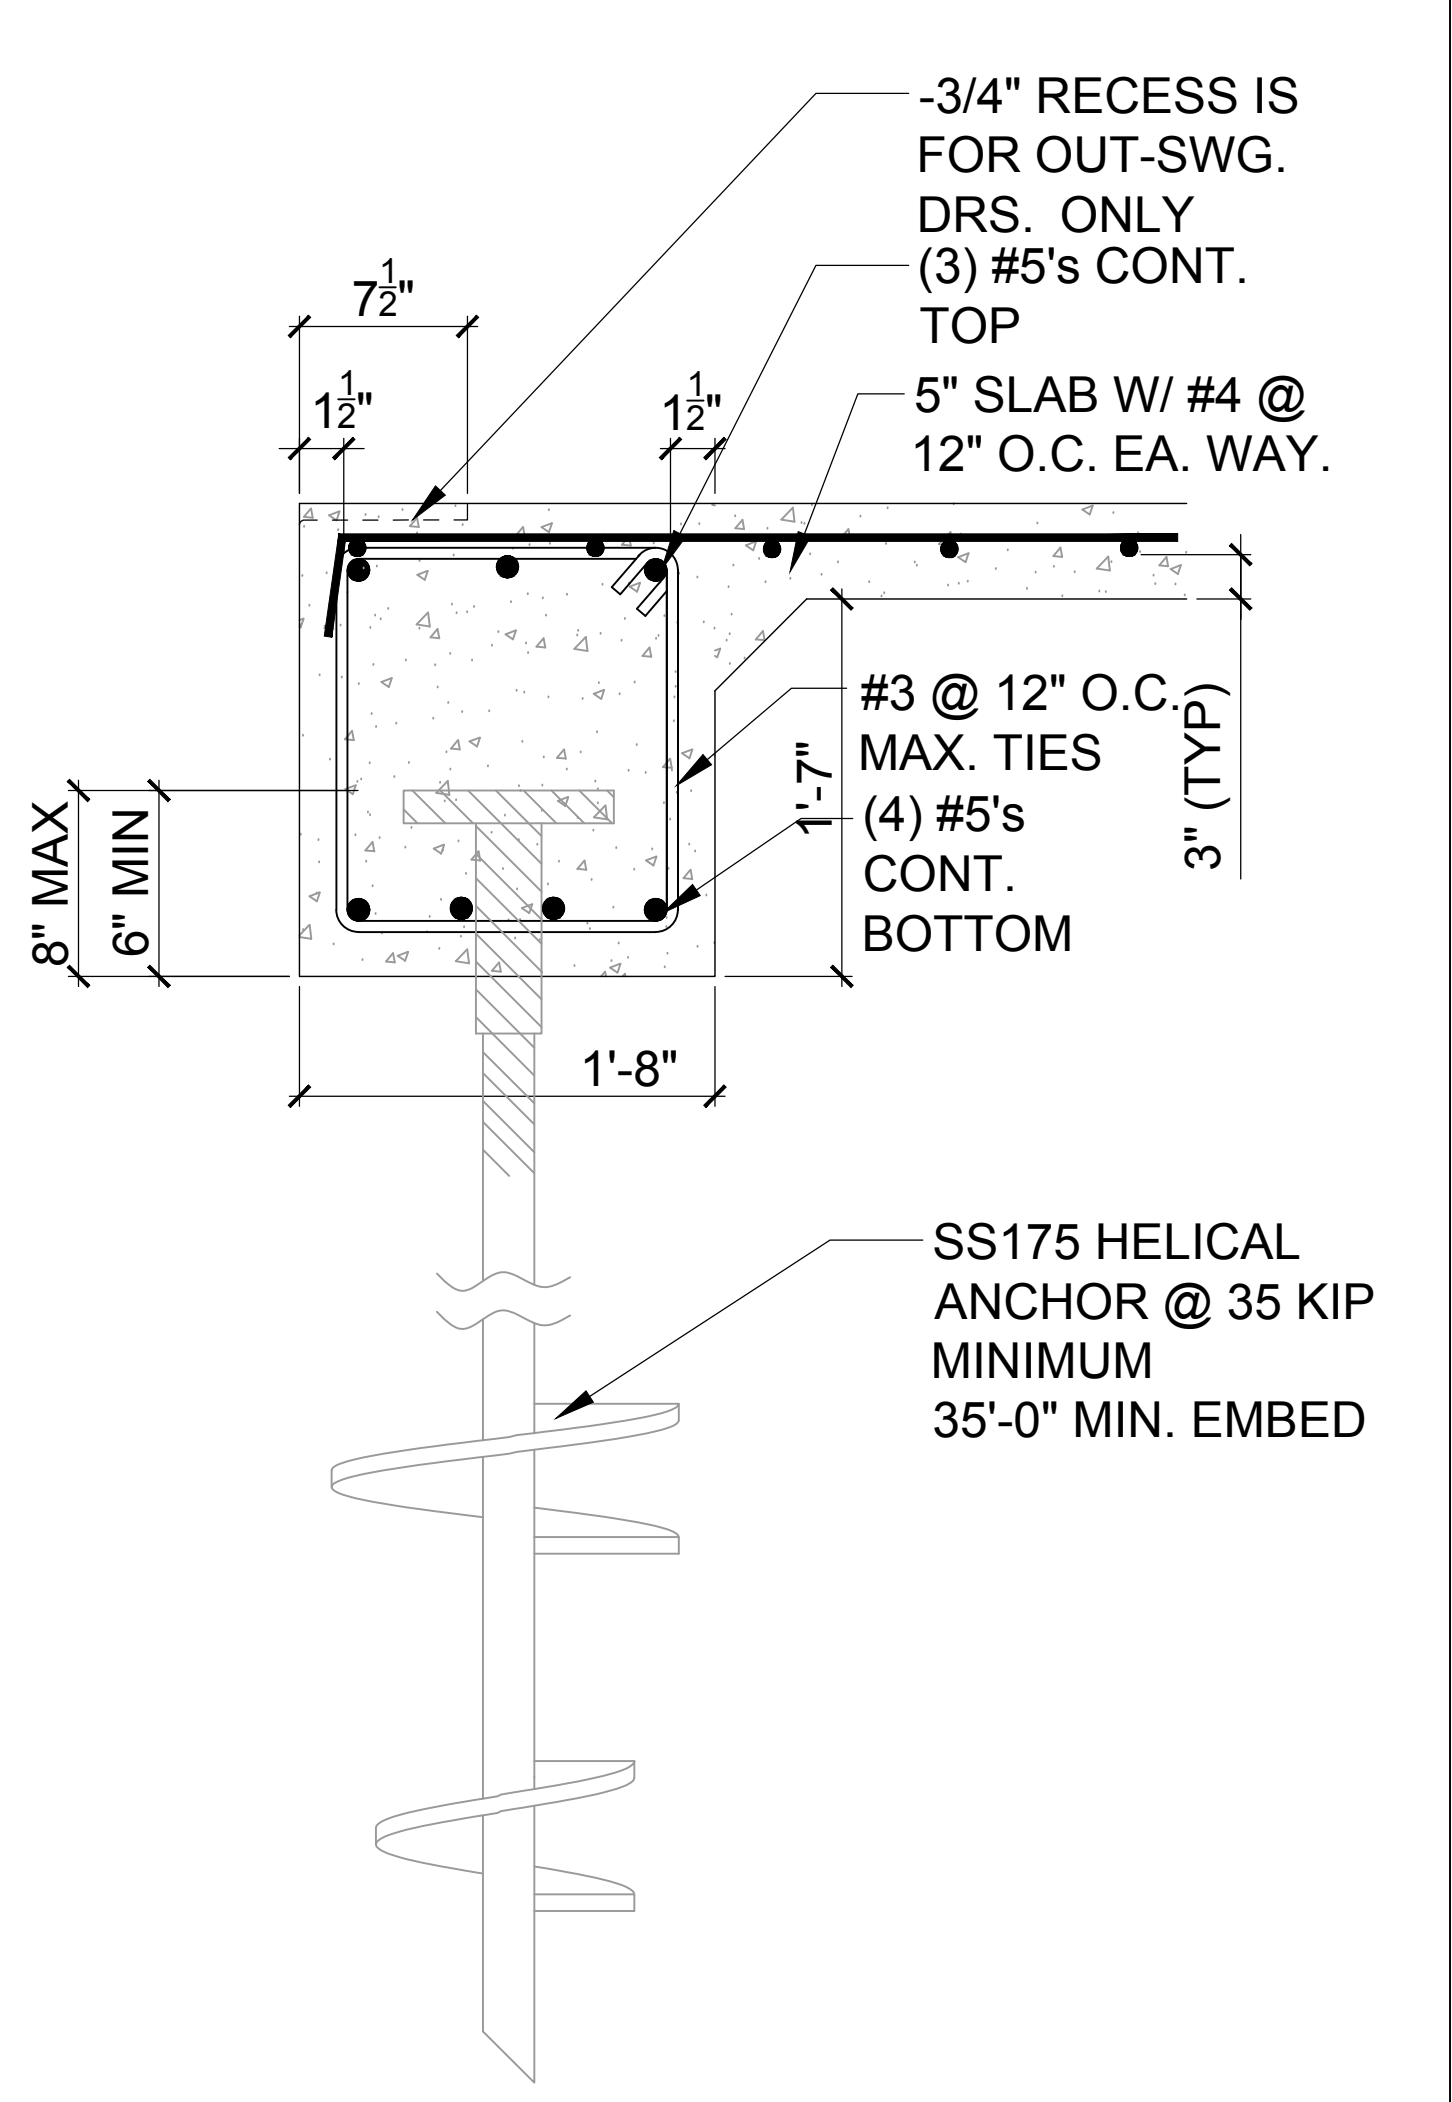


CONT. BEARING FOOTER ONE-STORY DETAIL
 2
 D6 N.T.S.

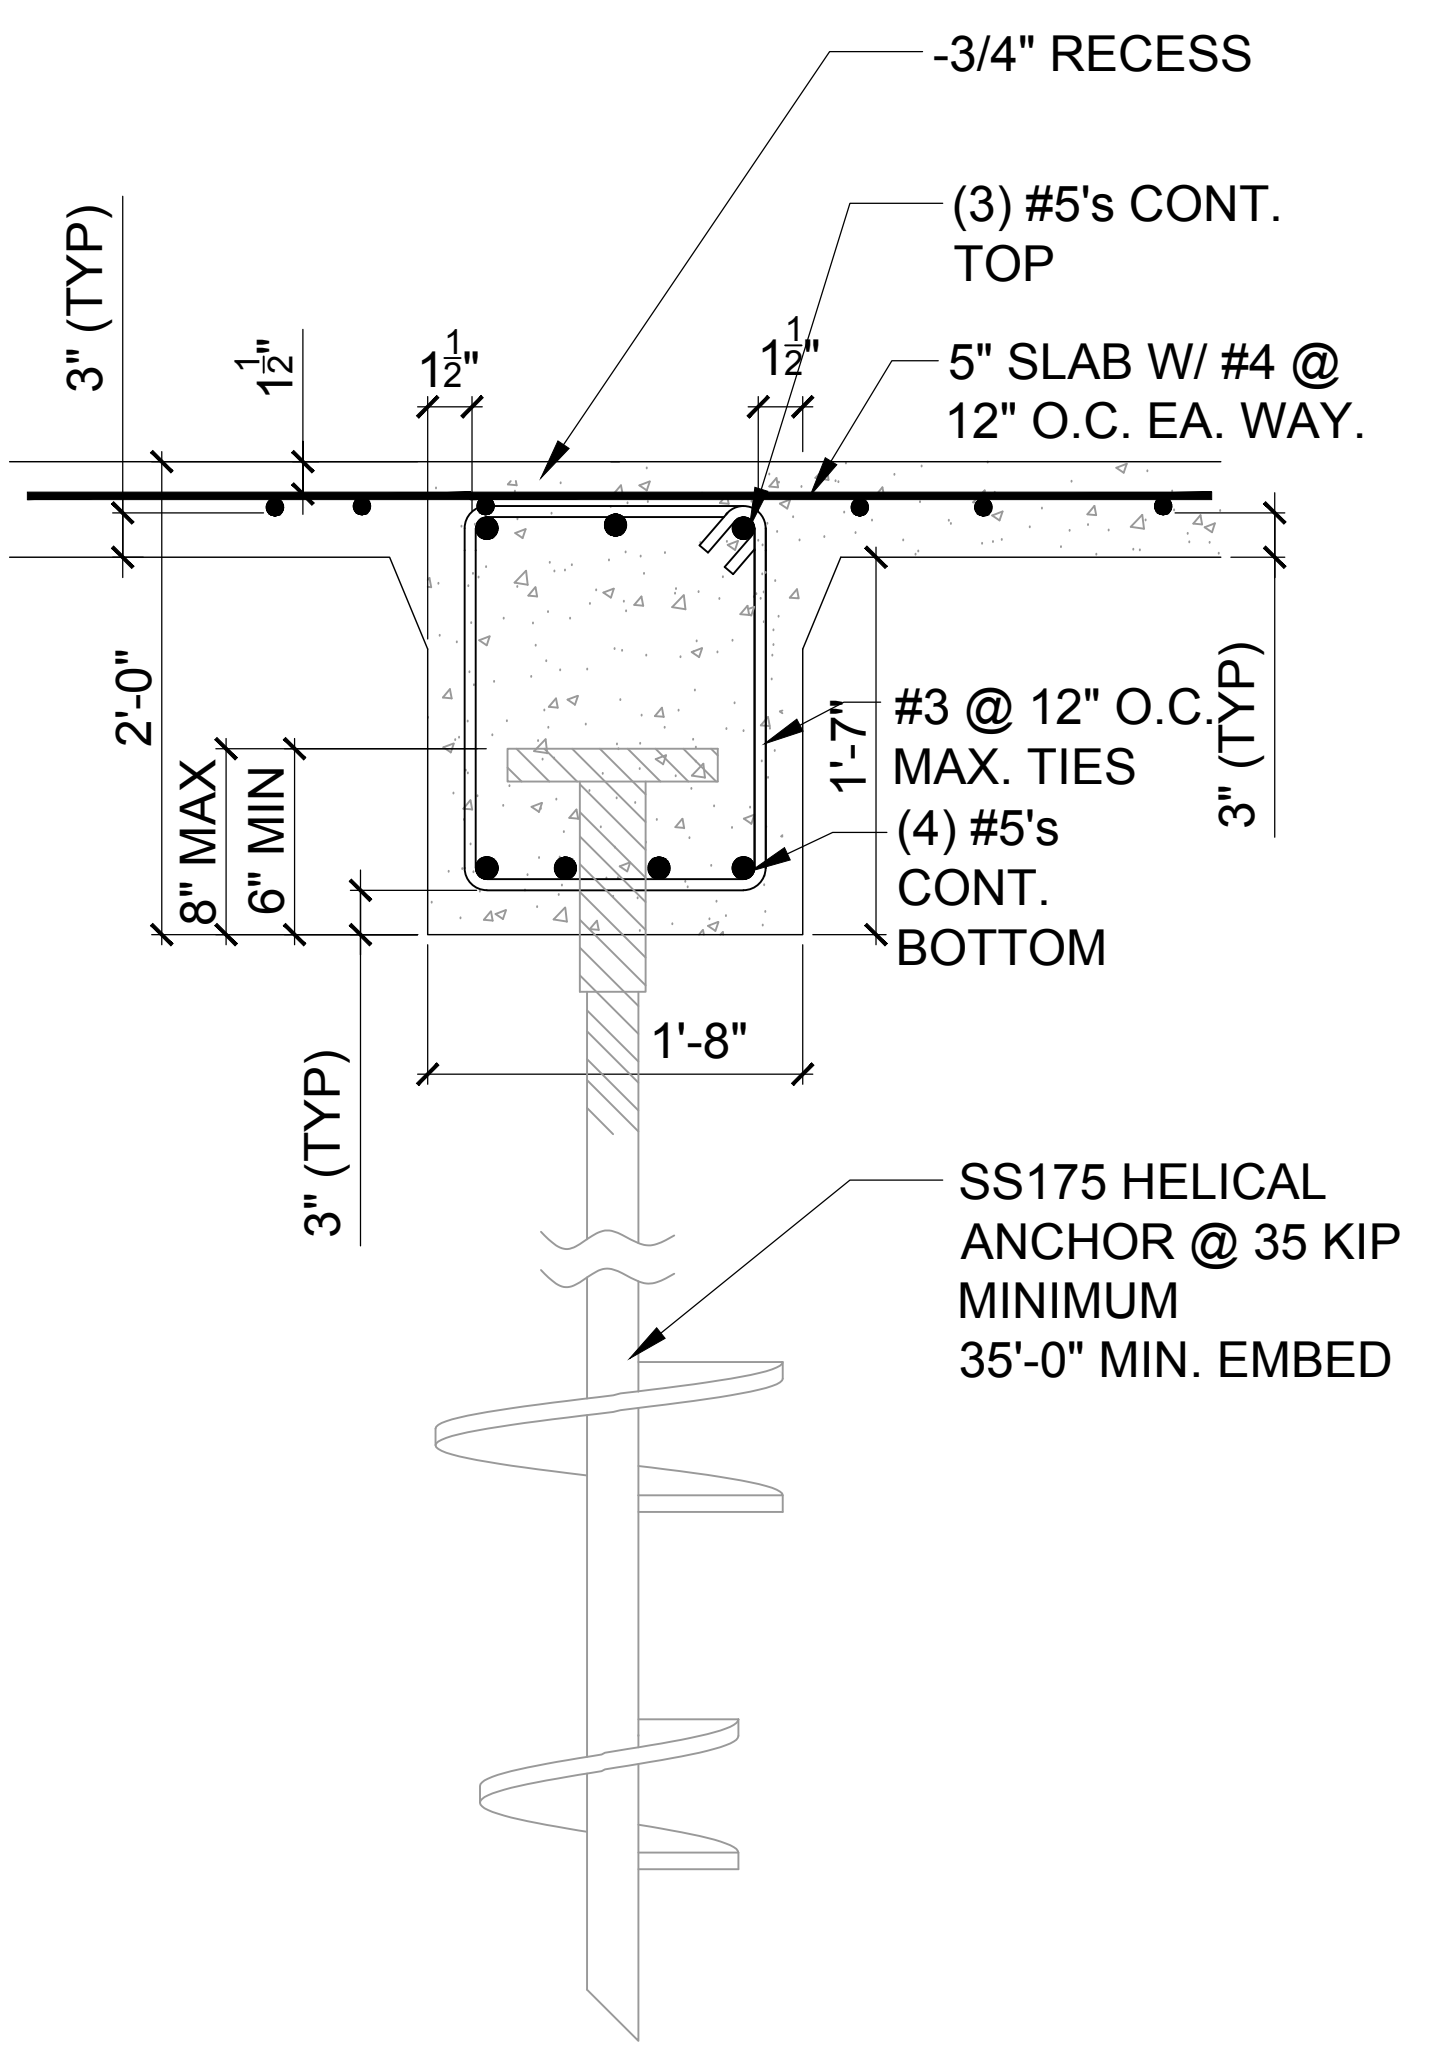


INTERIOR BEARING FOOTER @ TWO-STORY
 9
 D6 N.T.S.

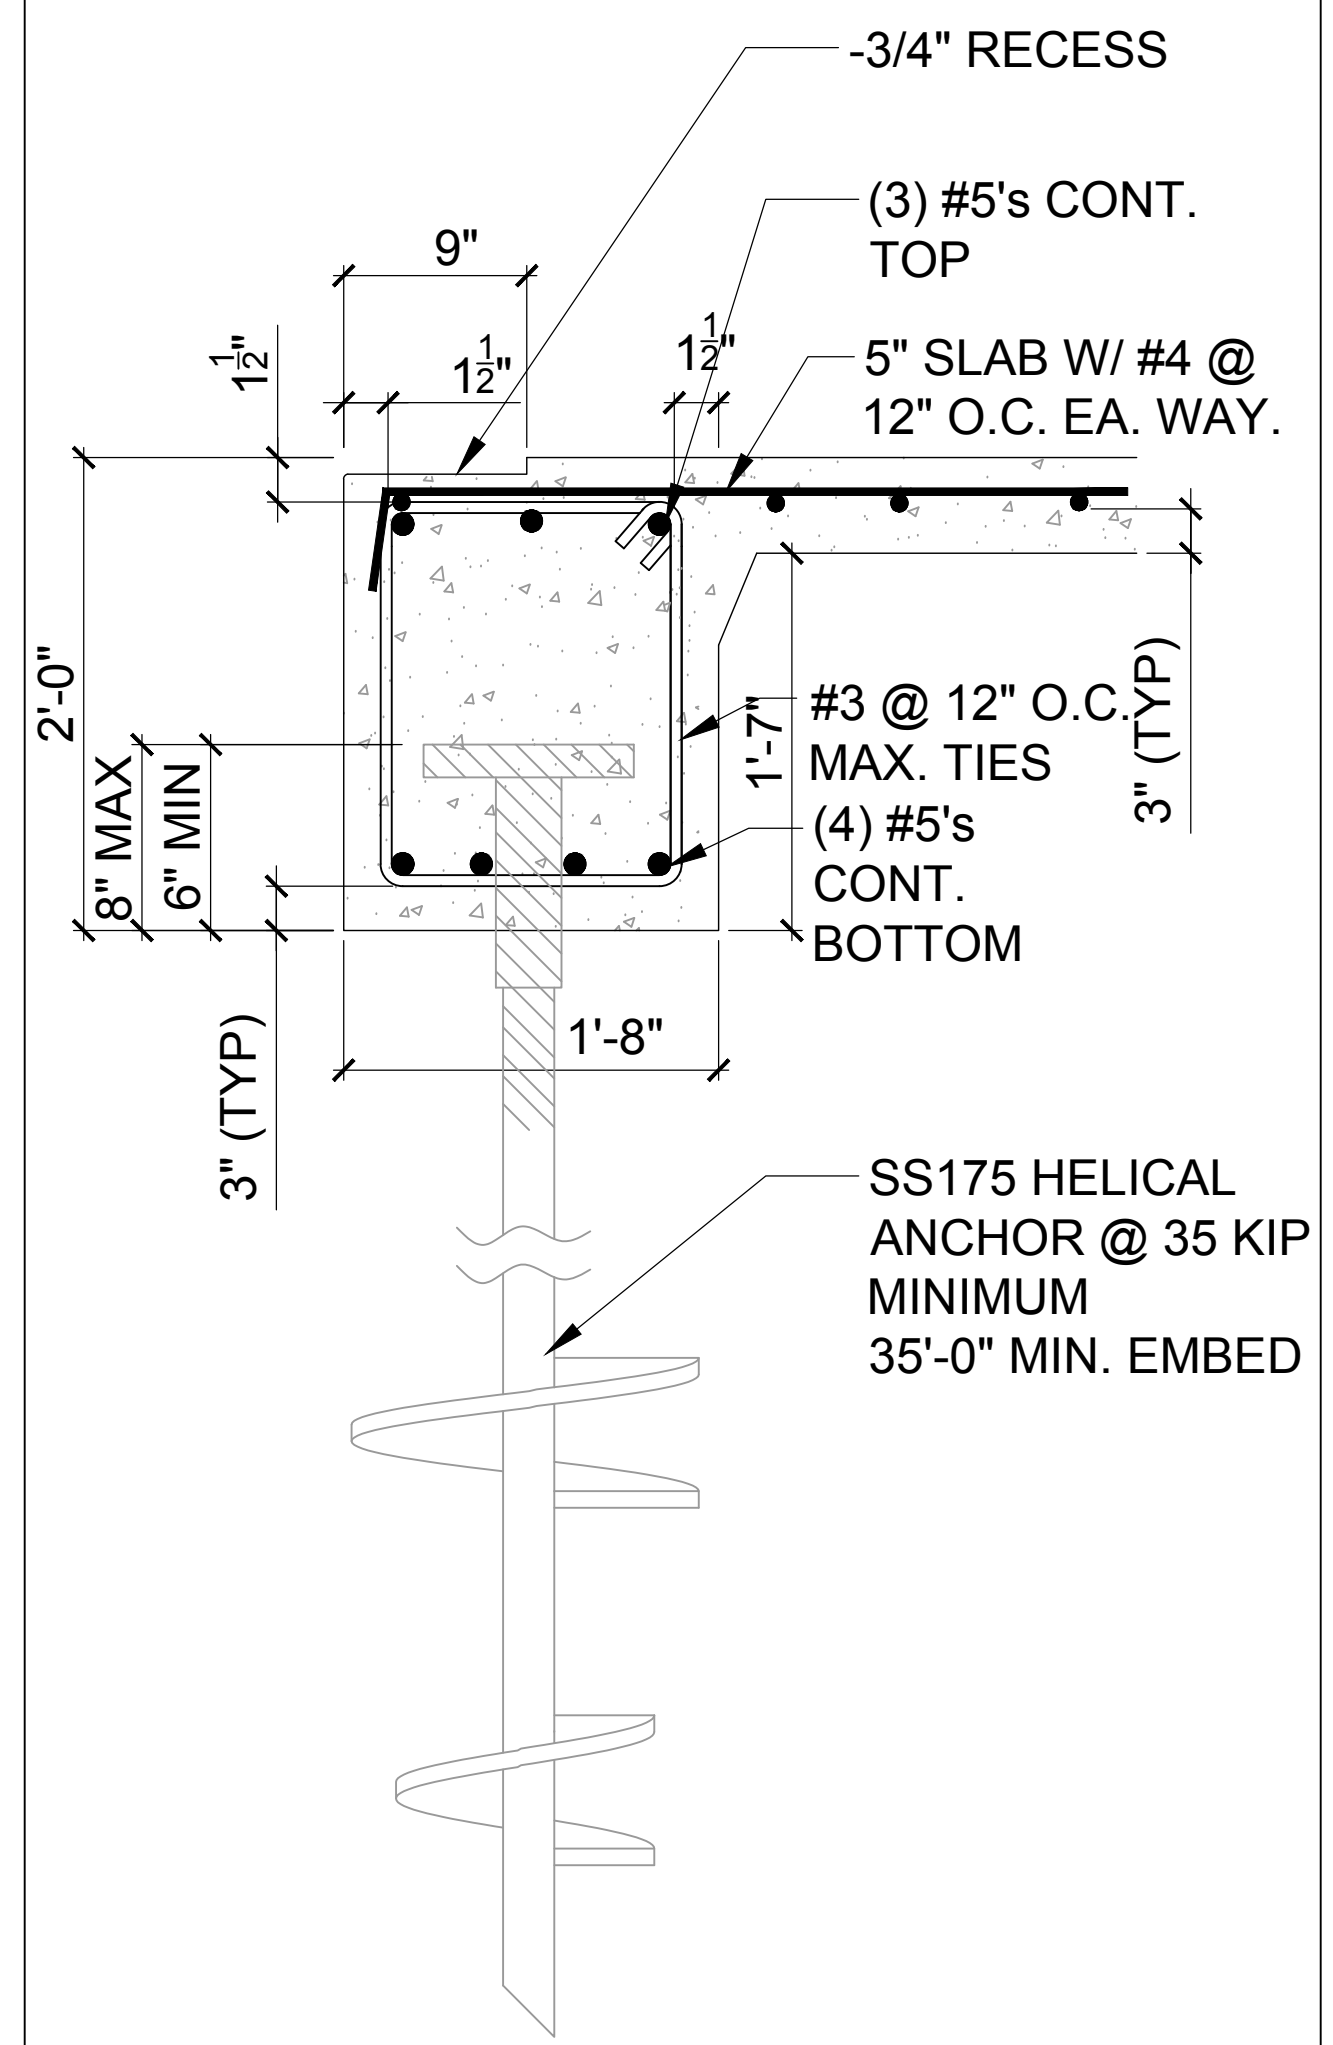


BEARING FOOTER @ CONCRETE RECESS SECTION TWO-STORY
 7
 D6 N.T.S.

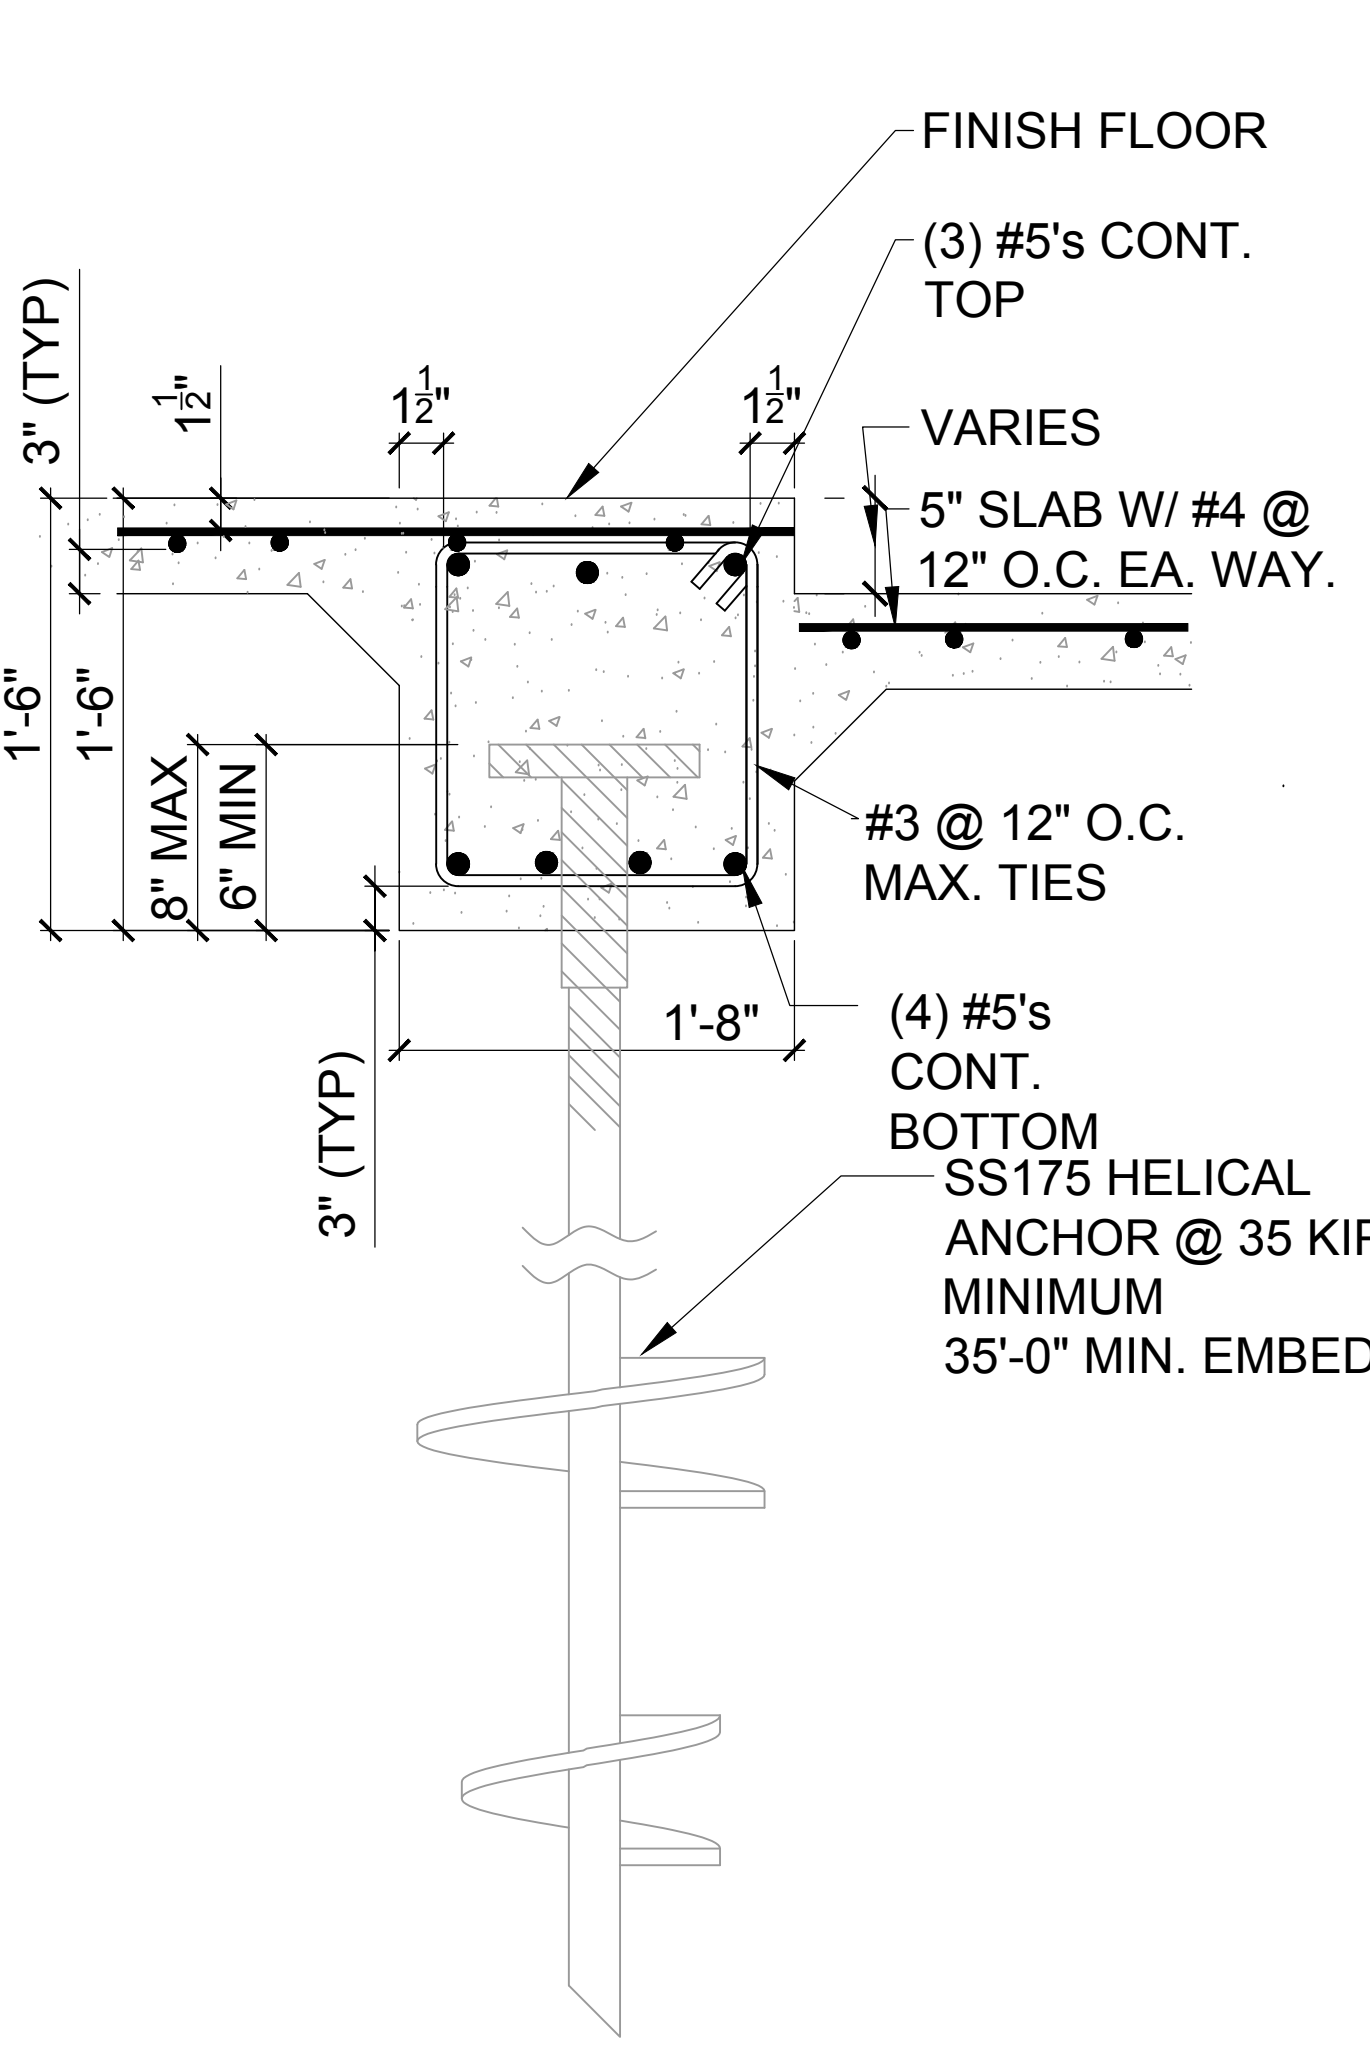

BEARING FOOTER @ STEPPED SLAB SECTION
 5
 D6 N.T.S.

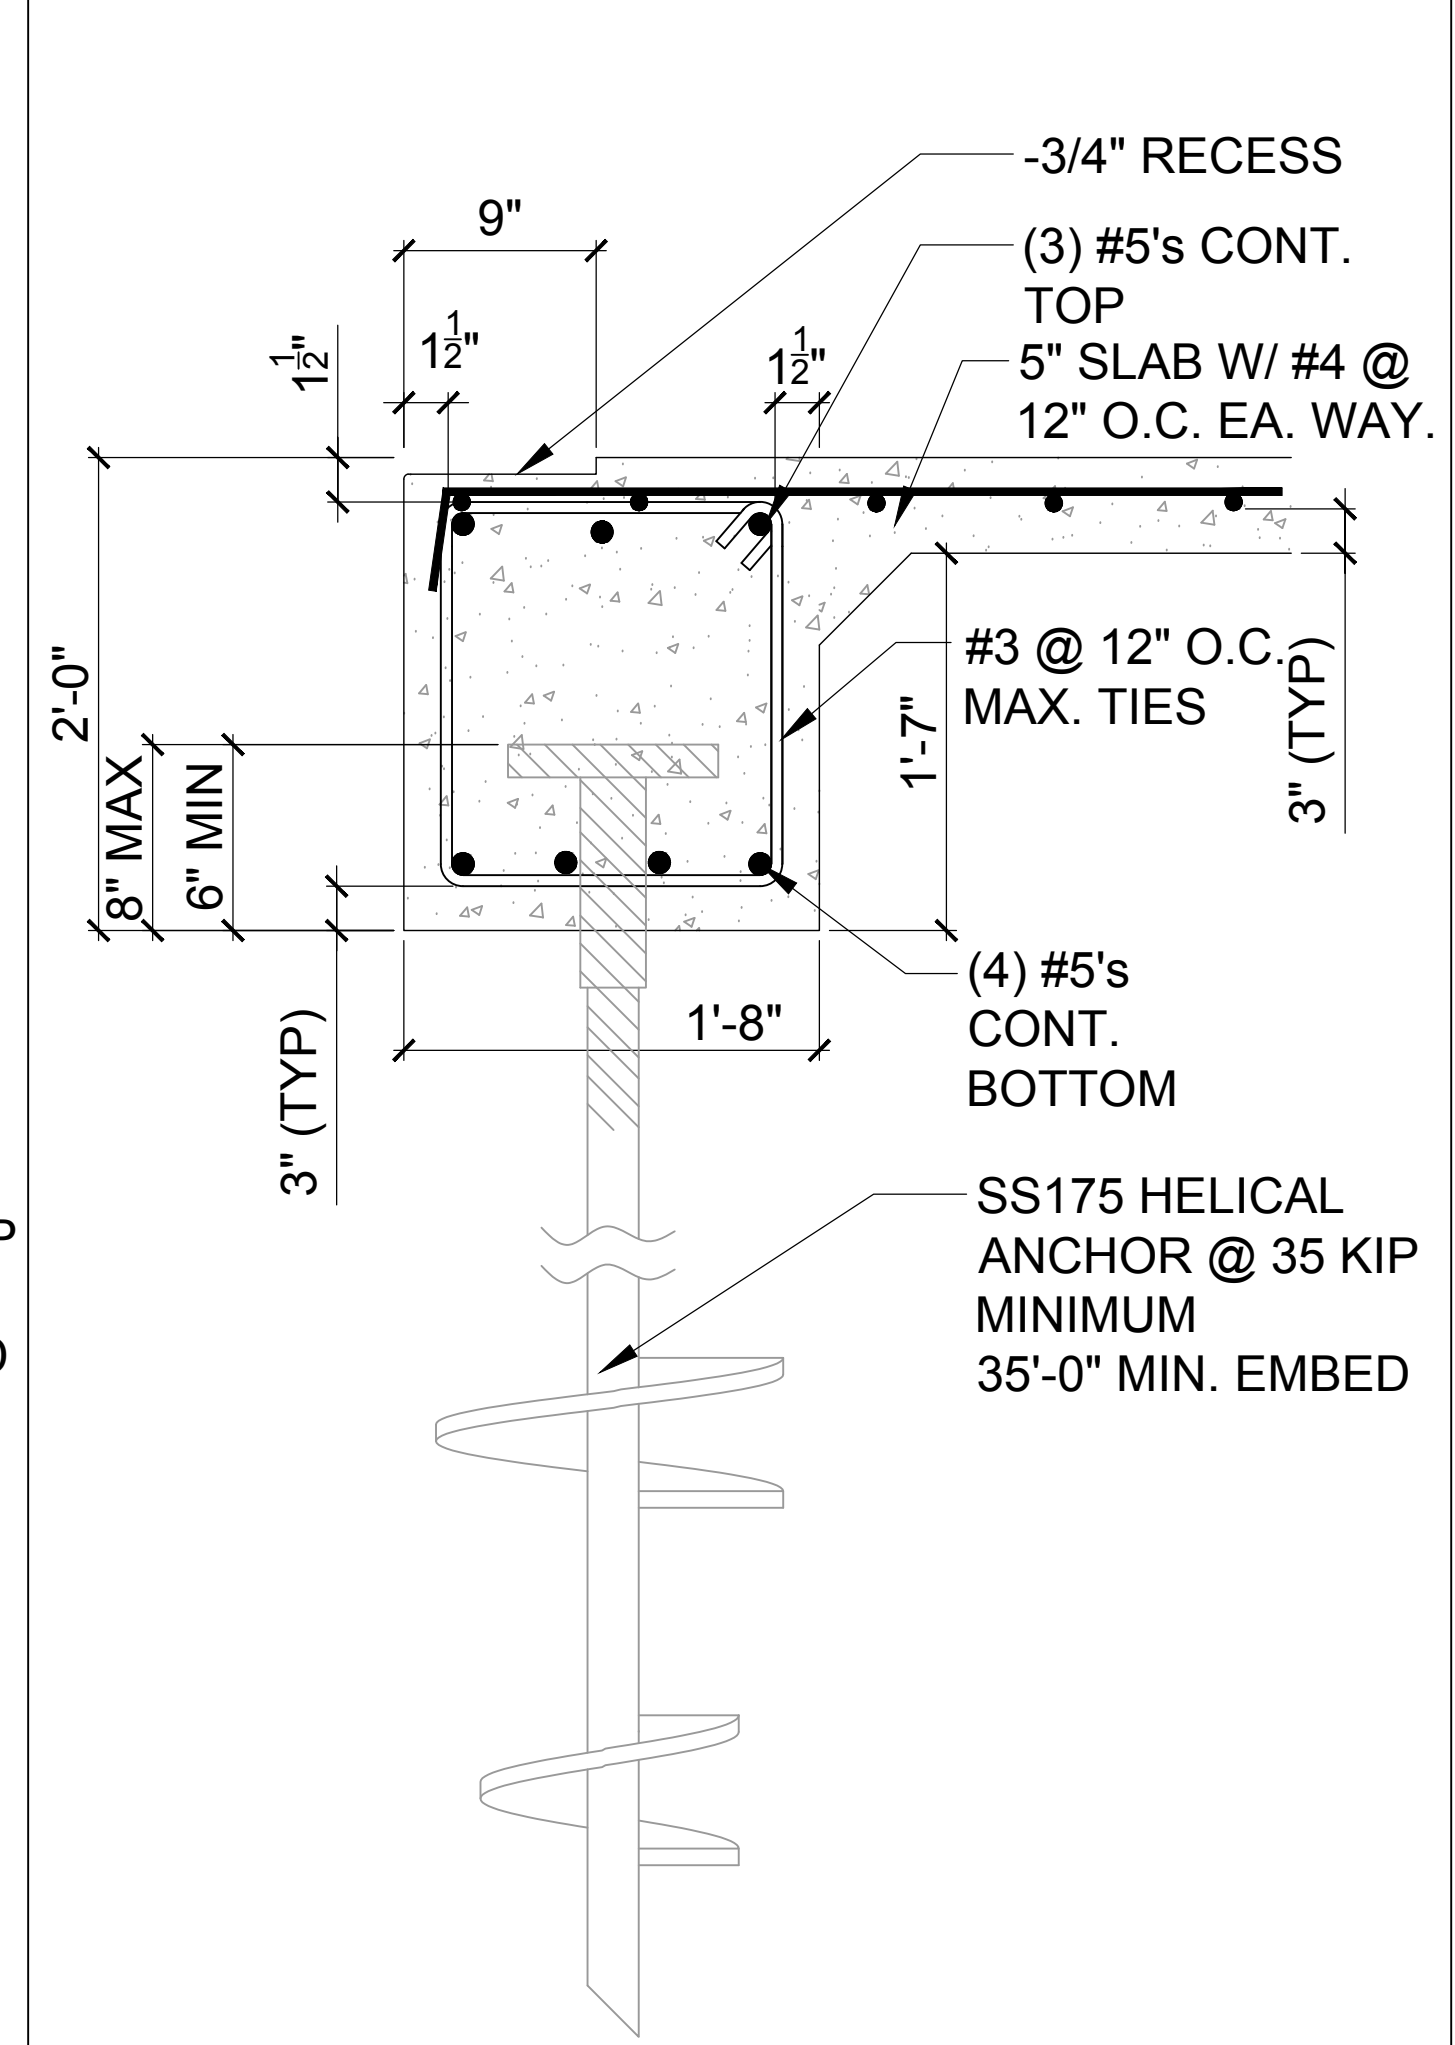

BEARING FOOTER @ CONCRETE RECESS SECTION ONE-STORY DET.
 3
 D6 N.T.S.

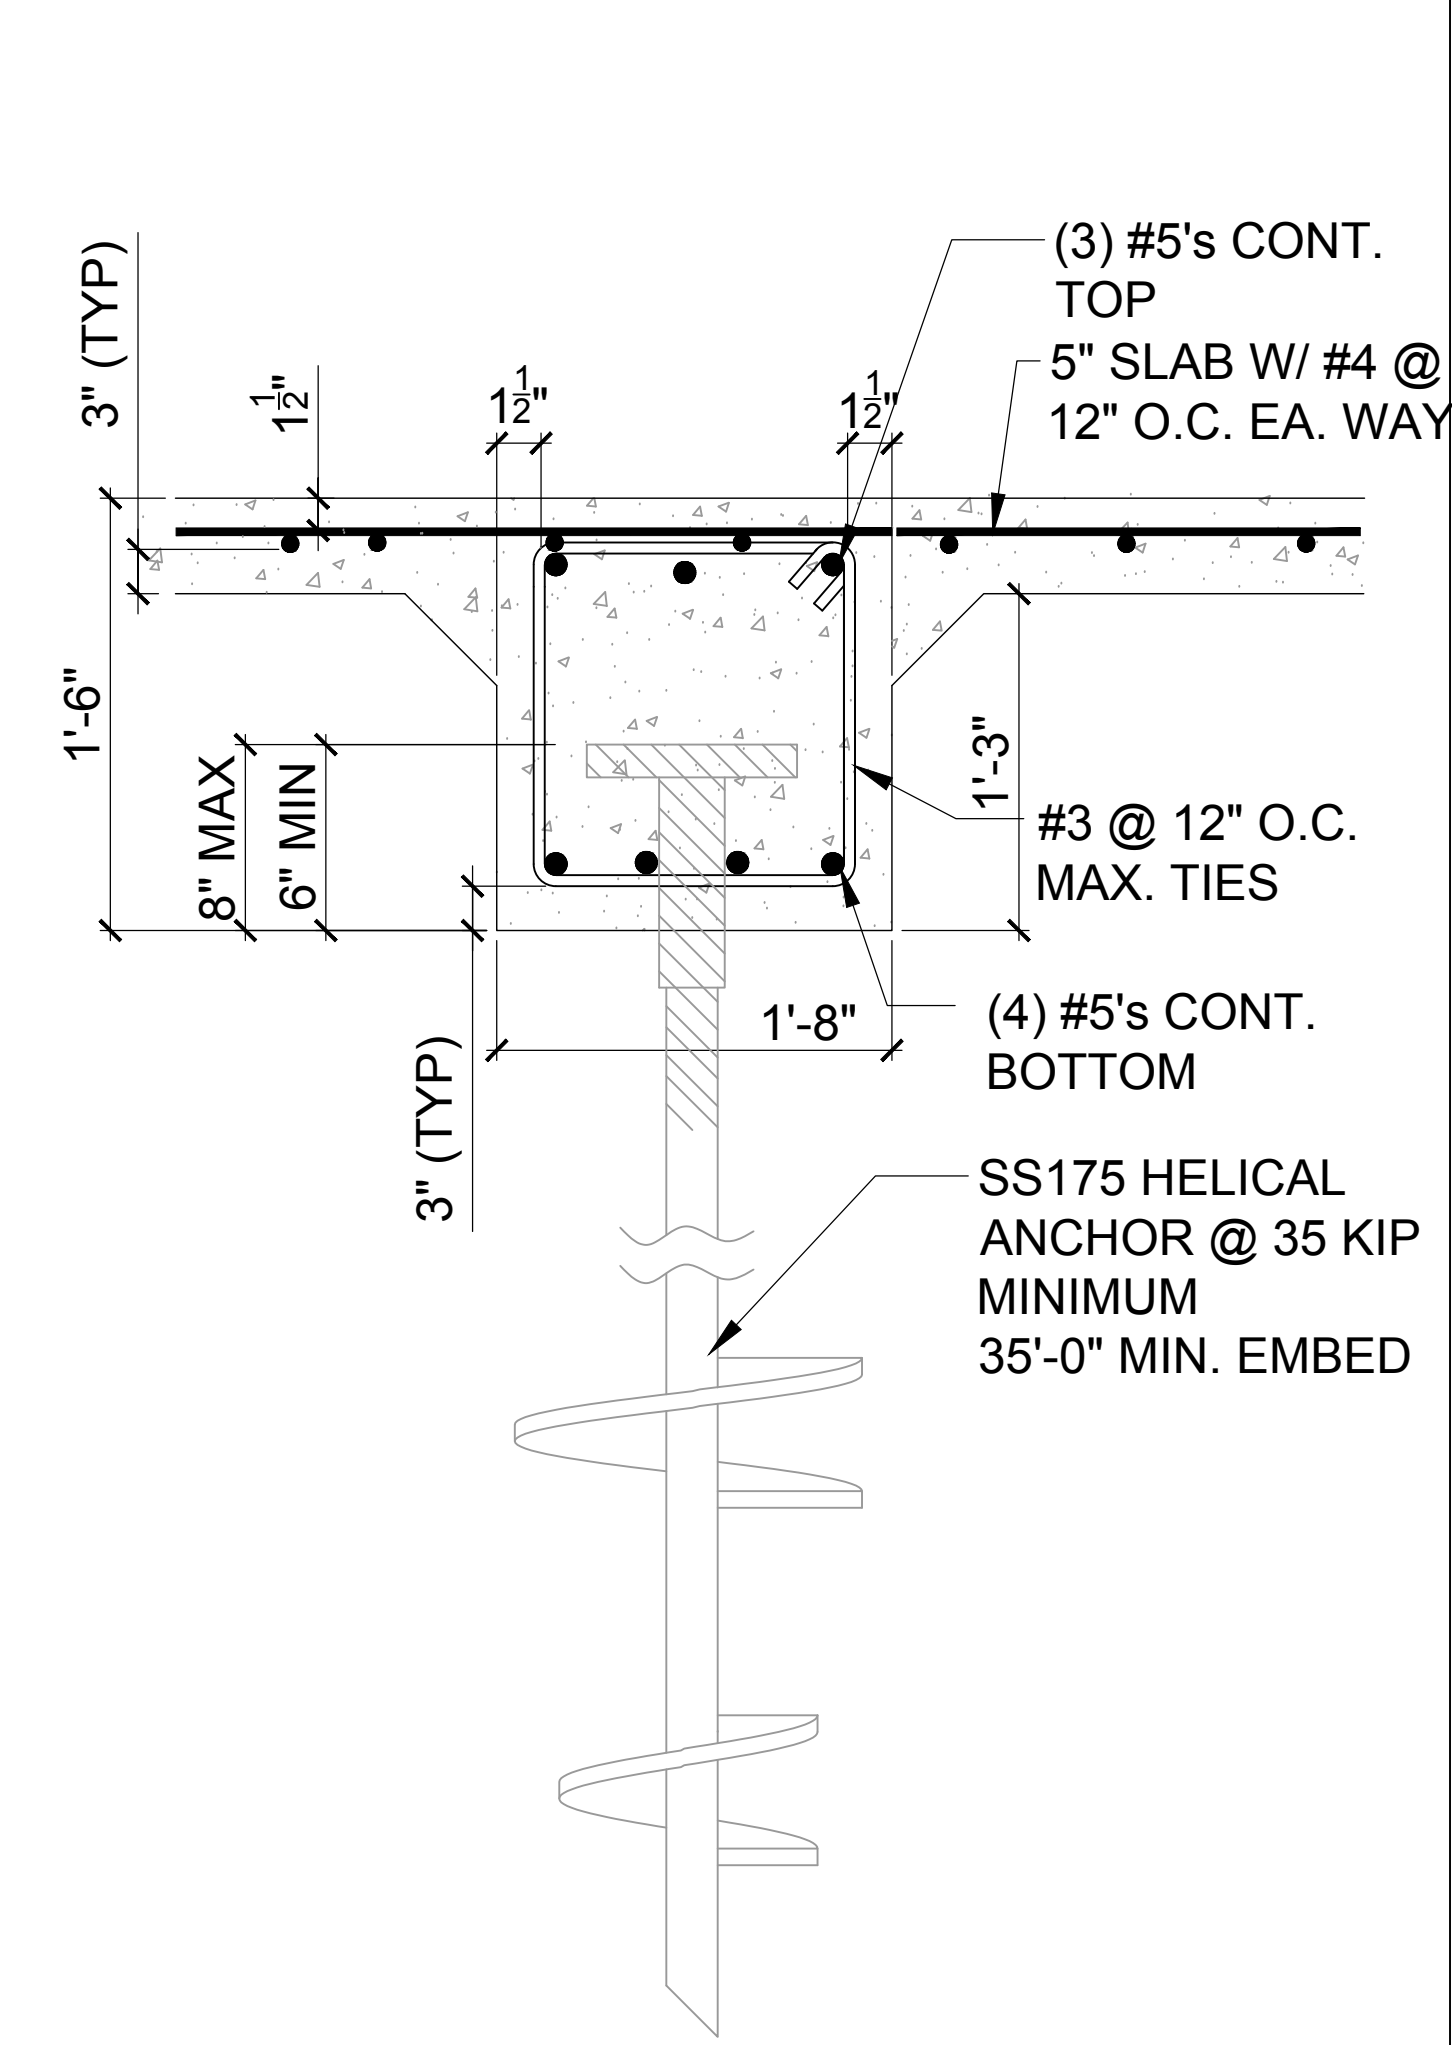

GRADE BEAM GB-20\"/>